













EXISTING PARTITION TYPE LEGEND

CONTRACTOR TO MODIFY EXISTING PARTITION FROM CEILING TO DECK TO CONFORM WITH PARTITION TYPE 'UL #465. CONTRACTOR ALSO, TO INSPECT AND SURVEY EXISTING CONDITION OF PARTITION AND PERFORM ALL WORK TO MAINTAIN REQUIRED FIRE RATING FROM FLOOR TO STRUCTURE ABOVE. CONTRACTOR TO USE MATERIALS IDENTICAL TO EXISTING MATERIALS OR MATERIALS WHOSE INSTALLED PERFORMANCE WILL EQUAL OR SURPASS THAT OF PARTITION TYPE 'UL #465 MATERIALS.

TYPE F

EXIST. PARTITION MODIFIED TO A 1 HOUR SMOKE BARRIER

- PARTITION TYPES GENERAL NOTES**
1. ALL FIRE RATED AND SMOKE BARRIER PARTITIONS MUST BE INSTALLED PER THEIR UL DESIGN NUMBERS.
 2. INSTALL FIRE SEALANT AROUND THE ENTIRE PERIMETER TO PREVENT THE PASSAGE OF SMOKE IN ALL RATED AND SMOKE PARTITIONS.
 3. INSTALL SOUND ATTENUATION BLANKET IN ALL PARTITIONS THAT FORM ANY PART OF THE ENCLOSURE OF THE FOLLOWING ROOMS: TOILET ROOMS, EXAM ROOMS, TREATMENT ROOMS, OFFICES AND MECHANICAL ROOMS. THESE PARTITIONS SHALL HAVE 3-1/2\"/>
 4. REPLACE 5/8\"/>
 5. FOR HEIGHTS UP TO AND INCLUDING 14'-0\"/>
 6. INSTALL SUPPLEMENTARY FRAMING, BLOCKING, AND BRACING IN PARTITIONS TO SUPPORT FIXTURES, EQUIPMENT SERVICES, HEAVY TRIM, GRAB BARS, TOILET ACCESSORIES, DOOR HARDWARE, FURNISHINGS, OR SIMILAR CONSTRUCTION COMPLY WITH DETAILS INDICATED AND WITH RECOMMENDATIONS OF 'GYPSUM CONSTRUCTION HANDBOOK'.
 7. WHEN INFILLING OR BUTTING EXISTING PARTITIONS CONTRACTOR TO ADD AN ADDITIONAL LAYER OF GYPSUM WALLBOARD TO PARTITION TYPE AND/OR SKIM COAT WALL, AS REQUIRED TO PROVIDE A FLUSH SURFACE. THICKNESS OF GYPSUM WALLBOARD AND/OR STUD SIZE TO BE DETERMINED IN FIELD TO PROVIDE A FLUSH SURFACE.
 8. EXTEND ALL WALLS TO UNDERSIDE OF STRUCTURE ABOVE. PROVIDE SLIP TRACK AT TOP OR ANOTHER APPROVED METHOD TO ALLOW FOR A DEFLECTION OF THE STRUCTURE.
 9. ALL WALLS ARE TYPE 5 UNO. SEE ALSO ENLARGED PLAN FOR PARTITION TYPE INDICATIONS.

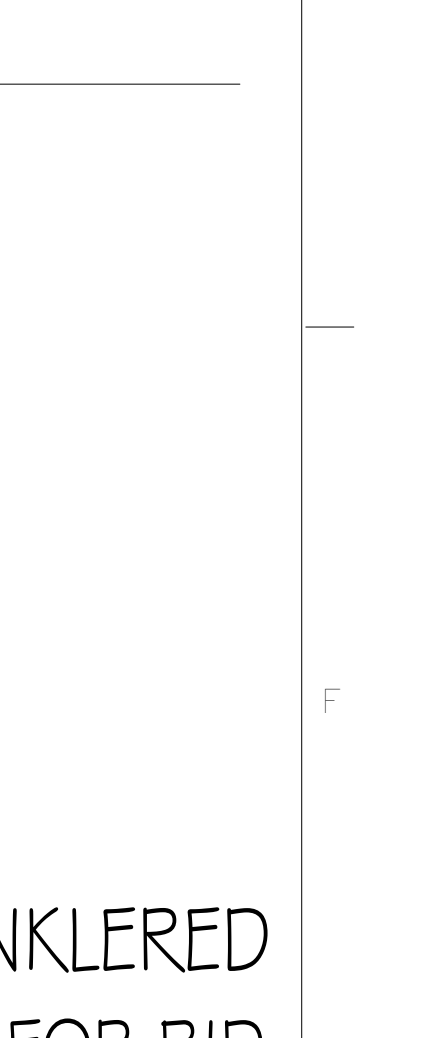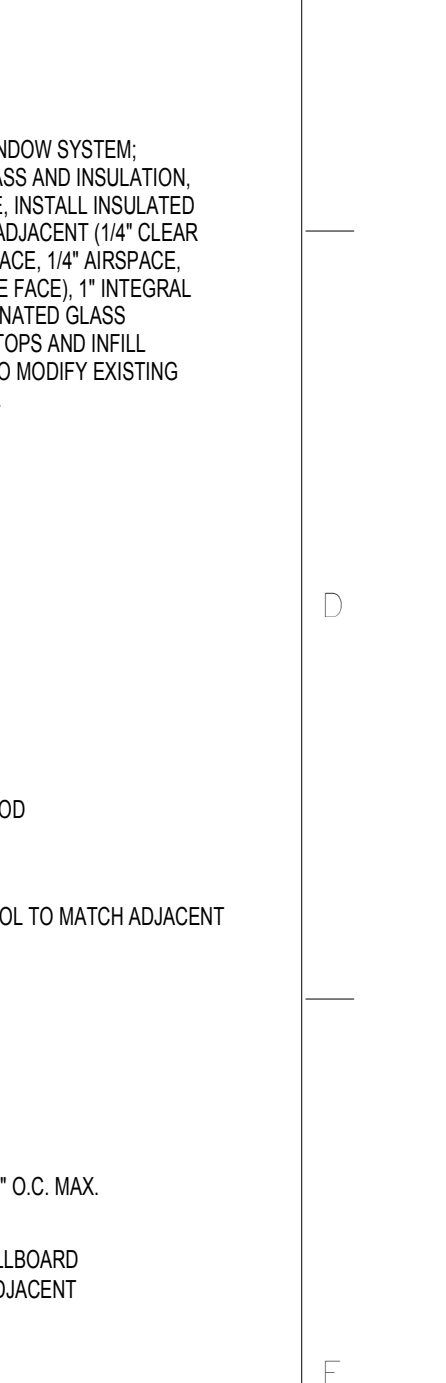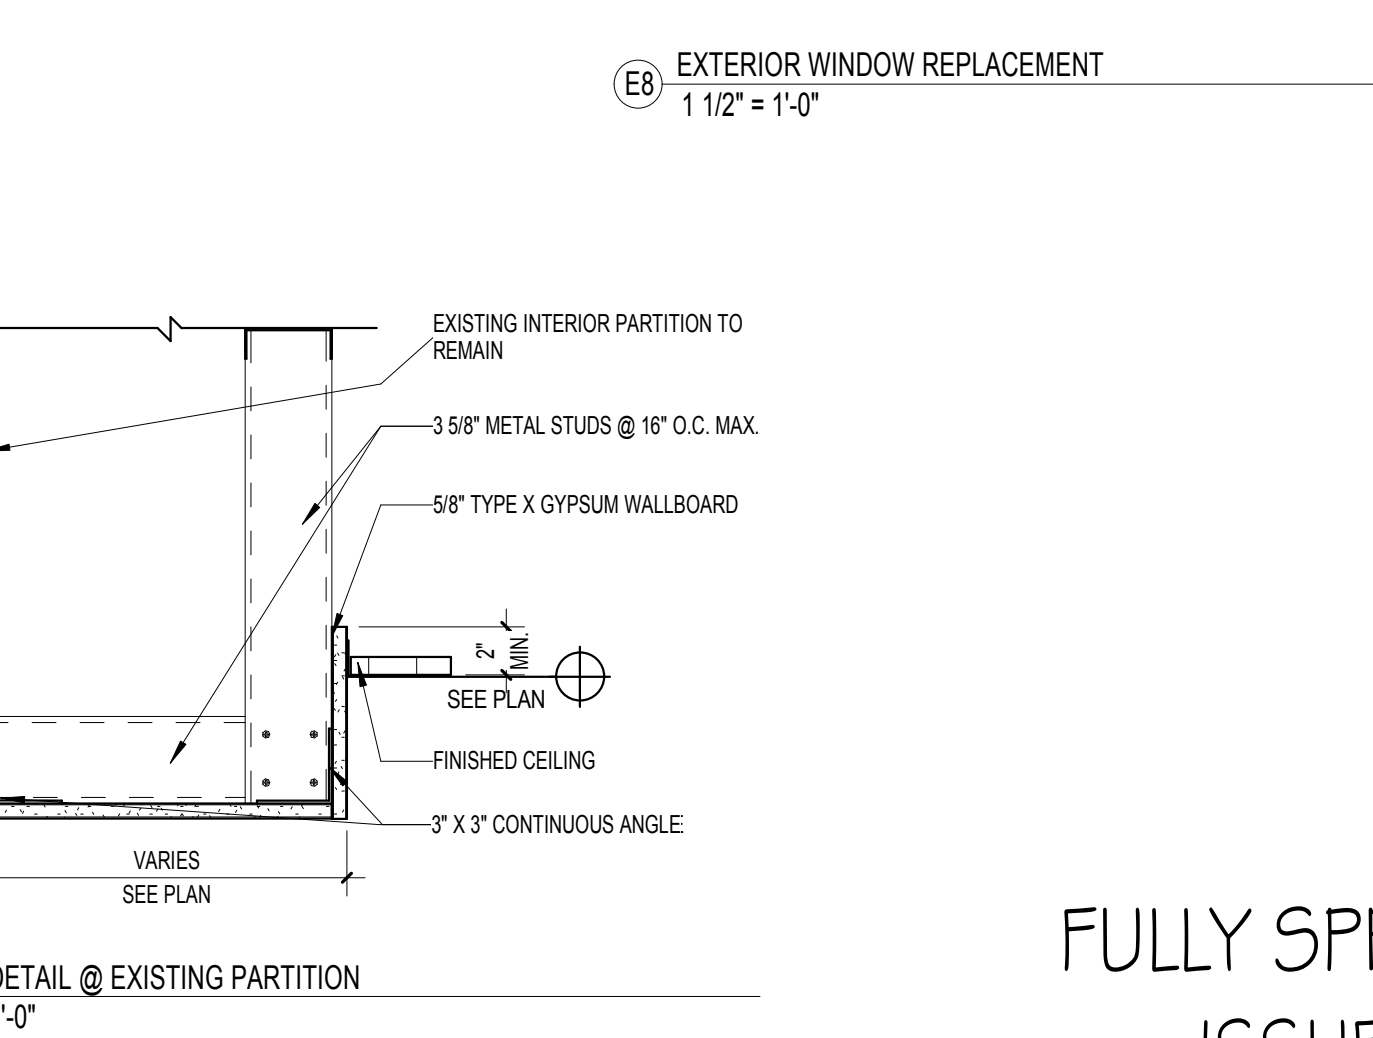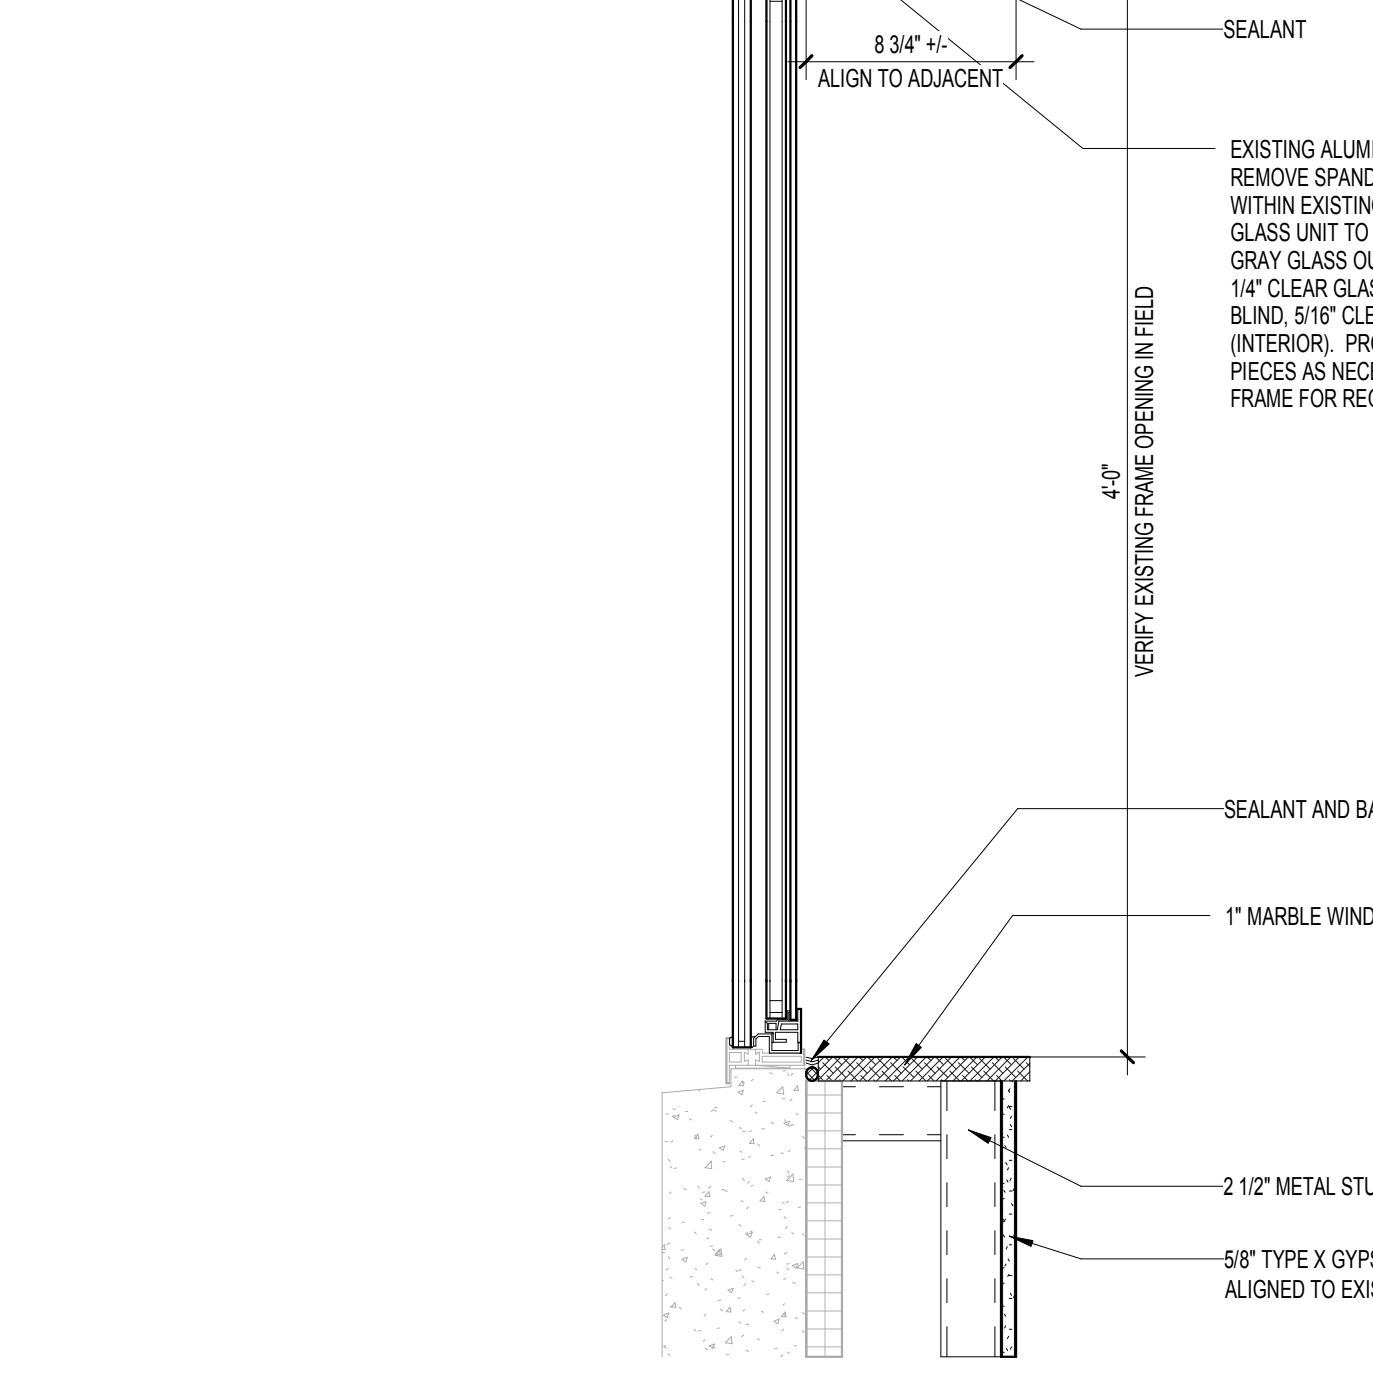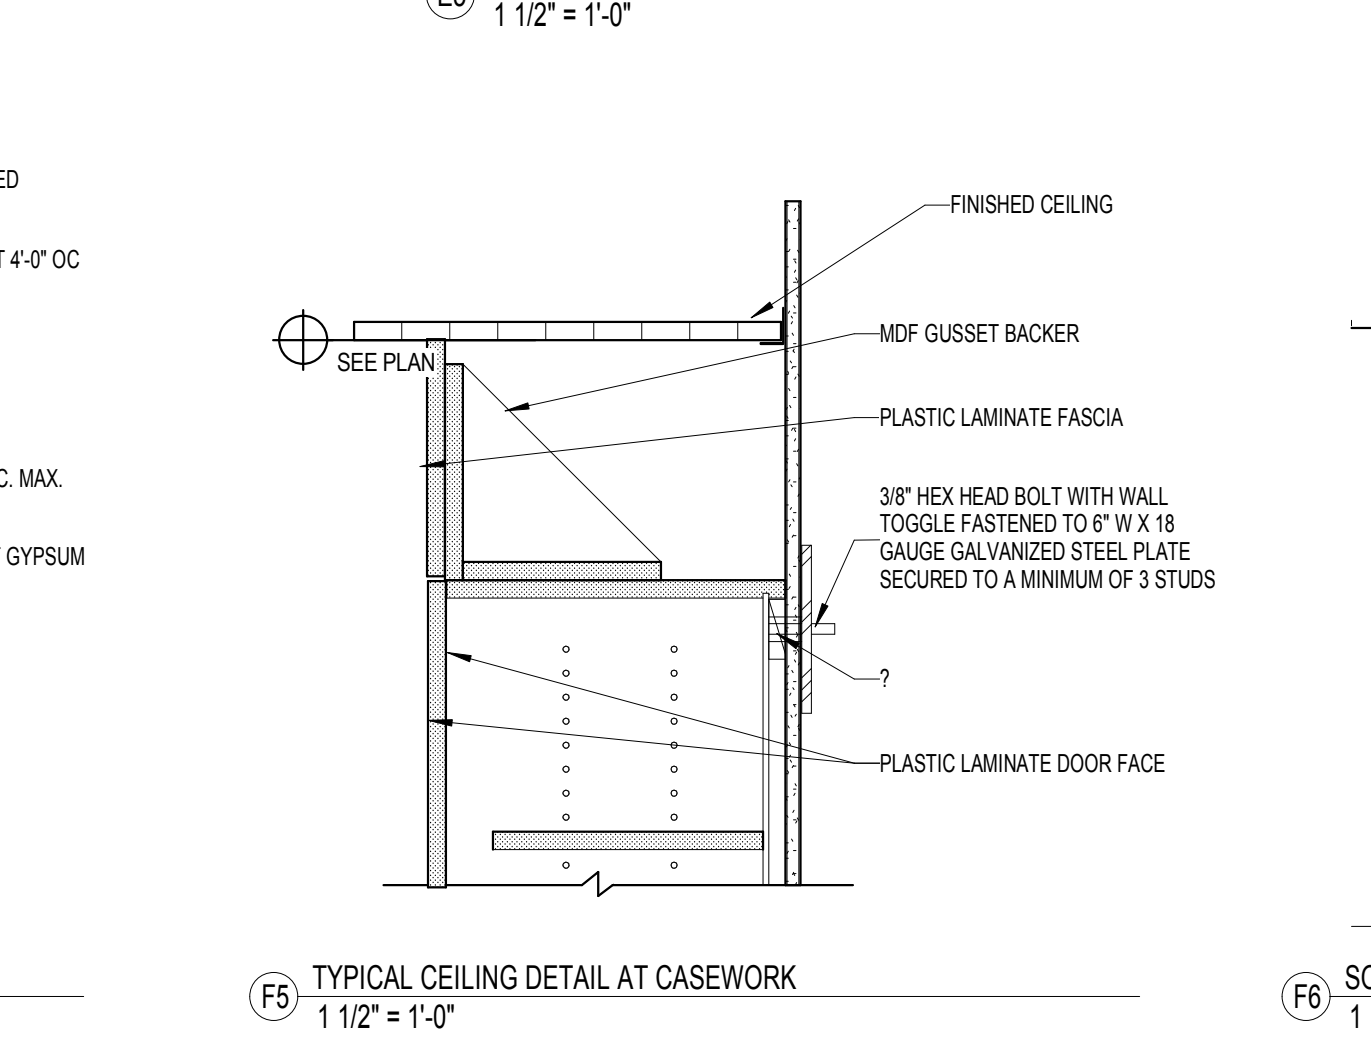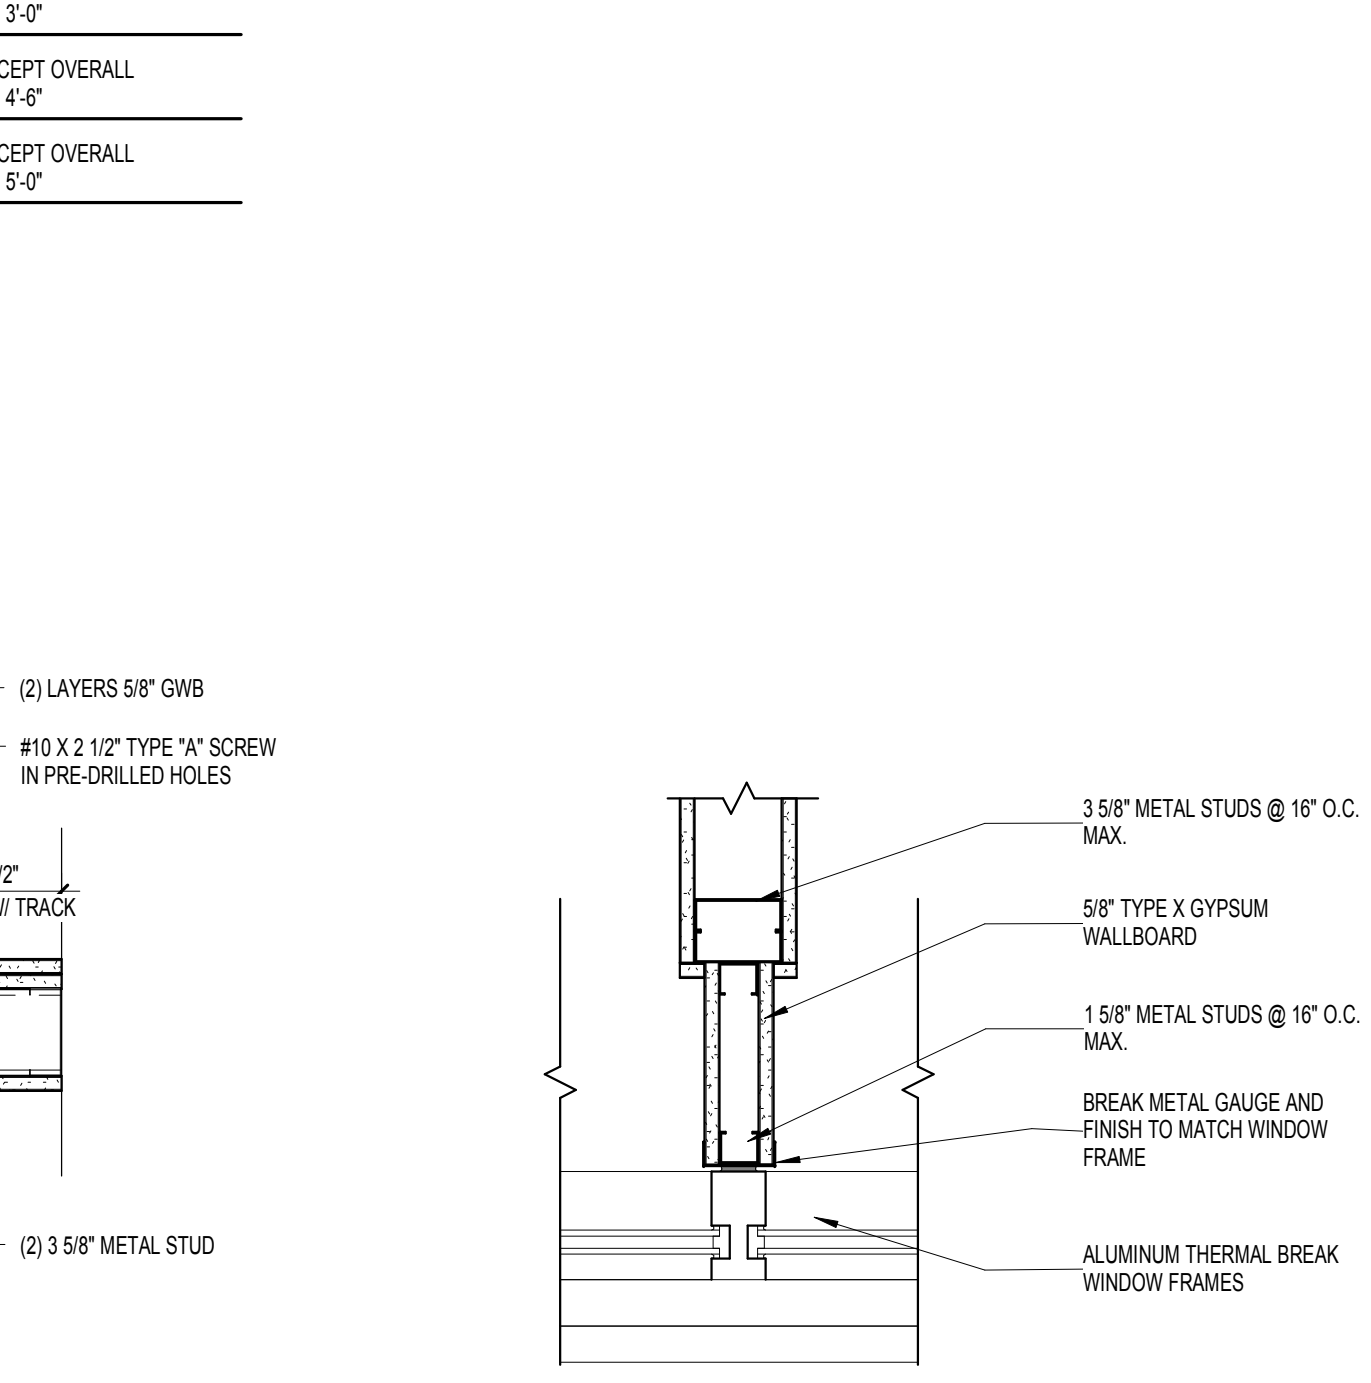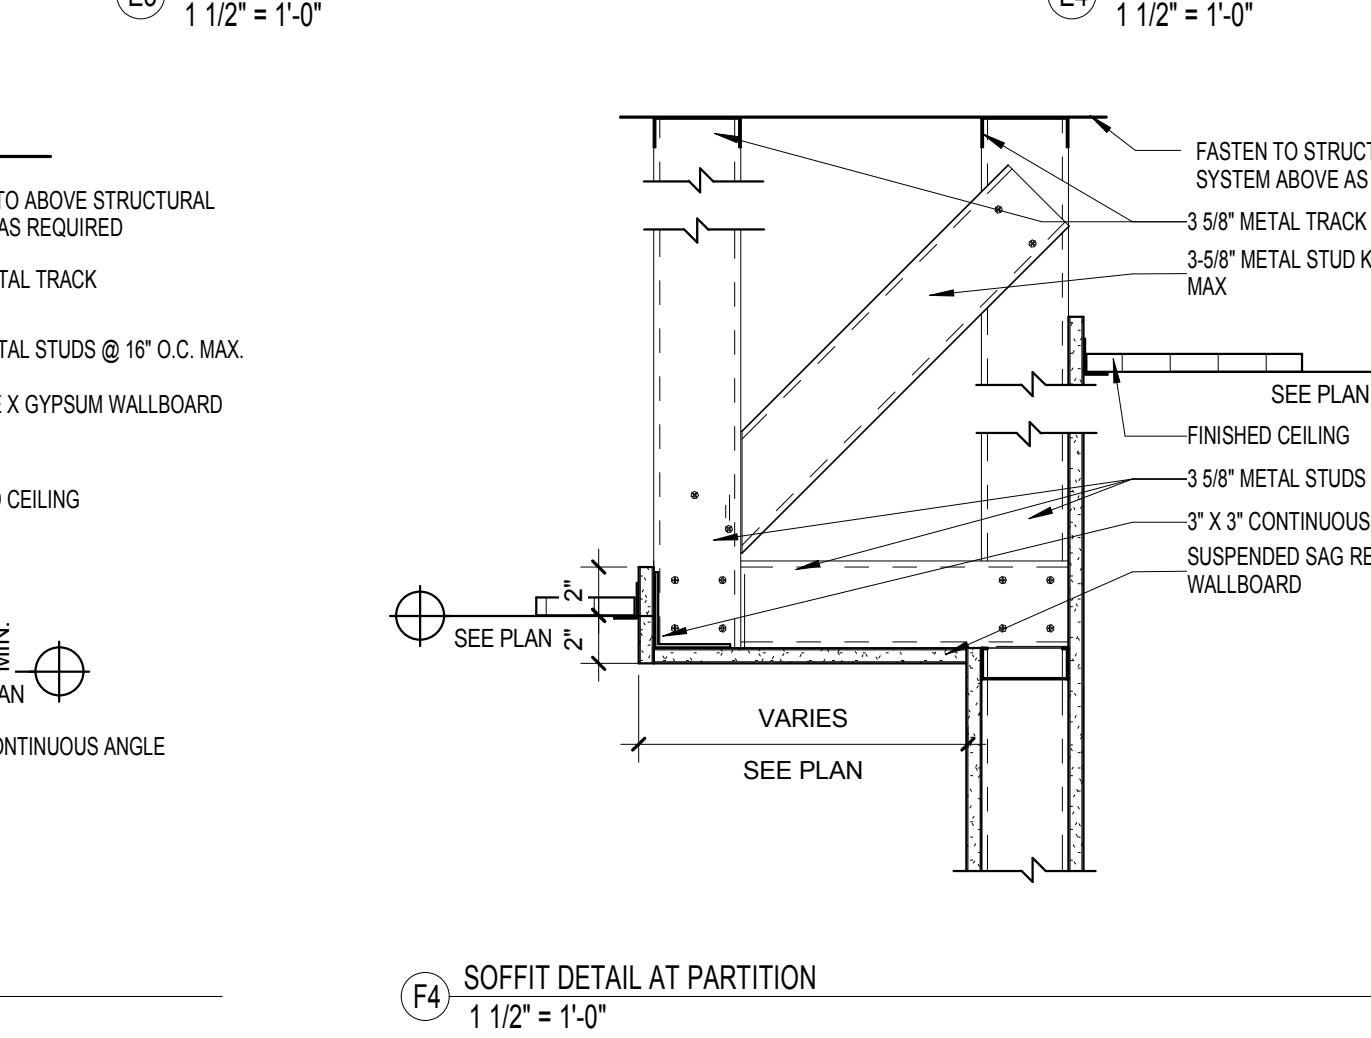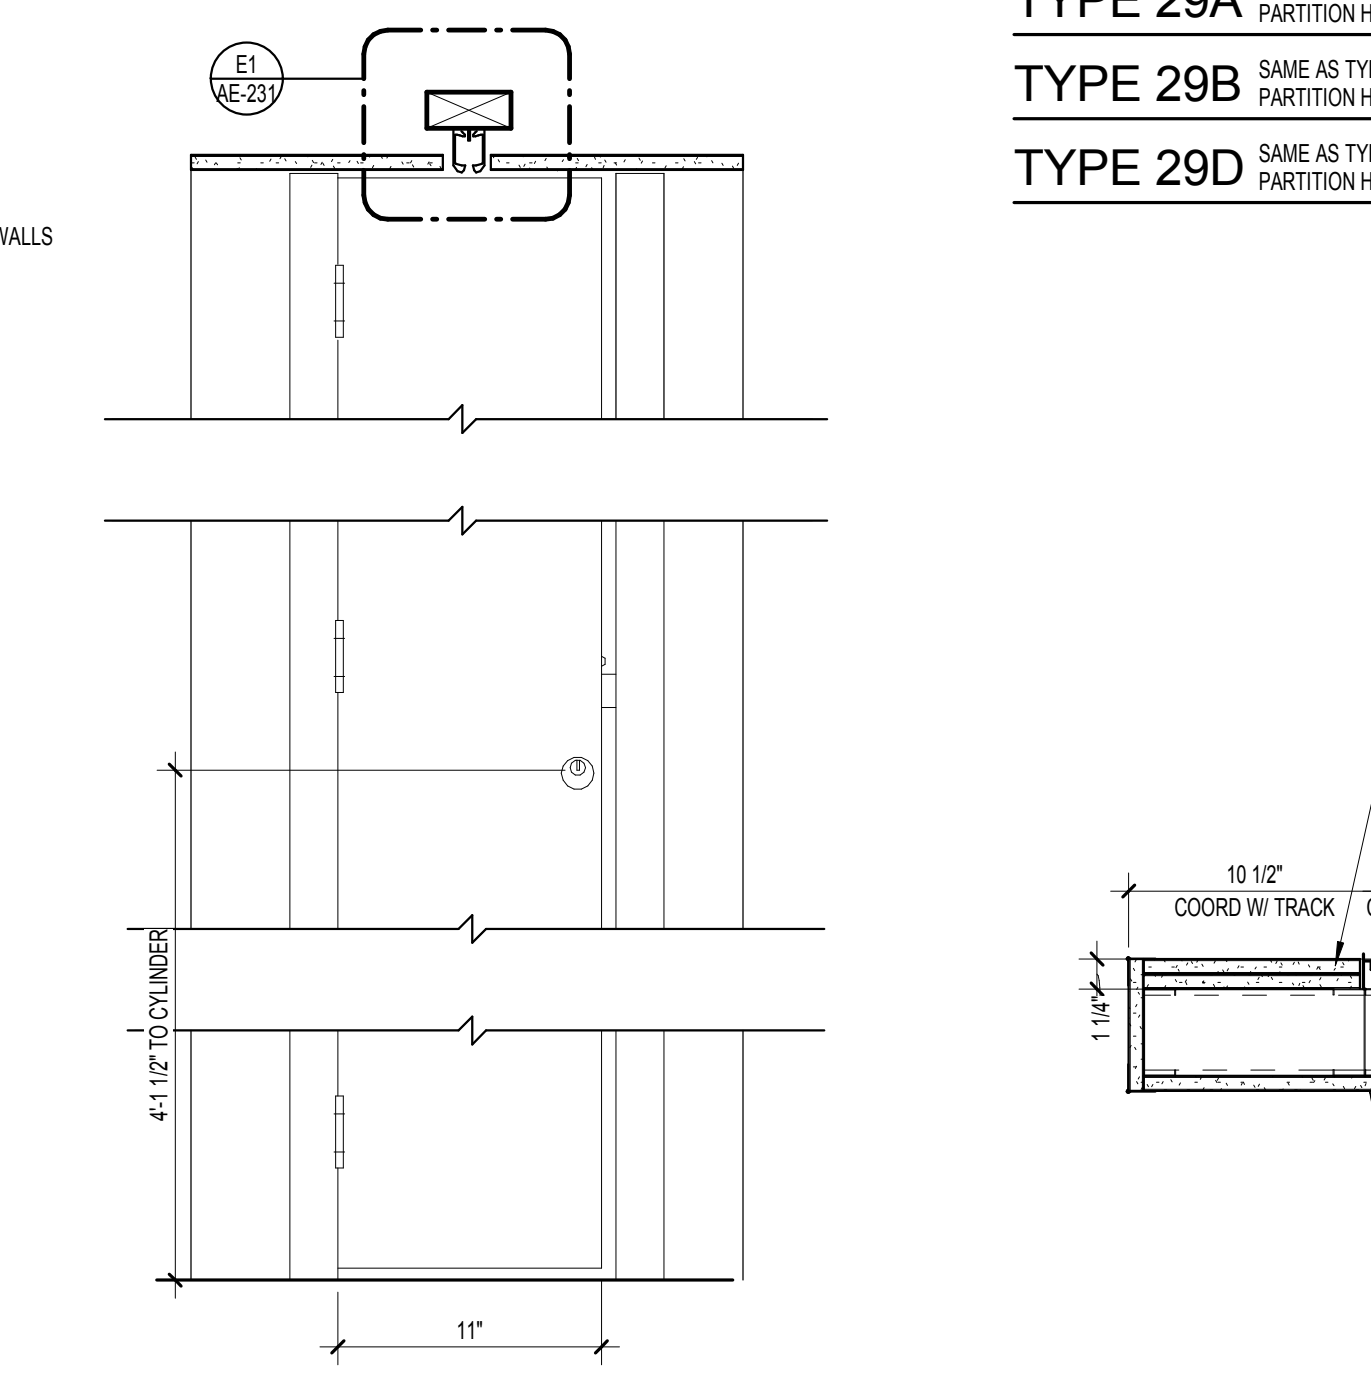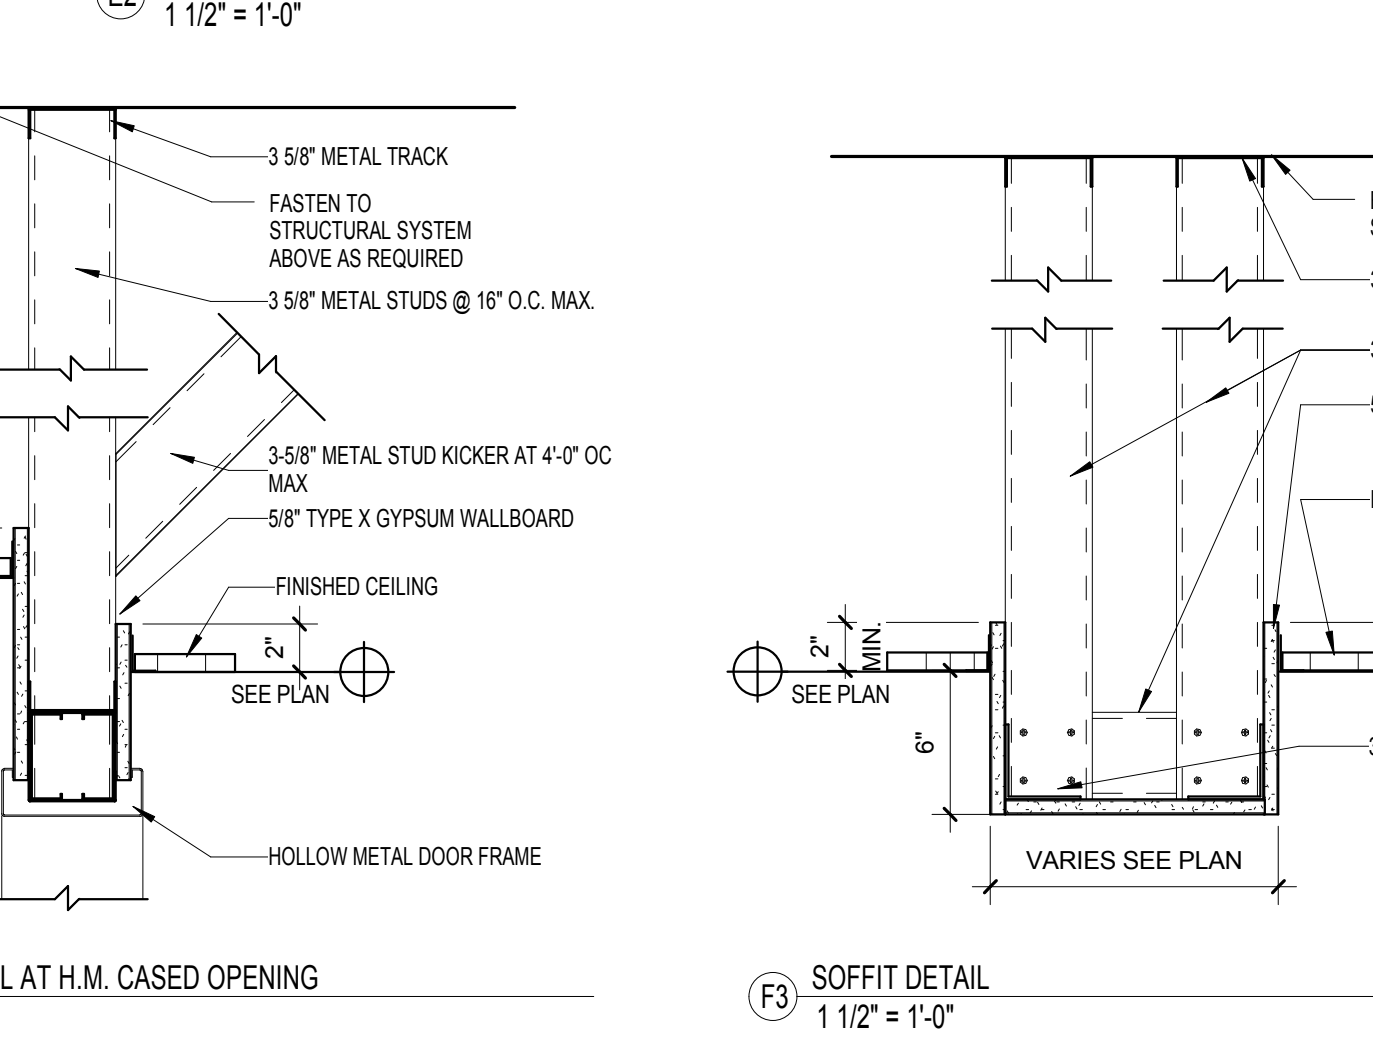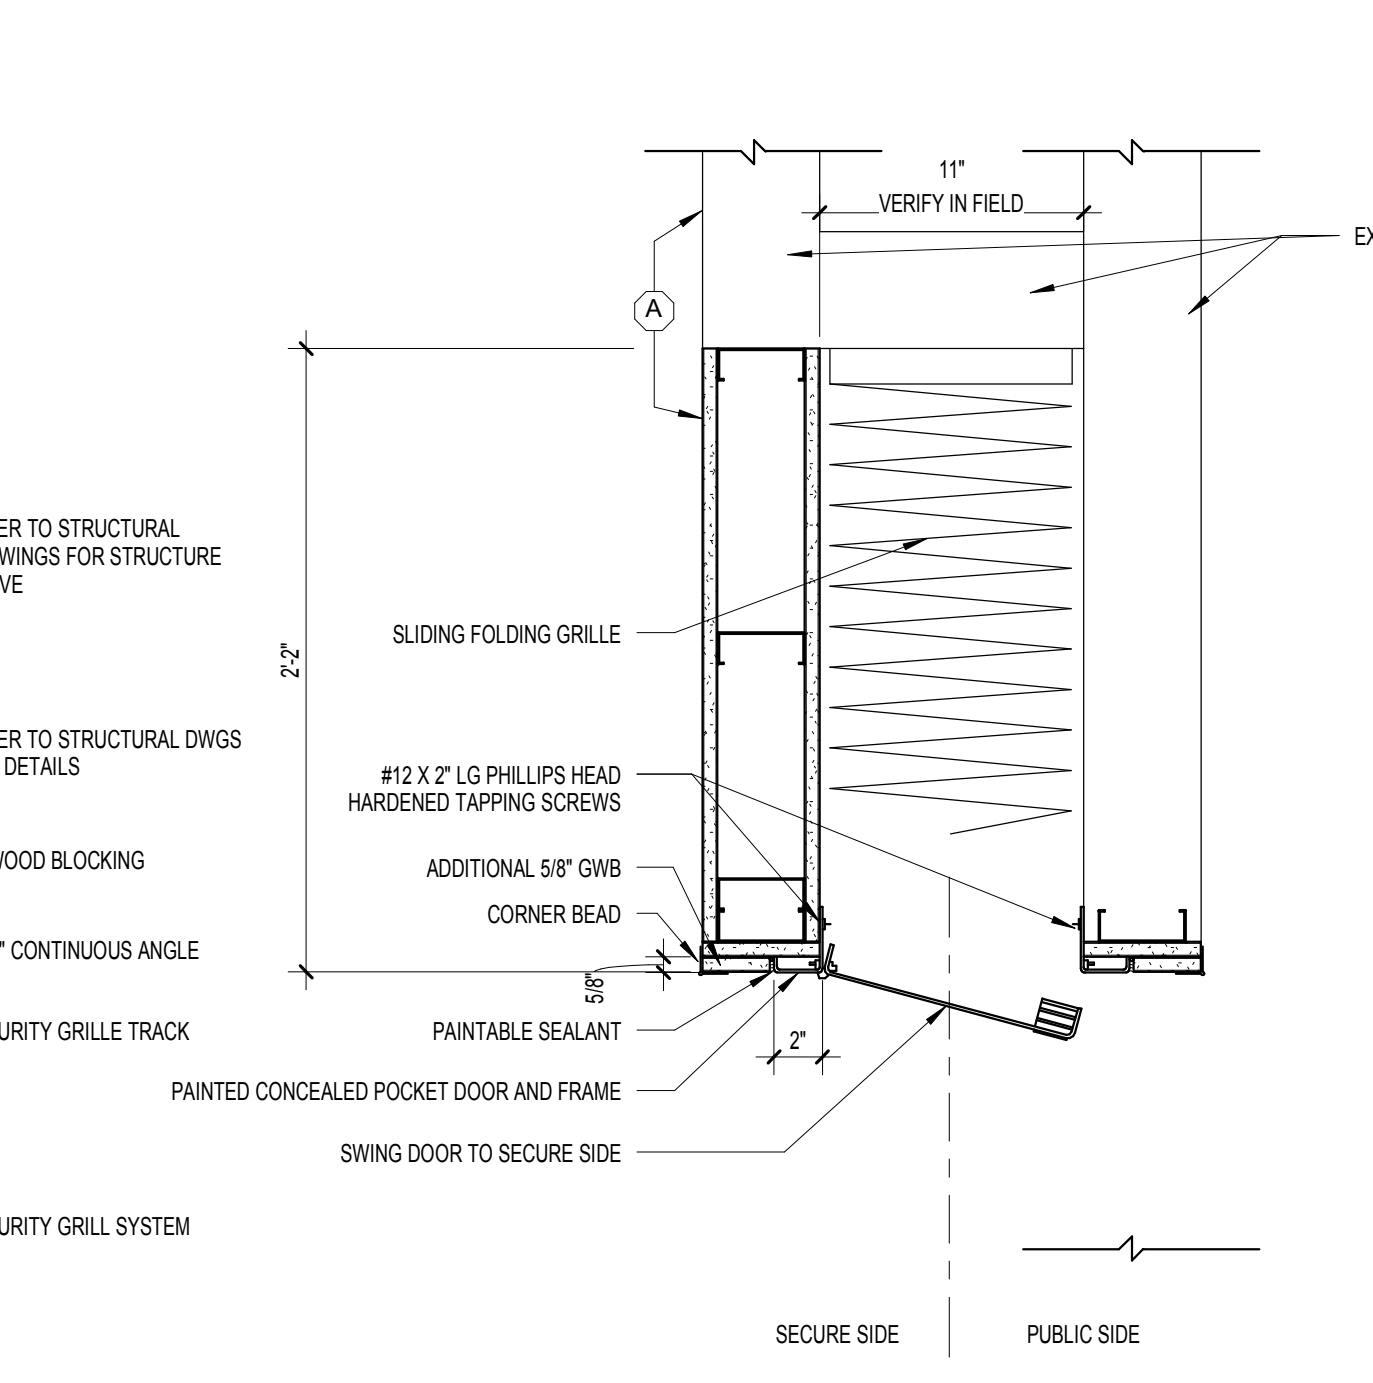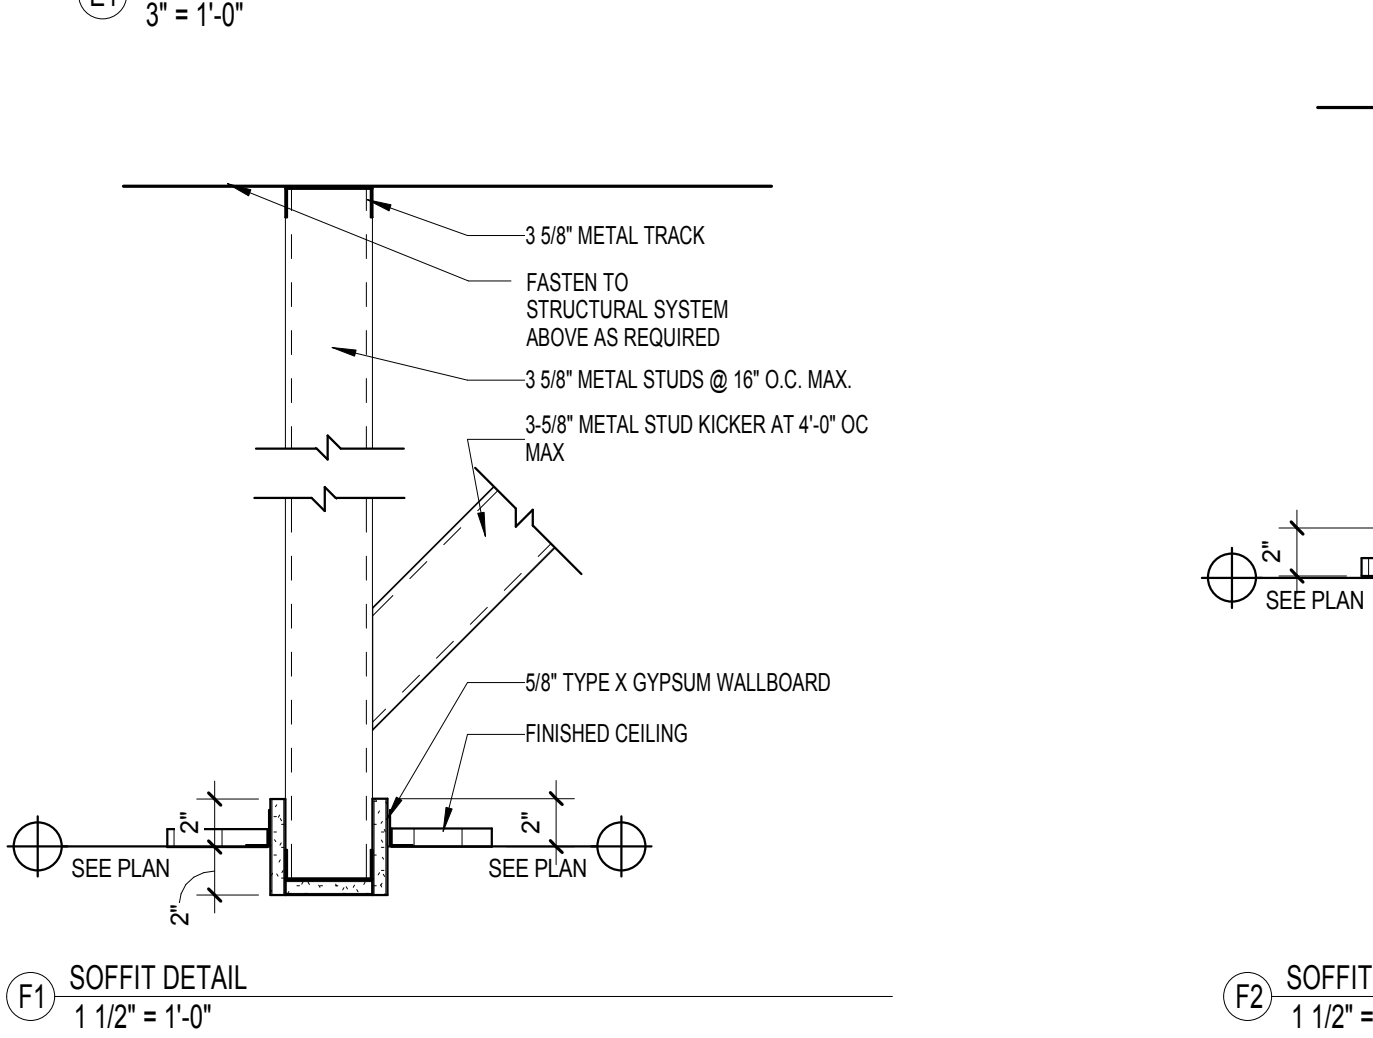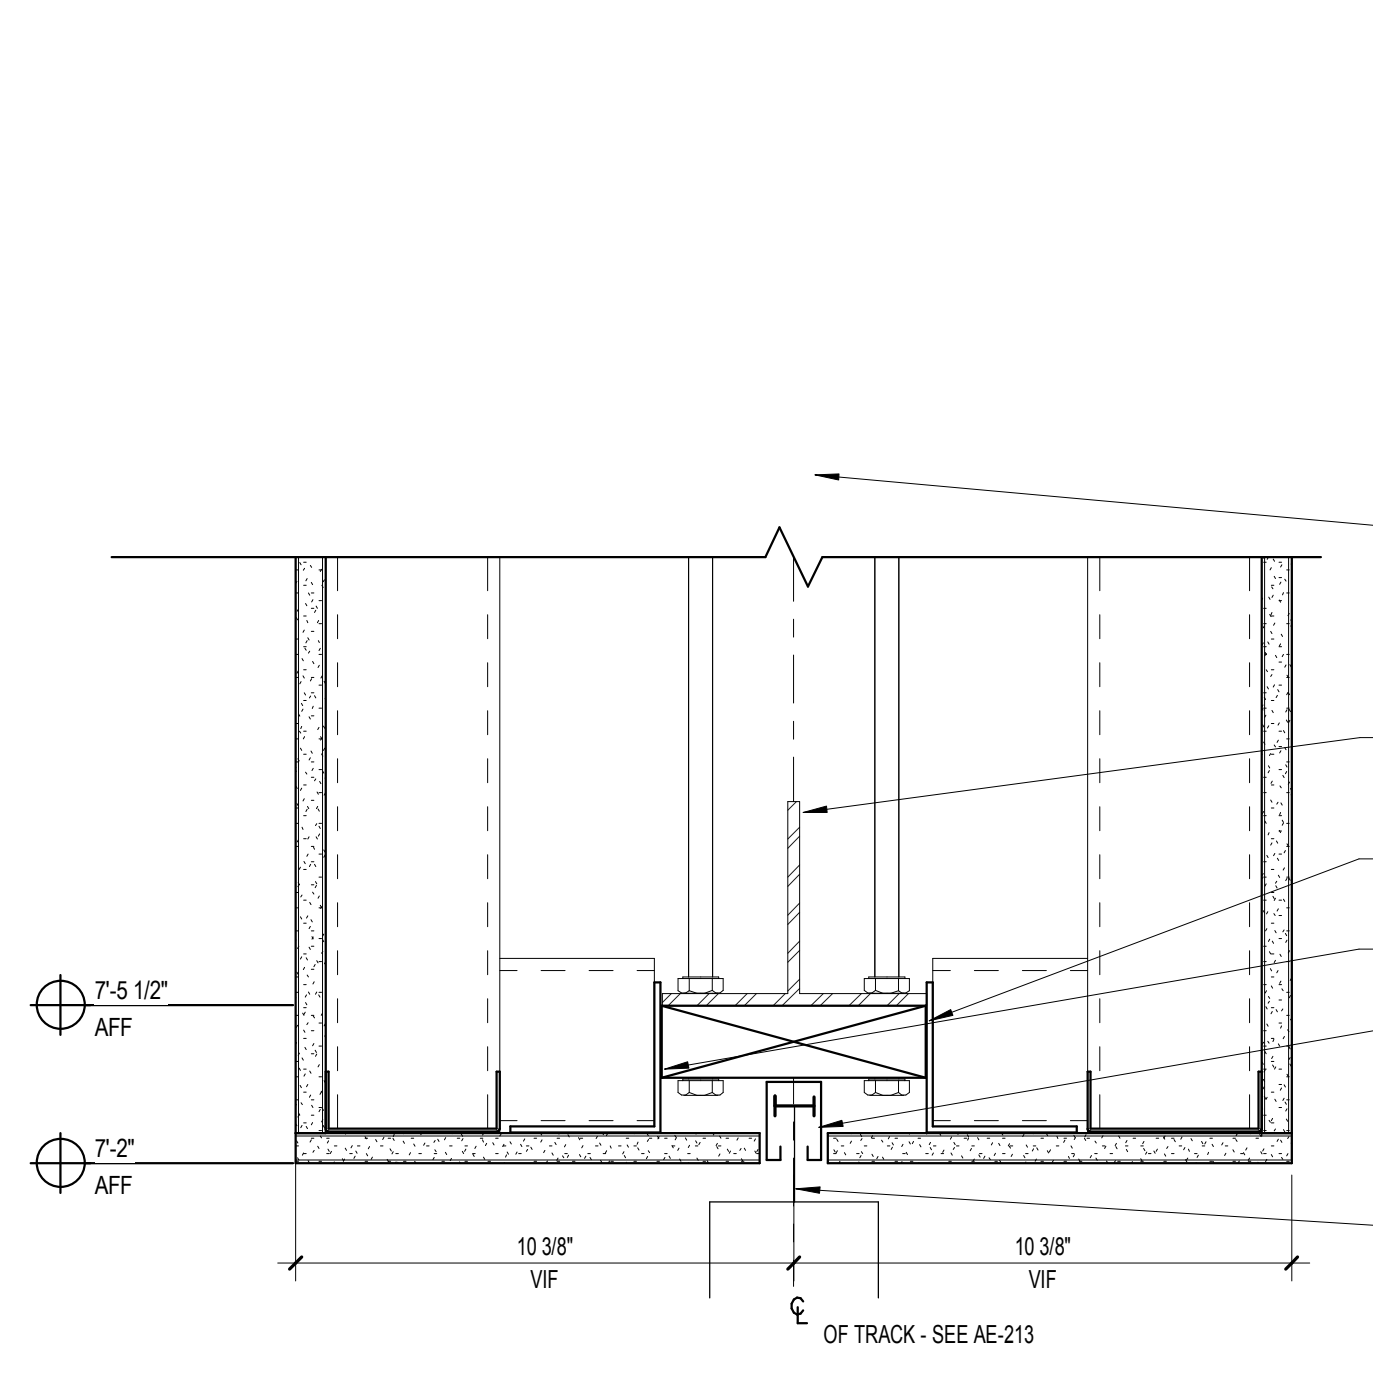

Revisions	

CONSULTANTS:

Lab Consultant HERA	MEP Engineer H.F. Lenz
-------------------------------	----------------------------------

230 S. Broad Street, Suite 201
Philadelphia, PA 19102
Tel: (215) 670-5333
Fax: (215) 670-5334

1407 Scalp Avenue
Johnstown, PA 15004
Tel: (814) 269-9360
Fax: (814) 269-9301

KEY PLAN:

ARCHITECT:

ARRAY

healthcare facilities solutions

Project Number
3515

Scale
As indicated

2520 Renaissance Boulevard, Suite 110
King of Prussia, PA 19406

t: 610.270.0599
f: 610.270.0995
www.arrayhfs.com

Drawing Title

DETAILS & PARTITION TYPES

Approved: Project Director

Project Title

REPLACEMENT OF AC-19 AND LABORATORY RENOVATION

Location
3900 WOODLAND AVENUE
PHILADELPHIA, PA 19104

Date
04-12-2012

Checked
WJ

Drawn
EN

VA Project Number
VA244-P-1786

Building Number
2

Drawing Number
AE-231

Dwg. of

Office of Facilities Management

Department of Veterans Affairs

**FULLY SPRINKLERED
ISSUED FOR BID**