




*NOTE: WHEN USED ON THE HIGH SIDE OF THE ROADWAYS, THE CROSS SLOPE OF THE GUTTER SHALL MATCH THE CROSS OF THE ADJACENT PAVEMENT AND THE THICKNESS OF THE LIP SHALL BE 6", UNLESS SHOWN OTHERWISE ON THE PLANS.

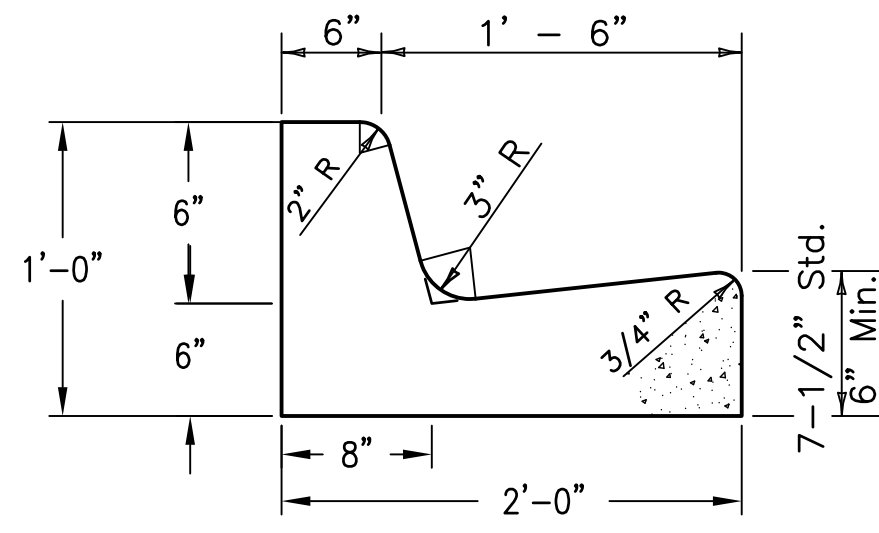


A1 TYPE "F" CURB & GUTTER DETAIL
CS101 N.T.S.

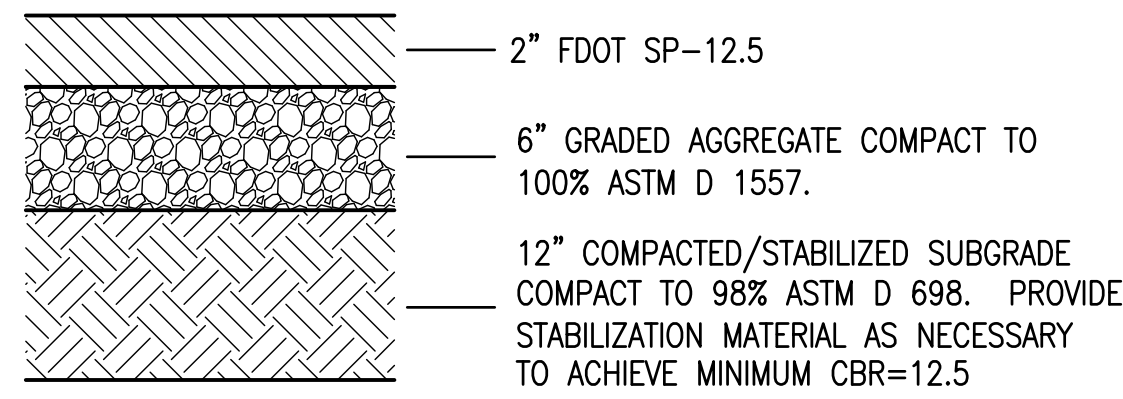


B1 LIGHT DUTY ASPHALT PAVEMENT SECTION
CS101 N.T.S.

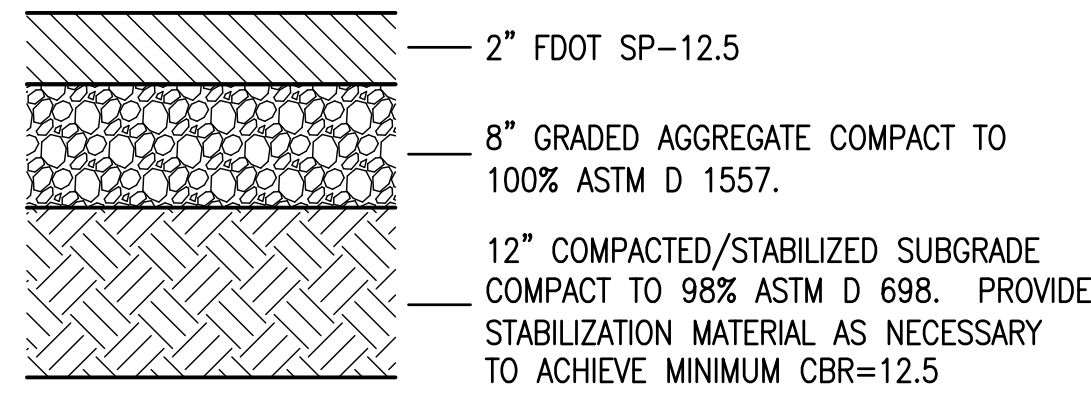


D1 MEDIUM DUTY ASPHALT PAVEMENT SECTION
CS101 N.T.S.

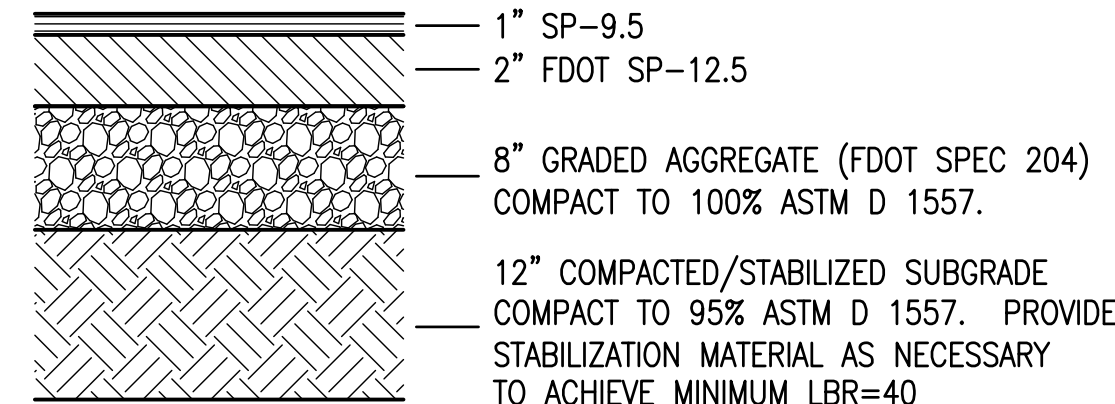


E1 MAGNOLIA BEACH ROAD ASPHALT PAVEMENT SECTION
CS110 N.T.S.
CG111

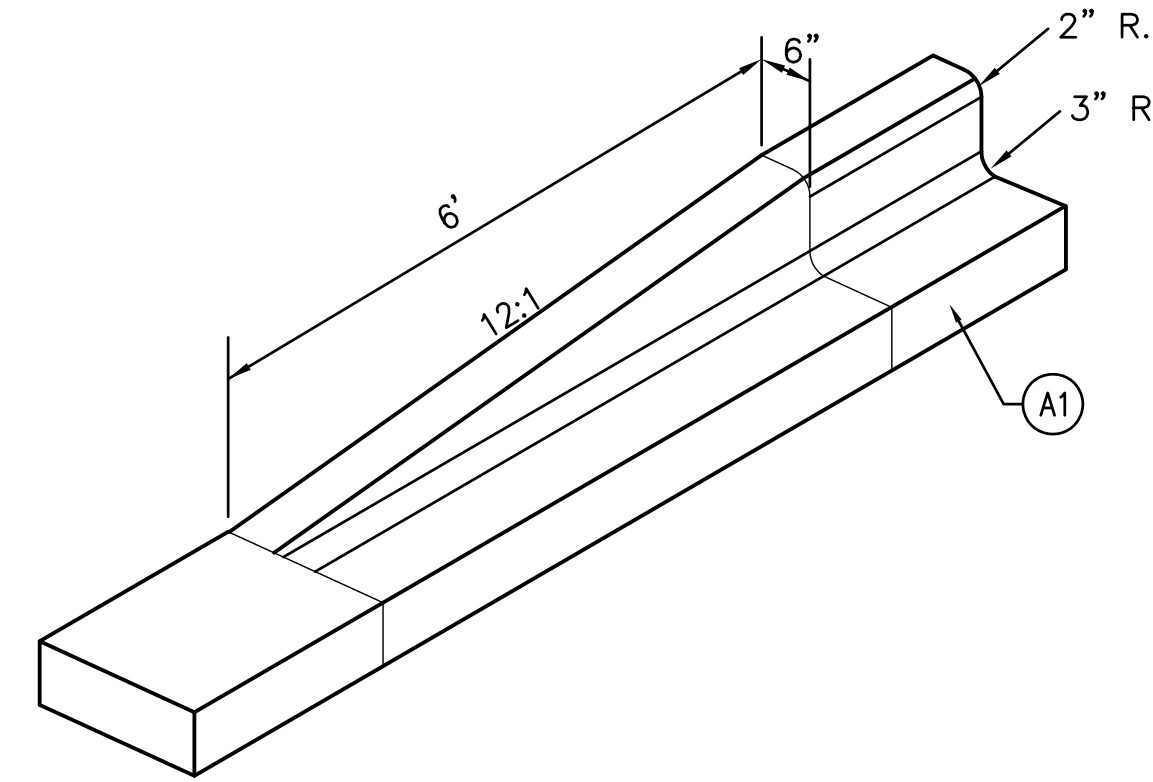


A3 TYPE "F" CURB TRANSITION DETAIL
CS101 N.T.S.

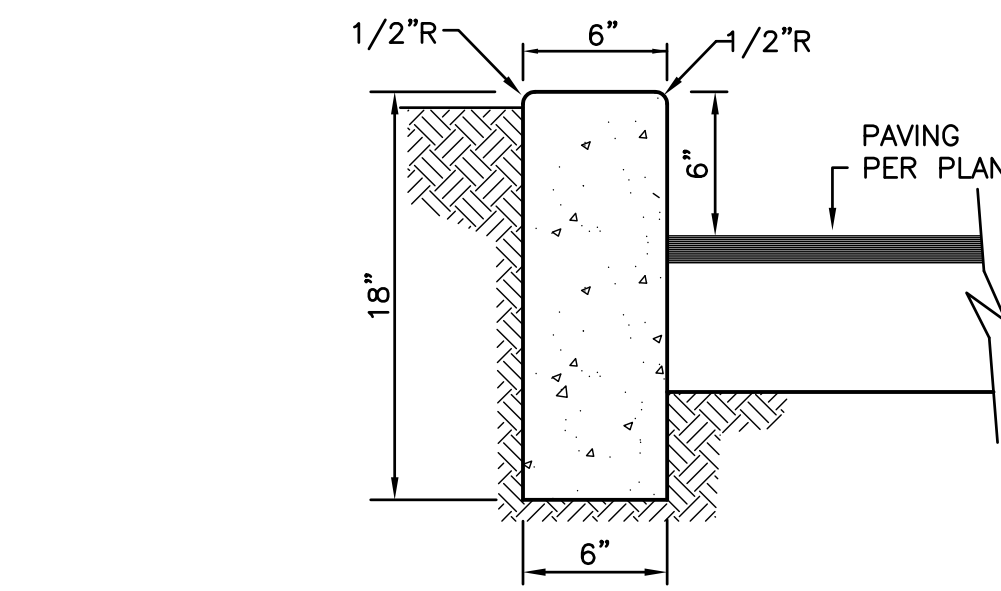


A5 6" VERTICAL CURB DETAIL
CS101 N.T.S.

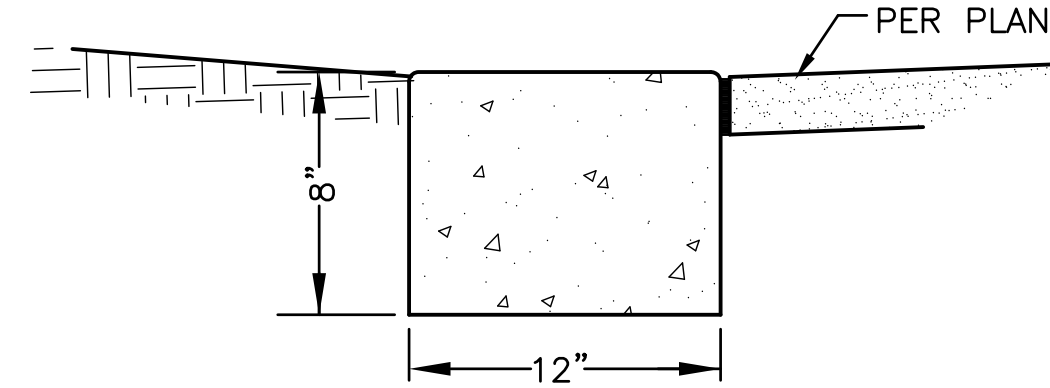


B5 RIBBON CURB DETAIL
CS101 N.T.S.

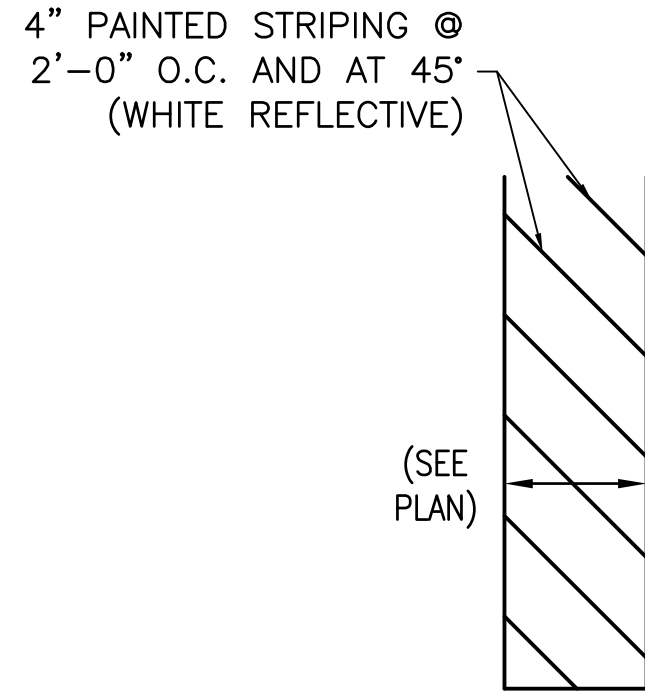


B4 AISLE STRIPING DETAILS
CS101 N.T.S.

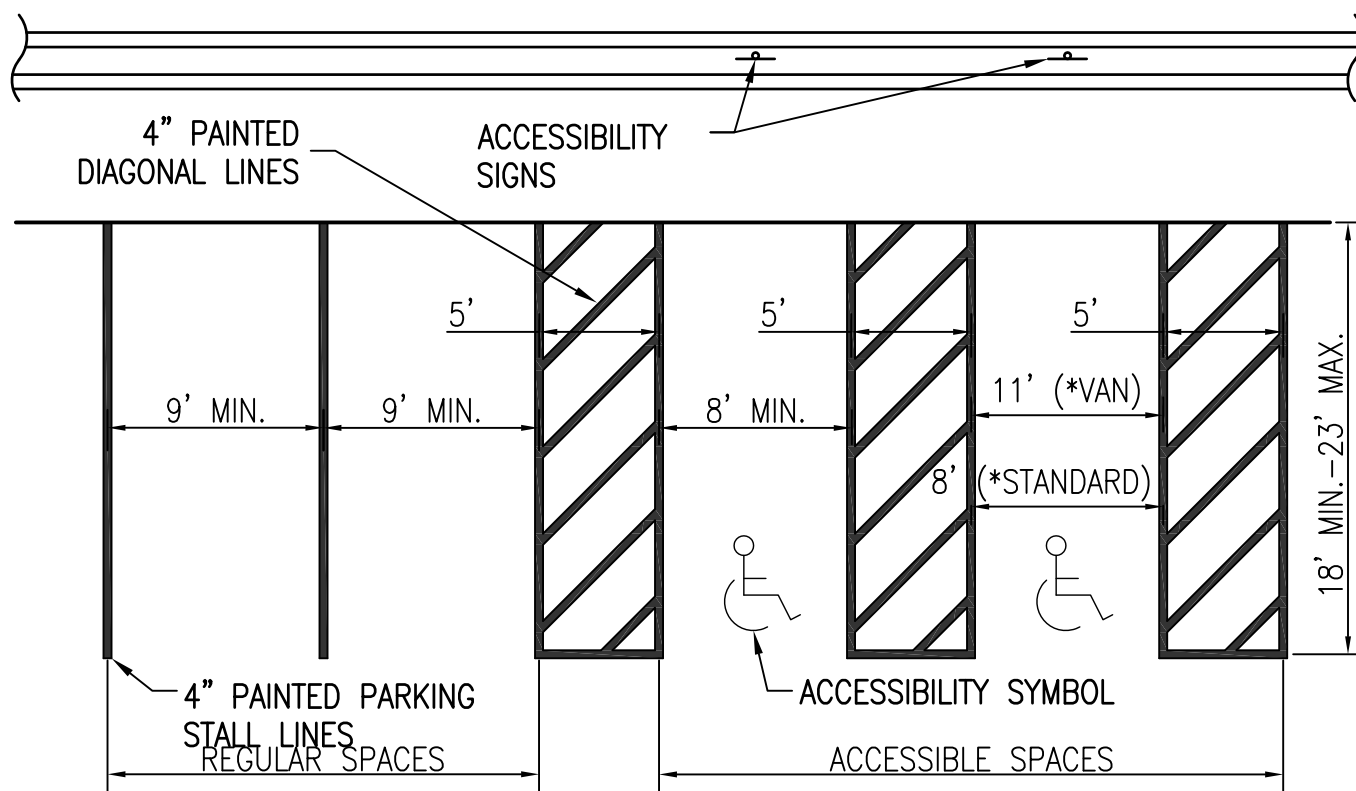

D4 PARKING STALL LAYOUT
CS101 N.T.S.

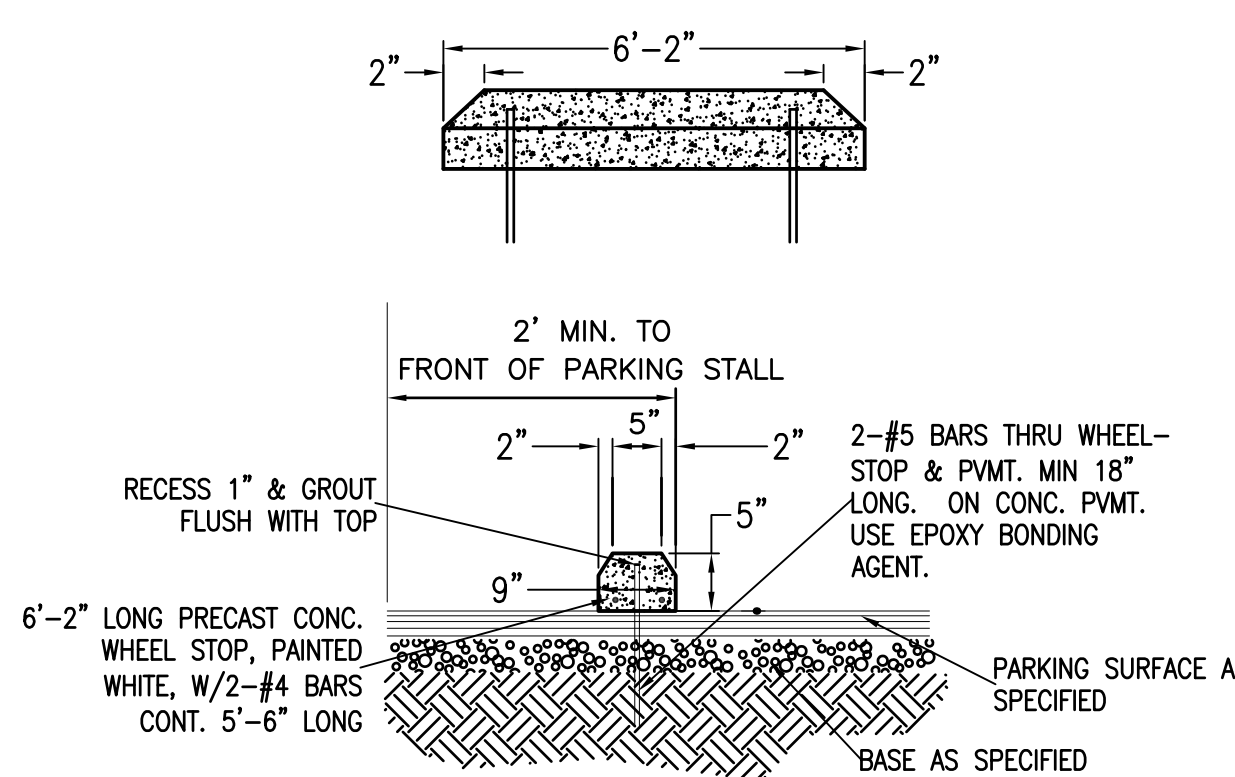


F4 CONC. BUMPER BLOCK DETAIL
CS101 N.T.S.



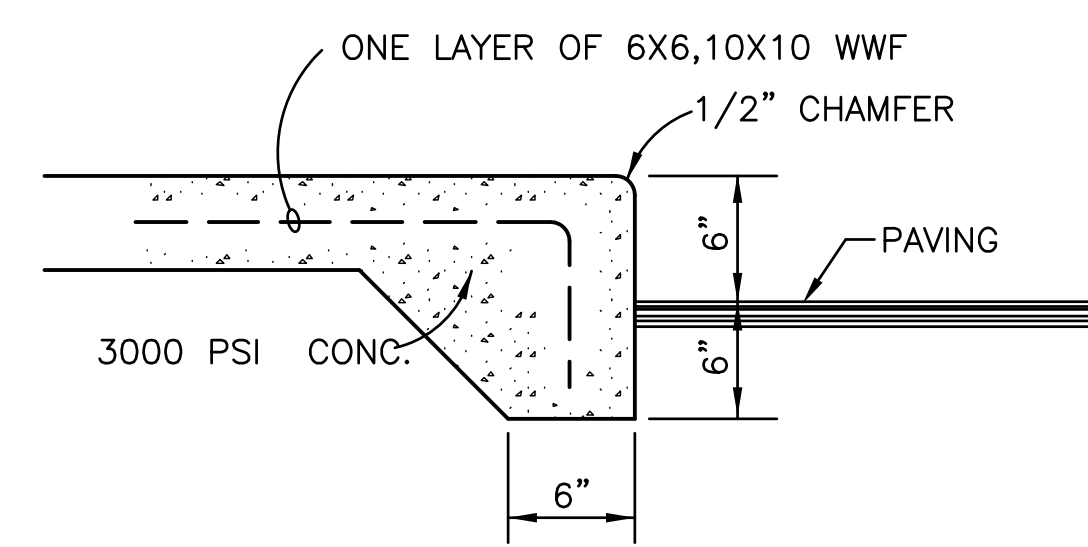


A6 SIDEWALK AT PAVING DETAIL
CS101 N.T.S.


NOTES:
1. SAWED OR SCORED CONTROL JOINTS SHALL BE SPACED AT 5 FT. MAXIMUM INTERVALS.
2. CONSTRUCT EXPANSION JOINTS WHERE NEW CONCRETE ABUTS NEW OR EXISTING CONCRETE CURBS, ASPHALT, OR OTHER STRUCTURES AND/OR ON 20 FT. CENTERS.
3. JOINT SEALER TO BE FLEXIBLE EPOXY JOINTING COMPOUND, AS SPECIFIED.
4. WALKWAY SLOPE VARIES, SEE PLANS. CROSS SLOPE NOT TO EXCEED 2%.
5. 3000 PSI CONCRETE.
6. SEE "SIDEWALK AT PAVING DETAIL" FOR LOCATIONS WHERE SIDEWALK IS ADJACENT TO ASPHALT PAVING.

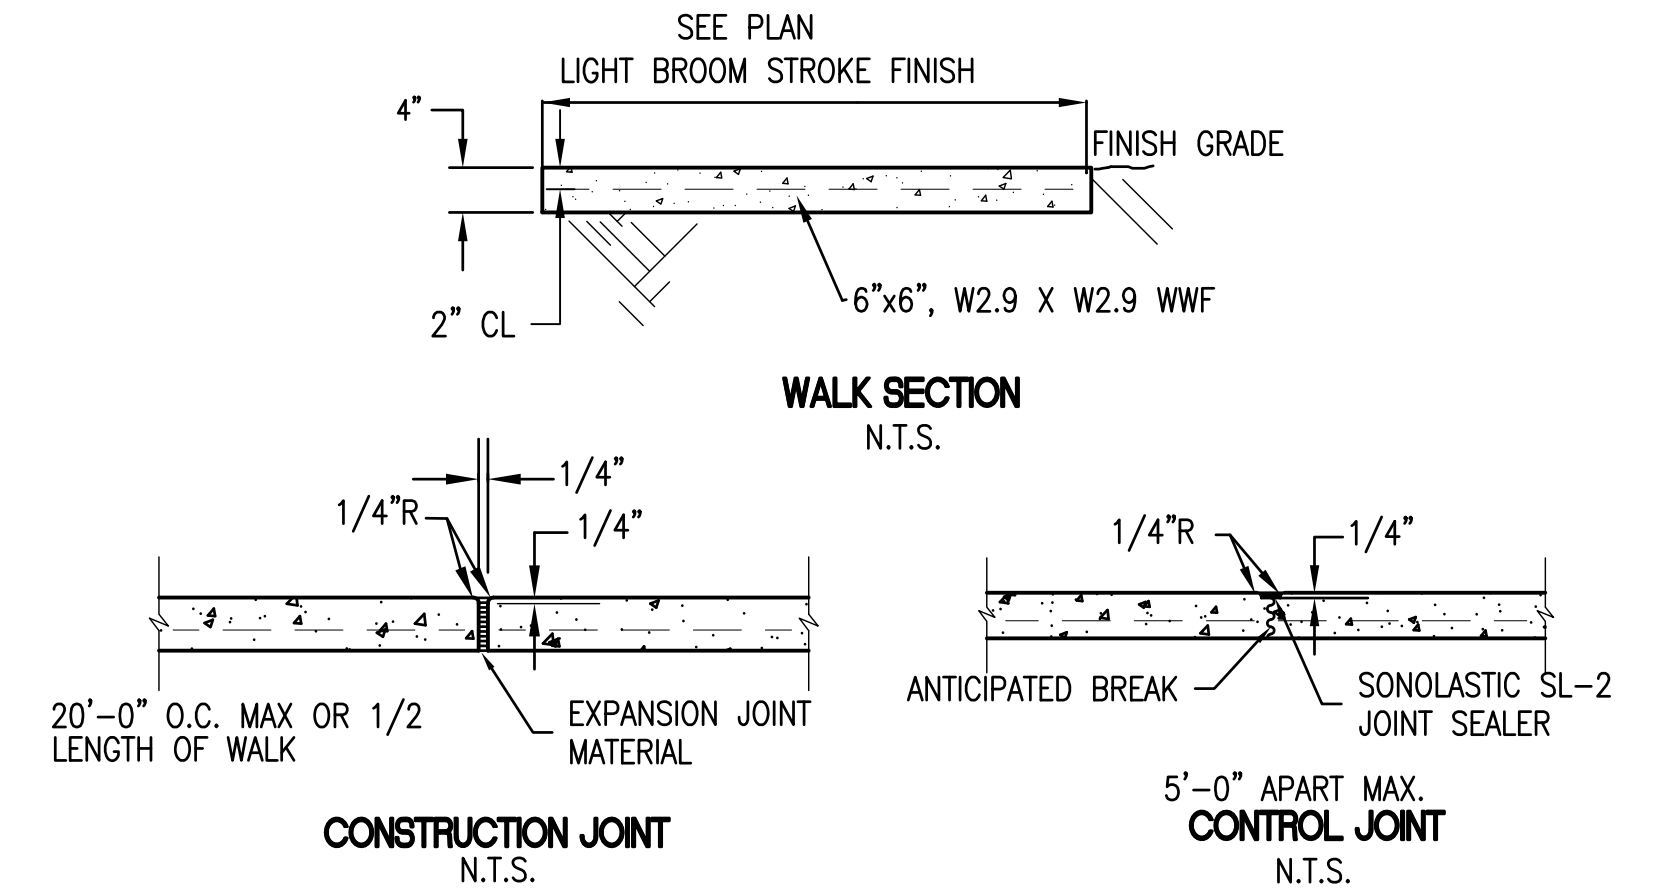

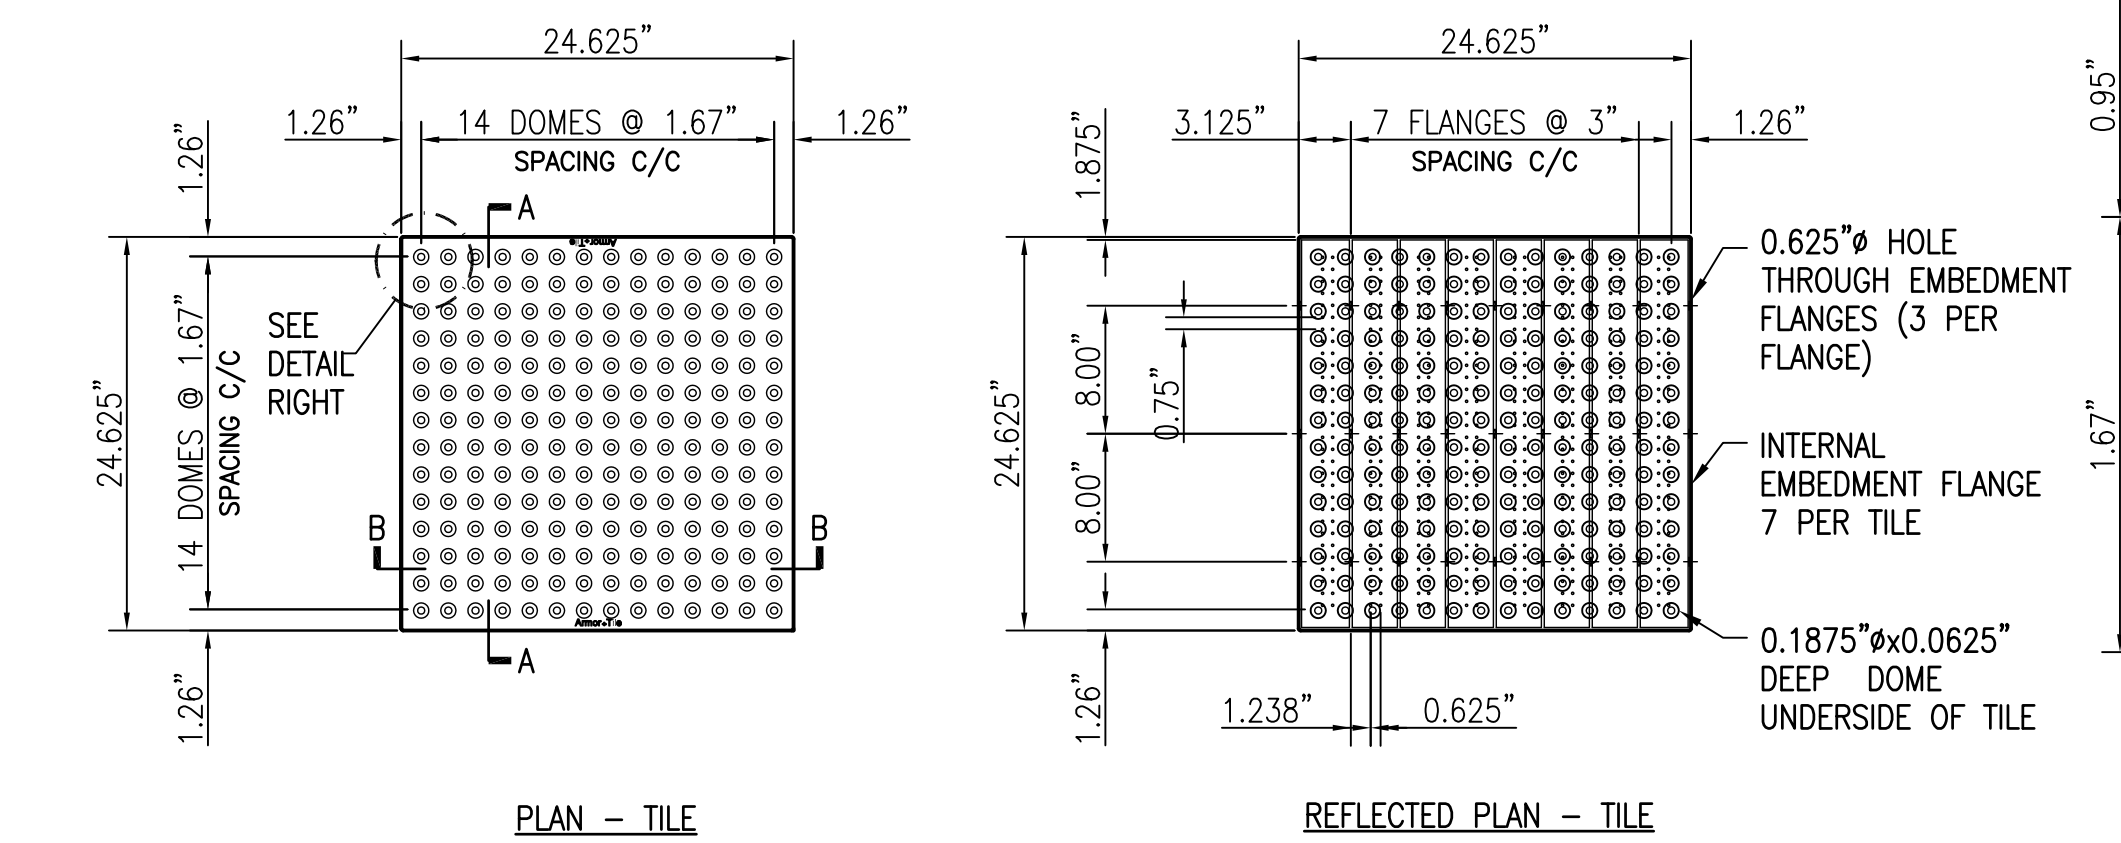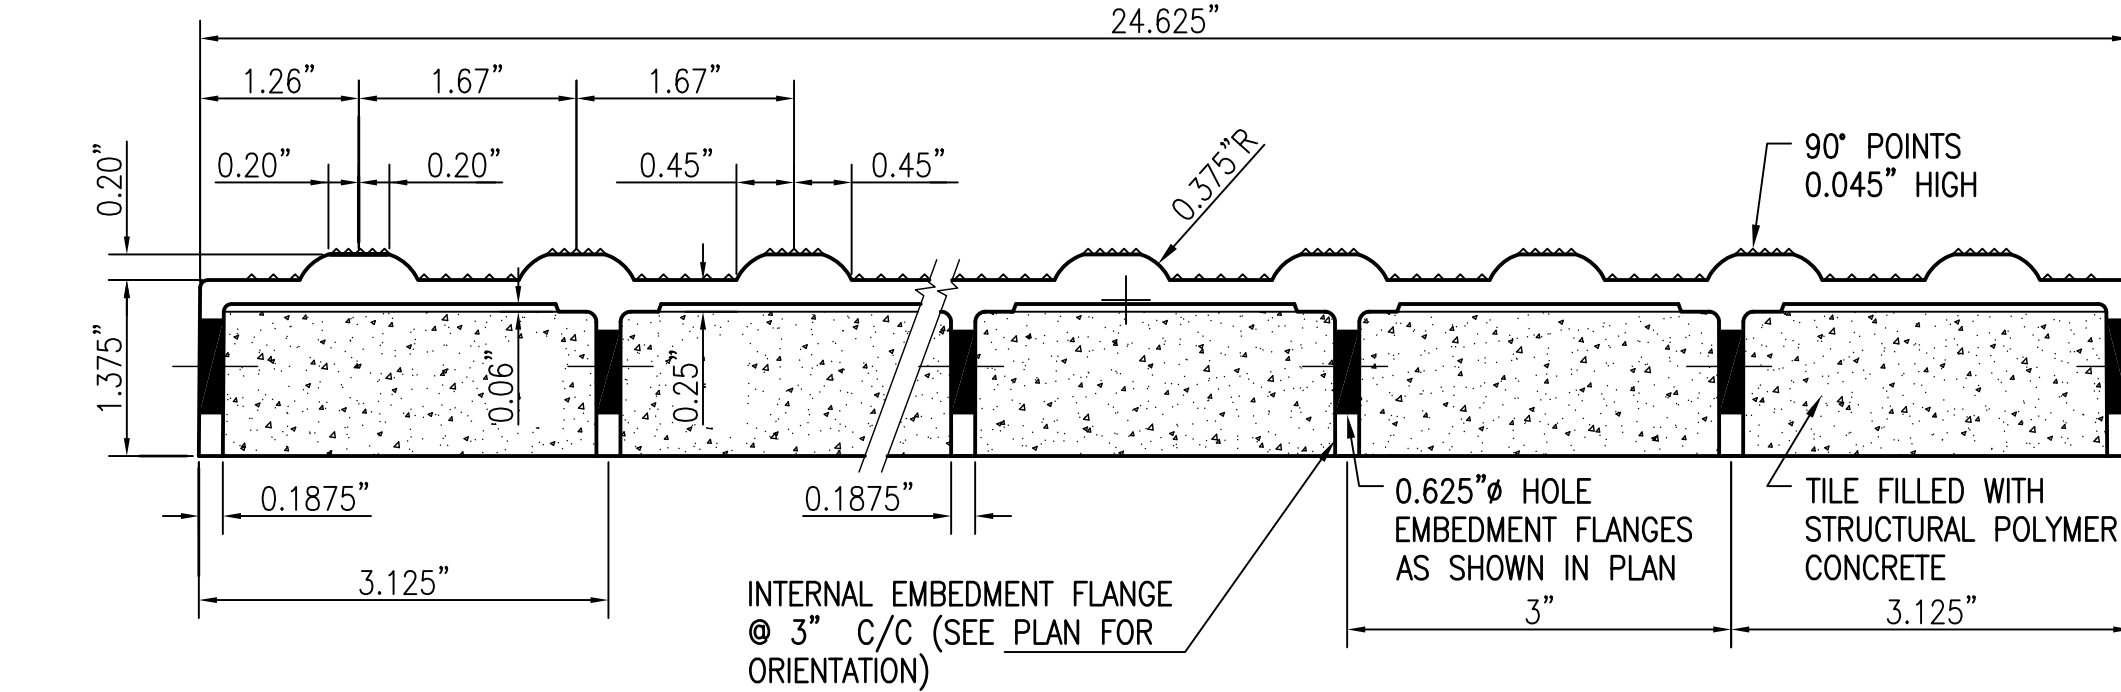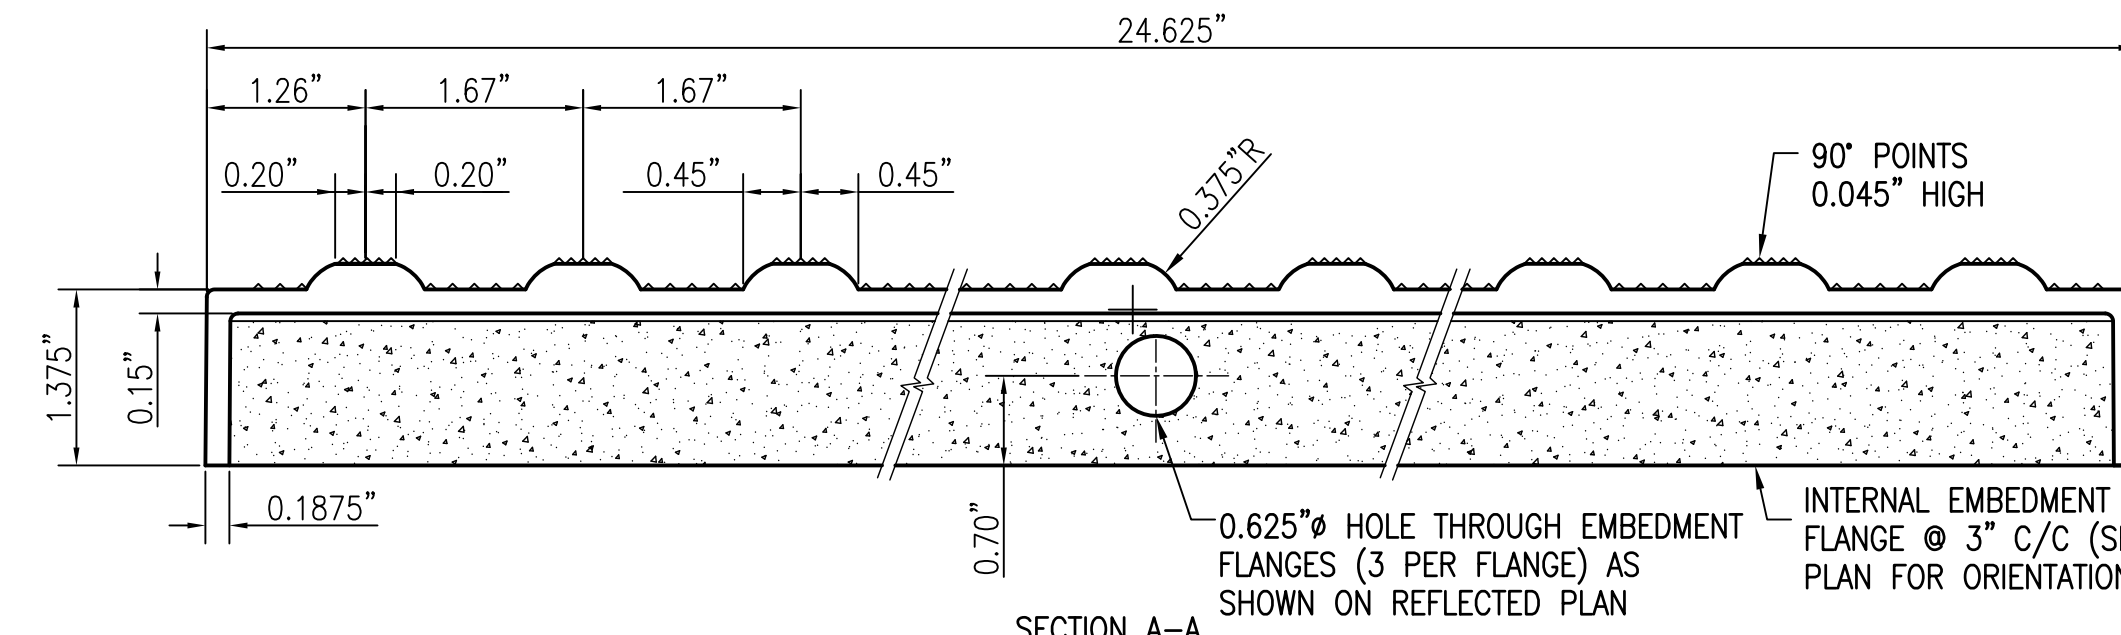


A8 SIDEWALK DETAIL
CS101 N.T.S.

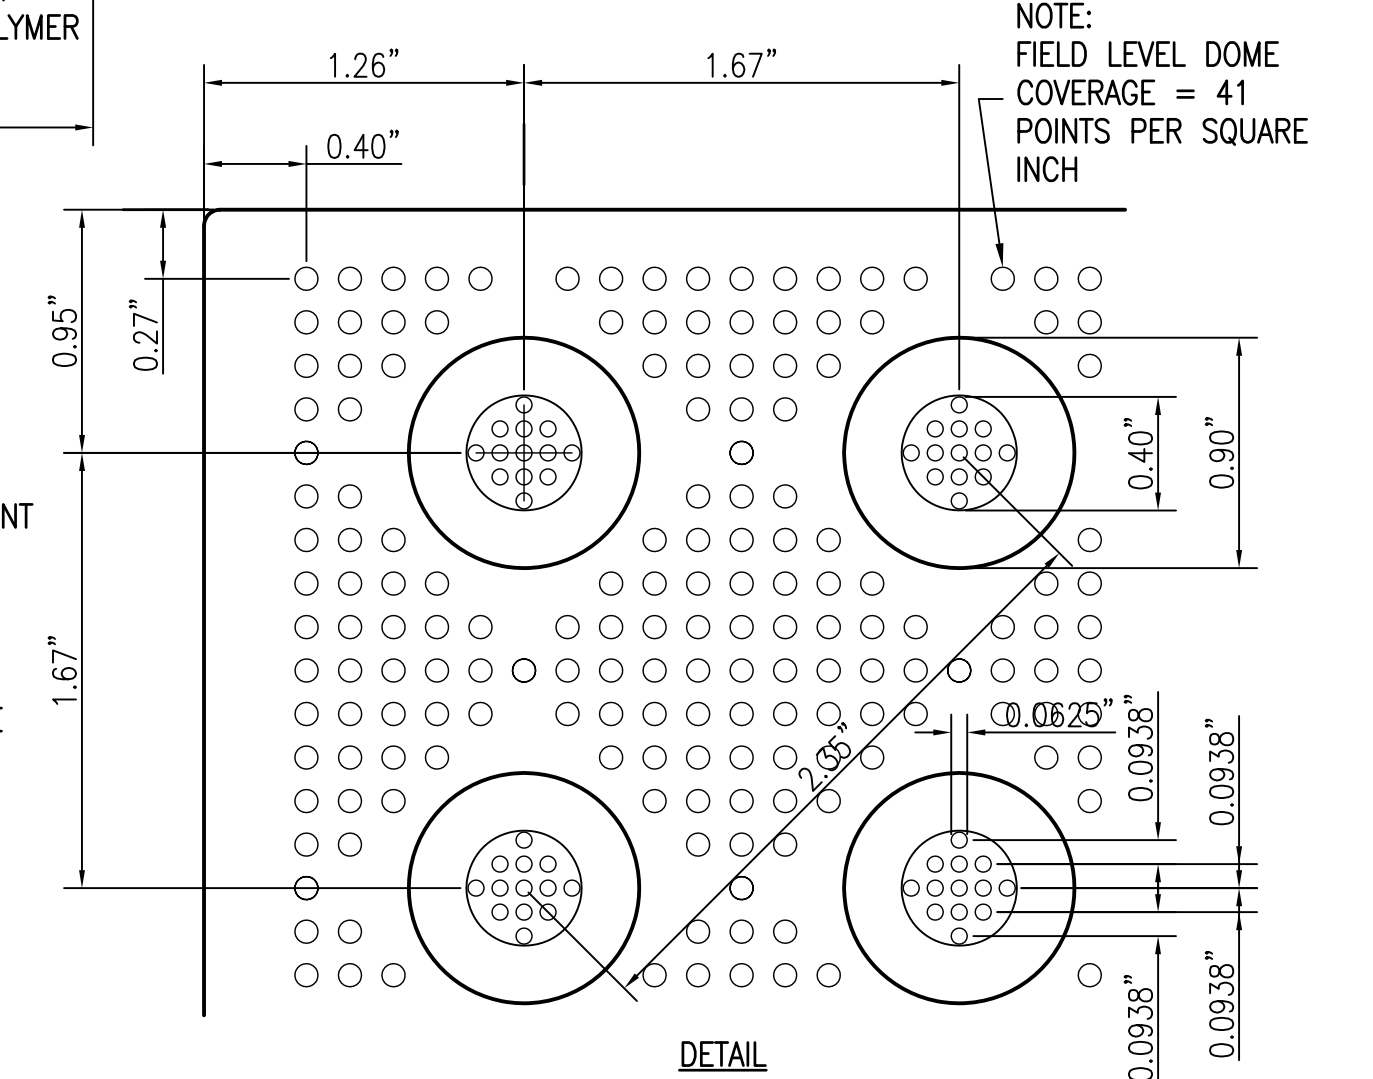

D7 TRUNCATED DOME TACTILE - WARNING STRIP
CS101 N.T.S.
CS502



FINAL SUBMISSION

		CONSULTANTS:				ARCHITECT/ENGINEERS:				Drawing Title		Project Title		Project Number		Office of Construction and Facilities Management			
		CIVIL: KENNETH HORNE & ASSOCIATES 1201 NORTH 9TH AVENUE, STE. 8 PENSACOLA, FLORIDA 32504 PH (850) 471-9008 FX (850) 471-0993		COMMAID: SCHMIDT CONSULTING GROUP, INC. 403 S. PALMFOX PLACE, STE. 500 PENSACOLA, FLORIDA 32502 PH (850) 438-0060 FX (850) 432-0631		SURVEYORS: KCI TECHNOLOGIES, INC. 10401 HIGHLAND MANOR DRIVE, SUITE 120 TAMPA, FLORIDA 33610 PH (813) 740-2300 FX (813) 740-2300		BES DESIGN/BUILD, LLC 766 Middle St, Fairhope, AL 36532 Phone: 251.990.5778 Fax: 251.990.3716		SITE DETAILS		PANAMA CITY JOINT OUTPATIENT CLINIC VA GULF COAST HEALTH CARE		520-326					
		LANDSCAPE ARCHITECT: CSA GROUP, INC. 909 PICCADILLY SQUARE DRIVE MOBILE, ALABAMA 36609 PH (251) 344-4223 FX (251) 344-4052		ARCHITECTURE: BULLOCK TOBE ASSOCIATES, INC. 609 EAST CERVANTES STREET PENSACOLA, FL 32501 PH (850) 438-0444 FX (850) 432-8651						Approved Project Director		Location PANAMA CITY, FLORIDA		Drawing Number		 Department of Veterans Affairs			
Revisions:		Date										Date MARCH 2012		Checked KCH				Drawn LRR	