



three inches = one foot
 one and one half inches = one foot
 one inch = one foot
 one half inch = one foot
 three quarters inch = one foot
 one half inch = one foot
 one eighth inch = one foot
 one quarter inch = one foot
 one eighth inch = one foot

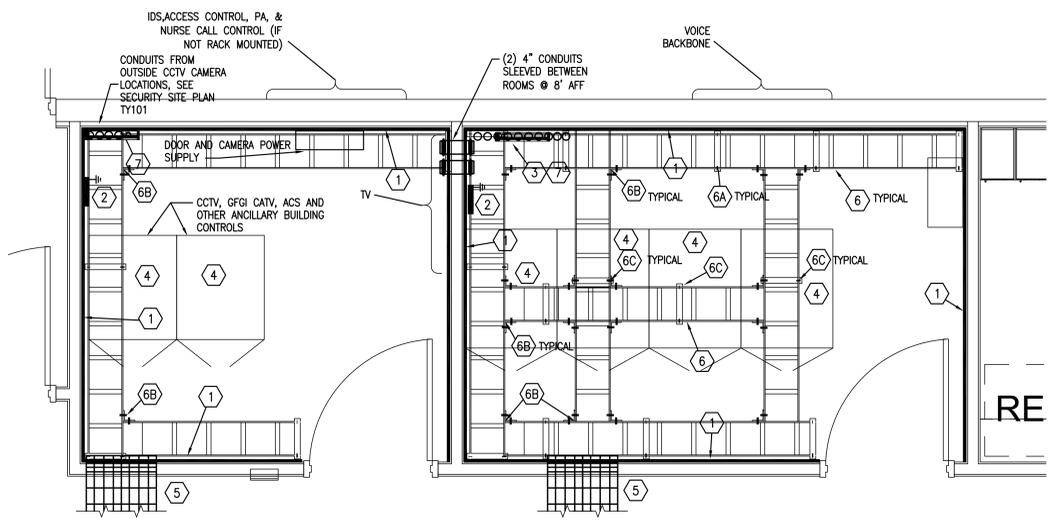

1 ENLARGED ELECTRICAL SYSTEMS ROOM
 TN201
 SCALE: 1/2"=1'-0"


2 ENLARGED TELECOMMUNICATIONS MAIN TELECOMMUNICATIONS ROOM (MTR.A)
 TN201
 SCALE: 1/2"=1'-0"

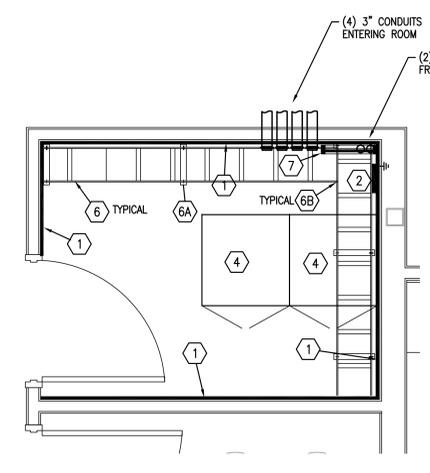


3 ENLARGED TELECOMMUNICATIONS TELECOMMUNICATIONS ROOM (TR.B)
 TN201
 SCALE: 1/2"=1'-0"

GROUNDING NOTE


- 1) ALL GROUND CONNECTIONS SHALL BE MADE WITH HEAVY DUTY 2 HOLE COMPRESSION LUGS WITH STAINLESS STEEL HEX HEAD CAP SCREWS WITH SS LOCKING NUTS (TWO SCREWS AND NUTS PER 2 HOLE LUG).
- 2) PROVIDE GROUNDING BUSBARS IN ALL COMMUNICATION CLOSETS. GROUND MAIN BUSBAR TO BUILDING MAIN ELECTRICAL SERVICE GROUND WITH #3/0 AWG INSULATED (GREEN) SOLID COPPER GROUNDING CONDUCTOR AND #2/0 BETWEEN BUSBARS. RUN CONDUCTOR FROM BUSBAR LOCATION TO BUILDING SERVICE GROUND IN EMT CONDUIT. PROVIDE INSULATED GROUNDING BUSHING - WALLABLE IRON, STEEL CITY #B-807 AT CONDUIT ENDS AND GROUND PER NEC. GROUNDING TO BUILDING STRUCTURE, CONDUITS, UTILITY PIPING, OR ELECTRICAL SUBPANELS IN LIEU OF BONDING TO BUILDING MAIN ELECTRICAL SERVICE GROUND IS NOT ACCEPTABLE.
- 3) GROUND ALL COMMUNICATION RACKS WITH #6 AWG INSULATED (GREEN) SOLID COPPER GROUNDING CONDUCTOR TO MAIN GROUNDING BUSBAR. GROUND RACKS INDIVIDUALLY TO BUSBAR (DO NOT LOOP GROUNDS). ROUTE CONDUCTOR ALONG RACK REAR AND IN CABLE RUNWAY TO GROUNDING BUSBAR.
- 4) GROUND EACH CONDUIT AND CONDUIT SUPPORTS STRUTS IN ALL COMMUNICATIONS ROOMS WITH #6 AWG INSULATED (GREEN) SOLID COPPER GROUNDING CONDUCTOR TO GROUNDING BUSBAR. ROUTE CONDUCTOR IN CABLE RUNWAY TO GROUNDING BUSBAR.
- 5) GROUND CABLE RUNWAY WITH #6 AWG INSULATED (GREEN) SOLID COPPER GROUNDING CONDUCTOR TO GROUNDING BUSBAR. ROUTE CONDUCTOR IN CABLE RUNWAY TO GROUNDING BUSBAR.

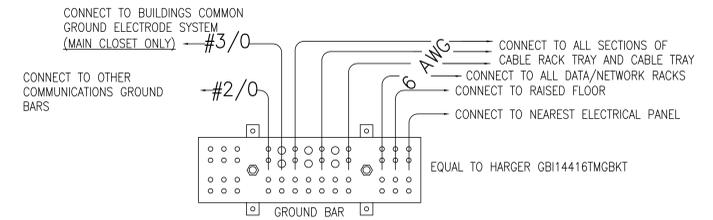


4 MAIN TELECOMMUNICATIONS ROOM GROUNDING BUSBAR DETAIL
 NOT TO SCALE

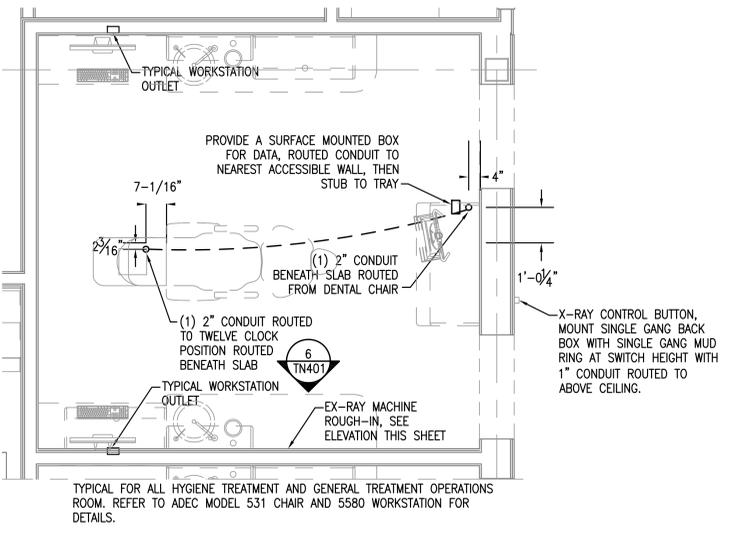

5 ENLARGED TYPICAL DENTAL HYGIENE AND DENTAL OPERATIONS ROOM
 TN201
 SCALE: 1/2"=1'-0"

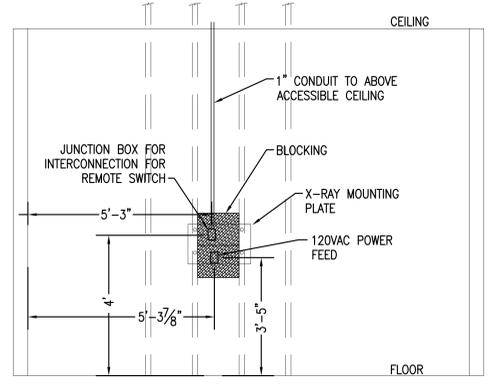

6 DENTAL X-RAY ROUGH-IN ELEVATION
 TN201
 SCALE: 1/2"=1'-0"

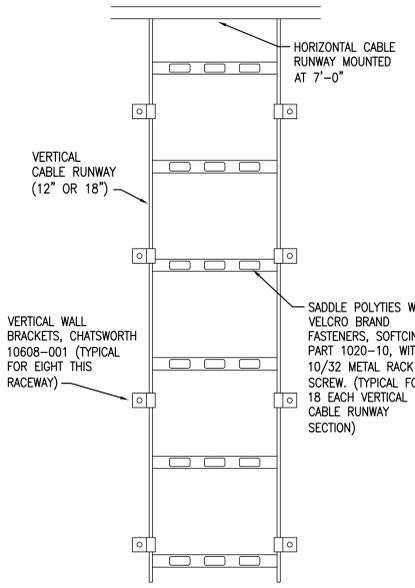

7 TYPICAL VERTICAL RUNWAY DETAIL
 NOT TO SCALE

ENLARGED FLOOR PLAN KEY NOTES

- 1) PLYWOOD BACKBOARD, 8'-0" HIGH X FULL LENGTH OF WALL, MOUNT WITH BOTTOM AT 6" ABOVE FINISH FLOOR. ROUGH ALL ELECTRICAL OUTLETS IN BACKBOARD FOR FLUSH MOUNT INSTALLATION OF FACEPLATES. BACKBOARDS SHALL BE 3/4" THICK AC EXTERIOR GRADE PLYWOOD, COUNTERSINK ALL SCREWS. PRIME WITH TWO COATS PRIMER, SANDING SMOOTH AFTER EACH COAT. FINISH WITH TWO COATS SEMI-GLOSS ENAMEL FIRE-RETARDANT PAINT, COLOR BATTLESHIP GREY. FINAL SURFACE SHALL BE UNIFORMLY SMOOTH AND EVEN. TOUCH UP AT END OF PROJECT. COORDINATE WORK WITH ELECTRICAL CONTRACTOR TO ENSURE THAT POWER RECEPTACLES ARE PROPERLY LOCATED AND WITH FACEPLATES FLUSH ON FACE OF BACKBOARD.
- 2) GROUNDING BUSBAR, WITH TWO ROWS OF 7/16" HOLES AT 1" SPACING EACH WAY. MAKE ALL CONNECTIONS WITH TWO HOLE LONG BARREL COMPRESSION LUGS AND BOND TO BUSBAR WITH TWO 3/8" SS HEX HEAD CAP SCREWS WITH SS LOCKING NUTS. SEE "GROUNDING NOTE" AND "VOICE SYSTEM SINGLE LINE DIAGRAM". ROUTE 3/4" EMT CONDUIT TO BUILDING MAIN ELECTRICAL PANEL FOR GROUNDING CONDUCTOR WITH INSULATED GROUNDING BUSHING.
- 3) COMMUNICATIONS BACKBONE CONDUIT. SEE COMMUNICATIONS SITE/FLOOR PLANS.
- 4) FLOOR MOUNT EQUIPMENT CABINETS. REFER TO RACK ELEVATION DETAILS.
- 4A) WALL MOUNTED LOCKING EQUIPMENT ENCLOSURE, REFER TO RACK ELEVATIONS.
- 5) 24" CABLE TRAY ENTERING ROOM AND TURNING DOWN WALL TO CABLE RUNWAY. CUT CEILING TILES AROUND CABLE TRAY ENTRANCE.
- 6) (2) 18" WIDE CABLE RUNWAY STACKED ON ONE ANOTHER WITH 12" CLEARANCE BETWEEN THE TWO. CHATSWORTH 10250-718 OR EQUAL, COLOR BLACK. PROVIDE BUTT-SPLICE KIT TO BUTT-SPLICE SECTIONS OF CABLE RUNWAY (PAINT BEFORE INSTALLING AND TOUCH UP AFTER INSTALLATION). INSTALL ALL CABLE RUNWAY, FITTINGS, AND ACCESSORIES IN ACCORDANCE WITH MANUFACTURER'S PRINTED INSTRUCTIONS.
- 6A) 18" CABLE RUNWAY WALL ANGLE SUPPORT KIT, CHATSWORTH 11421-718 OR EQUAL, COLOR BLACK.
- 6B) CABLE RUNWAY JUNCTION SPLICE KIT, CHATSWORTH 16298-001 OR EQUAL.
- 6C) CEILING SUPPORT BRACKET, CHATSWORTH 11310-003 OR EQUAL, COLOR BLACK.
- 7) 18" WIDE CABLE RUNWAY, CHATSWORTH 10250-718 OR EQUAL, MOUNTED VERTICALLY FROM CONDUIT ENTRANCE IN FLOOR TO 7'-0". SEE "TYPICAL VERTICAL CABLE RUNWAY DETAIL".

FINAL SUBMISSION



CONSULTANTS: CIVIL: KENNETH HORNE & ASSOCIATES 7201 NORTH 97th AVENUE PENSACOLA, FLORIDA 32504 PH: (850) 471-8005 FX: (850) 471-0993 LANDSCAPE ARCHITECT: CSA GROUP, INC. 6300 PICCADILLY SQUARE DRIVE MOBILE, ALABAMA 36609 PH: (251) 344-4023 FX: (251) 344-4026		COMM/DS: SCHMIDT CONSULTING GROUP, INC. 40 S. PALMFOX PLACE, STE. 300 PENSACOLA, FLORIDA 32502 PH: (850) 438-8050 FX: (850) 432-9631 ARCHITECTURE: BULLOCK TICE ASSOCIATES, INC. 909 EAST CERVANTES STREET PENSACOLA, FL 32501 PH: (850) 434-5444 FX: (850) 432-5208		SURVEYORS: KGI TECHNOLOGIES, INC. 19401 HIGHLAND MANOR DRIVE, SUITE 120 TAMPA, FLORIDA 33610 PH: (813) 740-2300		NO. 56882 STATE OF FLORIDA PROFESSIONAL ENGINEER		ARCHITECT/ENGINEERS: BES DESIGN/BUILD, LLC 766 Middle St, Fairhope, AL 36532 Phone: 251.990.5778 Fax: 251.990.3716		Drawing Title: ENLARGED TELECOMMUNICATIONS FLOOR PLAN Approved Project Director:		Project Title: PANAMA CITY JOINT OUTPATIENT CLINIC VA GULF COAST HEALTH CARE Location: PANAMA CITY, FLORIDA Date: MARCH 2012 Checked: TAN Drawn: CEC		Project Number: 520-326 Building Number: - Drawing Number: TN401 Dwg 4 of 14		Office of Construction and Facilities Management 	
---	--	---	--	---	--	--	--	--	--	---	--	---	--	--	--	---	--