



- GENERAL NOTES:**
1. FLEX DUCT RUNOUT LENGTHS 5'-0" MAX TO ALL CEILING DIFFUSERS & SLOT DIFFUSERS.
 2. CONSTRUCT SUPPLY DUCTWORK TO MIN SMALMA STANDARD FOR 3"wg. RETURN DUCTWORK FOR 2"wg. ALL DUCT TO BE SEAL CLASS A.
 3. ALL ELBOWS ON SUPPLY AIR TO BE RADIOUS OR CONTAIN AIRFOIL STYLE TURNING VANES.
 4. LABEL ALL DUCTWORK IN COMPLIANCE WITH SPEC. SECTIONS 23 05 11 AND 09 01 00.

KEYED CONSTRUCTION NOTES


- 1 THE GOVERNMENT INTENDS TO PROCURE AN AIR HANDLER THROUGH A SEPARATE EXISTING CONTRACT. THIS AIR HANDLER IS TO BE PROVIDED IN THE LOCATION SHOWN ON THE DRAWING. THE CONTRACTOR SHALL PROVIDE AN HVAC SYSTEM THAT IS COMPATIBLE WITH GOVERNMENT PROVIDED AIR HANDLER THAT MEETS THE REQUIREMENTS OF THE SPACE DESIGNED. THIS MAY REQUIRE THE CONTRACTOR TO PERFORM WORK OF SIMILAR SCOPE BUT WITH AN ALTERNATE DESIGN BASIS.
- 2 PROVIDE ALL DUCTWORK SHOWN ON DRAWINGS AND IN ACCORDANCE WITH DETAILS AND SPECIFICATIONS FOR MECHANICAL AND HVAC SYSTEM INSTALLATIONS.
- 3 CONTRACTOR SHALL PROVIDE HVAC SYSTEM CONTROLS IN ACCORDANCE WITH SPECIFICATIONS.
- 4 ALL REQUIRED CIRCUITS ARE TO BE PROVIDED BY THE CONTRACTOR FOR A FUNCTIONAL HVAC SYSTEM. THESE CIRCUITS SHALL BE CONNECTED AND RUN FROM PANEL E16-1A.

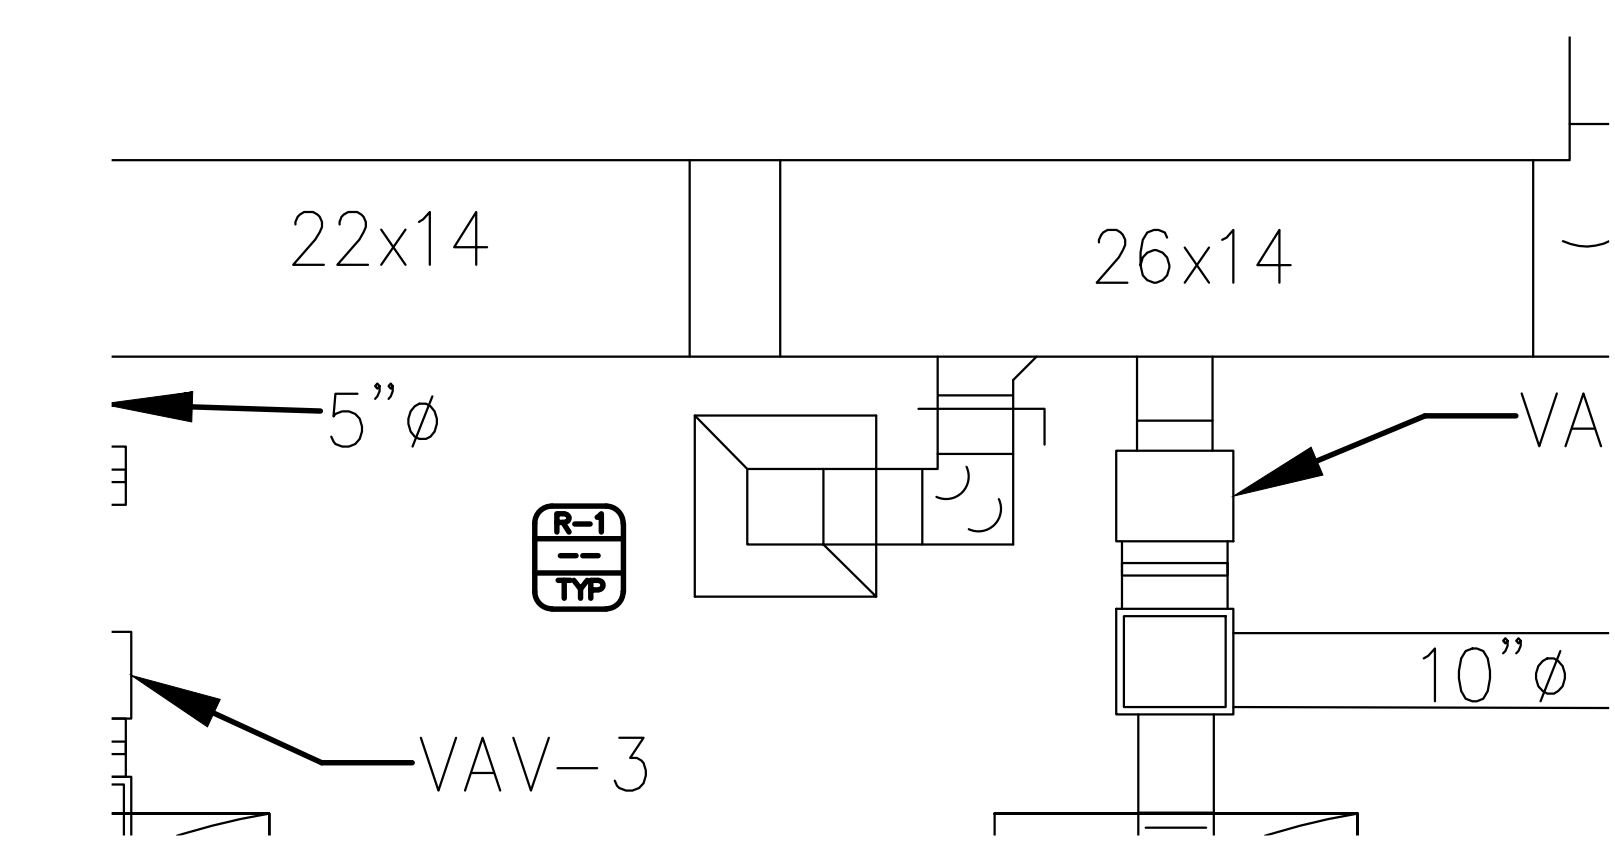

4 PARTIAL FLOOR PLAN VIEW - RETURN DIFFUSER
1-1/2"=1'-0"

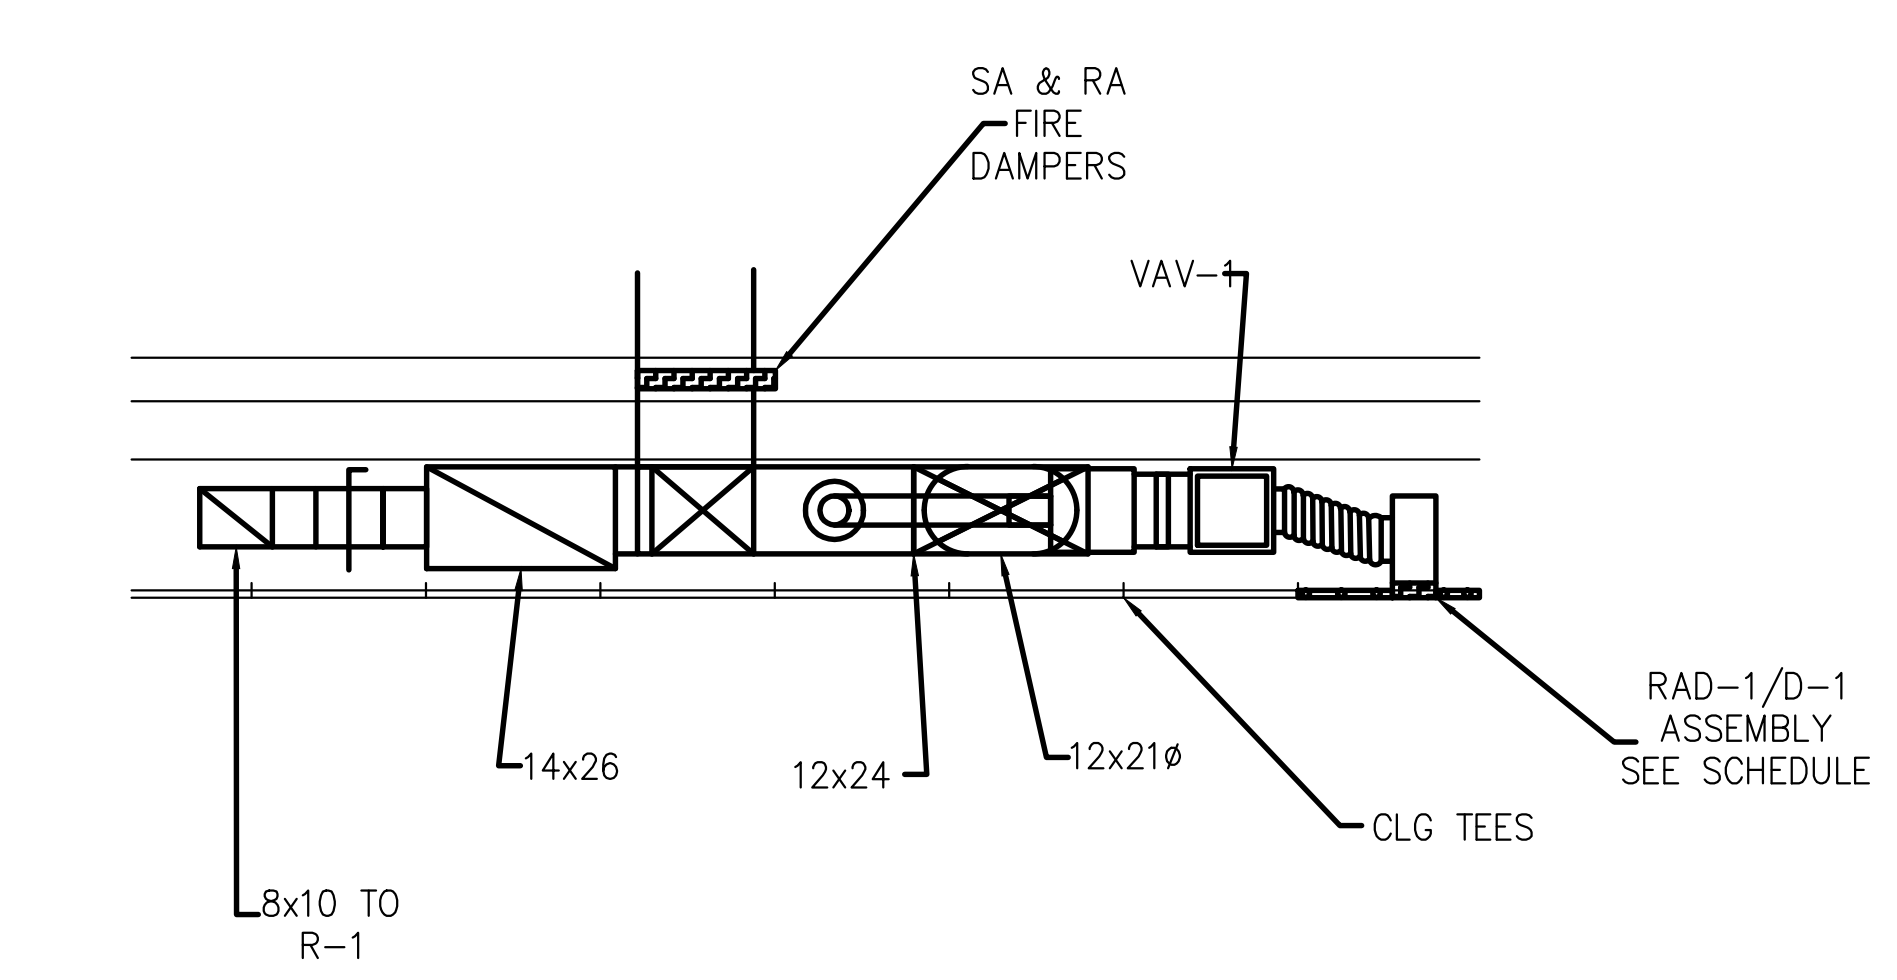

4 BUILDING 16 DUCTWORK SECTION
1-1/2"=1'-0"

		CONSULTANTS:			ARCHITECT/ENGINEERS:		Drawing Title	Project Title	Project Number	
							HVAC DUCTWORK PLAN	RENOVATE FOR EDUCATION SERVICE AND ADMINISTRATIVE SPACE.	528A7-12-732	
									Building Number	
									16	
									Drawing Number	
									MH-102	
							Approved: Project Director	Location SYRACUSE VAMC	Drawing Number	
			</							