

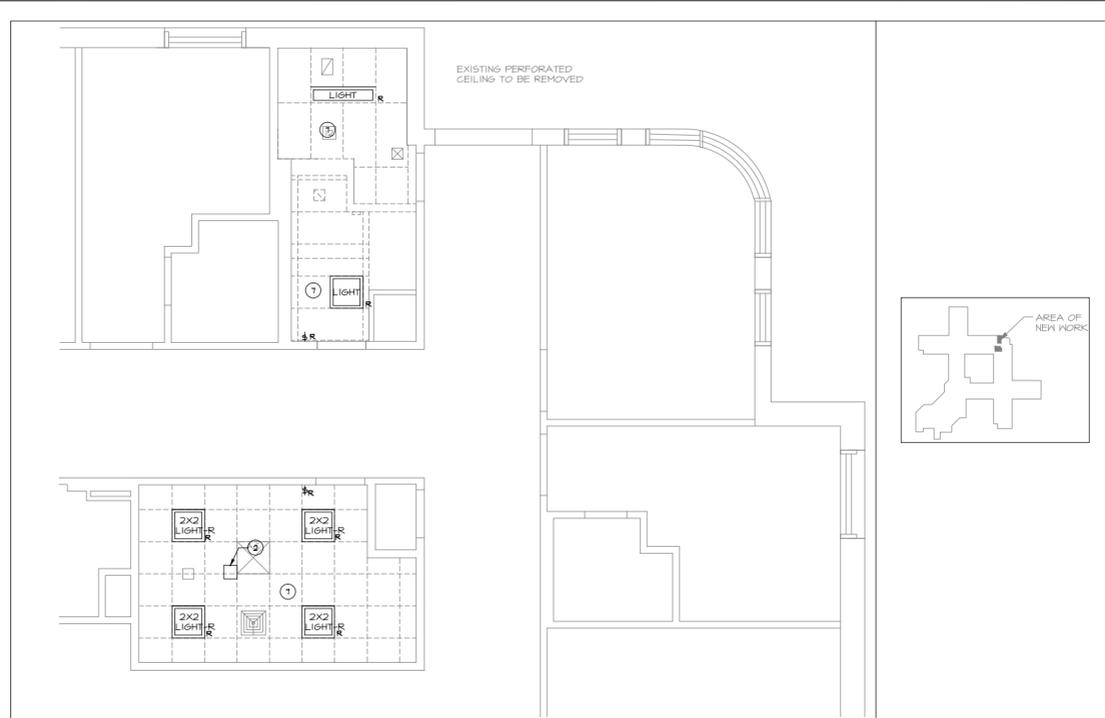



IF THIS SHEET IS NOT 30" x 42"
FULL SIZE, USE GRAPHIC SCALES




1 ELECTRICAL LIGHTING DEMOLITION PART PLAN
Scale : 1/4" = 1'-0"

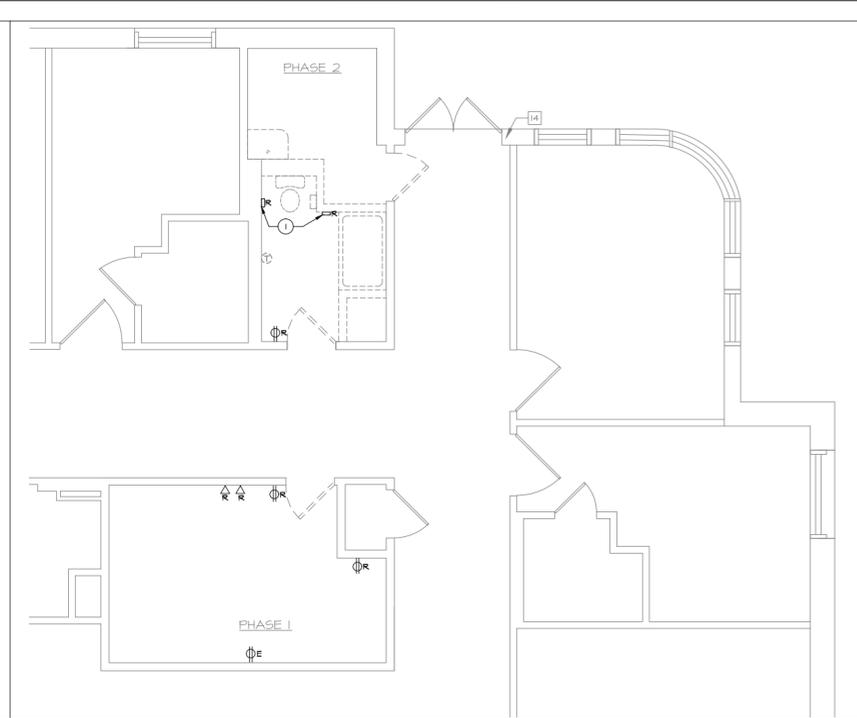

2 ELECTRICAL POWER DEMOLITION PART PLAN
Scale : 1/4" = 1'-0"

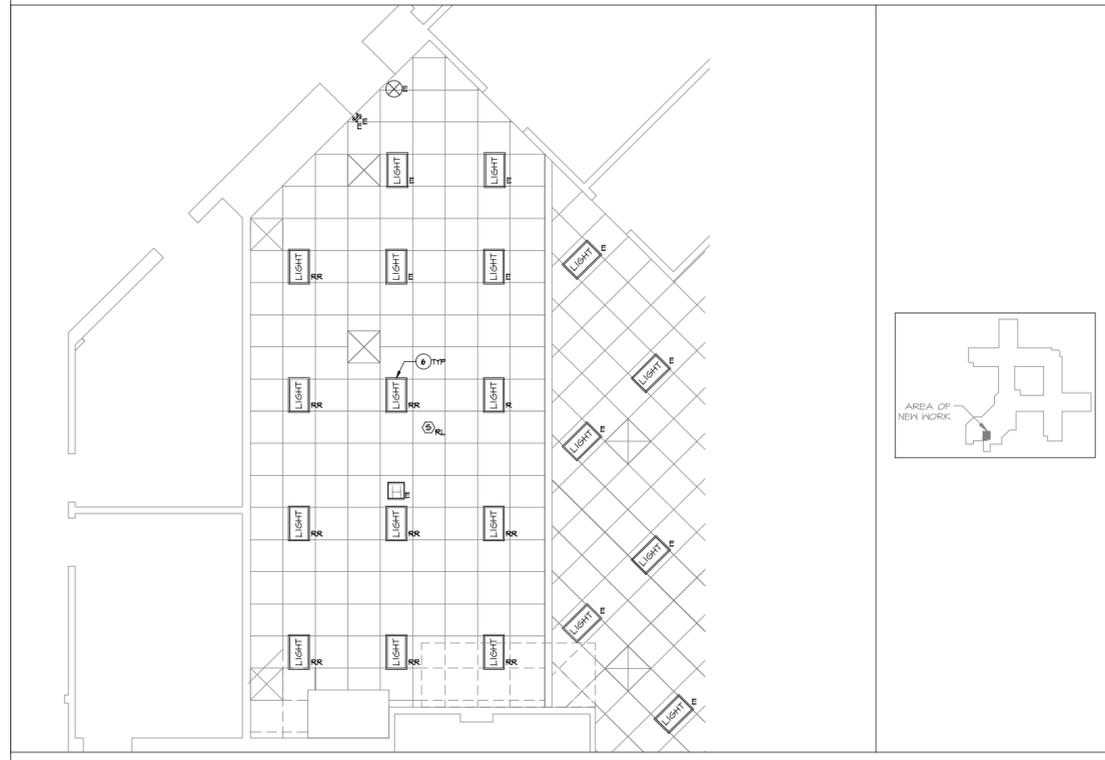

3 ELECTRICAL LIGHTING DEMOLITION PART PLAN
Scale : 1/4" = 1'-0"

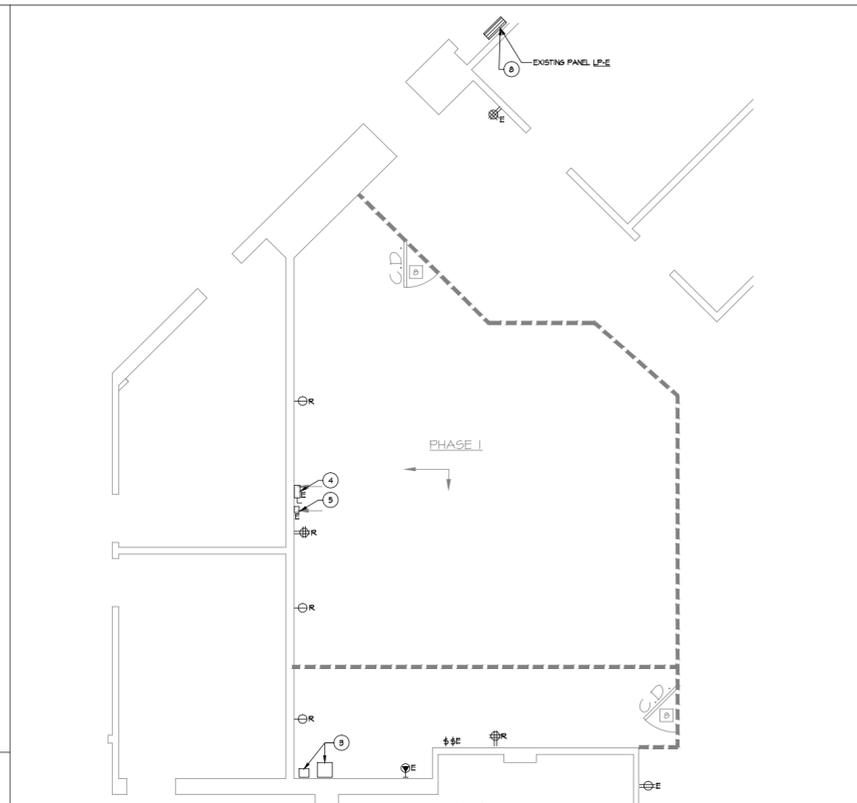

4 ELECTRICAL POWER DEMOLITION PART PLAN
Scale : 1/4" = 1'-0"

SYMBOL LIST POWER - DEMOLITION

- ⊕ DUPLEX RECEPTACLE
- ⊕ QUAD RECEPTACLE
- ⊕ SIMPLEX RECEPTACLE
- ▽ TEL/DATA OUTLET
- ⊕ OUTLET BOX WITH BLANK COVER
- ⊕ 200V RECEPTACLE
- ⊕ KEYED NOTE
- ⊕ NEXT TO SYMBOL INDICATES EXISTING TO BE REMOVED
- ⊕ NEXT TO SYMBOL INDICATES EXISTING TO REMAIN
- ⊕ NEXT TO SYMBOL INDICATES EXISTING TO BE REMOVED AND RELOCATED
- ⊕ EXISTING EXIT SIGN
- ⊕ SMOKE DETECTOR
- ⊕ FIRE ALARM HORN
- ⊕ SWITCH

- DEMOLITION KEYED NOTES - E-2**
- 1 DISCONNECT AND REMOVE ALL WIRING FOR EMERGENCY HELP CALL LINES BACK TO PANEL FOR REMOVAL. REPROGRAM / RECONFIGURE NARSE CALL SYSTEM AS REQUIRED. WORK TO BE PERFORMED ONLY BY CERTIFIED QUALIFIED TECHNICIAN/INSTALLERS EXPERIENCED IN SERVICING THIS EXISTING MAKE/MODEL SYSTEM.
 - 2 EXISTING C/S/O ROUTER TO BE REMOVED AND STORED. SEE DRAWING E-2 FOR NEW LOCATION. COORDINATE WITH VANG RESIDENT ENGINEER PRIOR TO REMOVAL.
 - 3 ANSL SYSTEM AND PULLBOX TO BE RELOCATED. SEE DRAWING E-4.
 - 4 200A DISCONNECT SWITCH FOR STOVE AND ANSL SYSTEM TO BE RELOCATED - SEE DRAWING E-4.
 - 5 EMERGENCY SWITCH FOR ANSL SYSTEM TO BE RELOCATED. SEE DRAWING E-4.
 - 6 DISCONNECT, REMOVE, & STORE EXISTING LIGHT FIXTURE FOR REINSTALLATION - SEE DRAWING E-4.
 - 7 DISCONNECT AND REMOVE ALL BRANCH CIRCUIT WIRING FOR EXISTING LIGHT FIXTURES TO BE REMOVED.
 - 8 DISCONNECT AND REMOVE EXISTING 2-SECTION PANEL (L1-E). SEE DRAWING E-4 & E-8 FOR ADDITIONAL INFORMATION. MAIN FEEDER AND EXISTING BRANCH CIRCUITS TO REMAIN.


EMTG CONSULTING ENGINEERS
TEL: 212-268-6465 FAX: 212-268-6467
115 WEST 30TH STREET, SUITE 202, NEW YORK, NY 10001

Revisions	Date

--	--

Kenneth Irving Architect P.C.
MEMORIAL PLAZA SUITE 501, PLEASANTVILLE, NY 10570
PHONE: (914) 747-0028 • E-MAIL: klandrade@kivar.com • FAX: (914) 747-9211

NOTE AND READ CAREFULLY:
The Contractor shall consult and study the requirements of each and every drawing and each specification section of this contract so that he/she may become acquainted with the project as a whole in order to determine how the work of his/hers subcontractor or vendor may affect the work required under this contract.
Written Specifications are part of this contract.



Drawing Title ELECTRICAL POWER AND LIGHTING DEMOLITION PART PLANS	
Approved: Division Chief	
Approved: Service Director	

Project Title Implement Community Living Center Cultural Transformation	
Building Number 92	Checked MA
Location Northport, New York	Drawn MA/DC

Date 3/30/2012	Project No. 632-08-123
DRAWING NO. E-2	Dwg. of 34

