

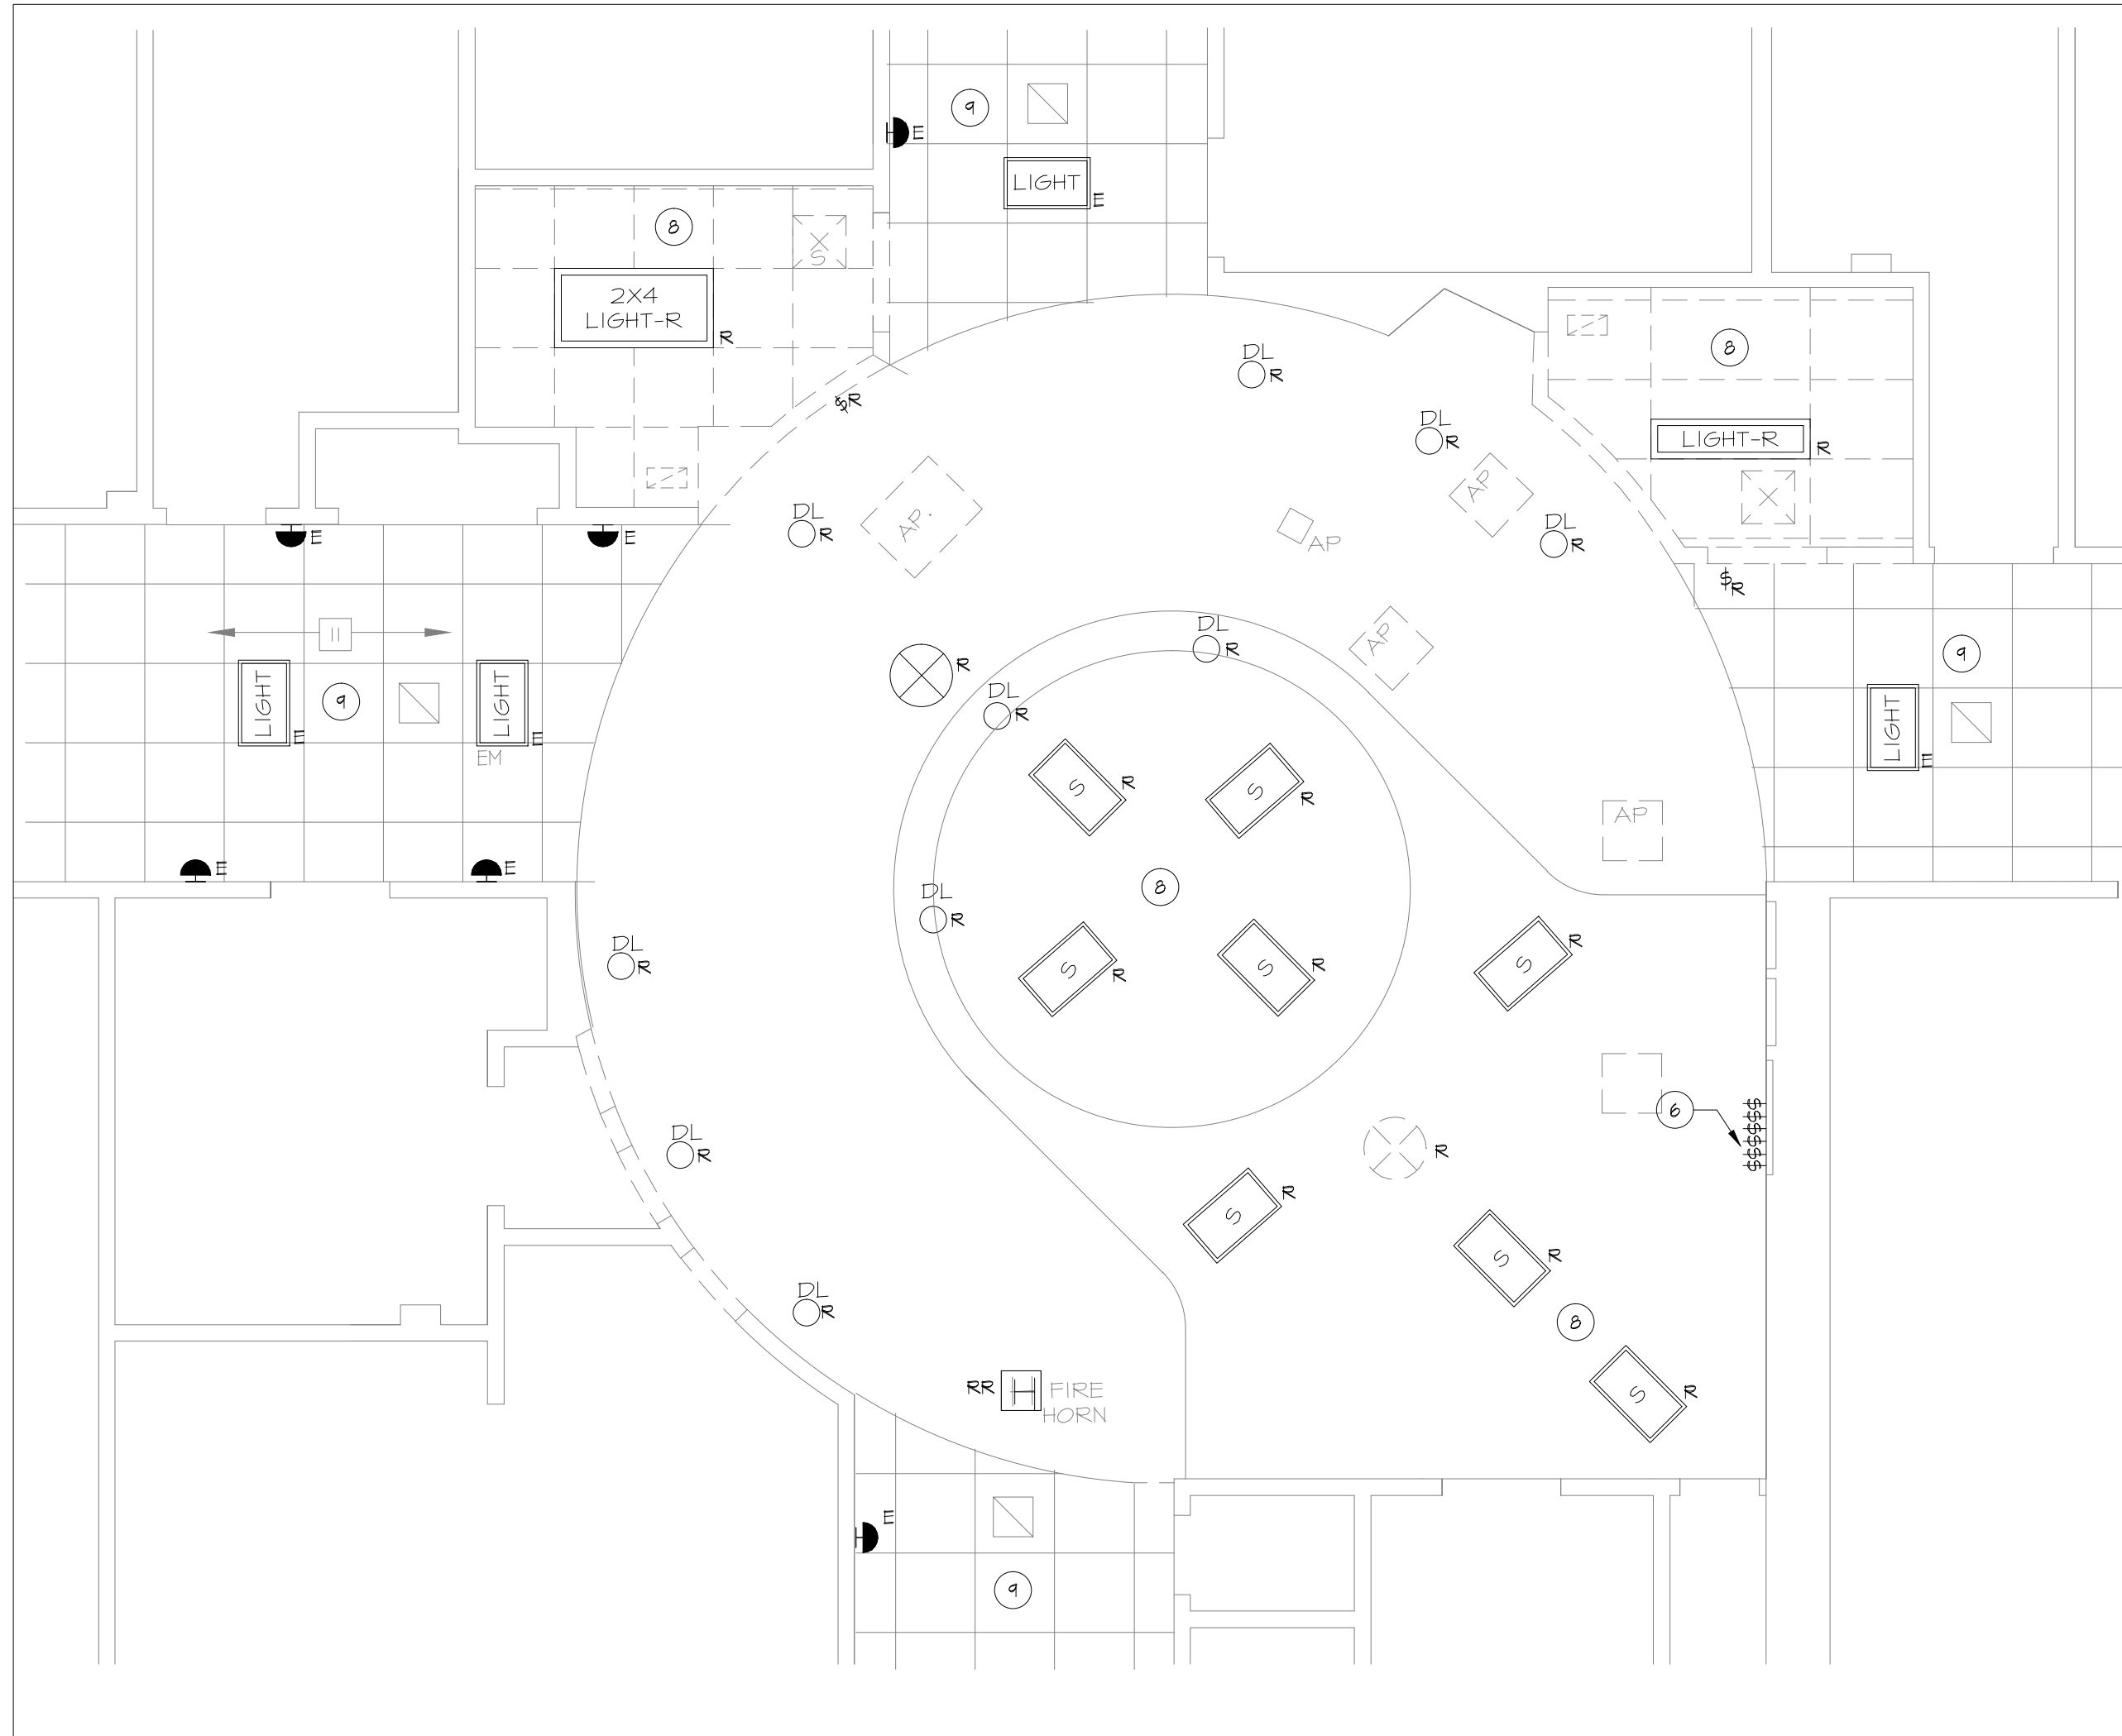
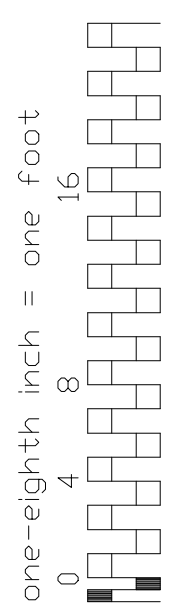
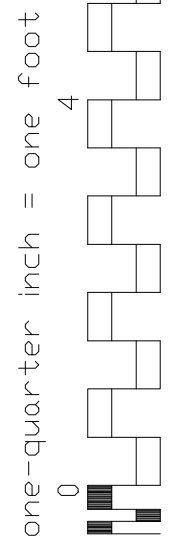
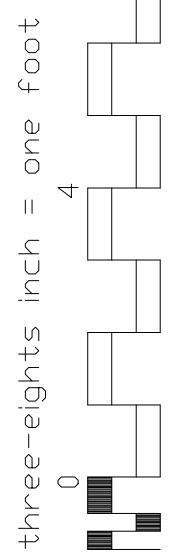
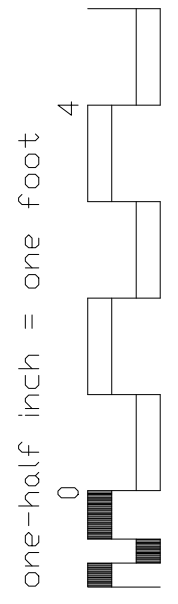
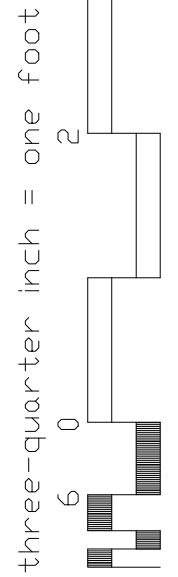
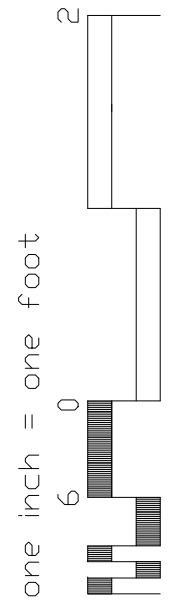


IF THIS SHEET IS NOT 30" x 42"
FULL SIZE, USE GRAPHIC SCALES

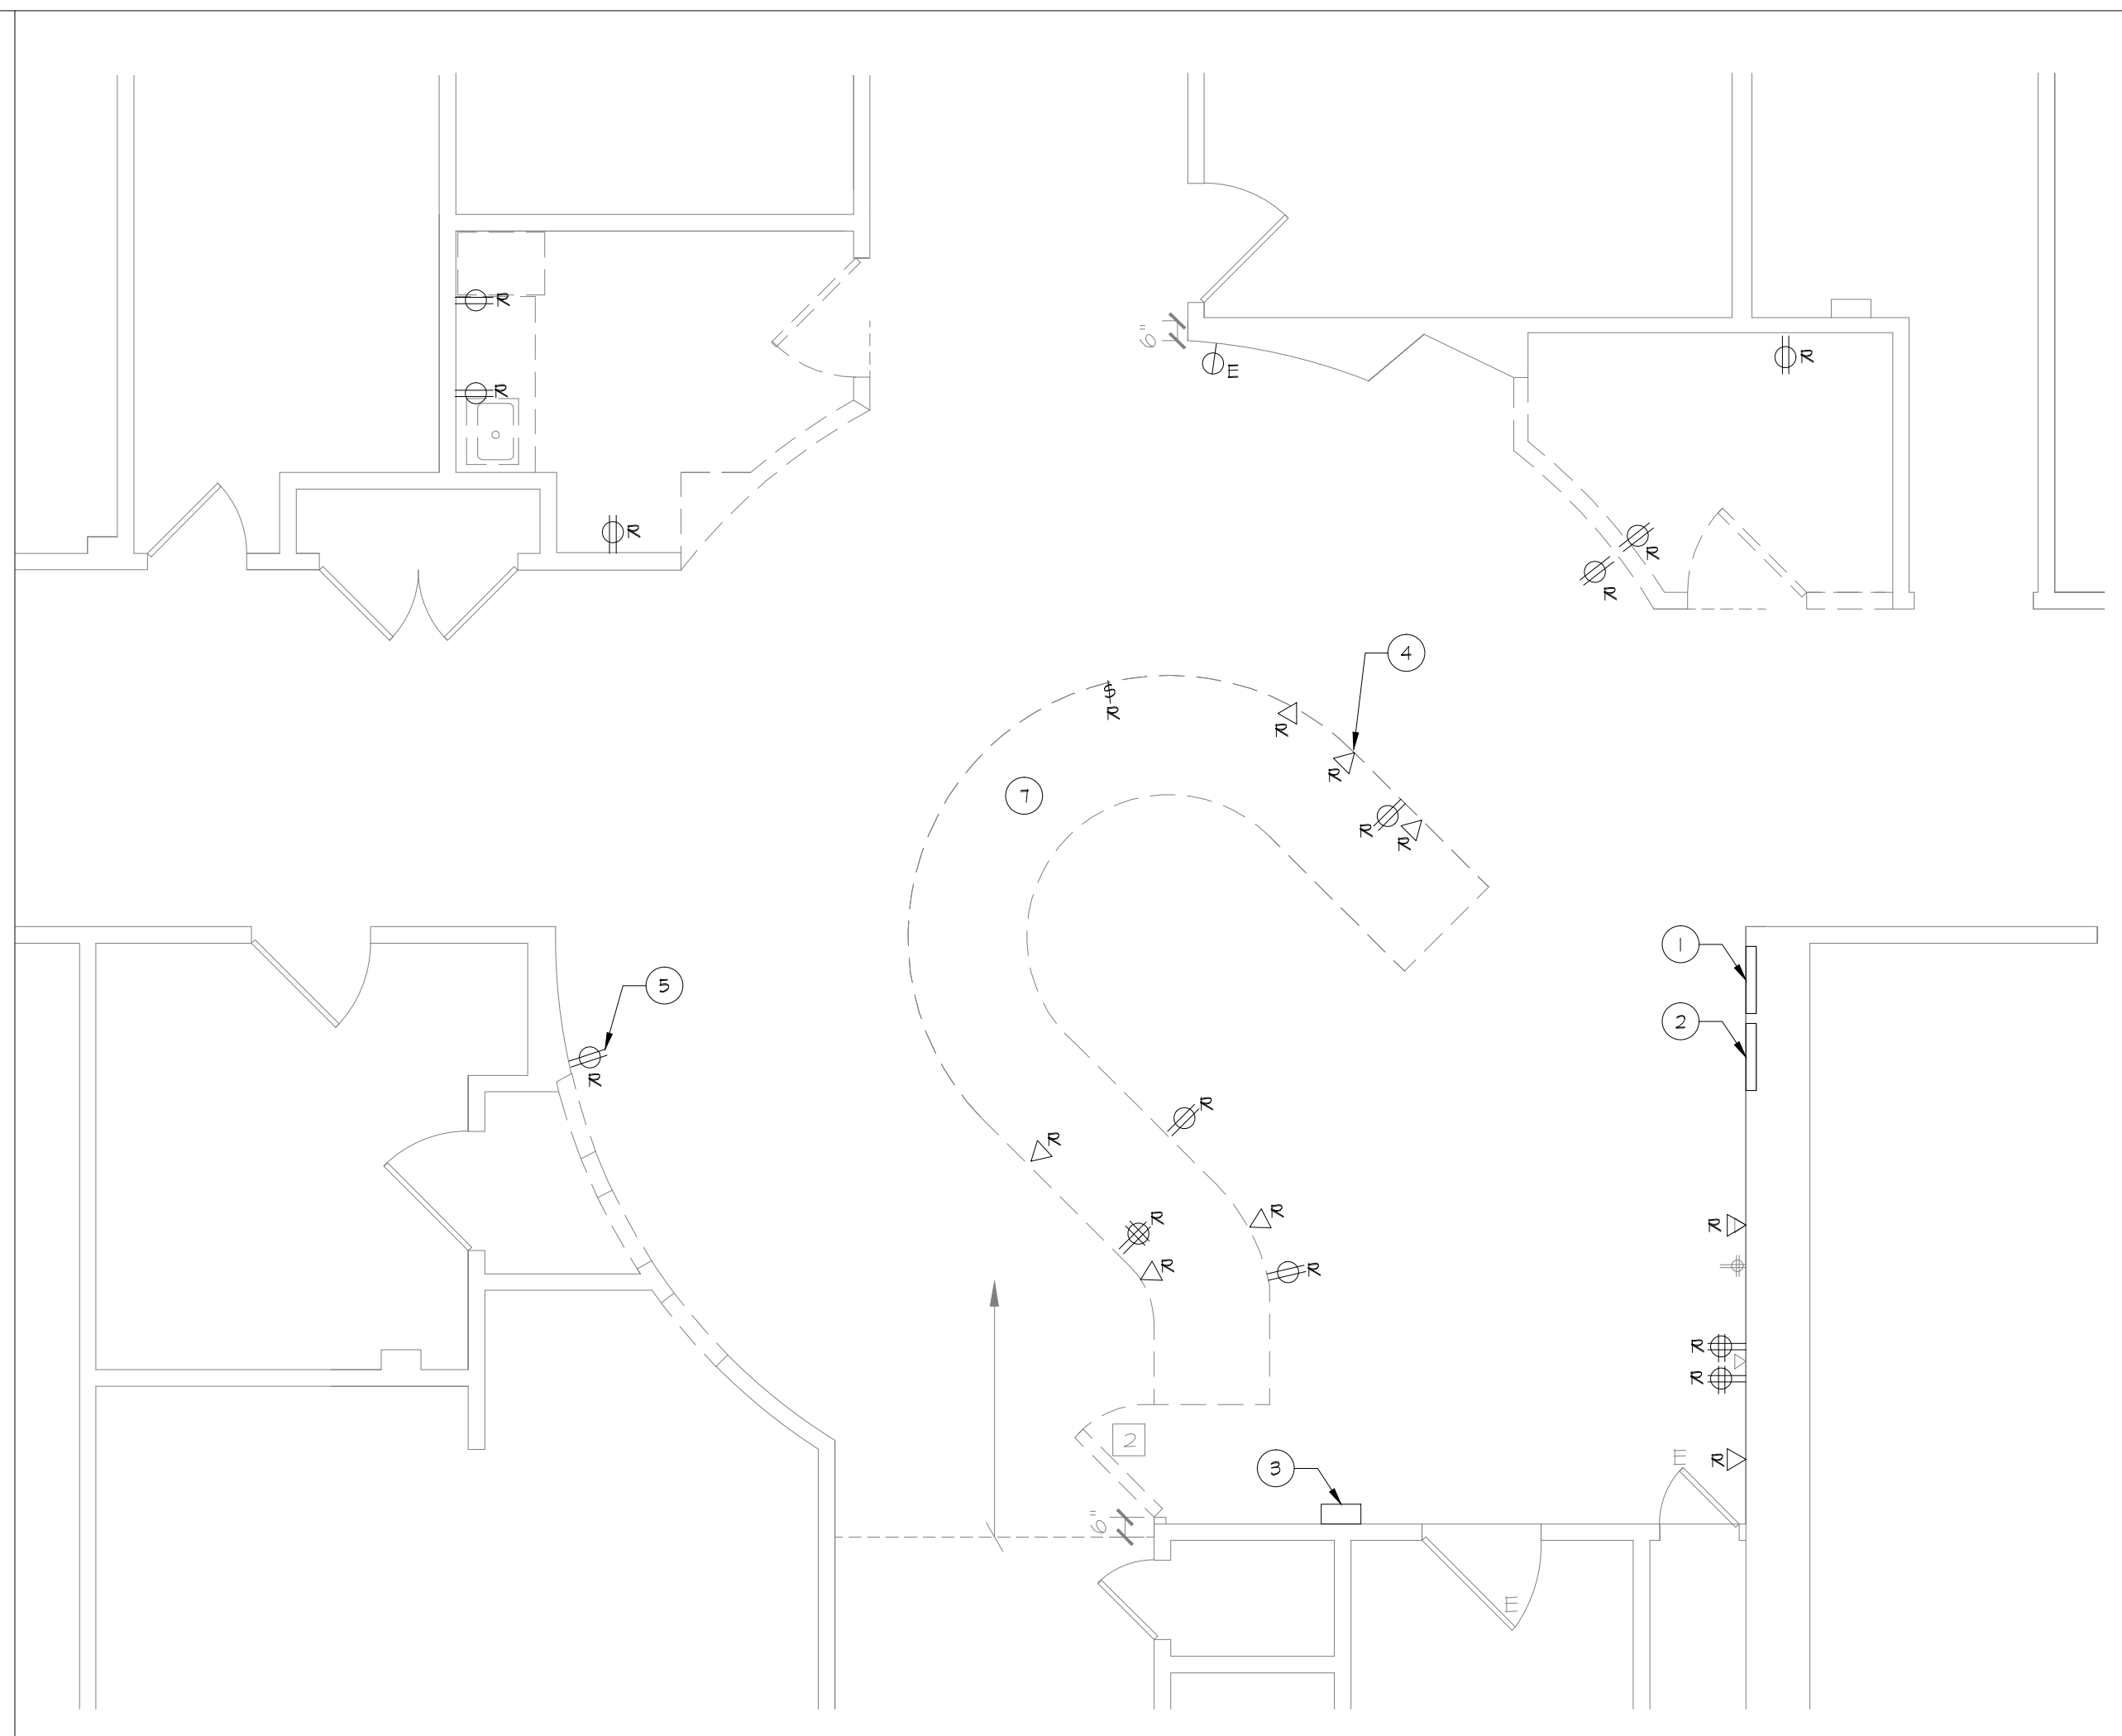


1 ELECTRICAL LIGHTING DEMOLITION PART PLAN
Scale : 1/4" = 1'-0"

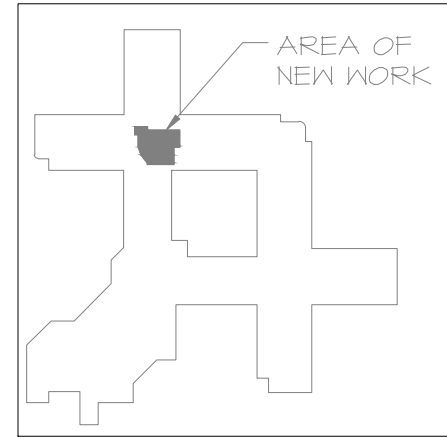



2 ELECTRICAL POWER DEMOLITION PART PLAN
Scale : 1/4" = 1'-0"

SYMBOL LIST POWER - DEMOLITION	
	DUPLEX RECEPTACLE
	QUAD RECEPTACLE
	SIMPLEX RECEPTACLE
	TEL/DATA OUTLET
	OUTLET BOX WITH BLANK COVER
	KEYED NOTE
	"R" NEXT TO SYMBOL INDICATES EXISTING TO BE REMOVED
	"T" NEXT TO SYMBOL INDICATES EXISTING TO REMAIN
	"RR" NEXT TO SYMBOL INDICATES EXISTING TO BE REMOVED AND REINSTALLED - REFER TO E-3 AND E-4 FOR NEW LOCATIONS
	EXISTING 2X4 LIGHT FIXTURE
	EXISTING 2X2 LIGHT FIXTURE
	EXISTING DOWNLIGHT FIXTURE
	EXISTING EXIT SIGN
	SWITCH
	WALL SCONCE
	FIRE ALARM HORN

KEYED NOTES - LIGHTING AND POWER DEMO	
1	EXISTING INTERPASE WATCHMATE CONTROLLER TO REMAIN IN OPERATION
2	EXISTING OXYGEN SYSTEM SHUTOFF TO REMAIN IN OPERATION
3	EXISTING GAS ALARM PANEL TO REMAIN IN OPERATION
4	EXISTING DATA OUTLET FOR NURSES CALL SYSTEM TO BE REMOVED. BEFORE REMOVAL OF DATA OUTLET INSTALL A TEMPORARY DATA OUTLET WITH CONNECTION TO NURSES CALL SYSTEM @ LOCATION DETERMINED BY VAMC RESIDENT ENGINEER.
5	DIGITAL READOUT FOR NURSES CALL SYSTEM TO REMAIN AT THIS LOCATION UNTIL NEW POWER RECEPTACLE AND DATA CONNECTIONS ARE INSTALLED IN NEW LOCATION - SEE DRAWING E-3. COORDINATE WITH VAMC RESIDENT ENGINEER PRIOR TO REMOVAL
6	LIGHT SWITCHES TO REMAIN
7	DISCONNECT AND REMOVE ALL FLOOR SLAB CONDUITS FOR POWER & COMMUNICATION TO NURSES STATIONS. PATCH & FIREPROOF FLOOR AS REQUIRED.
8	DISCONNECT AND REMOVE ALL BRANCH CIRCUIT WIRING FOR EXISTING LIGHT FIXTURES TO BE REMOVED.
9	MAINTAIN CONTINUITY OF ALL EXISTING LIGHT FIXTURES TO REMAIN.

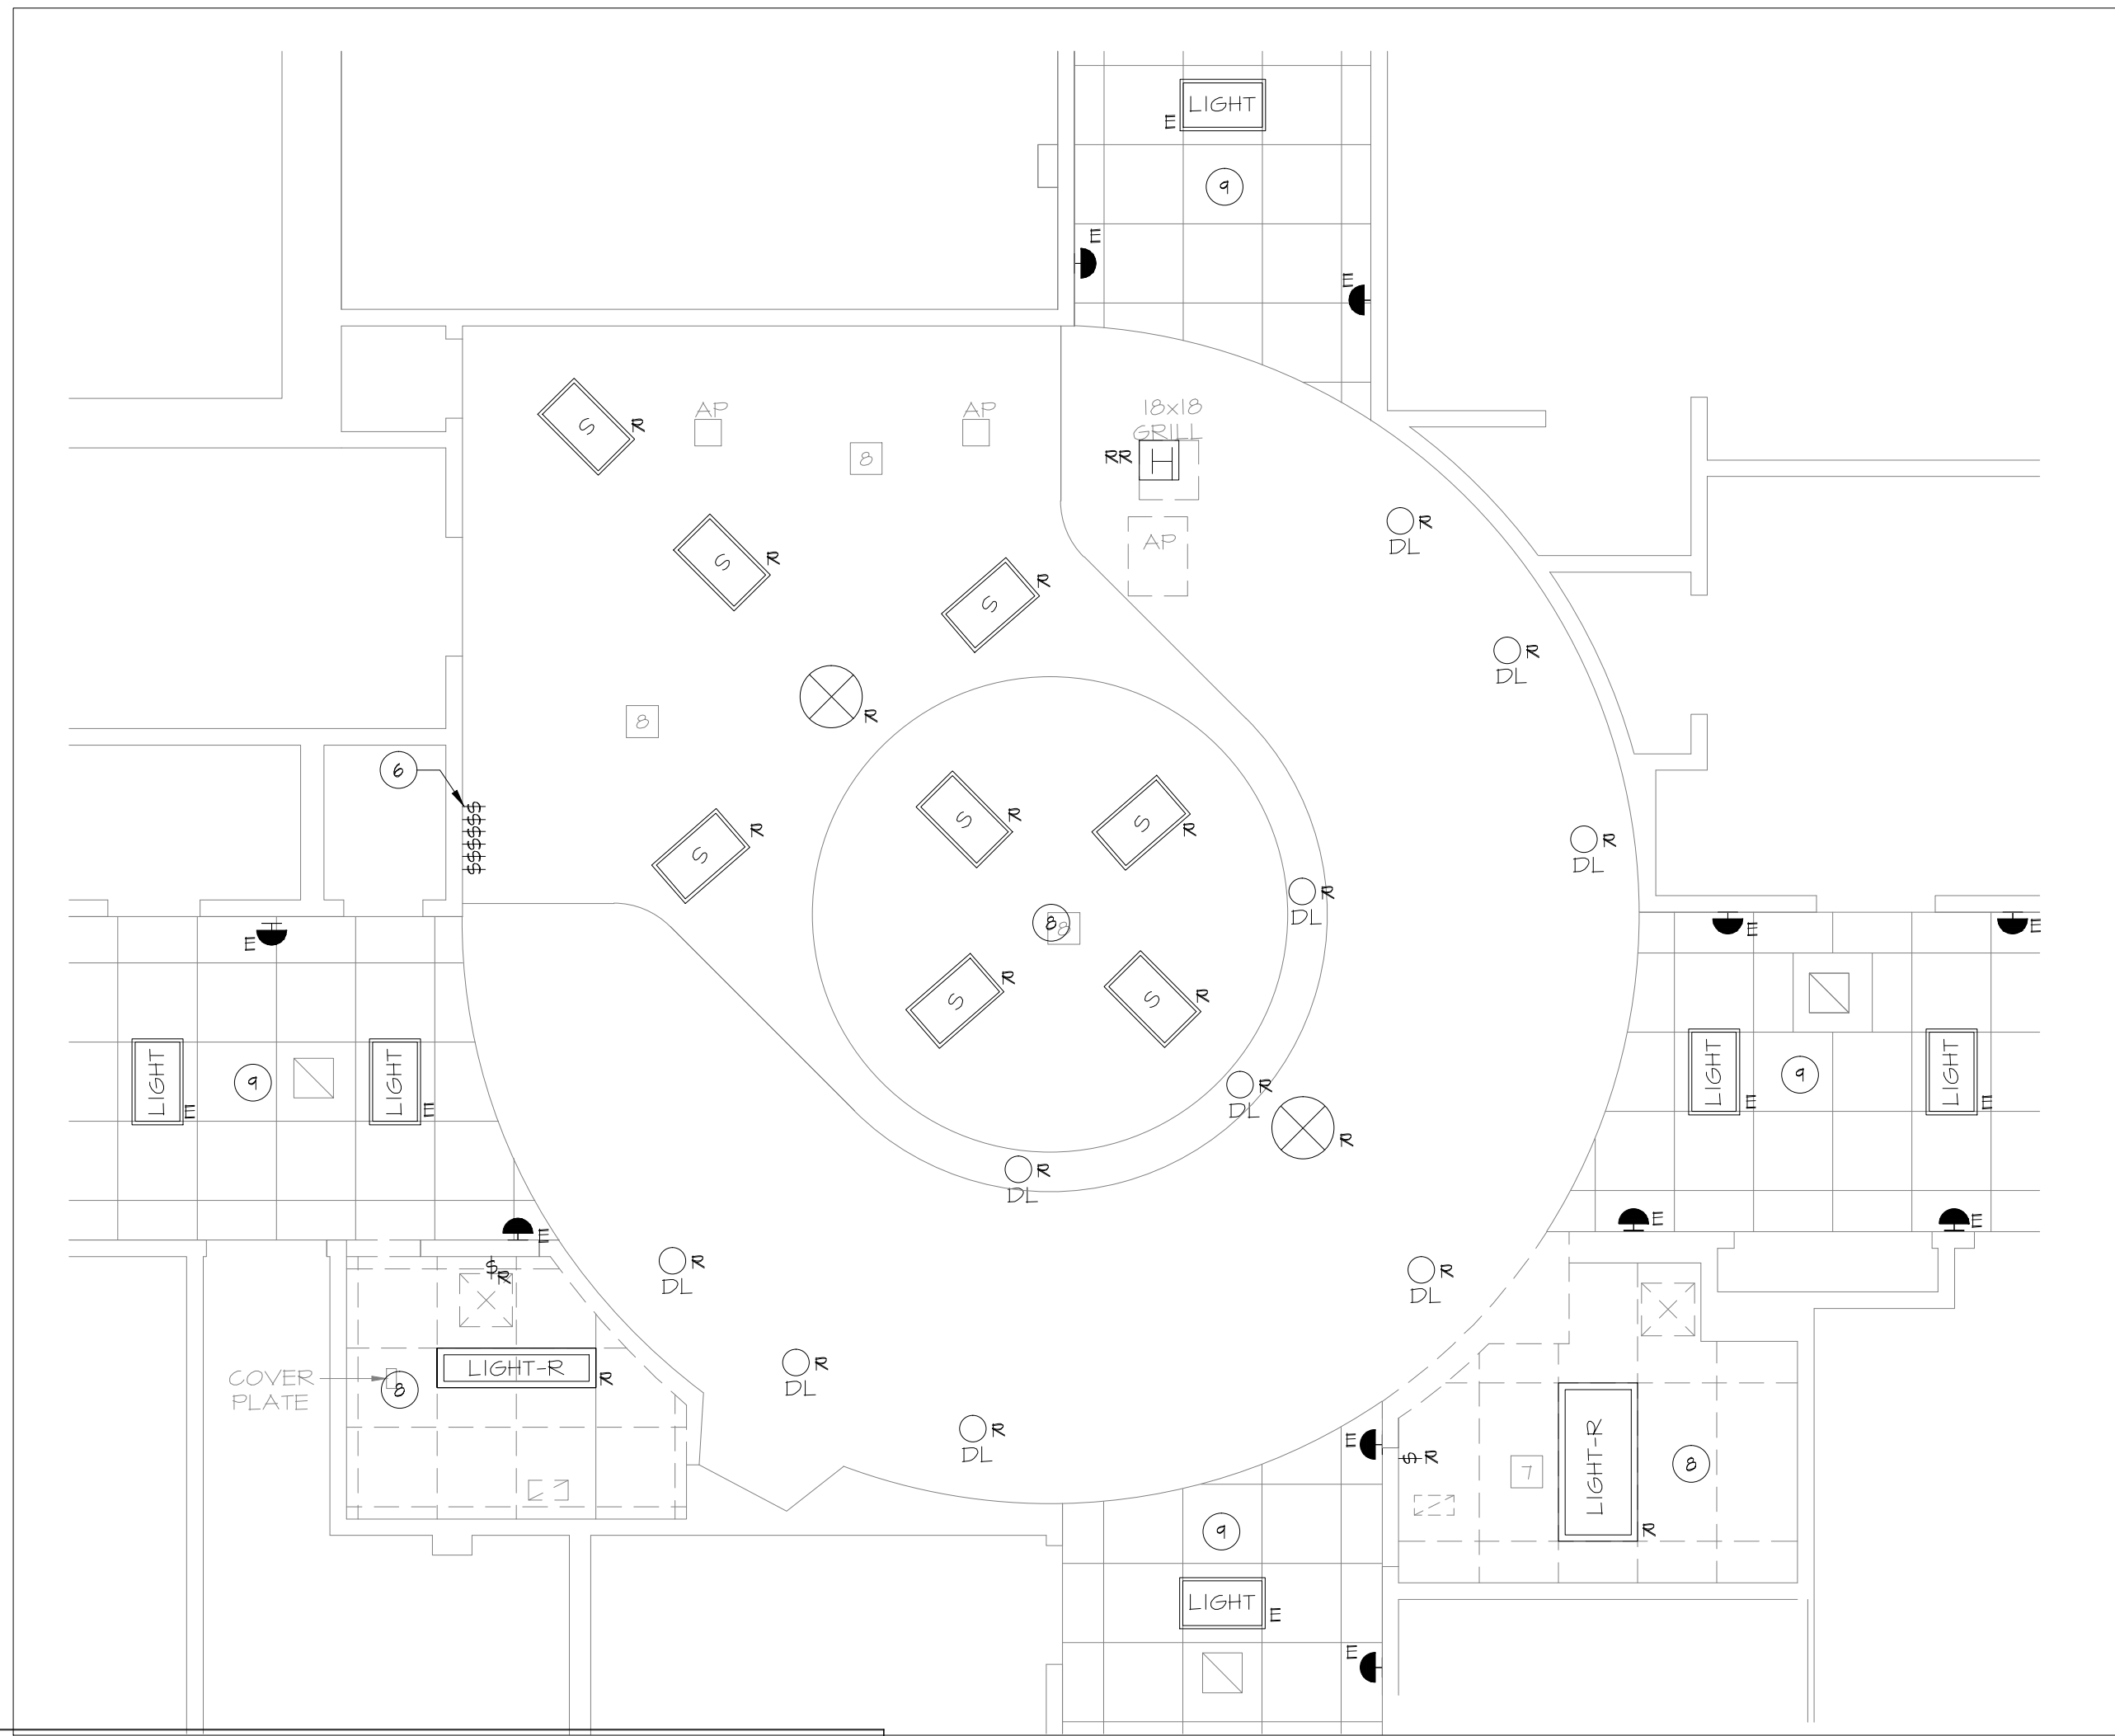


3 ELECTRICAL LIGHTING DEMOLITION PART PLAN
Scale : 1/4" = 1'-0"

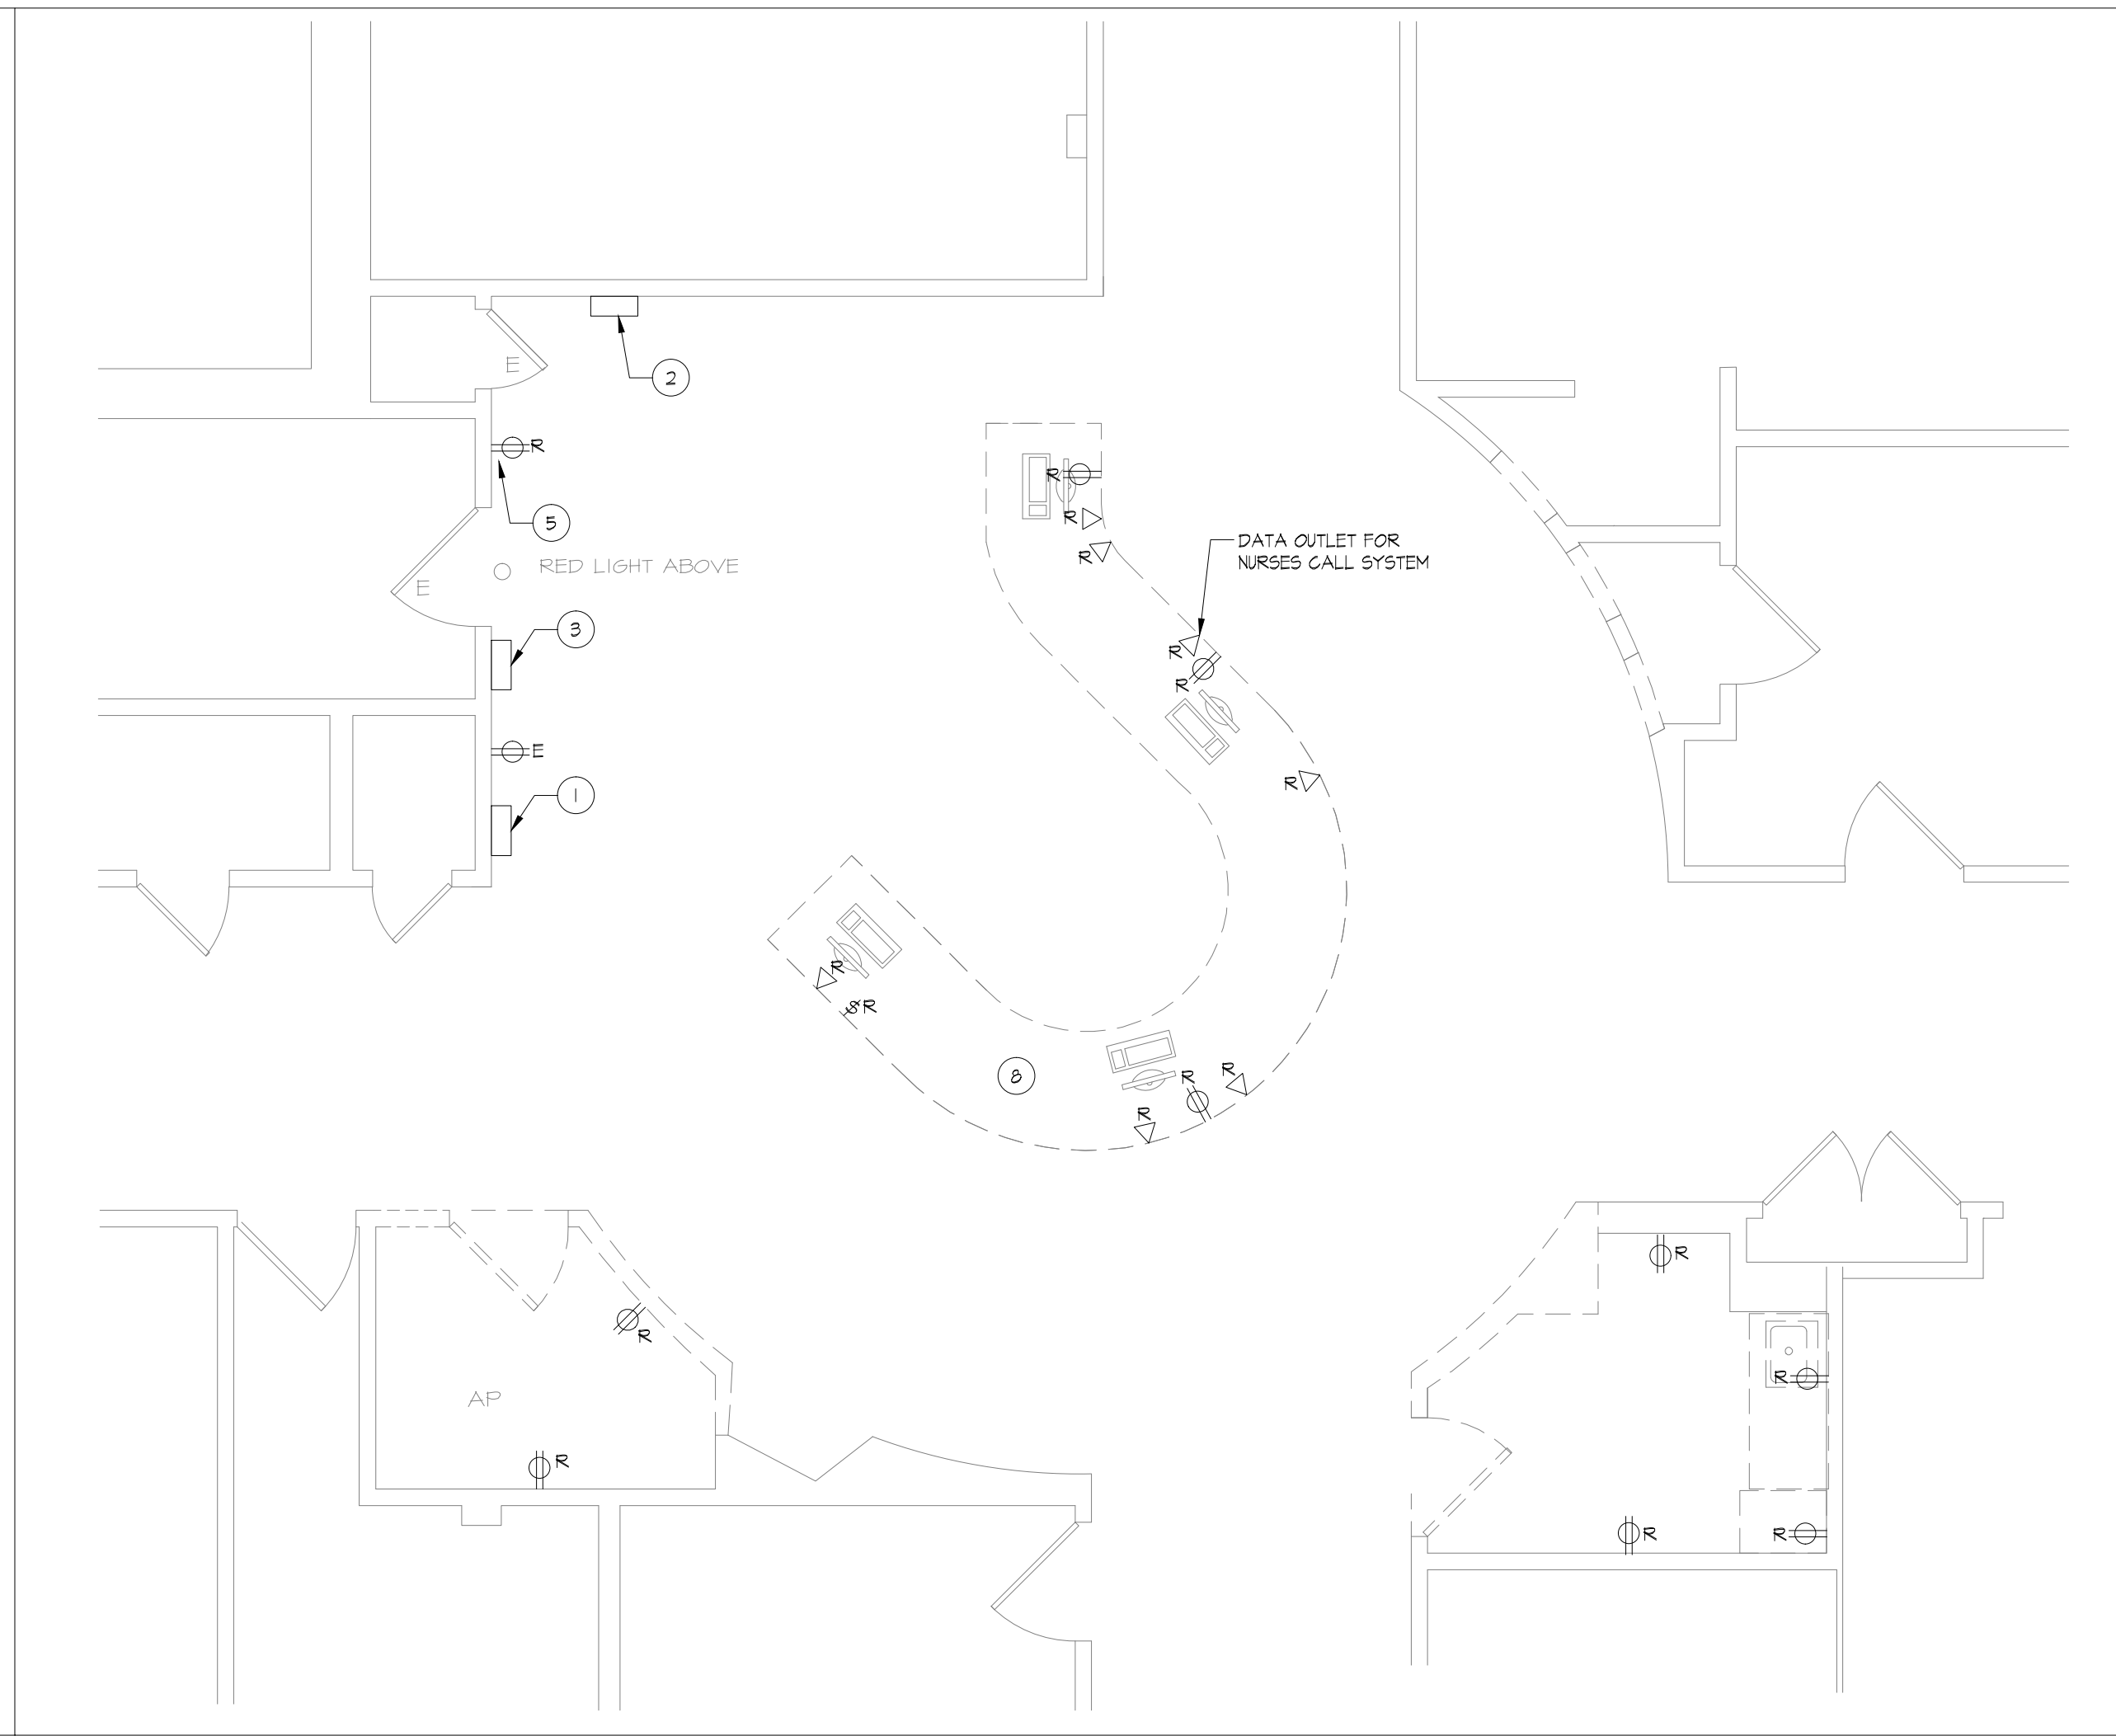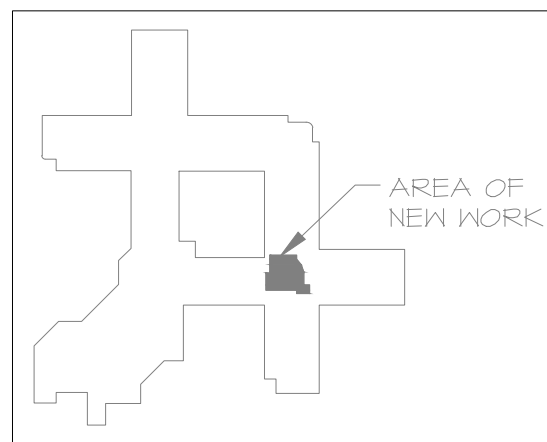

4 ELECTRICAL POWER DEMOLITION PART PLAN
Scale : 1/4" = 1'-0"

EMTG
Consulting Engineers
TEL: 212-268-6465 FAX: 212-268-6467
115 WEST 30TH STREET, SUITE 202, NEW YORK, NY 10001

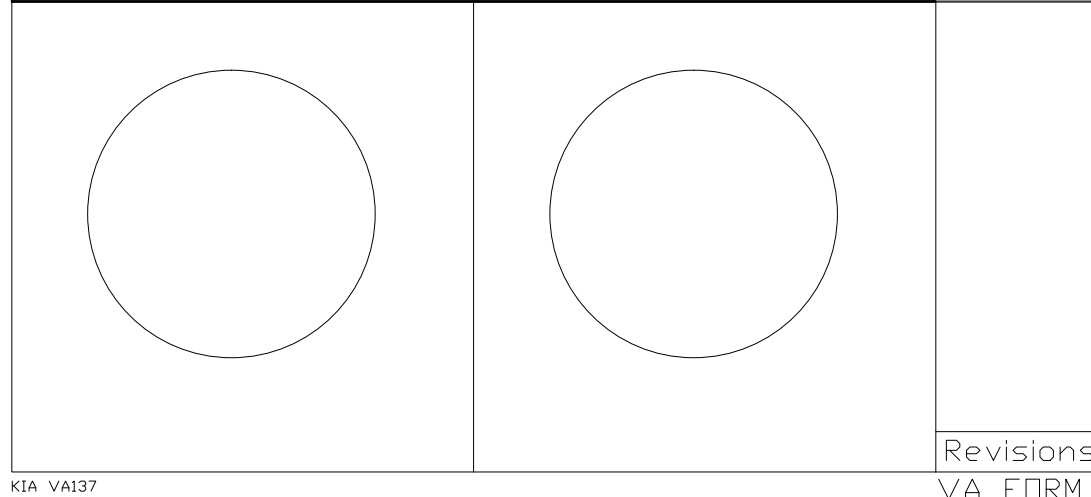


Revisions
VA FORM 08-6231, DEC 1989

Date

KI
KENNETH IRVING, ARCHITECT P.C.
42 MEMORIAL PLAZA, SUITE 301, PLEASANTVILLE, NY 10570
PHONE: (914) 747-0002 E-MAIL: mandraoe@kiarch.com FAX: (914) 747-9211

NOTE AND READ CAREFULLY:
The Contractor shall consult and study the requirements of each and every drawing and each specification section of this contract so that he/she may become acquainted with the project as a whole in order to determine how the work of his/hers subcontractor or vendor may affect the work required under this contract.
Written Specifications are part of this contract

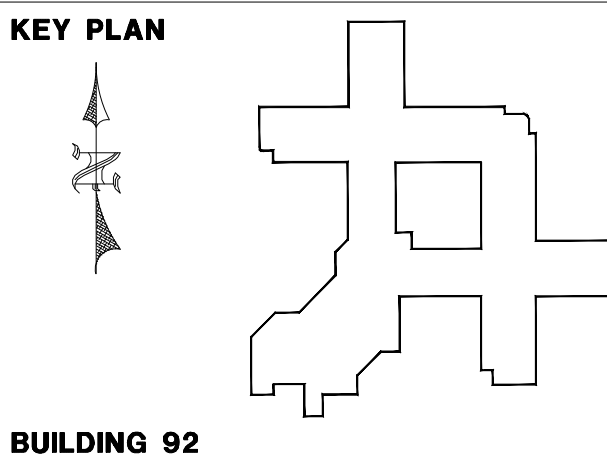

Drawing Title
ELECTRICAL POWER AND LIGHTING DEMOLITION PART PLANS
Approved: Division Chief
Approved: Service Director

Project Title
Implement Community Living Center Cultural Transformation
Building Number
92
Checked
MA
Drawn
MA/DC
Location
Northport, New York

Date
3/30/2012
Project No.
632-08-123
DRAWING NO.
E-1
Dwg. & Cof 34



U.S. GOVERNMENT PRINTING OFFICE: 1983-400-250