

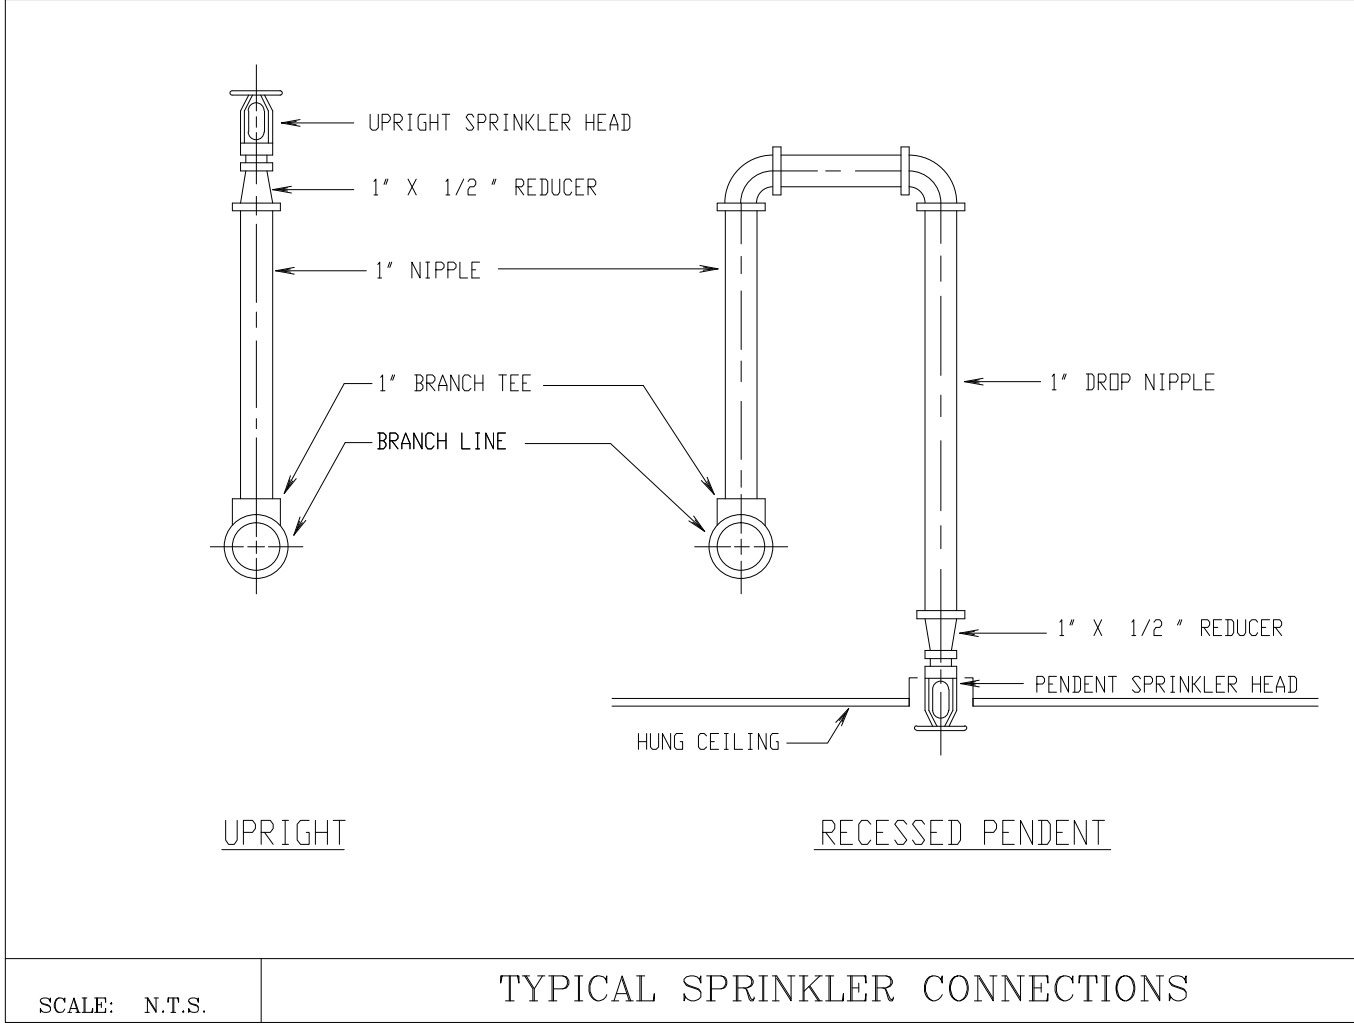
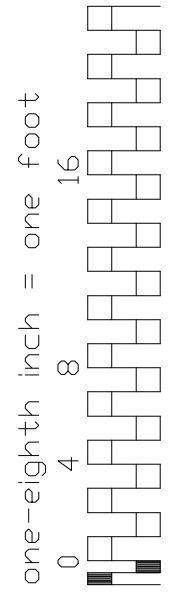
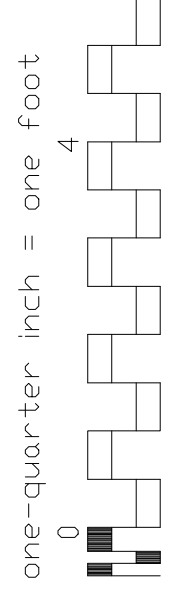
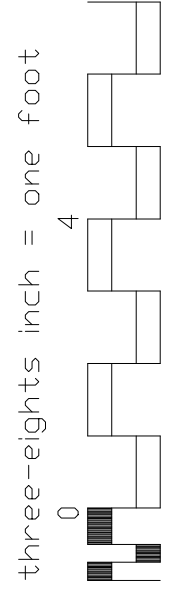
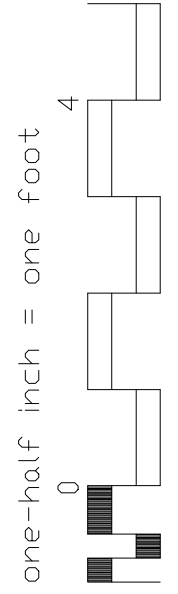
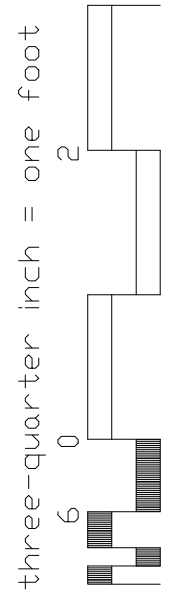
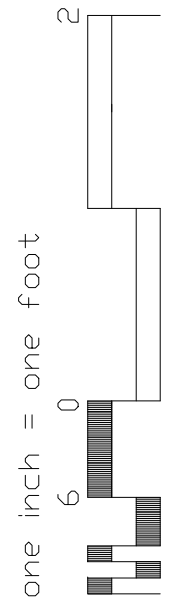


IF THIS SHEET IS NOT 30" x 42"
FULL SIZE, USE GRAPHIC SCALES

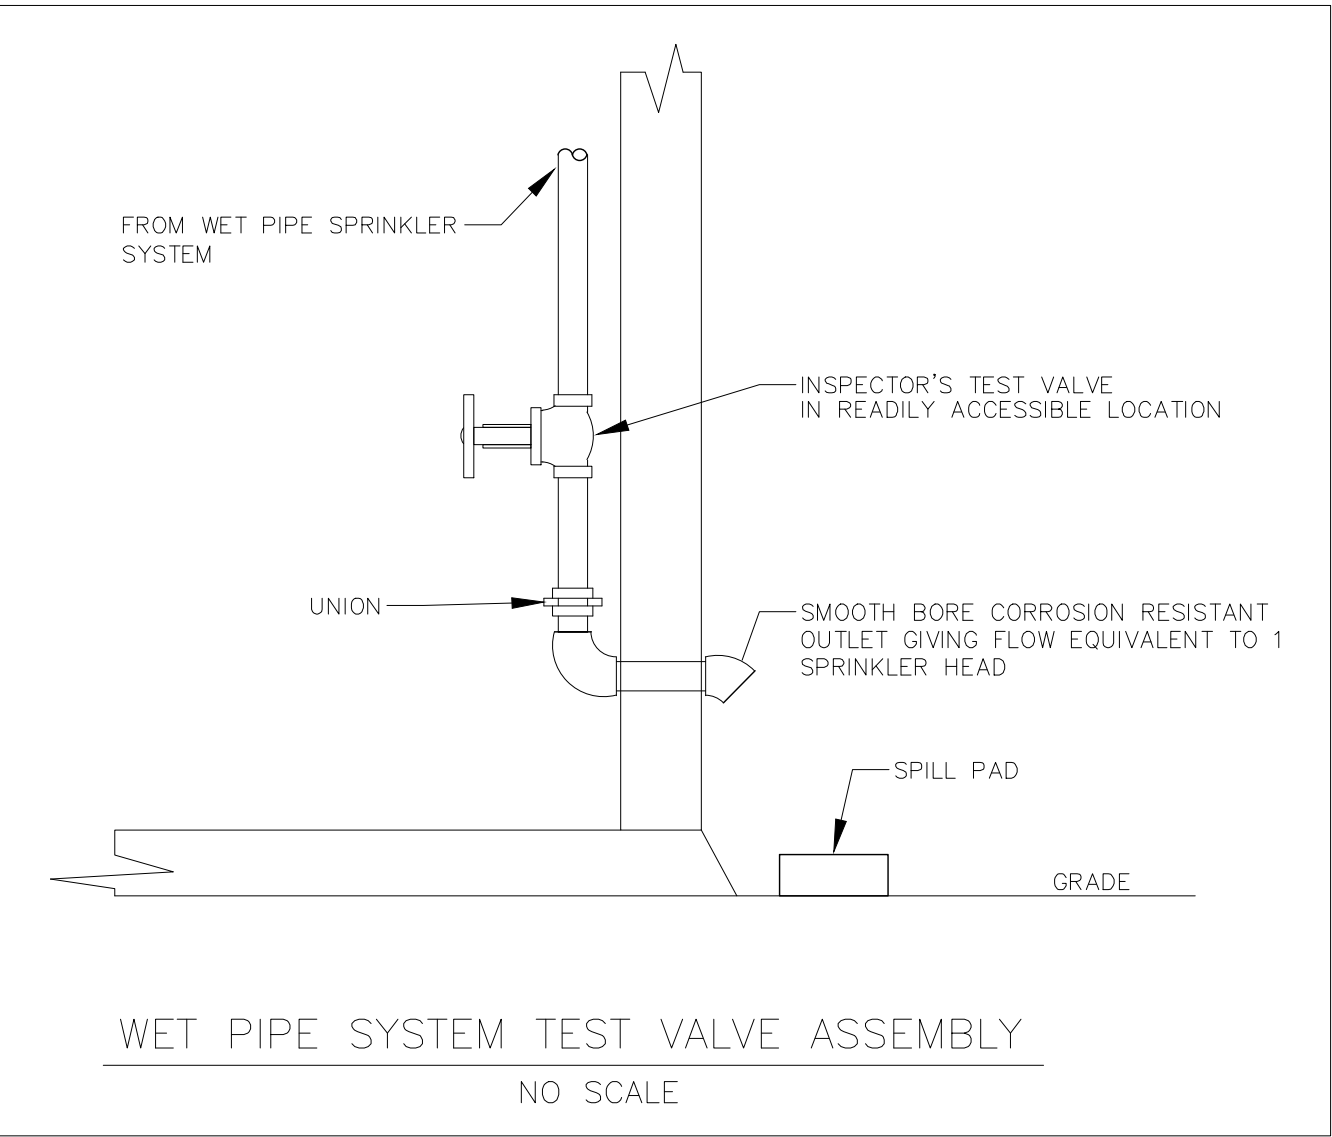

DETAIL OF PIPING PIERCING FIRE RATED
PARTITIONS, WALLS & FLOORS.

- (A) PACK ALL SPACES FULL DEPTH
W/MINERAL WOOL OR OTHER
EQUALLY APPROVED FIRE
RESISTIVE MATERIAL. (ASBESTOS
OR FIBERGLASS SHALL NOT BE USED)
- FIRE RESISTANT FOAM SEALANT
CHASE FOAM CTC P2-655 N.Y.C.
MEA 58-74 ME & IJ MAY BE USED.
INSTALLATION AS PER MANUFACTURER.
- (B) ESCUTCHEON BOTH SIDES.
- (C) SLEEVE
- (F) FIRE RATED PARTITION,
WALL OR FLOOR.
- (I) MAXIMUM 1/2" CLEARANCE
BETWEEN INSIDE OF SLEEVE
& PIPE.

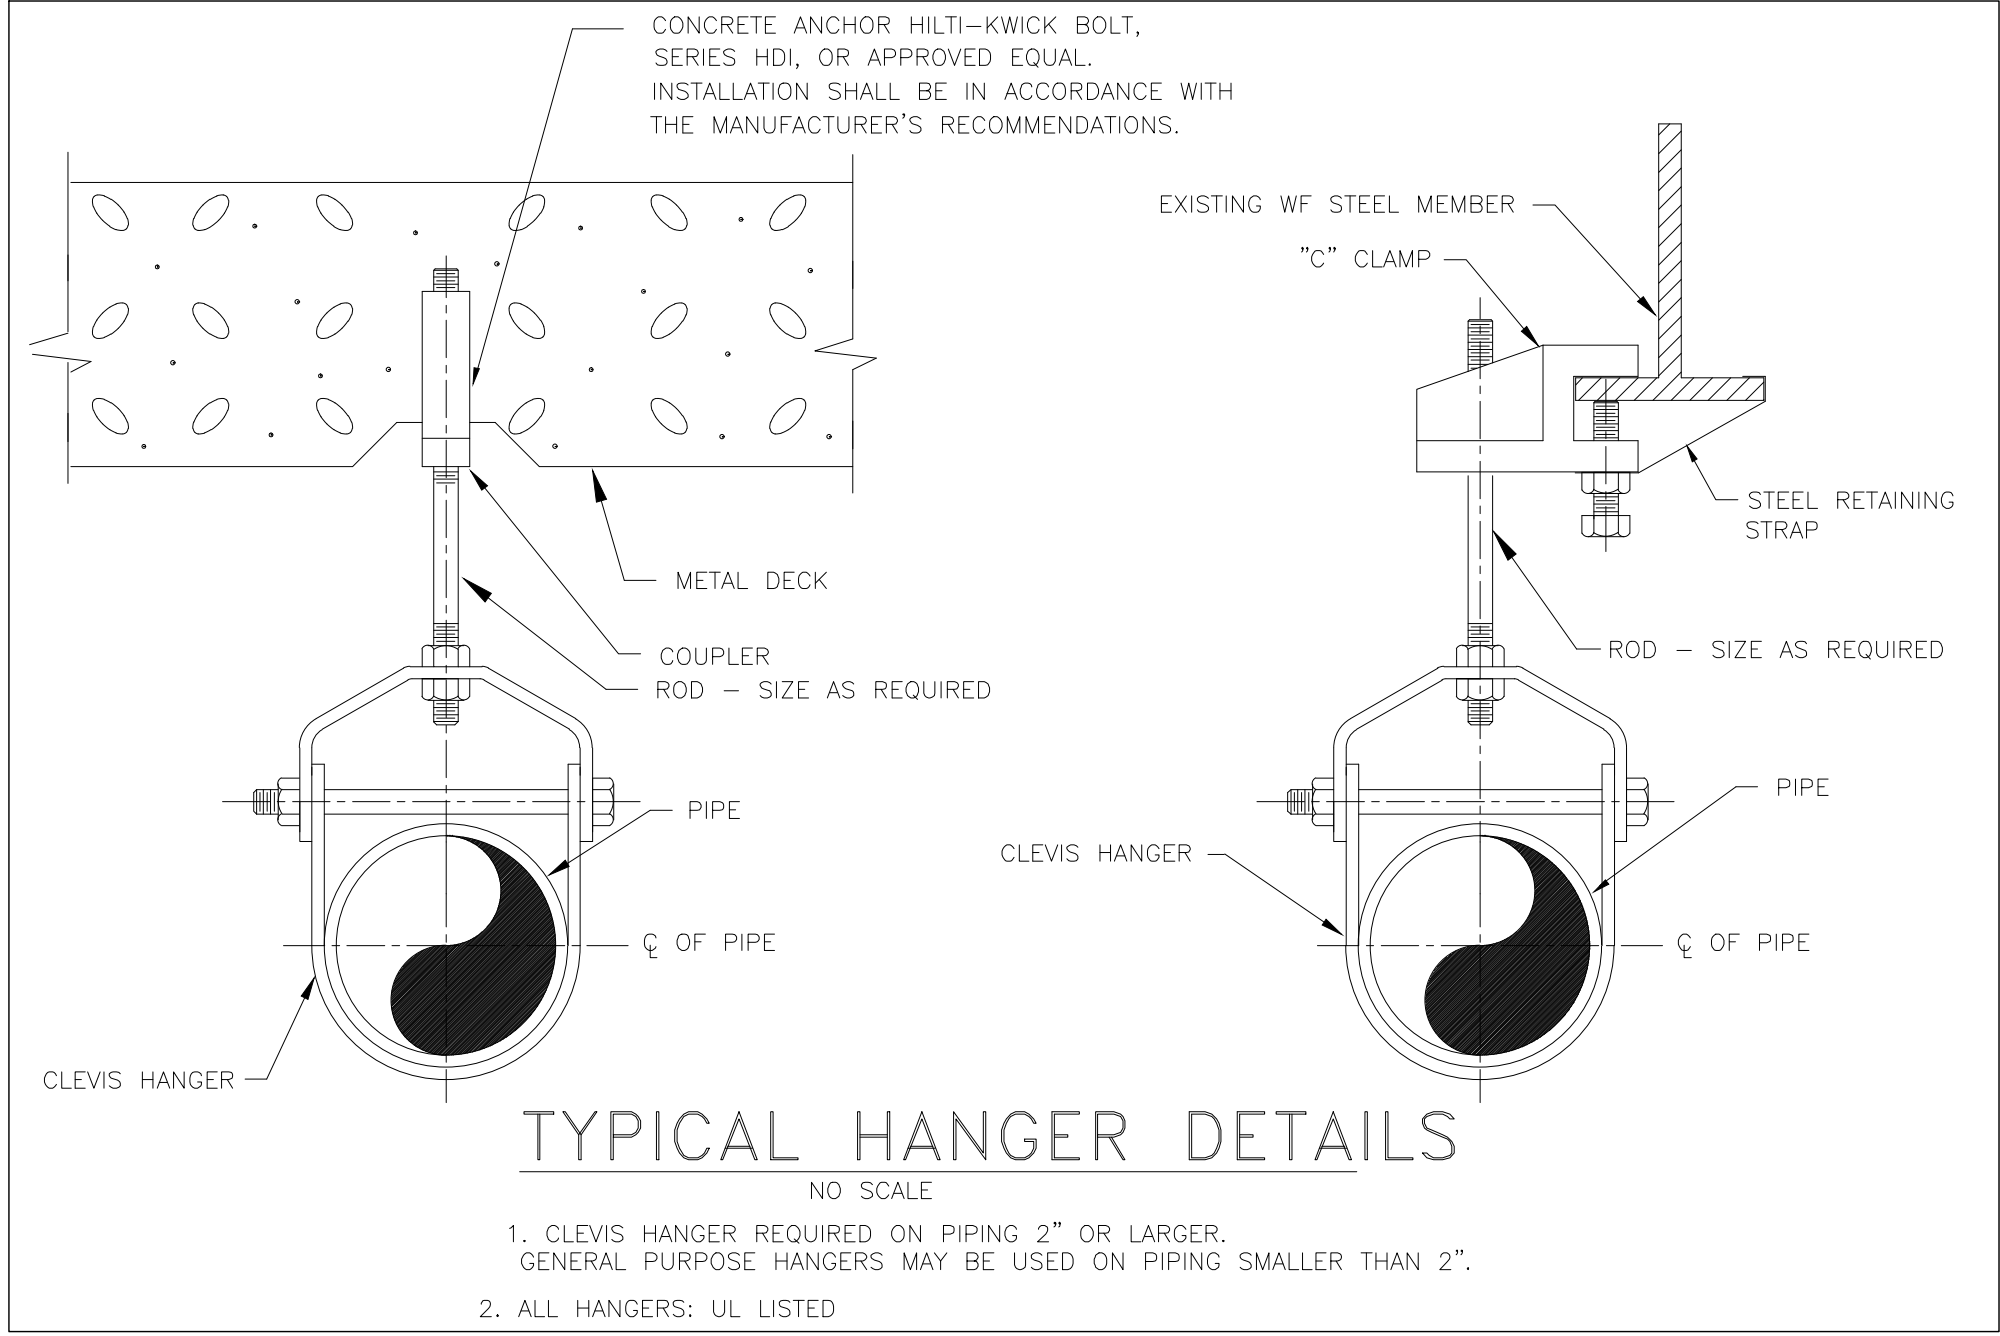

EMTG
Consulting Engineers

TEL: 212-268-6465 FAX: 212-268-6467

115 WEST 30TH STREET, SUITE 202, NEW YORK, NY 10001

Revisions

Date

KENNETH IRVING, ARCHITECT P.C.

2 MEMORIAL PLAZA SUITE 301, PLEASANTVILLE, NY 10570

PHONE: (914) 747-0002 E-MAIL: mandrade@kiarch.com FAX: (914) 747-9211

NOTE AND READ CAREFULLY:

The Contractor shall consult and study the requirements of each and every drawing and each specification section of this contract so that he/she may become acquainted with the project as a whole in order to determine how the work of his/hers subcontractor or vendor may affect the work required under this contract.

Written Specifications are part of this contract

KEY PLAN

BUILDING 92

Drawing Title
SPRINKLER DETAILS

Approved: Division Chief

Approved: Service Director

Project Title
Implement Community Living
Center Cultural Transformation

Building Number
92

Checked
MA

Drawn
MA/DC

Location
Northport, New York

Date
3/30/2012

Project No.
632-08-123

DRAWING NO.
SP-2

Dwg. 280f 34

Office of Facilities

DEPARTMENT OF
VETERANS AFFAIRS