




A. MECHANICAL CONTRACTOR SHALL COMMUNICATE AND COORDINATE WITH OWNER ANY SHUT DOWN OF EXISTING SYSTEMS OR SPACES IN WRITING AND RECEIVE APPROVAL A MINIMUM OF SEVEN (7) DAYS PRIOR TO EVENT.

B. BRANCH LINES SERVING TERMINAL UNITS TO BE INSTALLED WITH BALL VALVES AT THE TAP IN THE CORRIDOR.

1. NEW 2" LPR. CONNECT TO EXISTING WITH GATE VALVE.
2. NEW 2 1/2" CH/CR. CONNECT TO EXISTING WITH BALL VALVES.
3. NEW 2 1/2" LPS. CONNECT TO EXISTING WITH GATE VALVE.
4. NEW PIPING DOWN TO GROUND FLOOR.
5. NEW REFRIGERANT LINES.
6. EXISTING 1 1/4" HWS/R. PROVIDE AND INSTALL A DRIP PAN UNDER THESE PIPES RUNNING THRU IT CLOSET.
7. EXISTING 6" HWS/R RISERS
8. EXISTING 6" CH/CR RISERS
9. TAP EXISTING 6" HWS/R RISERS IN CHASE WITH 2 1/2" BRANCH TAPS DOWN LOW AND RISE UP IN CHASE TO EXIT CHASE WHERE SHOWN.
10. ROUTE 3/4" DRAIN LINE FROM CEILING CASSETTE DOWN WALL TO MOP BASIN.
11. CONNECT TO EXISTING 1" DRAIN LINE AND EXTEND OVER AND DOWN IN WALL AS SHOWN.
12. RUN NEW 1" CONDENSATE LINE DOWN TO WALL BOX BY PC AND CONNECT WITH AIR GAP. SEE DETAIL.
13. PROVIDE 3-WAY VALVE THIS TERMINAL UNIT.
14. ROUTE REFRIGERANT LINES UP TO 5TH FLOOR CEILING AND TURN OUT INTO CORRIDOR AS SHOWN.
15. CONDENSING UNIT 2-AAC1 MOUNTED ON 5TH FLOOR ROOF
16. SET FOR 8.50 GPM
17. SET FOR 18.50 GPM
18. RUN CENTER LINE OF PIPING AT APPROX. 9'-0" ABOVE FINISHED FLOOR SO THAT PIPING WILL JUST PASS UNDER CORRIDOR BEAMS.
19. NEW DDC CONTROL PANEL FOR 2-AHU4

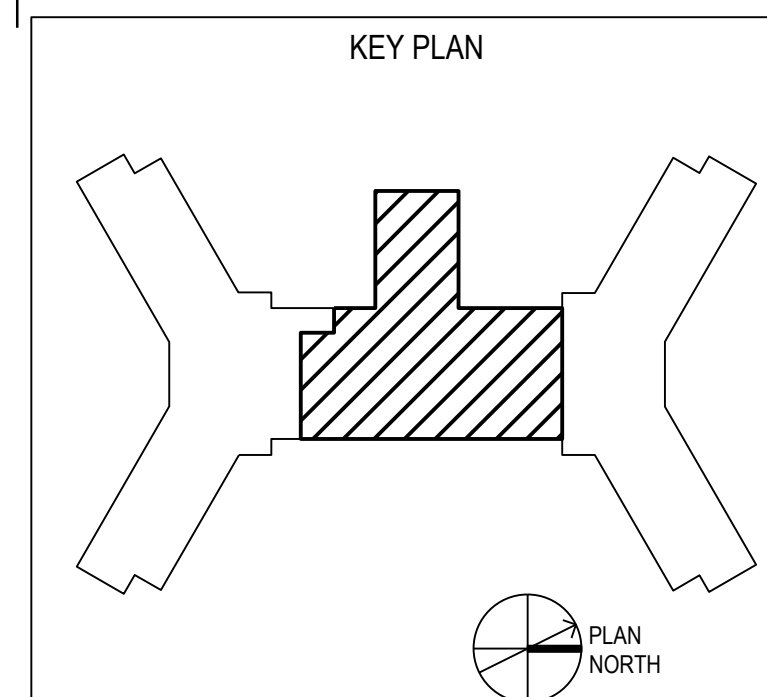

Office of
Construction
and Facilities
Management

 Department of
Veterans Affairs

		CONSULTANTS:		SEAL		ARCHITECT/ENGINEERS:		Drawing Title		Project Title		Project Number		<div>Office of Construction and Facilities Management</div> <div> Department of Veterans Affairs</div>					
		<div><div> FreemanWhite <small>a Heickel Company</small></div><div> LogGrand Engineering, Inc. <small>215 PARK AVE SE MARIETTA, GA 30067 PHONE: 770.522.0457 FAX: 770.522.0499 www.loggrandengineering.com</small></div><div> LAURENCE, RICKNER & SORELL, P.C. <small>8701 RED OAK BLVD., SUITE 500 CHARLOTTE, NC 28217-5593 PHONE: 704.522.0405 FAX: 704.522.0499 www.lrsopc.net</small></div></div>				<div><div> Atriax GROUP</div><div><p>Atriax, PLLC 102 3rd Avenue, NE PO Box 1629, Hickory, NC 28603 T: 828.315.9962 F: 828.315.9964</p><p>www.atriaxgroup.com</p></div></div>				THIRD FLOOR PLAN - PIPING		RENOVATE BUILDING 2 FOR MEDICAL SURGICAL MODERNIZATION				659-17-101			
								Approved: Project Director		Location W.G. HEFFNER VAMC SALISBURY, NC		Drawing Number MP103							
ADDENDUM A		8/08/18								<table><tr><th>Date</th><th>Checked</th><th>Drawn</th></tr><tr><td>MAY 1, 2018</td><td>HAS</td><td>GLR</td></tr></table>		Date	Checked	Drawn	MAY 1, 2018	HAS	GLR	Dwg. 07 of 17	
Date	Checked	Drawn																	
MAY 1, 2018	HAS	GLR																	