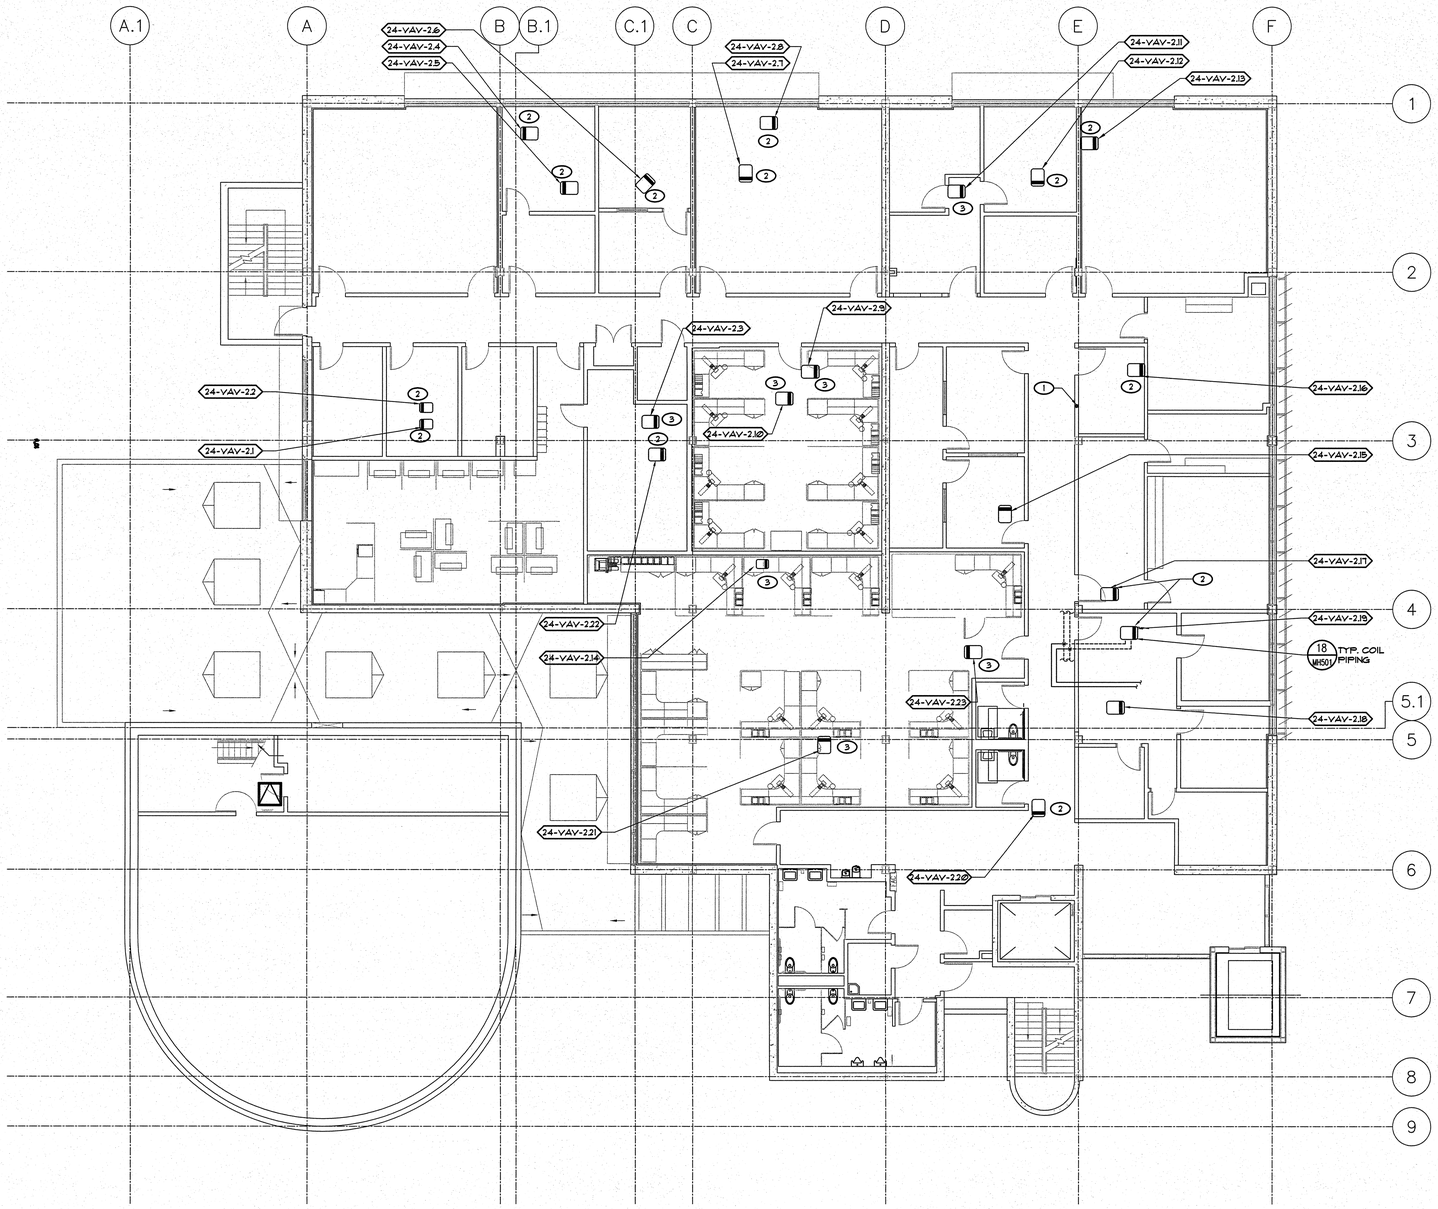

1 FIRST FLOOR MECHANICAL REMODEL PIPING PLAN
SCALE: 1/8" = 1'-0"

KEY NOTES

1. REFRIGERANT PIPING DROPS IN WALL FROM THIRD FLOOR DOWN TO FIRST FLOOR. SEE SHEET MP1@3 + MP1@1 FOR CONTINUATION OF PIPING. SEE SHEET M1-6@2 FOR PIPE SIZES ON SCHEMATICS.
2. VAV BOX WITH REHEAT COIL, REPLACE ALL COIL PIPING VALVES ALONG WITH ALL ASSOCIATED CONTROLS.
3. VAV BOX, WITH NO HOT WATER COIL.

EQUIPMENT NOTE

REFER TO SHEETS M1-6@@ AND M1-6@1 FOR EQUIPMENT SCHEDULES.

Revisions:	Date

CONSULTANTS:

REGISTERED PROFESSIONAL ENGINEER GLADEN N. LEAGUANG NO. 33380 Exp. 6-30-12 MECHANICAL STATE OF CALIFORNIA

LP Consulting Engineers, Inc.
895 W. Ashlan Ave, Suite 101 Clovis, CA 93612
p 559-348-2130 - f 559-348-2131
www.lpengineers.com
Job #: 10-1096

LICENSED ARCHITECT GREG FITH No. C-24897 REN. 07-31-2013 STATE OF CALIFORNIA

ARCHITECT/ENGINEERS:

HMC Architects
1827 E. Fir Avenue, Studio 103 / Fresno, CA 93720
T 559 322 2444 / www.hmcarchitects.com

Drawing Title: SECOND FLOOR MECHANICAL REMODEL PIPING PLAN

Approved: Project Director

Project Title: BUILDING 24 SEISMIC CORRECTION AND ADDITION

Location: VAMC FRESNO, CA

Date: January 31, 2012 | Checked: K.K. | Drawn: D.N.

Project Number: 570-215

Building Number: 24

Drawing Number: MP102

Dwg. 148 of 180

Office of Construction and Facilities Management

Department of Veterans Affairs

VA FORM 08-6231