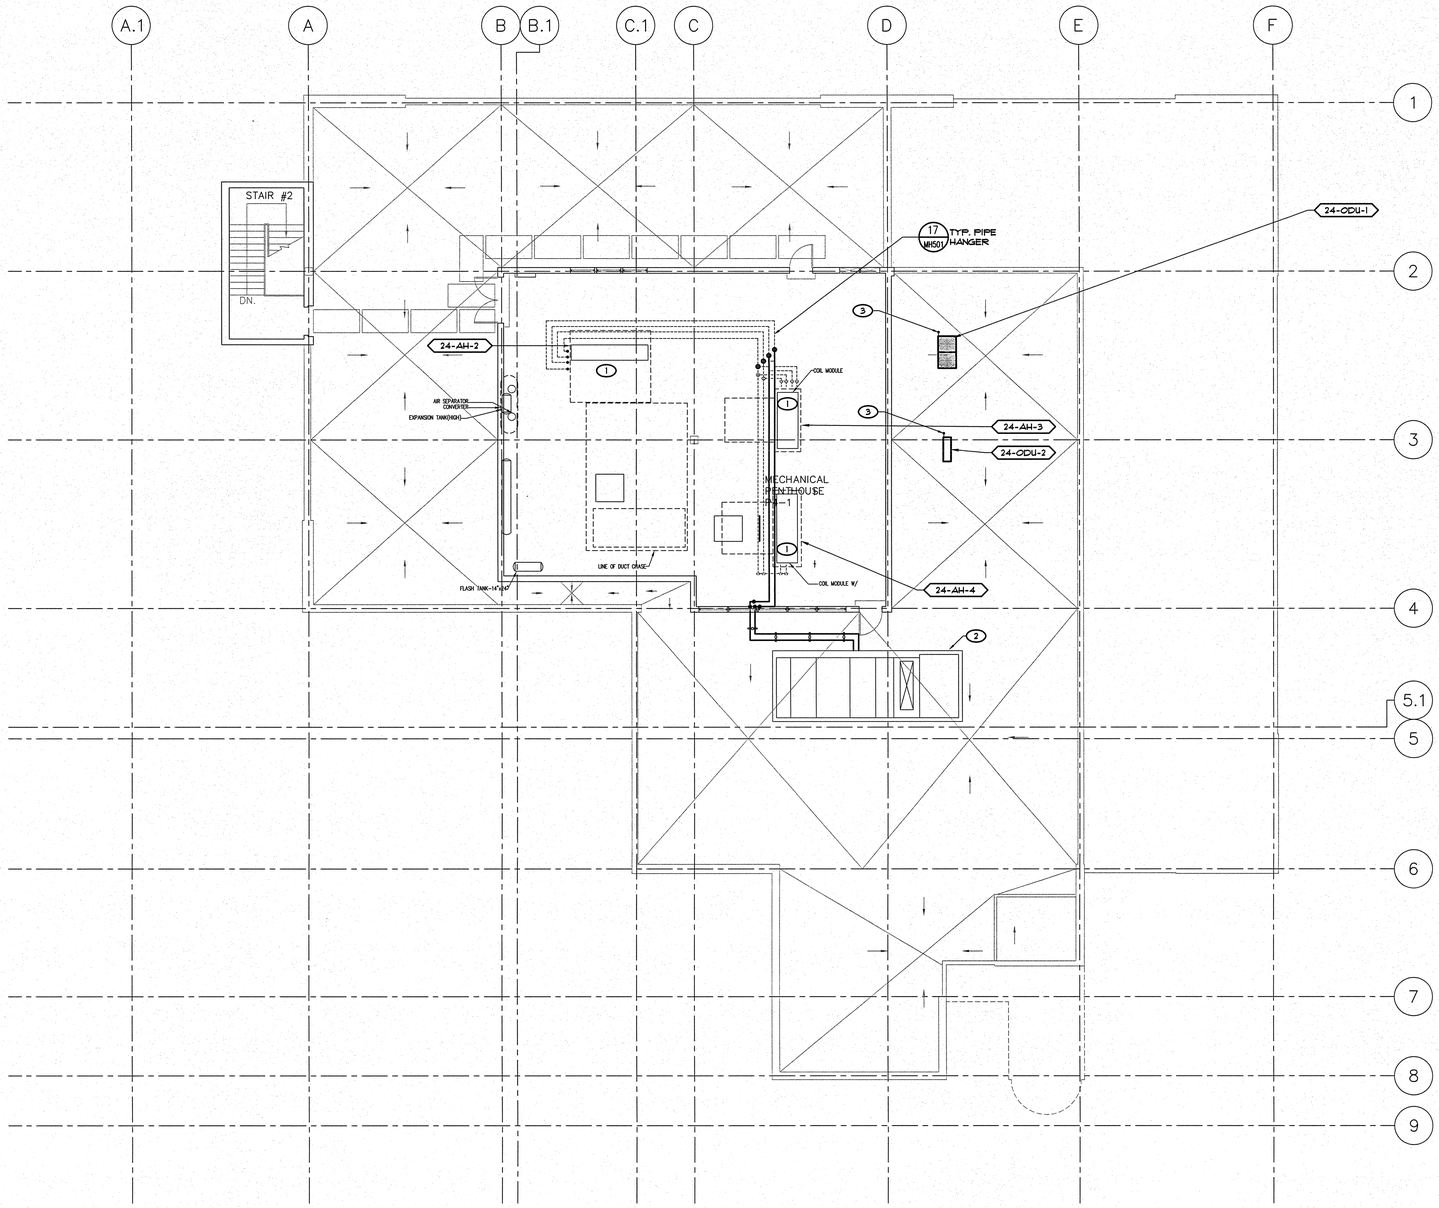

KEY NOTES

1. (E) AH TO BE REPLACED, REPLACE ALL COIL PIPING VALVES ALONG WITH ALL ASSOCIATED CONTROLS. ADD SEISMIC BRACING TO COIL PIPING.
2. (E) AH TO REMAIN.
3. REFRIGERANT PIPING DROPS FROM ODU THRU ROOF, SEE SHEET MP1203 FOR CONTINUATION.

EQUIPMENT NOTE

REFER TO SHEETS M1600 AND M1601 FOR EQUIPMENT SCHEDULES.

1 PENTHOUSE MECHANICAL REMODEL PIPING FLOOR AND ROOF PLAN
SCALE: 1/8" = 1'-0"

Revisions:	Date

CONSULTANTS:

REGISTERED PROFESSIONAL ENGINEER — CHRIS W. LEMPEBIER — NO. 33380 — MECHANICAL — STATE OF CALIFORNIA

LP Consulting Engineers, Inc.
895 W. Ashlan Ave, Suite 101 Clovis, CA 93612
p 559-348-2130 - f 559-348-2131
www.lpengineers.com
Job #: 10-1096

LICENSED ARCHITECT — CONTRACTOR — No. C-24897 — REN. 07-31-2013 — STATE OF CALIFORNIA

ARCHITECT/ENGINEERS:

HMC Architects
1827 E. Fir Avenue, Studio 103 / Fresno, CA 93720
T 559 322 2444 / www.hmcarchitects.com

Drawing Title	PENTHOUSE MECHANICAL REMODEL PIPING FLOOR AND ROOF PLAN
Approved: Project Director	
Project Title	BUILDING 24 SEISMIC CORRECTION AND ADDITION
Location	VAMC FRESNO, CA
Date	January 31, 2012
Checked	K.K.
Drawn	D.N.
Project Number	570-215
Building Number	24
Drawing Number	MP104
Dwg. 150 of 180	

Office of Construction and Facilities Management

Department of Veterans Affairs

VA FORM 08-6231