GENERAL NOTES:

1. CUT & PATCH AS REQUIRED FOR INSTALLATION OF WORK, PATCH TO MATCH (E) ADJACENT MATERIALS & FINISHES.
2. SEE H1.1 FOR PHASING NOTES

SHEET NOTES:

(1) REMOVE HHW COIL & SECTION OF DUCTWORK TO ALLOW FOR INSTALLATION OF (N) VAV BOX.

(2) REMOVE DUCTWORK INCLUDING INSULATION, DAMPERS, HANGERS, ETC.

(3) REMOVE VAV BOX AND CONTROLS.

DEMOLITION NOTE:

THERE ARE 6 TO 10 OBSOLESCENT ANTENNAS AND SIMILAR ROOF MOUNTED EQUIPMENT WHICH THE CONTRACTOR SHALL REMOVE AND DISPOSE OF AS PART OF THIS PROJECT. THE VA WILL TAG AND IDENTIFY SPECIFIC ITEMS FOR REMOVAL.

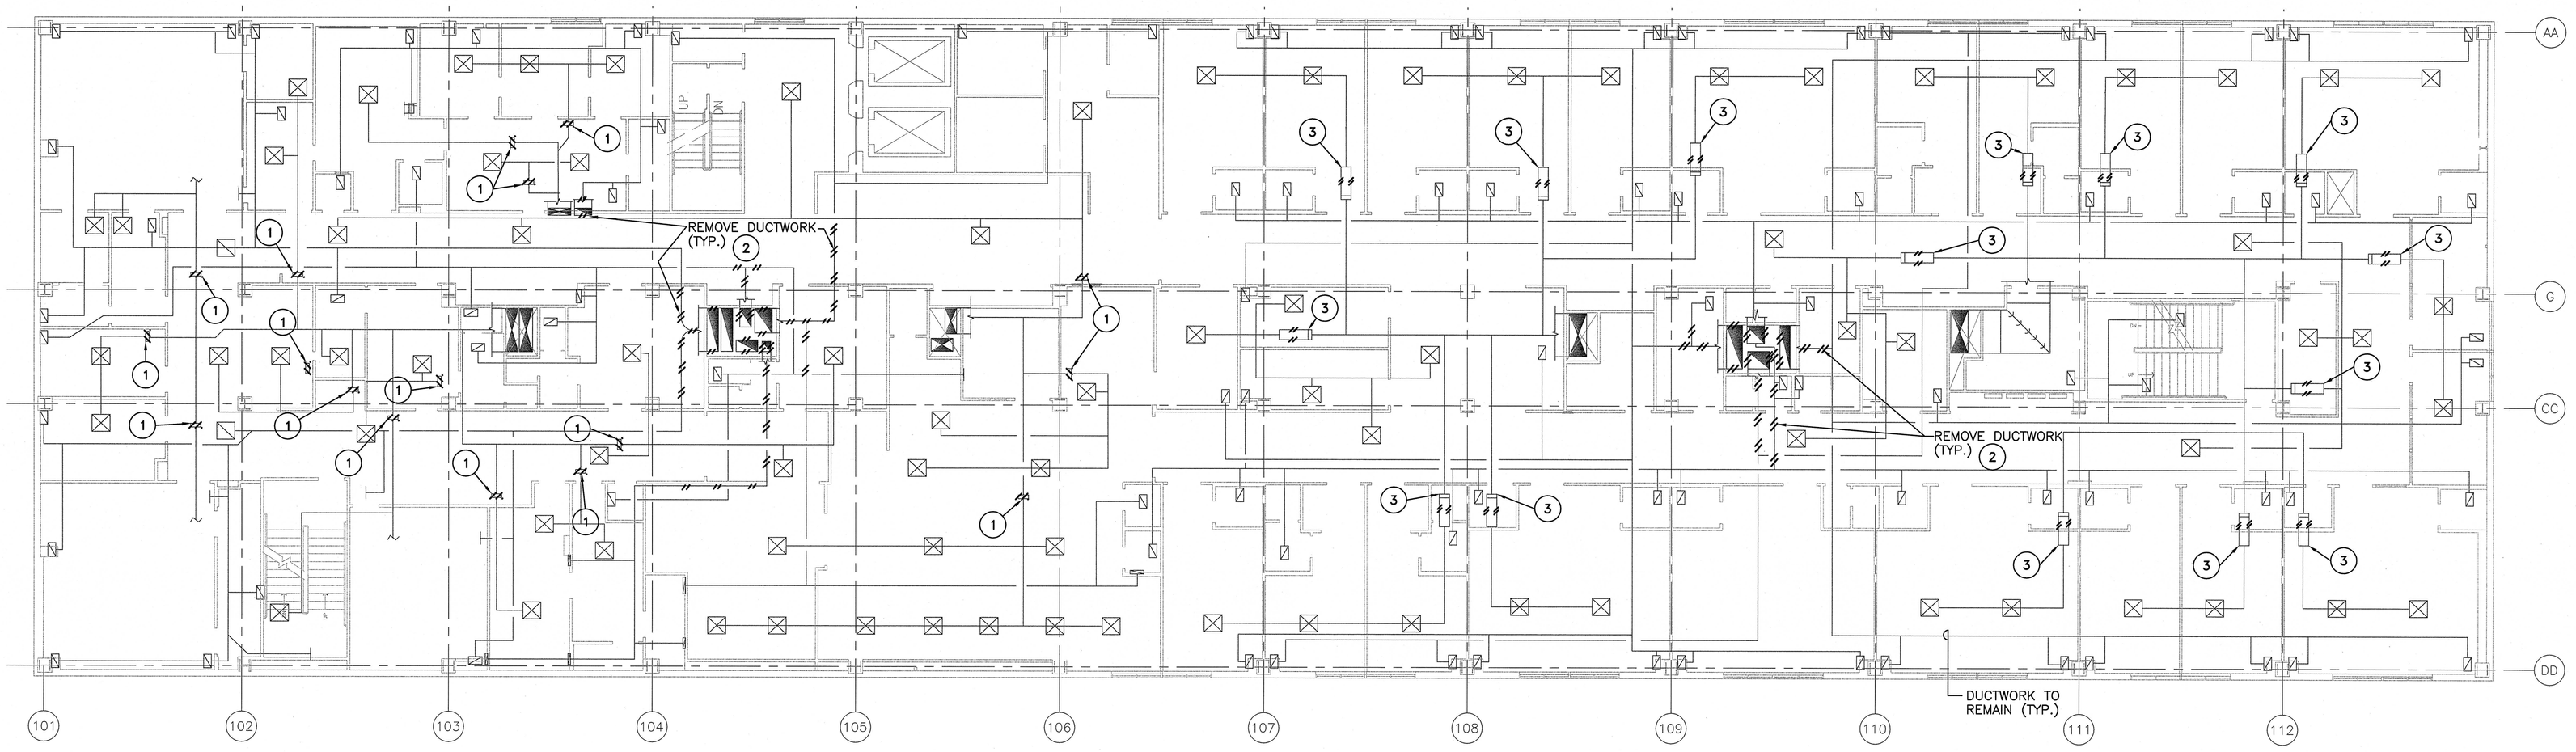

3RD FLOOR MECH DEMOLITION PLAN

SCALE: 1/8" = 1'-0"

NORTH

SCALE: 3/4"=1'-0" SCALE: 1/2"=1'-0" SCALE: 1/4"=1'-0" SCALE: 1/8"=1'-0"

011508

REGISTERED PROFESSIONAL ENGINEER KEITH CALVIN LAUNER Exp. 12/31/10 MECHANICAL STATE OF CALIFORNIA

BLDG 650 — 3RD FLOOR

KEY PLAN

K.F. DAVIS ENGINEERING, INC
530 LA GONDA WAY, SUITE E
DANVILLE, CA 94526

Revisions:	Drawing Title: DEMOLITION – 3RD FLOOR UNITS 9 THRU 15	Project Title: BLDG 650 REPLACE AIR HANDLERS 1 THRU 4, 7 AND 9 – 15	Date: 08/25/08
Approved:	Approved: Medical Center Director	Drawn: RMK / Building Number:	Project No.: 612A4-07-342
Approved:	Approved: Chief, Engineering Service	Checked: KL / Location: MATHER VAMC MATHER CALIFORNIA	DRAWING No. H2.3 Dwg. Of

Department of Veterans Affairs