GENERAL NOTES:

1. CUT & PATCH AS REQUIRED FOR INSTALLATION OF WORK, PATCH TO MATCH (E) ADJACENT MATERIALS & FINISHES
2. SEE H1.1 FOR PHASING NOTES.

SHEET NOTES:

1. INSTALL (N) VAV BOX IN SAME LOCATION AS HHW COIL, CONN. TO (E) HHWS & R PIPING & (E) DUCTWORK, REPLACE (E) THERMOSTAT WITH (N).
2. SEE 6/H6.2.
3. CONNECT TO (E) 2" HHWS&R IN 3RD FLOOR CEILING & EXTEND UP TO AHU-14
4. BALANCE (E) DIFFUSER OR GRILLE TO (N) CFM SHOWN.
5. BALANCE EXH. OR RETURN IN EACH ROOM TO EQUAL SUPPLY CFM.
6. PROVIDE DUCT MOUNTED SMOKE DETECTOR. MAKE & MODEL TO MATCH (E) FIRE ALARM DERVICES. CONTRACTOR TO PROVIDE CONTROL POWER AS NECESSARY.

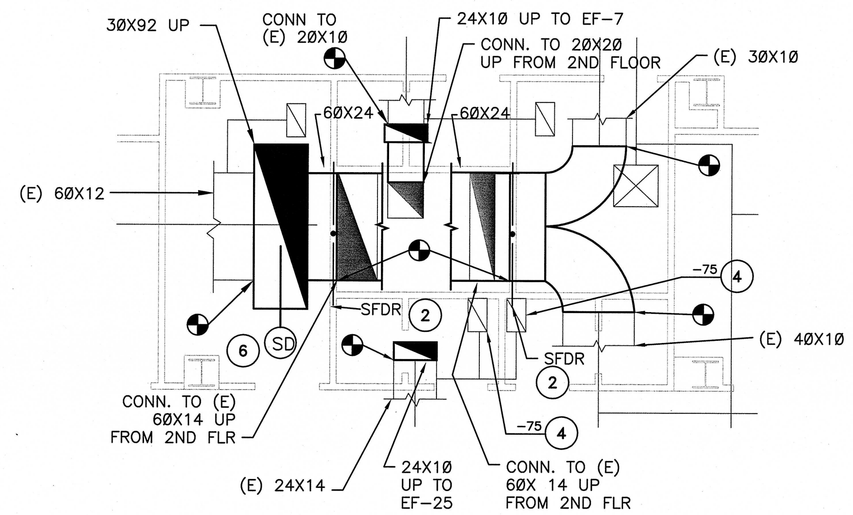

PARTIAL ENLARGED MECH PLAN

SCALE: 1/4" = 1'-0"

NORTH

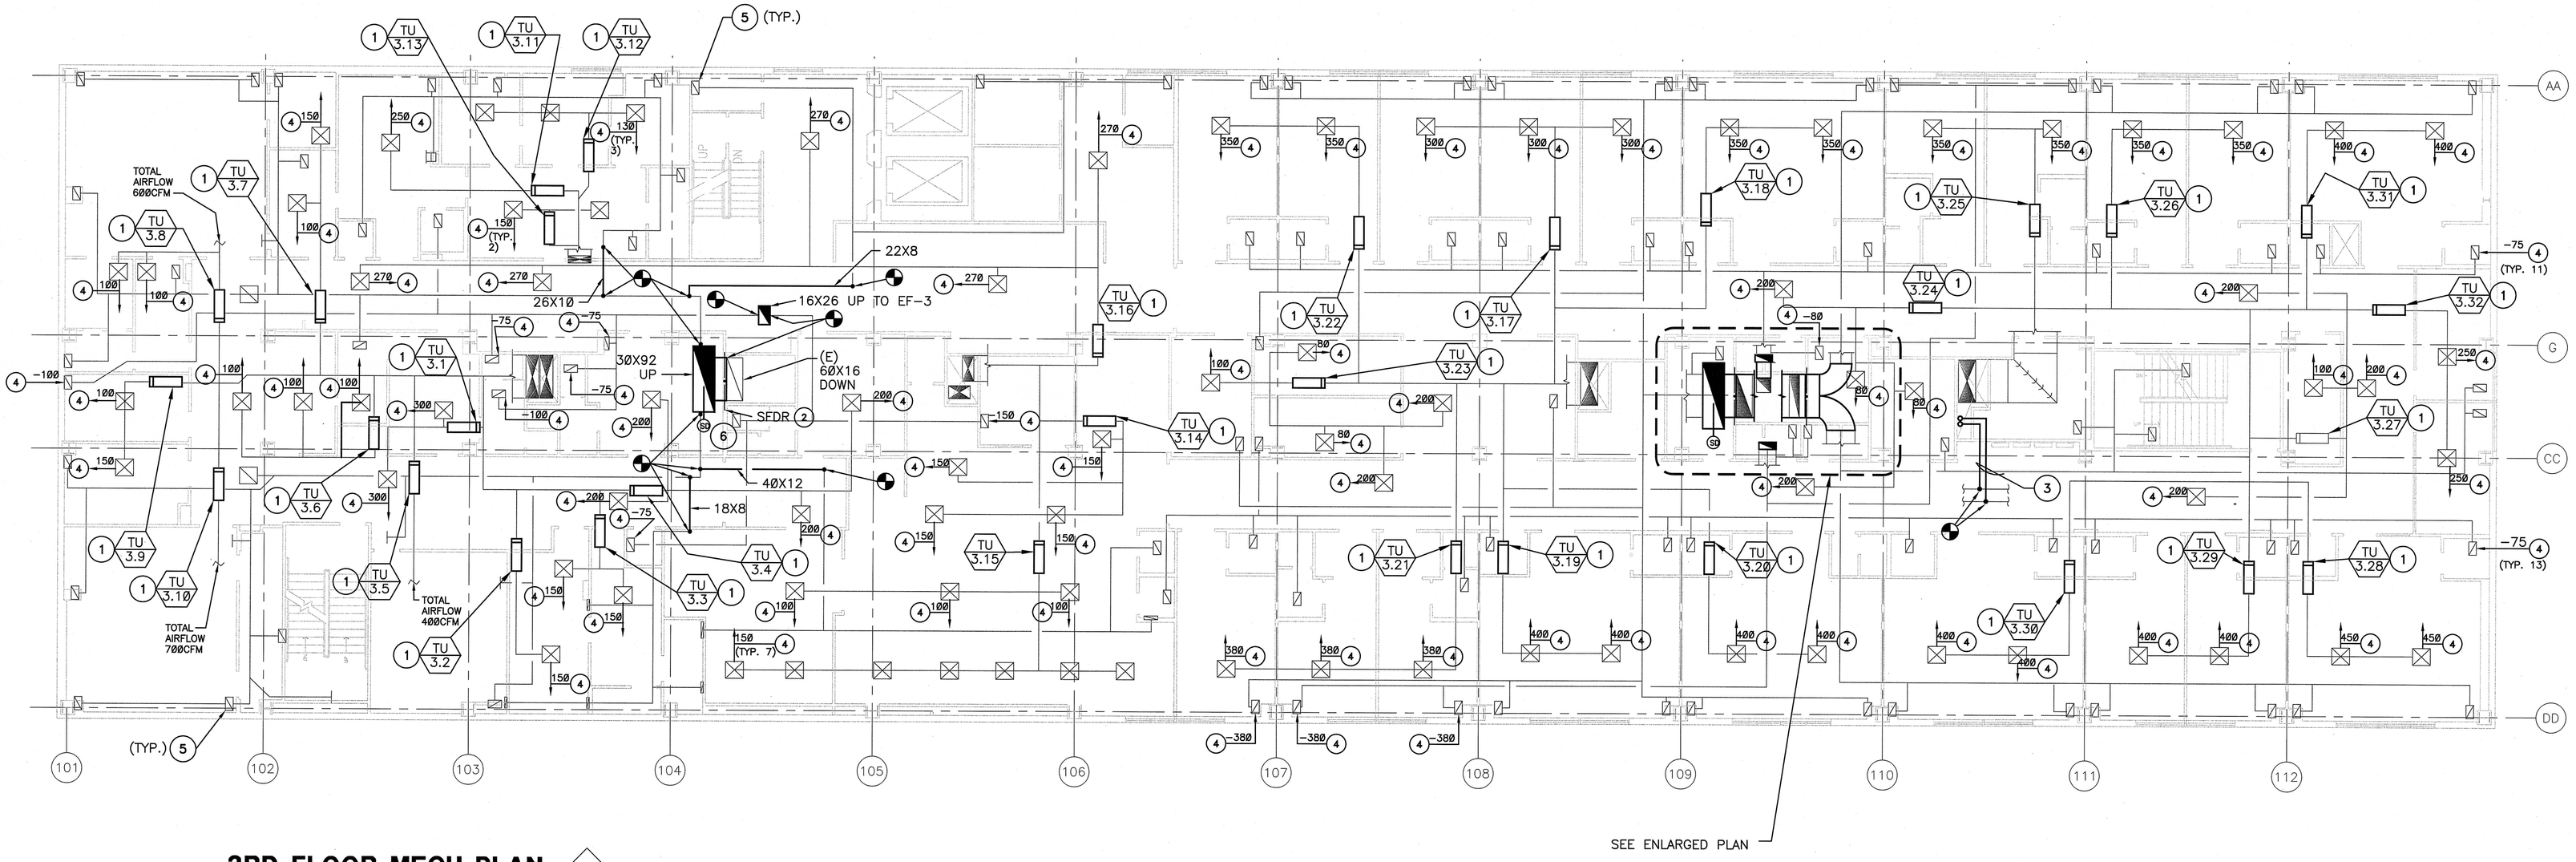

3RD FLOOR MECH PLAN

SCALE: 1/8" = 1'-0"

NORTH

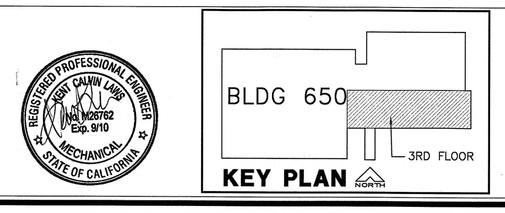

KEY PLAN

K.P. DAVIS ENGINEERING, INC
530 LA GONDA WAY, SUITE E
DANVILLE, CA 94526

Revisions:	Drawing Title: MECHANICAL 3RD FLOOR PLAN	Project Title: BLDG 650 REPLACE AIR HANDLERS 1 THRU 4, 7 AND 9 – 15	Date: 08/25/08
Approved:	Approved: Medical Center Director	Drawn: RMK	Project No.: 612A4-07-342
Approved:	Approved: Chief, Engineering Service	Checked: KL	Building Number:
		Location: MATHER VAMC MATHER CALIFORNIA	DRAWING No. H3.5 Dwg. Of

Department of Veterans Affairs

SCALE: 3/4"=1'-0" SCALE: 1/2"=1'-0" SCALE: 1/4"=1'-0" SCALE: 1/8"=1'-0"

011408