

DEMOLITION KEYNOTES (SHEET AD-2-1 AND AD-2-2 ONLY):

- ① CORE-DRILL PER CONDUIT REQUIREMENTS AT EXTERIOR WALL. REFER TO ELECTRICAL DRAWINGS FOR CONDUIT SIZE AND QUANTITY AND ALL REQUIREMENTS FOR CONDUIT REQUIRED. PROVIDE ALL REQUIRED FIRE-STOPPING AND SEALANT. CRITICAL: ALL OUTSIDE DIAMETERS OF REQUIRED CONDUITS SHALL BE A MINIMUM OF 3" CLEAR FROM ALL VERTICAL AND HORIZONTAL EDGES OF EXISTING CONCRETE/STONE VENEER PANELS - FIELD VERIFY EXACT LOCATIONS TO PENETRATE.

NEW WORK KEYNOTES (SHEET AD-2-1 AND AD-2-2 ONLY):

- 1 CONDUIT - REFER TO SHEETS AD-2-3, AD-2-4, AD-2-5 AND AD-2-6 FOR ADDITIONAL INFORMATION.
- 2 42" x 36" CONCRETE PAD FOR TRANSFORMER - REFER TO SHEET AD-2-5, AD-2-6 AND DETAIL 2/AD-2-1 THIS SHEET FOR ADDITIONAL INFORMATION.
- 3 CONDUIT BLOCKS FULLY ADHERED TO ROOF SYSTEM PER CONDUIT BLOCK MANUFACTURER RECOMMENDATIONS AND COMPATIBLE WITH EXISTING ROOF SYSTEMS. AT AREAS OF ROOF BALLAST, REMOVE STONE TO MINIMAL EXTENT REQUIRED FOR FULL ADHESION OF CONDUIT BLOCK. REFER TO SHEET AD-2-6 FOR ADDITIONAL INFORMATION.

GENERAL NOTES (ALL SHEETS):


THE CONTRACTOR SHALL LOCATE ANY AND ALL EXISTING UNDERGROUND UTILITIES IN THE LIMITS OF WORK AREA. COORDINATE LOCATION OF NEW AND EXISTING UNDERGROUND UTILITIES WITH THE COTR.

TEMPORARILY REMOVE EXISTING ACOUSTIC CEILING TILE TO MINIMAL EXTENT REQUIRED TO PERFORM WORK (REMOVE ASSOCIATED GRID AND OTHER CEILING DEVICES IF REQUIRED) AND STORE IN A SAFE PLACE. UPON COMPLETION OF WORK REINSTALL ACOUSTIC CEILING TILE, CEILING GRID AND DEVICES TO MATCH EXISTING. REPAIR AND REPLACE ANY DAMAGED COMPONENT TO MATCH EXISTING CONDITION IF REQUIRED.


REMOVE EXISTING GYPSUM BOARD CEILING TO MINIMAL EXTENT REQUIRED TO PERFORM WORK (REMOVE ASSOCIATED HARDWARE AND OTHER CEILING DEVICES IF REQUIRED). STORE HARDWARE AND DEVICES IN A SAFE PLACE. UPON COMPLETION OF WORK PATCH AND REPAIR GYPSUM BOARD CEILING TO MATCH EXISTING CONDITION AND REINSTALL DEVICES TO MATCH EXISTING CONDITION AND LOCATION. REPAIR AND REPLACE ANY DAMAGED COMPONENT TO MATCH EXISTING CONDITION IF REQUIRED.

C.M.U. WALLS AND METAL STUD WITH GYPSUM BOARD MAY EXTEND TO UNDERSIDE OF EXISTING SLAB ABOVE. CORE-DRILL AND SAW-CUT PER WALL TYPE. UPON COMPLETION OF WORK SEAL ALL PENETRATIONS AS REQUIRED TO MEET WALL RATING (IF REQUIRED).

CONTRACTOR SHALL COORDINATE THE EXACT CONDUIT ROUTE WITH THE COTR.

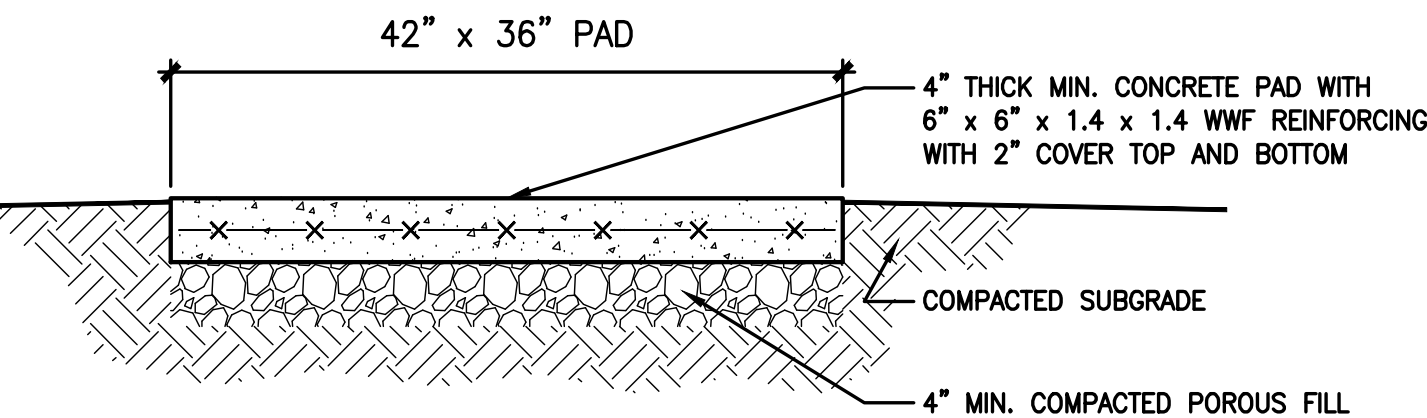

2 CONCRETE PAD DETAIL
AD-2-1 SCALE: 1" = 1'-0"

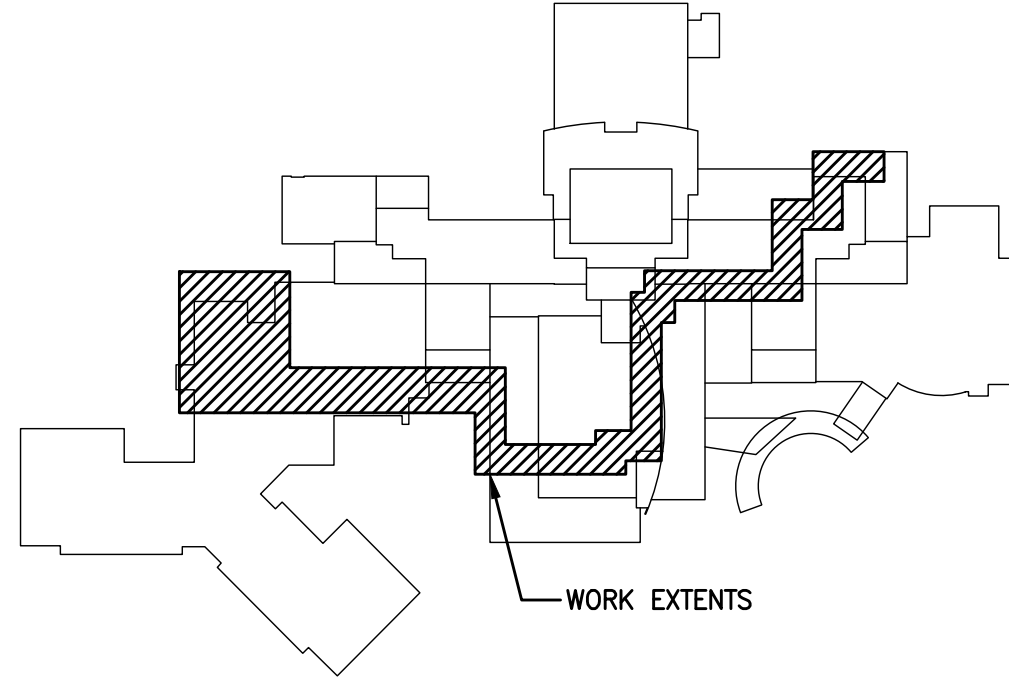

KEYPLAN

FULLY SPRINKLERED
AMENDMENT 2
PDG 110105.06

Additions: Revisions: 		Consultants BURDETTE KOEHLER MURPHY & ASSOCIATES, INC. MECHANICAL / ELECTRICAL CONSULTING ENGINEERING 1423 CLARKVIEW ROAD, SUITE 500 BALTIMORE, MARYLAND 21209 410.323.0800 - FAX 410.377.2543		BUILDING COST CONSULTANTS COST ESTIMATING 12917 - 30TH AVENUE PLATTSMOUTH, NEBRASKA 68048 402.298.8260 - FAX 402.298.8290		Seal: 		ARCHITECTURE PLANNING ENGINEERING POLT DESIGN GROUP 1301 ENTERPRISE COURT, SUITE 103-C Bel Air, Maryland 21014 410.803.2141 fax 410.838.1603 www.pdg http://www.polt-design.com		Drawing Scale: Drawing Start Date: Drawing Finish Date: Drawing Approved: Drawing Title: EXISTING FLOOR PLANS Approved: Associate Director for Operations: Approved: Chief, Facilities Engineer: Approved: Director, Medical Center:	Project Title: EMERGENCY POWER TO MAIN HOSPITAL ELEVATORS Building No: 1 Checked: CAJ Drawn: BDA Location: VAMHCS MEDICAL CENTER WILMINGTON, DELAWARE	Date: 9-4-2012 Project No: 460-12-123 DRAWING NO: AD-2-1 Dwg. 1 Of 6
--	--	---	--	--	--	----------------------------------	--	---	--	---	--	---

