

**PROJECT MANUAL**  
**FOR**  
**EAST INPATIENT ROOMS UPGRADE**  
**OSCAR G. JOHNSON VA MEDICAL CENTER**  
**IRON MOUNTAIN, MICHIGAN**  
**VA PROJECT NO. 585-17-107**



**ISSUED FOR BID**  
**SEPTEMBER 7, 2018**



**DEPARTMENT OF VETERANS AFFAIRS  
VHA MASTER SPECIFICATIONS**

**TABLE OF CONTENTS  
Section 00 01 10**

	<b>DIVISION 00 - SPECIAL SECTIONS</b>	<b>DATE</b>
00 01 10	Table of Contents	01-17
00 01 15	List of Drawing Sheets	07-15
00 41 00	Bid Form	09-18
	<b>DIVISION 01 - GENERAL REQUIREMENTS</b>	
01 00 00	General Requirements	11-15
01 32 16.15	Project Schedules	02-15
01 33 23	Shop Drawings, Product Data, and Samples	05-17
01 35 26	Safety Requirements	02-17
01 42 19	Reference Standards	05-16
01 45 00	Quality Control	01-18
01 74 19	Construction Waste Management	09-13
	<b>DIVISION 02 - EXISTING CONDITIONS</b>	
02 41 00	Demolition	02-15
	<b>DIVISION 03 - CONCRETE</b>	
03 30 53	Cast-in-Place Concrete	02-16
	<b>DIVISION 05 - METALS</b>	
05 50 00	Metal Fabrications	04-18
	<b>DIVISION 06 - WOOD, PLASTICS AND COMPOSITES</b>	
06 10 00	Rough Carpentry	10-17
06 20 00	Finish Carpentry	08-16
	<b>DIVISION 07 - THERMAL AND MOISTURE PROTECTION</b>	
07 21 13	Thermal Insulation	10-17
07 92 00	Joint Sealants	10-17
	<b>DIVISION 09 - FINISHES</b>	
09 05 16	Subsurface Preparation for Floor Finishes	02-15
09 06 00	Schedule for Finishes	04-15
09 22 16	Non-Structural Metal Framing	05-16
09 29 00	Gypsum Board	11-14
09 30 13	Ceramic/Porcelain Tiling	10-15
09 51 00	Acoustical Ceilings	12-16
09 65 13	Resilient Base and Accessories	02-16
09 65 16	Resilient Sheet Flooring	02-16

09 65 19	Resilient Tile Flooring	12-15
09 68 00	Carpeting	10-15
09 91 00	Painting	01-16
	<b>DIVISION 10 - SPECIALTIES</b>	
10 21 16	Shower Stalls	
10 21 23	Cubicle Curtain Tracks	05-15
10 26 00	Wall and Door Protection	10-15
10 28 00	Toilet, Bath, and Laundry Accessories	02-16
	<b>DIVISION 12 - FURNISHINGS</b>	
12 32 00	Manufactured Wood Casework	09-15
12 36 00	Countertops	12-15
	<b>DIVISION 21- FIRE SUPPRESSION</b>	
21 13 13	Wet-Pipe Sprinkler Systems	06-15
	<b>DIVISION 22 - PLUMBING</b>	
22 05 11	Common Work Results for Plumbing	07-16
22 05 19	Meters and Gages for Plumbing Piping	09-15
22 05 23	General-Duty Valves for Plumbing Piping	09-15
22 07 11	Plumbing Insulation	09-15
22 11 00	Facility Water Distribution	09-15
22 13 00	Facility Sanitary and Vent Piping	09-15
22 14 00	Facility Storm Drainage	09-15
22 40 00	Plumbing Fixtures	09-15
22 62 00	Vacuum Systems for Healthcare Facilities	09-15
22 63 00	Gas Systems for Healthcare Facilities	09-15
	<b>DIVISION 23 - HEATING, VENTILATING, AND AIR CONDITIONING (HVAC)</b>	
23 05 11	Common Work Results for HVAC	02-15
23 05 93	Testing, Adjusting, and Balancing for HVAC	02-15
23 09 23	Direct-Digital Control System for HVAC	09-11
23 09 93	Sequence of Operation for HVAC Controls	
23 31 00	HVAC Ducts and Casings	03-13
23 37 00	Air Outlets and Inlets	02-15
	<b>DIVISION 26 - ELECTRICAL</b>	
26 05 02	Electrical Demolition for Remodeling	
26 05 11	Requirements for Electrical Installations	01-16
26 05 19	Low-Voltage Electrical Power Conductors and Cables	07-13
26 05 26	Grounding and Bonding for Electrical Systems	12-12
26 05 29	Hangers and Supports for Electrical Piping & Equipment	
26 05 33	Raceway and Boxes for Electrical Systems	05-14
26 27 26	Wiring Devices	01-16
26 51 00	Interior Lighting	08-14

**SECTION 00 01 15**  
**LIST OF DRAWING SHEETS**

The drawings listed below accompanying this specification form a part of the contract.

Drawing No.		Title
<b>GENERAL</b>		
1	G001A	COVER SHEET
<b>ARCHITECTURAL</b>		
2	AD101A	FOURTH FLOOR - DEMOLITION PLAN
3	A101A	FOURTH FLOOR - NEW WORK PLAN
4	AR101A	FOURTH FLOOR - REFLECTED CEILING PLAN
5	AC101A	FOURTH FLOOR - COORDINATION CEILING PLAN
6	A401A	ENLARGED PLANS AND ELEVATIONS
7	A501A	MISCELLANEOUS DETAILS
8	A701A	CASEWORK DETAILS
<b>INTERIORS</b>		
9	I001A	EXISTING AND NEW ROOM FINISH SCHEDULE
10	I101A	FOURTH FLOOR - WALL SPECIAL PLAN
11	I102A	FOURTH FLOOR - FLOOR SPECIAL PLAN
<b>FIRE PROTECTION</b>		
12	FD101A	FOURTH FLOOR DEMOLITION PLAN
13	F101A	FOURTH FLOOR NEW WORK PLAN
<b>PLUMBING</b>		
14	PD101A	FOURTH FLOOR WATER PIPING DEMOLITION PLAN
15	PD102A	FOURTH FLOOR SANITARY PIPING DEMOLITION PLAN
16	PL101A	FOURTH FLOOR SANITARY PIPING PLAN
17	PP101A	FOURTH FLOOR WATER PIPING PLAN

**HVAC**

18	MD101A	FOURTH FLOOR PLAN - DEMOLITION (DUCTWORK)
19	MP101A	FOURTH FLOOR PLAN - NEW WORK (PIPING)
20	MH101A	FOURTH FLOOR PLAN - NEW WORK (DUCTWORK)
21	MH501A	SCHEDULES AND DETAILS

**ELECTRICAL**

22	E001A	ELECTRICAL SYMBOLS AND ABBREVIATIONS
23	ED101A	FOURTH FLOOR DEMOLITION PLAN
24	EL101A	FOURTH FLOOR LIGHTING PLAN
25	EP101A	FOURTH FLOOR POWER PLAN
26	ET101A	FOURTH FLOOR TELECOMMUNICATIONS PLAN
27	EY101A	FOURTH FLOOR AUXILIARY SYSTEMS PLAN
28	FA101A	FOURTH FLOOR FIRE ALARM PLAN
29	EK600A	ELECTRICAL SCHEDULES & DETAILS

---END---

**BID FORM**

**Upgrade 4East Inpatient Rooms**  
**PROJECT NO. 585-17-107**

**BID SCHEDULE**

**BASE BID:** Contractor shall completely prepare site for building operations, including demolition and removal of existing structures, and furnish all labor, superintendence, materials, tools, equipment, transportation, licenses, certifications, insurance, temporary protection, and other items designated under the provisions of this contract: Upgrade 4East Inpatient Rooms - Project 585-17-107 at the Oscar G. Johnson VA Medical Center, Iron Mountain, MI. The project includes renovating 15 existing patient rooms and adjoining restrooms to reflect the latest VA design guide. The work in the patient rooms will consist of interior finishes and the work in the restrooms will involve a complete renovation, including replacement of plumbing fixtures and re-sloping of floor. The flooring & finishes in the main corridors is to be replaced, and a minor expansion of the main nursing station into the adjacent medication room. In addition, many of the support rooms will receive finish upgrades. Work includes architectural, structural, fire protection, HVAC, Plumbing, electrical and other aspects of construction as required by the drawings and specifications.

**LUMP SUM: \$** \_\_\_\_\_

---END---





**SECTION 01 00 00**  
**GENERAL REQUIREMENTS**

**1.1 SAFETY REQUIREMENTS**

Refer to Section 01 35 26, SAFETY REQUIREMENTS for safety and infection control requirements.

**1.2 GENERAL INTENTION**

- A.** Contractor shall completely prepare site for building operations, including demolition and removal of existing structures, and furnish all labor, superintendence, materials, tools, equipment, transportation, licenses, certifications, insurance, temporary protection, and other items designated under the provisions of this contract: Upgrade 4East Inpatient Rooms - Project 585-17-107 at the Oscar G. Johnson VA Medical Center, Iron Mountain, MI. The project includes renovating 15 existing patient rooms and adjoining restrooms to reflect the latest VA design guide. The work in the patient rooms will consist of interior finishes and the work in the restrooms will involve a complete renovation, including replacement of plumbing fixtures and re-sloping of floor. The flooring & finishes in the main corridors is to be replaced, and a minor expansion of the main nursing station into the adjacent medication room. In addition, many of the support rooms will receive finish upgrades. Work includes architectural, structural, fire protection, HVAC, Plumbing, electrical and other aspects of construction as required by the drawings and specifications.
- B.** Information for visits to the site by Bidders are located on the solicitation cover. Verify existing conditions and locations in field prior to submitting proposal.
- C.** Offices of Berners-Schober Associates, Inc., located in Green Bay, WI, as Architect-Engineers, will render certain technical services during construction. Such services shall be considered as advisory to the Government and shall not be construed as expressing or implying a contractual act of the Government without affirmations by Contracting Officer or his duly authorized representative.
- D.** Before placement and installation of work subject to tests by testing laboratory retained by Department of Veterans Affairs, the Contractor shall notify the COR in sufficient time to enable

testing laboratory personnel to be present at the site in time for proper taking and testing of specimens and field inspection.

Such prior notice shall be not less than three work days unless otherwise designated by the COR.

**E.** All employees of general contractor and subcontractors shall comply with VA security management program and obtain permission of the VA police, be identified by project and employer, and restricted from unauthorized access.

**F. Schedule:** To ensure such executions, Contractor shall furnish the COR with a Baseline CPM schedule Per Spec Section 01 32 16.15 Project Schedules which indicates phasing dates on which the Contractor intends to accomplish work in each specific area of site, building or portion thereof. **No Work shall begin on-site by the Contractor until the CPM schedule has been approved by the COR.**

*The project duration will be limited to 220 calendar days.*

Mobilization/Submittals - 60 days

Phase 1 - 20 days

Owner moving into phase 1 - 5 days

Phase 2 - 25 days

Owner moving into phase 2 - 5 days

Phase 3 - 5 days

Owner moving into phase 3 - 5 days

Phase 4 - 27 days

Owner moving into phase 4 - 5 days

Phase 5 - 28 days

Owner moving into phase 5 - 5 days

Phase 6 - 10 days

Owner moving into phase 6 - 5 days

Phase 7 - 15 days

Any changes to this schedule shall be approved through the contracting office and justified through the approved CPM project schedule.

**1.3 STATEMENT OF BID ITEM(S)**

- A.** See solicitation for specific information.

**1.4 SPECIFICATIONS AND DRAWINGS FOR CONTRACTOR**

- A.** Drawings and contract documents may be obtained from the website where the solicitation is posted. Additional copies will be at Contractor's expense.

**1.5 CONSTRUCTION SECURITY REQUIREMENTS**

**A.** Security Plan:

1. The security plan defines both physical and administrative security procedures that will remain effective for the entire duration of the project.
2. The General Contractor is responsible for assuring that all sub-contractors working on the project and their employees also comply with these regulations.

**B.** Security Procedures:

1. General Contractor's employees shall not enter the project site without appropriate badge. They may also be subject to inspection of their personal effects when entering or leaving the project site.
2. Before starting work, and when working outside the "regular hours" as defined in the contract, the General Contractor shall give one week's notice to the contracting officer's representative, (COR), and Contracting Officer so that security arrangements can be provided for the employees. This notice is separate from any notices required for utility shutdown described later in this section.
3. No photography of VA premises is allowed without written permission by the COR and Contracting Officer.
4. VA reserves the right to close or shut down the project site and order General Contractor's employees off the premises in the event of a national emergency. The General Contractor may return to the site only with the written approval of the Contracting Officer.

**C. Key Control:**

1. The General Contractor shall provide duplicate keys and lock combinations to the Contracting Officer's Representative (COR) for the purpose of security inspections of every area of project including tool boxes and parked machines, and take any emergency action.
2. The General Contractor shall turn over all permanent lock cylinders to the VA locksmith for permanent installation.  
See Section 08 71 00, DOOR HARDWARE and coordinate.

**D. Document Control:**

1. Before starting any work, the General Contractor/Sub Contractors shall submit an electronic security memorandum describing the approach to following goals and maintaining confidentiality of "sensitive information".
2. The General Contractor is responsible for safekeeping of all drawings, project manual, and other project information.  
This information shall be shared only with those with a specific need to accomplish the project.
3. Certain documents, sketches, videos or photographs and drawings may be marked "Law Enforcement Sensitive" or "Sensitive Unclassified". Secure such information in separate containers and limit the access to only those who will need it for the project.  
Return the information to the Contracting Officer upon request.
4. These security documents shall not be removed or transmitted from the project site without the written approval of Contracting Officer.
5. All paper waste or electronic media such as CD's and diskettes shall be shredded and destroyed in a manner acceptable to the VA.
6. Notify Contracting Officer and Site Security Officer immediately when there is a loss or compromise of "sensitive information".

7. All electronic information shall be stored in specified location following VA standards and procedures using an Engineering Document Management Software (EDMS).
  - a. Security, access and maintenance of all project drawings, both scanned and electronic shall be performed and tracked through the EDMS system.
  - b. "Sensitive information" including drawings and other documents may be attached to e-mail provided all VA encryption procedures are followed.

**E. Motor Vehicle Restrictions:**

1. Coordinate parking at the VA Medical Center with VA Police and COR in the South Parking Lot. Dumpster for debris shall be located in the south contractor parking area and/or designated areas only.

**1.6 OPERATIONS AND STORAGE AREAS**

- A.** The Contractor shall confine all operations (including storage of materials) on Government premises to areas authorized or approved by the Contracting Officer. The Contractor shall hold and save the Government, its officers and agents, free and harmless from liability of any nature occasioned by the Contractor's performance.
- B.** Temporary buildings (e.g., storage sheds, shops, offices) and utilities may be erected by the Contractor only with the approval of the Contracting Officer and shall be built with labor and materials furnished by the Contractor without expense to the Government. The temporary buildings and utilities shall remain the property of the Contractor and shall be removed by the Contractor at its expense upon completion of the work. With the written consent of the Contracting Officer, the buildings and utilities may be abandoned and need not be removed.
- C.** The Contractor shall, under regulations prescribed by the Contracting Officer, use only established roadways, or use temporary roadways constructed by the Contractor when and as authorized by the Contracting Officer. When materials are transported in prosecuting the work, vehicles shall not be loaded beyond the loading capacity recommended by the manufacturer of the vehicle or prescribed by any Federal, State, or local law or regulation. When it is necessary to cross curbs or sidewalks, the Contractor shall protect them from damage. The Contractor shall repair or pay for the repair of any damaged curbs, sidewalks, or roads. **(FAR 52.236-10)**

- D. Working space and space available for storing materials shall be as shown on the drawings or as determined by the COR.
- E. Workmen are subject to rules of Medical Center applicable to their conduct.
- F. Execute work in such a manner as to interfere as little as possible with work being done by others. Keep roads clear of construction materials, debris, standing construction equipment and vehicles at all times.
- G. Execute work so as to interfere as little as possible with normal functioning of Medical Center as a whole, including operations of utility services, fire protection systems and any existing equipment, and with work being done by others. Use of equipment and tools that transmit vibrations and noises through the building structure, are not permitted in buildings that are occupied, during construction, jointly by patients or medical personnel, and Contractor's personnel, except as permitted by COR where required by limited working space. **Due to noise limitation requirements in the adjacent areas, all work which transmit significant noise, vibrations, etc. shall be completed between the hours of 7:00am and 9:00pm to limit disruptions to patient care unless pre-approved by COR.** In addition, all work within occupied spaces outside of the designated construction area shall be completed outside of normal facility business hours and coordinated with the COR. **Depending on specific patient needs, there may be sporadic, unknown times where "noisy and/or vibration type work" will need to be halted for a time period during the work day.**
  - 1. Do not store materials and equipment in other than assigned areas.
  - 2. Schedule delivery of materials and equipment to immediate construction working areas within buildings in use by Department of Veterans Affairs in quantities sufficient for not more than two work days. Provide unobstructed access to Medical Center areas required to remain in operation.
  - 3. Where access by Medical Center personnel to vacated portions of buildings is not required, storage of Contractor's materials and equipment will be permitted subject to fire and safety requirements.

**H. Utilities Services:** Where necessary to cut existing pipes, electrical wires, conduits, cables, etc., of utility services, or of fire protection systems or communications systems (except telephone), they shall be cut and capped at suitable places where shown; or, in absence of such indication, where directed by COR. All such actions shall be coordinated with the COR or Utility Company involved:

1. Whenever it is required that a connection fee be paid to a public utility provider for new permanent service to the construction project, for such items as water, sewer, electricity, gas or steam, payment of such fee shall be the responsibility of the Government and not the Contractor.

**I. Phasing:**

The Medical Center must maintain its operation 24 hours a day 7 days a week. Therefore, any interruption in service must be scheduled and coordinated with the COR to ensure that no lapses in operation occur. It is the **CONTRACTOR'S** responsibility to develop a work plan and schedule detailing, at a minimum, the procedures to be employed, the equipment and materials to be used, the interim life safety measure to be used during the work, and a schedule defining the duration of the work with milestone subtasks. The work to be outlined shall include, but not be limited to:

To ensure such executions, Contractor shall furnish the COR with a schedule of approximate phasing dates on which the Contractor intends to accomplish work in each specific area of site, building or portion thereof. Normal working hours are from 7am to 3:30pm, Monday through Friday. All corridor work and work in other occupied spaces shall be completed after normal working hours, starting at 4:30pm, unless pre-approved by COR. In addition, Contractor shall notify the COR two weeks in advance of the proposed date of starting work in each specific area of site, building or portion thereof. Arrange such phasing dates to ensure accomplishment of this work in successive phases mutually agreeable to Medical Center Director, COR, and Contractor, as follows:

**The project duration shall be limited to 220 calendar days and shall be accomplished in multiple phases with multiple milestones.**

**Phase 1:** Will commence upon the date identified within the approved Project Schedule. Phase 1 work consists of all work items in rooms 4243, 4245, 4245A, 4246, 4250, 4250A, 4251, 4251A, 4252, elevator lobby, and corridor as shown on drawing.

*Phase 1 shall be completed 80 days after the Notice to Proceed, (NTP), which includes the 60 days for schedule and submittals.*

**Phase 2:** Will commence 5 days after the completion of Phase 1 to allow VA to terminally clean rooms & move into the fully completed phase 1 area. Phase 3 work consists of all work items in rooms 4230, 4230A, 4233, 4233A, 4234, 4234A, 4236, 4236A, 4237, 4237A, 4238, and corridor as shown on drawing.

*Phase 2 shall be completed 110 days after the NTP, duration is 25 days.*

**Phase 3:** Will commence 5 days after the completion of Phase 2. Phase 3 work consists of all work items in rooms 4224, 4227, 4228, and corridor as shown on drawing.

*Phase 3 shall be completed 115 days after the NTP; duration is 5 days.*

**Phase 4:** Will commence 5 days after the completion of Phase 3. Phase 4 work consists of all work items in rooms 4205, 4205A, 4207, 4211, 4211A, 4215, 4215A, 4217, 4219, and corridor as shown on drawing. **Access on one side of the corridor will be maintained at all times.**

*Phase 4 shall be completed 152 days after the NTP; duration is 27 days.*

**Phase 5:** Will commence 5 days after the completion of Phase 4. Phase 5 work consists of all work items in rooms 4214, 4216, 4216A, 4220, 4261, 4263, and corridor as shown on drawing. **Access on one side of the corridor will be maintained at all times.**

*Phase 5 shall be completed 190 days after the NTP; duration is 28 days.*



**Phase 6:** Will commence 5 days after the completion of Phase 5. Phase 6 work consists of all work items in rooms 4260, 4262, 4262A, and corridor as shown on drawing. *Access on one side of the corridor will be maintained at all times.*

*Phase 6 shall be completed 200 days after the NTP; duration is 10 days.*

**Phase 7:** Will commence in room after the completion of Phase 6. Phase 7 work consists of all work items in rooms 4268, 4268A, 4270, and 4270A, and corridor as shown on drawing.

*Phase 7 shall be completed 220 days after the NTP, duration is 15 days.*

**All walls (Temporary and Permanent) visible to the public shall be prime painted immediately after they are installed. Temporary vinyl base molding will be installed immediately after prime painting. All walls will be maintained in presentable fashion and repaired/repainted as necessary.**

**Infection control permit shall be obtained before any work within occupied areas start and shall be adhered to.**

**Any changes to this phasing plan shall be approved by the Contracting Officer and justified through the approved CPM Project Schedule.**

1. Contractor shall take all measures and provide all material necessary for protecting existing equipment and property in affected areas of construction against dust and debris, so that equipment and affected areas to be used in the Medical Centers operations will not be hindered. Contractor shall permit access to Department of Veterans Affairs personnel and patients through other construction areas which serve as routes of access to such affected areas and equipment. These routes whether access or egress, shall be isolated from the construction area by temporary partitions and have walking surfaces, lighting etc. to facilitate patient and staff access. Coordinate alteration work in areas occupied by Department of Veterans Affairs so that Medical Center operations will continue during the construction period.
2. Immediate areas of alterations not mentioned in preceding Subparagraph 1 will not be temporarily vacated while alterations are performed.

- J.** When a building and/or construction site is turned over to Contractor, Contractor shall accept entire responsibility including upkeep and maintenance therefore:
1. Contractor shall maintain a minimum temperature of 4 degrees C (40 degrees F) at all times, except as otherwise specified.
  2. Contractor shall maintain in operating condition existing fire protection and alarm equipment. In connection with fire alarm equipment, Contractor shall make arrangements for pre-inspection of site with Fire Department or Company (Department of Veterans Affairs or municipal) whichever will be required to respond to an alarm from Contractor's employee or watchman.
- K.** Utilities Services: Maintain existing utility services for Medical Center at all times. Provide temporary facilities, labor, materials, equipment, connections, and utilities to assure uninterrupted services. Where necessary to cut existing water, steam, gases, sewer or air pipes, or conduits, wires, cables, etc. of utility services or of fire protection systems and communications systems (including telephone), they shall be cut and capped at suitable places where shown; or, in absence of such indication, where directed by COR.
1. No utility service such as water, gas, steam, sewers or electricity, or fire protection systems and communications systems may be interrupted without prior approval of COR. Electrical work shall be accomplished with all affected circuits or equipment de-energized. When an electrical outage cannot be accomplished, work on any energized circuits or equipment shall not commence without a detailed work plan, the Medical Center Director's prior knowledge and written approval. Refer to specification Sections 22 05 11, COMMON WORK RESULTS FOR PLUMBING, 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, 27 05 11 REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS and 28 05 00, COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY for additional requirements.
  2. Contractor shall submit a request to interrupt any such services to COR, in writing, 14 calendar days in advance of proposed interruption. Request shall state reason, date, exact time of, and approximate duration of such interruption.

3. Contractor will be advised (in writing) of approval of request, or of which other date and/or time such interruption will cause least inconvenience to operations of Medical Center.  
**Interruption time approved by Medical Center may occur at other than Contractor's normal working hours and may include nights, weekends, or holidays.**
4. Major interruptions of any system must be requested, in writing, **at least 15 calendar days** prior to the desired time and shall be performed as directed by the COR.
5. In case of a contract construction emergency, service will be interrupted on approval of COR. Such approval will be confirmed in writing as soon as practical.
6. Whenever it is required that a connection fee be paid to a public utility provider for new permanent service to the construction project, for such items as water, sewer, electricity, gas or steam, payment of such fee shall be the responsibility of the Government and not the Contractor.
- L. Abandoned Lines:** All service lines such as wires, cables, conduits, ducts, pipes and the like, and their hangers or supports, which are to be abandoned but are not required to be entirely removed, shall be sealed, capped or plugged at the main, branch or panel they originate from. The lines shall not be capped in finished areas, but shall be removed and sealed, capped or plugged in ceilings, within furred spaces, in unfinished areas, or within walls or partitions; so that they are completely behind the finished surfaces.
- M.** To minimize interference of construction activities with flow of Medical Center traffic, comply with the following:
  1. Keep roads, walks and entrances to grounds, to parking and to occupied areas of buildings clear of construction materials, debris and standing construction equipment and vehicles.  
Wherever excavation for new utility lines cross existing roads, at least one lane must be open to traffic at all times with approval.
- N.** Coordinate the work for this contract with other construction operations as directed by the COR. This includes the scheduling of traffic and the use of roadways, as specified in Article, USE OF ROADWAYS.

**1.7 ALTERATIONS**

- A. Survey:** Before any work is started, the Contractor shall make a thorough survey, with the COR of areas of building in which alterations occur, and areas which are anticipated routes of access and furnish a report, signed by both, to the Contracting Officer. This report shall list by rooms and spaces:
1. Existing condition and types of resilient flooring, doors, windows, walls and other surfaces not required to be altered throughout affected areas of building one.
  2. Existence and conditions of items such as plumbing fixtures and accessories, electrical fixtures, equipment, venetian blinds, shades, etc., required by drawings to be either reused or relocated, or both.
  3. Shall note any discrepancies between drawings and existing conditions at site.
  4. Shall designate areas for working space, materials storage and routes of access to areas within buildings where alterations occur and which have been agreed upon by Contractor and COR.
- B.** Any items required by drawings to be either reused or relocated or both, found during this survey to be non-existent, or in opinion of COR, to be in such condition that their use is impossible or impractical, shall be furnished and/or replaced by Contractor with new items in accordance with specifications which will be furnished by Government. Provided the contract work is changed by reason of this subparagraph B, the contract will be modified accordingly, under provisions of clause entitled "DIFFERING SITE CONDITIONS" (FAR 52.236-2) and "CHANGES" (FAR 52.243-4 and VAAR 852.236-88).
- C. Re-Survey:** Thirty days before expected partial or final inspection date, the Contractor and the COR together shall make a thorough re-survey of the areas of buildings involved. They shall furnish a report on conditions then existing, of resilient flooring, doors, windows, walls and other surfaces as compared with conditions of same as noted in first condition survey report:
1. Re-survey report shall also list any damage caused by Contractor to such flooring and other surfaces, despite protection measures; and, will form basis for determining extent of repair work required of Contractor to restore damage caused by Contractor's workmen in executing work of this contract.

**D. Protection:** Provide the following protective measures:

1. Wherever existing roof surfaces are disturbed they shall be protected against water infiltration. In case of leaks, they shall be repaired immediately upon discovery.
2. Temporary protection against damage for portions of existing structures and grounds where work is to be done, materials handled and equipment moved and/or relocated.
3. Protection of interior of existing structures at all times, from damage, dust and weather inclemency. Wherever work is performed, floor surfaces that are to remain in place shall be adequately protected prior to starting work, and this protection shall be maintained intact until all work in the area is completed.

**1.8 DISPOSAL AND RETENTION**

**A.** Materials and equipment accruing from work removed and from demolition of buildings or structures, or parts thereof, shall be disposed of as follows:

1. Reserved items which are to remain property of the Government are identified by attached tags or noted on drawings or in specifications as items to be stored. Items that remain property of the Government shall be removed or dislodged from present locations in such a manner as to prevent damage which would be detrimental to re-installation and reuse. Store such items where directed by COR.
2. Items not reserved shall become property of the Contractor and be removed by Contractor from Medical Center.
3. Items of portable equipment and furnishings located in rooms and spaces in which work is to be done under this contract shall remain the property of the Government. When rooms and spaces are vacated by the Department of Veterans Affairs during the alteration period, such items which are NOT required by drawings and specifications to be either relocated or reused will be removed by the Government in advance of work to avoid interfering with Contractor's operation.

### **1.9 PROTECTION OF EXISTING VEGETATION, STRUCTURES, EQUIPMENT, UTILITIES, AND IMPROVEMENTS**

- A.** The Contractor shall preserve and protect all structures, equipment, and vegetation (such as trees, shrubs, and grass) on or adjacent to the work site which are not to be removed and which do not unreasonably interfere with the work required under this contract. The Contractor shall only remove trees when specifically authorized to do so, and shall avoid damaging vegetation that will remain in place. If any limbs or branches of trees are broken during contract performance, or by the careless operation of equipment, or by workmen, the Contractor shall trim those limbs or branches with a clean cut and paint the cut with a tree-pruning compound as directed by the Contracting Officer.
- B.** The Contractor shall protect from damage all existing improvements and utilities at or near the work site and on adjacent property of a third party, the locations of which are made known to or should be known by the Contractor. The Contractor shall repair any damage to those facilities, including those that are the property of a third party, resulting from failure to comply with the requirements of this contract or failure to exercise reasonable care in performing the work. If the Contractor fails or refuses to repair the damage promptly, the Contracting Officer may have the necessary work performed and charge the cost to the Contractor. **(FAR 52.236-9)**

### **1.10 RESTORATION**

- A.** Remove, cut, alter, replace, patch and repair existing work as necessary to install new work. Except as otherwise shown or specified, do not cut, alter or remove any structural work, and do not disturb any ducts, plumbing, steam, gas, or electric work without approval of the COR. Existing work to be altered or extended and that is found to be defective in any way, shall be reported to the COR before it is disturbed. Materials and workmanship used in restoring work shall conform in type and quality to that of original existing construction, except as otherwise shown or specified.
- B.** Upon completion of contract, deliver work complete and undamaged. Existing work (walls, ceilings, partitions, floors, mechanical and electrical work, lawns, paving, roads, walks, etc.) disturbed or removed as a result of performing required new work, shall be patched, repaired, reinstalled, or replaced with new work, and refinished and left in as good condition as existed before commencing work.

- C. At Contractor's own expense, Contractor shall immediately restore to service and repair any damage caused by Contractor's workmen to existing piping and conduits, wires, cables, etc., of utility services or of fire protection systems and communications systems (including telephone) which are not scheduled for discontinuance or abandonment.
- D. Expense of repairs to such utilities and systems not shown on drawings or locations of which are unknown will be covered by adjustment to contract time and price in accordance with clause entitled "CHANGES" (FAR 52.243-4 and VAAR 852.236-88) and "DIFFERING SITE CONDITIONS" (FAR 52.236-2).

#### **1.11 PHYSICAL DATA**

- A. Data and information furnished or referred to below is for the Contractor's information. The Government shall not be responsible for any interpretation of or conclusion drawn from the data or information by the Contractor.
  - 1. The indications of physical conditions on the drawings and in the specifications are the result of site investigations by BSA.

#### **1.12 PROFESSIONAL SURVEYING SERVICES (RESERVED)**

#### **1.13 LAYOUT OF WORK**

- A. The Contractor shall layout the work from Government established base lines and bench marks, indicated on the drawings, and shall be responsible for all measurements in connection with the layout. The Contractor shall furnish, at Contractor's own expense, all stakes, templates, platforms, equipment, tools, materials, and labor required to lay out any part of the work. The Contractor shall be responsible for executing the work to the lines and grades that may be established or indicated by the Contracting Officer. The Contractor shall also be responsible for maintaining and preserving all stakes and other marks established by the Contracting Officer until authorized to remove them. If such marks are destroyed by the Contractor or through Contractor's negligence before their removal is authorized, the Contracting Officer may replace them and deduct the expense of the replacement from any amounts due or to become due to the Contractor. **(FAR 52.236-17)**
- B. Establish and plainly mark center lines for each building and corner of column lines and/or addition to each existing building, and such other lines and grades that are reasonably necessary to properly assure that location, orientation, and elevations established for each such structure and/or addition, roads, and parking lots, are in accordance with lines and elevations shown on contract drawings.

**1.14 AS-BUILT DRAWINGS**

- A.** The Contractor shall maintain two full size sets of as-built drawings which will be kept current during construction of the project, to include all contract changes, modifications and clarifications.
- B.** All variations shall be shown in the same general detail as used in the contract drawings. To insure compliance, as-built drawings shall be made available for the COR's review, as often as requested.
- C.** Contractor shall deliver two approved completed sets of as-built drawings in the electronic version (scanned PDF) to the COR within 15 calendar days after each completed phase and after the acceptance of the project by the COR.
- D.** Paragraphs A, B, & C shall also apply to all shop drawings.

**1.15 USE OF ROADWAYS**

- A.** For hauling, use only established public roads and roads on Medical Center property and, when authorized by the COR, such temporary roads which are necessary in the performance of contract work. Temporary roads shall be constructed and restoration performed by the Contractor at Contractor's expense. When necessary to cross curbing, sidewalks, or similar construction, they must be protected by well-constructed bridges.
- B.** When new permanent roads are to be a part of this contract, Contractor may construct them immediately for use to facilitate building operations. These roads may be used by all who have business thereon within zone of building operations.
- C.** When certain buildings (or parts of certain buildings) are required to be completed in advance of general date of completion, all roads leading thereto must be completed and available for use at time set for completion of such buildings or parts thereof.

**1.16 RESIDENT ENGINEER'S FIELD OFFICE (RESERVED)****1.17 TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT**

- A.** Use of new installed mechanical and electrical equipment to provide heat, ventilation, plumbing, light and power will be permitted subject to written approval and compliance with the following provisions:
  - 1. Permission to use each unit or system must be given by COR in writing. If the equipment is not installed and maintained in accordance with the written agreement and following provisions, the COR will withdraw permission for use of the equipment.



2. Electrical installations used by the equipment shall be completed in accordance with the drawings and specifications to prevent damage to the equipment and the electrical systems, i.e. transformers, relays, circuit breakers, fuses, conductors, motor controllers and their overload elements shall be properly sized, coordinated and adjusted. Installation of temporary electrical equipment or devices shall be in accordance with NFPA 70, National Electrical Code, (2014 Edition), Article 590, *Temporary Installations*. Voltage supplied to each item of equipment shall be verified to be correct and it shall be determined that motors are not overloaded. The electrical equipment shall be thoroughly cleaned before using it and again immediately before final inspection including vacuum cleaning and wiping clean interior and exterior surfaces.
  3. Units shall be properly lubricated, balanced, and aligned. Vibrations must be eliminated.
  4. Automatic temperature control systems for preheat coils shall function properly and all safety controls shall function to prevent coil freeze-up damage.
  5. The air filtering system utilized shall be that which is designed for the system when complete, and all filter elements shall be replaced at completion of construction and prior to testing and balancing of system.
  6. All components of heat production and distribution system, metering equipment, condensate returns, and other auxiliary facilities used in temporary service shall be cleaned prior to use; maintained to prevent corrosion internally and externally during use; and cleaned, maintained and inspected prior to acceptance by the Government. Boilers, pumps, feed-water heaters and auxiliary equipment must be operated as a complete system and be fully maintained by operating personnel. Boiler water must be given complete and continuous chemical treatment.
- B.** Prior to final inspection, the equipment or parts used which show wear and tear beyond normal, shall be replaced with identical replacements, at no additional cost to the Government.
- C.** This paragraph shall not reduce the requirements of the mechanical and electrical specifications sections.
- D.** Any damage to the equipment or excessive wear due to prolonged use will be repaired replaced by the Contractor at the Contractor's expense.

**1.18 TEMPORARY USE OF EXISTING ELEVATORS**

- A.** Contractor of existing service elevator for handling building materials and Contractor's personnel will be permitted subject to following provisions:

1. Contractor makes all arrangements with the COR for use of elevators. Contractor may use service elevator S4 in Building 1 for daily use. The service elevator can be used for material handling after 5:30pm to access the 4th floor. The service elevator shall not be used at the designated "lock-out" times noted below:

Exclusive Dietetic Usage:

7:00am - 7:35am Daily

12:00pm - 12:35pm Daily

4:45pm - 5:20pm Daily.

Contractor may not use passenger elevator #'s 2 and #3, or hydraulic elevator #'s 4 and 6 in Building No. 1 for daily use. In addition, contractors are not allowed to enter the hospital through the main entrance.

2. Contractor covers and provides maximum protection of following elevator components:
  - a. Entrance jambs, heads soffits and threshold plates.
  - b. Entrance columns, canopy, return panels and inside surfaces of car enclosure walls.
  - c. Finish flooring.

**1.19 TEMPORARY USE OF NEW ELEVATORS (RESERVED)****1.20 TEMPORARY TOILETS**

- A.** Provide where directed, (for use of all Contractor's workmen) ample temporary sanitary toilet accommodations with suitable sewer and water connections; or, when approved by COR, provide suitable dry closets where directed. Keep such places clean and free from flies and all connections and appliances connected therewith are to be removed prior to completion of contract, and premises left perfectly clean.
- B.** Contractor may have for use of Contractor's workmen such toilet accommodations as may be assigned to Contractor by Medical Center. Contractor shall keep such places clean and be responsible for any damage done thereto by Contractor's workmen. Failure to maintain satisfactory condition in toilets will deprive Contractor of the privilege to use such toilets.

**1.21 AVAILABILITY AND USE OF UTILITY SERVICES**

- A.** The Government shall make all reasonably required amounts of utilities available to the Contractor from existing outlets and supplies, as specified in the contract. The amount to be paid by the Contractor for chargeable electrical services shall be the prevailing rates charged to the Government. The Contractor shall carefully conserve any utilities furnished without charge.
- B.** The Contractor, at Contractor's expense and in a workmanlike manner, in compliance with code and as satisfactory to the Contracting Officer, shall install and maintain all necessary temporary connections and distribution lines, and all meters required to measure the amount of electricity used for the purpose of determining charges. Before final acceptance of the work by the Government, the Contractor shall remove all the temporary connections, distribution lines, meters, and associated paraphernalia and repair restore the infrastructure as required.
- C.** Contractor shall install meters at Contractor's expense and furnish the Medical Center a monthly record of the Contractor's usage of electricity as hereinafter specified.
- D.** Heat: Furnish temporary heat necessary to prevent injury to work and materials through dampness and cold. Use of open salamanders or any temporary heating devices which may be fire hazards or may smoke and damage finished work, will not be permitted. Maintain minimum temperatures as specified for various materials:
  - 1. Obtain heat by connecting to Medical Center heating distribution system.
    - a. Steam is available at no cost to Contractor.
- E.** Electricity (for Construction and Testing): Furnish all temporary electric services.
  - 1. Obtain electricity by connecting to the Medical Center electrical distribution system. The Contractor shall meter and pay for electricity required for electric cranes and hoisting devices, electrical welding devices and any electrical heating devices providing temporary heat. Electricity for all other uses is available at no cost to the Contractor.

**F. Water (for Construction and Testing):** Furnish temporary water service.

1. Obtain water by connecting to the Medical Center water distribution system. Provide reduced pressure backflow preventer at each connection as per code. Water is available at no cost to the Contractor.
2. Maintain connections, pipe, fittings and fixtures and conserve water-use so none is wasted. Failure to stop leakage or other wastes will be cause for revocation (at COR discretion) of use of water from Medical Center's system.

**1.22 NEW TELEPHONE EQUIPMENT (RESERVED)**

**1.23 TESTS**

- A.** As per specification section 23 05 93 the contractor shall provide a written testing and commissioning plan complete with component level, equipment level, sub-system level and system level breakdowns. The plan will provide a schedule and a written sequence of what will be tested, how and what the expected outcome will be. This document will be submitted for approval prior to commencing work. The Contractor shall document the results of the approved plan and submit for approval with the as-built documentation.
- B.** Pre-test mechanical and electrical equipment and systems and make corrections required for proper operation of such systems before requesting final tests. Final test will not be conducted unless pre-tested.
- C.** Conduct final tests required in various sections of specifications in presence of an authorized representative of the Contracting Officer. Contractor shall furnish all labor, materials, equipment, instruments, and forms, to conduct and record such tests.
- D.** Mechanical and electrical systems shall be balanced, controlled and coordinated. A system is defined as the entire system which must be coordinated to work together during normal operation to produce results for which the system is designed. For example, air conditioning supply air is only one part of entire system which provides comfort conditions for a building. Other related components are return air, exhaust air, steam, chilled water, refrigerant, hot water, controls and electricity, etc. Another example of a system which involves several components of different disciplines is a boiler installation. Efficient and acceptable boiler operation depends upon the coordination and proper operation of fuel, combustion air, controls, steam, feed-water, condensate and other related components.

- E.** All related components as defined above shall be functioning when any system component is tested. Tests shall be completed within a reasonably period of time during which operating and environmental conditions remain reasonably constant and are typical of the design conditions.
- F.** Individual test result of any component, where required, will only be accepted when submitted with the test results of related components and of the entire system.

#### **1.24 INSTRUCTIONS**

- A.** Contractor shall furnish Maintenance and Operating manuals (hard copies and electronic) and verbal instructions when required by the various sections of the specifications and as hereinafter specified.
- B.** Manuals: Maintenance and operating manuals and one compact disc (two hard copies and one electronic copy each) for each separate piece of equipment shall be delivered to the COR coincidental with the delivery of the equipment to the job site. Manuals shall be complete, detailed guides for the maintenance and operation of equipment. They shall include complete information necessary for starting, adjusting, maintaining in continuous operation for long periods of time and dismantling and reassembling of the complete units and sub-assembly components. Manuals shall include an index covering all component parts clearly cross-referenced to diagrams and illustrations. Illustrations shall include "exploded" views showing and identifying each separate item. Emphasis shall be placed on the use of special tools and instruments. The function of each piece of equipment, component, accessory and control shall be clearly and thoroughly explained. All necessary precautions for the operation of the equipment and the reason for each precaution shall be clearly set forth. Manuals must reference the exact model, style and size of the piece of equipment and system being furnished. **Manuals referencing equipment similar to but of a different model, style, and size than that furnished will not be accepted.**

- C. Instructions: Contractor shall provide qualified, factory-trained manufacturers' representatives to give detailed training to assigned Department of Veterans Affairs personnel in the operation and complete maintenance for each piece of equipment. All such training will be at the job site.** These requirements are more specifically detailed in the various technical sections. Instructions for different items of equipment that are component parts of a complete system shall be given in an integrated, progressive manner. All instructors for every piece of component equipment in a system shall be available until instructions for all items included in the system have been completed. This is to assure proper instruction in the operation of inter-related systems. All instruction periods shall be at such times as scheduled by the COR and shall be considered concluded only when the COR is satisfied in regard to complete and thorough coverage. The Contractor shall submit a course outline with associated material to the COR for review and approval prior to scheduling training to ensure the subject matter covers the expectations of the VA and the contractual requirements. The Department of Veterans Affairs reserves the right to request the removal of, and substitution for, any instructor who, in the opinion of the COR, does not demonstrate sufficient qualifications in accordance with requirements for instructors above.
- D. Contractor will complete top portion of VA's "New Utility Equipment Check-in" form for each piece of equipment; COR will furnish the form. This will be turned over to COR at the end of each phase.**

#### **1.25 GOVERNMENT-FURNISHED PROPERTY**

- A.** The Government shall deliver to the Contractor, the Government-furnished property shown on the drawings.
- B.** Equipment furnished by Government to be installed by Contractor will be furnished to Contractor at the Medical Center.
- C.** Storage space for equipment will be provided by the Government and the Contractor shall be prepared to unload and store such equipment therein upon its receipt at the Medical Center.

- D. Notify Contracting Officer in writing, 60 days in advance, of date on which Contractor will be prepared to receive equipment furnished by Government. Arrangements will then be made by the Government for delivery of equipment.
  - 1. Immediately upon delivery of equipment, Contractor shall arrange for a joint inspection thereof with a representative of the Government. At such time the Contractor shall acknowledge receipt of equipment described, make notations, and immediately furnish the Government representative with a written statement as to its condition or shortages.
  - 2. Contractor thereafter is responsible for such equipment until such time as acceptance of contract work is made by the Government.
- E. Equipment furnished by the Government will be delivered in a partially assembled (knock down) condition in accordance with existing standard commercial practices, complete with all fittings, fastenings, and appliances necessary for connections to respective services installed under contract. All fittings and appliances (i.e., couplings, ells, tees, nipples, piping, conduits, cables, and the like) necessary to make the connection between the Government furnished equipment item and the utility stub-up shall be furnished and installed by the Contractor at no additional cost to the Government.
- F. Completely assemble and install the Government furnished equipment in place ready for proper operation in accordance with specifications and drawings.
- G. Furnish supervision of installation of equipment at construction site by qualified factory trained technicians regularly employed by the equipment manufacturer.

#### **1.26 RELOCATED EQUIPMENT AND ITEMS**

- A. Contractor shall disconnect, dismantle as necessary, remove and reinstall in new location, all existing equipment and items indicated by symbol "R" or otherwise shown to be relocated by the Contractor.
- B. Perform relocation of such equipment or items at such times and in such a manner as directed by the COR.
- C. Suitably cap existing service lines, such as steam, condensate return, water, drain, gas, air, vacuum and/or electrical, at the main whenever such lines are disconnected from equipment to be relocated.  
Remove abandoned lines in finished areas and cap as specified herein before under paragraph "Abandoned Lines".

- D. Provide all mechanical and electrical service connections, fittings, fastenings and any other materials necessary for assembly and installation of relocated equipment; and leave such equipment in proper operating condition.
- E. Contractor shall employ services of an installation engineer who is an authorized representative of the manufacturer of this equipment to supervise assembly and installation of existing equipment required to be relocated.
- F. All service lines such as noted above for relocated equipment shall be in place at point of relocation ready for use before any existing equipment is disconnected. Make relocated existing equipment ready for operation or use immediately after reinstallation.

**1.27 STORAGE SPACE FOR DEPARTMENT OF VETERANS AFFAIRS EQUIPMENT (RESERVED)**

**1.28 CONSTRUCTION SIGN (RESERVED)**

**1.29 SAFETY SIGN (RESERVED)**

**1.30 PHOTOGRAPHIC DOCUMENTATION (RESERVED)**

**1.31 FINAL ELEVATION DIGITAL IMAGES (RESERVED)**

**1.32 HISTORIC PRESERVATION (RESERVED)**

---END---



**SECTION 01 32 16.15**  
**PROJECT SCHEDULES**  
*(SMALL PROJECTS - DESIGN/BID/BUILD)*

**PART 1- GENERAL**

**1.1 DESCRIPTION**

- A. The Contractor shall develop a Critical Path Method (CPM) plan and schedule demonstrating fulfillment of the contract requirements (Project Schedule), and shall keep the Project Schedule up-to-date in accordance with the requirements of this section and shall utilize the plan for scheduling, coordinating and monitoring work under this contract (including all activities of subcontractors, equipment vendors and suppliers). Conventional Critical Path Method (CPM) technique shall be utilized to satisfy both time and cost applications.

**1.2 CONTRACTOR'S REPRESENTATIVE**

- A. The Contractor shall designate an authorized representative responsible for the Project Schedule including preparation, review and progress reporting with and to the Contracting Officer's Representative (COTR).
- B. The Contractor's representative shall have direct project control and complete authority to act on behalf of the Contractor in fulfilling the requirements of this specification section.
- C. The Contractor's representative shall engage the services of an outside consultant.

**1.3 CONTRACTOR'S CONSULTANT**

- A. The Contractor shall submit a qualification proposal to the COTR, within 10 days of bid acceptance. The qualification proposal shall include:
1. The name and address of the proposed consultant.
  2. Information to show that the proposed consultant has the qualifications to meet the requirements specified in the preceding paragraph.
  3. A representative sample of prior construction projects, which the proposed consultant has performed complete project scheduling services. These representative samples shall be of similar size and scope.
- B. The Contracting Officer has the right to approve or disapprove the proposed consultant, and will notify the Contractor of the VA decision within seven calendar days from receipt of the qualification proposal. In case of disapproval, the Contractor shall resubmit another consultant within 10 calendar days for renewed consideration. The Contractor shall have their scheduling consultant approved prior to submitting any schedule for approval.

#### **1.4 COMPUTER PRODUCED SCHEDULES**

- A. The contractor shall provide monthly, to the Department of Veterans Affairs (VA), all computer-produced time/cost schedules and reports generated from monthly project updates. This monthly computer service will include: three copies of up to five different reports (inclusive of all pages) available within the user defined reports of the scheduling software approved by the Contracting Officer; a hard copy listing of all project schedule changes, and associated data, made at the update and an electronic file of this data; and the resulting monthly updated schedule in PDM format. These must be submitted with and substantively support the contractor's monthly payment request and the signed look ahead report. The COTR shall identify the five different report formats that the contractor shall provide.
- B. The contractor shall be responsible for the correctness and timeliness of the computer-produced reports. The Contractor shall also responsible for the accurate and timely submittal of the updated project schedule and all CPM data necessary to produce the computer reports and payment request that is specified.
- C. The VA will report errors in computer-produced reports to the Contractor's representative within ten calendar days from receipt of reports. The Contractor shall reprocess the computer-produced reports and associated diskette(s), when requested by the Contracting Officer's representative, to correct errors which affect the payment and schedule for the project.

#### **1.5 THE COMPLETE PROJECT SCHEDULE SUBMITTAL**

- A. Within 45 calendar days after receipt of Notice to Proceed, the Contractor shall submit for the Contracting Officer's review; three blue line copies of the interim schedule on sheets of paper 765 x 1070 mm (30 x 42 inches) and an electronic file in the previously approved CPM schedule program. The submittal shall also include three copies of a computer-produced activity/event ID schedule showing project duration; phase completion dates; and other data, including event cost. Each activity/event on the computer-produced schedule shall contain as a minimum, but not limited to, activity/event ID, activity/event description, duration, budget amount, early start date, early finish date, late start date, late finish date and total float. Work activity/event relationships shall be restricted to finish-to-start or start-to-start without lead or lag constraints. Activity/event date constraints, not required by the contract, will not be accepted unless submitted to and approved by the Contracting Officer. The contractor shall make a separate written detailed request to the Contracting

Officer identifying these date constraints and secure the Contracting Officer's written approval before incorporating them into the network diagram. The Contracting Officer's separate approval of the Project Schedule shall not excuse the contractor of this requirement. Logic events (non-work) will be permitted where necessary to reflect proper logic among work events, but must have zero duration. The complete working schedule shall reflect the Contractor's approach to scheduling the complete project. **The final Project Schedule in its original form shall contain no contract changes or delays which may have been incurred during the final network diagram development period and shall reflect the entire contract duration as defined in the bid documents.** These changes/delays shall be entered at the first update after the final Project Schedule has been approved. The Contractor should provide their requests for time and supporting time extension analysis for contract time as a result of contract changes/delays, after this update, and in accordance with Article, ADJUSTMENT OF CONTRACT COMPLETION.

- D. Within 30 calendar days after receipt of the complete project interim Project Schedule and the complete final Project Schedule, the Contracting Officer or his representative, will do one or both of the following:
  - 1. Notify the Contractor concerning his actions, opinions, and objections.
  - 2. A meeting with the Contractor at or near the job site for joint review, correction or adjustment of the proposed plan will be scheduled if required. Within 14 calendar days after the joint review, the Contractor shall revise and shall submit three blue line copies of the revised Project Schedule, three copies of the revised computer-produced activity/event ID schedule and a revised electronic file as specified by the Contracting Officer. The revised submission will be reviewed by the Contracting Officer and, if found to be as previously agreed upon, will be approved.
- E. The approved baseline schedule and the computer-produced schedule(s) generated there from shall constitute the approved baseline schedule until subsequently revised in accordance with the requirements of this section.

**1.6 WORK ACTIVITY/EVENT COST DATA**

- A. The Contractor shall cost load all work activities/events except procurement activities. The cumulative amount of all cost loaded work activities/events (including alternates) shall equal the total contract price. Prorate overhead, profit and general conditions on all work activities/events for the entire project length. The contractor shall generate from this information cash flow curves indicating graphically the total percentage of work activity/event dollar value scheduled to be in place on early finish, late finish. These cash flow curves will be used by the Contracting Officer to assist him in determining approval or disapproval of the cost loading. Negative work activity/event cost data will not be acceptable, except on VA issued contract changes.
- B. The Contractor shall cost load work activities/events for test, balance and adjust various systems in accordance with the provisions in Article, FAR 52.232 - 5 (PAYMENT UNDER FIXED-PRICE CONSTRUCTION CONTRACTS).
- C. The Contractor shall cost load work activities/events for all BID ITEMS including ASBESTOS ABATEMENT. The sum of each BID ITEM work shall equal the value of the bid item in the Contractors' bid.

**1.7 PROJECT SCHEDULE REQUIREMENTS**

- A. Show on the project schedule the sequence of work activities/events required for complete performance of all items of work. The Contractor Shall:
  - 1. Show activities/events as:
    - a. Contractor's time required for submittal of shop drawings, templates, fabrication, delivery and similar pre-construction work.
    - b. Contracting Officer's and Architect-Engineer's review and approval of shop drawings, equipment schedules, samples, template, or similar items.
    - c. Interruption of VA Facilities utilities, delivery of Government furnished equipment, and rough-in drawings, project phasing and any other specification requirements.
    - d. Test, balance and adjust various systems and pieces of equipment, maintenance and operation manuals, instructions and preventive maintenance tasks.
    - e. VA inspection and acceptance activity/event with a minimum duration of five work days at the end of each phase and immediately preceding any VA move activity/event required by the contract phasing for that phase.

2. Show not only the activities/events for actual construction work for each trade category of the project, but also trade relationships to indicate the movement of trades from one area, floor, or building, to another area, floor, or building, for at least five trades who are performing major work under this contract.
  3. Break up the work into activities/events of a duration no longer than 20 work days each or one reporting period, except as to non-construction activities/events (i.e., procurement of materials, delivery of equipment, concrete and asphalt curing) and any other activities/events for which the COTR may approve the showing of a longer duration. The duration for VA approval of any required submittal, shop drawing, or other submittals will not be less than 20 work days.
  4. Describe work activities/events clearly, so the work is readily identifiable for assessment of completion. Activities/events labeled "start," "continue," or "completion," are not specific and will not be allowed. Lead and lag time activities will not be acceptable.
  5. The schedule shall be generally numbered in such a way to reflect either discipline, phase or location of the work.
- B. The Contractor shall submit the following supporting data in addition to the project schedule:
1. The appropriate project calendar including working days and holidays.
  2. The planned number of shifts per day.
  3. The number of hours per shift.
- Failure of the Contractor to include this data shall delay the review of the submittal until the Contracting Officer is in receipt of the missing data.
- C. To the extent that the Project Schedule or any revised Project Schedule shows anything not jointly agreed upon, it shall not be deemed to have been approved by the COTR. Failure to include any element of work required for the performance of this contract shall not excuse the Contractor from completing all work required within any applicable completion date of each phase regardless of the COTR's approval of the Project Schedule.
- D. Compact Disk Requirements and CPM Activity/Event Record Specifications: Submit to the VA an electronic file(s) containing one file of the data required to produce a schedule, reflecting all the activities/events of the complete project schedule being submitted.

**1.8 PAYMENT TO THE CONTRACTOR:**

- A. Monthly, the contractor shall submit VA Form 10-6001a or the AIA application and certificate for payment documents G702 & G703 reflecting updated schedule activities and cost data in accordance with the provisions of the following Article, PAYMENT AND PROGRESS REPORTING, as the basis upon which progress payments will be made pursuant to Article, FAR 52.232 - 5 (PAYMENT UNDER FIXED-PRICE CONSTRUCTION CONTRACTS) and VAAR 852.236 - 83 (PAYMENT UNDER FIXED-PRICE CONSTRUCTION CONTRACTS). The Contractor shall be entitled to a monthly progress payment upon approval of estimates as determined from the currently approved updated project schedule. Monthly payment requests shall include: a listing of all agreed upon project schedule changes and associated data; and an electronic file (s) of the resulting monthly updated schedule.
- B. Approval of the Contractor's monthly Application for Payment shall be contingent, among other factors, on the submittal of a satisfactory monthly update of the project schedule.

**1.9 PAYMENT AND PROGRESS REPORTING**

- A. Monthly schedule update meetings will be held on dates mutually agreed to by the COTR and the Contractor. Contractor and their CPM consultant (if applicable) shall attend all monthly schedule update meetings. The Contractor shall accurately update the Project Schedule and all other data required and provide this information to the COTR three work days in advance of the schedule update meeting. Job progress will be reviewed to verify:
  - 1. Actual start and/or finish dates for updated/completed activities/events.
  - 2. Remaining duration for each activity/event started, or scheduled to start, but not completed.
  - 3. Logic, time and cost data for change orders, and supplemental agreements that are to be incorporated into the Project Schedule.
  - 4. Changes in activity/event sequence and/or duration which have been made, pursuant to the provisions of following Article, ADJUSTMENT OF CONTRACT COMPLETION.
  - 5. Completion percentage for all completed and partially completed activities/events.
  - 6. Logic and duration revisions required by this section of the specifications.
  - 7. Activity/event duration and percent complete shall be updated independently.

- B. After completion of the joint review, the contractor shall generate an updated computer-produced calendar-dated schedule and supply the Contracting Officer's representative with reports in accordance with the Article, COMPUTER PRODUCED SCHEDULES, specified.
- C. After completing the monthly schedule update, the contractor's representative or scheduling consultant shall rerun all current period contract change(s) against the prior approved monthly project schedule. The analysis shall only include original workday durations and schedule logic agreed upon by the contractor and resident engineer for the contract change(s). When there is a disagreement on logic and/or durations, the Contractor shall use the schedule logic and/or durations provided and approved by the resident engineer. After each rerun update, the resulting electronic project schedule data file shall be appropriately identified and submitted to the VA in accordance to the requirements listed in articles 1.4 and 1.7. This electronic submission is separate from the regular monthly project schedule update requirements and shall be submitted to the resident engineer within fourteen (14) calendar days of completing the regular schedule update. **Before inserting the contract changes durations, care must be taken to ensure that only the original durations will be used for the analysis, not the reported durations after progress. In addition, once the final network diagram is approved, the contractor must recreate all manual progress payment updates on this approved network diagram and associated reruns for contract changes in each of these update periods as outlined above for regular update periods. This will require detailed record keeping for each of the manual progress payment updates.**
- D. Following approval of the CPM schedule, the VA, the General Contractor, its approved CPM Consultant, RE office representatives, and all subcontractors needed, as determined by the SRE, shall meet to discuss the monthly updated schedule. The main emphasis shall be to address work activities to avoid slippage of project schedule and to identify any necessary actions required to maintain project schedule during the reporting period. The Government representatives and the Contractor should conclude the meeting with a clear understanding of those work and administrative actions necessary to maintain project schedule status during the reporting period. This schedule coordination meeting will occur after each monthly project schedule update meeting utilizing the resulting schedule reports from that schedule update. If the project is behind schedule, discussions should include ways to prevent further slippage as well as ways to improve the project schedule status, when appropriate.

**1.10 RESPONSIBILITY FOR COMPLETION**

- A. If it becomes apparent from the current revised monthly progress schedule that phasing or contract completion dates will not be met, the Contractor shall execute some or all of the following remedial actions:
  - 1. Increase construction manpower in such quantities and crafts as necessary to eliminate the backlog of work.
  - 2. Increase the number of working hours per shift, shifts per working day, working days per week, the amount of construction equipment, or any combination of the foregoing to eliminate the backlog of work.
  - 3. Reschedule the work in conformance with the specification requirements.
- B. Prior to proceeding with any of the above actions, the Contractor shall notify and obtain approval from the COTR for the proposed schedule changes. If such actions are approved, the representative schedule revisions shall be incorporated by the Contractor into the Project Schedule before the next update, at no additional cost to the Government.

**1.11 CHANGES TO THE SCHEDULE**

- A. Within 30 calendar days after VA acceptance and approval of any updated project schedule, the Contractor shall submit a revised electronic file (s) and a list of any activity/event changes including predecessors and successors for any of the following reasons:
  - 1. Delay in completion of any activity/event or group of activities/events, which may be involved with contract changes, strikes, unusual weather, and other delays will not relieve the Contractor from the requirements specified unless the conditions are shown on the CPM as the direct cause for delaying the project beyond the acceptable limits.
  - 2. Delays in submittals, or deliveries, or work stoppage are encountered which make rescheduling of the work necessary.
  - 3. The schedule does not represent the actual prosecution and progress of the project.
  - 4. When there is, or has been, a substantial revision to the activity/event costs regardless of the cause for these revisions.
- B. CPM revisions made under this paragraph which affect the previously approved computer-produced schedules for Government furnished equipment, vacating of areas by the VA Facility, contract phase(s) and sub phase(s), utilities furnished by the Government to the Contractor, or any other previously contracted item, shall be furnished in writing to the Contracting Officer for approval.



- C. Contracting Officer's approval for the revised project schedule and all relevant data is contingent upon compliance with all other paragraphs of this section and any other previous agreements by the Contracting Officer or the VA representative.
- D. The cost of revisions to the project schedule resulting from contract changes will be included in the proposal for changes in work as specified in FAR 52.243 - 4 (Changes) and VAAR 852.236 - 88 (Changes - Supplemental), and will be based on the complexity of the revision or contract change, man hours expended in analyzing the change, and the total cost of the change.
- E. The cost of revisions to the Project Schedule not resulting from contract changes is the responsibility of the Contractor.

#### **1.12 ADJUSTMENT OF CONTRACT COMPLETION**

- A. The contract completion time will be adjusted only for causes specified in this contract. Request for an extension of the contract completion date by the Contractor shall be supported with a justification, CPM data and supporting evidence as the COTR may deem necessary for determination as to whether or not the Contractor is entitled to an extension of time under the provisions of the contract. Submission of proof based on revised activity/event logic, durations (in work days) and costs is obligatory to any approvals. The schedule must clearly display that the Contractor has used, in full, all the float time available for the work involved in this request. The Contracting Officer's determination as to the total number of days of contract extension will be based upon the current computer-produced calendar-dated schedule for the time period in question and all other relevant information.
- B. Actual delays in activities/events which, according to the computer-produced calendar-dated schedule, do not affect the extended and predicted contract completion dates shown by the critical path in the network, will not be the basis for a change to the contract completion date. The Contracting Officer will within a reasonable time after receipt of such justification and supporting evidence, review the facts and advise the Contractor in writing of the Contracting Officer's decision.

- C. The Contractor shall submit each request for a change in the contract completion date to the Contracting Officer in accordance with the provisions specified under FAR 52.243 - 4 (Changes) and VAAR 852.236 - 88 (Changes - Supplemental). The Contractor shall include, as a part of each change order proposal, a sketch showing all CPM logic revisions, duration (in work days) changes, and cost changes, for work in question and its relationship to other activities on the approved network diagram.
- D. All delays due to non-work activities/events such as RFI's, WEATHER, STRIKES, and similar non-work activities/events shall be analyzed on a month by month basis.

- - - E N D - - -

**SECTION 01 33 23****SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES****PART 1 - GENERAL****1.1 DESCRIPTION**

- A. This specification defines the general requirements and procedures for submittals. A submittal is information submitted for VA review to establish compliance with the contract documents.
- B. Detailed submittal requirements are found in the technical sections of the contract specifications. The Contracting Officer may request submittals in addition to those specified when deemed necessary to adequately describe the work covered in the respective technical specifications at no additional cost to the government.
- C. VA approval of a submittal does not relieve the Contractor of the responsibility for any error which may exist. The Contractor is responsible for fully complying with all contract requirements and the satisfactory construction of all work, including the need to check, confirm, and coordinate the work of all subcontractors for the project. Non-compliant material incorporated in the work will be removed and replaced at the Contractor's expense.

**1.2 DEFINITIONS**

- A. Preconstruction Submittals: Submittals which are required prior to issuing contract notice to proceed or starting construction. For example, Certificates of insurance; Surety bonds; Site-specific safety plan; Construction progress schedule; Schedule of values; Submittal register; List of proposed subcontractors.
- B. Shop Drawings: Drawings, diagrams, and schedules specifically prepared to illustrate some portion of the work. Drawings prepared by or for the Contractor to show how multiple systems and interdisciplinary work will be integrated and coordinated.
- C. Product Data: Catalog cuts, illustrations, schedules, diagrams, performance charts, instructions, and brochures, which describe and illustrate size, physical appearance, and other characteristics of materials, systems, or equipment for some portion of the work. Samples of warranty language when the contract requires extended product warranties.

- D. Samples: Physical examples of materials, equipment, or workmanship that illustrate functional and aesthetic characteristics of a material or product and establish standards by which the work can be judged. Color samples from the manufacturer's standard line (or custom color samples if specified) to be used in selecting or approving colors for the project. Field samples and mock-ups constructed to establish standards by which the ensuing work can be judged.
- E. Design Data: Calculations, mix designs, analyses, or other data pertaining to a part of work.
- F. Test Reports: Report which includes findings of a test required to be performed by the Contractor on an actual portion of the work. Report which includes finding of a test made at the job site or on sample taken from the job site, on portion of work during or after installation.
- G. Certificates: Document required of Contractor, or of a manufacturer, supplier, installer, or subcontractor through Contractor. The purpose is to document procedures, acceptability of methods, or personnel qualifications for a portion of the work.
- H. Manufacturer's Instructions: Pre-printed material describing installation of a product, system, or material, including special notices and MSDS concerning impedances, hazards, and safety precautions.
- I. Manufacturer's Field Reports: Documentation of the testing and verification actions taken by manufacturer's representative at the job site on a portion of the work, during or after installation, to confirm compliance with manufacturer's standards or instructions. The documentation must indicate whether the material, product, or system has passed or failed the test.
- J. Operation and Maintenance Data: Manufacturer data that is required to operate, maintain, troubleshoot, and repair equipment, including manufacturer's help, parts list, and product line documentation. This data shall be incorporated in an operations and maintenance manual.
- K. Closeout Submittals: Documentation necessary to properly close out a construction contract. For example, Record Drawings and as-built drawings. Also, submittal requirements necessary to properly close out a phase of construction on a multi-phase contract.

**1.3 SUBMITTAL REGISTER**

- A. The submittal register will list items of equipment and materials for which submittals are required by the specifications. This list may not be all inclusive and additional submittals may be required by the specifications. The Contractor is not relieved from supplying submittals required by the contract documents but which have been omitted from the submittal register.
- B. The submittal register will serve as a scheduling document for submittals and will be used to control submittal actions throughout the contract period.
- C. The VA will provide the initial submittal register in electronic format. Thereafter, the Contractor shall track all submittals by maintaining a complete list, including completion of all data columns, including dates on which submittals are received and returned by the VA.
- D. The Contractor shall update the submittal register as submittal actions occur and maintain the submittal register at the project site until final acceptance of all work by Contracting Officer.
- E. The Contractor shall submit formal monthly updates to the submittal register in electronic format. Each monthly update shall document actual submission and approval dates for each submittal.

**1.4 SUBMITTAL SCHEDULING**

- A. Submittals are to be scheduled, submitted, reviewed, and approved prior to the acquisition of the material or equipment.
- B. Coordinate scheduling, sequencing, preparing, and processing of submittals with performance of work so that work will not be delayed by submittal processing. Allow time for potential resubmittal.
- C. No delay costs or time extensions will be allowed for time lost in late submittals or resubmittals.
- D. All submittals are required to be approved prior to the start of the specified work activity.

**1.5 SUBMITTAL PREPARATION**

- A. Each submittal is to be complete and in sufficient detail to allow ready determination of compliance with contract requirements.

- B. Collect required data for each specific material, product, unit of work, or system into a single submittal. Prominently mark choices, options, and portions applicable to the submittal. Partial submittals will not be accepted for expedition of construction effort. Submittal will be returned without review if incomplete.
- C. If available product data is incomplete, provide Contractor-prepared documentation to supplement product data and satisfy submittal requirements.
- D. All irrelevant or unnecessary data shall be removed from the submittal to facilitate accuracy and timely processing. Submittals that contain the excessive amount of irrelevant or unnecessary data will be returned with review.
- E. Provide a transmittal form for each submittal with the following information:
  - 1. Project title, location and number.
  - 2. Construction contract number.
  - 3. Date of the drawings and revisions.
  - 4. Name, address, and telephone number of subcontractor, supplier, manufacturer, and any other subcontractor associated with the submittal.
  - 5. List paragraph number of the specification section and sheet number of the contract drawings by which the submittal is required.
  - 6. When a resubmission, add alphabetic suffix on submittal description. For example, submittal 18 would become 18A, to indicate resubmission.
  - 7. Product identification and location in project.
- F. The Contractor is responsible for reviewing and certifying that all submittals are in compliance with contract requirements before submitting for VA review. Proposed deviations from the contract requirements are to be clearly identified. All deviations submitted must include a side by side comparison of item being proposed against item specified. Failure to point out deviations will result in the VA requiring removal and replacement of such work at the Contractor's expense.
- G. Stamp, sign, and date each submittal transmittal form indicating action taken.

H. Stamp used by the Contractor on the submittal transmittal form to certify that the submittal meets contract requirements is to be similar to the following:

CONTRACTOR
(Firm Name)
_____ Approved
_____ Approved with corrections as noted on submittal data and/or attached sheets(s)
SIGNATURE: _____
TITLE: _____
DATE: _____

#### 1.6 SUBMITTAL FORMAT AND TRANSMISSION

- A. Provide submittals in electronic format, with the exception of material samples. Use PDF as the electronic format, unless otherwise specified or directed by the Contracting Officer.
- B. Compile the electronic submittal file as a single, complete document. Name the electronic submittal file specifically according to its contents.
- C. Electronic files must be of sufficient quality that all information is legible. Generate PDF files from original documents so that the text included in the PDF file is both searchable and can be copied. If documents are scanned, Optical Character Resolution (OCR) routines are required.

- D. E-mail electronic submittal documents smaller than 5MB in size to e-mail addresses as directed by the Contracting Officer.
- E. Provide electronic documents over 5MB through an electronic FTP file sharing system. Confirm that the electronic FTP file sharing system can be accessed from the VA computer network. The Contractor is responsible for setting up, providing, and maintaining the electronic FTP file sharing system for the construction contract period of performance.
- F. Provide hard copies of submittals when requested by the Contracting Officer. Up to 3 additional hard copies of any submittal may be requested at the discretion of the Contracting Officer, at no additional cost to the VA.

#### **1.7 SAMPLES**

- A. Submit two sets of physical samples showing range of variation, for each required item.
- B. Where samples are specified for selection of color, finish, pattern, or texture, submit the full set of available choices for the material or product specified.
- C. When color, texture, or pattern is specified by naming a particular manufacturer and style, include one sample of that manufacturer and style, for comparison.
- D. Before submitting samples, the Contractor is to ensure that the materials or equipment will be available in quantities required in the project. No change or substitution will be permitted after a sample has been approved.
- E. The VA reserves the right to disapprove any material or equipment which previously has proven unsatisfactory in service.
- F. Physical samples supplied maybe requested back for use in the project after reviewed and approved.

#### **1.8 OPERATION AND MAINTENANCE DATA**

- A. Submit data specified for a given item within 30 calendar days after the item is delivered to the contract site.
- B. In the event the Contractor fails to deliver O&M Data within the time limits specified, the Contracting Officer may withhold from progress payments 50 percent of the price of the item with which such O&M Data are applicable.



## 1.9 TEST REPORTS

SRE may require specific test after work has been installed or completed which could require contractor to repair test area at no additional cost to contract.

## 1.10 VA REVIEW OF SUBMITTALS AND RFIS

- A. The VA will review all submittals for compliance with the technical requirements of the contract documents. The Architect-Engineer for this project will assist the VA in reviewing all submittals and determining contractual compliance. Review will be only for conformance with the applicable codes, standards and contract requirements.
- B. Period of review for submittals begins when the VA COR receives submittal from the Contractor.
- C. Period of review for each resubmittal is the same as for initial submittal.
- D. VA review period is 15 working days for submittals.
- E. VA review period is 10 working days for RFIs.
- F. The VA will return submittals to the Contractor with the following notations:
  - 1. "Approved": Authorizes the Contractor to proceed with the work covered.
  - 2. "Approved as Noted": Authorizes the Contractor to proceed with the work covered provided the Contractor incorporates the noted comments and makes the noted corrections.
  - 3. "Disapproved, Revise and Resubmit": Indicates noncompliance with the contract requirements or that submittal is incomplete. Resubmit with appropriate changes and corrections. No work shall proceed for this item until resubmittal is approved.
  - 4. "Not Reviewed": Indicates submittal does not have evidence of being reviewed and approved by Contractor or is not complete. A submittal marked "not reviewed" will be returned with an explanation of the reason it is not reviewed. Resubmit submittals after taking appropriate action.

**1.11 APPROVED SUBMITTALS**

- A. The VA approval of submittals is not to be construed as a complete check, and indicates only that the general method of construction, materials, detailing, and other information are satisfactory.
- B. VA approval of a submittal does not relieve the Contractor of the responsibility for any error which may exist. The Contractor is responsible for fully complying with all contract requirements and the satisfactory construction of all work, including the need to check, confirm, and coordinate the work of all subcontractors for the project. Non-compliant material incorporated in the work will be removed and replaced at the Contractor's expense.
- C. After submittals have been approved, no resubmittal for the purpose of substituting materials or equipment will be considered unless accompanied by an explanation of why a substitution is necessary.
- D. Retain a copy of all approved submittals at project site, including approved samples.

**1.12 WITHHOLDING OF PAYMENT**

- A. Payment for materials incorporated in the work will not be made if required approvals have not been obtained.

- - - E N D - - -

**SECTION 01 35 26**  
**SAFETY REQUIREMENTS**

**1.1 APPLICABLE PUBLICATIONS**

- A. Latest publications listed below form part of this Article to extent referenced. Publications are referenced in text by basic designations only.
- B. American Society of Safety Engineers (ASSE):
  - A10.1-2011.....Pre-Project & Pre-Task Safety and Health Planning
  - A10.34-2012.....Protection of the Public on or Adjacent to Construction Sites
  - A10.38-2013.....Basic Elements of an Employer's Program to Provide a Safe and Healthful Work Environment  
American National Standard Construction and Demolition Operations
- C. American Society for Testing and Materials (ASTM):
  - E84-2013.....Surface Burning Characteristics of Building Materials
- D. The Facilities Guidelines Institute (FGI):
  - FGI Guidelines-2010Guidelines for Design and Construction of Healthcare Facilities
- E. National Fire Protection Association (NFPA):
  - 10-2013.....Standard for Portable Fire Extinguishers
  - 30-2012.....Flammable and Combustible Liquids Code
  - 51B-2014.....Standard for Fire Prevention During Welding, Cutting and Other Hot Work
  - 70-2014.....National Electrical Code
  - 70B-2013.....Recommended Practice for Electrical Equipment Maintenance
  - 70E-2015 .....Standard for Electrical Safety in the Workplace
  - 99-2012.....Health Care Facilities Code
  - 241-2013.....Standard for Safeguarding Construction, Alteration, and Demolition Operations
- F. The Joint Commission (TJC)
  - TJC Manual .....Comprehensive Accreditation and Certification Manual
- G. U.S. Nuclear Regulatory Commission
  - 10 CFR 20 .....Standards for Protection Against Radiation

## H. U.S. Occupational Safety and Health Administration (OSHA):

29 CFR 1904 .....Reporting and Recording Injuries & Illnesses

29 CFR 1910 .....Safety and Health Regulations for General  
Industry

29 CFR 1926 .....Safety and Health Regulations for Construction  
Industry

CPL 2-0.124.....Multi-Employer Citation Policy

## I. VHA Directive 2005-007

**1.2 DEFINITIONS**

- A. Critical Lift. A lift with the hoisted load exceeding 75% of the crane's maximum capacity; lifts made out of the view of the operator (blind picks); lifts involving two or more cranes; personnel being hoisted; and special hazards such as lifts over occupied facilities, loads lifted close to power-lines, and lifts in high winds or where other adverse environmental conditions exist; and any lift which the crane operator believes is critical.
- B. OSHA "Competent Person" (CP). One who is capable of identifying existing and predictable hazards in the surroundings and working conditions which are unsanitary, hazardous or dangerous to employees, and who has the authorization to take prompt corrective measures to eliminate them (see 29 CFR 1926.32(f)).
- C. "Qualified Person" means one who, by possession of a recognized degree, certificate, or professional standing, or who by extensive knowledge, training and experience, has successfully demonstrated his ability to solve or resolve problems relating to the subject matter, the work, or the project.
- D. High Visibility Accident. Any mishap which may generate publicity or high visibility.

E. Accident/Incident Criticality Categories:

No impact - near miss incidents that should be investigated but are not required to be reported to the VA;

Minor incident/impact - incidents that require first aid or result in minor equipment damage (less than \$5000). These incidents must be investigated but are not required to be reported to the VA;

Moderate incident/impact - Any work-related injury or illness that results in:

1. Days away from work (any time lost after day of injury/illness onset);
2. Restricted work;
3. Transfer to another job;
4. Medical treatment beyond first aid;
5. Loss of consciousness;
6. A significant injury or illness diagnosed by a physician or other licensed health care professional, even if it did not result in (1) through (5) above or,
7. Any incident that leads to major equipment damage (greater than \$5000).

These incidents must be investigated and are required to be reported to the VA;

Major incident/impact - Any mishap that leads to fatalities, hospitalizations, amputations, and losses of an eye as a result of contractors' activities. Or any incident which leads to major property damage (greater than \$20,000) and/or may generate publicity or high visibility. These incidents must be investigated and are required to be reported to the VA as soon as practical, but not later than 2 hours after the incident.

F. Medical Treatment. Treatment administered by a physician or by registered professional personnel under the standing orders of a physician. Medical treatment does not include first aid treatment even though provided by a physician or registered personnel.

### **1.3 REGULATORY REQUIREMENTS**

- A. In addition to the detailed requirements included in the provisions of this contract, comply with 29 CFR 1926, comply with 29 CFR 1910 as incorporated by reference within 29 CFR 1926, comply with ASSE A10.34, and all applicable [federal, state, and local] laws, ordinances, criteria, rules and regulations. Submit matters of interpretation of standards for resolution before starting work. Where the requirements of this specification, applicable laws, criteria, ordinances, regulations, and referenced documents vary, the most stringent requirements govern except with specific approval and acceptance by the Contracting Officer Representative.

### **1.4 ACCIDENT PREVENTION PLAN (APP)**

- A. The APP (aka Construction Safety & Health Plan) shall interface with the Contractor's overall safety and health program. Include any portions of the Contractor's overall safety and health program referenced in the APP in the applicable APP element and ensure it is site-specific. The Government considers the Prime Contractor to be the "controlling authority" for all worksite safety and health of each subcontractor(s). Contractors are responsible for informing their subcontractors of the safety provisions under the terms of the contract and the penalties for noncompliance, coordinating the work to prevent one craft from interfering with or creating hazardous working conditions for other crafts, and inspecting subcontractor operations to ensure that accident prevention responsibilities are being carried out.
- B. The APP shall be prepared as follows:
1. Written in English by a qualified person who is employed by the Prime Contractor articulating the specific work and hazards pertaining to the contract (model language can be found in ASSE A10.33). Specifically articulating the safety requirements found within these VA contract safety specifications.
  2. Address both the Prime Contractors and the subcontractors work operations.
  3. State measures to be taken to control hazards associated with materials, services, or equipment provided by suppliers.

4. Address all the elements/sub-elements and in order as follows:

a. **SIGNATURE SHEET.** Title, signature, and phone number of the following:

- 1) Plan preparer (Qualified Person such as corporate safety staff person or contracted Certified Safety Professional with construction safety experience);
- 2) Plan approver (company/corporate officers authorized to obligate the company);
- 3) Plan concurrence (e.g., Chief of Operations, Corporate Chief of Safety, Corporate Industrial Hygienist, project manager or superintendent, project safety professional).  
Provide concurrence of other applicable corporate and project personnel (Contractor).

b. **BACKGROUND INFORMATION.** List the following:

- 1) Contractor;
- 2) Contract number;
- 3) Project name;
- 4) Brief project description, description of work to be performed, and location; phases of work anticipated (these will require an AHA).

c. **STATEMENT OF SAFETY AND HEALTH POLICY.** Provide a copy of current corporate/company Safety and Health Policy Statement, detailing commitment to providing a safe and healthful workplace for all employees. The Contractor's written safety program goals, objectives, and accident experience goals for this contract should be provided.

d. **RESPONSIBILITIES AND LINES OF AUTHORITIES.** Provide the following:

- 1) A statement of the employer's ultimate responsibility for the implementation of his SOH program;
- 2) Identification and accountability of personnel responsible for safety at both corporate and project level.  
Contracts specifically requiring safety or industrial hygiene personnel shall include a copy of their resumes.
- 3) The names of Competent and/or Qualified Person(s) and proof of competency/qualification to meet specific OSHA Competent/Qualified Person(s) requirements must be attached.;
- 4) Requirements that no work shall be performed unless a designated competent person is present on the job site;

- 5) Requirements for pre-task Activity Hazard Analysis (AHAs);
- 6) Lines of authority;
- 7) Policies and procedures regarding noncompliance with safety requirements (to include disciplinary actions for violation of safety requirements) should be identified;
- e. SUBCONTRACTORS AND SUPPLIERS.** If applicable, provide procedures for coordinating SOH activities with other employers on the job site:
  - 1) Identification of subcontractors and suppliers (if known);
  - 2) Safety responsibilities of subcontractors and suppliers.
- f. TRAINING.**
  - 1) Site-specific SOH orientation training at the time of initial hire or assignment to the project for every employee before working on the project site is required.
  - 2) Mandatory training and certifications that are applicable to this project (e.g., explosive actuated tools, crane operator, rigger, crane signal person, fall protection, electrical lockout/NFPA 70E, machine/equipment lockout, confined space, etc...) and any requirements for periodic retraining/recertification are required.
  - 3) Procedures for ongoing safety and health training for supervisors and employees shall be established to address changes in site hazards/conditions.
  - 4) OSHA 10-hour training is required for all workers on site and the OSHA 30-hour training is required for Trade Competent Persons (CPs)
- g. SAFETY AND HEALTH INSPECTIONS.**
  - 1) Specific assignment of responsibilities for a minimum daily job site safety and health inspection during periods of work activity: Who will conduct (e.g., "Site Safety and Health CP"), proof of inspector's training/qualifications, when inspections will be conducted, procedures for documentation, deficiency tracking system, and follow-up procedures.
  - 2) Any external inspections/certifications that may be required (e.g., contracted CSP or CSHT)



**h. ACCIDENT/INCIDENT INVESTIGATION & REPORTING.** The Contractor shall conduct mishap investigations of all Moderate and Major as well as all High Visibility Incidents. The APP shall include accident/incident investigation procedure and identify person(s) responsible to provide the following to the Contracting Officer Representative or Government Designated Authority:

- 1) Exposure data (man-hours worked);
- 2) Accident investigation reports;
- 3) Project site injury and illness logs.

**i. PLANS (PROGRAMS, PROCEDURES) REQUIRED.** Based on a risk assessment of contracted activities and on mandatory OSHA compliance programs, the Contractor shall address all applicable occupational, patient, and public safety risks in site-specific compliance and accident prevention plans. These Plans shall include but are not be limited to procedures for addressing the risks associated with the following:

- 1) Emergency response;
- 2) Contingency for severe weather;
- 3) Fire Prevention;
- 4) Medical Support;
- 5) Posting of emergency telephone numbers;
- 6) Prevention of alcohol and drug abuse;
- 7) Site sanitation(housekeeping, drinking water, toilets);
- 8) Night operations and lighting;
- 9) Hazard communication program;
- 10) Welding/Cutting "Hot" work;
- 11) Electrical Safe Work Practices (Electrical LOTO/NFPA 70E);
- 12) General Electrical Safety;
- 13) Hazardous energy control (Machine LOTO);
- 14) Site-Specific Fall Protection & Prevention;
- 15) Excavation/trenching;
- 16) Asbestos abatement;
- 17) Lead abatement;
- 18) Crane Critical lift;
- 19) Respiratory protection;
- 20) Health hazard control program;
- 21) Radiation Safety Program;
- 22) Abrasive blasting;

- 23) Heat/Cold Stress Monitoring;
- 24) Crystalline Silica Monitoring (Assessment);
- 25) Demolition plan (to include engineering survey);
- 26) Formwork and shoring erection and removal;
- 27) Precast Concrete;
- 28) Public (Mandatory compliance with ANSI/ASSE A10.34-2012).

- C. Submit the APP to the Contracting Officer Representative or Government Designated Authority for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES 15 calendar days prior to the date of the preconstruction conference for acceptance. Work cannot proceed without an accepted APP.
- D. Once accepted by the Contracting Officer Representative or Government Designated Authority, the APP and attachments will be enforced as part of the contract. Disregarding the provisions of this contract or the accepted APP will be cause for stopping of work, at the discretion of the Contracting Officer in accordance with FAR Clause 52.236-13, *Accident Prevention*, until the matter has been rectified.
- E. Once work begins, changes to the accepted APP shall be made with the knowledge and concurrence of the Contracting Officer Representative. Should any severe hazard exposure, i.e. imminent danger, become evident, stop work in the area, secure the area, and develop a plan to remove the exposure and control the hazard. Notify the Contracting Officer within 24 hours of discovery. Eliminate/remove the hazard. In the interim, take all necessary action to restore and maintain safe working conditions in order to safeguard onsite personnel, visitors, the public and the environment.

#### **1.5 ACTIVITY HAZARD ANALYSES (AHAS)**

- A. AHAs are also known as Job Hazard Analyses, Job Safety Analyses, and Activity Safety Analyses. Before beginning each work activity involving a type of work presenting hazards not experienced in previous project operations or where a new work crew or sub-contractor is to perform the work, the Contractor(s) performing that work activity shall prepare an AHA (Example electronic AHA forms can be found on the US Army Corps of Engineers web site).

- B. AHAs shall define the activities being performed and identify the work sequences, the specific anticipated hazards, site conditions, equipment, materials, and the control measures to be implemented to eliminate or reduce each hazard to an acceptable level of risk.
- C. Work shall not begin until the AHA for the work activity has been accepted by the Contracting Officer Representative or Government Designated Authority and discussed with all engaged in the activity, including the Contractor, subcontractor(s), and Government on-site representatives at preparatory and initial control phase meetings.
  - 1. The names of the Competent/Qualified Person(s) required for a particular activity (for example, excavations, scaffolding, fall protection, other activities as specified by OSHA and/or other State and Local agencies) shall be identified and included in the AHA. Certification of their competency/qualification shall be submitted to the Government Designated Authority (GDA) for acceptance prior to the start of that work activity.
  - 2. The AHA shall be reviewed and modified as necessary to address changing site conditions, operations, or change of competent/qualified person(s).
    - a. If more than one Competent/Qualified Person is used on the AHA activity, a list of names shall be submitted as an attachment to the AHA. Those listed must be Competent/Qualified for the type of work involved in the AHA and familiar with current site safety issues.
    - b. If a new Competent/Qualified Person (not on the original list) is added, the list shall be updated (an administrative action not requiring an updated AHA). The new person shall acknowledge in writing that he or she has reviewed the AHA and is familiar with current site safety issues.
  - 3. Submit AHAs to the Contracting Officer Representative or Government Designated Authority for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES for review at least 15 calendar days prior to the start of each phase. Subsequent AHAs as shall be formatted as amendments to the APP. The analysis should be used during daily inspections to ensure the implementation and effectiveness of the activity's safety and health controls.

4. The AHA list will be reviewed periodically (at least monthly) at the Contractor supervisory safety meeting and updated as necessary when procedures, scheduling, or hazards change.
5. Develop the activity hazard analyses using the project schedule as the basis for the activities performed. All activities listed on the project schedule will require an AHA. The AHAs will be developed by the contractor, supplier, or subcontractor and provided to the prime contractor for review and approval and then submitted to the Contracting Officer Representative or Government Designated Authority.

#### **1.6 PRECONSTRUCTION CONFERENCE**

- A. Contractor representatives who have a responsibility or significant role in implementation of the accident prevention program, as required by 29 CFR 1926.20(b)(1), on the project shall attend the preconstruction conference to gain a mutual understanding of its implementation. This includes the project superintendent, subcontractor superintendents, and any other assigned safety and health professionals.
- B. Discuss the details of the submitted APP to include incorporated plans, programs, procedures and a listing of anticipated AHAs that will be developed and implemented during the performance of the contract. This list of proposed AHAs will be reviewed at the conference and an agreement will be reached between the Contractor and the Contracting Officer's representative as to which phases will require an analysis. In addition, establish a schedule for the preparation, submittal, review, and acceptance of AHAs to preclude project delays.
- C. Deficiencies in the submitted APP will be brought to the attention of the Contractor within 14 days of submittal, and the Contractor shall revise the plan to correct deficiencies and re-submit it for acceptance. Do not begin work until there is an accepted APP.  
 WRITER NOTE: If the contract will involve (a) work of a long duration or hazardous nature, or (b) performance within a Government facility that on the advice of VA construction safety representatives involves hazardous operations that might endanger the safety of the public, patients and/or Government personnel or property, the SSHO and Superintendent and/or Quality Control Manager must be separate persons (See Section 1.7(C) for choice).

**1.7 "SITE SAFETY AND HEALTH OFFICER" (SSHO) AND "COMPETENT PERSON" (CP)**

- A. The Prime Contractor shall designate a minimum of one SSHO at each project site that will be identified as the SSHO to administer the Contractor's safety program and government-accepted Accident Prevention Plan. Each subcontractor shall designate a minimum of one CP in compliance with 29 CFR 1926.20 (b)(2) that will be identified as a CP to administer their individual safety programs.
- B. Further, all specialized Competent Persons for the work crews will be supplied by the respective contractor as required by 29 CFR 1926 (i.e. Asbestos, Electrical, Cranes, & Derricks, Demolition, Fall Protection, Fire Safety/Life Safety, Ladder, Rigging, Scaffolds, and Trenches/Excavations).
- C. These Competent Persons can have collateral duties as the subcontractor's superintendent and/or work crew lead persons as well as fill more than one specialized CP role (i.e. Asbestos, Electrical, Cranes, & Derricks, Demolition, Fall Protection, Fire Safety/Life Safety, Ladder, Rigging, Scaffolds, and Trenches/Excavations).
- D. The SSHO or an equally-qualified Designated Representative/alternate will maintain a presence on the site during construction operations in accordance with FAR Clause 52.236-6: *Superintendence by the Contractor*. CPs will maintain presence during their construction activities in accordance with above mentioned clause. A listing of the designated SSHO and all known CPs shall be submitted prior to the start of work as part of the APP with the training documentation and/or AHA as listed in Section 1.8 below.
- E. The repeated presence of uncontrolled hazards during a contractor's work operations will result in the designated CP as being deemed incompetent and result in the required removal of the employee in accordance with FAR Clause 52.236-5: Material and Workmanship, Paragraph (c).

## 1.8 TRAINING

- A. The designated Prime Contractor SSHO must meet the requirements of all applicable OSHA standards and be capable (through training, experience, and qualifications) of ensuring that the requirements of 29 CFR 1926.16 and other appropriate Federal, State and local requirements are met for the project. As a minimum the SSHO must have completed the OSHA 30-hour Construction Safety class and have five (5) years of construction industry safety experience or three (3) years if he/she possesses a Certified Safety Professional (CSP) or certified Construction Safety and Health Technician (CSHT) certification or have a safety and health degree from an accredited university or college.
- B. All designated CPs shall have completed the OSHA 30-hour Construction Safety course within the past 5 years.
- C. In addition to the OSHA 30 Hour Construction Safety Course, all CPs with high hazard work operations such as operations involving asbestos, electrical, cranes, demolition, work at heights/fall protection, fire safety/life safety, ladder, rigging, scaffolds, and trenches/excavations shall have a specialized formal course in the hazard recognition & control associated with those high hazard work operations. Documented "repeat" deficiencies in the execution of safety requirements will require retaking the requisite formal course.
- D. All other construction workers shall have the OSHA 10-hour Construction Safety Outreach course and any necessary safety training to be able to identify hazards within their work environment.
- E. Submit training records associated with the above training requirements to the Contracting Officer Representative for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES 15 calendar days prior to the date of the preconstruction conference for acceptance.
- F. Prior to any worker for the contractor or subcontractors beginning work, they shall undergo a safety briefing provided by the SSHO or his/her designated representative. As a minimum, this briefing shall include information on the site-specific hazards, construction limits, VAMC safety guidelines, means of egress, break areas, work hours, locations of restrooms, use of VAMC equipment, emergency procedures, accident reporting etc... Documentation shall be provided to the Resident Engineer that individuals have undergone contractor's safety briefing.
- G. Ongoing safety training will be accomplished in the form of weekly documented safety meeting.

## 1.9 INSPECTIONS

- A. The SSHO shall conduct frequent and regular safety inspections (daily) of the site and each of the subcontractors CPs shall conduct frequent and regular safety inspections (daily) of their work operations as required by 29 CFR 1926.20(b)(2). Each week, the SSHO shall conduct a formal documented inspection of the entire construction areas with the subcontractors' "Trade Safety and Health CPs" present in their work areas. Coordinate with, and report findings and corrective actions weekly to Contracting Officer Representative.
- B. A Certified Safety Professional (CSP) with specialized knowledge in construction safety or a certified Construction Safety and Health Technician (CSHT) shall randomly conduct a monthly site safety inspection. The CSP or CSHT can be a corporate safety professional or independently contracted. The CSP or CSHT will provide their certificate number on the required report for verification as necessary.
  - 1. Results of the inspection will be documented with tracking of the identified hazards to abatement.
  - 2. The Contracting Officer Representative will be notified immediately prior to start of the inspection and invited to accompany the inspection.
  - 3. Identified hazard and controls will be discussed to come to a mutual understanding to ensure abatement and prevent future reoccurrence.
  - 4. A report of the inspection findings with status of abatement will be provided to the Contracting Officer Representative within one week of the onsite inspection.

## 1.10 ACCIDENTS, OSHA 300 LOGS, AND MAN-HOURS

- A. The prime contractor shall establish and maintain an accident reporting, recordkeeping, and analysis system to track and analyze all injuries and illnesses, high visibility incidents, and accidental property damage (both government and contractor) that occur on site. Notify the Contracting Officer Representative as soon as practical, but no more than four hours after any accident meeting the definition of a Moderate or Major incidents, High Visibility Incidents, or any weight handling and hoisting equipment accident. Within notification include contractor name; contract title; type of contract; name of activity, installation or location where accident occurred; date and time of accident; names of personnel injured; extent of property damage,

if any; extent of injury, if known, and brief description of accident (to include type of construction equipment used, PPE used, etc.). Preserve the conditions and evidence on the accident site until the Contracting Officer Representative determine whether a government investigation will be conducted.

- B. Conduct an accident investigation for all Minor, Moderate and Major incidents as defined in paragraph DEFINITIONS, and property damage accidents resulting in at least \$20,000 in damages, to establish the root cause(s) of the accident. Complete the VA Form 2162 (or equivalent), and provide the report to the Contracting Officer Representative within 5 calendar days of the accident. The Contracting Officer Representative will provide copies of any required or special forms.
- C. A summation of all man-hours worked by the contractor and associated sub-contractors for each month will be reported to the Contracting Officer Representative monthly.
- D. A summation of all Minor, Moderate, and Major incidents experienced on site by the contractor and associated sub-contractors for each month will be provided to the Contracting Officer Representative monthly. The contractor and associated sub-contractors' OSHA 300 logs will be made available to the Contracting Officer Representative as requested.

#### **1.11 PERSONAL PROTECTIVE EQUIPMENT (PPE)**

- A. PPE is governed in all areas by the nature of the work the employee is performing. For example, specific PPE required for performing work on electrical equipment is identified in NFPA 70E, Standard for Electrical Safety in the Workplace.
- B. Mandatory PPE includes:
  - 1. Hard Hats - unless written authorization is given by the Contracting Officer Representative in circumstances of work operations that have limited potential for falling object hazards such as during finishing work or minor remodeling. With authorization to relax the requirement of hard hats, if a worker becomes exposed to an overhead falling object hazard, then hard hats would be required in accordance with the OSHA regulations.
  - 2. Safety Glasses - unless written authorization is given by the Contracting Officer Representative in circumstances of no eye hazards, appropriate safety glasses meeting the ANSI Z.87.1 standard must be worn by each person on site.



3. Appropriate Safety Shoes - based on the hazards present, safety shoes meeting the requirements of ASTM F2413-11 shall be worn by each person on site unless written authorization is given by the Contracting Officer Representative in circumstances of no foot hazards.
4. Hearing Protection - Use personal hearing protection at all times in designated noise hazardous areas or when performing noise hazardous tasks.

#### 1.12 INFECTION CONTROL

- A. Infection Control is critical in all medical center facilities. Interior construction activities causing disturbance of existing dust, or creating new dust, must be conducted within ventilation-controlled areas that minimize the flow of airborne particles into patient areas.
- B. An AHA associated with infection control will be performed by VA personnel in accordance with FGI Guidelines (i.e. Infection Control Risk Assessment (ICRA)). The ICRA procedure found on the American Society for Healthcare Engineering (ASHE) website will be utilized. Risk classifications of Class II or lower will require approval by the Contracting Officer Representative before beginning any construction work. Risk classifications of Class III or higher will require a permit before beginning any construction work. Infection Control permits will be issued by the Contracting Officer Representative. The Infection Control Permits will be posted outside the appropriate construction area. More than one permit may be issued for a construction project if the work is located in separate areas requiring separate classes. The primary project scope area for this project is: **Class III/IV**, however, work outside the primary project scope area may vary. The required infection control precautions with each class are as follows:

1. Class I Requirements:

- a. During Construction Work:

- 1) Notify the Contracting Officer Representative.
    - 2) Execute work by methods to minimize raising dust from construction operations.
    - 3) Ceiling tiles: Immediately replace a ceiling tiles displaced for visual inspection.

- b. Upon Completion:

- 1) Clean work area upon completion of task
    - 2) Notify the Contracting Officer Representative.

## 2. Class II Requirements:

### a. During Construction Work:

- 1) Notify the Contracting Officer Representative.
- 2) Provide active means to prevent airborne dust from dispersing into atmosphere such as wet methods or tool mounted dust collectors where possible.
- 3) Water mist work surfaces to control dust while cutting.
- 4) Seal unused doors with duct tape.
- 5) Block off and seal air vents.
- 6) Remove or isolate HVAC system in areas where work is being performed.

### b. Upon Completion:

- 1) Wipe work surfaces with cleaner/disinfectant.
- 2) Contain construction waste before transport in tightly covered containers.
- 3) Wet mop and/or vacuum with HEPA filtered vacuum before leaving work area.
- 4) Upon completion, restore HVAC system where work was performed
- 5) Notify the Contracting Officer Representative.

## 3. Class III Requirements:

### a. During Construction Work:

- 1) Obtain permit from the Contracting Officer Representative.
- 2) Remove or Isolate HVAC system in area where work is being done to prevent contamination of duct system.
- 3) Complete all critical barriers i.e. sheetrock, plywood, plastic, to seal area from non-work area or implement control cube method (cart with plastic covering and sealed connection to work site with HEPA vacuum for vacuuming prior to exit) before construction begins. Install construction barriers and ceiling protection carefully, outside of normal work hours.
- 4) Maintain negative air pressure, 0.01 inches of water gauge, within work site utilizing HEPA equipped air filtration units and continuously monitored with a digital display, recording and alarm instrument, which must be calibrated on installation, maintained with periodic calibration and monitored by the contractor.

- 5) Contain construction waste before transport in tightly covered containers.
- 6) Cover transport receptacles or carts. Tape covering unless solid lid.

b. Upon Completion:

- 1) Do not remove barriers from work area until completed project is inspected by the Contracting Officer Representative and thoroughly cleaned by the VA Environmental Services Department.
- 2) Remove construction barriers and ceiling protection carefully to minimize spreading of dirt and debris associated with construction, outside of normal work hours.
- 3) Vacuum work area with HEPA filtered vacuums.
- 4) Wet mop area with cleaner/disinfectant.
- 5) Upon completion, restore HVAC system where work was performed.
- 6) Return permit to the Contracting Officer Representative.

4. Class IV Requirements:

a. During Construction Work:

- 1) Obtain permit from the Contracting Officer Representative.
- 2) Isolate HVAC system in area where work is being done to prevent contamination of duct system.
- 3) Complete all critical barriers i.e. sheetrock, plywood, plastic, to seal area from non-work area or implement control cube method (cart with plastic covering and sealed connection to work site with HEPA vacuum for vacuuming prior to exit) before construction begins. Install construction barriers and ceiling protection carefully, outside of normal work hours.
- 4) Maintain negative air pressure, 0.01 inches of water gauge, within work site utilizing HEPA equipped air filtration units and continuously monitored with a digital display, recording and alarm instrument, which must be calibrated on installation, maintained with periodic calibration and monitored by the contractor.
- 5) Seal holes, pipes, conduits, and punctures.

- 5) Construct anteroom and require all personnel to pass through this room so they can be vacuumed using a HEPA vacuum cleaner before leaving work site or they can wear cloth or paper coveralls that are removed each time they leave work site.
- 6) All personnel entering work site are required to wear shoe covers. Shoe covers must be changed each time the worker exits the work area.

b. Upon Completion:

- 1) Do not remove barriers from work area until completed project is inspected by the Contracting Officer Representative with thorough cleaning by the VA Environmental Services Dept.
- 2) Remove construction barriers and ceiling protection carefully to minimize spreading of dirt and debris associated with construction, outside of normal work hours.
- 3) Contain construction waste before transport in tightly covered containers.
- 4) Cover transport receptacles or carts. Tape covering unless solid lid.
- 5) Vacuum work area with HEPA filtered vacuums.
- 6) Wet mop area with cleaner/disinfectant.
- 7) Upon completion, restore HVAC system where work was performed.
- 8) Return permit to the Contracting Officer Representative.

B. Barriers shall be erected as required based upon classification (Class III & IV requires barriers) and shall be constructed as follows:

1. Class III and IV - closed door with masking tape applied over the frame and door is acceptable for projects that can be contained in a single room.
2. Construction, demolition or reconstruction not capable of containment within a single room must have the following barriers erected and made presentable on hospital occupied side:
  - a. Class III & IV (where dust control is the only hazard, and an agreement is reached with the Resident Engineer and Medical Center) - Airtight plastic barrier that extends from the floor to ceiling. Seams must be sealed with duct tape to prevent dust and debris from escaping
  - b. Class III & IV - Drywall barrier erected with joints covered or sealed to prevent dust and debris from escaping.

- c. Class III & IV - Seal all penetrations in existing barrier airtight
  - d. Class III & IV - Barriers at penetration of ceiling envelopes, chases and ceiling spaces to stop movement air and debris
  - e. Class IV only - Anteroom or double entrance openings that allow workers to remove protective clothing or vacuum off existing clothing
  - f. Class III & IV - At elevators shafts or stairways within the field of construction, overlapping flap minimum of two feet wide of polyethylene enclosures for personnel access.
- C. Products and Materials:
- 1. Sheet Plastic: Fire retardant polystyrene, 6-mil thickness meeting local fire codes
  - 2. Barrier Doors: Self-Closing fire-rated solid core wood in steel frame, painted
  - 3. Dust proof fire-rated drywall
  - 4. High Efficiency Particulate Air-Equipped filtration machine rated at 95% capture of 0.3 microns including pollen, mold spores and dust particles. HEPA filters should have ASHRAE 85 or other prefilter to extend the useful life of the HEPA. Provide both primary and secondary filtrations units. Maintenance of equipment and replacement of the HEPA filters and other filters will be in accordance with manufacturer's instructions.
  - 5. Exhaust Hoses: Heavy duty, flexible steel reinforced; Ventilation Blower Hose
  - 6. Adhesive Walk-off Mats: Provide minimum size mats of 24 inches x 36 inches
  - 7. Disinfectant: Hospital-approved disinfectant or equivalent product
  - 8. Portable Ceiling Access Module
- D. Before any construction on site begins, all contractor personnel involved in the construction or renovation activity shall be educated and trained in infection prevention measures established by the medical center.

- E. A dust control program will be established and maintained as part of the contractor's infection preventive measures in accordance with the FGI Guidelines for Design and Construction of Healthcare Facilities. Prior to start of work, prepare a plan detailing project-specific dust protection measures with associated product data, including periodic status reports, and submit to Contracting Officer Representative for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.
- F. Medical center Infection Control personnel will monitor for airborne disease (e.g. aspergillosis) during construction. A baseline of conditions will be established by the medical center prior to the start of work and periodically during the construction stage to determine impact of construction activities on indoor air quality with safe thresholds established.
- G. In general, the following preventive measures shall be adopted during construction to keep down dust and prevent mold.
1. Contractor shall verify that construction exhaust to exterior is not reintroduced to the medical center through intake vents, or building openings. HEPA filtration is required where the exhaust dust may reenter the medical center.
  2. Exhaust hoses shall be exhausted so that dust is not reintroduced to the medical center.
  3. Adhesive Walk-off/Carpet Walk-off Mats shall be used at all interior transitions from the construction area to occupied medical center area. These mats shall be changed as often as required to maintain clean work areas directly outside construction area at all times.
  4. Vacuum and wet mop all transition areas from construction to the occupied medical center at the end of each workday. Vacuum shall utilize HEPA filtration. Maintain surrounding area frequently. Remove debris as it is created. Transport these outside the construction area in containers with tightly fitting lids.

5. The Contractor shall not haul debris through patient-care areas without prior approval of the Resident Engineer and the Medical Center. When, approved, debris shall be hauled in enclosed dust proof containers or wrapped in plastic and sealed with duct tape. No sharp objects should be allowed to cut through the plastic. Wipe down the exterior of the containers with a damp rag to remove dust. All equipment, tools, material, etc. transported through occupied areas shall be made free from dust and moisture by vacuuming and wipe down.
6. There shall be no standing water during construction. This includes water in equipment drip pans and open containers within the construction areas. All accidental spills must be cleaned up and dried within 12 hours. Remove and dispose of porous materials that remain damp for more than 72 hours.
7. At completion, remove construction barriers and ceiling protection carefully, outside of normal work hours. Vacuum and clean all surfaces free of dust after the removal.

#### H. Final Cleanup:

1. Upon completion of project, or as work progresses, remove all construction debris from above ceiling, vertical shafts and utility chases that have been part of the construction.
2. Perform HEPA vacuum cleaning of all surfaces in the construction area. This includes walls, ceilings, cabinets, furniture (built-in or free standing), partitions, flooring, etc.
3. All new air ducts shall be cleaned prior to final inspection.

#### I. Exterior Construction

1. Contractor shall verify that dust will not be introduced into the medical center through intake vents or building openings. HEPA filtration on intake vents is required where dust may be introduced.
2. Dust created from disturbance of soil such as from vehicle movement will be wetted with use of a water truck as necessary
3. All cutting, drilling, grinding, sanding, or disturbance of materials shall be accomplished with tools equipped with either local exhaust ventilation (i.e. vacuum systems) or wet suppression controls.

**1.13 TUBERCULOSIS SCREENING**

A. Contractor shall provide written certification that all contract employees assigned to the work site have had a pre-placement tuberculin screening within 90 days prior to assignment to the worksite and been found have negative TB screening reactions. Contractors shall be required to show documentation of negative TB screening reactions for any additional workers who are added after the 90-day requirement before they will be allowed to work on the work site. NOTE: This can be the Center for Disease Control (CDC) and Prevention and two-step skin testing or a Food and Drug Administration (FDA)-approved blood test.

1. Contract employees manifesting positive screening reactions to the tuberculin shall be examined according to current CDC guidelines prior to working on VHA property.
2. Subsequently, if the employee is found without evidence of active (infectious) pulmonary TB, a statement documenting examination by a physician shall be on file with the employer (construction contractor), noting that the employee with a positive tuberculin screening test is without evidence of active (infectious) pulmonary TB.
3. If the employee is found with evidence of active (infectious) pulmonary TB, the employee shall require treatment with a subsequent statement to the fact on file with the employer before being allowed to return to work on VHA property.

**1.14 FIRE SAFETY**

- A. Fire Safety Plan: Establish and maintain a site-specific fire protection program in accordance with 29 CFR 1926. Prior to start of work, prepare a plan detailing project-specific fire safety measures, including periodic status reports, and submit to Contracting Officer Representative for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES. This plan may be an element of the Accident Prevention Plan.
- B. Site and Building Access: Maintain free and unobstructed access to facility emergency services and for fire, police and other emergency response forces in accordance with NFPA 241.



- C. Separate temporary facilities, such as trailers, storage sheds, and dumpsters, from existing buildings and new construction by distances in accordance with NFPA 241. For small facilities with less than 6 m (20 feet) exposing overall length, separate by 3m (10 feet).
- D. Temporary Construction Partitions:
  - 1. Install and maintain temporary construction partitions to provide smoke-tight separations between construction areas, the areas that are described in phasing requirements, and adjoining areas. Construct partitions of gypsum board or treated plywood (flame spread rating of 25 or less in accordance with ASTM E84) on both sides of fire retardant treated wood or metal steel studs. Extend the partitions through suspended ceilings to floor slab deck or roof. Seal joints and penetrations. At door openings, install Class C, 3/4 hour fire/smoke rated doors with self-closing devices.
  - 2. Install fire-rated temporary construction partitions as shown on drawings to maintain integrity of existing exit stair enclosures, exit passageways, fire-rated enclosures of hazardous areas, horizontal exits, smoke barriers, vertical shafts and openings enclosures.
  - 3. Close openings in smoke barriers and fire-rated construction to maintain fire ratings. Seal penetrations with listed through-penetration firestop materials in accordance with Section 07 84 00, FIRESTOPPING.
- E. Temporary Heating and Electrical: Install, use and maintain installations in accordance with 29 CFR 1926, NFPA 241 and NFPA 70.
- F. Means of Egress: Do not block exiting for occupied buildings, including paths from exits to roads. Minimize disruptions and coordinate with Contracting Officer Representative.
- G. Egress Routes for Construction Workers: Maintain free and unobstructed egress. Inspect daily. Report findings and corrective actions weekly to Contracting Officer Representative.
- H. Fire Extinguishers: Provide and maintain extinguishers in construction areas and temporary storage areas in accordance with 29 CFR 1926, NFPA 241 and NFPA 10.
- I. Flammable and Combustible Liquids: Store, dispense and use liquids in accordance with 29 CFR 1926, NFPA 241 and NFPA 30.

- J. Sprinklers: Install, test and activate new automatic sprinklers prior to removing existing sprinklers.
- K. Existing Fire Protection: Do not impair automatic sprinklers, smoke and heat detection, and fire alarm systems, except for portions immediately under construction, and temporarily for connections. Provide fire watch for impairments more than 4 hours in a 24-hour period. Request interruptions in accordance with Article, OPERATIONS AND STORAGE AREAS, and coordinate with Contracting Officer Representative. All existing or temporary fire protection systems (fire alarms, sprinklers) located in construction areas shall be tested as coordinated with the medical center. Parameters for the testing and results of any tests performed shall be recorded by the medical center and copies provided to the Resident Engineer.
- L. Smoke Detectors: Prevent accidental operation. Remove temporary covers at end of work operations each day. Coordinate with Contracting Officer Representative.
- M. Hot Work: Perform and safeguard hot work operations in accordance with NFPA 241 and NFPA 51B. Coordinate with Contracting Representative Office. Obtain permits from Contracting Representative Officer at least 24 hours in advance. Designate contractor's responsible project-site fire prevention program manager to permit hot work.
- N. Fire Hazard Prevention and Safety Inspections: Inspect entire construction areas weekly. Coordinate with, and report findings and corrective actions weekly to Contracting Officer Representative.
- O. Smoking: Smoking is prohibited in and adjacent to construction areas inside existing buildings and additions under construction. In separate and detached buildings under construction, smoking is prohibited except in designated smoking rest areas.
- P. Dispose of waste and debris in accordance with NFPA 241. Remove from buildings daily.

#### **1.15 ELECTRICAL**

- A. All electrical work shall comply with NFPA 70 (NEC), NFPA 70B, NFPA 70E, 29 CFR Part 1910 Subpart J - General Environmental Controls, 29 CFR Part 1910 Subpart S - Electrical, and 29 CFR 1926 Subpart K in addition to other references required by contract.

- B. All qualified persons performing electrical work under this contract shall be licensed journeyman or master electricians. All apprentice electricians performing under this contract shall be deemed unqualified persons unless they are working under the immediate supervision of a licensed electrician or master electrician.
- C. All electrical work will be accomplished de-energized and in the Electrically Safe Work Condition (refer to NFPA 70E for Work Involving Electrical Hazards, including Exemptions to Work Permit). Any Contractor, subcontractor or temporary worker who fails to fully comply with this requirement is subject to immediate termination in accordance with FAR clause 52.236-5(c). Only in rare circumstance where achieving an electrically safe work condition prior to beginning work would increase or cause additional hazards, or is infeasible due to equipment design or operational limitations is energized work permitted. The Contracting Officer Representative with approval of the Medical Center Director will make the determination if the circumstances would meet the exception outlined above. An AHA and permit specific to energized work activities will be developed, reviewed, and accepted by the VA prior to the start of that activity.
1. Development of a Hazardous Electrical Energy Control Procedure is required prior to de-energization. A single Simple Lockout/Tagout Procedure for multiple work operations can only be used for work involving qualified person(s) de-energizing one set of conductors or circuit part source. Task specific Complex Lockout/Tagout Procedures are required at all other times.
  2. Verification of the absence of voltage after de-energization and lockout/tagout is considered "energized electrical work" (live work) under NFPA 70E, and shall only be performed by qualified persons wearing appropriate shock protective (voltage rated) gloves and arc rate personal protective clothing and equipment, using Underwriters Laboratories (UL) tested and appropriately rated contact electrical testing instruments or equipment appropriate for the environment in which they will be used.
  3. Personal Protective Equipment (PPE) and electrical testing instruments will be readily available for inspection by the Contracting Officer Representative.

- D. Before beginning any electrical work, an Activity Hazard Analysis (AHA) will be conducted to include Shock Hazard and Arc Flash Hazard analyses (NFPA Tables can be used only as a last alternative and it is strongly suggested a full Arc Flash Hazard Analyses be conducted). Work shall not begin until the AHA for the work activity and permit for energized work has been reviewed and accepted by the Contracting Officer Representative and discussed with all engaged in the activity, including the Contractor, subcontractor(s), and Government on-site representatives at preparatory and initial control phase meetings.
- E. Ground-fault circuit interrupters. GFCI protection shall be provided where an employee is operating or using cord- and plug-connected tools related to construction activity supplied by 125-volt, 15-, 20-, or 30-ampere circuits. Where employees operate or use equipment supplied by greater than 125-volt, 15-, 20-, or 30- ampere circuits, GFCI protection or an assured equipment grounding conductor program shall be implemented in accordance with NFPA 70E - 2015, Chapter 1, Article 110.4(C)(2).

#### **1.16 FALL PROTECTION**

- A. The fall protection (FP) threshold height requirement is 6 ft (1.8 m) for ALL WORK, unless specified differently or the OSHA 29 CFR 1926 requirements are more stringent, to include steel erection activities, systems-engineered activities (prefabricated) metal buildings, residential (wood) construction and scaffolding work.
  - 1. The use of a Safety Monitoring System (SMS) as a fall protection method is prohibited.
  - 2. The use of Controlled Access Zone (CAZ) as a fall protection method is prohibited.
  - 3. A Warning Line System (WLS) may ONLY be used on floors or flat or low-sloped roofs (between 0 - 18.4 degrees or 4:12 slope) and shall be erected around all sides of the work area (See 29 CFR 1926.502(f) for construction of WLS requirements). Working within the WLS does not require FP. No worker shall be allowed in the area between the roof or floor edge and the WLS without FP. FP is required when working outside the WLS.
  - 4. Fall protection while using a ladder will be governed by the OSHA requirements.

**1.17 SCAFFOLDS AND OTHER WORK PLATFORMS**

- A. All scaffolds and other work platforms construction activities shall comply with 29 CFR 1926 Subpart L.
- B. The fall protection (FP) threshold height requirement is 6 ft (1.8 m) as stated in Section 1.16.
- C. The following hierarchy and prohibitions shall be followed in selecting appropriate work platforms.
  - 1. Scaffolds, platforms, or temporary floors shall be provided for all work except that can be performed safely from the ground or similar footing.
  - 2. Ladders less than 20 feet may be used as work platforms only when use of small hand tools or handling of light material is involved.
  - 3. Ladder jacks, lean-to, and prop-scaffolds are prohibited.
  - 4. Emergency descent devices shall not be used as working platforms.
- D. Contractors shall use a scaffold tagging system in which all scaffolds are tagged by the Competent Person. Tags shall be color-coded. Green indicates the scaffold has been inspected and is safe to use; red indicates the scaffold is unsafe to use. Tags shall be readily visible, made of materials that will withstand the environment in which they are used, be legible and shall include:
  - 1. The Competent Person's name and signature;
  - 2. Dates of initial and last inspections.
- E. Mast Climbing work platforms: When access ladders, including masts designed as ladders, exceed 20 ft (6 m) in height, positive fall protection shall be used.

**1.18 EXCAVATION AND TRENCHES**

- A. All excavation and trenching work shall comply with 29 CFR 1926 Subpart P. Excavations less than 5 feet in depth require evaluation by the contractor's "Competent Person" (CP) for determination of the necessity of an excavation protective system where kneeling, laying in, or stooping within the excavation is required.

B. All excavations and trenches 24 inches in depth or greater shall require a written trenching and excavation permit (NOTE - some States and other local jurisdictions require separate state/jurisdiction-issued excavation permits). The permit shall have two sections, one section will be completed prior to digging or drilling and the other will be completed prior to personnel entering the excavations greater than 5 feet in depth. Each section of the permit shall be provided to the Contracting Officer Representative prior to proceeding with digging or drilling and prior to proceeding with entering the excavation. After completion of the work and prior to opening a new section of an excavation, the permit shall be closed out and provided to the Contracting Officer Representative. The permit shall be maintained onsite and the first section of the permit shall include the following:

1. Estimated start time & stop time
2. Specific location and nature of the work.
3. Indication of the contractor's "Competent Person" (CP) in excavation safety with qualifications and signature. Formal course in excavation safety is required by the contractor's CP.
4. Indication of whether soil or concrete removal to an offsite location is necessary.
5. Indication of whether soil samples are required to determine soil contamination.
6. Indication of coordination with local authority (i.e. "One Call") or contractor's effort to determine utility location with search and survey equipment.
7. Indication of review of site drawings for proximity of utilities to digging/drilling.

The second section of the permit for excavations greater than five feet in depth shall include the following:

1. Determination of OSHA classification of soil. Soil samples will be from freshly dug soil with samples taken from different soil type layers as necessary and placed at a safe distance from the excavation by the excavating equipment. A pocket penetrometer will be utilized in determination of the unconfined compression strength of the soil for comparison against OSHA table (Less than 0.5 Tons/FT<sup>2</sup> - Type C, 0.5 Tons/FT<sup>2</sup> to 1.5 Tons/FT<sup>2</sup> - Type B, greater than 1.5 Tons/FT<sup>2</sup> - Type A without condition to reduce to Type B).

2. Indication of selected protective system (sloping/benching, shoring, shielding). When soil classification is identified as "Type A" or "Solid Rock", only shoring or shielding or Professional Engineer designed systems can be used for protection. A Sloping/Benching system may only be used when classifying the soil as Type B or Type C. Refer to Appendix B of 29 CFR 1926, Subpart P for further information on protective systems designs.
  3. Indication of the spoil pile being stored at least 2 feet from the edge of the excavation and safe access being provided within 25 feet of the workers.
  4. Indication of assessment for a potential toxic, explosive, or oxygen deficient atmosphere where oxygen deficiency (atmospheres containing less than 19.5 percent oxygen) or a hazardous atmosphere exists or could reasonably be expected to exist. Internal combustion engine equipment is not allowed in an excavation without providing force air ventilation to lower the concentration to below OSHA PELs, providing sufficient oxygen levels, and atmospheric testing as necessary to ensure safe levels are maintained.
- C. As required by OSHA 29 CFR 1926.651(b)(1), the estimated location of utility installations, such as sewer, telephone, fuel, electric, water lines, or any other underground installations that reasonably may be expected to be encountered during excavation work, shall be determined prior to opening an excavation.
1. The planned dig site will be outlined/marked in white prior to locating the utilities.
  2. Used of the American Public Works Association Uniform Color Code is required for the marking of the proposed excavation and located utilities.
  3. 811 will be called two business days before digging on all local or State lands and public Right-of Ways.
  4. Digging will not commence until all known utilities are marked.
  5. Utility markings will be maintained
- D. Excavations will be hand dug or excavated by other similar safe and acceptable means as excavation operations approach within 3 to 5 feet of identified underground utilities. Exploratory bar or other detection equipment will be utilized as necessary to further identify the location of underground utilities.
- E. Excavations greater than 20 feet in depth require a Professional Engineer designed excavation protective system.

**1.19 CRANES**

- A. All crane work shall comply with 29 CFR 1926 Subpart CC.
- B. Prior to operating a crane, the operator must be licensed, qualified or certified to operate the crane. Thus, all the provisions contained with Subpart CC are effective and there is no "Phase In" date.
- C. A detailed lift plan for all lifts shall be submitted to the Contracting Officer Representative 14 days prior to the scheduled lift complete with route for truck carrying load, crane load analysis, siting of crane and path of swing and all other elements of a critical lift plan where the lift meets the definition of a critical lift. Critical lifts require a more comprehensive lift plan to minimize the potential of crane failure and/or catastrophic loss. The plan must be reviewed and accepted by the General Contractor before being submitted to the VA for review. The lift will not be allowed to proceed without prior acceptance of this document.
- D. Crane operators shall not carry loads
  - 1. over the general public or VAMC personnel
  - 2. over any occupied building unless
    - a. the top two floors are vacated
    - b. or overhead protection with a design live load of 300 psf is provided.

**1.20 CONTROL OF HAZARDOUS ENERGY (LOCKOUT/TAGOUT)**

- A. All installation, maintenance, and servicing of equipment or machinery shall comply with 29 CFR 1910.147 except for specifically referenced operations in 29 CFR 1926 such as concrete & masonry equipment [1926.702(j)], heavy machinery & equipment [1926.600(a)(3)(i)], and process safety management of highly hazardous chemicals (1926.64). Control of hazardous electrical energy during the installation, maintenance, or servicing of electrical equipment shall comply with Section 1.15 to include NFPA 70E and other VA specific requirements discussed in the section.

**1.21 CONFINED SPACE ENTRY**

- A. All confined space entry shall comply with 29 CFR 1926, Subpart AA except for specifically referenced operations in 29 CFR 1926 such as excavations/trenches [1926.651(g)].
- B. A site-specific Confined Space Entry Plan (including permitting process) shall be developed and submitted to the Contracting Officer Representative.



**1.22 WELDING AND CUTTING**

- A As specified in section 1.14, Hot Work: Perform and safeguard hot work operations in accordance with NFPA 241 and NFPA 51B. Coordinate with Contracting Officer Representative . Obtain permits from Contracting Officer Representative at least 24 hours in advance. Designate contractor's responsible project-site fire prevention program manager to permit hot work.

**1.23 LADDERS**

- A. All Ladder use shall comply with 29 CFR 1926 Subpart X.
- B. All portable ladders shall be of sufficient length and shall be placed so that workers will not stretch or assume a hazardous position.
- C. Manufacturer safety labels shall be in place on ladders
- D. Step Ladders shall not be used in the closed position
- E. Top steps or cap of step ladders shall not be used as a step
- F. Portable ladders, used as temporary access, shall extend at least 3 ft (0.9 m) above the upper landing surface.
  - 1. When a 3 ft (0.9-m) extension is not possible, a grasping device (such as a grab rail) shall be provided to assist workers in mounting and dismounting the ladder.
  - 2. In no case shall the length of the ladder be such that ladder deflection under a load would, by itself, cause the ladder to slip from its support.
- G. Ladders shall be inspected for visible defects on a daily basis and after any occurrence that could affect their safe use.  
Broken or damaged ladders shall be immediately tagged "DO NOT USE," or with similar wording, and withdrawn from service until restored to a condition meeting their original design.

**1.24 FLOOR AND WALL OPENINGS**

- A. All floor and wall openings shall comply with 29 CFR 1926 Subpart M.
- B. Floor and roof holes/openings are any that measure over 2 in (51 mm) in any direction of a walking/working surface which persons may trip or fall into or where objects may fall to the level below. Skylights located in floors or roofs are considered floor or roof hole/openings.

- C. All floor, roof openings or hole into which a person can accidentally walk or fall through shall be guarded either by a railing system with toeboards along all exposed sides or a load-bearing cover. When the cover is not in place, the opening or hole shall be protected by a removable guardrail system or shall be attended when the guarding system has been removed, or other fall protection system.
1. Covers shall be capable of supporting, without failure, at least twice the weight of the worker, equipment and material combined.
  2. Covers shall be secured when installed, clearly marked with the word "HOLE", "COVER" or "Danger, Roof Opening-Do Not Remove" or color-coded or equivalent methods (e.g., red or orange "X"). Workers must be made aware of the meaning for color coding and equivalent methods.
  3. Roofing material, such as roofing membrane, insulation or felts, covering or partly covering openings or holes, shall be immediately cut out. No hole or opening shall be left unattended unless covered.
  4. Non-load-bearing skylights shall be guarded by a load-bearing skylight screen, cover, or railing system along all exposed sides.
  5. Workers are prohibited from standing/walking on skylights.

- - - E N D - - -

**SECTION 01 42 19  
REFERENCE STANDARDS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

This section specifies the availability and source of references and standards specified in the project manual under paragraphs APPLICABLE PUBLICATIONS and/or shown on the drawings.

**1.2 AVAILABILITY OF SPECIFICATIONS LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS FPMR PART 101-29 (FAR 52.211-1) (AUG 1998)**

- A. The GSA Index of Federal Specifications, Standards and Commercial Item Descriptions, FPMR Part 101-29 and copies of specifications, standards, and commercial item descriptions cited in the solicitation may be obtained for a fee by submitting a request to - GSA Federal Supply Service, Specifications Section, Suite 8100, 470 East L'Enfant Plaza, SW, Washington, DC 20407, Telephone (202) 619-8925, Facsimile (202) 619-8978.
- B. If the General Services Administration, Department of Agriculture, or Department of Veterans Affairs issued this solicitation, a single copy of specifications, standards, and commercial item descriptions cited in this solicitation may be obtained free of charge by submitting a request to the addressee in paragraph (a) of this provision. Additional copies will be issued for a fee.

**1.3 AVAILABILITY FOR EXAMINATION OF SPECIFICATIONS NOT LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS (FAR 52.211-4) (JUN 1988)**

The specifications and standards cited in this solicitation can be examined at the following location:

DEPARTMENT OF VETERANS AFFAIRS  
Office of Construction & Facilities Management  
Facilities Quality Service (00CFM1A)  
425 Eye Street N.W, (sixth floor)  
Washington, DC 20001  
Telephone Numbers: (202) 632-5249 or (202) 632-5178  
Between 9:00 AM - 3:00 PM

**1.4 AVAILABILITY OF SPECIFICATIONS NOT LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS (FAR 52.211-3) (JUN 1988)**

The specifications cited in this solicitation may be obtained from the associations or organizations listed below.

AA Aluminum Association Inc.

<http://www.aluminum.org>

AABC Associated Air Balance Council

<http://www.aabchq.com>

AAMA American Architectural Manufacturer's Association

<http://www.aamanet.org>

AAN American Nursery and Landscape Association

<http://www.anla.org>

AASHTO American Association of State Highway and Transportation  
Officials

<http://www.aashto.org>

AATCC American Association of Textile Chemists and Colorists

<http://www.aatcc.org>

ACGIH American Conference of Governmental Industrial Hygienists

<http://www.acgih.org>

ACI American Concrete Institute

<http://www.aci-int.net>

ACPA American Concrete Pipe Association

<http://www.concrete-pipe.org>

ACPPA American Concrete Pressure Pipe Association

<http://www.acppa.org>

ADC Air Diffusion Council

<http://flexibleduct.org>

AGA American Gas Association

<http://www.aga.org>

AGC Associated General Contractors of America

<http://www.agc.org>

AGMA American Gear Manufacturers Association, Inc.

<http://www.agma.org>

AHAM Association of Home Appliance Manufacturers

<http://www.aham.org>

AIA American Institute of Architects

<http://www.aia.org>

AISC	American Institute of Steel Construction <a href="http://www.aisc.org">http://www.aisc.org</a>
AISI	American Iron and Steel Institute <a href="http://www.steel.org">http://www.steel.org</a>
AITC	American Institute of Timber Construction <a href="http://www.aitc-glulam.org">http://www.aitc-glulam.org</a>
AMCA	Air Movement and Control Association, Inc. <a href="http://www.amca.org">http://www.amca.org</a>
ANLA	American Nursery & Landscape Association <a href="http://www.anla.org">http://www.anla.org</a>
ANSI	American National Standards Institute, Inc. <a href="http://www.ansi.org">http://www.ansi.org</a>
APA	The Engineered Wood Association <a href="http://www.apawood.org">http://www.apawood.org</a>
ARI	Air-Conditioning and Refrigeration Institute <a href="http://www.ari.org">http://www.ari.org</a>
ASAE	American Society of Agricultural Engineers <a href="http://www.asae.org">http://www.asae.org</a>
ASCE	American Society of Civil Engineers <a href="http://www.asce.org">http://www.asce.org</a>
ASHRAE	American Society of Heating, Refrigerating, and Air-Conditioning Engineers <a href="http://www.ashrae.org">http://www.ashrae.org</a>
ASME	American Society of Mechanical Engineers <a href="http://www.asme.org">http://www.asme.org</a>
ASSE	American Society of Sanitary Engineering <a href="http://www.asse-plumbing.org">http://www.asse-plumbing.org</a>
ASTM	American Society for Testing and Materials <a href="http://www.astm.org">http://www.astm.org</a>
AWI	Architectural Woodwork Institute <a href="http://www.awinet.org">http://www.awinet.org</a>
AWS	American Welding Society <a href="http://www.aws.org">http://www.aws.org</a>
AWWA	American Water Works Association <a href="http://www.awwa.org">http://www.awwa.org</a>
BHMA	Builders Hardware Manufacturers Association <a href="http://www.buildershardware.com">http://www.buildershardware.com</a>

BIA	Brick Institute of America <a href="http://www.bia.org">http://www.bia.org</a>
CAGI	Compressed Air and Gas Institute <a href="http://www.cagi.org">http://www.cagi.org</a>
CGA	Compressed Gas Association, Inc. <a href="http://www.cganet.com">http://www.cganet.com</a>
CI	The Chlorine Institute, Inc. <a href="http://www.chlorineinstitute.org">http://www.chlorineinstitute.org</a>
CISCA	Ceilings and Interior Systems Construction Association <a href="http://www.cisca.org">http://www.cisca.org</a>
CISPI	Cast Iron Soil Pipe Institute <a href="http://www.cispi.org">http://www.cispi.org</a>
CLFMI	Chain Link Fence Manufacturers Institute <a href="http://www.chainlinkinfo.org">http://www.chainlinkinfo.org</a>
CPMB	Concrete Plant Manufacturers Bureau <a href="http://www.cpmc.org">http://www.cpmc.org</a>
CRA	California Redwood Association <a href="http://www.calredwood.org">http://www.calredwood.org</a>
CRSI	Concrete Reinforcing Steel Institute <a href="http://www.crsi.org">http://www.crsi.org</a>
CTI	Cooling Technology Institute <a href="http://www.cti.org">http://www.cti.org</a>
DHI	Door and Hardware Institute <a href="http://www.dhi.org">http://www.dhi.org</a>
EGSA	Electrical Generating Systems Association <a href="http://www.egsa.org">http://www.egsa.org</a>
EEI	Edison Electric Institute <a href="http://www.eei.org">http://www.eei.org</a>
EPA	Environmental Protection Agency <a href="http://www.epa.gov">http://www.epa.gov</a>
ETL	ETL Testing Laboratories, Inc. <a href="http://www.etl.com">http://www.etl.com</a>
FAA	Federal Aviation Administration <a href="http://www.faa.gov">http://www.faa.gov</a>
FCC	Federal Communications Commission <a href="http://www.fcc.gov">http://www.fcc.gov</a>
FPS	The Forest Products Society <a href="http://www.forestprod.org">http://www.forestprod.org</a>

GANNA	Glass Association of North America <a href="http://www.cssinfo.com/info/ganna.html/">http://www.cssinfo.com/info/ganna.html/</a>
FM	Factory Mutual Insurance <a href="http://www.fmglobal.com">http://www.fmglobal.com</a>
GA	Gypsum Association <a href="http://www.gypsum.org">http://www.gypsum.org</a>
GSA	General Services Administration <a href="http://www.gsa.gov">http://www.gsa.gov</a>
HI	Hydraulic Institute <a href="http://www.pumps.org">http://www.pumps.org</a>
HPVA	Hardwood Plywood & Veneer Association <a href="http://www.hpva.org">http://www.hpva.org</a>
ICBO	International Conference of Building Officials <a href="http://www.icbo.org">http://www.icbo.org</a>
ICEA	Insulated Cable Engineers Association Inc. <a href="http://www.icea.net">http://www.icea.net</a>
\ICAC	Institute of Clean Air Companies <a href="http://www.icac.com">http://www.icac.com</a>
IEEE	Institute of Electrical and Electronics Engineers <a href="http://www.ieee.org/">http://www.ieee.org/</a>
IMSA	International Municipal Signal Association <a href="http://www.imsasafety.org">http://www.imsasafety.org</a>
IPCEA	Insulated Power Cable Engineers Association
NBMA	Metal Buildings Manufacturers Association <a href="http://www.mbma.com">http://www.mbma.com</a>
MSS	Manufacturers Standardization Society of the Valve and Fittings Industry Inc. <a href="http://www.mss-hq.com">http://www.mss-hq.com</a>
NAAMM	National Association of Architectural Metal Manufacturers <a href="http://www.naamm.org">http://www.naamm.org</a>
NAPHCC	Plumbing-Heating-Cooling Contractors Association <a href="http://www.phccweb.org.org">http://www.phccweb.org.org</a>
NBS	National Bureau of Standards See - NIST
NBBPVI	National Board of Boiler and Pressure Vessel Inspectors <a href="http://www.nationboard.org">http://www.nationboard.org</a>
NEC	National Electric Code See - NFPA National Fire Protection Association

NEMA National Electrical Manufacturers Association  
<http://www.nema.org>

NFPA National Fire Protection Association  
<http://www.nfpa.org>

NHLA National Hardwood Lumber Association  
<http://www.natlhardwood.org>

NIH National Institute of Health  
<http://www.nih.gov>

NIST National Institute of Standards and Technology  
<http://www.nist.gov>

NLMA Northeastern Lumber Manufacturers Association, Inc.  
<http://www.nelma.org>

NPA National Particleboard Association  
 18928 Premiere Court  
 Gaithersburg, MD 20879  
 (301) 670-0604

NSF National Sanitation Foundation  
<http://www.nsf.org>

NWWDA Window and Door Manufacturers Association  
<http://www.nwwda.org>

OSHA Occupational Safety and Health Administration  
 Department of Labor  
<http://www.osha.gov>

PCA Portland Cement Association  
<http://www.portcement.org>

PCI Precast Prestressed Concrete Institute  
<http://www.pci.org>

PPI The Plastic Pipe Institute  
<http://www.plasticpipe.org>

PEI Porcelain Enamel Institute, Inc.  
<http://www.porcelainenamel.com>

PTI Post-Tensioning Institute  
<http://www.post-tensioning.org>

RFCI The Resilient Floor Covering Institute  
<http://www.rfci.com>

RIS Redwood Inspection Service  
 See - CRA



RMA	Rubber Manufacturers Association, Inc. <a href="http://www.rma.org">http://www.rma.org</a>
SCMA	Southern Cypress Manufacturers Association <a href="http://www.cypressinfo.org">http://www.cypressinfo.org</a>
SDI	Steel Door Institute <a href="http://www.steeldoor.org">http://www.steeldoor.org</a>
SOI	Secretary of the Interior <a href="http://www.cr.nps.gov/local-law/arch_stnds_8_2.htm">http://www.cr.nps.gov/local-law/arch_stnds_8_2.htm</a>
IGMA	Insulating Glass Manufacturers Alliance <a href="http://www.igmaonline.org">http://www.igmaonline.org</a>
SJI	Steel Joist Institute <a href="http://www.steeljoist.org">http://www.steeljoist.org</a>
SMACNA	Sheet Metal and Air-Conditioning Contractors National Association, Inc. <a href="http://www.smacna.org">http://www.smacna.org</a>
SSPC	The Society for Protective Coatings <a href="http://www.sspc.org">http://www.sspc.org</a>
STI	Steel Tank Institute <a href="http://www.steeltank.com">http://www.steeltank.com</a>
SWI	Steel Window Institute <a href="http://www.steelwindows.com">http://www.steelwindows.com</a>
TCA	Tile Council of America, Inc. <a href="http://www.tileusa.com">http://www.tileusa.com</a>
TEMA	Tubular Exchange Manufacturers Association <a href="http://www.tema.org">http://www.tema.org</a>
TPI	Truss Plate Institute, Inc. 583 D'Onofrio Drive; Suite 200 Madison, WI 53719 (608) 833-5900
UBC	The Uniform Building Code See ICBO
UL	Underwriters' Laboratories Incorporated <a href="http://www.ul.com">http://www.ul.com</a>
ULC	Underwriters' Laboratories of Canada <a href="http://www.ulc.ca">http://www.ulc.ca</a>

WCLIB      West Coast Lumber Inspection Bureau  
            6980 SW Varns Road, P.O. Box 23145  
            Portland, OR 97223  
            (503) 639-0651

WRCLA      Western Red Cedar Lumber Association  
            P.O. Box 120786  
            New Brighton, MN 55112  
            (612) 633-4334

WWPA      Western Wood Products Association  
            <http://www.wwpa.org>

- - - E N D - - -

**SECTION 01 45 00  
QUALITY CONTROL**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

This section specifies requirements for Quality Control (QC) for construction projects.

**1.2 APPLICABLE PUBLICATIONS**

A. The publication listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

B. ASTM International (ASTM)

1. ASTM D3740 - (2012a) Minimum Requirements for Agencies Engaged in the Testing and/or Inspection of Soil and Rock as Used in Engineering Design and Construction
2. ASTM E29 - (2014a) Standard Specification for Agencies Engaged in the Testing and/or Inspection of Materials Used in Construction

**1.3 SUBMITTALS**

Government approval is required for all submittals. QC inspection reports shall be submitted under this Specification section and follow the [Applicable QC Control Phase (Preparatory, Initial, or Follow-Up)]: [Applicable Specification section] naming convention.

1. Preconstruction Submittals
  - a. Interim QC Plan
  - b. QC Plan
2. Test Reports
  - a. Verification Statement

**PART 2 PRODUCTS - NOT USED**

**PART 3 - EXECUTION**

**3.1 GENERAL REQUIREMENTS**

Establish and maintain an effective quality control (QC) system that complies with the **FAR Clause 52.246.12** titled "**Inspection of Construction**". QC consists of plans, procedures, and organization necessary to produce an end product which complies with the Contract requirements. The QC system covers construction operations, both onsite

and offsite, and be keyed to the proposed construction sequence. The project superintendent will be held responsible for the quality of work and is subject to removal by the Contracting Office or Authorized designee for non-compliance with the quality requirements specified in the Contract. In this context, the highest-level manager responsible for the overall construction activities at the site, including quality and production is the project superintendent. The project superintendent maintains a physical presence at the site at all times and is responsible for all construction and related activities at the site, except as otherwise acceptable to the Contracting Officer.

### 3.2 QC PLAN

- A. Submit no later than 15 days after receipt of Notice to Proceed (NTP), the QC Plan proposed to implement the requirements of the **FAR Clause 52.246.12** titled "**Inspection of Construction**". The Government will consider an Interim QC Plan for the first 30 days of operation, which must be accepted within 10 business days of NTP. Construction will be permitted to begin only after acceptance of the QC Plan or acceptance of an Interim plan applicable to the particular feature of work to be started. Work outside of the accepted Interim QC Plan will not be permitted to begin until acceptance of a QC Plan or another Interim QC Plan containing the additional work scope is accepted.
- B. Content of the QC Plan: Include, as a minimum, the following to cover all construction operations, both onsite and offsite, including work by **subcontractors**, fabricators, suppliers, and purchasing agents:
  1. An acknowledgement that the QC staff will implement the three-phase control system for all aspects of the work specified. Include a QC System Manager that reports to the project manager.
  2. The name, qualifications, (in resume format) duties, responsibilities, and authorities of each person assigned a QC function.
  3. A statement to the QC System Manager signed by an authorized official of the firm which describes the responsibilities and delegates sufficient authorities to adequately perform the functions of the QC System Manager, including authority to stop work which is not in compliance with the Contract. Letters of direction to all other various quality control representatives outlining duties, authorities, and responsibilities will be issued by the QC System Manager to the Contracting Officer or Authorized designee.

4. Procedures for scheduling, reviewing, certifying, and managing submittals including those of subcontractors, consultants, suppliers and purchasing agents. These procedures must be in accordance with Section 01 33 23 Shop Drawings, Product Data, and Samples.
5. Control, verification, and acceptance of testing procedures for each specific test to include the test name, specification paragraph requiring test, feature of work to be tested, test frequency, and person responsible for each test. (Laboratory facilities approved by the Contracting Officer or Authorized designee are required to be used)
6. Procedures for tracking Preparatory, Initial, and Follow-Up control phases and control, verification, and acceptance tests including documentation.
7. Procedures for tracking and construction deficiencies from identification through acceptable corrective action. Establish verification procedures that identified deficiencies have been corrected.
8. Reporting procedures, including proposed reporting formats.
9. A list of the definable features of work. A definable feature of work is a task which is separate and distinct from other tasks has separate control requirements, and is identified by different trades or disciplines, or it is work by the same trade in a different environment. Although each section of specifications can generally be considered as a definable feature of work, there are frequently more than one definable feature under a particular section.  
This list will be agreed upon during the Coordination meeting.

### **3.3 COORDINATION MEETING**

After the Preconstruction Conference and before start construction, and prior to acceptance by the Government of the QC Plan, meet with the Contracting Officer or Authorized designee to discuss the Contractor's quality control system. Submit the QC Plan a minimum of 5 business days prior to the Coordination Meeting. During the meeting, a mutual understanding of the system details must be developed, including the forms for recording the QC operations, control activities, testing, administration of the system for both onsite and offsite work, and the interrelationship of Contractor's Management and control with the Government's Quality Assurance. Minutes of the meeting will be prepared by the Government, signed by both the Contractor and Contracting

Officer or Authorized designee and will become a part of the contract file. There can be occasions when subsequent conferences will be called by either party to reconfirm mutual understandings or address deficiencies in the QC system or procedures which can require corrective action by the Contractor.

#### **3.4 QUALITY CONTROL SYSTEM MANAGER**

- A. Personnel Requirements: The Contractor's QC system manager will maintain a presence at the site as required during progress of the work and have complete authority and responsibility to take any action necessary to ensure Contract compliance. The QC system manager will be subject to acceptance by the Contracting Officer or Authorized designee.
- B. QC System Manager: Identify as QC system Manager, an individual within the onsite work organization that is responsible for overall management of QC and has the authority to act in all QC matters for the Contractor. The QC system Manager is required to be a graduate engineer, graduate architect, or a graduate of construction management, with a minimum of 5 years' construction experience on construction similar to the scope of this Contract. This QC system manager is on the site as required during construction and is employed by the General Contractor. The QC system manager is assigned as QC system manager and can perform other duties, but needs to be allowed sufficient time to perform QC duties as described in the QC plan. The QC system manager will **NOT** have any duties as project superintendent in addition to quality control.
- C. Organizational Changes: Maintain the QC staff at full strength at all times. When it is necessary to make changes to the QC staff, revise the QC Plan to reflect the changes and submit the changes to the Contracting Officer or Authorized designee for acceptance.

#### **3.5 SUBMITTALS AND DELIVERABLES**

- A. Submittals must comply with the requirements in Section 01 33 23 Shop Drawings, Product Data, and Samples. The QC organization is responsible for certifying that all submittals and deliverables are in compliance with the contract requirements. Section 01 91 00 General Commissioning Requirements is included in the contract, the submittals required by the section must be coordinated with the Section 01 33 23 Shop

Drawings, Product Data, and Samples to ensure adequate time is allowed for each type of submittal required.

### 3.6 CONTROL

A. QC is the means by which the Contractor ensures that the construction, to include that of subcontractors and suppliers, complies with the requirements of the contract. At least three phases of control are required to be conducted by the QC system Manager for each definable feature of the construction work as follows:

1. Preparatory Phase: This phase is performed prior to beginning work on each definable feature of work after all required plans/documents/materials are approved/accepted, and after copies are at the work site. This phase includes:
  - a. A review of each paragraph of applicable specifications, references codes, and standards. Make available during the preparatory inspection a copy of those sections of referenced codes and standards applicable to that portion of the work to be accomplished in the field.
  - b. Review of the Contract drawings and specs.
  - c. Check to assure that all materials and equipment have been tested, submitted, and approved.
  - d. Review of provisions that have been made to provide required control inspection and testing.
  - e. Examination of the work area to assure that all required preliminary work has been completed and is in compliance with the Contract.
  - f. Examination of required materials, equipment, and sample work to assure that they are on hand, conform to approved shop drawings or submitted data, and are properly stored.
  - g. Review of the appropriate Activity Hazard Analysis (AHA) to assure safety requirements are met.
  - i. Discussion of procedures for controlling quality of the work including repetitive deficiencies. Document construction tolerances and workmanship standards - contract defined or industry standard if not contract defined - for that feature of work.
  - j. Check to ensure that the portion of the plan for the work to be performed has been accepted by the Contracting Officer.
  - k. Discussion of the initial control phase.

- B. Initial Phase: This phase is accomplished at the beginning of a definable feature of work. Accomplish the following:
  - 1. Check work to ensure that it is in full compliance with contract requirements.
  - 2. Verify adequacy of controls to ensure full contract compliance. Verify the required control inspection and testing is in compliance with the contract.
  - 3. Establish level of workmanship and verify that it meets minimum acceptable workmanship standards. Compare with required sample panels as appropriate.
  - 4. Resolve all differences.
  - 5. Check safety to include compliance with an upgrading of the safety plan and activity hazard analysis. Review the activity analysis with each worker.
- C. Follow-Up Phase: Perform daily checks to assure control activities, including control testing, are providing continued compliance with contract requirements until the completion of the particular feature of work. Record the checks in the QC documentation. Conduct final Follow-Up checks and correct all deficiencies prior to the start of additional features of work which may be affected by the deficient work. **Do not build upon nor conceal non-conforming work.**
- D. Additional Preparatory and Initial Phases on the same definable features of work if: the quality ongoing work is unacceptable; if there are changes in the applicable QC staff, onsite production supervision or work crew; if work on a definable feature is resumed after a substantial period of inactivity, or if other problems develop.

### 3.7 TESTS

- A. Testing Procedure: Perform specified or required tests to verify that control measures are adequate to provide a product which conforms to contract requirements. Upon request, furnish to the Government duplicate samples of test specimens for possible testing by the Government. Testing includes operation and acceptance test when specified. Perform the following activities and record and provide the following data:
  - 1. Verify that testing procedures comply with contract requirements.
  - 2. Verify that facilities and testing equipment are available and comply with testing standards.
  - 3. Check test instrument calibration data against certified standards.



4. Verify that recording forms and test identification control number system, including all of the test documentation requirements, have been prepared.
  5. Record results of all tests taken, both passing and failing on the QC report for the date taken. Specification paragraph reference, location where tests were taken, and the unique sequential control number identifying the test. If approved by the Contracting Officer or Authorized designee, actual test reports are submitted later with a reference to the test number and date taken. Provide an information copy of tests performed by an offsite or commercial test facility directly to the Contracting Officer or Authorized designee. Failure to submit timely test reports as stated results in nonpayment for related work performed and disapproval of the test facility for this Contract.
- B. Testing Laboratories: All testing laboratories must be validated through the procedures contained in Specification section 01 45 29 Testing Laboratory Services.
1. Capability Check: The Government reserves the right to check laboratory equipment in the proposed laboratory for compliance with the standards set forth in the contract specifications and to check the laboratory technician's testing procedures and techniques. Laboratories utilized for testing soils, concrete, asphalt and steel is required to meet criteria detailed in ASTM D3740 and ASTM E329.
  2. Capability Recheck: If the selected laboratory fails the capability check, the Contractor will be assessed a charge equal to value of recheck to reimburse the Government for each succeeding recheck of the laboratory or the checking of a subsequently selected laboratory. Such costs will be deducted from the Contract amount due the Contractor.

### **3.8 COMPLETION INSPECTION**

- A. Punch-Out Inspection: Conduct an inspection of the work by the QC system Manager near the end of the work, or any increment of the work established by a time stated FAR 52.211-10 - Commencement, Prosecution, and Completion of Work, or by the specifications. Prepare and include in the QC documentation a punch list of items which do not conform to the approved drawings and specifications. Include within the list of deficiencies the estimated date by which the deficiencies will be corrected. Make a second inspection the QC system Manager or staff to

ascertain that all deficiencies have been corrected. Once this is accomplished, notify the Government that the facility is ready for the Government Final Inspection.

- B. Final Acceptance Inspection: The Contractor's QC Inspection personnel, plus the superintendent or other primary management person, and the Contracting Officer's Authorized designee is required to be in attendance at the Final Acceptance Inspection. Additional Government personnel can also be in attendance. The Final Acceptance Inspection will be formally scheduled by the Contracting Officer's or Authorized designee Resident Engineer office at least 14 days prior to the Final Acceptance Inspection and include the Contractor's assurance that all specific items previously identified to the Contractor as being unacceptable, along with all remaining work performed under the contract, will be complete and acceptable by the date schedule for the Final Acceptance Inspection. Failure of the Contractor to have all contract work acceptably complete for this inspection will be cause for the Contracting Officer to bill the Contractor for the Government's additional inspection cost in accordance with **FAR Clause 52.246-12** titled "**Inspection of Construction**".

### **3.9 DOCUMENTATION**

- A. Quality Control Activities: Maintain current records providing factual evidence that required QC activities and tests have been performed. Include in these records the work of subcontractors and suppliers on an acceptable form that includes, as a minimum, the following information:
1. The name and area of responsibility of the Contractor/Subcontractor
  2. Test and control activities performed with results and references to specification/drawing requirements. Identify the Control Phase (Preparatory, Initial, and/or Follow-Up). List deficiencies noted, along with corrective action.
  3. Quantity of materials received at the site with statement as to acceptability, storage, and reference to specification/drawing requirements.
  4. Submittals and deliverables reviewed, with Contract reference, by whom, and action taken.
  5. Offsite surveillance activities, including actions taken.

6. Job safety evaluations stating what was checked, results, and instructions or corrective actions.
  7. Instructions given/received and conflicts in plans and specifications.
- B. Verification Statement: Cover both conforming and deficient features and include a statement that equipment and materials incorporated in the work and workmanship comply with the Contract. Furnish these records in report form for the previous week, as part of the daily log. As a minimum, prepare and submit on report for every 7 days of no work, all calendar days need to be accounted for throughout the life of the contract. Reports need to be signed and dated by the QC system Manager. Include copies of test reports and copies of reports prepared by all subordinate QC personnel within the QC system Manager Report.
- C. Quality Control Activities: Maintain current records providing factual evidence that required QC activities and tests have been performed. Include in these records the work of subcontractors and suppliers on an acceptable form that includes, as a minimum, the following information:
1. Type and results of inspection to include P - Preparatory, I - Initial, or F - Follow-up, and include satisfactory work completed or deficiencies with action taken to be taken.
  2. Tests required by plans and/or specs performed and results of tests.
  3. Contractors and/or sub-contractors, areas where inspections and/or tests were conducted, and any pertinent comments that the QC system manager feels is required.

### **3.10 NOTIFICATION OF NONCOMPLIANCE**

- A. The Contracting Officer or Authorized designee will notify the Contractor of any detected noncompliance with the foregoing requirements. The Contractor should take immediate corrective action after receipt of such notice. Such notice, when delivered to the Contractor at the work site will be deemed sufficient for the purpose of notification. If the Contractor fails or refuses to comply promptly, the Contracting Officer can issue an order stopping all or part of the work until satisfactory corrective action has been taken. No part of the time lost due to such stop orders will be made the subject of claim for extension of time or for excess costs or damages by the Contractor.

--- End of Section ---



**SECTION 01 74 19**  
**CONSTRUCTION WASTE MANAGEMENT**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the requirements for the management of non-hazardous building construction and demolition waste.
- B. Waste disposal in landfills shall be minimized to the greatest extent possible. Of the inevitable waste that is generated, as much of the waste material as economically feasible shall be salvaged, recycled or reused.
- C. Contractor shall use all reasonable means to divert construction and demolition waste from landfills and incinerators, and facilitate their salvage and recycle not limited to the following:
  - 1. Waste Management Plan development and implementation.
  - 2. Techniques to minimize waste generation.
  - 3. Sorting and separating of waste materials.
  - 4. Salvage of existing materials and items for reuse or resale.
  - 5. Recycling of materials that cannot be reused or sold.
- D. At a minimum, the following waste categories shall be diverted from landfills:
  - 1. Soil.
  - 2. Inerts (eg, concrete, masonry and asphalt).
  - 3. Clean dimensional wood and palette wood.
  - 4. Green waste (biodegradable landscaping materials).
  - 5. Engineered wood products (plywood, particle board and I-joists, etc).
  - 6. Metal products (eg, steel, wire, beverage containers, copper, etc).
  - 7. Cardboard, paper and packaging.
  - 8. Bitumen roofing materials.
  - 9. Plastics (eg, ABS, PVC).
  - 10. Carpet and/or pad.
  - 11. Gypsum board.
  - 12. Insulation.
  - 13. Paint.
  - 14. Fluorescent lamps.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.

### 1.3 QUALITY ASSURANCE

- A. Contractor shall practice efficient waste management when sizing, cutting and installing building products. Processes shall be employed to ensure the generation of as little waste as possible.
- Construction/Demolition waste includes products of the following:
1. Excess or unusable construction materials.
  2. Packaging used for construction products.
  3. Poor planning and/or layout.
  4. Construction error.
  5. Over ordering.
  6. Weather damage.
  7. Contamination.
  8. Mishandling.
  9. Breakage.
- B. Establish and maintain the management of non-hazardous building construction and demolition waste set forth herein. Conduct a site assessment to estimate the types of materials that will be generated by demolition and construction.
- C. Contractor shall develop and implement procedures to recycle construction and demolition waste to a minimum of 50 percent.
- D. Contractor shall be responsible for implementation of any special programs involving rebates or similar incentives related to recycling. Any revenues or savings obtained from salvage or recycling shall accrue to the contractor.
- E. Contractor shall provide all demolition, removal and legal disposal of materials. Contractor shall ensure that facilities used for recycling, reuse and disposal shall be permitted for the intended use to the extent required by local, state, federal regulations. The Whole Building Design Guide website <http://www.wbdg.org/tools/cwm.php> provides a Construction Waste Management Database that contains information on companies that haul, collect, and process recyclable debris from construction projects.
- F. Contractor shall assign a specific area to facilitate separation of materials for reuse, salvage, recycling, and return. Such areas are to be kept neat and clean and clearly marked in order to avoid contamination or mixing of materials.

- G. Contractor shall provide on-site instructions and supervision of separation, handling, salvaging, recycling, reuse and return methods to be used by all parties during waste generating stages.
- H. Record on daily reports any problems in complying with laws, regulations and ordinances with corrective action taken.

#### **1.4 TERMINOLOGY**

- A. Class III Landfill: A landfill that accepts non-hazardous resources such as household, commercial and industrial waste resulting from construction, remodeling, repair and demolition operations.
- B. Clean: Untreated and unpainted; uncontaminated with adhesives, oils, solvents, mastics and like products.
- C. Construction and Demolition Waste: Includes all non-hazardous resources resulting from construction, remodeling, alterations, repair and demolition operations.
- D. Dismantle: The process of parting out a building in such a way as to preserve the usefulness of its materials and components.
- E. Disposal: Acceptance of solid wastes at a legally operating facility for the purpose of land filling (includes Class III landfills and inert fills).
- F. Inert Backfill Site: A location, other than inert fill or other disposal facility, to which inert materials are taken for the purpose of filling an excavation, shoring or other soil engineering operation.
- G. Inert Fill: A facility that can legally accept inert waste, such as asphalt and concrete exclusively for the purpose of disposal.
- H. Inert Solids/Inert Waste: Non-liquid solid resources including, but not limited to, soil and concrete that does not contain hazardous waste or soluble pollutants at concentrations in excess of water-quality objectives established by a regional water board and does not contain significant quantities of decomposable solid resources.
- I. Mixed Debris: Loads that include commingled recyclable and non-recyclable materials generated at the construction site.
- J. Mixed Debris Recycling Facility: A solid resource processing facility that accepts loads of mixed construction and demolition debris for the purpose of recovering re-usable and recyclable materials and disposing non-recyclable materials.
- K. Permitted Waste Hauler: A company that holds a valid permit to collect and transport solid wastes from individuals or businesses for the purpose of recycling or disposal.

- L. Recycling: The process of sorting, cleansing, treating, and reconstituting materials for the purpose of using the altered form in the manufacture of a new product. Recycling does not include burning, incinerating or thermally destroying solid waste.
  - 1. On-site Recycling - Materials that are sorted and processed on site for use in an altered state in the work, i.e. concrete crushed for use as a sub-base in paving.
  - 2. Off-site Recycling - Materials hauled to a location and used in an altered form in the manufacture of new products.
- M. Recycling Facility: An operation that can legally accept materials for the purpose of processing the materials into an altered form for the manufacture of new products. Depending on the types of materials accepted and operating procedures, a recycling facility may or may not be required to have a solid waste facilities permit or be regulated by the local enforcement agency.
- N. Reuse: Materials that are recovered for use in the same form, on-site or off-site.
- O. Return: To give back reusable items or unused products to vendors for credit.
- P. Salvage: To remove waste materials from the site for resale or re-use by a third party.
- Q. Source-Separated Materials: Materials that are sorted by type at the site for the purpose of reuse and recycling.
- R. Solid Waste: Materials that have been designated as non-recyclable and are discarded for the purposes of disposal.
- S. Transfer Station: A facility that can legally accept solid waste for the purpose of temporarily storing the materials for re-loading onto other trucks and transporting them to a landfill for disposal or recovering some materials for re-use or recycling.

#### **1.5 SUBMITTALS**

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES, furnish the following:
- B. Prepare and submit to the Resident Engineer a written demolition debris management plan. The plan shall include, but not be limited to, the following information:
  - 1. Procedures to be used for debris management.
  - 2. Techniques to be used to minimize waste generation.



3. Analysis of the Estimated Job Site Waste to be Generated:
  - a. List of each material and quantity to be salvaged, reused, recycled.
  - b. List of each material and quantity proposed to be taken to a landfill.
4. Detailed description of the Means/Methods to be used for material handling.
  - a. On Site: Material separation, storage, protection where applicable.
  - b. Off Site: Transportation means and destination. Include list of materials.
    - 1) Description of materials to be site-separated and self-hauled to designated facilities.
    - 2) Description of mixed materials to be collected by designated waste haulers and removed from the site.
  - c. The names and locations of mixed debris reuse and recycling facilities or sites.
  - d. The names and locations of trash disposal landfill facilities or sites.
  - e. Documentation that the facilities or sites are approved to receive the materials.
- C. Designated Manager responsible for instructing personnel, supervising, documenting and administer over meetings relevant to the Waste Management Plan.
- D. Monthly summary of construction and demolition debris diversion and disposal, quantifying all materials generated at the work site and disposed of or diverted from disposal through recycling.

#### **1.6 APPLICABLE PUBLICATIONS**

- A Publications listed below form a part of this specification to the extent referenced. Publications are referenced by the basic designation only. In the event that criteria requirements conflict, the most stringent requirements shall be met.
- B. U.S. Green Building Council (USGBC):  
LEED Green Building Rating System for New Construction

**1.7 RECORDS**

Maintain records to document the quantity of waste generated; the quantity of waste diverted through sale, reuse, or recycling; and the quantity of waste disposed by landfill or incineration. Records shall be kept in accordance with the LEED Reference Guide and LEED Template.

**PART 2 - PRODUCTS****2.1 MATERIALS**

- A. List of each material and quantity to be salvaged, recycled, reused.
- B. List of each material and quantity proposed to be taken to a landfill.
- C. Material Tracking Data: Receiving parties, dates removed, transportation costs, weight tickets, tipping fees, manifests, invoices, net total costs or savings.

**PART 3 - EXECUTION****3.1 COLLECTION**

- A. Provide all necessary containers, bins and storage areas to facilitate effective waste management.
- B. Clearly identify containers, bins and storage areas so that recyclable materials are separated from trash and can be transported to respective recycling facility for processing.
- C. Hazardous wastes shall be separated, stored, disposed of according to local, state, federal regulations.

**3.2 DISPOSAL**

- A. Contractor shall be responsible for transporting and disposing of materials that cannot be delivered to a source-separated or mixed materials recycling facility to a transfer station or disposal facility that can accept the materials in accordance with state and federal regulations.
- B. Construction or demolition materials with no practical reuse or that cannot be salvaged or recycled shall be disposed of at a landfill or incinerator.

**3.3 REPORT**

- A. With each application for progress payment, submit a summary of construction and demolition debris diversion and disposal including beginning and ending dates of period covered.

- B. Quantify all materials diverted from landfill disposal through salvage or recycling during the period with the receiving parties, dates removed, transportation costs, weight tickets, manifests, invoices. Include the net total costs or savings for each salvaged or recycled material.
- C. Quantify all materials disposed of during the period with the receiving parties, dates removed, transportation costs, weight tickets, tipping fees, manifests, invoices. Include the net total costs for each disposal.

- - - E N D - - -



**SECTION 02 41 00  
DEMOLITION**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

This section specifies demolition and removal of portions of buildings.

**1.2 RELATED WORK**

- A. Safety Requirements: Section 01 35 26 Safety Requirements Article, ACCIDENT PREVENTION PLAN (APP).
- B. Reserved items that are to remain the property of the Government: Section 01 00 00, GENERAL REQUIREMENTS.
- C. Construction Waste Management: Section 01 74 19 CONSTRUCTION WASTE MANAGEMENT.

**1.3 PROTECTION**

- A. Perform demolition in such manner as to eliminate hazards to persons and property; to minimize interference with use of adjacent areas, utilities and structures or interruption of use of such utilities; and to provide free passage to and from such adjacent areas of structures. Comply with requirements of GENERAL CONDITIONS Article, ACCIDENT PREVENTION.
- B. Provide safeguards, including warning signs, barricades, temporary fences, warning lights, and other similar items that are required for protection of all personnel during demolition and removal operations. Comply with requirements of Section 01 00 00, GENERAL REQUIREMENTS, Article PROTECTION OF EXISTING VEGETATION, STRUCTURES, EQUIPMENT, UTILITIES AND IMPROVEMENTS.
- C. Provide enclosed dust chutes with control gates from each floor to carry debris to truck beds and govern flow of material into truck. Provide overhead bridges of tight board or prefabricated metal construction at dust chutes to protect persons and property from falling debris.
- D. Prevent spread of flying particles and dust. Sprinkle rubbish and debris with water to keep dust to a minimum. Do not use water if it results in hazardous or objectionable condition such as, but not limited to; ice, flooding, or pollution. Vacuum and dust the work area daily.
- E. In addition to previously listed fire and safety rules to be observed in performance of work, include following:
  - 1. Wherever a cutting torch or other equipment that might cause a fire is used, provide and maintain fire extinguishers nearby ready for immediate use. Instruct all possible users in use of fire extinguishers.
  - 2. Keep hydrants clear and accessible at all times. Prohibit debris from accumulating within a radius of 4500 mm (15 feet) of fire hydrants.

F. Before beginning any demolition work, the Contractor shall survey the site and examine the drawings and specifications to determine the extent of the work. The contractor shall take necessary precautions to avoid damages to existing items to remain in place, to be reused, or to remain the property of the Medical Center; any damaged items shall be repaired or replaced as approved by the Resident Engineer. The Contractor shall coordinate the work of this section with all other work and shall construct and maintain shoring, bracing, and supports as required. The Contractor shall ensure that structural elements are not overloaded and shall be responsible for increasing structural supports or adding new supports as may be required as a result of any cutting, removal, or demolition work performed under this contract. Do not overload structural elements. Provide new supports and reinforcement for existing construction weakened by demolition or removal works. Repairs, reinforcement, or structural replacement must have Resident Engineer's approval.

**PART 2 - PRODUCTS (NOT USED)**

**PART 3 - EXECUTION**

**3.1 DEMOLITION**

- A. Debris, including brick, concrete, stone, metals and similar materials shall become property of Contractor and shall be disposed of by him daily, off the Medical Center Property to avoid accumulation at the demolition site. Materials that cannot be removed daily shall be stored in areas specified by the Resident Engineer. Contractor shall dispose debris in compliance with applicable federal, state or local permits, rules and/or regulations.
- B. Remove existing utilities as indicated or uncovered by work and terminate in a manner conforming to the nationally recognized code covering the specific utility and approved by the Resident Engineer. When Utility lines are encountered that are not indicated on the drawings, the Resident Engineer shall be notified prior to further work in that area.

**3.2 CLEAN-UP**

On completion of work of this section and after removal of all debris, leave site in clean condition satisfactory to Resident Engineer. Clean-up shall include off the Medical Center Property disposal of all items and materials not required to remain property of the Government as well as all debris and rubbish resulting from demolition operations.

**3.3 DEMOLITION NOISE CONSTRAINTS**

Due to the proximity of the project area to Services sensitive to noise, all major demolition which will result in high noise levels shall be completed between the hours of 3:30pm - 9:00pm Monday through Friday; and 8:00am to 5:00pm Saturday and Sunday.

- - - E N D - - -





**SECTION 03 30 53**  
**CAST-IN-PLACE CONCRETE**

**PART 1 - GENERAL**

**1.1 SUMMARY**

A. Section Includes:

1. Concrete topping slabs.
2. Preparation of existing surface to received concrete topping.

**1.2 APPLICABLE PUBLICATIONS**

A. Comply with references to extent specified in this Section.

B. American Concrete Institute (ACI):

1. 117-15 - Tolerances for Concrete Construction, Materials and Commentary.
2. 117M-10(R2015) - Tolerances for Concrete Construction, Materials and Commentary.
3. 211.1-91(R2009) - Proportions for Normal, Heavyweight, and Mass Concrete.
4. 211.2-98(R2004) - Selecting Proportions for Structural Lightweight Concrete.
5. 301/310M-10 - Structural Concrete.
6. 305.1-14 - Hot Weather Concreting.
7. 306.1-90(R2002) - Cold Weather Concreting.
8. 318/318M-14 - Building Code Requirements for Structural Concrete and SP-66-04-ACI Detailing Manual.
9. 347-04 - Guide to Formwork for Concrete.

C. ASTM International (ASTM):

1. A615/A615M-15a/1 - Deformed and Plain Carbon-Steel Bars for Concrete Reinforcement.
2. A996/A996M-15 - Rail-Steel and Axle-Steel Deformed Bars for Concrete Reinforcement.
3. A1064/A1064M-15 - Carbon-Steel Wire and Welded Wire Reinforcement, Plain and Deformed, for Concrete.
4. C33/C33M-13 - Concrete Aggregates.
5. C39/C39M-15a - Compressive Strength of Cylindrical Concrete Specimens.
6. C94/C94M-15a - Ready-Mixed Concrete.
7. C143/C143M-15 - Slump of Hydraulic Cement Concrete.
8. C150/C150M-15 - Portland Cement.

9. C171-07 - Sheet Material for Curing Concrete.
  10. C192/C192M-15 - Making and Curing Concrete Test Specimens in the Laboratory.
  11. C219-14a - Terminology Relating to Hydraulic Cement.
  12. C260/C260M-10a - Air-Entraining Admixtures for Concrete.
  13. C330/C330M-14 - Lightweight Aggregates for Structural Concrete.
  14. C494/C494M-15 - Chemical Admixtures for Concrete.
  15. C618-15 - Coal Fly Ash and Raw or Calcined Natural Pozzolan for Use in Concrete.
  16. C881/C881M-14 - Epoxy-Resin-Base Bonding Systems for Concrete.
  17. C989/C989M-14 - Slag Cement for Use in Concrete and Mortars.
  18. C1240-15 - Silica Fume Used in Cementitious Mixtures.
  19. D1751-04(2013el) - Preformed Expansion Joint Fillers for Concrete Paving and Structural Construction (Non-extruding and Resilient Bituminous Types).
  20. E1155-14 - Determining FF Floor Flatness and FL Floor Levelness Numbers.
  21. E1745-11 - Water Vapor Retarders Used in Contact with Soil or Granular Fill under Concrete Slabs.
- D. International Concrete Repair Institute:
1. 310.2R-2013 - Selecting and Specifying Concrete Surface Preparation for Sealers, Coatings, Polymer Overlays, and Concrete Repair.

### 1.3 SUBMITTALS

- A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Submittal Drawings:
  1. Large scale drawings of reinforcing steel.
- C. Manufacturer's Literature and Data:
  1. Concrete Mix Design.
  2. Air-entraining admixture, chemical admixtures, and curing compounds.
  3. Indicate manufacturer's recommendation for each application.
- D. Certificates: Certify products comply with specifications.
  - a. Each ready mix concrete batch delivered to site.

### 1.4 DELIVERY

- A. Deliver each ready-mixed concrete batch with mix certification in duplicate according to ASTM C94/C94M.

**1.5 WARRANTY**

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."

**PART 2 - PRODUCTS****2.1 MATERIALS**

- A. Portland Cement: ASTM C150/C150M, Type I or II.
- B. Pozzolans:
  - 1. Fly Ash: ASTM C618, Class C or F including supplementary optional physical requirements.
  - 2. Slag: ASTM C989/C989M; Grade 80, Grade 100 or Grade 120 as suitable for the Work.
  - 3. Silica Fume: ASTM C1240.
- C. Coarse Aggregate: ASTM C33/C33M.
  - 1. Size 467 for footings and walls over 300 mm (12 inches) thick.
  - 2. Size 7 for coarse aggregate for applied topping and metal pan stair fill.
  - 3. Size 67 for other applications.
- D. Fine Aggregate: ASTM C33/C33M.
- E. Lightweight Aggregate for Structural Concrete: ASTM C330/C330M, Table 1.
- F. Mixing Water: Fresh, clean, and potable.
- G. Chemical Admixtures: ASTM C494/C494M.
- H. Reinforcing Steel: ASTM A615/A615M or ASTM A996/A996M, deformed. See Structural Drawings for grade.
- I. Forms: Wood, plywood, metal, or other materials, approved by Contracting Officer, of grade or type suitable to obtain type of finish specified.
  - 1. Plywood: Exterior grade, free of defects and patches on contact surface.
  - 2. Lumber: Sound, grade-marked, S4S stress graded softwood.
  - 3. Form coating: As recommended by Contractor.
- J. Welded Wire Fabric: ASTM A1064/A1064M, plain or deformed; Grade 65; sized as indicated.
- K. Expansion Joint Filler: ASTM D1751.
- L. Sheet Materials for Curing Concrete: ASTM C171.
- M. Abrasive Aggregates: Aluminum oxide grains or emery grits.

- N. Liquid Densifier/Sealer: 100 percent active colorless aqueous silicate solution.
- O. Grout, Non-Shrinking: Premixed ferrous or non-ferrous. Grout to show no settlement or vertical drying shrinkage at 3 days. Compressive strength for grout, at least 18 MPa (2500 psi) at 3 days and 35 MPa (5000 psi) at 28 days.
- P. Moisture Vapor Emissions and Alkalinity Control Sealer: 100% active colorless aqueous silicate solution concrete surface.
  - 1. ASTM C1315 Type 1 Class A, and ASTM C309 Type 1 Class A, penetrating product to have no less than 34% solid content, leaving no sheen, volatile organic compound (VOC) content rating as required to suite regulatory requirements. The product shall have at least a five (5) year documented history in controlling moisture vapor emission from damaging floor covering, compatible with all finish materials.
  - 2. MVE 15-Year Warranty:
    - a. When a floor covering is installed on a below grade, on grade, or above grade concrete slab treated with Moisture Vapor Emissions & Alkalinity Control Sealer according to manufacturer's instruction, sealer manufacturer shall warrant the floor covering system against failure due to moisture vapor migration or moisture-born contaminants for a period of fifteen (15) years from the date of original installation. The warranty shall cover all labor and materials needed to replace all floor covering that fails due to moisture vapor emission & moisture born contaminants.

## 2.2 ACCESSORIES

- A. Bonding Agent: ASTM C 1059/C 1059M, Type II.
- B. Structural Adhesive: ASTM C881, 2-component material suitable for use on dry or damp surfaces. Provide material Type, Grade, and Class to suit Project requirements.
- C. Water Stops: Rubber base with self-healing properties. Expanding clay based products not acceptable.

## 2.3 CONCRETE MIXES

- A. Design concrete mixes according to ASTM C94/C94M, Option C.
- B. Compressive strength at 28 days: minimum 30 MPa (4,000 psi).

- C. Submit mix design and results of compression tests to the Contracting Officer for his evaluation. Identify all materials, including admixtures, making-up the concrete.
- D. Maximum Slump for Vibrated Concrete: 100 mm (4 inches) tested according to ASTM C143.
- E. Cement and Water Factor (See Table I):

TABLE I - CEMENT AND WATER FACTORS FOR CONCRETE				
Concrete: Strength	Non-Air-Entrained		Air-Entrained	
Min. 28 Day Comp. Str. MPa (psi)	Min. Cement kg/cu. m (lbs./cu. yd.)	Max. Water Cement Ratio	Min. Cement kg/cu. m (lbs./cu. yd.)	Max. Water Cement Ratio
35 (5000)1,3	375 (630)	0.45	385 (650)	0.40
30 (4000)1,3	325 (550)	0.55	340 (570)	0.50
25 (3000)1,3	280 (470)	0.65	290 (490)	0.55
25 (3000)1,2	300 (500)	*	310 (520)	*
Footnotes:				
1. If trial mixes are used, achieve a compressive strength 8.3 MPa (1 200 psi) in excess of f'c. For concrete strengths greater than 35 MPa (5,000 psi), achieve a compressive strength 9.7 MPa (1,400 psi) in excess of f'c.				
2. Lightweight Structural Concrete: Pump mixes may require higher cement values as specified in ACI 318/318M.				
3. For Concrete Exposed to High Sulfate Content Soils: Maximum water cement ratio is 0.44.				
* Laboratory Determined according to ACI 211.1 for normal weight concrete or ACI 211.2 for lightweight structural concrete.				

#### 2.4 BATCHING AND MIXING

- A. Store, batch, and mix materials according to ASTM C94/C94M.
1. Job-Mixed: Batch mix concrete in stationary mixers as specified in ASTM C94/C94M.
  2. Ready-Mixed Concrete: Comply with ASTM C94/C94M, except use of non-agitating equipment for transporting concrete to Site is not acceptable.

3. Mixing Structural Lightweight Concrete: Charge mixer with 2/3 of total mixing water and total aggregate for each batch. Mix ingredients minimum 30 seconds in stationary mixer or minimum 10 revolutions at mixing speed in truck mixer. Add remaining mixing water and other ingredients and continue mixing. Above procedure may be modified as recommended by aggregate producer.
4. When aggregate producer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.

### **PART 3 - EXECUTION**

#### **3.1 FORMWORK**

- A. Installation: Conform to ACI 347. Construct forms to obtain concrete of the shapes, dimensions and profiles indicated, with tight joints.
- B. Design and construct forms to prevent bowing-out of forms between supports and to be removable without prying against or otherwise damaging fresh concrete.
- C. When patching formed concrete, seal form edges against existing surface to prevent leakage; set forms so that patch is flush with adjacent surfaces.
- D. Treating and Wetting: Treat or wet concrete contact surfaces:
  1. Coat plywood and lumber forms with non-staining form sealer.
  2. Wet wood forms thoroughly when they are not treated with form release agent.
  3. Prevent water from accumulating and remaining within forms.
  4. Clean and coat removable metal forms with light form oil before reinforcement is placed.
  5. In hot weather, cool metal forms by thoroughly wetting with water just before placing concrete.
  6. Prevent water from accumulating and remaining within forms.
- E. Inserts, Sleeves, and Similar Items: Install flashing reglets, masonry ties, anchors, inserts, wires, hangers, sleeves, boxes for floor hinges, and other cast-in items specified in other Sections. Place where indicated, square, flush and secured to formwork.
- F. Construction Tolerances - General: Install and maintain concrete formwork to assure completion of work within specified tolerances.
- G. Adjust or replace completed work exceeding specified tolerances before placing concrete.

### 3.2 REINFORCEMENT

- A. Install concrete reinforcement according to ACI 318 and ACI SP-66.
- B. Support and securely tie reinforcing steel to prevent displacement during placing of concrete.
- C. Drilling for Dowels in Existing Concrete: Use sharp bits, drill hole slightly oversize, fill with epoxy grout, inset the dowel, and remove excess epoxy.

### 3.3 PLACING CONCRETE

- A. Remove water from excavations before concrete is placed.  
Remove hardened concrete, debris and other foreign materials from interior of forms, and from inside of mixing and conveying equipment. Obtain approval from Contracting Officer's Representative before placing concrete.
- B. Install screeds at required elevations for concrete slabs.
- C. Roughen and clean free from laitance, foreign matter, and loose particles before placing new concrete on existing concrete.
  - 1. Blow-out areas with compressed air and immediately coat contact areas with adhesive in compliance with manufacturer's instructions.
- D. Place structural concrete according to ACI 301 and ACI 318.
- E. Convey concrete from mixer to final place of deposit by method that will prevent segregation or loss of ingredients. Do not deposit, in Work, concrete that has attained its initial set or has contained its water or cement more than 1 1/2 hours. Do not allow concrete to drop freely more than 1500 mm (5 feet) in unexposed work nor more than 900 mm (3 feet) in exposed work.
- F. Place and consolidate concrete in horizontal layers not exceeding 300 mm (12 inches) in thickness. Consolidate concrete by spading, rodding, and mechanical vibrator. Do not secure vibrator to forms or reinforcement. Continuously vibrate during placement of concrete.
- G. Hot Weather Concrete Placement: As recommended by ACI 305.1 to prevent adversely affecting properties and serviceability of hardened concrete.
- H. Cold Weather Concrete Placement: As recommended by ACI 306.1, to prevent freezing of thin sections less than 300 mm (12 inches) and to permit concrete to gain strength properly.
  - 1. Do not use calcium chloride without written approval from Contracting Officer's Representative.

**3.4 TOLERANCES**

- A. Slab on Grade Finish Tolerance: Comply with ACI 117, FF-number and FL-number method.
  - 1. Paragraph 4.8.3, Class A 3 mm (1/8 inches) for offset in form-work.
  - 2. Table R4.8.4, "Flat" 6 mm (1/4 inch) in 3 m (10 feet) for slabs.

**3.5 PROTECTION AND CURING**

- A. Protect exposed surfaces of concrete from premature drying, wash by rain or running water, wind, mechanical damage, and excessive hot or cold temperatures.
- B. Curing Methods: Cure concrete with curing compound using wet method with sheets.
- C. Formed Concrete Curing: Wet the tops and exposed portions of formed concrete and keep moist until forms are removed.
  - 1. If forms are removed before 14 days after concrete is cast, install sheet curing materials as specified above.
- D. Concrete Flatwork Curing:
  - 1. Install sheet materials according to the manufacturer's instructions.
    - a. When manufacturer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.

**3.6 SLABS RECEIVING RESILIENT COVERING**

- A. Slab shall be allowed to cure for 6 weeks minimum prior to placing resilient covering. After curing, slab shall be tested by the Contractor for moisture in accordance with ASTM D4263 or ASTM F1869. Moisture content shall be less than 3 pounds per 1000 sf prior to placing covering.
- B. In lieu of curing for 6 weeks, Contractor has the option, at his own cost, to utilize the Moisture Vapor Emissions & Alkalinity Control Sealer as follows:
  - 1. Sealer is applied on the day of the concrete pour or as soon as harsh weather permits, prior to any other chemical treatments for concrete slabs either on grade, below grade or above grade receiving resilient flooring, such as, sheet vinyl, vinyl composition tile, rubber, wood flooring, epoxy coatings and overlays.



2. Manufacturer's representative will be on the site the day of concrete pour to install or train its application and document.
  - a. Apply Sealer to concrete slabs as soon as final finishing operations are complete and the concrete has hardened sufficiently to sustain floor traffic without damage.
  - b. Spray apply Sealer at the rate of 20 m<sup>2</sup> (200 square feet) per gallon. Lightly broom product evenly over the substrate and product has completely penetrated the surface.
  - c. If within two (2) hours after initial application areas are subjected to heavy rainfall and puddling occurs, reapply Sealer product to these areas as soon as weather condition permits.

### **3.7 FORM REMOVAL**

- A. Maintain forms in place until concrete is self-supporting, with construction operation loads.
- B. Remove fins, laitance and loose material from concrete surfaces when forms are removed. Repair honeycombs, rock pockets, sand runs, spalls, or otherwise damaged surfaces by patching with the same mix as concrete minus the coarse aggregates.
- C. Finish to match adjacent surfaces.

### **3.8 FINISHES**

- A. Slab Finishes:
  1. Allow bleed water to evaporate before surface is finished. Do not sprinkle dry cement on surface to absorb water.
  2. Scratch Finish: Rake or wire broom after partial setting slab surfaces to received bonded applied cementitious application, within 2 hours after placing, to roughen surface and provide permanent bond between base slab and applied cementitious materials.
  3. Float Finish: Both equipment pads, and slabs to receive non-cementitious materials, except as specified.
    - a. Screen and float to smooth dense finish.
    - b. After first floating, while surface is still soft, check surfaces for alignment using straightedge or template. Correct high spots by cutting down with trowel or similar tool. Correct low spots by filling in with material same composition as floor finish. Remove any surface projections on floated finish by rubbing or dry grinding. Refloat slab to uniform sandy texture.

4. Steel Trowel Finish: Applied toppings, concrete surfaces to receive resilient floor covering or carpet, future floor roof and other monolithic concrete floor slabs exposed to view without other finish indicated or specified.
  - a. Delay final steel troweling to secure smooth, dense surface, usually when surface can no longer be dented by fingers. During final troweling, tilt steel trowel at slight angle and exert heavy pressure on trowel to compact cement paste and form dense, smooth surface.
  - b. Finished surface: Free from trowel marks. Uniform in texture and appearance.
5. Finished Slab Flatness (FF) and Levelness (FL):
  - a. Slab on Grade: Specified overall value FF 25/FL 20. Minimum local value FF 17/FL 15.
  - b. Test flatness and levelness according to ASTM E1155.

### **3.9 SURFACE TREATMENTS**

- A. Mix and apply the following surface treatments according to manufacturer's instructions.
  1. When manufacturer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.
- B. Liquid Densifier/Sealer: Use for exposed concrete floors and concrete floors to receive carpeting.

### **3.10 APPLIED TOPPING**

- A. Install concrete topping with thickness and strength shown with only enough water to ensure stiff, workable, plastic mix.
- B. Continuously place applied topping until entire area is complete, struck off with straightedge, compact by rolling or tamping, float and steel trowel to hard smooth finish.

### **3.11 RESURFACING FLOORS**

- A. Remove existing flooring by abrasive blasting or grinding, in areas to receive resurfacing, to expose existing structural slab. Achieve a surface profile of 2 to 4 according to ICRI 310.2R for the condition found at Site.
- B. Prepare exposed structural slab surface by cleaning, wetting, and applying adhesive according to manufacturer's instructions as specified in the flooring section.

- - E N D - -

**SECTION 05 50 00  
METAL FABRICATIONS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies items and assemblies fabricated from structural steel shapes and other materials as shown and specified.
- B. Items specified.
  - 1. Support for Wall and Ceiling Mounted Items: (SD055000-02, SD102600-01, SD123100-01 & SD123100-02)
  - 2. Support framing for swing-up grab bars.

**1.2 RELATED WORK**

- A. Colors, Finishes, and Textures: Section 09 06 00, SCHEDULE FOR FINISHES.
- B. Prime and Finish Painting: Section 09 91 00, PAINTING.

**1.3 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings:
  - 1. Each item specified, showing complete detail, location in the project, material and size of components, method of joining various components and assemblies, finish, and location, size and type of anchors.
  - 2. Mark items requiring field assembly for erection identification and furnish erection drawings and instructions.
  - 3. Provide templates and rough-in measurements as required.
- C. Manufacturer's Certificates:
  - 1. Anodized finish as specified.
  - 2. Live load designs as specified.
- D. Design Calculations for specified live loads including dead loads.
- E. Furnish setting drawings and instructions for installation of anchors to be preset into concrete and masonry work, and for the positioning of items having anchors to be built into concrete or masonry construction.

**1.4 QUALITY ASSURANCE**

- A. Each manufactured product shall meet, as a minimum, the requirements specified, and shall be a standard commercial product of a manufacturer regularly presently manufacturing items of type specified.

- B. Each product type shall be the same and be made by the same manufacturer.
- C. Assembled product to the greatest extent possible before delivery to the site.
- D. Include additional features, which are not specifically prohibited by this specification, but which are a part of the manufacturer's standard commercial product.

#### 1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):
  - B18.6.1-97.....Wood Screws
  - B18.2.2-87(R2005).....Square and Hex Nuts
- C. American Society for Testing and Materials (ASTM):
  - A36/A36M-12.....Structural Steel
  - A47-99(R2009).....Malleable Iron Castings
  - A48-03(R2012).....Gray Iron Castings
  - A53-12.....Pipe, Steel, Black and Hot-Dipped, Zinc-Coated  
Welded and Seamless
  - A123-12.....Zinc (Hot-Dip Galvanized) Coatings on Iron and  
Steel Products
  - A240/A240M-14.....Standard Specification for Chromium and  
Chromium-Nickel Stainless Steel Plate, Sheet  
and Strip for Pressure Vessels and for General  
Applications.
  - A269-10.....Seamless and Welded Austenitic Stainless Steel  
Tubing for General Service
  - A307-12.....Carbon Steel Bolts and Studs, 60,000 PSI  
Tensile Strength
  - A391/A391M-07(R2012)....Grade 80 Alloy Steel Chain
  - A786/A786M-09.....Rolled Steel Floor Plate
  - B221-13.....Aluminum and Aluminum-Alloy Extruded Bars,  
Rods, Wire, Shapes, and Tubes
  - B456-11.....Electrodeposited Coatings of Copper Plus Nickel  
Plus Chromium and Nickel Plus Chromium
  - B632-08.....Aluminum-Alloy Rolled Tread Plate

- C1107-13.....Packaged Dry, Hydraulic-Cement Grout  
(Nonshrink)
- D3656-13.....Insect Screening and Louver Cloth Woven from  
Vinyl-Coated Glass Yarns
- F436-11.....Hardened Steel Washers
- F468-06(R2012).....Nonferrous Bolts, Hex Cap Screws, Socket Head  
Cap Screws and Studs for General Use
- F593-13.....Stainless Steel Bolts, Hex Cap Screws, and  
Studs
- F1667-11.....Driven Fasteners: Nails, Spikes and Staples
- D. American Welding Society (AWS):
- D1.1-10.....Structural Welding Code Steel
- D1.2-08.....Structural Welding Code Aluminum
- D1.3-08.....Structural Welding Code Sheet Steel
- E. National Association of Architectural Metal Manufacturers (NAAMM)
- AMP 521-01.....Pipe Railing Manual
- AMP 500-06.....Metal Finishes Manual
- MBG 531-09.....Metal Bar Grating Manual
- MBG 532-09.....Heavy Duty Metal Bar Grating Manual
- F. Structural Steel Painting Council (SSPC)/Society of Protective  
Coatings:
- SP 1-04.....No. 1, Solvent Cleaning
- SP 2-04.....No. 2, Hand Tool Cleaning
- SP 3-04.....No. 3, Power Tool Cleaning
- G. Federal Specifications (Fed. Spec):
- RR-T-650E.....Treads, Metallic and Nonmetallic, Nonskid

## **PART 2 - PRODUCTS**

### **2.1 MATERIALS**

- A. Structural Steel: ASTM A36.
- B. Stainless Steel: ASTM A240, Type 302 or 304.
- C. Aluminum, Extruded: ASTM B221, Alloy 6063-T5 unless otherwise  
specified. For structural shapes use alloy 6061-T6 and alloy  
6061-T4511.
- D. Cast-Iron: ASTM A48, Class 30, commercial pattern.
- E. Malleable Iron Castings: A47.
- F. Primer Paint: As specified in Section 09 91 00, PAINTING.
- G. Stainless Steel Tubing: ASTM A269, type 302 or 304.
- H. Grout: ASTM C1107, pourable type.

## 2.2 HARDWARE

### A. Rough Hardware:

1. Furnish rough hardware with a standard plating, applied after punching, forming and assembly of parts; galvanized, cadmium plated, or zinc-coated by electro-galvanizing process. Galvanized G-90 where specified.

### B. Fasteners:

#### 1. Bolts with Nuts:

- a. ASME B18.2.2.
- b. ASTM A307 for 415 MPa (60,000 psi) tensile strength bolts.
- c. ASTM F468 for nonferrous bolts.
- d. ASTM F593 for stainless steel.

#### 2. Screws: ASME B18.6.1.

#### 3. Washers: ASTM F436, type to suit material and anchorage.

#### 4. Nails: ASTM F1667, Type I, style 6 or 14 for finish work.

## 2.3 FABRICATION GENERAL

### A. Material

1. Use material as specified. Use material of commercial quality and suitable for intended purpose for material that is not named or its standard of quality not specified.
2. Use material free of defects which could affect the appearance or service ability of the finished product.

### B. Size:

1. Size and thickness of members as shown.
2. When size and thickness is not specified or shown for an individual part, use size and thickness not less than that used for the same component on similar standard commercial items or in accordance with established shop methods.

### C. Connections

1. Except as otherwise specified, connections may be made by welding, riveting or bolting.
2. Field riveting will not be approved.
3. Design size, number and placement of fasteners, to develop a joint strength of not less than the design value.
4. Holes, for rivets and bolts: Accurately punched or drilled and burrs removed.

5. Size and shape welds to develop the full design strength of the parts connected by welds and to transmit imposed stresses without permanent deformation or failure when subject to service loadings.
6. Use Rivets and bolts of material selected to prevent corrosion (electrolysis) at bimetallic contacts. Plated or coated material will not be approved.
7. Use stainless steel connectors for removable members machine screws or bolts.

#### D. Fasteners and Anchors

1. Use methods for fastening or anchoring metal fabrications to building construction as shown or specified.
2. Where fasteners and anchors are not shown, design the type, size, location and spacing to resist the loads imposed without deformation of the members or causing failure of the anchor or fastener, and suit the sequence of installation.
3. Use material and finish of the fasteners compatible with the kinds of materials which are fastened together and their location in the finished work.
4. Fasteners for securing metal fabrications to new construction only, may be by use of threaded or wedge type inserts or by anchors for welding to the metal fabrication for installation before the concrete is placed or as masonry is laid.
5. Fasteners for securing metal fabrication to existing construction or new construction may be expansion bolts, toggle bolts, power actuated drive pins, welding, self-drilling and tapping screws or bolts.

#### E. Workmanship

1. General:
  - a. Fabricate items to design shown.
  - b. Furnish members in longest lengths commercially available within the limits shown and specified.
  - c. Fabricate straight, true, free from warp and twist, and where applicable square and in same plane.
  - d. Provide holes, sinkages and reinforcement shown and required for fasteners and anchorage items.
  - e. Provide openings, cut-outs, and tapped holes for attachment and clearances required for work of other trades.
  - f. Prepare members for the installation and fitting of hardware.

- g. Cut openings in gratings and floor plates for the passage of ducts, sumps, pipes, conduits and similar items. Provide reinforcement to support cut edges.
  - h. Fabricate surfaces and edges free from sharp edges, burrs and projections which may cause injury.
2. Welding:
- a. Weld in accordance with AWS.
  - b. Welds shall show good fusion, be free from cracks and porosity and accomplish secure and rigid joints in proper alignment.
  - c. Where exposed in the finished work, continuous weld for the full length of the members joined and have depressed areas filled and protruding welds finished smooth and flush with adjacent surfaces.
  - d. Finish welded joints to match finish of adjacent surface.
3. Joining:
- a. Miter or butt members at corners.
  - b. Where frames members are butted at corners, cut leg of frame member perpendicular to surface, as required for clearance.
4. Anchors:
- a. Where metal fabrications are shown to be preset in concrete, weld 32 x 3 mm (1-1/4 by 1/8 inch) steel strap anchors, 150 mm (6 inches) long with 25 mm (one inch) hooked end, to back of member at 600 mm (2 feet) on center, unless otherwise shown.
  - b. Where metal fabrications are shown to be built into masonry use 32 x 3 mm (1-1/4 by 1/8 inch) steel strap anchors, 250 mm (10 inches) long with 50 mm (2 inch) hooked end, welded to back of member at 600 mm (2 feet) on center, unless otherwise shown.
5. Cutting and Fitting:
- a. Accurately cut, machine and fit joints, corners, copes, and miters.
  - b. Fit removable members to be easily removed.
  - c. Design and construct field connections in the most practical place for appearance and ease of installation.
  - d. Fit pieces together as required.
  - e. Fabricate connections for ease of assembly and disassembly without use of special tools.
  - f. Joints firm when assembled.



- g. Conceal joining, fitting and welding on exposed work as far as practical.
  - h. Do not show rivets and screws prominently on the exposed face.
  - i. The fit of components and the alignment of holes shall eliminate the need to modify component or to use exceptional force in the assembly of item and eliminate the need to use other than common tools.
- F. Finish:
- 1. Finish exposed surfaces in accordance with NAAMM AMP 500 Metal Finishes Manual.
  - 2. Aluminum: NAAMM AMP 501.
    - a. Mill finish, AA-M10, as fabricated, use unless specified otherwise.
    - b. Clear anodic coating, AA-C22A41, chemically etched medium matte, with Architectural Class 1, 0.7 mils or thicker.
    - c. Colored anodic coating, AA-C22A42, chemically etched medium matte with Architectural Class 1, 0.7 mils or thicker.
    - d. Painted: AA-C22R10.
  - 3. Steel and Iron: NAAMM AMP 504.
    - a. Zinc coated (Galvanized): ASTM A123, G90 unless noted otherwise.
    - b. Surfaces exposed in the finished work:
      - 1) Finish smooth rough surfaces and remove projections.
      - 2) Fill holes, dents and similar voids and depressions with epoxy type patching compound.
    - c. Shop Prime Painting:
      - 1) Surfaces of Ferrous metal:
        - a) Items not specified to have other coatings.
        - b) Galvanized surfaces specified to have prime paint.
        - c) Remove all loose mill scale, rust, and paint, by hand or power tool cleaning as defined in SSPC-SP2 and SP3.
        - d) Clean of oil, grease, soil and other detrimental matter by use of solvents or cleaning compounds as defined in SSPC-SP1.
        - e) After cleaning and finishing apply one coat of primer as specified in Section 09 91 00, PAINTING.
      - 2) Non-ferrous metals: Comply with MAAMM-500 series.
  - 4. Stainless Steel: NAAMM AMP-504 Finish No. 4.

## G. Protection:

1. Insulate aluminum surfaces that will come in contact with concrete, masonry, plaster, or metals other than stainless steel, zinc or white bronze by giving a coat of heavy-bodied alkali resisting bituminous paint or other approved paint in shop.
2. Spot prime all abraded and damaged areas of zinc coating which expose the bare metal, using zinc rich paint on hot-dip zinc coat items and zinc dust primer on all other zinc coated items.

**2.4 SUPPORTS**

## A. General:

1. Fabricate ASTM A36 structural steel shapes as shown.
2. Use clip angles or make provisions for welding hangers and braces to overhead construction.
3. Field connections may be welded or bolted.

## B. For Wall Mounted Items:

1. For items supported by metal stud partitions.
2. Steel strip or hat channel minimum of 1.5 mm (0.0598 inch) thick.
3. Steel strip minimum of 150 mm (6 inches) wide, length extending one stud space beyond end of item supported.
4. Steel hat channels where shown. Flange cut and flattened for anchorage to stud.
5. Structural steel tube or channel for grab bar at water closets floor to structure above with clip angles or end plates formed for anchors.
6. Use steel angles for thru wall counters. Drill angle for fasteners at ends and not over 100 mm (4 inches) on center between ends.

## C. For Cubical Curtain Track:

1. Fabricate assembly of steel angle as shown.
2. Drill angle bent ends for anchor screws to acoustical suspension system and angle for hanger wires.
3. Provide pipe sleeve welded to angle.

**PART 3 - EXECUTION****3.1 INSTALLATION, GENERAL**

- A. Set work accurately, in alignment and where shown, plumb, level, free of rack and twist, and set parallel or perpendicular as required to line and plane of surface.

- B. Items set into concrete or masonry.
  - 1. Provide temporary bracing for such items until concrete or masonry is set.
  - 2. Place in accordance with setting drawings and instructions.
  - 3. Build strap anchors, into masonry as work progresses.
- C. Set frames of gratings, covers, corner guards, trap doors and similar items flush with finish floor or wall surface and, where applicable, flush with side of opening.
- D. Field weld in accordance with AWS.
  - 1. Design and finish as specified for shop welding.
  - 2. Use continuous weld unless specified otherwise.
- E. Install anchoring devices and fasteners as shown and as necessary for securing metal fabrications to building construction as specified. Power actuated drive pins may be used except for removable items and where members would be deformed or substrate damaged by their use.
- F. Spot prime all abraded and damaged areas of zinc coating as specified and all abraded and damaged areas of shop prime coat with same kind of paint used for shop priming.
- G. Isolate aluminum from dissimilar metals and from contact with concrete and masonry materials as required to prevent electrolysis and corrosion.
- H. Secure escutcheon plate with set screw.

### **3.2 INSTALLATION OF SUPPORTS**

- A. Anchorage to structure.
  - 1. Secure angles or channels and clips to overhead structural steel by continuous welding unless bolting is shown.
  - 2. Secure supports to concrete inserts by bolting or continuous welding as shown.
  - 3. Secure supports to mid height of concrete beams when inserts do not exist with expansion bolts and to slabs, with expansion bolts. unless shown otherwise.
  - 4. Secure steel plate or hat channels to studs as detailed.
- B. Supports for Wall Mounted items:
  - 1. Locate center of support at anchorage point of supported item.
  - 2. Locate support at top and bottom of wall hung cabinets.
  - 3. Locate support at top of floor cabinets and shelving installed against walls.
  - 4. Locate supports where required for items shown.

C. Supports for Cubicle Curtain Track:

1. Install assembly where shown after ceiling suspension grid is installed.
2. Drill angle for bolt and weld nut to angle prior to installation of tile.

D. Support for cantilever grab bars:

1. Locate channels or tube in partition for support as shown, and extend full height from floor to underside of structural slab above.
2. Anchor at top and bottom with angle clips bolted to channels or tube with two, 9 mm (3/8 inch) diameter bolts.
3. Anchor to floors and overhead construction with two 9 mm (3/8 inch) diameter bolts.
4. Fasten clips to concrete with expansion bolts, and to steel with machine bolts or welds.

**3.3 STEEL COMPONENTS FOR MILLWORK ITEMS**

Coordinate and deliver to Millwork fabricator for assembly where millwork items are secured to metal fabrications.

**3.4 CLEAN AND ADJUSTING**

- A. Adjust movable parts including hardware to operate as designed without binding or deformation of the members centered in the opening or frame and, where applicable, contact surfaces fit tight and even without forcing or warping the components.
- B. Clean after installation exposed prefinished and plated items and items fabricated from stainless steel, aluminum and copper alloys, as recommended by the metal manufacture and protected from damage until completion of the project.

- - - E N D - - -

**SECTION 06 10 00  
ROUGH CARPENTRY**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies wood blocking and nailers.

**1.2 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings showing framing connection details, fasteners, connections and dimensions.
- C. Manufacturer's Literature and Data:
1. Submit data for lumber, panels, hardware and adhesives.
  2. Submit data for wood-preservative treatment from chemical treatment manufacturer and certification from treating plants that treated materials comply with requirements. Indicate type of preservative used and net amount of preservative retained.
  3. Submit data for fire retardant treatment from chemical treatment manufacturer and certification by treating plant that treated materials comply with requirements. Include physical properties of treated materials based on testing by a qualified independent testing agency.
  4. For products receiving a waterborne treatment, submit statement that moisture content of treated materials was reduced to levels specified before shipment to project site.
- D. Manufacturer's certificate for unmarked lumber.

**1.3 PRODUCT DELIVERY, STORAGE AND HANDLING**

- A. Protect lumber and other products from dampness both during and after delivery at site.
- B. Pile lumber in stacks in such manner as to provide air circulation around surfaces of each piece.
- C. Stack plywood and other board products so as to prevent warping.
- D. Locate stacks on well drained areas, supported at least 152 mm (6 inches) above grade and cover with well-ventilated sheds having firmly constructed over hanging roof with sufficient end wall to protect lumber from driving rain.

**1.4 QUALITY ASSURANCE**

- A. Installer: A firm with a minimum of three (3) years' experience in the type of work required by this section.

**1.5 GRADING AND MARKINGS**

- A. Any unmarked lumber or plywood panel for its grade and species will not be allowed on VA Construction sites for lumber and material not normally grade marked, provide manufacturer's certificates (approved by an American Lumber Standards approved agency) attesting that lumber and material meet the specified the specified requirements.

**1.6 APPLICABLE PUBLICATIONS**

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in the text by basic designation only.
- B. American Forest and Paper Association (AFPA):
  - NDS-15.....National Design Specification for Wood Construction
  - WCD1-01.....Details for Conventional Wood Frame Construction
- C. American Institute of Timber Construction (AITC):
  - A190.1-07.....Structural Glued Laminated Timber
- D. American Society of Mechanical Engineers (ASME):
  - B18.2.1-12(R2013).....Square and Hex Bolts and Screws
  - B18.2.2-10.....Square and Hex Nuts
  - B18.6.1-81(R2008).....Wood Screws
- E. American Plywood Association (APA):
  - E30-11.....Engineered Wood Construction Guide
- F. ASTM International (ASTM):
  - A653/A653M-13.....Steel Sheet Zinc-Coated (Galvanized) or Zinc-Iron Alloy Coated (Galvannealed) by the Hot Dip Process
  - C954-11.....Steel Drill Screws for the Application of Gypsum Board or Metal Plaster Bases to Steel Studs from 0.033 inch (2.24 mm) to 0.112-inch (2.84 mm) in thickness
  - C1002-14.....Steel Self-Piercing Tapping Screws for the Application of Gypsum Panel Products or Metal Plaster Bases to Wood Studs or Metal Studs

- D198-14.....Test Methods of Static Tests of Lumber in  
Structural Sizes
- D2344/D2344M-13.....Test Method for Short-Beam Strength of Polymer  
Matrix Composite Materials and Their Laminates
- D2559-12a.....Adhesives for Structural Laminated Wood  
Products for Use Under Exterior (Wet Use)  
Exposure Conditions
- D3498-03(R2011).....Adhesives for Field-Gluing Plywood to Lumber  
Framing for Floor Systems
- D6108-13.....Test Method for Compressive Properties of  
Plastic Lumber and Shapes
- D6109-13.....Test Methods for Flexural Properties of  
Unreinforced and Reinforced Plastic Lumber and  
Related Products
- D6111-13a.....Test Method for Bulk Density and Specific  
Gravity of Plastic Lumber and Shapes by  
Displacement
- D6112-13.....Test Methods for Compressive and Flexural Creep  
and Creep-Rupture of Plastic Lumber and Shapes
- F844-07a(R2013).....Washers, Steel, Plan (Flat) Unhardened for  
General Use
- F1667-13.....Nails, Spikes, and Staples
- G. American Wood Protection Association (AWPA):  
AWPA Book of Standards
- H. Commercial Item Description (CID):  
A-A-55615.....Shield, Expansion (Wood Screw and Lag Bolt Self  
Threading Anchors)
- I. Forest Stewardship Council (FSC):  
FSC-STD-01-001(Ver. 4-0)FSC Principles and Criteria for Forest  
Stewardship
- J. Military Specification (Mil. Spec.):  
MIL-L-19140E.....Lumber and Plywood, Fire-Retardant Treated
- K. Environmental Protection Agency (EPA):  
40 CFR 59(2014).....National Volatile Organic Compound Emission  
Standards for Consumer and Commercial Products
- L. Truss Plate Institute (TPI):  
TPI-85.....Metal Plate Connected Wood Trusses

- M. U.S. Department of Commerce Product Standard (PS)
  - PS 1-95.....Construction and Industrial Plywood
  - PS 20-10.....American Softwood Lumber Standard
- N. ICC Evaluation Service (ICC ES):
  - AC09.....Quality Control of Wood Shakes and Shingles
  - AC174.....Deck Board Span Ratings and Guardrail Systems  
(Guards and Handrails)

## **PART 2 - PRODUCTS**

### **2.1 LUMBER**

- A. Unless otherwise specified, each piece of lumber must bear grade mark, stamp, or other identifying marks indicating grades of material, and rules or standards under which produced.
  - 1. Identifying marks are to be in accordance with rule or standard under which material is produced, including requirements for qualifications and authority of the inspection organization, usage of authorized identification, and information included in the identification.
  - 2. Inspection agency for lumber approved by the Board of Review, American Lumber Standards Committee, to grade species used.
- B. Structural Members: Species and grade as listed in the AFPA NDS having design stresses as shown.
- C. Lumber Other Than Structural:
  - 1. Unless otherwise specified, species graded under the grading rules of an inspection agency approved by Board of Review, American Lumber Standards Committee.
  - 2. Furring, blocking, nailers and similar items 101 mm (4 inches) and narrower Standard Grade; and, members 152 mm (6 inches) and wider, Number 2 Grade.
- D. Sizes:
  - 1. Conforming to PS 20.
  - 2. Size references are nominal sizes, unless otherwise specified, actual sizes within manufacturing tolerances allowed by standard under which produced.



E. Moisture Content:

1. Maximum moisture content of wood products is to be as follows at the time of delivery to site.
  - a. Boards and Lumber 50 mm (2 inches) and Less in Thickness: 19 percent or less.
  - b. Lumber Over 50 mm (2 inches) Thick: 25 percent or less.

F. Fire Retardant Treatment:

1. Comply with Mil Spec. MIL-L-19140.
2. Treatment and performance inspection, by an independent and qualified testing agency that establishes performance ratings.

G. Preservative Treatment:

1. Do not treat Heart Redwood and Western Red Cedar.
2. Treat wood members and plywood exposed to weather or in contact with plaster, masonry or concrete, including framing of open roofed structures; sills, sole plates, furring, and sleepers that are less than 610 mm (24 inches) from ground; nailers, edge strips, blocking, crickets, curbs, cant, vent strips and other members provided in connection with roofing and flashing materials.
3. Treat other members specified as preservative treated (PT).
4. Preservative treat by the pressure method complying with AWPA Book use category system standards U1 and T1, except any process involving the use of Chromated Copper Arsenate (CCA) or other agents classified as carcinogenic for pressure treating wood is not permitted.

## 2.2 PLYWOOD

- A. Comply with PS 1.
- B. Bear the mark of a recognized association or independent inspection agency that maintains continuing control over quality of plywood which identifies compliance by veneer grade, group number, span rating where applicable, and glue type.

## 2.3 ROUGH HARDWARE AND ADHESIVES

A. Anchor Bolts:

1. ASME B18.2.1 and ASME B18.2.2 galvanized, 13 mm (1/2 inch) unless shown otherwise.
2. Extend at least 203 mm (8 inches) into masonry or concrete with ends bent 50 mm (2 inches).

B. Miscellaneous Bolts: Expansion Bolts: C1D A-A-55615; lag bolt, long enough to extend at least 65 mm (2-1/2 inches) into masonry or concrete. Provide 13 mm (1/2 inch) bolt unless shown otherwise.

C. Washers:

1. ASTM F844.
2. Provide zinc or cadmium coated steel or cast iron for washers exposed to weather.

D. Screws:

1. Wood to Wood: ASME B18.6.1 or ASTM C1002.
2. Wood to Steel: ASTM C954, or ASTM C1002.

E. Nails:

1. Size and type best suited for purpose unless noted otherwise. Provide aluminum-alloy nails, plated nails, or zinc-coated nails, for nailing wood work exposed to weather and on roof blocking.
2. ASTM F1667:
  - a. Common: Type I, Style 10.
  - b. Concrete: Type I, Style 11.
  - c. Barbed: Type I, Style 26.
  - d. Underlayment: Type I, Style 25.
  - e. Masonry: Type I, Style 27.
  - f. Provide special nails designed for use with ties, strap anchors, framing connectors, joists hangers, and similar items. Nails not less than 32 mm (1-1/4 inches) long, 8d and deformed or annular ring shank.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION OF FRAMING AND MISCELLANEOUS WOOD MEMBERS**

A. Conform to applicable requirements of the following:

1. AFPA NDS for timber connectors.
2. AITC A190.1 Timber Construction Manual for heavy timber construction.
3. AFPA WCD1 for nailing and framing unless specified otherwise.
4. APA for installation of plywood or structural use panels.

## B. Fasteners:

## 1. Nails.

- a. Nail in accordance with the Recommended Nailing Schedule as specified in AFPA WCD1 where detailed nailing requirements are not specified in nailing schedule. Select nail size and nail spacing sufficient to develop adequate strength for the connection without splitting the members.
- b. Use special nails with framing connectors.
- c. For sheathing and subflooring, select length of nails sufficient to extend 25 mm (1 inch) into supports.
- d. Use 8d or larger nails for nailing through 25 mm (1 inch) thick lumber and for toe nailing 50 mm (2 inch) thick lumber.
- e. Use 16d or larger nails for nailing through 50 mm (2 inch) thick lumber.
- f. Select the size and number of nails in accordance with the Nailing Schedule except for special nails with framing anchors.

## 2. Bolts:

- a. Fit bolt heads and nuts bearing on wood with washers.
- b. Countersink bolt heads flush with the surface of nailers.
- c. Embed in concrete and solid masonry or provide expansion bolts. Special bolts or screws designed for anchor to solid masonry or concrete in drilled holes may be used.
- d. Provide toggle bolts to hollow masonry or sheet metal.
- e. Provide bolts to steel over 2.84 mm (0.112 inch, 11 gage) in thickness. Secure wood nailers to vertical structural steel members with bolts, placed one at ends of nailer and 610 mm (24 inch) intervals between end bolts. Provide clips to beam flanges.

## 3. Drill Screws to steel less than 2.84 mm (0.112 inch) thick.

- a. ASTM C1002 for steel less than 0.84 mm (0.033 inch) thick.
- b. ASTM C954 for steel over 0.84 mm (0.033 inch) thick.

## 4. Power actuated drive pins may be provided where practical to anchor to solid masonry, concrete, or steel.

## 5. Do not anchor to wood plugs or nailing blocks in masonry or concrete. Provide metal plugs, inserts or similar fastening.

6. Screws to Join Wood:
  - a. Where shown or option to nails.
  - b. ASTM C1002, sized to provide not less than 25 mm (1 inch) penetration into anchorage member.
  - c. Spaced same as nails.
- C. Cut notch, or bore in accordance with AFPA WCD1 passage of ducts wires, bolts, pipes, conduits and to accommodate other work. Repair or replace miscut, misfit or damaged work.
- D. Blocking Nailers, and Furring:
  1. Install furring, blocking, nailers, and grounds where shown.
  2. Provide longest lengths practicable.
  3. Provide fire retardant treated wood blocking where shown at openings and where shown or specified.
  4. Layers of Blocking or Plates:
    - a. Stagger end joints between upper and lower pieces.
    - b. Nail at ends and not over 610 mm (24 inches) between ends.
    - c. Stagger nails from side to side of wood member over 127 mm (5 inches) in width.
- E. Blocking:
  1. All blocking shall be 2" x 12" fire treated wood.

- - - E N D - - -

**SECTION 06 20 00  
FINISH CARPENTRY**

**PART 1 - GENERAL**

**1.1 SUMMARY**

- A. Items Specified:
  - 1. Window Sills

**1.2 RELATED REQUIREMENTS**

- A. Woodwork Finish and Color: Section 09 06 00, SCHEDULE FOR FINISHES.
- B. Fabricated Metal Brackets, Bench Supports and Countertop Legs: Section 05 50 00, METAL FABRICATIONS.
- C. Framing, Furring and Blocking: Section 06 10 00, ROUGH CARPENTRY.
- D. Color and Texture of Finish: Refer to Finish Legend.
- E. Stock Casework: Section 12 32 00, MANUFACTURED WOOD CASEWORK.
- F. Other Countertops: Division 11, EQUIPMENT and Division 12, FURNISHINGS.
- G. Electrical Light Fixtures and Duplex Outlets: Division 26, ELECTRICAL.

**1.3 APPLICABLE PUBLICATIONS**

- A. Comply with references to extent specified in this section.
- B. ASTM International:
  - 1. A36/A36M-14 - Carbon Structural Steel.
  - 2. A53/A53M-12 - Pipe, Steel, Black and Hot-Dipped Zinc Coated, Welded and Seamless.
  - 3. A240/A240M-15b - Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and for General Applications.
  - 4. B26/B26M-14e1 - Aluminum-Alloy Sand Castings.
  - 5. B221-14 - Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes.
  - 6. E84-15b - Surface Burning Characteristics of Building Materials.
- C. American Hardboard Association (AHA):
  - 1. A135.4-04 - Basic Hardboard.
- D. Architectural Woodwork Institute (AWI):
  - 1. AWI-09 - Architectural Woodwork Quality Standards and Quality Certification Program.
- E. Builders Hardware Manufacturers Association (BHMA):
  - 1. A156.9-10 - Cabinet Hardware.
  - 2. A156.11-14 - Cabinet Locks.
  - 3. A156.16-13 - Auxiliary Hardware.

- F. Federal Specifications (Fed. Spec.):
  - 1. A-A-1922A - Shield Expansion (Calking Anchors, Single Lead).
  - 2. A-A-1936A - Adhesive, Contact, Neoprene Rubber.
  - 3. FF-N-836E- Nut: Square, Hexagon, Cap, Slotted, Castle, Knurled, Welding.
  - 4. FF-S-111D(1) - Screw, Wood (Notice 1 inactive for new design).
  - 5. MM-L-736C(1) - Lumber, Hardwood.
- G. Hardwood Plywood and Veneer Association (HPVA):
  - 1. HP1-09 - Hardwood and Decorative Plywood.
- H. Military Specification (Mil. Spec):
  - 1. MIL-L-19140E - Lumber and Plywood, Fire-Retardant Treated.
- I. National Particleboard Association (NPA):
  - 1. A208.1-09 - Wood Particleboard.
- J. National Electrical Manufacturers Association (NEMA):
  - 1. LD 3-05 - High-Pressure Decorative Laminates.
- K. U.S. Department of Commerce, Product Standard (PS):
  - 1. PS1-07 - Construction and Industrial Plywood.
  - 2. PS20-10 - American Softwood Lumber Standard.

#### **1.4 PREINSTALLATION MEETINGS**

- A. Conduct preinstallation meeting at project site minimum 30 days before beginning Work of this section.
  - 1. Required Participants:
    - a. Contracting Officer's Representative.
    - b. Architect/Engineer.
    - c. Contractor.
    - d. Installer.
  - 2. Meeting Agenda: Distribute agenda to participants minimum 3 days before meeting.
    - a. Installation schedule.
    - b. Installation sequence.
    - c. Preparatory work.
    - d. Protection before, during, and after installation.
    - e. Installation.
    - f. Terminations.
    - g. Transitions and connections to other work.
    - h. Other items affecting successful completion.
  - 3. Document and distribute meeting minutes to participants to record decisions affecting installation.

**1.5 SUBMITTALS**

- A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Submittal Drawings:
  - 1. Show size, configuration, and fabrication and installation details.
  - 2. Millwork Items - Half Full Size Scale for Sections and Details 1: 50 (1/4 inch) for elevations and plans.
- C. Samples:
  - 1. Solid Polymer Window Sill Material: 150 mm (6 inch) square samples each color.
- D. Certificates: Certify each product complies with specifications.
  - 1. Moisture content of materials.
- E. Qualifications: Substantiate qualifications comply with specifications.
  - 1. Fabricator with project experience list.
  - 2. Installer with project experience list.

**1.6 QUALITY ASSURANCE**

- A. Fabricator Qualifications:
  - 1. Regularly fabricates specified products.
  - 2. Fabricated specified products with satisfactory service on five similar installations for minimum five years.
    - a. Project Experience List: Provide contact names and addresses for completed projects.
- B. Installer Qualifications:
  - 1. Regularly installs specified products.
  - 2. Installed specified products with satisfactory service on five similar installations for minimum five years.
    - a. Project Experience List: Provide contact names and addresses for completed projects.

**1.7 DELIVERY, STORAGE AND HANDLING**

- A. Deliver products in manufacturer's original sealed packaging.
- B. Mark packaging, legibly. Indicate manufacturer's name or brand, type, color, production run number, and manufacture date.
- C. Before installation, return or dispose of products within distorted, damaged, or opened packaging.
- D. Store products indoors in dry, weathertight, conditioned facility.
- E. Protect products from damage during handling and construction operations.

**1.8 FIELD CONDITIONS****A. Environment:**

1. Product Temperature: Minimum 21 degrees C (70 degrees F) for minimum 48 hours before installation.
2. Work Area Ambient Conditions: HVAC systems are complete, operational, and maintaining facility design operating conditions continuously, beginning 48 hours before installation until Government occupancy.
3. Install products when building is permanently enclosed and when wet construction is completed, dried, and cured.
4. Do not install finish lumber or millwork in any room or space where wet process systems such as concrete, masonry, or plaster work is not complete and dry.

**B. Field Measurements: Verify field conditions affecting fabrication and installation. Show field measurements on Submittal Drawings.**

1. Coordinate field measurement and fabrication schedule to avoid delay.

**1.9 WARRANTY**

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."

**PART 2 - PRODUCTS****2.1 MATERIALS**

- A. Grading and Marking: Factory mark with grade stamp lumber and plywood of inspection agency approved by the Board of Review, American Lumber Standard Committee.
- B. Lumber:
  1. Sizes:
    - a. Lumber Size references, unless otherwise specified, are nominal sizes, and actual sizes within manufacturing tolerances allowed by the standard under which product is produced.
    - b. Millwork, Standing and Running Trim, and Rails: Actual size as shown or specified.
  2. Hardwood: MM-L-736, species as specified for each item.
  3. Softwood: PS-20, exposed to view appearance grades:
    - a. Use C select or D select, vertical grain for transparent finish including stain transparent finish.
    - b. Use Prime for painted or opaque finish.



4. Use edge grain Wood members exposed to weather.
  5. Moisture Content:
    - a. 32 mm (1-1/4 inches) or Less Nominal Thickness: 12 percent on 85 percent of the pieces and 15 percent on the remainder.
    - b. Other materials: According to standards under which the products are produced.
- C. Plywood:
1. Softwood Plywood: DOC PS1.
    - a. Plywood, 13 mm (1/2 inch) and thicker; minimum five ply construction, except 32 mm (1-1/4 inch) thick plywood minimum seven ply.
    - b. Plastic Laminate Plywood Cores:
      - 1) Exterior Type, and species group.
      - 2) Veneer Grade: A-C.
    - c. Shelving Plywood:
      - 1) Interior Type, any species group.
      - 2) Veneer Grade: A-B.
    - d. Other: As specified for item.
- D. Particleboard: NPA A208.1.
1. Plastic Laminate Particleboard Cores:
    - a. Type 2, Grade 2-M-2, unless otherwise specified.
    - b. Type 1, Grade 1-M-3 shall be used for shelving.
- E. Plastic Laminate: NEMA LD-3.
1. Exposed Laminate Surfaces including Countertops, and Sides of Cabinet Doors: Grade HGL.
  2. Cabinet Interiors including Shelving: NEMA, CLS as a minimum, with the following:
    - a. Plastic laminate clad plywood or particle board.
    - b. Resin impregnated decorative paper thermally fused to particle board.
  3. Plastic Laminate Covered Wood Tops Backing: Grade HGP.
  4. Post-formed Surfaces: Grade HGP.

## F. Solid Polymer (Solid Surface) Material:

1. Filled Methyl Methacrylic Polymer.
2. Performance properties required:

Property	Result	Test
Elongation	0.3% min.	ASTM D638
Hardness	90 Rockwell M	ASTM D785
Gloss (60° Gordon)	5-20	NEMA LD3.1
Color stability	No change	NEMA LD3 except 200 hour
Abrasion resistance	No loss of pattern Max wear depth 0.0762 mm (0.003 in) - 10000 cycles	NEMA LD3
Water absorption weight (5 max)	24 hours 0.9	ASTM D-570
Izod impact	14 N·m/m (0.25 ft-lb/in)	ASTM D256 (Method A)
Impact resistance	No fracture	NEMA LD-3 900 mm (36") drop 1 kg (2 lb.) ball
Boiling water surface resistance	No visible change	NEMA LD3
High temperature resistance	Slight surface dulling	NEMA LD3

3. Cast into sheet form.
4. Color throughout with subtle veining through thickness.
5. Joint adhesive and sealer: Manufacturers silicone adhesive and sealant for joining methyl methacrylic polymer sheet.
6. Bio-based products will be preferred.

## G. Stainless Steel: ASTM A240, Type 302 or 304.

**2.2 PRODUCTS - GENERAL**

- A. Basis of Design: Refer to Finish Legend.
- B. Provide each product from one manufacturer and from one production run.

**2.3 FABRICATION**

- A. General:
  1. AWI Custom Grade for interior millwork.
  2. Finish woodwork, free from pitch pockets.
  3. Trim, standard stock molding and members of same species, except where special profiles are shown.

4. Plywood, minimum 13 mm (1/2 inch), unless otherwise shown on Drawings or specified.
5. Edges of members in contact with concrete or masonry having a square corner caulking rebate.
6. Fabricate members less than 4 m (14 feet) in length from one piece of lumber, back channeled and molded as shown.
7. Fabricate interior trim and items of millwork to be painted from jointed, built-up, or laminated members, unless otherwise shown on Drawings or specified.

B. Windowsills

1. Fabricate in largest sections practicable.
2. Fabricate with joints flush on top surface.
3. Fabricate countertops to profile indicated on drawings.
4. Join edges with a chemical resistant waterproof epoxy cement.

## 2.4 ACCESSORIES

A. Hardware:

1. Rough Hardware:

- a. Provide rough hardware with a standard plating, applied after punching, forming and assembly of parts; galvanized, cadmium plated, or zinc-coated by electric-galvanizing process. Galvanized where specified.

b. Fasteners:

- 1) Bolts with Nuts: FF-N-836.
- 2) Expansion Bolts: A-A-1922A.
- 3) Screws: Fed. Spec. FF-S-111.

B. Adhesive:

1. Interior Millwork: Unextended urea resin, unextended melamine resin, phenol resin, or resorcinol resin.

## PART 3 - EXECUTION

### 3.1 PREPARATION

- A. Examine and verify substrate suitability for product installation.
- B. Protect existing construction and completed work from damage.
- C. Clean substrates. Remove contaminants capable of affecting subsequently installed product's performance.

**3.2 INSTALLATION****A. Installation:**

1. Prime millwork receiving transparent finish and back-paint concealed surfaces.
2. Fasten trim with fine finishing nails, screws, or glue as required.
3. Set nails for putty stopping. Provide washers under bolt heads where no other bearing plate occurs.
4. Seal cut edges of fire retardant treated wood materials with a certified acceptable sealer.
5. Coordinate with plumbing and electrical work for installation of fixtures and service connections in millwork items.
6. Plumb and level items unless shown otherwise.
7. Nail finish at each blocking, lookout, or other nailer and intermediate points; toggle or expansion bolt in place where nails are not suitable.
8. Apply adhesive uniformly for full contact between each contacting surface.

**B. Window Sills**

1. Install per manufacturer's instructions and per drawings.

**3.3 CLEANING**

- A. Remove excess adhesive before adhesive sets.
- B. Clean exposed surfaces. Remove contaminants and stains.
- C. Touch up damaged factory finishes.
  1. Repair painted surfaces with touch up primer.

**3.4 PROTECTION**

- A. Protect finish carpentry from construction operations.
- B. Cover finish carpentry with reinforced kraft paper and plywood or hardboard.
- C. Remove protective materials immediately before acceptance.
- D. Repair damage.

---END---

**SECTION 07 21 13**  
**THERMAL INSULATION**

**PART 1 - GENERAL**

**1.1 SUMMARY**

A. Section Includes:

1. Thermal insulation.
  - a. Board insulation at exterior walls.
2. Acoustical insulation.
  - a. Semi-rigid insulation at interior framed partitions.
  - b. Batt and blanket insulation at interior framed partitions and ceilings.

**1.2 APPLICABLE PUBLICATIONS**

A. Comply with references to extent specified in this section.

B. ASTM International (ASTM):

1. C552-15 - Cellular Glass Thermal Insulation.
2. C553-13 - Mineral Fiber Blanket Thermal Insulation for Commercial and Industrial Applications.
3. C591-15 - Unfaced Preformed Rigid Cellular Polyisocyanurate Thermal Insulation.
4. C612-14 - Mineral Fiber Block and Board Thermal Insulation.
5. C665-12 - Mineral-Fiber Blanket Thermal Insulation for Light Frame Construction and Manufactured Housing.
6. E84-15a - Surface Burning Characteristics of Building Materials.
7. F1667-15 - Driven Fasteners: Nails, Spikes, and Staples.

**1.3 SUBMITTALS**

A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Submittal Drawings:

1. Show insulation type, thickness, and R-value for each location.

C. Manufacturer's Literature and Data:

1. Description of each product.
2. Adhesive indicating manufacturer recommendation for each application.

**1.4 DELIVERY**

- A. Deliver products in manufacturer's original sealed packaging.
- B. Mark packaging, legibly. Indicate manufacturer's name or brand, type, production run number, and manufacture date.
- C. Before installation, return or dispose of products within distorted, damaged, or opened packaging.

**1.5 STORAGE AND HANDLING**

- A. Store products indoors in dry, weathertight facility.
- B. Protect products from damage during handling and construction operations.
- C. Protect foam plastic insulation from UV exposure.

**1.6 WARRANTY**

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."

**PART 2 - PRODUCTS****2.1 INSULATION - GENERAL**

- A. Insulation Thickness:
  - 1. Provide thickness required by R-value shown on drawings.

**2.2 THERMAL INSULATION**

- A. Inside Face of Exterior Wall Insulation:
  - 1. Polyisocyanurate Board: ASTM C591, Type I, with vapor retarder facing; maximum permeance 29 ng/Pa/s/sq. m (0.5 perms).

**2.3 ACOUSTICAL INSULATION**

- A. Semi Rigid, Batts and Blankets:
  - 1. Widths and lengths to fit tight against framing.
  - 2. Mineral Fiber boards: ASTM C553, Type II, flexible, or Type III, semi rigid unfaced.
    - a. Density: nominal 4.5 pound.
  - 3. Mineral Fiber Batt or Blankets: ASTM C665 unfaced.
  - 4. Maximum Surface Burning Characteristics: ASTM E84.
    - a. Flame Spread Rating: 25.
    - b. Smoke Developed Rating: 450.

## **2.4 ACCESSORIES**

### **A. Fasteners:**

1. Staples or Nails: ASTM F1667, zinc-coated, size and type to suit application.
2. Screws: ASTM C954 or ASTM C1002, size and length to suit application with washer minimum 50 mm (2 inches) diameter.
3. Impaling Pins: Steel pins with head minimum 50 mm (2 inches) diameter.
  - a. Length: As required to extend beyond insulation and retain cap washer when washer is placed on pin.
  - b. Adhesive: Type recommended by manufacturer to suit application.

### **B. Insulation Adhesive:**

1. Nonflammable type recommended by insulation manufacturer to suit application.

### **C. Tape:**

1. Pressure sensitive adhesive on one face.

## **PART 3 - EXECUTION**

### **3.1 PREPARATION**

- A. Examine and verify substrate suitability for product installation.
- B. Protect existing construction and completed work from damage.
- C. Clean substrates. Remove contaminants capable of affecting subsequently installed product's performance.

### **3.2 INSTALLATION - GENERAL**

- A. Install products according to manufacturer's instructions and approved submittal drawings.
  1. When manufacturer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.
- B. Install insulation with vapor barrier facing the heated side, unless indicated otherwise.
- C. Install board insulation with joints close and flush, in regular courses, and with end joints staggered.
- D. Install batt and blanket insulation with joints tight. Fill framing voids completely.
- E. Fit insulation tight against adjoining construction and penetrations, unless indicated otherwise.

### 3.3 THERMAL INSULATION

#### A. Inside Face of Exterior Wall Insulation:

1. Location: On interior face of solid masonry and concrete walls, beams, beam soffits, underside of floors, and to face of studs to support interior wall finish where indicated.
2. Bond insulation to solid vertical surfaces with adhesive. Fill joints with adhesive cement.
3. Fasten board insulation to face of studs with screws, nails or staples. Space fastenings maximum 300 mm (12 inches) on center. Stagger fasteners at board joints. Install fasteners at each corner.

### 3.4 ACOUSTICAL INSULATION

#### A. General:

1. Install insulation without voids.
2. Pack insulation around door frames and windows, in building expansion joints, door soffits, and other voids.
3. Pack behind outlets, around pipes, ducts, and services encased in walls.
4. Hold insulation in place with pressure sensitive tape.
5. Lap facer flanges together over framing for continuous surface. Seal all penetrations through the insulation and facers.
6. Do not compress insulation below required thickness except where embedded items prevent required thickness.

#### B. Semi-Rigid, Batts and Blankets:

1. When insulation is not full thickness of cavity, adhere insulation to one side of cavity, maintaining continuity of insulation and covering penetrations or embedment.
  - a. Metal Framing:
    - 1) Fasten insulation between metal framing with pressure sensitive tape continuous along flanged edges.
    - 2) At metal framing or ceilings suspension systems, install blanket insulation above suspended ceilings or metal framing at right angles to the main runners or framing.
    - 3) Tape insulation tightly together so no gaps occur and metal framing members are covered by insulation.

### 3.5 CLEANING

- #### A. Remove excess adhesive before adhesive sets.



**3.6 PROTECTION**

- A. Protect insulation from construction operations.
- B. Repair damage.

- - E N D - -



**SECTION 07 92 00  
JOINT SEALANTS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section covers interior and exterior sealant and their application, wherever required for complete installation of building materials or systems.

**1.2 RELATED WORK (INCLUDING BUT NOT LIMITED TO THE FOLLOWING)**

- A. Sound Rated Gypsum Partitions/Sound Sealants: Section 09 29 00, GYPSUM BOARD.
- B. Mechanical Work: Section 21 05 11, COMMON WORK RESULTS FOR FIRE SUPPRESSION; Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING; Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

**1.3 QUALITY ASSURANCE**

- A. Installer Qualifications: An experienced installer with a minimum of three (3) years' experience and who has specialized in installing joint sealants similar in material, design, and extent to those indicated for this Project and whose work has resulted in joint-sealant installations with a record of successful in-service performance. Submit qualification.
- B. Source Limitations: Obtain each type of joint sealant through one (1) source from a single manufacturer.
- C. Product Testing: Obtain test results from a qualified testing agency based on testing current sealant formulations within a 12-month period.
1. Testing Agency Qualifications: An independent testing agency qualified according to ASTM C1021.
  2. Test elastomeric joint sealants for compliance with requirements specified by reference to ASTM C920, and where applicable, to other standard test methods.
  3. Test elastomeric joint sealants according to SWRI's Sealant Validation Program for compliance with requirements specified by reference to ASTM C920 for adhesion and cohesion under cyclic movement, adhesion-in peel, and indentation hardness.
  4. Test other joint sealants for compliance with requirements indicated by referencing standard specifications and test methods.

- D. Lab Tests: Submit samples of materials that will be in contact or affect joint sealants to joint sealant manufacturers for tests as follows:
1. Adhesion Testing: Before installing elastomeric sealants, test their adhesion to protect joint substrates according to the method in ASTM C794 to determine if primer or other specific joint preparation techniques are required.
  2. Compatibility Testing: Before installing elastomeric sealants, determine compatibility when in contact with glazing and gasket materials.
  3. Stain Testing: Perform testing per ASTM C1248 on interior and exterior sealants to determine if sealants or primers will stain adjacent surfaces. No sealant work is to start until results of these tests have been submitted to the Contracting Officer Representative (COR) and the COR has given written approval to proceed with the work.

#### **1.4 CERTIFICATION**

- A. Contractor is to submit to the COR written certification that joints are of the proper size and design, that the materials supplied are compatible with adjacent materials and backing, that the materials will properly perform to provide permanent watertight, airtight or vapor tight seals (as applicable), and that materials supplied meet specified performance requirements.

#### **1.5 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Installer qualifications.
- C. Contractor certification.
- D. Manufacturer's installation instructions for each product used.
- E. Cured samples of exposed sealants for each color.
- F. Manufacturer's Literature and Data:
1. Primers
  2. Sealing compound, each type, including compatibility when different sealants are in contact with each other.
- G. Manufacturer warranty.

**1.6 PROJECT CONDITIONS****A. Environmental Limitations:**

1. Do not proceed with installation of joint sealants under following conditions:
  - a. When ambient and substrate temperature conditions are outside limits permitted by joint sealant manufacturer or are below 4.4 degrees C (40 degrees F).
  - b. When joint substrates are wet.

**B. Joint-Width Conditions:**

1. Do not proceed with installation of joint sealants where joint widths are less than those allowed by joint sealant manufacturer for applications indicated.

**C. Joint-Substrate Conditions:**

1. Do not proceed with installation of joint sealants until contaminants capable of interfering with adhesion are removed from joint substrates.

**1.7 DELIVERY, HANDLING, AND STORAGE**

- A. Deliver materials in manufacturers' original unopened containers, with brand names, date of manufacture, shelf life, and material designation clearly marked thereon.
- B. Carefully handle and store to prevent inclusion of foreign materials.
- C. Do not subject to sustained temperatures exceeding 32 degrees C (90 degrees F) or less than 5 degrees C (40 degrees F).

**1.8 DEFINITIONS**

- A. Definitions of terms in accordance with ASTM C717 and as specified.
- B. Backing Rod: A type of sealant backing.
- C. Bond Breakers: A type of sealant backing.
- D. Filler: A sealant backing used behind a back-up rod.

**1.9 WARRANTY**

- A. Construction Warranty: Comply with FAR clause 52.246-21 "Warranty of Construction".
- B. Manufacturer Warranty: Manufacturer shall warranty their sealant for a minimum of five (5) years from the date of installation and final acceptance by the Government. Submit manufacturer warranty.

**1.10 APPLICABLE PUBLICATIONS**

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.
- B. ASTM International (ASTM):
- C509-06.....Elastomeric Cellular Preformed Gasket and Sealing Material
  - C612-14.....Mineral Fiber Block and Board Thermal Insulation
  - C717-14a.....Standard Terminology of Building Seals and Sealants
  - C734-06(R2012).....Test Method for Low-Temperature Flexibility of Latex Sealants after Artificial Weathering
  - C794-10.....Test Method for Adhesion-in-Peel of Elastomeric Joint Sealants
  - C919-12.....Use of Sealants in Acoustical Applications.
  - C920-14a.....Elastomeric Joint Sealants.
  - C1021-08(R2014).....Laboratories Engaged in Testing of Building Sealants
  - C1193-13.....Standard Guide for Use of Joint Sealants.
  - C1248-08(R2012).....Test Method for Staining of Porous Substrate by Joint Sealants
  - C1330-02(R2013).....Cylindrical Sealant Backing for Use with Cold Liquid Applied Sealants
  - C1521-13.....Standard Practice for Evaluating Adhesion of Installed Weatherproofing Sealant Joints
  - D217-10.....Test Methods for Cone Penetration of Lubricating Grease
  - D1056-14.....Specification for Flexible Cellular Materials—Sponge or Expanded Rubber
  - E84-09.....Surface Burning Characteristics of Building Materials
- C. Sealant, Waterproofing and Restoration Institute (SWRI).  
The Professionals' Guide
- D. Environmental Protection Agency (EPA):
- 40 CFR 59(2014).....National Volatile Organic Compound Emission Standards for Consumer and Commercial Products

**PART 2 - PRODUCTS****2.1 SEALANTS****A. Floor Joint Sealant:**

1. ASTM C920, Type S or M, Grade P, Class 25, Use T. S-1
2. S-#1 Provide location(s) of floor joint sealant as follows.
  - b. Control and expansion joints in floors, slabs, and ceramic tile.

**B. Interior Sealants:**

1. VOC Content of Interior Sealants: Sealants and sealant primers used inside the weatherproofing system are to comply with the following limits for VOC content when calculated according to 40 CFR 59, (EPA Method 24):
  - a. Architectural Sealants: 250 g/L.
  - b. Sealant Primers for Nonporous Substrates: 250 g/L.
  - c. Sealant Primers for Porous Substrates: 775 g/L.
2. S-#2 Vertical and Horizontal Surfaces: ASTM C920, Type S or M, Grade NS, Class 25, Use NT.
3. S-#3 Food Service: Use a Vinyl Acetate Homopolymer, or other low VOC, non-toxic sealant approved for use in food preparation areas.
4. Provide location(s) of interior sealant as follows:
  - a. Typical narrow joint 6 mm, (1/4 inch) or less at walls and adjacent components.
  - b. Perimeter of doors, windows, access panels which adjoin concrete or masonry surfaces.
  - c. Interior surfaces of exterior wall penetrations.
  - d. Joints at masonry walls and columns, piers, concrete walls or exterior walls.
  - e. Exposed isolation joints at top of full height walls.
  - f. Joints between bathtubs and ceramic tile; joints between shower receptors and ceramic tile; joints formed where nonplanar tile surfaces meet.
  - g. Joints formed between tile floors and tile base cove; joints between tile and dissimilar materials; joints occurring where substrates change.
  - h. Behind escutcheon plates at valve pipe penetrations and showerheads in showers.

C. Acoustical Sealant:

1. Conforming to ASTM C919; flame spread of 25 or less; and a smoke developed rating of 50 or less when tested in accordance with ASTM E84. Acoustical sealant have a consistency of 250 to 310 when tested in accordance with ASTM D217; remain flexible and adhesive after 500 hours of accelerated weathering as specified in ASTM C734; and be non-staining.
2. Provide location(s) of acoustical sealant as follows:
  - a. Exposed acoustical joint at sound rated partitions.
  - b. Concealed acoustic joints at sound rated partitions.
  - c. Joints where item pass-through sound rated partitions.

**2.2 COLOR**

- A. Sealants used with exposed masonry are to match color of mortar joints.
- B. Sealants used with unpainted concrete are to match color of adjacent concrete.
- C. Color of sealants for other locations to be light gray or aluminum, unless otherwise indicated in construction documents.

**2.3 JOINT SEALANT BACKING**

- A. General: Provide sealant backings of material and type that are non-staining; are compatible with joint substrates, sealants, primers, and other joint fillers; and are approved for applications indicated by sealant manufacturer based on field experience and laboratory testing.
- B. Cylindrical Sealant Backings: ASTM C1330, of type indicated below and of size and density to control sealant depth and otherwise contribute to producing optimum sealant performance:
  1. Type C: Closed-cell material with a surface skin.
- C. Elastomeric Tubing Sealant Backings: Neoprene, butyl, EPDM, or silicone tubing complying with ASTM D1056 or synthetic rubber (ASTM C509), non-absorbent to water and gas, and capable of remaining resilient at temperatures down to minus 32 degrees C (minus 26 degrees F). Provide products with low compression set and of size and shape to provide a secondary seal, to control sealant depth, and otherwise contribute to optimum sealant performance.
- D. Bond-Breaker Tape: Polyethylene tape or other plastic tape recommended by sealant manufacturer for preventing sealant from adhering to rigid, inflexible joint-filler materials or joint surfaces at back of joint where such adhesion would result in sealant failure. Provide self-adhesive tape where applicable.



**2.4 FILLER**

- A. Mineral Fiberboard: ASTM C612, Class 1.
- B. Thickness same as joint width.
- C. Depth to fill void completely behind back-up rod.

**2.5 PRIMER**

- A. As recommended by manufacturer of caulking or sealant material.
- B. Stain-free type.

**2.6 CLEANERS-NON POROUS SURFACES**

- A. Chemical cleaners compatible with sealant and acceptable to manufacturer of sealants and sealant backing material. Cleaners to be free of oily residues and other substances capable of staining or harming joint substrates and adjacent non-porous surfaces and formulated to promote adhesion of sealant and substrates.

**PART 3 - EXECUTION****3.1 INSPECTION:**

- A. Inspect substrate surface for bond breaker contamination and unsound materials at adherent faces of sealant.
- B. Coordinate for repair and resolution of unsound substrate materials.
- C. Inspect for uniform joint widths and that dimensions are within tolerance established by sealant manufacturer.

**3.2 PREPARATIONS**

- A. Prepare joints in accordance with manufacturer's instructions and SWRI (The Professionals' Guide).
- B. Clean surfaces of joint to receive caulking or sealants leaving joint dry to the touch, free from frost, moisture, grease, oil, wax, lacquer paint, or other foreign matter that would tend to destroy or impair adhesion.
  - 1. Clean porous joint substrate surfaces by brushing, grinding, blast cleaning, mechanical abrading, or a combination of these methods to produce a clean, sound substrate capable of developing optimum bond with joint sealants.
  - 2. Remove loose particles remaining from above cleaning operations by vacuuming or blowing out joints with oil-free compressed air. Porous joint surfaces include but are not limited to the following:
    - a. Concrete.
    - b. Masonry.
    - c. Unglazed surfaces of ceramic tile.

3. Remove laitance and form-release agents from concrete.
4. Clean nonporous surfaces with chemical cleaners or other means that do not stain, harm substrates, or leave residues capable of interfering with adhesion of joint sealants. Nonporous surfaces include but are not limited to the following:
  - a. Metal.
  - b. Glass.
  - c. Porcelain enamel.
  - d. Glazed surfaces of ceramic tile.
- C. Do not cut or damage joint edges.
- D. Apply non-staining masking tape to face of surfaces adjacent to joints before applying primers, caulking, or sealing compounds.
  1. Do not leave gaps between ends of sealant backings.
  2. Do not stretch, twist, puncture, or tear sealant backings.
  3. Remove absorbent sealant backings that have become wet before sealant application and replace them with dry materials.
- E. Apply primer to sides of joints wherever required by compound manufacturer's printed instructions or as indicated by pre-construction joint sealant substrate test.
  1. Apply primer prior to installation of back-up rod or bond breaker tape.
  2. Use brush or other approved means that will reach all parts of joints. Avoid application to or spillage onto adjacent substrate surfaces.

### **3.3 BACKING INSTALLATION**

- A. Install backing material, to form joints enclosed on three sides as required for specified depth of sealant.
- B. Where deep joints occur, install filler to fill space behind the backing rod and position the rod at proper depth.
- C. Cut fillers installed by others to proper depth for installation of backing rod and sealants.
- D. Install backing rod, without puncturing the material, to a uniform depth, within plus or minus 3 mm (1/8 inch) for sealant depths specified.
- E. Where space for backing rod does not exist, install bond breaker tape strip at bottom (or back) of joint so sealant bonds only to two opposing surfaces.

### 3.4 SEALANT DEPTHS AND GEOMETRY

- A. At widths up to 6 mm (1/4 inch), sealant depth equal to width.
- B. At widths over 6 mm (1/4 inch), sealant depth 1/2 of width up to 13 mm (1/2 inch) maximum depth at center of joint with sealant thickness at center of joint approximately 1/2 of depth at adhesion surface.

### 3.5 INSTALLATION

- A. General:
  - 1. Apply sealants and caulking only when ambient temperature is between 5 degrees C and 38 degrees C (40 degrees and 100 degrees F).
  - 2. Do not install polysulfide base sealants where sealant may be exposed to fumes from bituminous materials, or where water vapor in continuous contact with cementitious materials may be present.
  - 3. Do not install sealant type listed by manufacture as not suitable for use in locations specified.
  - 4. Apply caulking and sealing compound in accordance with manufacturer's printed instructions.
  - 5. Avoid dropping or smearing compound on adjacent surfaces.
  - 6. Fill joints solidly with compound and finish compound smooth.
  - 7. Tool exposed joints to form smooth and uniform beds, with slightly concave surface conforming to joint configuration per Figure 5A in ASTM C1193 unless shown or specified otherwise in construction documents. Remove masking tape immediately after tooling of sealant and before sealant face starts to "skin" over. Remove any excess sealant from adjacent surfaces of joint, leaving the working in a clean finished condition.
  - 8. Finish paving or floor joints flush unless joint is otherwise detailed.
  - 9. Apply compounds with nozzle size to fit joint width.
  - 10. Test sealants for compatibility with each other and substrate. Use only compatible sealant. Submit test reports.
  - 11. Replace sealant which is damaged during construction process.
- B. For application of sealants, follow requirements of ASTM C1193 unless specified otherwise. Take all necessary steps to prevent three-sided adhesion of sealants.

- C. Interior Sealants: Where gypsum board partitions are of sound rated, fire rated, or smoke barrier construction, follow requirements of ASTM C919 only to seal all cut-outs and intersections with the adjoining construction unless specified otherwise.
1. Apply a 6 mm (1/4 inch) minimum bead of sealant each side of runners (tracks), including those used at partition intersections with dissimilar wall construction.
  2. Coordinate with application of gypsum board to install sealant immediately prior to application of gypsum board.
  3. Partition Intersections: Seal edges of face layer of gypsum board abutting intersecting partitions, before taping and finishing or application of veneer plaster-joint reinforcing.
  4. Openings: Apply a 6 mm (1/4 inch) bead of sealant around all cutouts to seal openings of electrical boxes, ducts, pipes and similar penetrations. To seal electrical boxes, seal sides and backs.
  5. Control Joints: Before control joints are installed, apply sealant in back of control joint to reduce flanking path for sound through control joint.

### **3.6 CLEANING**

- A. Fresh Compound Accidentally Smeared on Adjoining Surfaces: Scrape off immediately and rub clean with a solvent as recommended by manufacturer of the adjacent material or if not otherwise indicated by the caulking or sealant manufacturer.
- B. Leave adjacent surfaces in a clean and unstained condition.

- - - E N D - - -

**SECTION 09 05 16**  
**SUBSURFACE PREPARATION FOR FLOOR FINISHES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

This section specifies subsurface preparation requirements for areas to receive the installation of applied and resinous flooring. This section includes removal of existing floor coverings, testing concrete for moisture and pH, remedial floor coating for concrete floor slabs having unsatisfactory moisture or pH conditions, floor leveling and repair as required.

**1.2 RELATED WORK**

- A. Section 07 92 00, JOINT SEALANTS
- B. Section 09 65 16, RESILIENT SHEET FLOORING
- C. Section 09 65 19, RESILIENT TILE FLOORING
- D. Section 09 68 00, CARPETING

**1.3 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA and TEST DATA.
- B. Written approval confirming product compatibility with subfloor material manufacturer and the flooring manufacturer
- C. Product Data:
  - 1. Moisture Remediation System
  - 2. Underlayment Primer
  - 3. Cementitious Self-Leveling Underlayment
  - 4. Cementitious Trowel-Applied Underlayment (Not suitable for resinous floor finishes)
- D. Test Data:
  - 1. Moisture test and pH results performed by a qualified independent testing agency or warranty holding manufacturer's technical representative.

**1.4 DELIVERY AND STORAGE**

- A. Deliver materials in containers with labels legible and intact and grade-seals unbroken.
- B. Store material to prevent damage or contamination.

## 1.5 APPLICABLE PUBLICATIONS

A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in text by basic designation only.

B. American Society for Testing and Materials (ASTM):

<b>D638-10</b> (2010)	Test Method for Tensile Properties of Plastics
<b>D4259-88</b> (2012)	Standard Practice for Abrading Concrete to alter the surface profile of the concrete and to remove foreign materials and weak surface laitance.
<b>C109/C109M</b> -12 (2012)	Standard Test Method for Compressive Strength of Hydraulic Cement Mortars (Using 2-in. or [50-mm] Cube Specimens) Modified Air Cure Only
<b>D7234-12</b> (2012)	Standard Test Method for Pull-Off Adhesion Strength of Coatings on Concrete Using Portable Pull-Off Adhesion Testers.
<b>E96/E96M -</b> <b>12</b> (2012)	Standard Test Methods for Water Vapor Transmission of Materials
<b>F710-11</b> (2011)	Standard Practice for Preparing Concrete Floors to Receive Resilient Flooring
<b>F1869-11</b> (2011)	Standard Test Method for Measuring Moisture Vapor Emission Rate of Concrete Subfloor Using Anhydrous Calcium Chloride
<b>F2170-11</b> (2011)	Standard Test Method for Determining Relative Humidity in Concrete Floor Slabs Using in situ Probes
<b>C348-08</b> (2008)	Standard Test Method for Flexural Strength of Hydraulic-Cement Mortars
<b>C191-13</b> (2013)	Standard Test Method for Time of Setting of Hydraulic Cement by Vicat Needle

## PART 2 - PRODUCTS

### 2.1 MOISTURE REMEDIATION COATING

A. System Descriptions:

1. High-solids, epoxy system designed to suppress excess moisture in concrete prior to an overlayment. For use under resinous products, VCT, tile and carpet where issues caused by moisture vapor are a concern.

B. Products: Subject to compliance with applicable fire, health, environmental, and safety requirements for storage, handling, installation, and clean up.

- C. System Components: Verify specific requirements as systems vary by manufacturer. Verify build up layers and installation method. Verify compatibility with substrate. Use manufacturer's standard components, compatible with each other and as follows:
1. Liquid Applied Coating:
    - a. Resin: Epoxy.
    - b. Formulation Description: Multiple component high solids.
    - c. Application: Per manufacturer's written installation requirements.
    - d. Thickness: minimum 10 mils
- D. Material Vapor Permeance: Application shall achieve a permeance rating of less than 0.1 perm in accordance with ASTM E96/E96M.
- E. Maximum RH Requirement: 100% testing in accordance with ASTM F2170.

Property	Test	Value
Tensile Strength	ASTM D638	4,400 psi
Volatile Organic Compound Limits (V.O.C.)	SCAMD Rule 1113	25 grams per liter
Permeance	ASTM E96	0.1 perms
Tensile Modulus	ASTM D638	1.9X10 <sup>5</sup> psi
Percent Elongation	ASTM D638	12%
Cure Rate	Per manufacture's Data	4 hours Tack free with 24hr recoat window
Bond Strength	ASTM D7234	100% bond to concrete failure

## 2.2 CEMENTITIOUS SELF-LEVELING UNDERLAYMENT

- A. System Descriptions:
1. High performance self-leveling underlayment resurfacer.  
Single component, self-leveling, cementitious material designed for easy application as an underlayment for all types of flooring materials. It is used for substrate repair and leveling.
- B. Products: Subject to compliance with applicable fire, health, environmental, and safety requirements for storage, handling, installation, and clean up. Gypsum-based products are unacceptable.

## C. System Characteristics:

1. Wearing Surface: Smooth
  2. Thickness: Per architectural drawings, ranging from feathered edge to 1", per application. Applications greater than 1" require additional 3/8" aggregate to mix or as recommended by manufacturer.
- D. Underlayment shall be calcium aluminate cement-based, containing Portland cement. Gypsum-based products are unacceptable.
- E. Compressive Strength: Minimum 4100 psi in 28 days in accordance with ASTM C109/C109M.
- F. Flexural Strength: Minimum 1000 psi in 28 days in accordance with ASTM C348
- G. Dry Time: Underlayment shall receive the application of moisture insensitive tile in 6 hours, and floor coverings in 16 hours.
- H. Primer: Compatible and as recommended by manufacturer for use over intended substrate
- I. System Components: Manufacturer's standard components that are compatible with each other and as follows:
1. Primer:
    - a. Resin: Copolymer
    - b. Formulation Description: Single component ready to use.
    - c. Application Method: Squeegee and medium nap roller.  
All puddles shall be removed, and material shall be allowed to dry, 1-2 hours at 70F/21C.
    - d. Number of Coats: (1) one.
  2. Grout Resurfacing Base:
    - a. Formulation Description: Single component, cementitious self-leveling high-early and high-ultimate strength grout.
    - b. Application Method: Colloidal mix pump, cam rake, spike roll.
      - 1) Thickness of Coats: Per architectural scope, 1" lifts.
      - 2) Number of Coats: More than one if needed.
    - c. Aggregates: For applications greater than 1", require additional 3/8" aggregate to mix.

Property	Test	Value
Compressive Strength	ASTM C109/C109M	2,200 psi @ 24 hrs 3,000 psi @ 7 days
Initial set time	ASTM C191	30-45 min.
Final Set time		1 to 1.5 hours
Bond Strength	ASTM D7234	100% bond to concrete failure



### **2.3 CEMENTITIOUS TROWEL-APPLIED UNDERLAYMENT (NOT SUITABLE FOR RESINOUS FLOOR FINISHES)**

- A. Underlayment shall be calcium aluminate cement-based, containing Portland cement. Gypsum-based products are unacceptable.
- B. Compressive Strength: Minimum 4000 psi in 28 days
- C. Trowel-applied underlayment shall not contain silica quartz (sand).
- D. Dry Time: Underlayment shall receive the application of floor covering in 15-20 minutes.

## **PART 3 - EXECUTION**

### **3.1 ENVIRONMENTAL REQUIREMENTS**

- A. Maintain ambient temperature of work areas at not less than 16 degree C (60 degrees F), without interruption, for not less than 24 hours before testing and not less than three days after testing.
- B. Maintain higher temperatures for a longer period of time where required by manufacturer's recommendation.
- C. Do not install materials when the temperatures of the substrate or materials are not within 60-85 degrees F/ 16-30 degrees C.

### **3.2 SURFACE PREPARATION**

- A. Existing concrete slabs with existing floor coverings:
  - 1. Conduct visual observation of existing floor covering for adhesion, water damage, alkaline deposits, and other defects.
  - 2. Remove existing floor covering and adhesives. Comply with local, state and federal regulations and the RFCI Recommended Work Practices for Removal of Resilient Floor Coverings, as applicable to the floor covering being removed.
- B. Concrete shall meet the requirements of ASTM F710 and be sound, solid, clean, and free of all oil, grease, dirt, curing compounds, and any substance that might act as a bond-breaker before application. As required prepare slab by mechanical methods. No chemicals or solvents shall be used.
- C. General: Prepare and clean substrates according to flooring manufacturer's written instructions for substrate indicated.

- D. Prepare concrete substrates per ASTM D4259 as follows:
  - 1. Dry abrasive blasting.
  - 2. Wet abrasive blasting.
  - 3. Vacuum-assisted abrasive blasting.
  - 4. Centrifugal-shot abrasive blasting.
  - 5. Comply with manufacturer's written instructions.
- E. Repair damaged and deteriorated concrete according to flooring manufacturer's written recommendations.
- F. Verify that concrete substrates are dry.
- G. Perform anhydrous calcium chloride test, ASTM F 1869. Proceed with application only after substrates have maximum moisture-vapor-emission rate of per flooring manufacturers' formal and project specific written recommendation.
- H. Perform in situ probe test, ASTM F2170. Proceed with application only after substrates do not exceed a maximum potential equilibrium relative humidity per flooring manufacture's formal and project specific written recommendation.
- I. Provide a written report showing test placement and results.
- J. Prepare joints in accordance with Section 07 92 00, JOINT SEALANTS and material manufacturer's instructions.
- K. Alkalinity: Measure surface pH in accordance with procedures provided in ASTM F710 or as outlined by qualified testing agency or flooring manufacturer's technical representative.
- L. Tolerances: Subsurface shall meet the flatness and levelness tolerance specified on drawings or recommended by the floor finish manufacturer. Tolerance shall also not to exceed 1/4" deviation in 10'. As required, install underlayment to achieve required tolerance.
- M. Other Subsurface: For all other subsurface conditions, such as wood or metal, contact the floor finish or underlayment manufacturer, as appropriate, for proper preparation practices.

### **3.3 MOISTURE REMEDIATION COATING**

- A. Where results of relative humidity testing (ASTM F2170) exceed the requirements of the specified flooring manufacturer, apply remedial coating as specified to correct excessive moisture condition.

- B. Prior to remedial floor coating installation mechanically prepare the concrete surface to provide a concrete surface profile in accordance with ASTM D4259.
- C. Mix and apply moisture remediation coating in accordance with manufacturer's instructions.

#### **3.4 CEMENTITIOUS UNDERLAYMENT**

- A. Install cementitious self-leveling underlayment as required to correct surface defects, floor flatness or levelness corrections to meet the tolerance requirements as or detailed on drawings, address non-moving cracks or joints, provide a smooth surface for the installation of floor covering, or meet elevation requirements detailed on drawings.
- B. Mix and apply in accordance with manufacturer's instructions.

#### **3.5 PROTECTION**

- A. Prior to the installation of the finish flooring, the surface of the underlayment should be protected from abuse by other trades by the use of plywood, tempered hardwood, or other suitable protection course

#### **3.6 FIELD QUALITY CONTROL**

- A. Where specified, field sampling of products shall be conducted by a qualified, independent testing facility.

- - - E N D - - -



**SECTION 09 06 00  
SCHEDULE FOR FINISHES**

**PART I - GENERAL**

**1.1 DESCRIPTION**

This section contains a coordinated system in which requirements for materials specified in other sections shown are identified by abbreviated material names and finish codes in the room finish schedule or shown for other locations.

**1.2 MANUFACTURERS**

Manufacturer's trade names and numbers used herein are only to identify colors, finishes, textures and patterns. Products of other manufacturer's equivalent to colors, finishes, textures and patterns of manufacturers listed that meet requirements of technical specifications will be acceptable upon approval in writing by contracting officer for finish requirements.

**1.3 SUBMITALS**

Submit in accordance with SECTION 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES—provide quadruplicate samples for color approval of materials and finishes specified in this section.

**1. DIGITAL COLOR PHOTOS-INTERIOR VIEWS:**

Room Number and Name	Item/View to be Photographed
1.	
2.	
3.	
4.	

**1.4 APPLICABLE PUBLICATIONS**

A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in text by basic designation only.

B. MASTER PAINTING INSTITUTE: (MPI)

2001.....Architectural Painting Specification Manual

**PART 2- PRODUCTS****2.1 DIGITAL COLOR PHOTOS**

A. Size 24 x 35 mm.

B. Labeled for:

1. Building name and Number.

2. Room Name and Number.

**2.2 DIVISION 06 WOOD, PLASTICS, AND COMPOSITES**

A. SECTION 06 20 00, FINISH CARPENTRY

1. Items Specified			
Room No. and Name	Component	Material	Finish/Color
	Window Sills	Solid Surface Material	Refer to Finish Legend

**2.3 DIVISION 07 - THERMAL AND MOISTURE PROTECTION****A. SECTION 07 92 00, JOINT SEALANTS**

Location	Color
Color of sealants at all locations	Match adjacent locations. Where adjacent surfaces are different colors, verify with Architect.

**2.4 DIVISION 09 - FINISHES****A. SECTION 09 30 13, CERAMIC TILING**

1. SECTION 09 30 13, CERAMIC/PORCELAIN TILING		
Finish Code	Manufacturer	Mfg. Color Name/No
Refer to Finish Legend		

2. SECTION 09 30 13, GROUTING MATERIAL		
Finish Code	Manufacturer	Mfg. Color Name/No.
Refer to Finish Legend		

3. SECTION 09 30 13, FLUID-APPLIED WATERPROOF MEMBRANE	
Manufacturer	Product
Crossfield Products Corp. Rancho Dominguez, CA	Dex-O-Tex - Neobond Fracture Resistant Waterproof Membrane

## 4. SECTION 09 30 13, METAL DIVIDER STRIPS

Size	Material	Material
		Clear Anodized Aluminum

## B. SECTION 09 51 00, ACOUSTICAL CEILINGS

Finish Code	Component	Color Pattern	Manufacturer	Mfg Name/No.
Refer to Finish Legend				

## C. SECTION 09 65 13, RESILIENT BASE AND ACCESSORIES

Finish Code	Item	Height	Manufacturer	Mfg. Name/No.
Refer to Finish Legend				

## D. SECTION 09 65 16, VINYL SHEET FLOORING, HEAT WELDED SEAMS (WSF)

Finish Code	Pattern name	Manufacturer	Mfg. Color Name/No.
Refer to Finish Legend			



## E. SECTION 09 65 19, RESILIENT TILE FLOORING

Finish Code	Size	Material/Component	Manufacturer	Mfg Name/No.
Refer to Finish Legend				

## F. SECTION 09 68 00, CARPET MODULES (CFT)

Finish Code	Size	Pattern direction	Manufacturer	Mfg. Color Name/No.
Refer to Finish Legend				

## G. SECTION 09 91 00, PAINT AND COATINGS

## 1. MPI Gloss and Sheen Standards

		Gloss @60	Sheen @85
Gloss Level 1	a traditional matte finish-flat	max 5 units, and	max 10 units
Gloss Level 2	a high side sheen flat-"a velvet-like" finish	max 10 units, and	10-35 units
Gloss Level 3	a traditional "egg-shell like" finish	10-25 units, and	10-35 units
Gloss Level 4	a "satin-like" finish	20-35 units, and	min. 35 units
Gloss Level 5	a traditional semi-gloss	35-70 units	
Gloss Level 6	a traditional gloss	70-85 units	
Gloss level 7	a high gloss	more than 85 units	

**Refer to Finish Legend for Paint Color Code.**

Paint Type	Manufacturer	Manufacturer's Product Name	Number Of Coats	Substrate
- Interior - Latex Primer	Sherwin Williams	ProMar 200 Zero VOC Interior Latex Primer B28W2600	1	All Gypsum Board Unless Noted as Epoxy
- Interior - Latex Enamel Topcoat	Sherwin Williams	ProMar 200 Zero VOC Interior Latex Eg-Shel B20-2600 Series	2	All Gypsum Board Unless Noted as Epoxy  Concrete Block and Exposed Interior Poured-in-Place Concrete Walls
- Interior - Block Filler	Sherwin Williams	PrepRite Block Filler B25W25		Concrete Block and Exposed Interior Poured-in-Place Concrete Walls
- Interior - Epoxy Primer	Sherwin Williams	PrepRite ProBlock Primer/Sealer B51-600	1	Gypsum Board
- Interior - Epoxy Topcoat	Sherwin Williams	Pro Industrial, Water Based Catalyzed Epoxy B73 Series	2	Gypsum Board  Concrete Block and Exposed Interior Poured-in-Place Concrete Walls
- Interior - Dryfall Acrylic Latex Primer	Sherwin Williams	Pro-Cryl Universal Primer B66-310	1	Concrete Structural Ceiling, Metal Joists and Deck
- Interior - Dryfall Acrylic Latex Topcoat	Sherwin Williams	Waterborne Acrylic Eggshell Dryfall B42W2	2	Concrete Structural Ceiling, Metal Joists and Deck

Paint Type	Manufacturer	Manufacturer's Product Name	Number Of Coats	Substrate
- Interior - Interior Metal Primer	Sherwin Williams	Pro-Cryl Universal Primer B66-310	1 (Where surfaces are furnished preprimed, just spot prime bare spots with a compatible primer.)	Hollow Metal Frames, Hollow Metal Doors and Interior Ferrous Metal  Covered Piping and Ductwork
- Interior - Interior Metal Topcoat	Sherwin Williams	Sher-Cryl High Performance Acrylic B66- 350 Series	2	Hollow Metal Frames, Hollow Metal Doors and Interior Ferrous Metal  Covered Piping and Ductwork
- Interior - Wood Stain	Diamond Vogel	Old Masters Hi Solids Penetrating Stain, MP- Series	1	Wood
- Interior - Sanding Sealer	Diamond Vogel	Old Masters H20 Acrylic Sanding Sealer, MP- Series	1	Wood
- Interior - Wood Topcoat - Clear Finish	Diamond Vogel	Old Masters H20 Acrylic Polyurethane, MP-Series	1	Wood

**2.5 DIVISION 10 - SPECIALTIES****A. SECTION 10 21 16, SHOWER STALLS**

Component	Material	Manufacturer	Mfg. Color Name/No.
Refer to Finish Legend		InPro Corp.	

**B. SECTION 10 21 23, CUBICLE CURTAINS AND SHOWER CURTAIN TRACKS**

Manufacturer		Model No.
Imperial Fastener Co., Inc. Pompano Beach, Florida		Track: Model IFC-98 (or equal) Carriers: IFC 300 (or equal) / Four carriers per foot.

**C. SECTION 10 26 00, WALL GUARDS AND CORNER GUARDS**

Item	Material	Manufacturer	Mfg. Color Name/No.
REFER TO FINISH LEGEND			

## D. SECTION 10 28 00, TOILET AND BATH ACCESSORIES

Item	Manufacturer	Series/Model Number	Finish	
Robe Hooks	Bobrick Washroom Equipment Inc., New York, New York	Model B-6827	Stainless Steel with #4 Satin Finish	
Mirrors	Bobrick Washroom Equipment Inc., New York, New York	Model B-290 1836	Stainless Steel with #4 Satin Finish	
Grab Bars - Typical Wall Mounted	Bobrick Washroom Equipment Inc., New York, New York	B-6806 Series Size as indicated on drawings.	Stainless Steel with #4 Satin Finish	
Swing-Up Grab Bars	Bobrick Washroom Equipment Inc., New York, New York	Model B-4998	Stainless Steel with #4 Satin Finish	
Shower Curtain Rod	Bobrick Washroom Equipment Inc., New York, New York	B-6047	Stainless Steel with #4 Satin Finish	

## 2.6 DIVISION 12- FURNISHINGS

## A. SECTION 12 32 00, WOOD CASEWORK

Item Type	Location	Finish/Color
Refer to Finish Legend		

## B. SECTION 12 36 00, COUNTERTOPS AND ACCESSORIES

Type	Finish/Color
Plastic Laminate	Refer to Finish Legend
Methyl Methacrylate	Refer to Finish Legend

## PART III EXECUTION

## 3.1 FINISH SCHEDULES &amp; MISCELLANEOUS ABBREVIATIONS

FINISH SCHEDULE & MISCELLANEOUS ABBREVIATIONS	
Term	Abbreviation
Access Flooring	AF
Accordion Folding Partition	AFP
Acoustical Ceiling	AT
Acoustical Ceiling, Special Faced	AT (SP)
Acoustical Metal Pan Ceiling	AMP
Acoustical Wall Panel	AWP
Acoustical Wall Treatment	AWT
Acoustical Wallcovering	AWF
Anodized Aluminum Colored	AAC
Anodized Aluminum Natural Finish	AA
Baked On Enamel	BE
Brick Face	BR
Brick Flooring	BF
Brick Paving	BP
Carpet	CP

Carpet Athletic Flooring	CAF
Carpet Module Tile	CPT
Ceramic Glazed Facing Brick	CGFB
Ceramic Mosaic Tile	FTCT
Concrete	C
Concrete Masonry Unit	CMU
Divider Strips Marble	DS MB
Epoxy Coating	EC
Epoxy Resin Flooring	ERF
Existing	E
Exposed Divider Strips	EXP
Exterior	EXT
Exterior Finish System	EFS
Exterior Paint	EXT-P
Exterior Stain	EXT-ST
Fabric Wallcovering	WF
Facing Tile	SCT
Feature Strips	FS
Floor Mats & Frames	FM
Floor Tile, Mosaic	FT
Fluorocarbon	FC
Folding Panel Partition	FP
Foot Grille	FG
Glass Masonry Unit	GUMU
Glazed Face CMU	GCMU

Glazed Structural Facing Tile	SFTU
Granite	GT
Gypsum Wallboard	GWB
High Glazed Coating	SC
Latex Mastic Flooring	LM
Linear Metal Ceiling	LMC
Linear Wood Ceiling	LWC
Marble	MB
Material	MAT
Mortar	M
Multi-Color Coating	MC
Natural Finish	NF
Paint	P
Paver Tile	PVT
Perforated Metal Facing (Tile or Panels)	PMF
Plaster	PL
Plaster High Strength	HSPL
Plaster Keene Cement	KC
Plastic Laminate	HPDL
Polypropylene Fabric Wallcovering	PFW
Porcelain Paver Tile	PPT
Quarry Tile	QT
Radiant Ceiling Panel System	RCP
Resilient Stair Tread	RST

Rubber Base	RB
Rubber Tile Flooring	RT
Spandrel Glass	SLG
Stain	ST
Stone Flooring	SF
Structural Clay	SC
Suspension Decorative Grids	SDG
Terrazzo Portland Cement	PCT
Terrazzo Tile	TT
Terrazzo, Thin Set	
Textured Gypsum Ceiling Panel	TGC
Textured Metal Ceiling Panel	TMC
Thin set Terrazzo	TST
Veneer Plaster	VP
Vinyl Base	VB
Vinyl Coated Fabric Wallcovering	W
Vinyl Composition Tile	VCT
Vinyl Sheet Flooring	VSF
Vinyl Sheet Flooring (Welded Seams)	WSF
Wall Border	WB
Wood	WD

### 3.2 FINISH SCHEDULE SYMBOLS

#### Symbol Definition

\*\* Same finish as adjoining walls  
 - No color required  
 E Existing  
 XX To match existing  
 EFTR Existing finish to remain  
 RM Remove

--- E N D ---





**SECTION 09 22 16**  
**NON-STRUCTURAL METAL FRAMING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

This section specifies steel studs wall systems, shaft wall systems, ceiling or soffit suspended or furred framing, wall furring, fasteners, and accessories for the screw attachment of gypsum board, plaster bases or other building boards.

**1.2 RELATED WORK**

- A. Support for Wall Mounted Items: Section 05 50 00, METAL FABRICATIONS.
- B. Ceiling Suspension Systems for Acoustical Tile or Panels and Lay-In Gypsum Board Panels: Section 09 51 00, ACOUSTICAL CEILINGS and Section 09 29 00, GYPSUM BOARD.

**1.3 TERMINOLOGY**

- A. Description of terms shall be in accordance with ASTM C754, ASTM C11, ASTM C841, and as specified.
- B. Underside of Structure Overhead: In spaces where steel trusses or bar joists are shown, the underside of structure overhead shall be the underside of the floor or roof construction supported by beams, trusses, or bar joists. In interstitial spaces with walk-on floors the underside of the walk-on floor is the underside of structure overhead.
- C. Thickness of steel specified is the minimum bare (uncoated) steel thickness.

**1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
  - 1. Studs, runners and accessories.
  - 2. Hanger inserts.
  - 3. Channels (Rolled steel).
  - 4. Furring channels.
  - 5. Screws, clips and other fasteners.

## C. Shop Drawings:

1. Typical ceiling suspension system.
2. Typical metal stud and furring construction system including details around openings and corner details.
3. Typical shaft wall assembly
4. Typical fire rated assembly and column fireproofing showing details of construction same as that used in fire rating test.

D. Test Results: Fire rating test designation, each fire rating required for each assembly.

**1.5 DELIVERY, IDENTIFICATION, HANDLING AND STORAGE**

In accordance with the requirements of ASTM C754.

**1.6 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM)
- |                     |   |
|---------------------|---|
| A641-09.....        | Zinc-Coated (Galvanized) Carbon Steel Wire  |
| A653/653M-11.....   | Specification for Steel Sheet, Zinc Coated<br>(Galvanized) or Zinc-Iron Alloy-Coated<br>(Galvannealed) by Hot-Dip Process.  |
| C11-10.....         | Terminology Relating to Gypsum and Related<br>Building Materials and Systems  |
| C635-07.....        | Manufacture, Performance, and Testing of Metal<br>Suspension System for Acoustical Tile and<br>Lay-in Panel Ceilings  |
| C636-08.....        | Installation of Metal Ceiling Suspension<br>Systems for Acoustical Tile and Lay-in Panels   |
| C645-09.....        | Non-Structural Steel Framing Members  |
| C754-11.....        | Installation of Steel Framing Members to<br>Receive Screw-Attached Gypsum Panel Products  |
| C841-03(R2008)..... | Installation of Interior Lathing and Furring  |
| C954-10.....        | Steel Drill Screws for the Application of<br>Gypsum Panel Products or Metal Plaster Bases to<br>Steel Studs from 0.033 in. (0.84 mm) to 0.112<br>in. (2.84 mm) in Thickness |
| E580-11.....        | Application of Ceiling Suspension Systems for<br>Acoustical Tile and Lay-in Panels in Areas<br>Requiring Moderate Seismic Restraint.  |

**PART 2 - PRODUCTS****2.1 PROTECTIVE COATING**

- A. Galvanize steel studs, runners (track), rigid (hat section) furring channels, "Z" shaped furring channels, and resilient furring channels, with coating designation of G40 or equivalent.

**2.2 STEEL STUDS AND RUNNERS (TRACK)**

- A. ASTM C645, modified for thickness specified and sizes as shown.
  - 1. Use C 645 steel, 0.75 mm (0.0296-inch) minimum base-metal (30 mil).
  - 2. Runners same thickness as studs.
  - 3. Exception: Members that can show certified third party testing with gypsum board in accordance with ICC ES AC86 (Approved May 2012) need not meet the minimum thickness limitation or minimum section properties set forth in ASTM C 645. The submission of an evaluation report is acceptable to show conformance to this requirement.

Use C 645 steel, 0.48mm (0.019 inch) minimum base-metal (19 mil).
- B. Provide not less than two cutouts in web of each stud, approximately 300 mm (12 inches) from each end, and intermediate cutouts on approximately 600 mm (24-inch) centers.
- C. Doubled studs for openings and studs for supporting concrete backer-board.
- D. Studs 3600 mm (12 feet) or less in length shall be in one piece.
- E. Shaft Wall Framing:
  - 1. Conform to rated wall construction.
  - 2. C-H Studs or C-T Studs.
  - 3. E Studs.
  - 4. J Runners.
  - 5. Steel Jamb-Strut.

**2.3 FURRING CHANNELS**

- A. Rigid Furring Channels (hat shape): ASTM C645.
- B. Resilient Furring Channels:
  - 1. Not less than 0.45 mm (0.0179-inch) thick bare metal.
  - 2. Semi-hat shape, only one flange for anchorage with channel web leg slotted on anchorage side, channel web leg on other side stiffens fastener surface but shall not contact anchorage surface other channel leg is attached to.

## C. "Z" Furring Channels:

1. Not less than 0.45 mm (0.0179-inch)-thick base metal, with 32 mm (1-1/4 inch) and 19 mm (3/4-inch) flanges.
2. Web furring depth to suit thickness of insulation.

## D. Rolled Steel Channels: ASTM C754, cold rolled; or, ASTM C841, cold rolled.

**2.4 FASTENERS, CLIPS, AND OTHER METAL ACCESSORIES**

## A. ASTM C754, except as otherwise specified.

## B. For fire rated construction: Type and size same as used in fire rating test.

## C. Fasteners for steel studs thicker than 0.84 mm (0.033-inch) thick. Use ASTM C954 steel drill screws of size and type recommended by the manufacturer of the material being fastened.

## D. Clips: ASTM C841 (paragraph 6.11), manufacturer's standard items. Clips used in lieu of tie wire shall have holding power equivalent to that provided by the tie wire for the specific application.

## E. Concrete ceiling hanger inserts (anchorage for hanger wire and hanger straps): Steel, zinc-coated (galvanized), manufacturers standard items, designed to support twice the hanger loads imposed and the type of hanger used.

## F. Tie Wire and Hanger Wire:

1. ASTM A641, soft temper, Class 1 coating.
2. Gage (diameter) as specified in ASTM C754 or ASTM C841.

## G. Attachments for Wall Furring:

1. Manufacturers standard items fabricated from zinc-coated (galvanized) steel sheet.
2. For concrete or masonry walls: Metal slots with adjustable inserts or adjustable wall furring brackets. Spacers may be fabricated from 1 mm (0.0396-inch) thick galvanized steel with corrugated edges.

## H. Power Actuated Fasteners: Type and size as recommended by the manufacturer of the material being fastened.

**2.5 SUSPENDED CEILING SYSTEM FOR GYPSUM BOARD (OPTION)**

- A. Conform to ASTM C635, heavy duty, with not less than 35 mm (1-3/8 inch) wide knurled capped flange face designed for screw attachment of gypsum board.
- B. Wall track channel with 35 mm (1-3/8 inch) wide flange.

**PART 3 - EXECUTION****3.1 INSTALLATION CRITERIA**

- A. Where fire rated construction is required for walls, partitions, columns, beams and floor-ceiling assemblies, the construction shall be same as that used in fire rating test.
- B. Construction requirements for fire rated assemblies and materials shall be as shown and specified, the provisions of the Scope paragraph (1.2) of ASTM C754 and ASTM C841 regarding details of construction shall not apply.

**3.2 INSTALLING STUDS**

- A. Install studs in accordance with ASTM C754, except as otherwise shown or specified.
- B. Space studs not more than 610 mm (24 inches) on center.
- C. Cut studs 6 mm to 9 mm (1/4 to 3/8-inch) less than floor to underside of structure overhead when extended to underside of structure overhead.
- D. Where studs are shown to terminate above suspended ceilings, provide bracing as shown or extend studs to underside of structure overhead.
- E. Extend studs to underside of structure overhead for fire, rated partitions, smoke partitions, shafts, and sound rated partitions.
- F. Openings:
  - 1. Frame jambs of openings in stud partitions and furring with two studs placed back to back or as shown.
  - 2. Fasten back to back studs together with 9 mm (3/8-inch) long Type S pan head screws at not less than 600 mm (two feet) on center, staggered along webs.
  - 3. Studs fastened flange to flange shall have splice plates on both sides approximately 50 X 75 mm (2 by 3 inches) screwed to each stud with two screws in each stud. Locate splice plates at 600 mm (24 inches) on center between runner tracks.
- G. Fastening Studs:
  - 1. Fasten studs located adjacent to partition intersections, corners and studs at jambs of openings to flange of runner tracks with two screws through each end of each stud and flange of runner.
  - 2. Do not fasten studs to top runner track when studs extend to underside of structure overhead.

H. Chase Wall Partitions:

1. Locate cross braces for chase wall partitions to permit the installation of pipes, conduits, carriers and similar items.
2. Use studs or runners as cross bracing not less than 63 mm (2-1/2 inches wide).

I. Form building seismic or expansion joints with double studs back to back spaced 75 mm (three inches) apart plus the width of the seismic or expansion joint.

J. Form control joint, with double studs spaced 13 mm (1/2-inch) apart.

**3.3 INSTALLING WALL FURRING FOR FINISH APPLIED TO ONE SIDE ONLY**

A. In accordance with ASTM C754, or ASTM C841 except as otherwise specified or shown.

B. Wall Furring-Stud System:

1. Framed with 63 mm (2-1/2 inch) or narrower studs, 600 mm (24 inches) on center.
2. Brace as specified in ASTM C754 for Wall Furring-Stud System or brace with sections or runners or studs placed horizontally at not less than three foot vertical intervals on side without finish.
3. Securely fasten braces to each stud with two Type S pan head screws at each bearing.

C. Direct attachment to masonry or concrete; rigid channels or "Z" channels:

1. Install rigid (hat section) furring channels at 600 mm (24 inches) on center, horizontally or vertically.
2. Install "Z" furring channels vertically spaced not more than 600 mm (24 inches) on center.
3. At corners where rigid furring channels are positioned horizontally, provide mitered joints in furring channels.
4. Ends of spliced furring channels shall be nested not less than 200 mm (8 inches).
5. Fasten furring channels to walls with power-actuated drive pins or hardened steel concrete nails. Where channels are spliced, provide two fasteners in each flange.
6. Locate furring channels at interior and exterior corners in accordance with wall finish material manufacturers printed erection instructions. Locate "Z" channels within 100 mm (4 inches) of corner.

D. Installing Wall Furring-Bracket System: Space furring channels not more than 400 mm (16 inches) on center.

### **3.4 INSTALLING SUPPORTS REQUIRED BY OTHER TRADES**

- A. Provide for attachment and support of electrical outlets, plumbing, laboratory or heating fixtures, recessed type plumbing fixture accessories, access panel frames, wall bumpers, wood seats, toilet stall partitions, dressing booth partitions, urinal screens, chalkboards, tackboards, wall-hung casework, handrail brackets, recessed fire extinguisher cabinets and other items like auto door buttons and auto door operators supported by stud construction.
- B. Provide additional studs where required. Install metal backing plates, or special metal shapes as required, securely fastened to metal studs.
- C. All blocking shall be 2" x 12" fire treated wood.

### **3.5 INSTALLING SHAFT WALL SYSTEM**

- A. Conform to UL Design No. U438 for two-hour fire rating. Provide one hour fire rating Shaft wall where indicated on drawings.
- B. Position J runners at floor and ceiling with the short leg toward finish side of wall. Securely attach runners to structural supports with power driven fasteners at both ends and 600 mm (24 inches) on center.
- C. After liner panels have been erected, cut C-H studs and E studs, from 9 mm (3/8-inch) to not more than 13 mm (1/2-inch) less than floor-to-ceiling height. Install C-H studs between liner panels with liner panels inserted in the groove.
- D. Install full-length steel E studs over shaft wall line at intersections, corners, hinged door jambs, columns, and both sides of closure panels.
- E. Suitably frame all openings to maintain structural support for wall:
  - 1. Provide necessary liner fillers and shims to conform to label frame requirements.
  - 2. Frame openings cut within a liner panel with E studs around perimeter.
  - 3. Frame openings with vertical E studs at jambs, horizontal J runner at head and sill.

### **3.6 INSTALLING FURRED AND SUSPENDED CEILINGS OR SOFFITS**

- A. Install furred and suspended ceilings or soffits in accordance with ASTM C754 or ASTM C841 except as otherwise specified or shown for screw attached gypsum board ceilings and for plaster ceilings or soffits.
  - 1. Space framing at 400 mm (16-inch) centers for metal lath anchorage.
  - 2. Space framing at 600 mm (24-inch) centers for gypsum board anchorage.

B. New Exposed Concrete Slabs:

1. Use metal inserts required for attachment and support of hangers or hanger wires with tied wire loops for embedding in concrete.
2. Furnish for installation under Division 3, CONCRETE.
3. Suspended ceilings under concrete rib construction shall have runner channels at right angles to ribs and be supported from ribs with hangers at ends and at 1200 mm (48-inch) maximum intervals along channels. Stagger hangers at alternate channels.

C. Concrete Slabs on Steel Decking Composite Construction:

1. Use pull down tabs when available.
2. Use power activated fasteners when direct attachment to structural framing cannot be accomplished.

D. Where bar joists or beams are more than 1200 mm (48 inches) apart, provide intermediate hangers so that spacing between supports does not exceed 1200 mm (48 inches). Use clips, bolts, or wire ties for direct attachment to steel framing.

E. Existing Concrete Construction Exposed or Concrete on Steel Decking:

1. Use power actuated fasteners either eye pin, threaded studs or drive pins for type of hanger attachment required.
2. Install fasteners at approximate mid height of concrete beams or joists. Do not install in bottom of beams or joists.

F. Steel Decking Without Concrete Topping:

1. Do not fasten to steel decking 0.76 mm (0.0299-inch) or thinner.
2. Toggle bolt to decking 0.9 mm (0.0359-inch) or thicker only where anchorage to steel framing is not possible.

G. Installing Suspended Ceiling System for Gypsum Board (ASTM C635 Option):

1. Install only for ceilings to receive screw attached gypsum board.
2. Install in accordance with ASTM C636.
  - a. Install main runners spaced 1200 mm (48 inches) on center.
  - b. Install 1200 mm (four foot) tees not over 600 mm (24 inches) on center; locate for edge support of gypsum board.
  - c. Install wall track channel at perimeter.



**H. Installing Ceiling Bracing System:**

1. Construct bracing of 38 mm (1-1/2 inch) channels for lengths up to 2400 mm (8 feet) and 50 mm (2 inch) channels for lengths over 2400 mm (8 feet) with ends bent to form surfaces for anchorage to carrying channels and overhead construction. Lap channels not less than 600 mm (2 feet) at midpoint back to back. Screw or bolt lap together with two fasteners.
2. Install bracing at an approximate 45 degree angle to carrying channels and structure overhead; secure as specified to structure overhead with two fasteners and to carrying channels with two fasteners or wire ties.
3. Brace suspended ceiling or soffit framing in seismic areas in accordance with ASTM E580.

**3.7 TOLERANCES**

- A. Fastening surface for application of subsequent materials shall not vary more than 3 mm (1/8-inch) from the layout line.
- B. Plumb and align vertical members within 3 mm (1/8-inch.)
- C. Level or align ceilings within 3 mm (1/8-inch.)

- - - E N D - - -



**SECTION 09 29 00  
GYPSUM BOARD**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

This section specifies installation and finishing of gypsum board.

**1.2 RELATED WORK**

- A. Installation of Steel Framing Members for Walls, Partitions, Furring, Soffits, and Ceilings: Section 09 22 16, NON-STRUCTURAL METAL FRAMING.
- B. Sound Deadening Board: Section 07 21 13, THERMAL INSULATION.
- C. Acoustical Sealants: Section 07 92 00, JOINT SEALANTS.
- D. Lay-in Gypsum Board Ceiling Panels: Section 09 51 00, ACOUSTICAL CEILING.

**1.3 TERMINOLOGY**

- A. Definitions and description of terms shall be in accordance with ASTM C11, C840, and as specified.
- B. Underside of Structure Overhead: In spaces where steel trusses or bar joists are shown, the underside of structure overhead shall be the underside of the floor or roof construction supported by the trusses or bar joists.
- C. "Yoked": Gypsum board cut out for opening with no joint at the opening (along door jamb or above the door).

**1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
  - 1. Cornerbead and edge trim.
  - 2. Finishing materials.
  - 3. Laminating adhesive.
  - 4. Gypsum board, each type.
- C. Shop Drawings:
  - 1. Typical gypsum board installation, showing corner details, edge trim details and the like.
  - 2. Typical sound rated assembly, showing treatment at perimeter of partitions and penetrations at gypsum board.
  - 3. Typical shaft wall assembly.
  - 4. Typical fire rated assembly and column fireproofing, indicating details of construction same as that used in fire rating test.

## D. Samples:

1. Cornerbead.
2. Edge trim.
3. Control joints.

## E. Test Results:

1. Fire rating test, each fire rating required for each assembly.
2. Sound rating test.

## F. Certificates: Certify that gypsum board types, gypsum backing board types, cementitious backer units, and joint treating materials do not contain asbestos material.

**1.5 DELIVERY, IDENTIFICATION, HANDLING AND STORAGE**

In accordance with the requirements of ASTM C840.

**1.6 ENVIRONMENTAL CONDITIONS**

In accordance with the requirements of ASTM C840.

**1.7 APPLICABLE PUBLICATIONS**

## A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

## B. American Society for Testing and Materials (ASTM):

- C11-08.....Terminology Relating to Gypsum and Related Building Materials and Systems
- C475-02.....Joint Compound and Joint Tape for Finishing Gypsum Board
- C840-08.....Application and Finishing of Gypsum Board
- C919-08.....Sealants in Acoustical Applications
- C954-07.....Steel Drill Screws for the Application of Gypsum Board or Metal Plaster Bases to Steel Stud from 0.033 in. (0.84mm) to 0.112 in. (2.84mm) in thickness
- C1002-07.....Steel Self-Piercing Tapping Screws for the Application of Gypsum Panel Products or Metal Plaster Bases to Wood Studs or Steel Studs
- C1047-05.....Accessories for Gypsum Wallboard and Gypsum Veneer Base
- C1177-06.....Glass Mat Gypsum Substrate for Use as Sheathing

C1658-06.....Glass Mat Gypsum Panels

C1396-06.....Gypsum Board

E84-08.....Surface Burning Characteristics of Building  
Materials

C. Underwriters Laboratories Inc. (UL):

Latest Edition.....Fire Resistance Directory

D. Inchcape Testing Services (ITS):

Latest Editions.....Certification Listings

## **PART 2 - PRODUCTS**

### **2.1 GYPSUM BOARD**

A. Gypsum Board: ASTM C1396, Type X, 16 mm (5/8 inch) thick unless shown otherwise. Shall contain a minimum of 20 percent recycled gypsum.

B. Coreboard or Shaft Wall Liner Panels.

1. ASTM C1396, Type X.

2. ASTM C1658: Glass Mat Gypsum Panels,

3. Coreboard for shaft walls 300, 400, 600 mm (12, 16, or 24 inches) wide by required lengths 25 mm (one inch) thick with paper faces treated to resist moisture.

C. Water Resistant Gypsum Backing Board: ASTM C620, Type X, 16 mm (5/8 inch) thick.

D. Gypsum cores shall contain maximum percentage of post-industrial recycled gypsum content available in the area (a minimum of 95 percent post-industrial recycled gypsum content). Paper facings shall contain 100 percent post-consumer recycled paper content.

### **2.2 ACCESSORIES**

A. ASTM C1047, except form of 0.39 mm (0.015 inch) thick zinc coated steel sheet or rigid PVC plastic.

B. Flanges not less than 22 mm (7/8 inch) wide with punchouts or deformations as required to provide compound bond.

### **2.3 FASTENERS**

A. ASTM C1002 and ASTM C840, except as otherwise specified.

B. ASTM C954, for steel studs thicker than 0.04 mm (0.33 inch).

C. Select screws of size and type recommended by the manufacturer of the material being fastened.

D. For fire rated construction, type and size same as used in fire rating test.

E. Clips: Zinc-coated (galvanized) steel; gypsum board manufacturer's standard items.

**2.4 FINISHING MATERIALS AND LAMINATING ADHESIVE**

ASTM C475 and ASTM C840. Free of antifreeze, vinyl adhesives, preservatives, biocides and other VOC. Adhesive shall contain a maximum VOC content of 50 g/l.

**PART 3 - EXECUTION****3.1 GYPSUM BOARD HEIGHTS**

- A. Extend all layers of gypsum board from floor to underside of structure overhead on following partitions and furring:
  - 1. Two Sides of Partitions:
    - a. Fire rated partitions.
    - b. Smoke partitions.
    - c. Sound rated partitions.
    - d. Full height partitions shown (FHP).
    - e. Corridor partitions.
  - 2. One Side of Partitions or Furring:
    - a. Inside of exterior wall furring or stud construction.
    - b. Room side of room without suspended ceilings.
    - c. Furring for pipes and duct shafts, except where fire rated shaft wall construction is shown.
  - 3. Extend all layers of gypsum board construction used for fireproofing of columns from floor to underside of structure overhead, unless shown otherwise.
- B. In locations other than those specified, extend gypsum board from floor to heights as follows:
  - 1. Not less than 100 mm (4 inches) above suspended acoustical ceilings.
  - 2. At ceiling of suspended gypsum board ceilings.
  - 3. At existing ceilings.

**3.2 INSTALLING GYPSUM BOARD**

- A. Coordinate installation of gypsum board with other trades and related work.
- B. Install gypsum board in accordance with ASTM C840, except as otherwise specified.
- C. Moisture and Mold-Resistant Assemblies: Provide and install moisture and mold-resistant glass mat gypsum wallboard products with moisture-resistant surfaces complying with ASTM C1658 where shown and in locations which might be subject to moisture exposure during construction.

- D. Use gypsum boards in maximum practical lengths to minimize number of end joints.
- E. Bring gypsum board into contact, but do not force into place.
- F. Ceilings:
  - 1. For single-ply construction, use perpendicular application.
  - 2. For two-ply assemblies:
    - a. Use perpendicular application.
    - b. Apply face ply of gypsum board so that joints of face ply do not occur at joints of base ply with joints over framing members.
- G. Walls (Except Shaft Walls):
  - 1. When gypsum board is installed parallel to framing members, space fasteners 300 mm (12 inches) on center in field of the board, and 200 mm (8 inches) on center along edges.
  - 2. When gypsum board is installed perpendicular to framing members, space fasteners 300 mm (12 inches) on center in field and along edges.
  - 3. Stagger screws on abutting edges or ends.
  - 4. For single-ply construction, apply gypsum board with long dimension either parallel or perpendicular to framing members as required to minimize number of joints except gypsum board shall be applied vertically over "Z" furring channels.
  - 5. For two-ply gypsum board assemblies, apply base ply of gypsum board to assure minimum number of joints in face layer. Apply face ply of wallboard to base ply so that joints of face ply do not occur at joints of base ply with joints over framing members.
  - 6. For three-ply gypsum board assemblies, apply plies in same manner as for two-ply assemblies, except that heads of fasteners need only be driven flush with surface for first and second plies. Apply third ply of wallboard in same manner as second ply of two-ply assembly, except use fasteners of sufficient length enough to have the same penetration into framing members as required for two-ply assemblies.
  - 7. No offset in exposed face of walls and partitions will be permitted because of single-ply and two-ply or three-ply application requirements.

8. Installing Two Layer Assembly Over Sound Deadening Board:
  - a. Apply face layer of wallboard vertically with joints staggered from joints in sound deadening board over framing members.
  - b. Fasten face layer with screw, of sufficient length to secure to framing, spaced 300 mm (12 inches) on center around perimeter, and 400 mm (16 inches) on center in the field.
9. Control Joints ASTM C840 and as follows:
  - a. Locate at both side jambs of openings if gypsum board is not "yoked". Use one system throughout.
  - b. Not required for wall lengths less than 9000 mm (30 feet).
  - c. Extend control joints the full height of the wall or length of soffit/ceiling membrane.
- H. Acoustical or Sound Rated Partitions, Fire and Smoke Partitions:
  1. Cut gypsum board for a space approximately 3 mm to 6 mm (1/8 to 1/4 inch) wide around partition perimeter.
  2. Coordinate for application of caulking or sealants to space prior to taping and finishing.
  3. For sound rated partitions, use sealing compound (ASTM C919) to fill the annular spaces between all receptacle boxes and the partition finish material through which the boxes protrude to seal all holes and/or openings on the back and sides of the boxes. STC minimum values as shown.
- I. Electrical and Telecommunications Boxes:
  1. Seal annular spaces between electrical and telecommunications receptacle boxes and gypsum board partitions.
- J. Accessories:
  1. Set accessories plumb, level and true to line, neatly mitered at corners and intersections, and securely attach to supporting surfaces as specified.
  2. Install in one piece, without the limits of the longest commercially available lengths.
  3. Corner Beads:
    - a. Install at all vertical and horizontal external corners and where shown.
    - b. Use screws only. Do not use crimping tool.



#### 4. Edge Trim (Casing Beads):

- a. At both sides of expansion and control joints unless shown otherwise.
- b. Where gypsum board terminates against dissimilar materials and at perimeter of openings, except where covered by flanges, casings or permanently built-in equipment.
- c. Where gypsum board surfaces of non-load bearing assemblies abut load bearing members.
- d. Where shown.

### 3.3 CAVITY SHAFT WALL

- A. Coordinate assembly with Section 09 22 16, NON-STRUCTURAL METAL FRAMING, for erection of framing and gypsum board.
- B. Conform to UL Design No. U438 or FM WALL CONSTRUCTION 12-2/HR (Nonbearing for two-hour fire rating. Conform to FM WALL CONSTRUCTION 25-1/HR (Non-loadbearing) for one-hour fire rating where shown.
- C. Cut coreboard (liner) panels 25 mm (one inch) less than floor-to-ceiling height and erect vertically between J-runners on shaft side.
  1. Where shaft walls exceed 4300 mm (14 feet) in height, position panel end joints within upper and lower third points of wall.
  2. Stagger joints top and bottom in adjacent panels.
  3. After erection of J-struts of opening frames, fasten panels to J-struts with screws of sufficient length to secure to framing staggered from those in base, spaced 300 mm (12 inches) on center.
- D. Gypsum Board:
  1. Two Hour Wall:
    - a. Erect base layer (backing board) vertically on finish side of wall with end joints staggered. Fasten base layer panels to studs with 25 mm (one inch) long screws, spaced 600 mm (24 inches) on center.
    - b. Use laminating adhesive between plies in accordance with UL or FM if required by fire test.
    - c. Apply face layer of gypsum board required by fire test vertically over base layer with joints staggered and attach with screws of sufficient length to secure to framing staggered from those in base, spaced 300 mm (12 inches) on center.

2. One hour wall with one layer on finish side of wall: Apply face layer of gypsum board vertically. Attach to studs with screws of sufficient length to secure to framing, spaced 300 mm (12 inches) on center in field and along edges.
  3. Where coreboard is covered with face layer of gypsum board, stagger joints of face layer from those in the coreboard base.
- E. Treat joints, corners, and fasteners in face layer as specified for finishing of gypsum board.

#### **3.4 FINISHING OF GYPSUM BOARD**

- A. Finish joints, edges, corners, and fastener heads in accordance with ASTM C840. Use Level 4 finish for all finished areas open to public view.
- B. Before proceeding with installation of finishing materials, assure the following:
  1. Gypsum board is fastened and held close to framing or furring.
  2. Fastening heads in gypsum board are slightly below surface in dimple formed by driving tool.
- C. Finish joints, fasteners, and all openings, including openings around penetrations, on that part of the gypsum board extending above suspended ceilings to seal surface of non-decorated smoke barrier, fire rated and sound rated gypsum board construction. After the installation of hanger rods, hanger wires, supports, equipment, conduits, piping and similar work, seal remaining openings and maintain the integrity of the smoke barrier, fire rated and sound rated construction. Sanding is not required of nondecorated surfaces.

#### **3.5 REPAIRS**

- A. After taping and finishing has been completed, and before decoration, repair all damaged and defective work, including nondecorated surfaces.
- B. Patch holes or openings 13 mm (1/2 inch) or less in diameter, or equivalent size, with a setting type finishing compound or patching plaster.
- C. Repair holes or openings over 13 mm (1/2 inch) diameter, or equivalent size, with 16 mm (5/8 inch) thick gypsum board secured in such a manner as to provide solid substrate equivalent to undamaged surface.

- D. Tape and refinish scratched, abraded or damaged finish surfaces including cracks and joints in non-decorated surface to provide smoke tight construction fire protection equivalent to the fire rated construction and STC equivalent to the sound rated construction.

- - - E N D - - -



**SECTION 09 30 13**  
**CERAMIC/PORCELAIN TILING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies interior ceramic, porcelain tile, fluid-applied waterproofing, tile backer board and vapor retarder at shower/bathroom walls.

**1.2 RELATED WORK**

- A. Sealing of Joints: Section 07 92 00, JOINT SEALANTS.
- B. Color, Texture, Pattern, and Size of Field Tile and Trim Shapes, and Color of Grout Specified: Section 09 06 00, SCHEDULE FOR FINISHES.
- C. Metal and Resilient Edge Strips at Joints with New Resilient Flooring, and Carpeting: Section 09 65 19, RESILIENT TILE FLOORING and Section 09 68 00, CARPETING.

**1.3 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Samples:
  - 1. Base tile, each type, each color, each size.
  - 2. Porcelain tile, each type, color, patterns and size.
  - 3. Wall (or wainscot) tile, each color, size and pattern.
  - 4. Trim shapes, bullnose cap and cove including bullnose cap and base pieces at internal and external corners of vertical surfaces, each type, color, and size.
- C. Product Data:
  - 1. Ceramic and porcelain tile, marked to show each type, size, and shape required.
  - 2. Cementitious backer unit.
  - 3. Dry-set portland cement mortar and grout.
  - 4. Divider strip.
  - 5. Elastomeric membrane and bond coat.
  - 6. Reinforcing tape.
  - 7. Leveling compound.
  - 8. Latex-portland cement mortar and grout.
  - 9. Commercial portland cement grout.
  - 10. Organic adhesive.
  - 11. Slip resistant tile.
  - 12. Waterproofing isolation membrane.
  - 13. Fasteners.

D. Certification:

1. Master grade certificate, ANSI A137.1.
2. Manufacturer's certificates indicating that the following materials comply with specification requirements:
  - a. Chemical resistant mortar and grout (epoxy and furan).
  - b. Modified epoxy emulsion.
  - c. Commercial portland cement grout.
  - d. Cementitious backer unit.
  - e. Dry-set portland cement mortar and grout.
  - f. Elastomeric membrane and bond coat.
  - g. Reinforcing tape.
  - h. Latex-portland cement mortar and grout.
  - i. Leveling compound.
  - j. Organic adhesive.
  - k. Waterproof isolation membrane.
  - l. Factory back mounted tile documentation for suitability for application in wet area.

E. Installer Qualifications:

1. Submit letter stating installer's experience.

**1.4 DELIVERY AND STORAGE**

- A. Deliver materials in containers with labels legible and intact and grade-seals unbroken.
- B. Store material to prevent damage or contamination.

**1.5 QUALITY ASSURANCE**

- A. Installers to be from a company specializing in performing installation of products specified and have a minimum of three (3) years' experience.
- B. Each type and color of tile to be provided from a single source.
- C. Each type and color of mortar, adhesive, and grout to be provided from the same source.

**1.6 WARRANTY**

- A. Construction Warranty: Comply with FAR clause 52.246-21, "Warranty of Construction".

## 1.7 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in text by basic designation only.
- B. American National Standards Institute (ANSI):
- A10.20-06(R2011).....Safe Operating Practices for Tile, Terrazzo and Marble Work
  - A108/A118/A136-14 Installation of Ceramic Tile
  - A108.01-13.....Subsurfaces and Preparations by Other Trades
  - A108.02-13.....Materials, Environmental, and Workmanship
  - A108.1A-14.....Installation of Ceramic Tile in the Wet-Set Method with Portland Cement Mortar
  - A108.1B-10.....Installation of Ceramic Tile on a Cured Portland Cement Mortar Setting Bed with Dry-Set or Latex-Portland Cement Mortar
  - A108.1C-10.....Contractors Option; Installation of Ceramic Tile in the Wet-Set method with Portland Cement Mortar or Installation of Ceramic Tile on a Cured Portland Cement Mortar Setting Bed with Dry-Set or Latex-Portland Cement Mortar
  - A108.4-09.....Ceramic Tile with Organic Adhesives or Water Cleanable Tile-Setting Epoxy Adhesive
  - A108.6-10.....Ceramic Tile with Chemical Resistant, Water Cleanable Tile-Setting and -Grouting Epoxy
  - A108.8-10.....Ceramic Tile with Chemical Resistant Furan Resin Mortar and Grout
  - A108.10-10.....Grout in Tilework
  - A108.13-10.....Load Bearing, Bonded, Waterproof Membranes for Thin-Set Ceramic Tile and Dimension Stone
  - A118.1-12.....Dry-Set Portland Cement Mortar
  - A118.3-13.....Chemical Resistant, Water Cleanable Tile-Setting and -Grouting Epoxy and Water Cleanable Tile-Setting Epoxy Adhesive
  - A118.4-12.....Latex-Portland Cement Mortar
  - A118.5-10.....Chemical Resistant Furan Mortars and Grouts
  - A118.6-10.....Cement Grouts for Tile Installation
  - A118.7-10.....High Performance Cement Grouts for Tile Installation

- A118.9-10.....Cementitious Backer Units
- A118.10-14.....Load Bearing, Bonded, Waterproof Membranes for  
Thin-Set Ceramic Tile and Dimension Stone  
Installation
- A136.1-13.....Organic Adhesives for Installation of Ceramic  
Tile
- A137.1-12.....American National Standard Specifications for  
Ceramic Tile
- C. ASTM International (ASTM):
- A666-10.....Annealed or Cold-Worked Austenitic Stainless  
Steel Sheet, Strip, Plate and Flat Bar
- A1064/A1064M-14.....Carbon-Steel Wire and Welded Wire  
Reinforcement, Plain and Deformed, for Concrete
- C109/C109M-13.....Standard Test Method for Compressive Strength  
of Hydraulic Cement Mortars (Using 2 inch. or  
[50-mm] Cube Specimens)
- C241/C241M-13.....Abrasion Resistance of Stone Subjected to Foot  
Traffic
- C348-14.....Standard Test Method for Flexural Strength of  
Hydraulic-Cement Mortars
- C627-10.....Evaluating Ceramic Floor Tile Installation  
Systems Using the Robinson-Type Floor Tester
- C954-11.....Steel Drill Screws for the Application of  
Gypsum Board on Metal Plaster Base to Steel  
Studs from 0.033 in (0.84 mm) to 0.112 in  
(2.84 mm) in thickness
- C979/C979M-10.....Pigments for Integrally Colored Concrete
- C1002-14.....Steel Self-Piercing Tapping Screws for the  
Application of Panel Products
- C1027-09.....Test Method for Determining Visible Abrasion  
Resistance of Glazed Ceramic Tile
- C1127-01(R2009).....Standard Guide for Use of High Solids Content,  
Cold Liquid-Applied Elastomeric Waterproofing  
Membrane with an Integral Wearing Surface
- C1178/C1178M-13.....Standard Specification for Coated Glass Mat  
Water-Resistant Gypsum Backing Panel
- C1325-14.....Non-Asbestos Fiber-Mat Reinforced Cementitious  
Backer Units



- C1353/C1353M-09(R2013)..Abrasion Resistance of Dimension Stone  
 Subjected to Foot Traffic Using a Rotary  
 Platform, Double-Head Abraser
- D1204-14.....Test Method for Linear Dimensional Changes of  
 Nonrigid Thermoplastic Sheeting or Film at  
 Elevated Temperature
- D2240-05(R2010).....Test Method for Rubber Property - Durometer  
 Hardness
- D2497-07(R2012).....Tolerances for Manufactured Organic-Base  
 Filament Single Yarns
- D3045-92(R2010).....Heat Aging of Plastics Without Load
- D4397-10.....Standard Specification for Polyethylene  
 Sheeting for Construction, Industrial and  
 Agricultural Applications
- D5109-12.....Standard Test Methods for Copper-Clad  
 Thermosetting Laminates for Printed Wiring  
 Boards
- D. Code of Federal Regulation (CFR):
- 40 CFR 59.....Determination of Volatile Matter Content, Water  
 Content, Density Volume Solids, and Weight  
 Solids of Surface Coating
- E. Marble Institute of America (MIA): Design Manual III-2007
- F. Tile Council of North America, Inc. (TCNA):  
 Handbook for Ceramic Tile Installation (2014)
- DCOF AcuTest-2012.....Dynamic Coefficient of Friction Test

## **PART 2 - PRODUCTS**

### **2.1 TILE**

- A. Comply with ANSI A137.1, Standard Grade, except as modified:
1. Inspection procedures listed under the Appendix of ANSI A137.1.
  2. Abrasion Resistance Classification:
    - a. Tested in accordance with values listed in Table 1, ASTM C1027.
    - b. Class V, 12000 revolutions for floors in Corridors, Kitchens,  
 Storage including Refrigerated Rooms
    - c. Class IV, 6000 revolutions for remaining areas.

3. Slip Resistant Tile for Floors:
  - a. Coefficient of friction, when tested in accordance with ANSI A137.1 and measured per the TCNA DCOF AcuTest.
    - 1) Equal to or greater than .42 for level interior tile floors that will be walked on when wet.
  - b. Tile Having Abrasive Grains:
  - c. Porcelain Paver Tile: Matte surface finish.
4. Back mounted tiles in showers. Provide certification that the factory mounted tile has been used successfully in service at three (3) projects and is suitable for wet locations.
5. Factory Blending: For tile with color variations, within the ranges selected during sample submittals blend tile in the factory and package so tile units taken from one (1) package show the same range in colors as those taken from other packages and match approved samples.
6. Factory-Applied Temporary Protective Coating:
  - a. Protect exposed face surfaces (top surface) of tile against adherence of mortar and grout by pre-coating with a continuous film of hot applied petroleum paraffin wax.
  - b. Do not coat unexposed tile surfaces.
  - c. Pre-wax tiles set or grouted with furan or epoxy or latex modified mortars.
- B. Glazed Wall Tile: Cushion edges, glazing.
- C. Porcelain Paver Tile: Nominal 8 mm (5/16 inch) thick, with cushion edges. Porcelain tile produced by the dust pressed method are to be made of approximately 50% feldspar; the remaining 50% is to be made up of various high-quality light firing ball clays yielding a tile with a water absorption rate of 0.5% or less and a breaking strength of between 176 to 181 kg (390 to 400 lbs.).
- D. Trim Shapes:
  1. Conform to applicable requirements of adjoining floor and wall tile.
  2. Use slip resistant trim shapes for horizontal surfaces of showers, shower curbs, drying area curbs, and seats.
  3. Use trim shapes sizes conforming to size of adjoining field wall tile including existing spaces unless detailed on construction documents or specified otherwise.

#### 4. Internal and External Corners:

- a. Square internal and external corner joints are not acceptable.
- b. External corners including edges: Use bullnose shapes.
- c. Internal corners: Use cove shapes.
- d. Base to floor internal corners: Use special shapes providing integral cove vertical and horizontal joint.
- e. Base to floor external corners: Use special shapes providing bullnose vertical edge with integral cove horizontal joint.  
Use stop at bottom of openings having bullnose return to wall.
- f. Wall top edge internal corners: Use special shapes providing integral cove vertical joint with bullnose top edge.
- g. Wall top edge external corners: Use special shapes providing bullnose vertical and horizontal joint edge.
- h. For unglazed ceramic mosaic and glazed wall tile installed in portland cement mortar setting bed, use cove and bullnose shapes as applicable. When ceramic mosaic wall and base tile is required, use C Series cove and bullnose shapes.
- i. For unglazed ceramic mosaic and glazed wall tile installed in dry-set portland cement mortar, latex-portland cement mortar, and organic adhesive (thin set methods), use cove and surface bullnose shapes as applicable.
- j. Provide cove and bullnose shapes where indicated in construction documents, and required to complete tile work.
  1. Where coved shaped Extruded Aluminum Trim is indicated on drawings, provide cove profile equal to Schluter-DILEX\_AHK with all necessary accessory fittings.

#### 2.2 BACKER UNITS

##### A. Cementitious Backer Units:

1. Use in showers or wet areas.
2. Conform to ASTM C1325; Type A.
3. Use in maximum lengths available to minimize end to end butt joints.

#### 2.3 JOINT MATERIALS FOR CEMENTITIOUS BACKER UNITS

- ##### A. Reinforcing Tape: Vinyl coated woven glass fiber mesh tape, open weave, 50 mm (2 inches) wide. Tape with pressure sensitive adhesive backing will not be permitted.

- B. Tape Embedding Material: Latex-portland cement mortar complying with ANSI A108.01.
- C. Joint material, including reinforcing tape, and tape embedding material, are to be as specifically recommended by the backer unit manufacturer.

#### **2.4 FASTENERS**

- A. Screws for Cementitious Backer Units.
  - 1. Standard screws for gypsum board are not acceptable.
  - 2. Minimum 11 mm (7/16 inch) diameter head, corrosion resistant coated, with washers.
  - 3. ASTM C954 for steel 1 mm (0.033 inch) thick.
  - 4. ASTM C1002 for steel framing less than 0.0329 inch thick.
- B. Washers: Galvanized steel, 13 mm (1/2 inch) minimum diameter.

#### **2.5 SETTING MATERIALS OR BOND COATS**

- A. Conform to TCNA Handbook for Ceramic Tile Installation.
- B. Portland Cement Mortar: ANSI A108.02.
- C. Latex-Portland Cement Mortar: ANSI A118.4.
  - 1. For wall applications, provide non-sagging, latex-portland cement mortar complying with ANSI A118.4.
  - 2. Prepackaged Dry-Mortar Mix: Factory-prepared mixture of portland cement; dry, redispersible, ethylene vinyl acetate additive; and other ingredients to which only water needs to be added at Project site.
- D. Dry-Set Portland Cement Mortar: ANSI A118.1. For wall applications, provide non-sagging, latex-portland cement mortar complying with ANSI A118.1.
- E. Elastomeric Waterproofing Membrane and Bond Coat:
  - 1. TCNA F122-14 (on ground concrete) and TCNA F112A-14 (above ground concrete).
  - 2. ANSI A118.10.
  - 3. One component polyurethane, liquid applied material having the following additional physical properties:
    - a. Hardness: Shore "A" between 40-60.
    - b. Elongation: Between 300-600 percent.
    - c. Tensile Strength: Between .27 - .41 Newton per square millimeter (40-60 pounds per square inch gauge).
    - d. No volatile compounds (VOC).
  - 4. Coal tar modified urethanes are not acceptable.

F. Fluid-Applied Waterproofing Membrane:

1. Refer to SECTION 09 06 00 for additional product information.
2. Refer to drawings for locations.

**2.6 GROUTING MATERIALS**

A. Coloring Pigments:

1. Pure mineral pigments, lime proof and nonfading, complying with ASTM C979/C979M.
2. Coloring pigments may only be added to grout by the manufacturer.
3. Job colored grout is not acceptable.
4. Use is required in Commercial Portland Cement Grout, Dry-Set Grout, and Latex-Portland Cement Grout.

B. Sand-Portland Cement Grout: ANSI A108.10, consisting of white or gray cement and white or colored aggregate as required to produce color indicated. Zero VOC content.

C. Standard Cement Grout: ANSI A118.6.

D. High Performance Tile Grout: ANSI A118.7 with a VOC content of 65 g/L or less when calculated according to 40 CFR 59 (EPA Method 24).

1. Polymer Type: Ethylene vinyl acetate or acrylic additive, in dry, redispersible form, prepackaged with other dry ingredients.
2. Polymer Type: Acrylic resin or styrene-butadiene rubber in liquid-latex form for addition to prepackaged dry-grout mix.

E. Water-Cleanable Epoxy Grout: ANSI A118.3, with a VOC content of 65 g/L or less when calculated according to 40 CFR 59 (EPA Method 24).

1. Provide product capable of withstanding continuous and intermittent exposure to temperatures of up to 60 and 100 degrees C (140 and 212 degrees F), respectively, and certified by manufacturer for intended use.

**2.7 PATCHING AND LEVELING COMPOUND**

A. Portland cement base, polymer-modified, self-leveling compound, manufactured specifically for resurfacing and leveling concrete floors. Products containing gypsum are not acceptable.

B. Provide a patching and leveling compound with the following minimum physical properties:

1. Compressive strength - 25 MPa (3500 psig) per ASTM C109/C109M.
2. Flexural strength - 7 MPa (1000 psig) per ASTM C348 (28 day value).
3. Tensile strength - 4.1 MPa (600 psi) per ANSI 118.7.
4. Density - 1.9.

- C. Capable of being applied in layers up to 38 mm (1-1/2 inches) thick without fillers and up to 101 mm (4 inches) thick with fillers, being brought to a feather edge, and being troweled to a smooth finish.
- D. Primers, fillers, and reinforcement as required by manufacturer for application and substrate condition.
- E. Ready for use in 48 hours after application.

## **2.8 METAL DIVIDER STRIPS**

- A. Terrazzo type divider strips.
- B. Heavy top type strip with 5 mm (3/16 inch) wide top and 38 mm (1 1/2 inch) long leg. Height to match tile and setting-bed thickness.
- C. Embedded leg perforated and deformed for keying to mortar.
- D. Stainless-steel, ASTM A666, 300 Series exposed-edge material.

## **2.9 WATER**

- A. Clean, potable and free from salts and other injurious elements to mortar and grout materials.

## **2.10 CLEANING COMPOUNDS**

- A. Specifically designed for cleaning masonry and concrete and which will not prevent bond of subsequent tile setting materials including patching and leveling compounds and elastomeric waterproofing membrane and coat.
- B. Materials containing acid or caustic Material are not acceptable.

## **2.11 FLOOR MORTAR BED REINFORCING**

- A. ASTM A1064/A1064M welded wire fabric without backing, MW3 x MW3 (2 x 2-W0.5 x W0.5).

## **2.12 POLYETHYLENE SHEET (VAPOR RETARDER)**

- A. Polyethylene sheet conforming to ASTM D4397.
- B. Nominal thickness: 0.15 mm (6 mils).

# **PART 3 - EXECUTION**

## **3.1 ENVIRONMENTAL REQUIREMENTS**

- A. Maintain ambient temperature of work areas at not less than 16 degrees C (60 degrees F), without interruption, for not less than 24 hours before installation and not less than three (3) days after installation.
- B. Maintain higher temperatures for a longer period of time where required by manufacturer's recommendation and ANSI Specifications for installation.

- C. Do not install tile when the temperature is above 38 degrees C (100 degrees F).
- D. Do not install materials when the temperature of the substrate is below 16 degrees C (60 degrees F).
- E. Do not allow temperature to fall below 10 degrees C (50 degrees F) after third day of completion of tile work.

### **3.2 ALLOWABLE TOLERANCE**

- A. Variation in plane of sub-floor, including concrete fills leveling compounds and mortar beds:
  - 1. Not more than 6 mm in 3048 mm (1/4 inch in 10 feet) from required elevation where portland cement mortar setting bed is used.
  - 2. Not more than 3 mm in 3048 mm (1/8 inch in 10 feet) where dry-set portland cement, and latex-portland cement mortar setting beds and chemical-resistant bond coats are used.
- B. Variation in Plane of Wall Surfaces:
  - 1. Not more than 6 mm in 2438 mm (1/4 inch in 8 feet) from required plane where portland cement mortar setting bed is used.
  - 2. Not more than 3 mm in 2438 mm (1/8 inch in 8 feet) where dry-set or latex-portland cement mortar or organic adhesive setting materials is used.

### **3.3 SURFACE PREPARATION**

- A. Cleaning New Concrete or Masonry:
  - 1. Chip out loose material, clean off all oil, grease dirt, adhesives, curing compounds, and other deterrents to bonding by mechanical method, or by using products specifically designed for cleaning concrete and masonry.
  - 2. Use self-contained power blast cleaning systems to remove curing compounds and steel trowel finish from concrete slabs where ceramic tile will be installed directly on concrete surface with thin-set materials.
  - 3. Steam cleaning or the use of acids and solvents for cleaning will not be permitted.

B. Patching and Leveling:

1. Mix and apply patching and leveling compound in accordance with manufacturer's instructions.
2. Fill holes and cracks and align concrete floors that are out of required plane with patching and leveling compound.
  - a. Thickness of compound as required to bring finish tile system to elevation shown on construction documents.
  - b. Float finish except finish smooth for elastomeric waterproofing.
  - c. At substrate expansion, isolation, and other moving joints, allow joint of same width to continue through underlayment.
3. Apply patching and leveling compound to concrete and masonry wall surfaces that are out of required plane.
4. Apply leveling coats of material compatible with wall surface and tile setting material to wall surfaces, other than concrete and masonry that are out of required plane.

C. Mortar Bed for Slopes to Drains:

1. Slope compound to drain where drains are shown on construction documents.
2. Install mortar bed in depressed slab sloped to drains not less than 3.2 mm in 305 mm (1/8 inch per foot).
3. Allow not less than 50 mm (2 inch) depression at edge of depressed slab.
4. Screed for slope to drain and float finish.
5. Cure mortar bed for not less than seven (7) days. Do not use curing compounds or coatings.
6. Perform flood test to verify mortar bed slopes to drain before installing tile. Contracting Officer Representative (COR) to be present during flood test.

D. Additional preparation of concrete floors for tile set with epoxy, or furan-resin is to be in accordance with the manufacturer's printed instructions.

E. Cleavage Membrane:

1. Install polythene sheet as cleavage membrane in depressed slab.
2. Turn up at edge of depressed floor slab to top of floor.



F. Walls:

1. In toilet rooms and showers or other wet areas cover studs with polyethylene sheet.
2. Apply patching and leveling compound to concrete and masonry surfaces that are out of required plane.
3. Apply leveling coats of material compatible with wall surface and tile setting material to wall surfaces, other than concrete and masonry that are out of required plane.

G. Existing Floors and Walls:

1. Remove existing composition floor finishes and adhesive. Prepare surface by grinding, chipping, self-contained power blast cleaning or other suitable mechanical methods to completely expose uncontaminated concrete or masonry surfaces. Follow safety requirements of ANSI A10.20.
2. Remove existing concrete fill or topping to structural slab. Clean and level the substrate for new setting bed and waterproof membrane or cleavage membrane.
3. Where new tile bases are required to finish flush with plaster above or where they are extensions of similar bases in conjunction with existing floor tiles, cut channel in floor slab and expose rough wall construction sufficiently to accommodate new tile base and setting material.
4. Install fluid-applied waterproof membrane at locations indicated on the drawings. Apply per manufacturer's instructions.

### 3.4 CEMENTITIOUS BACKER UNITS

- A. Remove polyethylene wrapping from cementitious backer units and separate to allow for air circulation. Allow moisture content of backer units to dry down to a maximum of 35 percent before applying joint treatment and tile.
- B. Install in accordance with ANSI A118.9 except as specified otherwise.
- C. Install units horizontally or vertically to minimize joints with end joints over framing members. Units with rounded edges; face rounded edge away from studs to form a "V" joint for joint treatment.
- D. Secure cementitious backer units to each framing member with screws spaced not more than 203 mm (8 inches) on center and not closer than 13 mm (1/2 inch) from the edge of the backer unit or as recommended by backer unit manufacturer. Install screws so that the screw heads are flush with the surface of the backer unit.

- E. Where backer unit joins shower pans or waterproofing, lap backer unit over turned up waterproof system. Install fasteners only through top one-inch of turned up waterproof systems.
- F. Do not install joint treatment for seven (7) days after installation of cementitious backer unit.
- G. Joint Treatment:
  - 1. Fill horizontal and vertical joints and corners with latex-portland cement mortar. Apply fiberglass tape over joints and corners and embed with same mortar.
  - 2. Leave 6 mm (1/4 inch) space for sealant at lips of tubs, sinks, or other plumbing receptors.

### **3.5 METAL DIVIDER STRIPS**

- A. Install metal divider strips in floor joints between tile floors and adjacent flooring of other materials where the finish floors are flush unless shown otherwise on construction documents.
- B. Set divider strip in mortar bed to line and level centered under doors or in openings.
- C. At preformed sealant joint:
  - 1. Comply with recommendations in TCNA for Vertical and Horizontal Joint Design Essentials. TCNA Systems EJ 171.
    - a. Locate joint in tile surfaces directly above joint in sub-floor or where indicated when used with isolation membranes to allow off-setting of joint location from sub-floor joint.
    - b. Fasten full length to sub-floor using a construction adhesive.
    - c. Trowel setting material with full coverage over the entire leg.
  - 2. Set tile up against the joint ensuring that the top edge of the joint is flush or slightly below the top of the tile.

### **3.6 CERAMIC TILE - GENERAL**

- A. Comply with ANSI A108/A118/A136 series of tile installation standards applicable to methods of installation and TCNA Installation Guidelines.
- B. Installing Mortar Beds for Floors:
  - 1. Install mortar bed in a manner that does not damage cleavage membrane or waterproof membrane; 32 mm (1-1/2 inch) minimum thickness.
  - 2. Install floor mortar bed reinforcing centered in mortar fill.
  - 3. Screed finish to level plane or slope to drains shown on construction documents, float finish.

4. For thin set systems cure mortar bed not less than seven (7) days.  
Do not use curing compounds or coatings.
5. For tile set with portland cement paste over plastic mortar bed  
coordinate to set tile before mortar bed sets.

C. Setting Beds or Bond Coats:

1. Where recessed or depressed floor slabs are filled with portland cement mortar bed, set ceramic mosaic floor tile in either portland cement paste over plastic mortar bed or latex-portland cement mortar over cured mortar bed except as specified otherwise, ANSI A108-1C, TCNA System F121-14 or F111-14.
2. Set floor tile in fluid-applied waterproof membrane per ANSI 108.13, and the TCNA System(s) indicated on construction documents.
3. Set wall tile installed over concrete or masonry in dry-set portland cement mortar, or latex-portland cement mortar, ANSI 108.1B and TCNA System W211-14, W221-14 or W222-14.
4. Set wall tile installed over concrete backer board and fluid-applied waterproof membrane in latex-portland cement mortar, ANSI A108.1B.
5. Set tile installed over gypsum board and gypsum plaster in organic adhesive, ANSI A108.1, TCNA System W242-14.
6. Set trim shapes in same material specified for setting adjoining tile.

D. Workmanship:

1. Lay out tile work so that no tile less than one-half full size is used. Make all cuts on the outer edge of the field. Align new tile work scheduled for existing spaces to the existing tile work unless specified otherwise.
2. Set tile firmly in place with finish surfaces in true planes. Align tile flush with adjacent tile unless shown otherwise on construction documents.
3. Form intersections and returns accurately.
4. Cut and drill tile neatly without marring surface.
5. Cut edges of tile abutting penetrations, finish, or built-in items:
  - a. Fit tile closely around electrical outlets, piping, fixtures and fittings, so that plates, escutcheons, collars and flanges will overlap cut edge of tile.
  - b. Seal tile joints water tight as specified in Section 07 92 00, JOINT SEALANTS, around electrical outlets, piping fixtures and fittings before cover plates and escutcheons are set in place.

6. Completed work is to be free from hollow sounding areas and loose, cracked or defective tile.
7. Remove and reset tiles that are out of plane or misaligned.
8. Floors:
  - a. Extend floor tile beneath casework and equipment, except those units mounted in wall recesses.
  - b. Align finish surface of new tile work flush with other and existing adjoining floor finish where indicated in construction documents.
  - c. In areas where floor drains occur, slope tile to drains.
  - d. Push and vibrate tiles over 203 mm (8 inches) square to achieve full support of bond coat.
9. Walls:
  - a. Cover walls and partitions, including pilasters, furred areas, and freestanding columns from floor to ceiling, or from floor to nominal wainscot heights as indicated in construction documents with tile.
  - b. Finish reveals of openings with tile, except where other finish materials are indicated in construction documents.
  - c. Finish wall surfaces behind and at sides of casework and equipment, except those units mounted in wall recesses, with same tile as scheduled for room proper.
10. Joints:
  - a. Keep all joints in line, straight, level, perpendicular and of even width unless shown otherwise on construction documents.
  - b. Make joints 2 mm (1/16 inch) wide for glazed wall tile and mosaic tile work.
  - c. Make joints in paver tile, porcelain type; maximum 3 mm (1/8 inch) wide.
11. Back Buttering: For installations indicated below, obtain 100 percent mortar coverage by complying with applicable special requirements for back buttering of tile in referenced ANSI A108/A118/A136 series of tile installation standards:
  - a. Tile wall installations in wet areas, including showers.
  - b. Tile installed with chemical-resistant mortars and grouts.
  - c. Tile wall installations composed of tiles 203 by 203 mm (8 by 8 inches) or larger.

### **3.7 CERAMIC TILE INSTALLED WITH PORTLAND CEMENT MORTAR**

- A. Mortar Mixes for Floor, Wall and Base Tile (including Showers):  
ANSI A108.1A. except specified otherwise.
- B. Installing Wall and Base Tile: ANSI A108.1A, except specified otherwise.
- C. Installing Floor Tile: ANSI A108.1A, except as specified otherwise.  
Slope mortar beds to floor drains at a minimum of 3 mm in 305 mm (1/8 inch per foot).

### **3.8 PORCELAIN TILE INSTALLED WITH LATEX PORTLAND CEMENT BONDING MORTAR**

- A. Due to the denseness of porcelain tile use latex portland cement bonding mortar that meets the requirements of ANSI A108.01. Mix bonding mortars in accordance with manufacturer's instructions. Provide liquid ratios and comply with dwell times during the placement of bonding mortar and tile.

### **3.9 THIN SET CERAMIC AND PORCELAIN TILE INSTALLED WITH DRY-SET PORTLAND CEMENT AND LATEX-PORTLAND CEMENT MORTAR:**

- A. Installation of Tile: ANSI A108.1B, except as specified otherwise.
- B. Slope tile work to drains at not less than 3 mm in 305 mm (1/8 inch per foot).

### **3.10 CERAMIC AND PORCELAIN TILE INSTALLED WITH ELASTOMERIC BOND COAT:**

- A. Surface Preparation: Prepare surfaces as specified.
- B. Installation of Elastomeric Membrane: ANSI A108.10 and TCNA F122-14 (on ground concrete) and F122A-14 (above-ground concrete).
  - 1. Prime surfaces, where required, in accordance with manufacturer's instructions.
  - 2. Install first coat of membrane material in accordance with manufacturer's instructions, in thickness of 0.76 to 1.3 mm (30 to 50 mils).
  - 3. Extend material over flashing rings of drains and turn up vertical surfaces not less than 101 mm (4 inches) above finish floor surface.
  - 4. When material has set, recoat areas with a second coat of elastomeric membrane material for a total thickness of 1.3 to 1.9 mm (50 to 75 mils).
  - 5. After curing test for leaks with 25 mm (1 inch) of water for 24 hours.

C. Installation of Tile in Elastomeric Membrane:

1. Spread no more material than can be covered with tile before material starts to set.
2. Apply tile in second coat of elastomeric membrane material in accordance with the coating manufacturer's instructions in lieu at aggregate surfacing specified in ASTM C1127. Do not install top coat over tile.

### 3.11 GROUTING

A. Grout Type and Location:

1. Grout for glazed wall and base tile, paver tile and unglazed mosaic tile, portland cement grout, latex-portland cement grout, dry-set grout, or commercial portland cement grout.

B. Workmanship:

1. Install and cure grout in accordance with the applicable standard.
2. Sand Portland Cement Grout: ANSI A108.10.
3. Standard Cement Grout: ANSI A118.6.
4. High Performance Grout: ANSI A118.7.
5. Water-Cleanable Epoxy Grout: ANSI A118.3.

### 3.12 MOVEMENT JOINTS

- A. Prepare tile expansion, isolation, construction and contraction joints for installation of sealant. Refer to Section 07 92 00, JOINT SEALANTS.
- B. TCNA details EJ 171-14.
- C. At expansion joints, rake out joint full depth of tile and setting bed and mortar bed. Do not cut waterproof or isolation membrane.
- D. Rake out grout at joints between tile, service sink, at toe of base, and where indicated in construction documents not less than 6 mm (1/4 inch) deep.

### 3.13 CLEANING

- A. Thoroughly sponge and wash tile. Polish glazed surfaces with clean dry cloths.
- B. Methods and materials used are not permitted to damage or impair appearance of tile surfaces.
- C. The use of acid or acid cleaners on glazed tile surfaces is prohibited.
- D. Clean tile grouted with epoxy, and commercial portland cement grout and tile set in elastomeric bond coat as recommended by the manufacturer of the grout and bond coat.

**3.14 PROTECTION**

- A. Keep traffic off tile floor, until grout and setting material is fully set and cured.
- B. Where traffic occurs over tile floor is unavoidable, cover tile floor with not less than 9 mm (3/8 inch) thick plywood, wood particle board, or hardboard securely taped in place. Do not remove protective cover until time for final inspection. Clean tile of any tape, adhesive and stains.

**3.15 TESTING FINISH FLOOR**

- A. Test floors in accordance with ASTM C627 to show compliance with codes 1 through 10.

- - - E N D - - -





**SECTION 09 51 00  
ACOUSTICAL CEILINGS**

**PART 1 - GENERAL**

**1.1 SUMMARY**

A. Section Includes:

1. Acoustical units.
2. Metal ceiling suspension system for acoustical ceilings.

**1.2 RELATED REQUIREMENTS**

- A. Color, Pattern, and Location of Each Type of Acoustical Unit: Section 09 06 00, SCHEDULE FOR FINISHES.
- B. Ceiling Suspension System: Section 09 22 16, NON-STRUCTURAL METAL FRAMING.

**1.3 APPLICABLE PUBLICATIONS**

- A. Comply with references to extent specified in this section.
- B. ASTM International (ASTM):
1. A641/A641M-09a(2014) - Zinc-coated (Galvanized) Carbon Steel Wire.
  2. A653/A653M-15e1 - Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-coated (Galvannealed) by the Hot-Dip Process.
  3. C423-09a - Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method.
  4. C634-13 - Terminology Relating to Environmental Acoustics.
  5. C635/C635M-13a - Manufacture, Performance, and Testing of Metal Suspension Systems for Acoustical Tile and Lay-in Panel Ceilings.
  6. C636/C636M-13 - Installation of Metal Ceiling Suspension Systems for Acoustical Tile and Lay-in Panels.
  7. D1779-98(2011) - Adhesive for Acoustical Materials.
  8. E84-15b - Surface Burning Characteristics of Building Materials.
  9. E119-16 - Fire Tests of Building Construction and Materials.
  10. E413-16 - Classification for Rating Sound Insulation.
  11. E580/E580M-14 - Installation of Ceiling Suspension Systems for Acoustical Tile and Lay-in Panels in Areas Subject to Earthquake Ground Motions.
  12. E1264-14 - Classification for Acoustical Ceiling Products.
- C. International Organization for Standardization (ISO):
1. ISO 14644-1 - Classification of Air Cleanliness.

**1.4 PREINSTALLATION MEETINGS**

- A. Conduct preinstallation meeting at project site minimum 30 days before beginning Work of this section.
  - 1. Required Participants:
    - a. Contracting Officer's Representative.
    - b. Architect/Engineer.
    - c. Contractor.
    - d. Installer.
    - e. Manufacturer's field representative.
    - f. Other installers responsible for adjacent and intersecting work, including sprinkler, HVAC, and lighting installers.
  - 2. Meeting Agenda: Distribute agenda to participants minimum 3 days before meeting.
    - a. Installation schedule.
    - b. Installation sequence.
    - c. Preparatory work.
    - d. Protection before, during, and after installation.
    - e. Installation.
    - f. Terminations.
    - g. Transitions and connections to other work.
    - h. Inspecting and testing.
    - i. Other items affecting successful completion.
  - 3. Document and distribute meeting minutes to participants to record decisions affecting installation.

**1.5 SUBMITTALS**

- A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Submittal Drawings:
  - 1. Show size, configuration, and fabrication and installation details.
- C. Manufacturer's Literature and Data:
  - 1. Description of each product.
  - 2. Ceiling suspension system indicating manufacturer recommendation for each application.
  - 3. Installation instructions.
  - 4. Warranty.

## D. Samples:

1. Acoustical units, 150 mm (6 inches) in size, each type.
  - a. Submit quantity required to show full color and texture range.
2. Suspension system, trim and molding, 300 mm (12 inches) long.
3. Colored markers for access service.
4. Approved samples may be incorporated into work.

## E. Certificates: Certify each product complies with specifications.

1. Acoustical units, each type.

## F. Qualifications: Substantiate qualifications comply with specifications.

1. Manufacturer.

## G. Operation and Maintenance Data:

1. Care instructions for each exposed finish product.

**1.6 QUALITY ASSURANCE**

## A. Manufacturer Qualifications:

1. Regularly manufactures specified products.
2. Manufactured specified products with satisfactory service on five similar installations for minimum five years.

**1.7 DELIVERY**

- A. Deliver products in manufacturer's original sealed packaging.
- B. Mark packaging, legibly. Indicate manufacturer's name or brand, type, color, production run number, and manufacture date.
- C. Before installation, return or dispose of products within distorted, damaged, or opened packaging.

**1.8 STORAGE AND HANDLING**

- A. Store products indoors in dry, weathertight conditioned facility.
- B. Protect products from damage during handling and construction operations.

**1.9 FIELD CONDITIONS**

## A. Environment:

1. Product Temperature: Minimum 21 degrees C (70 degrees F) for minimum 48 hours before installation.
2. Work Area Ambient Conditions: HVAC systems are complete, operational, and maintaining facility design operating conditions continuously, beginning 48 hours before installation until Government occupancy.
3. Install products when building is permanently enclosed and when wet construction is completed, dried, and cured.

**1.10 WARRANTY**

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."

**PART 2 - PRODUCTS****2.1 SYSTEM DESCRIPTION**

- A. Ceiling System: Acoustical ceilings units on exposed grid suspension systems.

**2.2 SYSTEM PERFORMANCE**

- A. Design product complying with specified performance:
  - 1. Maximum Deflection: 1/360 of span, maximum.
- B. Fire Resistance: ASTM E119; as component of roof-ceiling assembly.
- C. Surface Burning Characteristics: When tested according to ASTM E84.
  - 1. Flame Spread Rating: 25 maximum.
  - 2. Smoke Developed Rating: 450 maximum.

**2.3 PRODUCTS - GENERAL**

- A. Basis of Design: Section 09 06 00, SCHEDULE FOR FINISHES.
- B. Provide acoustical units from one manufacturer.
  - 1. Provide each product exposed to view from one production run.
- C. Provide suspension system from same manufacturer.

**2.4 ACOUSTICAL UNITS**

- A. General:
  - 1. Ceiling Panel and Tile: ASTM E1264, bio-based content according to USDA Bio-Preferred Product requirements.
    - a. Mineral Fiber: 3.6 kg/sq. m (3/4 psf) weight, minimum.
  - 2. Classification: Provide type and form as follows:
    - a. Type III Units - Mineral base with water-based painted finish maximum 10 g/l VOC; Form 2 - Water felted, minimum 16 mm (5/8 inch) thick.
    - b. Type IV Units - Mineral base with membrane-faced overlay, Form 2 - Water felted, minimum 16 mm (5/8 inch) thick. Apply poly (vinyl) chloride over paint coat.
    - c. NRC (Noise Reduction Coefficient): ASTM C423, minimum 0.55.
    - d. CAC (Ceiling Attenuation Class): ASTM E413, 33-42 range.
    - e. LR (Light Reflectance): Minimum 0.78.
  - 3. Lay-in panels: Sizes as indicated on Drawings, with square edges and reveal edges.

- B. SPECIAL FACED ACOUSTICAL TILE UNITS: Anti-microbial coated surfaces suitable for use in Class 5 Clean Rooms per ISO 14644-1. Special faced acoustical tile units shall meet all general requirements stated in this specification.

1. Type XX Units - Gypsum based units.
  - a. Thickness: 12.7 mm (1/2 inches) minimum.

## 2.5 METAL SUSPENSION SYSTEM

- A. General: ASTM C635, heavy-duty system, except as otherwise specified.
1. Suspension System: Provide the following:
    - a. Galvanized cold-rolled steel, bonderized.
  2. Main and Cross Runner: Use same construction Do not use lighter-duty sections for cross runners.
- B. Exposed Grid Suspension System: Support of lay-in panels.
1. Grid Width: 22 mm (7/8 inch) minimum with 8 mm (5/16 inch) minimum panel bearing surface.
  2. Molding: Fabricate from the same material with same exposed width and finish.
  3. Finish: Baked-on enamel flat texture finish.
    - a. Color: To match adjacent acoustical units unless specified otherwise in Section 09 06 00, SCHEDULE FOR FINISHES.
- C. Carrying Channels Secondary Framing: Cold-rolled or hot-rolled steel, black asphaltic paint finish, rust free.
1. Weight per 300 m (per thousand linear feet), minimum:

Size		Cold-rolled		Hot-rolled	
Mm	inches	kg	pound	Kg	pound
38	1-1/2	215.4	475	508	1120
50	2	267.6	590	571.5	1260

- D. Anchors and Inserts: Provide anchors or inserts to support twice the loads imposed by hangers.
1. Hanger Inserts: Steel, zinc-coated (galvanized after fabrication).
    - a. Nailing type option for wood forms:
      - 1) Upper portion designed for anchorage in concrete and positioning lower portion below surface of concrete approximately 25 mm (one inch).
      - 2) Lower portion provided with minimum 8 mm (5/16 inch) hole to permit attachment of hangers.

b. Flush ceiling insert type:

- 1) Designed to provide a shell covered opening over a wire loop to permit attachment of hangers and keep concrete out of insert recess.
- 2) Insert opening inside shell approximately 16 mm (5/8 inch) wide by 9 mm (3/8 inch) high over top of wire.
- 3) Wire 5 mm (3/16 inch) diameter with length to provide positive hooked anchorage in concrete.

E. Clips: Galvanized steel, designed to secure framing member in place.

F. Wire: ASTM A641.

1. Size:

- a. Wire Hangers: Minimum diameter 2.68 mm (0.1055 inch).
- b. Bracing Wires: Minimum diameter 3.43 mm (0.1350 inch).

## 2.6 ACCESSORIES

A. Perimeter Seal: Vinyl, polyethylene or polyurethane open cell sponge material, density of 1.3 plus or minus 10 percent, compression set less than 10 percent with pressure sensitive adhesive coating on one side.

1. Thickness: As required to fill voids between back of wall molding and finish wall.
2. Size: Minimum 9 mm (3/8 inch) wide strip.

B. Access Identification Markers: Colored markers with pressure sensitive adhesive on one side, paper or plastic, 6 to 9 mm (1/4 to 3/8 inch) diameter.

1. Color Code: Provide the following color markers for service identification:

Color	Service
Red	Sprinkler System: Valves and Controls
Green	Domestic Water: Valves and Controls
Yellow	Chilled Water and Heating Water
Orange	Ductwork: Fire Dampers
Blue	Ductwork: Dampers and Controls
Black	Gas: Laboratory, Medical, Air and Vacuum

## PART 3 - EXECUTION

### 3.1 PREPARATION

- A. Examine and verify substrate suitability for product installation.
- B. Protect existing construction and completed work from damage.

C. Remove existing acoustical panels and suspension system to permit new installation.

1. Where noted on drawings, retain existing acoustical panels and suspension system for reuse.
2. Dispose of other removed materials.

### **3.2 INSTALLATION - GENERAL**

A. Install products according to manufacturer's instructions and approved submittal drawings.

1. When manufacturer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.

### **3.3 ACOUSTICAL UNIT INSTALLATION**

A. Applications:

1. Cut acoustic units for perimeter borders and penetrations to fit tight against penetration for joint not concealed by molding.

B. Layout acoustical unit symmetrically, with minimum number of joints.

C. Installation:

1. Install acoustic tiles after wet finishes have been installed and solvents have cured.
2. Install lay-in acoustic panels in exposed grid with minimum 6 mm (1/4 inch) bearing at edges on supports.
  - a. Install tile to lay level and in full contact with exposed grid.
  - b. Replace cracked, broken, stained, dirty, or tile.
3. Markers:
  - a. Install color coded markers to identify the various concealed piping, mechanical, and plumbing systems.
  - b. Attach colored markers to exposed grid on opposite sides of the units providing access.
  - c. Attach marker on exposed ceiling surface of upward access acoustical unit.

D. Touch up damaged factory finishes.

1. Repair painted surfaces with touch up primer.

### 3.4 CEILING SUSPENSION SYSTEM INSTALLATION

#### A. General: Install according to ASTM C636.

1. Use direct or indirect hung suspension system or combination of both.
2. Support a maximum area of 1.48 sq. m (16 sq. ft.) of ceiling per hanger.
3. Prevent deflection in excess of 1/360 of span of cross runner and main runner.
4. Provide additional hangers located at each corner of support components.
5. Provide minimum 100 mm (4 inch) clearance from the exposed face of the acoustical units to the underside of ducts, pipe, conduit, secondary suspension channels, concrete beams or joists; and steel beam or bar joist unless furred system is shown.
6. Provide main runners minimum 1200 mm (48 inches) in length.
7. Install hanger wires vertically. Angled wires are not acceptable except for seismic restraint bracing wires.

#### B. Direct Hung Suspension System: ASTM C635.

1. Support main runners by hanger wires attached directly to the structure overhead.
2. Maximum spacing of hangers, 1200 mm (4 feet) on centers unless interference occurs by mechanical systems. Use indirect hung suspension system where not possible to maintain hanger spacing.

#### C. Anchorage to Structure:

1. Concrete:
  - a. Install hanger inserts and wire loops required for support of hanger and bracing wire. Install hanger wires with looped ends through steel deck when steel deck does not have attachment device.
  - b. Use eye pins or threaded studs with screw-on eyes in existing or already placed concrete structures to support hanger and bracing wire. Install in sides of concrete beams or joists at mid height.



## 2. Steel:

- a. Install carrying channels for attachment of hanger wires.
  - 1) Size and space carrying channels to support load within performance limit.
  - 2) Attach hangers to steel carrying channels, spaced four feet on center, unless area supported or deflection exceeds the amount specified.
- b. Attach carrying channels to the bottom flange of steel beams spaced not 1200 mm (4 feet) on center before fireproofing is installed. Weld or use steel clips for beam attachment.
- c. Attach hangers to bottom chord of bar joists or to carrying channels installed between the bar joists when hanger spacing prevents anchorage to joist. Rest carrying channels on top of the bottom chord of the bar joists, and securely wire tie or clip to joist.

## D. Indirect Hung Suspension System: ASTM C635.

- 1. Space carrying channels for indirect hung suspension system maximum 1200 mm (4 feet) on center. Space hangers for carrying channels maximum 2400 mm (8 feet) on center or for carrying channels less than 1200 mm (4 feet) on center so as to ensure that specified requirements are not exceeded.
- 2. Support main runners by specially designed clips attached to carrying channels.

## 3.5 CEILING TREATMENT

### A. Moldings:

- 1. Install metal wall molding at perimeter of room, column, or edge at vertical surfaces.
- 2. Install special shaped molding at changes in ceiling heights and at other breaks in ceiling construction to support acoustical units and to conceal their edges.

### B. Perimeter Seal:

- 1. Install perimeter seal between vertical leg of wall molding and finish wall, partition, and other vertical surfaces.
- 2. Install perimeter seal to finish flush with exposed faces of horizontal legs of wall molding.

C. Existing Ceiling:

1. Where extension of existing ceilings occurs, match existing.
2. Where acoustical units are salvaged and reinstalled or joined, use salvaged units within a space. Do not mix new and salvaged units within a space which results in contrast between old and new acoustic units.
3. Comply with specifications for new acoustical units for new units required to match appearance of existing units.

**3.6 CLEANING**

- A. Remove excess adhesive before adhesive sets.
- B. Clean exposed surfaces. Remove contaminants and stains.

- - - E N D - - -

**SECTION 09 65 13  
RESILIENT BASE AND ACCESSORIES**

**PART 1 - GENERAL**

**1.1 SUMMARY**

A. Section Includes:

1. Resilient base (RB) adhered to interior walls and partitions.

**1.2 RELATED REQUIREMENTS**

- A. Sheet Flooring Integral Base: Section 09 65 16, RESILIENT SHEET FLOORING.
- B. Section 09 65 19, RESILIENT TILE FLOORING.

**1.3 APPLICABLE PUBLICATIONS**

- A. Comply with references to extent specified in this section.
- B. ASTM International (ASTM):
  1. F1344-15 - Rubber Floor Tile.
  2. F1859-14 - Rubber Sheet Floor Covering without Backing.
  3. F1860-14 - Rubber Sheet Floor Covering with Backing.
  4. F1861-08(2012)e1 - Resilient Wall Base.
  5. D4259-88(2012) - Abrading Concrete.
- C. Federal Specifications (Fed. Spec.):
  1. RR-T-650E - Treads, Metallic and Non-Metallic, Skid-Resistant.
- D. International Concrete Repair Institute (ICRI):
  1. 310.2R-13 - Selecting and Specifying Concrete Surface Preparation for Sealers, Coatings, and Polymer Overlays.

**1.4 SUBMITTALS**

- A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
  1. Description of each product.
  2. Adhesives and primers indicating manufacturer's recommendation for each application.
  3. Installation instructions.
- C. Samples:
  1. Resilient Base: 150 mm (6 inches) long, each type and color.
- D. Operation and Maintenance Data:
  1. Care instructions for each exposed finish product.

**1.5 DELIVERY**

- A. Deliver products in manufacturer's original sealed packaging.
- B. Mark packaging, legibly. Indicate manufacturer's name or brand, type, color, production run number, and manufacture date.
- C. Before installation, return or dispose of products within distorted, damaged, or opened packaging.

**1.6 STORAGE AND HANDLING**

- A. Store products indoors in dry, weathertight facility.
- B. Protect products from damage when handling and during construction operations.

**1.7 FIELD CONDITIONS**

- A. Environment:
  - 1. Product Temperature: Minimum 21 degrees C (70 degrees F) for minimum 48 hours before installation.
  - 2. Work Area Ambient Temperature Range: 21 to 27 degrees C (70 to 80 degrees F) continuously, beginning 48 hours before installation.
  - 3. Install products when building is permanently enclosed and when wet construction is completed, dried, and cured.

**1.8 WARRANTY**

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."

**PART 2 - PRODUCTS****2.1 PRODUCTS**

- A. Basis of Design: Section 09 06 00, SCHEDULE FOR FINISHES.
- B. Provide each product from one manufacturer and from one production run.

**2.2 RESILIENT BASE**

- A. Resilient Base: 3 mm (1/8 inch) thick, 100 mm (4 inches) high.
  - 1. Type: Rubber or vinyl; use one type throughout.
  - 2. ASTM F1861, Type TP thermoplastic rubber or Type TV thermoplastic vinyl, Group 2 - layered.
- B. Applications:
  - 1. Carpet Flooring Locations: Style A - Straight.
  - 2. Other Locations: Style B - Cove.

### **2.3 ADHESIVES**

- A. Adhesives: Low pollutant-emitting, water-based type recommended by adhered product manufacturer for each application.

## **PART 3 - EXECUTION**

### **3.1 PREPARATION**

- A. Examine and verify substrate suitability for product installation.
- B. Protect existing construction and completed work from damage.
- C. Remove existing base to permit new installation.
  - 1. Dispose of removed materials.
- D. Correct substrate deficiencies.
  - 1. Fill cracks, pits, and depressions with leveling compound.
  - 2. Remove protrusions; grind high spots.
  - 3. Apply leveling compound to achieve 3 mm (1/8 inch) in 3 m (10 feet) maximum surface variation.
- E. Clean substrates. Remove contaminants capable of affecting subsequently installed product's performance.
- F. Allow substrate to dry and cure.

### **3.2 INSTALLATION GENERAL**

- A. Install products according to manufacturer's instructions.
  - 1. When instructions deviate from specifications, submit proposed resolution for Contracting Officer consideration.

### **3.3 RESILIENT BASE INSTALLATION**

- A. Applications:
  - 1. Install resilient base in rooms scheduled on Drawings.
  - 2. Install resilient base on casework toe spaces, and other curb supported fixed equipment.
  - 3. Extend resilient base into closets, alcoves, and cabinet knee spaces, and around columns within scheduled room.
- B. Lay out resilient base with minimum number of joints.
  - 1. Length: 600 mm (24 inches) minimum, each piece.
  - 2. Locate joints 150 mm (6 inches) minimum from corners and intersection of adjacent materials.

## C. Installation:

1. Apply adhesive uniformly for full contact between resilient base and substrate.
2. Set resilient base with hairline butted joints aligned along top edge.

## D. Field or factory form corners and end stops.

1. V-groove back of outside corner.
2. V-groove face of inside corner and notch cove for miter joint.

## E. Roll resilient base ensuring complete adhesion.

**3.4 CLEANING**

- A. Remove excess adhesive before adhesive sets.
- B. Clean exposed resilient base and surfaces. Remove contaminants and stains.
  1. Clean with mild detergent. Leave surfaces free of detergent residue.

**3.5 PROTECTION**

- A. Protect products from construction traffic and operations.
- B. Replace damaged products and re-clean.
  1. Damaged Products include cut, gouged, scraped, torn, and unbonded products.

- - E N D - -

**SECTION 09 65 16  
RESILIENT SHEET FLOORING**

**PART 1 - GENERAL**

**1.1 SUMMARY**

A. Section Includes:

1. Welded seam sheet flooring (WSF) with heat welded seams and integral cove base.

**1.2 RELATED REQUIREMENTS**

- A. Color, Pattern and Texture: Section 09 06 00, SCHEDULE FOR FINISHES.
- B. Resilient Base Over Base of Lockers, Equipment and Casework: Section 09 65 13, RESILIENT BASE AND ACCESSORIES.

**1.3 APPLICABLE PUBLICATIONS**

- A. Comply with references to extent specified in this section.
- B. ASTM International (ASTM):
1. D4259-88(2012) - Abrading Concrete.
  2. E648-15e1 - Standard Test Method for Critical Radiant Flux of Floor-Covering Systems Using a Radiant Heat Energy Source.
  3. E662-15a - Standard Test Method for Specific Optical Density of Smoke Generated by Solid Materials.
  4. F1303-04(2014) - Sheet Vinyl Floor Covering with Backing.
  5. F1860-14 - Rubber Sheet Floor Covering With Backing.
  6. F1913-04(2014) - Vinyl Sheet Floor Covering Without Backing.
- C. International Concrete Repair Institute (ICRI):
1. 310.2R-13 - Selecting and Specifying Concrete Surface Preparation for Sealers, Coatings, and Polymer Overlays, and Concrete Repair.
- D. SCS Global Services (SCS):
1. FloorScore.

**1.4 SUBMITTALS**

- A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
1. Show size, configuration, and fabrication and installation details.
- B. Manufacturer's Literature and Data:
1. Description of each product.
  2. Installation instructions.
  3. Warranty.

## C. Samples:

1. Sheet material, 38 mm by 300 mm (1-1/2 inch by 12 inch), of each color and pattern with welded seam using specified welding rod
2. Cap strip and fillet strip, 300 mm (12 inches) for integral base.
3. Shop Drawings and Certificates: Layout of joints showing patterns where joints are expressed, and type and location of obscure type joints. Indicate orientation of directional patterns.
4. Certificates: Quality Control Certificate Submittals and lists specified in paragraph, QUALIFICATIONS.
5. Edge Strips: 150 mm (6 inches) long each type.
6. Primer: Pint container, each type.

## D. Certificates: Certify products comply with specifications.

1. Heat welded seaming is manufacturer's prescribed method of installation.

## E. Qualifications: Substantiate qualifications comply with specifications.

1. Manufacturer.
2. Installer.

**1.5 QUALITY ASSURANCE**

## A. Manufacturer Qualifications:

1. Manufactured specified products with satisfactory service on five similar installations for minimum five years.

## B. Installer Qualifications:

1. Regularly installs specified products and is approved by the manufacturer.

**1.6 DELIVERY**

- A. Deliver products in manufacturer's original sealed packaging.
- B. Mark packaging, legibly. Indicate manufacturer's name or brand, type, color, production run number, and manufacture date.
- C. Before installation, return or dispose of products within distorted, damaged, or opened packaging.

**1.7 STORAGE AND HANDLING**

- A. Store products indoors in dry, weathertight conditioned facility.
- B. Protect products from damage during handling and construction operations.



**1.8 FIELD CONDITIONS****A. Environment:**

1. Work Area Ambient Temperature Range: Minimum 18 to 38 degrees C (65 to 100 degrees F) continuously, beginning 48 hours before installation. Maintain room temperature above 18 degrees C (65 degrees F) after installation.
2. Install products when building is permanently enclosed and when wet construction is completed, dried, and cured.

**1.9 WARRANTY**

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."
- B. Manufacturer's Warranty: Warrant resilient sheet flooring against material and manufacturing defects.
  1. Warranty Period: 2 years.

**PART 2 - PRODUCTS****2.1 SYSTEM PERFORMANCE**

- A. Sheet Flooring:
  1. Critical Radiant Flux: ASTM E648; 0.45 watts per sq.cm or more, Class I.
  2. Smoke Density: ASTM E662; less than 450.

**2.2 PRODUCTS - GENERAL**

- A. Basis of Design: Section 09 06 00, SCHEDULE FOR FINISHES.
- B. Provide vinyl sheet color and pattern from one production run.

**2.3 RESILIENT SHEET FLOORING**

- A. Resilient Sheet Flooring (RSF1): ASTM F1303; Type I, Grade 1, vinyl.
  1. Wear Surface: Smooth.
  2. Wear Layer Thickness: Minimum 0.80 mm (0.0832 inches).
  3. Total Thickness: 2 mm (0.080 inches).
- B. Resilient Sheet Flooring (RSF2): ASTM F1913; Vinyl, without backing.
  1. Wear Surface: Smooth.
  2. Thickness: 2 mm (0.080 inches).
- C. Sheet Size: Provide maximum size sheet produced by manufacturer to minimize joints.
  1. Minimum Width: 1200 mm (48 inches).

## 2.4 ACCESSORIES

- A. Welding Rod: Flooring manufacturer's standard, in color matching field color of sheet flooring.
- B. Adhesives: Water resistant type recommended by flooring manufacturer to suit application.
  - 1. At RSF1 provide water resistant type recommended by flooring manufacturer to suit application.
  - 2. At RSF2 provide two-part urethane type adhesive recommended by flooring manufacturer to suit application.
- C. Base Accessories:
  - 1. Fillet Strip: 19 mm (3/4 inch) radius fillet strip compatible with flooring material.
  - 2. Cap Strip: J-Shape extruded flanged reducer strip compatible with flooring material approximately 25 mm (1 inch) exposed height with 13 mm (1/2 inch) flange.
- D. Leveling Compound:
  - 1. Provide cementitious type with latex or polyvinyl acetate resins additive.
- E. Primer:
  - 1. Type recommended by adhesive or flooring manufacturer.
- F. Edge Strips:
  - 1. Extruded aluminum, mill finish, mechanically cleaned.
  - 2. 28 mm (1-1/8 inch) wide, 6 mm (1/4 inch) thick, bevel one edge to 3 mm (1/8 inch) thick.
  - 3. Drill and counter sink edge strips for flat head screws. Space holes near ends and approximately 225 mm (9 inches) on center.
  - 4. Fasteners: Stainless steel, type to suit application.
- G. Sealant:
  - 1. As specified in Section 07 92 00, JOINT SEALANTS.
  - 2. Compatible with flooring.

## PART 3 - EXECUTION

### 3.1 PREPARATION

- A. Examine and verify substrate suitability for product installation.
- B. Protect existing construction and completed work from damage.
- C. Remove existing sheet flooring to permit new installation.
  - 1. Do not use solvents for removing adhesives.
  - 2. Dispose of removed materials.

- D. Ensure interior finish work such as plastering, drywall finishing, concrete, terrazzo, ceiling work, and painting work is complete and dry before installation.
  - 1. Complete mechanical, electrical, and other work above ceiling line.
  - 2. Ensure heating, ventilating, and air conditioning systems are installed and operating in order to maintain temperature and humidity requirements.
- E. Correct substrate deficiencies.
  - 1. Fill cracks, pits, and dents with leveling compound.
  - 2. Grind, sand, or cut away protrusions. Grind high spots.
  - 3. Level flooring substrate to 3 mm (1/8 inch) maximum variation.
- F. Clean substrates. Remove contaminants capable of affecting subsequently installed product's performance.
  - 1. Mechanically clean concrete floor substrate according to ASTM D4259.
  - 2. Surface Profile: ICRI 310.2R CSP 3 to CSP 4.
- G. Perform flooring manufacturer's recommended bond, substrate moisture content, and pH tests.
- H. Broom or vacuum clean substrates immediately before flooring installation.
- I. Primer: Apply primer according to manufacturer's instructions.

### **3.2 INSTALLATION - GENERAL**

- A. Install products according to manufacturer's instructions.
  - 1. When manufacturer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.

### **3.3 INSTALLATION OF FLOORING**

- A. Flooring Layout:
  - 1. Arrange pattern in one direction with side and end joints pattern matched.
  - 2. Extend flooring wall-to-wall, under cabinets, casework, laboratory and pharmacy furniture, and other equipment for seamless flooring installation.
  - 3. Arrange sheets to minimize seams.
  - 4. Locate seams in inconspicuous and low traffic areas, minimum 150 mm (6 inches) away from parallel joints in flooring substrates.
- B. Match edges of flooring for color shading and pattern at seams.
- C. Install flooring flush with adjacent floor finishes.

- D. Extend flooring into toe spaces, door reveals, closets, and similar openings.
- E. Install flooring fully adhered to substrate.
  - 1. Air pockets or loose edges are not acceptable.
  - 2. Trim sheet materials tight to flooring penetrations; seal joints at pipe with waterproof sealant specified in Section 07 92 00, JOINT SEALANTS.
- F. Butt joints tight, without gaps and bulges.
- G. Installation of Edge Strips:
  - 1. Install edge strips at flooring terminations and transitions to other floor finishes.
  - 2. Locate edge strips under center lines of doors unless otherwise indicated.
  - 3. Set edge strips in adhesive and mechanically fasten to substrate.

### **3.4 INTEGRAL COVE BASE INSTALLATION**

- A. Set preformed fillet strip at floor intersection with walls and other vertical surfaces
- B. Extend flooring over fillet strip and 100 mm (4 inches) up wall surface.
- C. Form straight or radius internal and external corners to suit Application.
- D. Adhere base to wall surface.
- E. Terminate base exposed top edge with cap strip. Seal cap strip to wall with sealant.
- F. Weld joints as specified for flooring.

### **3.5 HEAT WELDING**

- A. Heat weld joints of flooring and base using welding rod.
- B. Rout joint, insert welding rod into routed space, and fuse flooring and welding rods for seamless, watertight installation.
  - 1. Fuse joints for seamless weld.
- C. Finish joints flush, free from voids, and recessed or raised areas.

**3.6 CLEANING**

- A. Remove excess adhesive before adhesive sets.
- B. Clean and polish materials.
- C. Vacuum floor thoroughly.
- D. Perform initial maintenance according to flooring manufacturer's instructions.
  - 1. Delay washing flooring until adhesive is fully set and welded joints can contain wash water.

**3.7 PROTECTION**

- A. Protect flooring from traffic and construction operations.
- B. Keep traffic off sheet flooring for minimum 24 hours after installation.
- C. Cover flooring with reinforced kraft paper, and plywood or hardboard.
- D. Remove protective materials immediately before acceptance.
- E. Repair damage.
- F. Buff flooring to uniform sheen when recommended by manufacturer.

- - E N D - -



**SECTION 09 65 19  
RESILIENT TILE FLOORING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the installation of luxury vinyl tile and accessories required for a complete installation.

**1.2 RELATED WORK**

- A. Resilient Base: Section 09 65 13, RESILIENT BASE AND ACCESSORIES.
- B. Subfloor Testing and Preparation: Section 09 05 16, SUBSURFACE PREPARATION FOR FLOOR FINISHES.
- C. Color, Pattern and Texture for Resilient Tile Flooring and Accessories: Section 09 06 00, SCHEDULE FOR FINISHES.

**1.3 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
  - 1. Description of each product.
  - 2. Resilient material manufacturer's recommendations for adhesives, underlayment, primers, and polish.
  - 3. Application, installation and maintenance instructions.
- C. Samples:
  - 1. Tile: Each type, color, thickness and finish.
  - 2. Edge Strips: Each type, color, thickness and finish.
  - 3. Feature Strips: Each type, color, thickness and finish.
- D. Shop Drawings:
  - 1. Layout of patterns as shown on the construction documents.
  - 2. Edge strip locations showing types and detail cross sections.
- E. Test Reports:
  - 1. Abrasion resistance: Depth of wear for each tile type and color and volume loss of tile, certified by independent laboratory. Tested per ASTM F510/F510M.
  - 2. Moisture and pH test results as per Section 09 05 16, SUBSURFACE PREPARATION FOR FLOOR FINISHES.

**1.4 DELIVERY**

- A. Deliver materials to the site in original sealed packages or containers, clearly marked with the manufacturer's name or brand, type and color, production run number and date of manufacture.
- B. Materials from containers which have been distorted, damaged or opened prior to installation are not acceptable.

**1.5 STORAGE**

- A. Store materials in a clean, dry, enclosed space off the ground, protected from harmful weather conditions and at temperature and humidity conditions recommended by the manufacturer. Protect adhesives from freezing. Store flooring, adhesives, and accessories in the spaces where they will be installed for at least 48 hours before beginning installation.

**1.6 QUALITY ASSURANCE**

- A. Installer Qualifications: A company specializing in installation with minimum three (3) years' experience and employs experienced flooring installers who have retained, and currently hold, an INSTALL Certification, or a certification from a comparable certification program.
  - 1. Installers to be certified by INSTALL or a comparable certification program with the following minimum criteria:
    - a. US Department of Labor approved four (4) year apprenticeship program, 160 hours a year.
    - b. Career long training.
    - c. Manufacturer endorsed training.
    - d. Fundamental journeyman skills certification.
- B. Furnish product type materials from the same production run.

**1.7 WARRANTY**

- A. Construction Warranty: Comply with FAR clause 52.246-21, "Warranty of Construction".

**1.8 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. ASTM International (ASTM):
  - D2047-11.....Test Method for Static Coefficient of Friction of Polish-Coated Flooring Surfaces as Measured by the James Machine



- D2240-05(R2010).....Test Method for Rubber Property—Durometer Hardness
- D4078-02(R2008).....Water Emulsion Floor Finish
- E648-14c.....Critical Radiant Flux of Floor Covering Systems Using a Radiant Energy Source
- E662-14.....Specific Optical Density of Smoke Generated by Solid Materials
- E1155/E1155M-14.....Determining Floor Flatness and Floor Levelness Numbers
- F510/F510M-14.....Resistance to Abrasion of Resilient Floor Coverings Using an Abrader with a Grit Feed Method
- F710-11.....Preparing Concrete Floors to Receive Resilient Flooring
- F925-13.....Test Method for Resistance to Chemicals of Resilient Flooring
- F1344-12(R2013).....Rubber Floor Tile
- F1700-13a.....Solid Vinyl Floor Tile
- F1869-11.....Test Method for Measuring Moisture Vapor Emission Rate of Concrete Subfloor Using Anhydrous Calcium Chloride
- F2170-11.....Test Method for Determining Relative Humidity in Concrete Floor Slabs Using in Situ Probes
- F2195-13.....Linoleum Floor Tile
- C. Code of Federal Regulation (CFR):
- 40 CFR 59.....Determination of Volatile Matter Content, Water Content, Density Volume Solids, and Weight Solids of Surface Coating

D. International Standards and Training Alliance (INSTALL):

## **PART 2 - PRODUCTS**

### **2.1 PERFORMANCE REQUIREMENTS**

- A. Provide adhesives, underlayment, primers, and polish recommended by resilient floor material manufacturer.
- B. Critical Radiant Flux: 0.45 watts per sq. cm or more, Class I, per ASTM E648.
- C. Smoke Density: Less than 450 per ASTM E662.
- D. Slip Resistance - Not less than 0.5 when tested with ASTM D2047.

**2.2 LUXURY VINYL TILE**

- A. ASTM F1700, Class III, Printed Film Vinyl Tile, Type B.
- B. Thickness: 12 mil (1/8 inch).
- C. Size: Refer to Finish Legend.

**2.3 ADHESIVES**

- A. Provide water resistant type adhesive for flooring, base and accessories as recommended by the manufacturer to suit substrate conditions. VOC content to be less than the 50 grams/L when calculated according to 40 CFR 59 (EPA Method 24). Submit manufacturer's descriptive data, documentation stating physical characteristics, and mildew and germicidal characteristics.

**2.4 PRIMER FOR CONCRETE SUBFLOORS**

- A. Provide in accordance with Section 09 05 16, SUBSURFACE PREPARATION FOR FLOOR FINISHES.

**2.5 LEVELING COMPOUND FOR CONCRETE FLOORS**

- A. Provide cementitious products with latex or polyvinyl acetate resins in the mix in accordance with Section 09 05 16, SUBSURFACE PREPARATION FOR FLOOR FINISHES.

**2.6 POLISH AND CLEANERS**

- A. Cleaners: As recommended in writing by floor tile manufacturer.

**2.7 MOULDING**

- A. Provide tapered mouldings of vinyl, rubber, -colored anodized aluminum, clear anodized aluminum and types as indicated on the construction documents for both edges and transitions of flooring materials specified. Provide vertical lip on moulding of maximum 6 mm (1/4 inch). Provide bevel change in level between 6 and 13 mm (1/4 and 1/2 inch) with a slope no greater than 1:2.
- B. Fasteners for Aluminum Mouldings: Stainless steel of type required for substrate condition.

**PART 3 - EXECUTION****3.1 ENVIRONMENTAL REQUIREMENTS**

- A. Maintain flooring materials and areas to receive resilient flooring at a temperature above 20 degrees C (68 degrees F) for three (3) days before application, during application and two (2) days after application, unless otherwise directly by the flooring manufacturer for the flooring being installed. Maintain a minimum temperature of 13 degrees C (55 degrees F) thereafter. Provide adequate ventilation to remove moisture from area and to comply with regulations limiting concentrations of hazardous vapors.
- B. Do not install flooring until building is permanently enclosed and wet construction in or near areas to receive tile materials is complete, dry and cured.

**3.2 SUBFLOOR TESTING AND PREPARATION**

- A. Prepare and test surfaces to receive resilient tile and adhesive as per Section 09 05 16, SUBSURFACE PREPARATION FOR FLOOR FINISHES.
  - 1. Remove existing resilient floor and existing adhesive.
- B. Prepare concrete substrates in accordance with ASTM F710.

**3.3 INSTALLATION**

- A. Install in accordance with manufacturer's instructions for application and installation unless specified otherwise.
- B. Mix tile from at least two containers. An apparent line either of shades or pattern variance is not acceptable.
- C. Tile Layout:
  - 1. If layout is not shown on construction documents, lay tile symmetrically about center of room or space with joints aligned.
  - 2. Vary edge width as necessary to maintain full size tiles in the field, no edge tile to be less than 1/2 the field tile size, except where irregular shaped rooms make it impossible.
  - 3. Place tile pattern in the same direction; do not alternate tiles unless specifically indicated in the construction documents to the contrary.
- D. Application:
  - 1. Adhere floor tile to flooring substrates using a full spread of adhesive applied to substrate to produce a completed installation without open cracks, voids, raising and puckering at joints, telegraphing of adhesive spreader marks, and other surface imperfections.

2. Scribe, cut, and fit floor tiles to butt neatly and tightly to vertical surfaces and permanent fixtures including built-in furniture, cabinets, pipes, outlets, and door frames.
  3. Extend floor tiles into toe spaces, door reveals, closets, and similar openings. Extend floor tiles to center of door openings.
  4. Roll tile floor with a minimum 45 kg (100 pound) roller.
- E. Seal joints at pipes with sealants in accordance with Section 07 92 00, JOINT SEALANTS.
- F. Installation of Edge Strips:
1. Locate edge strips under center line of doors unless otherwise shown on construction documents.
  2. Set resilient edge strips in adhesive. Anchor metal edge strips with anchors and screws.
  3. Where tile edge is exposed, butt edge strip to touch along tile edge.
  4. Where thin set ceramic tile abuts resilient tile, set edge strip against floor file and against the ceramic tile edge.

### **3.4 CLEANING AND PROTECTION**

- A. Clean adhesive marks on exposed surfaces during the application of resilient materials before the adhesive sets. Exposed adhesive is not acceptable.
- B. Keep traffic off resilient material for a minimum 72 hours after installation.
- C. Clean flooring as recommended in accordance with manufacturer's printed maintenance instructions and within the recommended time frame. As required by the manufacturer, apply the recommended number of coats and type of polish and/or finish in accordance with manufacturer's written instructions.
- D. When construction traffic occurs over tile, cover resilient materials with reinforced kraft paper properly secured and maintained until removal is directed by COR. At entrances and where wheeled vehicles or carts are used, cover tile with plywood, hardboard, or particle board over paper, secured and maintained until removal is directed by COR.
- E. When protective materials are removed and immediately prior to acceptance, replace damaged tile and mouldings, re-clean resilient materials.

### 3.5 LOCATION

- A. Unless otherwise indicated in construction documents, install tile flooring, under areas where casework, and other equipment occur.
- B. Extend tile flooring for room into adjacent closets and alcoves.

- - - E N D - - -



**SECTION 09 68 00  
CARPETING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Section specifies carpet, edge strips, adhesives, and other items required for complete installation.

**1.2 RELATED WORK**

- A. Manufacturer, Color and Style of Carpet and Edge Strip: Section 09 06 00, SCHEDULE FOR FINISHES.
- B. Resilient Wall Base: Section 09 65 13, RESILIENT BASE AND ACCESSORIES.
- C. Testing of Concrete Floors Before Installation: Section 09 05 16, SUBSURFACE PREPARATION FOR FLOOR FINISHES.

**1.3 QUALITY ASSURANCE**

- A. Installer Qualifications: A company specializing in carpet installation with a minimum three (3) years' experience and employing experienced flooring installers who have retained, and currently hold, an INSTALL Certification, or a certification from a comparable certification program, and a valid OSHA 10 certification.
  - 1. Installers to be certified by INSTALL or a comparable certification program with the following minimum criteria:
    - a. US Department of Labor approved four (4) year apprenticeship program, 160 hours a year.
    - b. Career long training.
    - c. Manufacturer endorsed training.
    - d. Fundamental journeyman skills certification.

**1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Product Data:
  - 1. Manufacturer's catalog data and printed documentation stating physical characteristics, durability, resistance to fading and flame resistance characteristics for each type of carpet material and installation accessory.
  - 2. Manufacturer's printed installation instructions for the carpet, including preparation of installation substrate, seaming techniques and recommended adhesives and tapes.

## C. Samples:

1. Carpet: "Production Quality" samples 305 x 305 mm (12 x 12 inches) of carpets, showing quality, pattern and color specified in Section 09 06 00, SCHEDULE FOR FINISHES.
2. Floor Edge Strip (Molding): 152 mm (6 inches) long of each color and type specified.
3. Base Edge Strip (Molding): 152 mm (6 inches) long of each color specified.

D. Shop Drawings: Installers layout plan showing seams and cuts for sheet carpet and carpet module.

E. Maintenance Data: Carpet manufacturer's maintenance instructions describing recommended type of cleaning equipment and material, spotting and cleaning methods and cleaning cycles.

F. Installer's qualifications.

G. Manufacturer's warranty.

**1.5 DELIVERY AND STORAGE**

- A. Deliver carpet in manufacturer's original wrappings and packages clearly labeled with manufacturer's brand name, size, dye lot number and related information. Transport carpet to job site in a manner that prevents damage and distortion that might render it unusable. When bending or folding is unavoidable for delivery purposes, unfold carpet and lay flat immediately.
- B. Deliver adhesives in containers clearly labeled with manufacturer's brand name, number, installation instructions, safety instructions and flash points.
- C. Store in a clean, dry, well-ventilated area, protected from damage and soiling. Before installation, acclimate carpet to the atmospheric conditions of the areas in which it will be installed for 2 days prior to installation

**1.6 ENVIRONMENTAL REQUIREMENTS**

- A. Maintain areas in which carpeting is to be installed at a temperature between 18 - 35 degrees C (65 - 95 degrees F) with a maximum relative humidity of 65 percent for two (2) days before installation, during installation and for three (3) days after installation.
- B. Minimum Substrate Surface Temperature: 18 degrees C (65 degrees F) at time of installation.
- C. Three (3) days after installation, maintain minimum temperature of 10 degrees C (50 degrees F) for the duration of the contract.



**1.7 WARRANTY**

- A. Construction Warranty: Comply with FAR clause 52.246-21, "Warranty of Construction".
- B. Manufacturer Warranty: Manufacturer shall warranty their carpet for a minimum of ten (10) years from date of installation and final acceptance by the Government. Submit manufacturer warranty.

**1.8 APPLICABLE PUBLICATIONS**

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.
- B. American National Standards Institute (ANSI):
  - ANSI/NSF 140-10.....Sustainable Carpet Assessment Standard
- C. American Association of Textile Chemists and Colorists (AATCC):
  - 16-04.....Colorfastness to Light
  - 134-11.....Electric Static Propensity of Carpets
  - 165-08.....Colorfastness to Crocking: Textile Floor Coverings-AATCC Crockmeter Method
  - 174-11.....Antimicrobial Activity Assessment of New Carpets
- D. ASTM International (ASTM):
  - D1335-12.....Tuft Bind of Pile Yarn Floor Coverings
  - D3278-96(R2011).....Flash Point of Liquids by Small Scale Closed-Cup Apparatus
  - D5116-10.....Determinations of Organic Emissions from Indoor Materials/Products
  - D5252-11.....Operation of the Hexapod Tumble Drum Tester
  - D5417-11.....Operation of the Vettermann Drum Tester
  - E648-14c.....Critical Radiant Flux of Floor-Covering Systems Using a Radiant Heat Energy Source
- E. Code of Federal Regulation (CFR):
  - 40 CFR 59.....Determination of Volatile Matter Content, Water Content, Density Volume Solids, and Weight Solids of Surface Coating
- F. The Carpet and Rug Institute (CRI):
  - CIS.....Carpet Installation Standard
- G. International Standards and Training Alliance (INSTALL)

H. International Organization for Standardization (ISO):

2551-81.....Machine-Made Textile Floor Coverings

I. U.S. Consumer Product and Safety Commission (CPSC):

16 CFR 1630.....Surface Flammability of Carpets and Rugs

## **PART 2 - PRODUCTS**

### **2.1 CARPET**

A. Physical Characteristics:

1. Carpet free of visual blemishes, streaks, poorly dyed areas, fuzzing of pile yarn, spots or stains and other physical and manufacturing defects.

2. Type:

a. Carpet Construction: Tufted.

b. Carpet Type: Modular tile.

c. Pile Type: Textured loop. Pile type and thickness must conform to ADA requirements.

d. Pile Fiber: Commercial 100 percent branded (federally registered trademark), nylon continuous filament.

3. Static Control: Provide static control to permanently regulate static buildup to less than 3.5 kV when tested at 20 percent relative humidity and 21 degrees C (70 degrees F) in accordance with AATCC 134.

4. Backing Materials: Provide backing for release adhesive for modular tile installations. For healthcare installations, provide impervious moisture backing that is 100 percent PVC free.

a. Modular Tile:

1) Primary Backing/Backcoating: Manufacturer's standard composite materials.

2) Secondary Backing: Manufacturer's standard material.

5. Appearance Retention Rating (ARR): Carpet to be tested and have the minimum 3.5 - 4.0 severe ARR when tested in accordance with either the ASTM D5252 (Hexapod) or ASTM D5417 (Vettermann) test methods using the number of cycles for short and long term tests as specified in the ASTM standard.

6. Tuft Bind: Comply with ASTM D1335 for tuft bind force required to pull a tuft or loop free from carpet backing with a minimum 36 N (8 pound) average force for modular carpet tile.

7. Colorfastness to Crocking: Dry and wet crocking and water bleed, comply with AATCC 165 Color Transference Chart for colors, minimum class 4 rating.
8. Colorfastness to Light (AATCC 16, Option 3): Color change between the exposed and unexposed carpet areas equivalent to a minimum of Grade 4 on the Gray Scale for Color Change after an exposure of 40 AFU (AATCC fading units) for all specified colors.
9. Delamination Strength: Minimum of 440 N/m (2.5 lb./inch) between secondary backing.
10. Flammability and Critical Radiant Flux Requirements:
  - a. Comply with 16 CFR 1630.
  - b. Test Carpet in accordance with ASTM E648.
  - c. Class I: Minimum critical radiant flux of 0.45 watts per square centimeter (2.9 watts per square inch).
  - d. Carpet in corridors, exits and Medical Facilities to be Class I.
11. Average Pile Yarn Density (APYD):
  - a. Corridors, lobbies, entrances, common areas or multipurpose rooms, open offices, waiting areas and dining areas: Minimum APYD 6000.
  - b. Other areas: Minimum APYD 4000.

## **2.2 ADHESIVE AND CONCRETE PRIMER**

- A. Provide water resistant, mildew resistant, nonflammable, and non-staining adhesives and concrete primers for carpet installation. Provide release adhesive for modular tile carpet as recommended by the carpet manufacturer. Provide adhesives flashpoint of minimum 60 degrees C (140 degrees F) in accordance with ASTM D3278. Materials are to have a VOC maximum of 50 g/L when calculated according to 40 CFR 59, (EPA Method 24).

## **2.3 EDGE STRIPS (MOLDING)**

- A. Metal:
  1. Hammered surface aluminum, pinless, clamp down type designed for the carpet being installed.
  2. Floor flange not less than 38 mm (1-1/2 inches) wide, face not less than 16 mm (5/8 inch) wide.
  3. Finish: Clear anodic coating unless specified otherwise in Section 09 06 00, SCHEDULE FOR FINISHES.

**B. Vinyl Edge Strip:**

1. Beveled floor flange minimum 50 mm (2 inches) wide.
2. Beveled surface to finish flush with carpet for tight joint and other side to floor finish.
3. Color as specified in Section 09 06 00, SCHEDULE FOR FINISHES.

**PART 3 - EXECUTION****3.1 SURFACE PREPARATION**

- A. Contractor to prepare and test surfaces to receive carpet and adhesives as per Section 09 05 16, SUBSURFACE PREPARATION FOR FLOOR FINISHES.

**3.2 GENERAL INSTALLATION**

- A. Isolate area of installation from rest of building.
- B. Perform all work by manufacturer's approved installers.  
Conduct installation in accordance with the manufacturer's printed instructions and CRI CIS.
- C. Protect edges of carpet meeting hard surface flooring with molding and install in accordance with the molding manufacturer's printed instructions.
- D. Follow ventilation, personal protection, and other safety precautions recommended by the adhesive manufacturer. Continue ventilation during installation and for at least three (3) days following installation.
- E. Do not permit traffic or movement of furniture or equipment in carpeted area for 24 hours after installation.
- F. Complete other work which would damage the carpet prior to installation of carpet.
- G. Follow carpet manufacturer's recommendations for matching pattern and texture directions.
- H. Cut openings in carpet where required for installing equipment, pipes, outlets, and penetrations. Bind or seal cut edge of sheet carpet. Use additional adhesive to secure carpets around pipes and other vertical projections.

**3.3 MODULAR TILE INSTALLATION**

- A. Install per CRI CIS, Adhesive Application.
- B. Lay carpet modules with pile in same direction unless specified otherwise in Section 09 06 00, SCHEDULE FOR FINISHES.

- C. Install carpet modules so that cleaning methods and solutions do not cause dislocation of modules.
- D. Lay carpet modules uniformly to provide tight flush joints free from movement when subject to traffic.

#### **3.4 EDGE STRIPS INSTALLATION**

- A. Install edge strips over exposed carpet edges adjacent to uncarpeted finish flooring.
- B. Anchor metal strips to floor with suitable fasteners. Apply adhesive to edge strips, insert carpet into lip and press it down over carpet.
- C. Anchor vinyl edge strip to floor with adhesive. Apply adhesive to edge strip and insert carpet into lip and press lip down over carpet.

#### **3.5 PROTECTION AND CLEANING**

- A. Once a carpet installation is complete, clean up scrap materials and debris, and vacuum the area, using manufacturer-approved equipment. Inspect seams carefully for evenness and protruding backing yarns, and inspect the perimeter of the installation for an acceptable finished appearance.
- B. Protect installed carpet if furniture is being moved, by laying plywood, fiberboard or porous non-staining sheeting material for minimum time practical. Based on manufacturer guidelines, protect carpet from rolling or foot traffic. Protect against other materials or renovation or construction activities, including dust, debris, paint, contractor traffic, until it is ready for its final use.
- C. Do not move furniture or equipment on unprotected carpeted surfaces.
- D. Just before final acceptance of work, remove protection and vacuum carpet clean.

- - - E N D - - -



**SECTION 09 91 00**  
**PAINTING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Work of this Section includes all labor, materials, equipment, and services necessary to complete the painting and finishing as shown on the construction documents and/or specified herein, including, but not limited to, the following:
1. Prime coats which may be applied in shop under other sections.
  2. Prime painting unprimed surfaces to be painted under this Section.
  3. Painting items furnished with a prime coat of paint, including touching up of or repairing of abraded, damaged or rusted prime coats applied by others.
  4. Painting ferrous metal (except stainless steel) exposed to view.
  5. Painting galvanized ferrous metals exposed to view.
  6. Painting interior concrete block exposed to view.
  7. Painting gypsum drywall exposed to view.
  8. Painting of wood exposed to view, except items which are specified to be painted or finished under other Sections of these specifications. Back painting of all wood in contact with concrete, masonry or other moisture areas.
  9. Painting pipes, pipe coverings, conduit, ducts, insulation, hangers, supports and other mechanical and electrical items and equipment exposed to view.
  10. Painting surfaces above, behind or below grilles, gratings, diffusers, louvers lighting fixtures, and the like, which are exposed to view through these items.
  11. Painting includes shellacs, stains, varnishes, coatings specified, and striping or markers and identity markings.
  12. Incidental painting and touching up as required to produce proper finish for painted surfaces, including touching up of factory finished items.
  13. Painting of any surface not specifically mentioned to be painted herein or on construction documents, but for which painting is obviously necessary to complete the job, or work which comes within the intent of these specifications, is to be included as though specified.

**1.2 RELATED WORK**

- A. Activity Hazard Analysis: Section 01 35 26, SAFETY REQUIREMENTS.
- B. Shop Prime Painting of Steel and Ferrous Metals: Division 05 - METALS, Division 08 - OPENINGS; Division 10 - SPECIALTIES; Division 12 - FURNISHINGS; Division 21 - FIRE SUPPRESSION; Division 22 - PLUMBING; Division 23 - HEATING; VENTILATION AND AIR-CONDITIONING; Division 26 - ELECTRICAL; Division 27 - COMMUNICATIONS; and Division 28 - ELECTRONIC SAFETY AND SECURITY sections.
- C. Type of Finish, Color, and Gloss Level of Finish Coat: Section 09 06 00, SCHEDULE FOR FINISHES.

**1.3 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Painter qualifications.
- C. Manufacturer's Literature and Data:
  - 1. Before work is started, or sample panels are prepared, submit manufacturer's literature and technical data, the current Master Painters Institute (MPI) "Approved Product List" indicating brand label, product name and product code as of the date of contract award, will be used to determine compliance with the submittal requirements of this specification. The Contractor may choose to use subsequent MPI "Approved Product List", however, only one (1) list may be used for the entire contract and each coating system is to be from a single manufacturer. All coats on a particular substrate must be from a single manufacturer. No variation from the MPI "Approved Product List" where applicable is acceptable.
- E. Sample Panels:
  - 1. After painters' materials have been approved and before work is started submit sample panels showing each type of finish and color specified.
  - 2. Panels to Show Color: Composition board, 100 x 250 mm (4 x 10 inch).
  - 3. Panel to Show Transparent Finishes: Wood of same species and grain pattern as wood approved for use, 100 x 250 mm (4 x 10 inch face) minimum, and where both flat and edge grain will be exposed, 250 mm (10 inches) long by sufficient size, 50 x 50 mm (2 x 2 inch) minimum or actual wood member to show complete finish.



4. Attach labels to panel stating the following:
  - a. Federal Specification Number or manufacturers name and product number of paints used.
  - b. Specification code number specified in Section 09 06 00, SCHEDULE FOR FINISHES.
  - c. Product type and color.
  - d. Name of project.
5. Strips showing not less than 50 mm (2 inch) wide strips of undercoats and 100 mm (4 inch) wide strip of finish coat.
- F. Sample of identity markers if used.
- G. Manufacturers' Certificates indicating compliance with specified requirements:
  1. Manufacturer's paint substituted for Federal Specification paints meets or exceeds performance of paint specified.
  2. High temperature aluminum paint.
  3. Epoxy coating.
  4. Intumescent clear coating or fire retardant paint.
  5. Plastic floor coating.

#### **1.4 DELIVERY AND STORAGE**

- A. Deliver materials to site in manufacturer's sealed container marked to show following:
  1. Name of manufacturer.
  2. Product type.
  3. Batch number.
  4. Instructions for use.
  5. Safety precautions.
- B. In addition to manufacturer's label, provide a label legibly printed as following:
  1. Federal Specification Number, where applicable, and name of material.
  2. Surface upon which material is to be applied.
  3. Specify Coat Types: Prime; body; finish; etc.
- C. Maintain space for storage, and handling of painting materials and equipment in a ventilated, neat and orderly condition to prevent spontaneous combustion from occurring or igniting adjacent items.
- D. Store materials at site at least 24 hours before using, at a temperature between 7 and 30 degrees C (45 and 85 degrees F).

### 1.5 QUALITY ASSURANCE

- A. Qualification of Painters: Use only qualified journeyman painters for the mixing and application of paint on exposed surfaces. Submit evidence that key personnel have successfully performed surface preparation and application of coating on a minimum of three (3) similar projects within the past three (3) years.
- B. Paint Coordination: Provide finish coats which are compatible with the prime paints used. Review other Sections of these specifications in which prime paints are to be provided to ensure compatibility of the total coatings system for the various substrates. Upon request from other subcontractors, furnish information on the characteristics of the finish materials proposed to be used, to ensure that compatible prime coats are used. Provide barrier coats over incompatible primers or remove and re-prime as required. Notify the Contracting Officer Representative (COR) in writing of any anticipated problems using the coating systems as specified with substrates primed by others.

### 1.6 REGULATORY REQUIREMENTS

- A. Paint materials are to conform to the restrictions of the local Environmental and Toxic Control jurisdiction.
  - 1. Volatile Organic Compounds (VOC) Emissions Requirements: Field-applied paints and coatings that are inside the waterproofing system to not exceed limits of authorities having jurisdiction.
  - 2. Lead-Based Paint:
    - a. Comply with Section 410 of the Lead-Based Paint Poisoning Prevention Act, as amended, and with implementing regulations promulgated by Secretary of Housing and Urban Development.
    - b. Regulations concerning prohibition against use of lead-based paint in federal and federally assisted construction, or rehabilitation of residential structures are set forth in Subpart F, Title 24, Code of Federal Regulations, Department of Housing and Urban Development.
    - c. Do not use coatings having a lead content over 0.06 percent by weight of non-volatile content.
  - 3. Asbestos: Provide materials that do not contain asbestos.
  - 4. Chromate, Cadmium, Mercury, and Silica: Provide materials that do not contain zinc-chromate, strontium-chromate, Cadmium, mercury or mercury compounds or free crystalline silica.

5. Human Carcinogens: Provide materials that do not contain any of the ACGIH-BKLT and ACGHI-DOC confirmed or suspected human carcinogens.
6. Use high performance acrylic paints in place of alkyd paints.

#### **1.7 SAFETY AND HEALTH**

- A. Apply paint materials using safety methods and equipment in accordance with the following:
  1. Comply with applicable Federal, State, and local laws and regulations, and with the ACCIDENT PREVENTION PLAN, including the Activity Hazard Analysis (AHA) as specified in Section 01 35 26, SAFETY REQUIREMENTS. The AHA is to include analyses of the potential impact of painting operations on painting personnel and on others involved in and adjacent to the work zone.
- B. Safety Methods Used During Paint Application: Comply with the requirements of SSPC PA Guide 10.
- C. Toxic Materials: To protect personnel from overexposure to toxic materials, conform to the most stringent guidance of:
  1. The applicable manufacturer's Material Safety Data Sheets (MSDS) or local regulation.
  2. 29 CFR 1910.1000.
  3. ACHIH-BKLT and ACGHI-DOC, threshold limit values.

#### **1.8 APPLICABLE PUBLICATIONS**

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by basic designation only.
- B. American Conference of Governmental Industrial Hygienists (ACGIH):
  - ACGIH TLV-BKLT-2012.....Threshold Limit Values (TLV) for Chemical Substances and Physical Agents and Biological Exposure Indices (BEIs)
  - ACGIH TLV-DOC-2012.....Documentation of Threshold Limit Values and Biological Exposure Indices, (Seventh Edition)
- C. ASME International (ASME):
  - A13.1-07(R2013).....Scheme for the Identification of Piping Systems
- D. Code of Federal Regulation (CFR):
  - 40 CFR 59.....Determination of Volatile Matter Content, Water Content, Density Volume Solids, and Weight Solids of Surface Coating
- E. Commercial Item Description (CID):
  - A-A-1272A.....Plaster Gypsum (Spackling Compound)

## F. Federal Specifications (Fed Spec):

TT-P-1411A.....Paint, Copolymer-Resin, Cementitious (For  
Waterproofing Concrete and Masonry Walls) (CEP)

## G. Master Painters Institute (MPI):

1.....Aluminum Paint  
4.....Interior/ Exterior Latex Block Filler  
5.....Exterior Alkyd Wood Primer  
7.....Exterior Oil Wood Primer  
8.....Exterior Alkyd, Flat MPI Gloss Level 1  
9.....Exterior Alkyd Enamel MPI Gloss Level 6  
10.....Exterior Latex, Flat  
11.....Exterior Latex, Semi-Gloss  
18.....Organic Zinc Rich Primer  
22.....Aluminum Paint, High Heat (up to 590° - 1100F)  
27.....Exterior / Interior Alkyd Floor Enamel, Gloss  
31.....Polyurethane, Moisture Cured, Clear Gloss  
36.....Knot Sealer  
43.....Interior Satin Latex, MPI Gloss Level 4  
44.....Interior Low Sheen Latex, MPI Gloss Level 2  
45.....Interior Primer Sealer  
46.....Interior Enamel Undercoat  
47.....Interior Alkyd, Semi-Gloss, MPI Gloss Level 5  
48.....Interior Alkyd, Gloss, MPI Gloss Level 6  
50.....Interior Latex Primer Sealer  
51.....Interior Alkyd, Eggshell, MPI Gloss Level 3  
52.....Interior Latex, MPI Gloss Level 3  
53.....Interior Latex, Flat, MPI Gloss Level 1  
54.....Interior Latex, Semi-Gloss, MPI Gloss Level 5  
59.....Interior/Exterior Alkyd Porch & Floor Enamel, Low  
Gloss  
60.....Interior/Exterior Latex Porch & Floor Paint, Low  
Gloss  
66.....Interior Alkyd Fire Retardant, Clear Top-Coat (ULC  
Approved)  
67.....Interior Latex Fire Retardant, Top-Coat (ULC  
Approved)  
68.....Interior/ Exterior Latex Porch & Floor Paint,  
Gloss

- 71.....Polyurethane, Moisture Cured, Clear, Flat
- 77.....Epoxy Cold Cured, Gloss
- 79.....Marine Alkyd Metal Primer
- 90.....Interior Wood Stain, Semi-Transparent
- 91.....Wood Filler Paste
- 94.....Exterior Alkyd, Semi-Gloss
- 95.....Fast Drying Metal Primer
- 98.....High Build Epoxy Coating
- 101.....Epoxy Anti-Corrosive Metal Primer
- 108.....High Build Epoxy Coating, Low Gloss
- 114.....Interior Latex, Gloss
- 119.....Exterior Latex, High Gloss (acrylic)
- 134.....Galvanized Water Based Primer
- 135.....Non-Cementitious Galvanized Primer
- 138.....Interior High Performance Latex, MPI Gloss Level 2
- 139.....Interior High Performance Latex, MPI Gloss Level 3
- 140.....Interior High Performance Latex, MPI Gloss Level 4
- 141.....Interior High Performance Latex (SG) MPI Gloss  
Level 5
- 163.....Exterior Water Based Semi-Gloss Light Industrial  
Coating, MPI Gloss Level 5

G. Society for Protective Coatings (SSPC):

- SSPC SP 1-82(R2004).....Solvent Cleaning
- SSPC SP 2-82(R2004).....Hand Tool Cleaning
- SSPC SP 3-28(R2004).....Power Tool Cleaning
- SSPC SP 10/NACE No.2.....Near-White Blast Cleaning
- SSPC PA Guide 10.....Guide to Safety and Health Requirements

H. Maple Flooring Manufacturer's Association (MFMA):

I. U.S. National Archives and Records Administration (NARA):

- 29 CFR 1910.1000.....Air Contaminants

J. Underwriter's Laboratory (UL)

## **PART 2 - PRODUCTS**

### **2.1 MATERIALS**

- A. Conform to the coating specifications and standards referenced in PART 3.  
Submit manufacturer's technical data sheets for specified coatings and solvents.

## 2.2 PAINT PROPERTIES

- A. Use ready-mixed (including colors), except two component epoxies, polyurethanes, polyesters, paints having metallic powders packaged separately and paints requiring specified additives.
- B. Where no requirements are given in the referenced specifications for primers, use primers with pigment and vehicle, compatible with substrate and finish coats specified.
- C. Provide undercoat paint produced by the same manufacturer as the finish coats. Use only thinners approved by the paint manufacturer, and use only to recommended limits.
- D. VOC Content: For field applications that are inside the weatherproofing system, paints and coating to comply with VOC content limits of authorities having jurisdiction and the following VOC content limits:
  - 1. Flat Paints and Coatings: 50 g/L.
  - 2. Non-flat Paints and Coatings: 150 g/L.
  - 3. Dry-Fog Coatings: 400 g/L.
  - 4. Primers, Sealers, and Undercoaters: 200 g/L.
  - 5. Anticorrosive and Antirust Paints applied to Ferrous Metals: 250 g/L.
  - 6. Zinc-Rich Industrial Maintenance Primers: 340 g/L.
  - 7. Pretreatment Wash Primers: 420 g/L.
  - 8. Shellacs, Clear: 730 g/L.
  - 9. Shellacs, Pigmented: 550 g/L.
- E. VOC test method for paints and coatings is to be in accordance with 40 CFR 59 (EPA Method 24). Part 60, Appendix A with the exempt compounds' content determined by Method 303 (Determination of Exempt Compounds) in the South Coast Air Quality Management District's (SCAQMD) "Laboratory Methods of Analysis for Enforcement Samples" manual.

## 2.3 PLASTIC TAPE

- A. Pigmented vinyl plastic film in colors as specified in Section 09 06 00, SCHEDULE FOR FINISHES or specified.
- B. Pressure sensitive adhesive back.
- C. Snap on coil plastic markers.
- D. Widths as shown on construction documents.

**PART 3 - EXECUTION****3.1 JOB CONDITIONS**

- A. Safety: Observe required safety regulations and manufacturer's warning and instructions for storage, handling and application of painting materials.
  - 1. Take necessary precautions to protect personnel and property from hazards due to falls, injuries, toxic fumes, fire, explosion, or other harm.
  - 2. Deposit soiled cleaning rags and waste materials in metal containers approved for that purpose. Dispose of such items off the site at end of each day's work.
- B. Atmospheric and Surface Conditions:
  - 1. Do not apply coating when air or substrate conditions are:
    - a. Less than 3 degrees C (5 degrees F) above dew point.
    - b. Below 10 degrees C (50 degrees F) or over 35 degrees C (95 degrees F), unless specifically pre-approved by the COR and the product manufacturer. Under no circumstances are application conditions to exceed manufacturer recommendations.
    - c. When the relative humidity exceeds 85 percent; or to damp or wet surfaces; unless otherwise permitted by the paint manufacturer's printed instructions.
  - 2. Maintain interior temperatures until paint dries hard.
  - 3. Do no exterior painting when it is windy and dusty.
  - 4. Do not paint in direct sunlight or on surfaces that the sun will warm.
  - 5. Apply only on clean, dry and frost free surfaces except as follows:
    - a. Apply water thinned acrylic and cementitious paints to damp (not wet) surfaces only when allowed by manufacturer's printed instructions.
    - b. Concrete and masonry when permitted by manufacturer's recommendations, dampen surfaces to which water thinned acrylic and cementitious paints are applied with a fine mist of water on hot dry days to prevent excessive suction and to cool surface.
  - 6. Varnishing:
    - a. Apply in clean areas and in still air.
    - b. Before varnishing vacuum and dust area.
    - c. Immediately before varnishing wipe down surfaces with a tack rag.

### 3.2 INSPECTION

- A. Examine the areas and conditions where painting and finishing are to be applied and correct any conditions detrimental to the proper and timely completion of the work. Do not proceed with the work until unsatisfactory conditions are corrected to permit proper installation of the work.

### 3.3 GENERAL WORKMANSHIP REQUIREMENTS

- A. Application may be by brush or roller. Spray application only upon acceptance from the COR in writing.
- B. Furnish to the COR a painting schedule indicating when the respective coats of paint for the various areas and surfaces will be completed. This schedule is to be kept current as the job progresses.
- C. Protect work at all times. Protect all adjacent work and materials by suitable covering or other method during progress of work. Upon completion of the work, remove all paint and varnish spots from floors, glass and other surfaces. Remove from the premises all rubbish and accumulated materials of whatever nature not caused by others and leave work in a clean condition.
- D. Remove and protect hardware, accessories, device plates, lighting fixtures, and factory finished work, and similar items, or provide in place protection. Upon completion of each space, carefully replace all removed items by workmen skilled in the trades involved.
- E. When indicated to be painted, remove electrical panel box covers and doors before painting walls. Paint separately and re-install after all paint is dry.
- F. Materials are to be applied under adequate illumination, evenly spread and flowed on smoothly to avoid runs, sags, holidays, brush marks, air bubbles and excessive roller stipple.
- G. Apply materials with a coverage to hide substrate completely. When color, stain, dirt or undercoats show through final coat of paint, the surface is to be covered by additional coats until the paint film is of uniform finish, color, appearance and coverage, at no additional cost to the Government.
- H. All coats are to be dry to manufacturer's recommendations before applying succeeding coats.
- I. All suction spots or "hot spots" in plaster after the application of the first coat are to be touched up before applying the second coat.
- J. Do not apply paint behind frameless mirrors that use mastic for adhering to wall surface.



### 3.4 SURFACE PREPARATION

#### A. General:

1. The Contractor shall be held wholly responsible for the finished appearance and satisfactory completion of painting work.  
Properly prepare all surfaces to receive paint, which includes cleaning, sanding, and touching-up of all prime coats applied under other Sections of the work. Broom clean all spaces before painting is started. All surfaces to be painted or finished are to be completely dry, clean and smooth.
2. See other sections of specifications for specified surface conditions and prime coat.
3. Perform preparation and cleaning procedures in strict accordance with the paint manufacturer's instructions and as herein specified, for each particular substrate condition.
4. Clean surfaces before applying paint or surface treatments with materials and methods compatible with substrate and specified finish. Remove any residue remaining from cleaning agents used. Do not use solvents, acid, or steam on concrete and masonry. Schedule the cleaning and painting so that dust and other contaminants from the cleaning process will not fall in wet, newly painted surfaces.
5. Maximum Moisture Content of Substrates: When measured with an electronic moisture meter as follows:
  - a. Concrete: 12 percent.
  - b. Fiber-Cement Board: 12 percent.
  - c. Masonry (Clay and CMU's): 12 percent.
  - d. Wood: 15 percent.
  - e. Gypsum Board: 12 percent.
  - f. Plaster: 12 percent.

#### B. Wood:

1. Sand to a smooth even surface and then dust off.
2. Sand surfaces showing raised grain smooth between each coat.
3. Wipe surface with a tack rag prior to applying finish.
4. Surface painted with an opaque finish:
  - a. Coat knots, sap and pitch streaks with MPI 36 (Knot Sealer) before applying paint.
  - b. Apply two coats of MPI 36 (Knot Sealer) over large knots.

5. After application of prime or first coat of stain, fill cracks, nail and screw holes, depressions and similar defects with wood filler paste. Sand the surface to make smooth and finish flush with adjacent surface.
6. Before applying finish coat, reapply wood filler paste if required, and sand surface to remove surface blemishes. Finish flush with adjacent surfaces.
7. Fill open grained wood such as oak, walnut, ash and mahogany with MPI 91 (Wood Filler Paste), colored to match wood color.
  - a. Thin filler in accordance with manufacturer's instructions for application.
  - b. Remove excess filler, wipe as clean as possible, dry, and sand as specified.

C. Ferrous Metals:

1. Remove oil, grease, soil, drawing and cutting compounds, flux and other detrimental foreign matter in accordance with SSPC-SP 1 (Solvent Cleaning).
2. Remove loose mill scale, rust, and paint, by hand or power tool cleaning, as defined in SSPC-SP 2 (Hand Tool Cleaning) and SSPC-SP 3 (Power Tool Cleaning).
3. Fill dents, holes and similar voids and depressions in flat exposed surfaces of hollow steel doors and frames, access panels, roll-up steel doors and similar items specified to have semi-gloss or gloss finish with TT-F-322D (Filler, Two-Component Type, For Dents, Small Holes and Blow-Holes). Finish flush with adjacent surfaces.
  - a. Fill flat head countersunk screws used for permanent anchors.
  - b. Do not fill screws of item intended for removal such as glazing beads.
4. Spot prime abraded and damaged areas in shop prime coat which expose bare metal with same type of paint used for prime coat. Feather edge of spot prime to produce smooth finish coat.
5. Spot prime abraded and damaged areas which expose bare metal of factory finished items with paint as recommended by manufacturer of item.

D. Zinc-Coated (Galvanized) Metal, Aluminum, Copper and Copper Alloys  
Surfaces Specified Painted:

1. Clean surfaces to remove grease, oil and other deterrents to paint adhesion in accordance with SSPC-SP 1 (Solvent Cleaning).
2. Spot coat abraded and damaged areas of zinc-coating which expose base metal on hot-dip zinc-coated items with MPI 18 (Organic Zinc Rich Coating). Prime or spot prime with MPI 134 (Waterborne Galvanized Primer) or MPI 135 (Non-Cementitious Galvanized Primer) depending on finish coat compatibility.

E. Masonry, Concrete, Cement Board, Cement Plaster and Stucco:

1. Clean and remove dust, dirt, oil, grease efflorescence, form release agents, laitance, and other deterrents to paint adhesion.
2. Use emulsion type cleaning agents to remove oil, grease, paint and similar products. Use of solvents, acid, or steam is not permitted.
3. Remove loose mortar in masonry work.
4. Replace mortar and fill open joints, holes, cracks and depressions with new mortar. Do not fill weep holes. Finish to match adjacent surfaces.
5. Neutralize Concrete floors to be painted by washing with a solution of 1.4 Kg (3 pounds) of zinc sulfate crystals to 3.8 L (1 gallon) of water, allow to dry three (3) days and brush thoroughly free of crystals.
6. Repair broken and spalled concrete edges with concrete patching compound to match adjacent surfaces as specified in Division 03, CONCRETE Sections. Remove projections to level of adjacent surface by grinding or similar methods.

F. Gypsum Plaster and Gypsum Board:

1. Remove efflorescence, loose and chalking plaster or finishing materials.
2. Remove dust, dirt, and other deterrents to paint adhesion.
3. Fill holes, cracks, and other depressions with CID-A-A-1272A finished flush with adjacent surface, with texture to match texture of adjacent surface. Patch holes over 25 mm (1-inch) in diameter as specified in Section for plaster or gypsum board.

### 3.5 PAINT PREPARATION

- A. Thoroughly mix painting materials to ensure uniformity of color, complete dispersion of pigment and uniform composition.
- B. Do not thin unless necessary for application and when finish paint is used for body and prime coats. Use materials and quantities for thinning as specified in manufacturer's printed instructions.
- C. Remove paint skins, then strain paint through commercial paint strainer to remove lumps and other particles.
- D. Mix two (2) component and two (2) part paint and those requiring additives in such a manner as to uniformly blend as specified in manufacturer's printed instructions unless specified otherwise.
- E. For tinting required to produce exact shades specified, use color pigment recommended by the paint manufacturer.

### 3.6 APPLICATION

- A. Start of surface preparation or painting will be construed as acceptance of the surface as satisfactory for the application of materials.
- B. Unless otherwise specified, apply paint in three (3) coats; prime, body, and finish. When two (2) coats applied to prime coat are the same, first coat applied over primer is body coat and second coat is finish coat.
- C. Apply each coat evenly and cover substrate completely.
- D. Allow not less than 48 hours between application of succeeding coats, except as allowed by manufacturer's printed instructions, and approved by COR.
- E. Apply by brush or roller. Spray application for new or existing occupied spaces only upon approval by acceptance from COR in writing.
  - 1. Apply painting materials specifically required by manufacturer to be applied by spraying.
  - 2. In new construction and in existing occupied spaces, where paint is applied by spray, mask or enclose with polyethylene, or similar air tight material with edges and seams continuously sealed including items specified in "Building and Structural Work Field Painting"; "Work not Painted"; motors, controls, telephone, and electrical equipment, fronts of sterilizes and other recessed equipment and similar prefinished items.
- F. Do not paint in closed position operable items such as access doors and panels, window sashes, overhead doors, and similar items except overhead roll-up doors and shutters.

### 3.7 PRIME PAINTING

- A. After surface preparation, prime surfaces before application of body and finish coats, except as otherwise specified.
- B. Spot prime and apply body coat to damaged and abraded painted surfaces before applying succeeding coats.
- C. Additional field applied prime coats over shop or factory applied prime coats are not required except for exterior exposed steel apply an additional prime coat.
- D. Prime rabbets for stop and face glazing of wood, and for face glazing of steel.
- E. Wood and Wood Particleboard:
  - 1. Use same kind of primer specified for exposed face surface.
    - a. Interior wood except for transparent finish: MPI 45 (Interior Primer Sealer) or MPI 46 (Interior Enamel Undercoat), thinned if recommended by manufacturer.
    - b. Transparent finishes as specified under "Transparent Finishes on Wood Except Floors Article".
  - 2. Apply two (2) coats of sealer MPI 45 (Interior Primer Sealer) or MPI 46 (Interior Enamel Undercoat) to surfaces of wood doors, including top and bottom edges, which are cut for fitting or for other reason.
  - 3. Apply one (1) coat of sealer MPI 45 (Interior Primer Sealer) or MPI 46 (Interior Enamel Undercoat) as soon as delivered to site to surfaces of unfinished woodwork, except concealed surfaces of shop fabricated or assembled millwork and surfaces specified to have varnish, stain or natural finish.
  - 4. Apply MPI 67 (Interior Latex Fire Retardant, Top-Coat (UL Approved) to wood for fire retardant finish.
- F. Metals except boilers, incinerator stacks, and engine exhaust pipes:
  - 1. Steel and iron: MPI 95 (Fast Drying Metal Primer). Use MPI 101 (Cold Curing Epoxy Primer) where MPI 77 (Epoxy Cold Cured, Gloss MPI 98 (High Build Epoxy Coating), MPI 108 (High Build Epoxy Marine Coating) finish is specified.
  - 2. Zinc-coated steel and iron: MPI 134 (Waterborne Galvanized Primer) or MPI 135 (Non-Cementitious Galvanized Primer).
  - 3. Aluminum scheduled to be painted: MPI 95 (Fast Drying Metal Primer).
  - 4. Terne Metal: MPI 95 (Fast Drying Metal Primer).
  - 5. Copper and copper alloys scheduled to be painted: MPI 95 (Fast Drying Metal Primer).

6. Machinery not factory finished: MPI 9 (Exterior Alkyd Enamel).
7. Asphalt coated metal: MPI 1 (Aluminum Paint).
8. Metal over 94 degrees C (201 degrees F), Boilers, Incinerator Stacks, and Engine Exhaust Pipes: MPI 22 (High Heat Resistant Coating).

G. Gypsum Board and Hardboard:

1. Surfaces scheduled to have MPI 53 (Interior Latex, Flat), MPI Gloss Level 1, MPI 52 (Interior Latex, MPI Gloss Level 3), MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5), MPI 114 (Interior Latex, Gloss) finish: Use MPI 53 (Interior Latex, MPI Gloss Level 1), MPI 52 (Interior Latex, MPI Gloss Level 3), MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5), MPI 114 (Interior Latex, Gloss) respectively.
2. Primer: MPI 50 (Interior Latex Primer Sealer) except use MPI 45 (Interior Primer Sealer), or MPI 46 (Interior Enamel Undercoat) in shower and bathrooms.
3. Use MPI 101 (Cold Curing Epoxy Primer) for surfaces scheduled to receive MPI 77 (Epoxy Cold Cured, Gloss), MPI 98 (High Build Epoxy Coating).

H. Gypsum Plaster and Veneer Plaster:

1. MPI 45 (Interior Primer Sealer), except use MPI 50 (Interior Latex Primer Sealer) when an alkyd flat finish is specified.
2. Surfaces scheduled to have MPI 53 (Interior Latex, Flat, MPI Gloss Level 1), MPI 52 (Interior Latex, MPI Gloss Level 3), MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5), MPI 114 (Interior Latex, Gloss) finish: Use MPI 53 (Interior Latex, Flat, MPI Gloss Level 1), MPI 52 (Interior Latex, MPI Gloss Level 3), MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5), MPI 114 (Interior Latex, Gloss) respectively.
3. Use MPI 101 (Cold Curing Epoxy Primer) for surfaces scheduled to receive MPI 77 (Epoxy Cold Cured, Gloss) or finish.

I. Concrete Masonry Units Except Glazed or Integrally Colored and Decorative Units:

1. MPI 4 (Block Filler) on interior surfaces.
2. Prime exterior surface as specified for exterior finishes.

J. Cement Plaster or Stucco, Concrete Masonry, Brick Masonry and Cement Board  
Interior Surfaces of Ceilings and Walls:

1. MPI 53 (Interior Latex, Flat, MPI Gloss Level 1), MPI 52 (Interior Latex, MPI Gloss Level 3), MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5), MPI 114 (Interior Latex, Gloss) except use two (2) coats where substrate has aged less than six (6) months.
2. Use MPI 138 (Interior High Performance Latex, MPI Gloss Level 2), MPI 139 (Interior High Performance Latex, MPI Gloss level 3), MPI 140 (Interior High Performance latex, MPI Gloss Level 4), MPI 141 (Interior High Performance Latex, MPI Gloss Level 5), MPI 114 (Interior Latex, Gloss), TT-P-1411A (Paint, Copolymer Resin, Cementitious) Type II. MPI 77 (Epoxy Cold Cured, Gloss, MPI 98 (High Build Epoxy Coating), MPI 108 (High Build Epoxy Marine Coating) as scheduled.

K. Concrete Floors: MPI 68 (Interior/ Exterior Latex Porch & Floor Paint, Gloss), MPI 60 (Interior/ Exterior Latex Porch & Floor Paint, Low Gloss), MPI 99 (Water-based Acrylic Curing and Sealing Compound).

### 3.8 INTERIOR FINISHES

A. Apply following finish coats over prime coats in spaces or on surfaces specified in Section 09 06 00, SCHEDULE FOR FINISHES.

B. Metal Work:

1. Apply to exposed surfaces.
2. Omit body and finish coats on surfaces concealed after installation except electrical conduit containing conductors over 600 volts.
3. Ferrous Metal, Galvanized Metal, and Other Metals Scheduled:
  - a. Apply two (2) coats of MPI 47 (Interior Alkyd, Semi-Gloss) unless specified otherwise.
  - b. Two (2) coats of MPI 48 (Interior Alkyd Gloss), MPI 51 (Interior Alkyd, Eggshell).
  - c. One (1) coat of MPI 46 (Interior Enamel Undercoat) plus one coat of MPI 47 (Interior Alkyd, Semi-Gloss) on exposed interior surfaces of alkyd-amine enamel prime finished windows.
  - d. Machinery: One (1) coat MPI 9 (Exterior Alkyd Enamel).
  - e. Asphalt Coated Metal: One (1) coat MPI 1 (Aluminum Paint).
  - f. Ferrous Metal over 94 degrees K (290 degrees F): Boilers, Incinerator Stacks, and Engine Exhaust Pipes: One (1) coat MPI 22 (High Heat Resistant Coating).

## C. Gypsum Board:

1. One (1) coat of MPI 45 (Interior Primer Sealer), MPI 46 (Interior Enamel Undercoat), plus one (1) coat of MPI 139 (Interior High Performance Latex, MPI Gloss level 3).
2. Two (2) coats of MPI 138 (Interior High Performance Latex, MPI Gloss Level 2).
3. One (1) coat of MPI 45 (Interior Primer Sealer), MPI 46 (Interior Enamel Undercoat), plus one (1) coat of MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5) or MPI 114 (Interior Latex, Gloss).
4. One (1) coat of MPI 45 (Interior Primer Sealer), MPI 46 (Interior Enamel Undercoat), plus one (1) coat of MPI 48 (Interior Alkyd Gloss).

## D. Plaster:

1. One (1) coat of MPI 45 (Interior Primer Sealer), MPI 46 (Interior Enamel Undercoat), MPI 50 (Interior Latex Primer Sealer), plus one (1) coat of MPI 139 (Interior High Performance Latex, MPI Gloss level 3).
2. Two (2) coats of MPI 51 (Interior Alkyd, Eggshell).
3. One (1) coat of MPI 45 (Interior Primer Sealer), MPI 46 (Interior Enamel Undercoat), or MPI 50 (Interior Latex Primer Sealer) plus one (1) coat of 139 (Interior High Performance Latex, MPI Gloss level 3).
4. One (1) coat MPI 101 (Cold Curing Epoxy Prime).

## E. Masonry and Concrete Walls:

1. Over MPI 4 (Interior/Exterior Latex Block Filler) on CMU surfaces.
2. Two (2) coats of MPI 53 (Interior Latex, Flat, MPI Gloss Level 1), MPI 52 (Interior Latex, MPI Gloss Level 3), MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5), MPI 114 (Interior Latex, Gloss).
3. Two (2) coats of MPI 138 (Interior High Performance Latex, MPI Gloss Level 2), MPI 139 (Interior High Performance Latex, MPI Gloss Level 3), MPI 140 (Interior High Performance Latex MPI Gloss Level 4), MPI 141 (Interior High Performance Latex MPI Gloss Level 5), MPI 114 (Interior Latex, Gloss).

## F. Wood:

1. Sanding:
  - a. Use 220-grit sandpaper.
  - b. Sand sealers and varnish between coats.
  - c. Sand enough to scarify surface to assure good adhesion of subsequent coats, to level roughly applied sealer and varnish, and to knock off "whiskers" of any raised grain as well as dust particles.



2. Sealers:

- a. MPI 31 (gloss) or MPI 71 (flat) thinned as recommended by manufacturer at rate of one (1) part of thinner to four (4) parts of varnish.
- b. Apply sealers specified except sealer may be omitted where pigmented, penetrating, or wiping stains containing resins are used.
- c. Allow manufacturer's recommended drying time before sanding, but not less than 24 hours or 36 hours in damp or muggy weather.
- d. Sand as specified.

3. Paint Finish:

- a. One (1) coat of MPI 45 (Interior Primer Sealer), MPI 46 (Interior Enamel Undercoat), plus one (1) coat of MPI 47 (Interior Alkyd, Semi-Gloss).
- b. One (1) coat of, MPI 45 Interior Primer Sealer), MPI 46 (Interior Enamel Undercoat), plus one (1) coat of MPI 48 (Interior Alkyd Gloss).
- d. Two (2) coats of MPI 51 (Interior Alkyd, Eggshell).

4. Transparent Finishes on Wood Except Floors.

a. Natural Finish:

- 1) One (1) coat of sealer MPI 31 (gloss), MPI 71 (flat), thinned with thinner recommended by manufacturer at rate of one (1) part of thinner to four (4) parts of varnish.
- 2) Two (2) coats of MPI 71 (Polyurethane, Moisture Cured, Clear Flat MPI 31 (Polyurethane, Moisture Cured, Clear Gloss).

b. Stain Finish:

- 1) One (1) coat of MPI 90 (Interior Wood Stain, Semi-Transparent).
- 2) Use wood stain of type and color required to achieve finish specified. Do not use varnish type stains.
- 3) One (1) coat of sealer MPI 31 (gloss), MPI 71 (flat), thinned as recommended by manufacturer at rate of one (1) part of thinner to four (4) parts of varnish.
- 4) Two (2) coats of MPI 71 (Polyurethane, Moisture Cured, Clear Flat), MPI 31 (Polyurethane Moisture Cured, Clear Gloss).

c. Varnish Finish:

- 1) One (1) coat of sealer MPI 31 (gloss), MPI 71 (flat), thinned as recommended by manufacturer at rate of one (1) part of thinner to four (4) parts of varnish.
- 2) Two (2) coats of MPI 71 (Polyurethane, Moisture Cured, Clear Flat), MPI 31 (Polyurethane Moisture Cured, Clear Gloss).

G. Cement Board: One (1) coat of MPI 138 (Interior High Performance Latex, MPI Gloss Level 2), MPI 139 (Interior High Performance Latex, MPI Gloss Level 3), MPI 140 (Interior High Performance Latex MPI Gloss Level 4), MPI 141 (Interior High Performance Latex, MPI Gloss Level 5, MPI 114 (Interior Latex, Gloss).

H. Miscellaneous:

1. Apply where specified in Section 09 06 00, SCHEDULE FOR FINISHES.
2. MPI 1 (Aluminum Paint): Two (2) coats of aluminum paint.
3. Interstitial floor markings: One (1) coat MPI 27 (Exterior/ Interior Alkyd Floor Enamel, Gloss), MPI 59 ((Interior/ Exterior Alkyd Porch & Floor Enamel, Low Gloss), MPI 68 (Interior/ Exterior Latex Porch & Floor Paint, Gloss), MPI 60 (interior/ Exterior Latex Porch & Floor Paint, Low Gloss).

### 3.9 REFINISHING EXISTING PAINTED SURFACES

- A. Clean, patch and repair existing surfaces as specified under "Surface Preparation". No "telegraphing" of lines, ridges, flakes, etc., through new surfacing is permitted. Where this occurs, sand smooth and re-finish until surface meets with COR's approval.
- B. Remove and reinstall items as specified under "General Workmanship Requirements".
- C. Remove existing finishes or apply separation coats to prevent non compatible coatings from having contact.
- D. Patched or Replaced Areas in Surfaces and Components: Apply spot prime and body coats as specified for new work to repaired areas or replaced components.
- E. Except where scheduled for complete painting apply finish coat over plane surface to nearest break in plane, such as corner, reveal, or frame.
- F. In existing rooms and areas where alterations occur, clean existing stained and natural finished wood retouch abraded surfaces and then give entire surface one (1) coat of MPI 31 (Polyurethane, Moisture Cured, Clear Gloss), MPI 71 (Polyurethane, Moisture Cured, Clear Flat).

- G. Refinish areas as specified for new work to match adjoining work unless specified or scheduled otherwise.
- H. Coat knots and pitch streaks showing through old finish with MPI 36 (Knot Sealer) before refinishing.
- I. Sand or dull glossy surfaces prior to painting.
- J. Sand existing coatings to a feather edge so that transition between new and existing finish will not show in finished work.

### **3.10 PAINT COLOR**

- A. Color and gloss of finish coats is specified in Section 09 06 00, SCHEDULE FOR FINISHES.
- B. For additional requirements regarding color see Articles, "REFINISHING EXISTING PAINTED SURFACE" and "MECHANICAL AND ELECTRICAL FIELD PAINTING SCHEDULE".
- C. Coat Colors:
  - 1. Color of Priming Coat: Lighter than body coat.
  - 2. Color of Body Coat: Lighter than finish coat.
  - 3. Color prime and body coats to not show through the finish coat and to mask surface imperfections or contrasts.
- D. Painting, Caulking, Closures, and Fillers Adjacent to Casework:
  - 1. Paint to match color of casework where casework has a paint finish.
  - 2. Paint to match color of wall where casework is stainless steel, plastic laminate, or varnished wood.

### **3.11 MECHANICAL AND ELECTRICAL WORK FIELD PAINTING SCHEDULE**

- A. Field painting of mechanical and electrical consists of cleaning, touching-up abraded shop prime coats, and applying prime, body and finish coats to materials and equipment if not factory finished in space scheduled to be finished.
- B. In spaces not scheduled to be finish painted in Section 09 06 00, SCHEDULE FOR FINISHES paint as specified below.
- C. Paint various systems specified in Division 02 - EXISTING CONDITIONS, Division 21 - FIRE SUPPRESSION, Division 22 - PLUMBING, Division 23 - HEATING, VENTILATION AND AIR-CONDITIONING, Division 26 - ELECTRICAL, Division 27 - COMMUNICATIONS, and Division 28 - ELECTRONIC SAFETY AND SECURITY.
- D. Paint after tests have been completed.
- E. Omit prime coat from factory prime-coated items.

- F. Finish painting of mechanical and electrical equipment is not required when located in interstitial spaces, above suspended ceilings, in concealed areas such as pipe and electric closets, pipe basements, pipe tunnels, trenches, attics, roof spaces, shafts and furred spaces except on electrical conduit containing feeders 600 volts or more.
- G. Omit field painting of items specified in "BUILDING AND STRUCTURAL WORK FIELD PAINTING"; "Building and Structural Work not Painted".
- H. Color:
  - 1. Paint items having no color specified in Section 09 06 00, SCHEDULE FOR FINISHES to match surrounding surfaces.
  - 2. Paint colors as specified in Section 09 06 00, SCHEDULE FOR FINISHES except for following:
    - a. White: Exterior unfinished surfaces of enameled plumbing fixtures. Insulation coverings on breeching and uptake inside boiler house, drums and drum-heads, oil heaters, condensate tanks and condensate piping.
    - b. Gray: Heating, ventilating, air conditioning and refrigeration equipment (except as required to match surrounding surfaces), and water and sewage treatment equipment and sewage ejection equipment.
    - c. Aluminum Color: Ferrous metal on outside of boilers and in connection with boiler settings including supporting doors and door frames and fuel oil burning equipment, and steam generation system (bare piping, fittings, hangers, supports, valves, traps and miscellaneous iron work in contact with pipe).
    - d. Federal Safety Red: Exposed fire protection piping hydrants, post indicators, electrical conduits containing fire alarm control wiring, and fire alarm equipment.
    - e. Federal Safety Orange: Entire lengths of electrical conduits containing feeders 600 volts or more.
    - f. Color to match brickwork sheet metal covering on breeching outside of exterior wall of boiler house.

I. Apply paint systems on properly prepared and primed surface as follows:

1. Interior Locations:

a. Apply two (2) coats of MPI 47 (Interior Alkyd, Semi-Gloss)

to following items:

1) Metal under 94 degrees C (201 degrees F) of items such as bare piping, fittings, hangers and supports.

2) Equipment and systems such as hinged covers and frames for control cabinets and boxes, cast-iron radiators, electric conduits and panel boards.

3) Heating, ventilating, air conditioning, plumbing equipment, and machinery having shop prime coat and not factory finished.

b. Apply two (2) coats of MPI 22 (High Heat Resistant Coating)

to ferrous metal surface over 94 degrees K (290 degrees F) of following items:

1) Steam line flanges, bare pipe, fittings, valves, hangers and supports over 94 degrees K (290 degrees F).

c. Paint electrical conduits containing cables rated 600 volts

or more using two (2) coats of MPI 9 (Exterior Alkyd Enamel), MPI 8 (Exterior Alkyd, Flat), MPI 94 (Exterior Alkyd, Semi-gloss), in the Federal Safety Orange color in exposed and concealed spaces full length of conduit.

3. Other Exposed Locations:

a. Metal surfaces, except aluminum, of cooling towers exposed to view, including connected pipes, rails, and ladders: Two (2) coats of MPI 1 (Aluminum Paint).

b. Cloth jackets of insulation of ducts and pipes in connection with plumbing, air conditioning, ventilating refrigeration and heating systems: One (1) coat of MPI 50 (Interior Latex Primer Sealer) and one (1) coat of MPI 10 (Exterior Latex, Flat), MPI 11 (Exterior Latex Semi-Gloss, MPI 119 (Exterior Latex, High Gloss (acrylic)).

### **3.12 BUILDING AND STRUCTURAL WORK FIELD PAINTING**

A. Painting and finishing of interior and exterior work except as specified here-in-after.

1. Painting and finishing of new and existing work including colors and gloss of finish selected is specified in Finish Schedule, Section 09 06 00, SCHEDULE FOR FINISHES.

2. Painting of disturbed, damaged and repaired or patched surfaces when entire space is not scheduled for complete repainting or refinishing.
  3. Painting of ferrous metal and galvanized metal.
  4. Identity painting and safety painting.
- B. Building and Structural Work not Painted:
1. Prefinished Items:
    - a. Casework, doors, elevator entrances and cabs, metal panels, wall covering, and similar items specified factory finished under other sections.
    - b. Factory finished equipment.
  2. Finished Surfaces:
    - a. Hardware except ferrous metal.
    - b. Anodized aluminum, stainless steel, chromium plating, copper, and brass, except as otherwise specified.
    - c. Signs, fixtures, and other similar items integrally finished.
  3. Concealed Surfaces:
    - a. Inside dumbwaiter, elevator and duct shafts, interstitial spaces, pipe basements, crawl spaces, pipe tunnels, above ceilings, attics, except as otherwise specified.
    - b. Inside walls or other spaces behind access doors or panels.
    - c. Surfaces concealed behind permanently installed casework and equipment.
  4. Moving and Operating Parts:
    - a. Shafts, chains, gears, mechanical and electrical operators, linkages, and sprinkler heads, and sensing devices.
    - b. Tracks for overhead or coiling doors, shutters, and grilles.
  5. Labels:
    - a. Code required label, such as Underwriters Laboratories Inc., Intertek Testing Service or Factory Mutual Research Corporation.
    - b. Identification plates, instruction plates, performance rating, and nomenclature.
  6. Galvanized Metal:
    - a. Exterior chain link fence and gates, corrugated metal areaways, and gratings.
    - b. Gas Storage Racks.
    - c. Except where specifically specified to be painted.

7. Metal safety treads and nosings.
8. Gaskets.
9. Face brick.
10. Structural steel encased in concrete, masonry, or other enclosure.
11. Structural steel to receive sprayed-on fire proofing.
12. Ceilings, walls, columns in interstitial spaces.
13. Ceilings, walls, and columns in pipe basements.

### **3.13 IDENTITY PAINTING SCHEDULE**

- A. Identify designated service in new buildings or projects with extensive remodeling in accordance with ASME A13.1, unless specified otherwise, on exposed piping, piping above removable ceilings, piping in accessible pipe spaces, interstitial spaces, and piping behind access panels. For existing spaces where work is minor, match existing.
  1. Legend may be identified using snap-on coil plastic markers or by paint stencil applications.
  2. Apply legends adjacent to changes in direction, on branches, where pipes pass through walls or floors, adjacent to operating accessories such as valves, regulators, strainers and cleanouts a minimum of 12.2 M (40 feet) apart on straight runs of piping. Identification next to plumbing fixtures is not required.
  3. Locate Legends clearly visible from operating position.
  4. Use arrow to indicate direction of flow using black stencil paint.
  5. Identify pipe contents with sufficient additional details such as temperature, pressure, and contents to identify possible hazard. Insert working pressure shown on construction documents where asterisk appears for High, Medium, and Low Pressure designations as follows:
    - a. High Pressure - 414 kPa (60 psig) and above.
    - b. Medium Pressure - 104 to 413 kPa (15 to 59 psig).
    - c. Low Pressure - 103 kPa (14 psig) and below.
    - d. Add Fuel oil grade numbers.

## 6. Legend name in full or in abbreviated form as follows:

PIPING	COLOR OF EXPOSED PIPING	COLOR OF BACKGROUND	COLOR OF LETTERS	LEGEND ABBREVIATIONS
Blow-off		Green	White	Blow-off
Boiler Feedwater		Green	White	Blr Feed
A/C Condenser Water Supply		Green	White	A/C Cond Wtr Sup
A/C Condenser Water Return		Green	White	A/C Cond Wtr Ret
Chilled Water Supply		Green	White	Ch. Wtr Sup
Chilled Water Return		Green	White	Ch. Wtr Ret
Shop Compressed Air		Blue	White	Shop Air
Air-Instrument Controls		Green	White	Air-Inst Cont
Drain Line		Green	White	Drain
Emergency Shower		Green	White	Emg Shower
High Pressure Steam		Green	White	H.P. _____*
High Pressure Condensate Return		Green	White	H.P. Ret _____*
Medium Pressure Steam		Green	White	M. P. Stm _____*
Medium Pressure Condensate Return		Green	White	M.P. Ret _____*
Low Pressure Steam		Green	White	L.P. Stm _____*
Low Pressure Condensate Return		Green	White	L.P. Ret _____*
High Temperature Water Supply		Green	White	H. Temp Wtr Sup
High Temperature Water Return		Green	White	H. Temp Wtr Ret
Hot Water Heating Supply		Green	White	H. W. Htg Sup
Hot Water Heating Return		Green	White	H. W. Htg Ret
Gravity Condensate Return		Green	White	Gravity Cond Ret
Pumped Condensate Return		Green	White	Pumped Cond Ret
Vacuum Condensate Return		Green	White	Vac Cond Ret
Fuel Oil - Grade (Diesel Fuel included under Fuel Oil)		Brown	White	Fuel Oil-Grade
Boiler Water Sampling		Green	White	Sample
Chemical Feed		Green	White	Chem Feed
Continuous Blow-Down		Green	White	Cont. B D
Pumped Condensate		Green	White	Pump Cond
Pump Recirculating		Green	White	Pump-Recirc.
Vent Line		Green	White	Vent
Alkali		Orange	Black	Alk
Bleach		Orange	Black	Bleach
Detergent		Yellow	Black	Det



Liquid Supply		Yellow	Black	Liq Sup
Reuse Water		Yellow	Black	Reuse Wtr
Cold Water (Domestic)	White	Green	White	C.W. Dom
Hot Water (Domestic)				
Supply	White	Yellow	Black	H.W. Dom
Return	White	Yellow	Black	H.W. Dom Ret
Tempered Water	White	Yellow	Black	Temp. Wtr
Ice Water				
Supply	White	Green	White	Ice Wtr
Return	White	Green	White	Ice Wtr Ret
Reagent Grade Water		Green	White	RG
Reverse Osmosis		Green	White	RO
Sanitary Waste		Green	White	San Waste
Sanitary Vent		Green	White	San Vent
Storm Drainage		Green	White	St Drain
Pump Drainage		Green	White	Pump Disch
Chemical Resistant Pipe				
Waste		Orange	Black	Acid Waste
Vent		Orange	Black	Acid Vent
Atmospheric Vent		Green	White	ATV
Silver Recovery		Green	White	Silver Rec
Oral Evacuation		Green	White	Oral Evac
Fuel Gas		Yellow	Black	Gas
Fire Protection Water				
Sprinkler	Red	Red	White	Auto Spr
Standpipe	Red	Red	White	Stand
Sprinkler	Red	Red	White	Drain
Hot Water Supply Dom./				
Solar Water		Green	White	H.W. Sup Dom/SW
Hot Water Return Dom./				
Solar Water		Green	White	H.W. Ret Dom/SW

7. Electrical Conduits containing feeders over 600 volts, paint legends using 50 mm (2 inch) high black numbers and letters, showing the voltage class rating. Provide legends where conduits pass through walls and floors and at maximum 6096 mm (20 foot) intervals in between. Use labels with yellow background with black border and words Danger High Voltage Class, (label as applicable) 5000, 15000, 25000.

8. See Sections for methods of identification, legends, and abbreviations of the following:
  - a. Medical Gases and Vacuum Lines: Section 22 62 00, VACUUM SYSTEMS FOR HEALTHCARE FACILITIES / Section 22 63 00, GAS SYSTEMS FOR HEALTHCARE FACILITIES.
  - f. Conduits Containing High Voltage Feeders Over 600 Volts:  
Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS.

B. Fire and Smoke Partitions:

1. Identify partitions above ceilings on both sides of partitions except within shafts in letters not less than 64 mm (2 1/2 inches) high.
2. Stenciled message: "SMOKE BARRIER" or, "FIRE BARRIER" as applicable.
3. Locate not more than 6096 mm (20 feet) on center on corridor sides of partitions, and with a least one (1) message per room on room side of partition.
4. Use semi-gloss paint of color that contrasts with color of substrate.

C. Identify columns in pipe basements and interstitial space:

1. Apply stenciled number and letters to correspond with grid numbering and lettering indicated on construction documents.
2. Paint numbers and letters 101 mm (4 inches) high, locate 45 mm (18 inches) below overhead structural slab.
3. Apply on four (4) sides of interior columns and on inside face only of exterior wall columns.
4. Color:
  - a. Use black on concrete columns.
  - b. Use white or contrasting color on steel columns.

**3.14 PROTECTION CLEAN UP, AND TOUCH-UP**

- A. Protect work from paint droppings and spattering by use of masking, drop cloths, removal of items or by other approved methods.
- B. Upon completion, clean paint from hardware, glass and other surfaces and items not required to be painted of paint drops or smears.
- C. Before final inspection, touch-up or refinished in a manner to produce solid even color and finish texture, free from defects in work which was damaged or discolored.

- - - E N D - - -

## **SECTION 10 21 16**

### **SHOWER STALLS**

#### **PART 1 - GENERAL**

##### **1.1 WORK INCLUDED**

- A. Solid surface shower receptors and shower surrounds.

##### **1.2 RELATED WORK**

- A. Division 22 - Plumbing

##### **1.3 PERFORMANCE REQUIREMENTS**

- A. Provide shower receptors that conform to the following requirements of regulatory agencies.
  - 1. Provide shower receptors and shower surrounds that conform to ANSI 124.1.2-2005 when tested for workmanship and finish, structural integrity and material characteristics.
  - 2. Fungal and Bacterial Resistance: Provide BioPrism Solid Surface that does not support fungal and bacterial growth as tested in accordance with ASTM G-21 and ASTM G-22.

##### **1.4 SUBMITTALS**

- A. Product Data: Manufacturer's printed product data for each type of shower receptor and shower surround specified.
- B. Samples: Verification samples minimum of 3" x 3" samples indicating color and pattern.

##### **1.5 QUALITY ASSURANCE**

- A. Provide all shower receptors and shower surrounds from a single source.

##### **1.6 DELIVERY, HANDLING, AND STORAGE**

- A. Deliver materials in unopened factory packaging to the jobsite
- B. Inspect materials at delivery to assure that specified products have been received.
- C. Store in original packaging in an interior climate-controlled location away from direct sunlight.
  - 1. Receptors must be laid flat. Do not stack.

#### **PART 2 - PRODUCTS**

##### **2.1 MANUFACTURER**

- A. Inpro Corp., Muskego, Wisconsin
  - 1. BioPrism Solid Surface Shower Systems.

## **2.2 MATERIALS**

- A. BioPrism Solid Surface Material:
  - 1. A bio polyester and acrylic hybrid resin with natural filler material.
- B. Adhesive/Sealant:
  - 1. Per manufacturer's recommendations.

## **2.3 MANUFACTURED UNITS**

- A. Shower Receptors:
  - 1. Style: ADA Transfer Shower Receptor.
  - 2. Size: Refer to drawings for standard and/or custom sizes.
  - 3. Color: Refer to Finish Legend.
  - 4. Drain Location: Refer to drawings.
  - 5. Threshold: Integral ADA compliant threshold.
- B. Shower Surrounds:
  - 1. Edges: Square
  - 2. Color: Refer to Finish Legend.

## **2.4 ACCESSORIES**

- A. Inside Corner Moldings:
  - 1. Solid Surface Inside Corner Molding, DSICP196, 15/16"w x 1/4"h x 96" long
  - 2. Solid Surface Inside Corner Molding - L-shaped, DSICPL196, 1"h x 1"w x 96" long 1/4" thick
- B. Outside Corner Molding:
  - 1. Solid Surface Outside Corner Molding, DSOCP196, 1/4" thick x 1" x 96"
- C. Perimeter Trim:
  - 1. Solid Surface Perimeter Trim, DSPTP96250, 1/2" thick x 2-1/2" x 96", includes 5/16" x 3/4" rabbit.
  - 2. Solid Surface Outside Corner Perimeter Trim, DSPOCP96250, 1/2" thick x 2-1/2" x 96"
- D. Corner Shelves:
  - 1. Solid Surface Large Tub and Shower Corner Shelf, DSSHPL, 1/2" thick x 8"

## **2.5 FABRICATION**

- A. Receptor floor to be solid cast product with integral threshold and water barrier.

## **PART 3 - EXECUTION**

### **3.1 EXAMINATION**

- A. Examine areas and conditions in which shower receptors and shower surrounds will be installed.

### **3.2 PREPARATION**

- A. Prior to installation, clean area to remove dust, debris and loose particles.

### **3.3 INSTALLATION**

- A. Install components plumb and level, scribe adjacent finishes, in accordance with approved shop drawings and recommended installation instructions.

### **3.4 CLEANING**

- A. At completion of the installation, clean surfaces in accordance with the Inpro® Decorative Surfaces clean-up and maintenance instructions.

- - E N D - -



**SECTION 10 21 23  
CUBICLE CURTAIN TRACKS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies cubicle curtain track (C.C.T.).

**1.2 RELATED WORK**

- A. Steel shapes for suspending track assembly: Section 05 50 00, METAL FABRICATIONS.
- B. Acoustical ceiling tile and suspension systems Section 09 51 00, ACOUSTICAL CEILINGS.

**1.3 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Samples:
  - 1. 305 mm (12 inch) long piece of cubicle curtain track with carrier access and end stop.
  - 2. Clip anchor for fastening track to grid system of acoustical ceilings.
  - 3. Curtain carrier for attaching curtain to track.
- C. Shop Drawings: Showing layout of tracks and method of anchorage.
- D. Manufacturer's Literature and Data:
  - 1. Cubicle curtain track.

**1.4 DELIVERY, STORAGE AND HANDLING**

- A. Deliver material in original package marked to identify the contents, brand name, and the name of the manufacturer or supplier.
- B. Store in dry and protected location. Store so as to not bend or warp the tracks.
- C. Do not open packages until contents are needed for installation, unless verification inspection is required.

**1.5 WARRANTY**

- A. Construction Warranty: Cubicle curtain tracks are subject to the terms of the Article "Warranty of Construction," FAR clause 52.246-21.

**1.6 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

## B. ASTM International (ASTM):

- B221-14.....Aluminum and Aluminum-Alloy Extruded Bars,  
Rods, Wire, Shapes, and Tubes
- B221M-13.....Aluminum and Aluminum-Alloy Extruded Bars,  
Rods, Wire, Shapes, and Tubes (Metric)
- B456-11.....Electrodeposited Coatings for Copper Plus  
Nickel Plus Chromium and Nickel Plus Chromium

## C. Aluminum Association (AA):

- DAF 45-09.....Designation System for Aluminum Finishes

## D. American Architectural Manufacturers Association (AAMA):

- 2603-13.....Voluntary Specification, Performance  
Requirements and Test Procedures for Pigmented  
Organic Coatings on Aluminum Extrusions and  
Panels

## E. The National Association of Architectural Metal Manufacturers (NAAMM):

- AMP 500 Series.....Metal Finishes Manual

**PART 2 - PRODUCTS****2.1 CUBICLE CURTAIN TRACKS**

- A. Channel Tracks (Surface Mounted Type): Extruded aluminum, ASTM B221M (B221), alloy 6063, temper T5 or T6, channel shaped, with smooth inside raceway for curtain carriers.
- B. Curtain Carriers: Nylon carriers, with nylon wheels on metal or nylon axles.
  - 1. Equip each carrier with either stainless steel, chromium plated brass or steel hooks with swivel, or nickel chromium plated brass or stainless steel bead chain.
  - 2. Hook for bead chain may be the same material and finish as the bead chain or may be chromium plated steel.
  - 3. Provide 2.2 carriers for every 305 mm (1 foot) of each section of each track length, plus one (1) additional carrier.
- C. End Stop Connectors, Ceiling Flanges and Other Accessories: Fabricate from the same material with the same finish as the tracks or from nylon.
- D. Hangers and Fittings: Fabricate from the same material with the same finish as the tracks. Hangers may be round or square for channel tracks and round for tubular tracks. Design fittings to be compatible with design of tracks and to safely transmit the track load to the hangers.
- E. At end of each section of track, make provision for insertion and removal of carriers. Design to prevent accidental removal of carrier. Provide operating mechanism shall be removable with common tools.



**2.2 FASTENERS**

- A. Exposed Fasteners, Screws and Bolts: Stainless steel or chromium/nickel plated brass.
- B. Concealed Fasteners, Screws and Bolts: Hot-dip galvanized.
- C. Metal Clips: Anchor curtain tracks to exposed grid of lay-in acoustical tile ceilings, with concealed metal (butterfly) type or two piece snap locking type ceiling clip of high strength spring steel.
  - 1. When it is not possible to install the metal ceiling clip, the cubicle curtain track may be screwed to the ceiling grid.

**2.3 FINISHES**

- A. Aluminum: Finish numbers for aluminum specified are in accordance with AA DAF 45. AA-C22A31 finish, chemically etched medium matte with clear anodic coating, Class II Architectural, .01 mm (0.4 mils) thick.
- B. Chrome/Nickel Plating: Satin or polished finish, ASTM B546, minimum thickness of chromium plate as follows:
  - 1. 0.005 mm (0.2 mil) on copper alloys.
  - 2. 0.01 mm (0.4 mil) on steel.
- C. Stainless Steel: No. 4 in accordance with NAAMM AMP 500.
- D. Baked Enamel or Powder Coat Finish: AAMA 2603.

**2.4 FABRICATION**

- A. Weld and grind smooth joints of fabricated components.
- B. Form tracks and bends of lengths that will produce the minimum number of joints. Make track sections up to 4877 mm (16 feet) without joints. Form corner bend on a 305 mm (12 inch) radius.
- C. Provide steel anchor plates, supports, and anchors for securing components to building construction.
- D. Form flat surface without distortion.
- E. Shop assemble components and package complete with anchors and fittings.

**PART 3 - EXECUTION****3.1 INSTALLATION**

- A. Install tracks after finish painting and ceiling finishing operations are complete.
- B. Install track level and hangers plumb and securely anchor to the ceiling to form a rigid installation.
- C. Anchor surface mounted curtain tracks directly to exposed grid of lay-in acoustical tile ceilings with suitable fasteners, spaced approximately 610 mm (24 inches) on center.

- D. Anchor surface mounted curtain tracks to concrete, plaster and gypsum board ceilings with a minimum of 3 mm (1/8-inch) diameter fastenings or concealed clips spaced not more than 914 mm (3 feet) on center.
- E. Fasten end stop caps to prevent them from being forced out by the striking weight of carriers.
- F. Remove damaged or defective components and replace with new components or repair to the original condition.
- G. Install track rigid, plumb, level and true, and securely anchored to the overhead construction.
- H. Verify that carrier units operate smoothly and easily over the full range of travel.

- - - E N D - - -

**SECTION 10 26 00  
WALL AND DOOR PROTECTION**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies wall guards, corner guards, recladding handrails, bed locators and sheet wall protection.

**1.2 RELATED WORK**

- A. Armor Plates and Kick Plates Not Specified in This Section: Section 08 71 00, DOOR HARDWARE.
- B. Division 26, ELECTRICAL WORK.
- C. Color and Texture of Aluminum and Resilient Material: Section 09 06 00, SCHEDULE FOR FINISHES.

**1.3 QUALITY ASSURANCE**

- A. Manufacturer's Qualifications: Manufacturer with a minimum of three (3) years' experience in providing items of type specified.
  - 1. Obtain wall and door protection from single manufacturer.
- B. Installer's Qualifications: Installers are to have a minimum of three (3) years' experience in the installation of units required for this project.

**1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings: Show design and installation details.
- C. Manufacturer's Literature and Data:
  - 1. Handrail Cladding Material.
  - 2. Wall Guards.
  - 3. Corner Guards.
  - 4. Bed Locators.
  - 5. Sheet Wall Protection
- D. Test Report: Showing that resilient material complies with specified fire and safety code requirements.
- E. Manufacturer's qualifications.
- F. Installer's qualifications.
- G. Manufacturer's warranty.

**1.5 DELIVERY AND STORAGE**

- A. Deliver materials to the site in original sealed packages or containers marked with the name and brand, or trademark of the manufacturer.
- B. Protect from damage from handling and construction operations before, during and after installation.
- C. Store in a dry environment of approximately 21 degrees C (70 degrees F) for at least 48 hours prior to installation.

**1.6 WARRANTY**

- A. Construction Warranty: Comply with FAR clause 52.246-21 "Warranty of Construction".
- B. Manufacturer Warranty: Manufacturer shall warranty their wall and door protection for a minimum of five (5) years from date of installation and final acceptance by the Government. Submit manufacturer warranty.

**1.7 APPLICABLE PUBLICATIONS**

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.
- B. ASTM International (ASTM):
  - A240/A240M-14.....Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and For General Applications
  - B221-14.....Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Shapes, and Tubes
  - B221M-13.....Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Shapes, and Tubes (Metric)
  - D256-10.....Impact Resistance of Plastics
  - D635-10.....Rate of Burning and/or Extent and Time of Burning of Self-Supporting Plastics in a Horizontal Position
  - E84-14.....Surface Burning Characteristics of Building Materials
- C. Aluminum Association (AA):
  - DAF 45-09.....Designation System for Aluminum Finishes
- D. American Architectural Manufacturers Association (AAMA):
  - 611-14.....Anodized Architectural Aluminum

- E. Code of Federal Regulation (CFR):
  - 40 CFR 59.....Determination of Volatile Matter Content,  
Water Content, Density Volume Solids, and  
Weight Solids of Surface Coating
- F. The National Association of Architectural Metal Manufacturers (NAAMM):
  - AMP 500-06.....Metal Finishes Manual
- G. National Fire Protection Association (NFPA):
  - 80-13.....Standard for Fire Doors and Windows
- H. SAE International (SAE):
  - J 1545-05(R2014).....Instrumental Color Difference Measurement for  
Exterior Finishes.
- I. Underwriters Laboratories Inc. (UL):
  - Annual Issue.....Building Materials Directory

## **PART 2 - PRODUCTS**

### **2.1 MATERIALS**

- A. Stainless Steel: A240/A240M, Type 304.
- B. Aluminum Extruded: ASTM B221M (B221), Alloy 6063, Temper T5 or T6.  
Provide aluminum alloy used for colored anodizing coating as required to produce specified color.
- C. Resilient Material:
  - 1. Provide resilient material consisting of high impact resistant extruded acrylic vinyl, polyvinyl chloride, or injection molded thermal plastic conforming to the following:
    - a. Minimum impact resistance of 960.8 N-m/m (18 ft.-lbs./sq. inch) when tested in accordance with ASTM D256 (Izod impact, ft.-lbs. per inch notched).
    - b. Class 1 fire rating when tested in accordance with ASTM E84, having a maximum flame spread of 25 and a smoke developed rating of 450 or less.
    - c. Rated self-extinguishing when tested in accordance with ASTM D635.
    - d. Provide material labeled and tested by Underwriters Laboratories or other approved independent testing laboratory.
    - e. Provide integral color with colored components matched in accordance with SAE J 1545 to within plus or minus 1.0 on the CIE-LCH scales.

## 2.2 CORNER GUARDS

- A. Resilient, Shock-Absorbing Corner Guards: Surface mounted type.
  - 1. Snap-on corner guard formed from resilient material, minimum 1.98 mm (0.078-inch) thick, free floating on a continuous 1.52 mm (0.060-inch) thick extruded aluminum retainer. Provide appropriate mounting hardware, cushions and base plates as required.
  - 2. Profile: Minimum 76 mm (3 inch) long leg and 6 mm (1/4 inch) corner radius.
  - 3. Height: 2.43 m (8 feet).
  - 4. Retainer Clips: Provide manufacturer's standard impact-absorbing clips.
  - 5. Provide factory fabricated end closure caps at top and bottom of surface mounted corner guards.

## 2.3 WALL GUARDS AND HANDRAILS

- A. Resilient Wall Guards and Handrails:
  - 1. Handrails
    - a. Remove existing resilient covers and re clad with new resilient material as noted on Finish Legend.
  - 2. Wall Guards:
    - a. Snap-on covers of resilient material, minimum 2 mm (0.080-inch) thick. Free-floated over a continuous extruded aluminum retainer, minimum 2.03 mm (0.080-inch) thick anchored to wall at maximum 610 mm (24 inches) on center.
  - 3. Provide handrails and wall guards with prefabricated end closure caps, inside and outside corners, concealed splices, cushions, mounting hardware and other accessories as required. End caps and corners to be field adjustable to assure close alignment with handrails and wall guards. Screw or bolt closure caps to aluminum retainer in a concealed manner.

## 2.4 BED LOCATORS

- A. Material: Single piece vacuum molded high impact Kydex-T with Microban protection.
- B. Each bed locator system shall hold up to four (4) electrical/communication devices on each side of the unit. It shall contain electrical raceways to enclose electrical wiring for each type of power (critical, normal, and low voltage/communication).

**2.5 SHEET WALL PROTECTION COVERING**

- A. Provide wall covering/panels consisting of high impact rigid acrylic vinyl or polyvinyl chloride resilient material.
- B. Panel Size: As required to avoid seams.
- C. Submit fire rating and extinguishing test results for resilient material.
- D. Submit statements attesting that the items comply with specified fire and safety code requirements.
- E. Sheet Wall Protection Wall Covering: Wall covering thickness to be 1.52 mm (0.060 inch).
- G. Provide adhesive as recommended by the wall covering manufacturer.

**2.6 FASTENERS AND ANCHORS**

- A. Provide fasteners and anchors as required for each specific type of installation.
- B. Where type, size, spacing or method of fastening is not shown or specified in construction documents, submit shop drawings showing proposed installation details.

**2.7 FINISH**

- A. Resilient Material: Embossed textures and color in accordance with SAE J1545.

**PART 3 - INSTALLATION****3.1 RESILIENT CORNER GUARDS**

- A. Install corner guards on walls in accordance with manufacturer's instructions.

**3.2 RESILIENT WALL GUARDS**

- A. Secure wall guards to walls with brackets and fasteners in accordance with manufacturer's details and instructions.

**3.3 RESILIENT HANDRAIL CLADDING MATERIAL**

- A. Secure handrails to walls with brackets and fasteners in accordance with manufacturer's details and instructions.
- B. Install new cladding material per manufacturer's instructions.

**3.4 BED LOCATOR**

- A. Verify rough-in services to connect to bed locator rough-in boxes are correct.
- B. Mount per manufacturer's instructions.
- C. Unit shall be installed plumb, level and square.

### 3.5 SHEET WALL PROTECTION WALL COVERING

- A. Surfaces to receive protection to be clean, smooth and free of obstructions.
- B. Apply with adhesive in controlled environment according to manufacturer's recommendations.

- - - E N D - - -



**SECTION 10 28 00**  
**TOILET, BATH, AND LAUNDRY ACCESSORIES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

A. SUMMARY:

1. Section Includes: Toilet and bath accessories at dressing rooms, toilets, baths, locker rooms and other areas indicated on drawings.

**1.2 RELATED REQUIREMENTS**

- A. Color of Finishes: Section 09 06 00, SCHEDULE FOR FINISHES.

**1.3 APPLICABLE PUBLICATIONS**

- A. Comply with references to extent specified in this section.
- B. American Society of Mechanical Engineers (ASME):
1. B18.6.4-98(R2005) - Thread Forming and Thread Cutting Tapping Screws and Metallic Drive Screws inch.
- C. American Welding Society (AWS):
1. D10.4-86(2000) - Welding Austenitic Chromium-Nickle Stainless Steel Piping and Tubing.
- D. ASTM International (ASTM):
1. A269/A269M-15 - Seamless and Welded Austenitic Stainless Steel Tubing for General Service.
  2. A312/A312M-15b - Seamless, Welded, and Heavily Cold Worked Austenitic Stainless Steel Pipes.
  3. A653/A653M-15 - Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process.
  4. A666-15 - Annealed or Cold-Worked Austenitic Stainless Steel Sheet, Strip, Plate, and Flat Bar.
  5. A1011/A1011M-14 - Steel, Sheet and Strip, Hot-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, and Ultra-High Strength.
  6. B30-14a - Copper Alloys in Ingot Form.
  7. B75/B75M-11 - Seamless Copper Tube.
  8. B221-14 - Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes.
  9. B221M-13 - Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes (Metric).
  10. B456-11e1 - Electrodeposited Coatings of Copper Plus Nickel Plus Chromium and Nickel Plus Chromium.

- 11. B824-14 - General Requirements for Copper Alloy Castings.
- 12. C1036-11e1 - Flat Glass.
- 13. C1048-12e1 - Heat-Strengthened and Fully Tempered Flat Glass.
- 14. D635-14 - Rate of Burning and/or Extent and Time of Burning of Plastics in a Horizontal Position.
- 15. F446-85(2009) - Grab Bars and Accessories Installed in the Bathing Area.

E. Federal Specifications (Fed. Spec.):

- 1. A-A-3002 - Mirror, Glass.
- 2. FF-S-107C(2) - Screws, Tapping and Drive.
- 3. WW-P-541/8B(1) - Plumbing Fixtures (Accessories, Land Use).

F. National Architectural Metal Manufacturers (NAAMM):

- 1. AMP 500-06 - Metal Finishes Manual.

#### 1.4 SUBMITTALS

A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Submittal Drawings:

- 1. Show size, configuration, and fabrication, anchorage and installation details.
- 2. Show mounting locations and heights.

C. Manufacturer's Literature and Data:

- 1. Description of each product.
- 2. Installation instructions.

D. Samples:

- 1. Full sized, complete assembly of each product specified.
- 2. Approved samples may be incorporated into project.

E. Certificates: Certify each product complies with specifications.

- 1. Soap dispensers: Certify soap dispensers are fabricated of material that will not be affected by liquid soap, aseptic detergents, and hexachlorophene solutions.

F. Qualifications: Substantiate qualifications comply with specifications.

- 1. Manufacturer.

G. Operation and Maintenance Data:

- 1. Care instructions for each exposed finish product.

#### 1.5 QUALITY ASSURANCE

A. Manufacturer Qualifications:

- 1. Regularly manufactures specified products.

**1.6 DELIVERY**

- A. Deliver products in manufacturer's original sealed packaging.
- B. Mark packaging, legibly. Indicate manufacturer's name or brand, type, color, production run number, and manufacture date.
- C. Before installation, return or dispose of products within distorted, damaged, or opened packaging.

**1.7 STORAGE AND HANDLING**

- A. Store products indoors in dry, weathertight facility.
- B. Protect products from damage during handling and construction operations.

**1.8 WARRANTY**

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."

**PART 2 - PRODUCTS****2.1 MATERIALS**

- A. Aluminum: ASTM B221M (ASTM B221), Alloy 6063-T5 and Alloy 6463-T5.
- B. Stainless Steel:
  - 1. Plate Or Sheet: ASTM A666, Type 304, 0.8 mm (0.031 inch) thick unless otherwise specified.
  - 2. Tubing: ASTM A269/A269M, Grade TP 304, seamless or welded.
  - 3. Pipe: ASTM A312/A312M; Grade TP 304.
- C. Steel Sheet: ASTM A653/A653M, zinc-coated (galvanized) coating designation G90.
- D. Chrome Plating (Service Condition Number SC 2): ASTM B456.
- E. Brass Castings: ASTM B30.
- F. Copper:
  - 1. Tubing: ASTM B75/B75M.
  - 2. Castings: ASTM B824.
- G. Glass:
  - 1. ASTM C1036, Type 1, Class 1, Quality q2, for mirrors, and for mirror doors in medicine cabinets.
  - 2. ASTM C1036, Type 1 Class 1 Quality q3, for shelves in medicine cabinets.
  - 3. ASTM C1048, Kind FT, Condition A, Type 1, Class 1 for glass and mirrors in Mental Health and Behavior Patient Care Units, and Security Examination Rooms.

**2.2 PRODUCTS - GENERAL**

- A. Basis of Design: Section 09 06 00, SCHEDULE FOR FINISHES.
- B. Provide each product from one manufacturer.

**2.3 GRAB BARS**

- A. Fed. Spec. WW-P-541/8B, Type IV, bars, surface mounted, Class 2, grab bars and complying with ASTM F446.
- B. Fabricate from stainless steel.
  - 1. Stainless steel: Grab bars, flanges, mounting plates, supports, screws, bolts, and exposed nuts and washers.
- C. Mounting:
  - 1. Floor Mounted Grab Bars: Exposed type.
  - 2. Swing Up Grab Bars: Exposed type.
  - 3. Other Types and Locations: Concealed type.
- D. Bars:
  - 1. Fabricate to 38 mm (1-1/2 inch) outside diameter.
    - a. Stainless steel, minimum 1.2 mm (0.05 inch) thick.
    - b. Nylon coated bars, minimum 1.5 mm (0.06 inch) thick.
  - 2. Fabricate in one continuous piece with ends turned toward walls.
    - a. Swing up grab bars and grab bars continuous around three sides of showers may be fabricated in two sections, with concealed slip joint between.
  - 3. Continuously weld intermediate support to grab bar.
  - 4. Swing Up Bars: Manually operated; designed to prevent bar from falling when in raised position.
- E. Flange for Concealed Mounting:
  - 1. Minimum 2.65 mm (0.1 inch) thick, maximum 79 mm (3-1/8 inch) diameter by 13 mm (1/2 inch) deep, with minimum three set screws for securing flange to back plate.
  - 2. Insert grab bar through center of flange and continuously weld perimeter of grab bar flush to back side of flange.
  - 3. In lieu of providing flange for concealed mounting, and back plate as specified, grab bar may be welded to back plate covered with flange.

F. Flange for Exposed Mounting:

1. Minimum 5 mm (3/16 inch) thick, maximum 79 mm (3-1/8 inch) diameter.
2. Insert grab bar through flange and continuously weld perimeter of grab bar flush to backside of flange.
3. Where mounted on floor, provide four equally spaced holes, sized to accommodate 5 mm (3/8 inch) diameter bolts, maximum 5 mm (3/8 inch) from edge of flange.

G. Back Plates:

1. Minimum 2.65 mm (0.1046 inch) thick metal.
2. Fabricate in one piece, maximum 6 mm (1/4 inch) deep, with diameter sized to fit flange. Provide slotted holes to accommodate anchor bolts.
3. Provide spreaders, through bolt fasteners, and cap nuts, where grab bars are mounted on partitions.

**2.4 SHOWER CURTAIN RODS**

- A. Stainless steel tubing, minimum 1.27 mm (0.050 inch) wall thickness, 32 mm (1-1/4 inch) outside diameter.
- B. Flanges, stainless steel rings, 66 mm (2.6 inch) minimum outside diameter, with 2 holes opposite each other for 6 mm (1/4 inch) stainless steel fastening bolts. Provide set screw within curvature of each flange for securing rod.
- C. Intermediate Support: For rods over 1800 mm (72 inches) long. Provide adjustable ceiling flanges with set screws, tubular hangers and stirrups.

**2.5 CLOTHES HOOKS, ROBE OR COAT**

- A. Fabricate hook units from chromium plated brass with satin finish, or stainless steel, using 6 mm (1/4 inch) minimum thick stock, with edges and corners rounded smooth to thickness of metal, or 3 mm (1/8 inch) minimum radius.
- B. Fabricate each unit as a double hook on a single shaft, integral with or permanently fastened to wall flange, provided with concealed fastenings.

**2.6 METAL FRAMED MIRRORS**

- A. Fed. Spec. A-A-3002 metal frame; stainless steel.
- B. Mirror Glass:
  - 1. Minimum 6 mm (1/4 inch) thick.
  - 2. Set mirror in a protective vinyl glazing tape.
- C. Frames:
  - 1. Channel or angle shaped section with face of frame minimum 9 mm (3/8 inch) wide. Fabricate with square corners.
  - 2. Metal Thickness 0.9 mm (0.035 inch).
  - 3. Filler:
    - a. Where mirrors are mounted on walls having ceramic tile wainscots not flush with wall above, provide fillers contoured to conceal void between back of mirror and wall surface.
    - b. Fabricate fillers from same material and finish as mirror frame.
- D. Back Plate:
  - 1. Fabricate backplate for concealed wall hanging from zinc-coated, or cadmium plated 0.9 mm (0.036 inch) thick sheet steel, die cut to fit face of mirror frame.
  - 2. Provide set screw type theft resistant concealed fastening system for mounting mirrors.
- E. Mounting Bracket:
  - 1. Designed to support mirror tight to wall.
  - 2. Designed to retain mirror with concealed set screw fastenings.

**2.7 FABRICATION - GENERAL**

- A. Welding, AWS D10.4.
- B. Grind, dress, and finish welded joints to match finish of adjacent surface.
- C. Form exposed surfaces from one sheet of stock, free of joints.
- D. Provide steel anchors and components required for secure installation.
- E. Form flat surfaces without distortion. Keep exposed surfaces free from scratches and dents. Reinforce doors to prevent warp or twist.
- F. Isolate aluminum from dissimilar metals and from contact with building materials as required to prevent electrolysis and corrosion.
- G. Hot-dip galvanized steel or stainless steel, anchors and fastening devices.
- H. Shop assemble accessories and package with components, anchors, fittings, fasteners and keys.
- I. Key items alike.

- J. Provide templates and rough-in measurements.
- K. Round and deburr edges of sheets to remove sharp edges.

## 2.8 FINISH

- A. Steel Paint Finish:
  - 1. Powder-Coat Finish: Manufacturer's standard two-coat finish system consisting of the following:
    - a. One coat primer.
    - b. One coat thermosetting topcoat.
    - c. Dry-film Thickness: 0.05 mm (2 mils) minimum.
    - d. Color: Refer to Section 09 06 00, SCHEDULE FOR FINISHES.
- B. Stainless Steel: NAAMM AMP 500; No. 4 polished finish.
- C. Aluminum Anodized Finish: NAAMM AMP 500.
  - 1. Clear Anodized Finish: AA-C22A41; Class I Architectural, 0.018 mm (0.7 mil) thick.
  - 2. Color Anodized Finish: AA-C22A42 or AA-C22A44; Class I Architectural, 0.018 mm (0.7 mil) thick.
- D. Chromium Plating: ASTM B456, satin or bright as specified, Service Condition No. SC2.

## 2.9 ACCESSORIES

- A. Fasteners:
  - 1. Fasteners in Mental Health and Behavioral Patient Care Units: Tamper resistant hot-dipped galvanized or stainless steel.
  - 2. Exposed Fasteners: Stainless steel or chromium plated brass, finish to match adjacent surface.
  - 3. Concealed Fasteners:
    - a. Shower, Bath Tubs, and High Moisture Areas: Stainless steel.
    - b. Other Locations: Steel, hot-dipped galvanized.
  - 4. Toggle Bolts: For use in hollow masonry or frame construction.
  - 5. Sex Bolts: For through bolting on thin panels.
  - 6. Expansion Shields: Lead or plastic for solid masonry and concrete substrate as recommended by accessory manufacturer to suit application.
  - 7. Screws:
    - a. ASME B18.6.4.
    - b. Fed. Spec. FF-S-107, Stainless steel Type A.
- B. Adhesive: As recommended by manufacturer to suit application.

**PART 3 - EXECUTION****3.1 PREPARATION**

- A. Examine and verify substrate suitability for product installation.
  - 1. Verify blocking to support accessories is installed and located correctly.
- B. Verify location of accessories with Contracting Officer's Representative.

**3.2 INSTALLATION**

- A. Install products according to manufacturer's instructions.
  - 1. When manufacturer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.
- B. Install grab bars according to ASTM F446.
- C. Set work accurately, in alignment and where indicated, parallel or perpendicular as required to line and plane of surface. Install accessories plumb, level, free of rack and twist.
- D. Toggle bolt to steel anchorage plates in frame partitions and hollow masonry. Expansion bolt to concrete or solid masonry.
- E. Install accessories to function as designed. Perform maintenance service without interference with performance of other devices.
- F. Position and install dispensers, and other devices in countertops, clear of drawers, permitting ample clearance below countertop between devices, and ready access for maintenance.
- G. Align mirrors, dispensers and other accessories even and level, when installed in battery.
- H. Install accessories to prevent striking by other moving, items or interference with accessibility.

**3.3 CLEANING**

- A. After installation, clean toilet accessories according to manufacturer's instructions.

**3.4 PROTECTION**

- A. Protect accessories from damage until project completion.

- - E N D - -



**SECTION 12 32 00**  
**MANUFACTURED WOOD CASEWORK**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies plastic laminate casework as detailed on the construction documents, including related components and accessories required to form integral units. Wood casework items shown on the construction documents, but not specified below are to be included as part of the work under this section, and applicable portions of the specification are to apply to these items.

**1.2 RELATED WORK**

- A. Custom Wood Casework: Section 06 20 00, FINISH CARPENTRY.  
B. Sealants: Section 07 92 00, JOINT SEALANTS.  
C. Color of Casework Finish: Section 09 06 00, SCHEDULE OF FINISHES.  
D. Resilient Base: Section 09 65 13, RESILIENT BASE AND ACCESSORIES.  
E. Backing Plates for Wall Mounted Casework: Section 09 22 16, NON-STRUCTURAL METAL FRAMING.  
F. Countertop Construction and Materials and Items Installed in Countertops: Section 12 36 00, COUNTERTOPS.  
G. Plumbing Requirements Related to Casework: Division 22, PLUMBING.  
H. Electrical Lighting and Power Requirements Related to Casework: Division 26, ELECTRICAL.

**1.3 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.  
B. Manufacturer's Literature and Data:  
    1. Locks for doors and drawers.  
    2. Adhesive cements.  
    3. Casework hardware.  
C. Samples:  
    2. Plastic laminate.  
D. Shop Drawings (1/2 full size):  
    1. Each casework type, showing details of construction, including materials, hardware and accessories.  
    2. Fastenings and method of installation.  
E. Certification:  
    1. Manufacturer's qualifications specified.  
    2. Installer's qualifications specified.

**1.4 QUALITY ASSURANCE**

- A. Approval by COR is required of manufacturer and installer based upon certification of qualifications specified.
- B. Manufacturer's qualifications:
  - 1. Manufacturer is regularly engaged in design and manufacture of modular plastic laminate casework, casework components and accessories of scope and type similar to indicated requirements for a period of not less than five (5) years.
  - 2. Manufacturer has successfully completed at least three (3) projects of scope and type similar to indicated requirements.
  - 3. Submit manufacturer's qualifications and list of projects, including owner contact information.
- C. Installer Qualifications:
  - 1. Installer has completed at least three (3) projects in last five (5) years in which these products were installed.
  - 2. Submit installer qualifications.

**1.5 WARRANTY**

- A. Construction Warranty: Comply with FAR clause 52.246-21 "Warranty of Construction".
- B. Manufacturer Warranty: Manufacturer shall warranty their wood casework for a minimum of five (5) years from date of installation and final acceptance by the Government. Submit manufacturer warranty.

**1.6 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only.
- B. ASTM International (ASTM):
  - A240/A240M-14.....Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and for General Applications
  - A1008/A1008M-13.....Steel, Sheet, Cold-Rolled, Carbon, Structural, High Strength Low Alloy
  - C1036-11E1(R2012).....Flat Glass
- C. Builders Hardware Manufacturers Association (BHMA):
  - A156.1-13.....Butts and Hinges
  - A156.9-10.....Cabinet Hardware
  - A156.5-14.....Auxiliary Locks and Associated Products
  - A156.11-14.....Cabinet Locks

- D. Composite Panel Association (CPA):
  - A208.1-09.....Particleboard
  - A208.2-09.....Medium Density Fiberboard (MDF) for Interior Applications
- E. U.S. Department of Commerce Product Standards (Prod. Std):
  - PS 1-09.....Construction and Industrial Plywood
- F. Hardwood, Plywood and Veneer Association (HPVA):
  - HP-1-09.....Hardwood and Decorative Plywood
- G. Architectural Woodwork Institute (AWI):
  - Architectural Woodwork Standards, Edition 2 Certification Program - 2014
- H. American Society of Mechanical Engineers (ASME):
  - A112.18.1-12.....Plumbing Fixture Fittings
- I. National Electrical Manufacturers Association (NEMA):
  - LD 3-05.....High Pressure Decorative Laminates
- J. Underwriters Laboratories Inc. (UL):
  - 437-08(R2013).....Key Locks
- K. Scientific Equipment and Furniture Association (SEFA):
  - 2.3-10.....Installation of Scientific Laboratory Furniture and Equipment

## **PART 2 - PRODUCTS**

### **2.1 PLASTIC LAMINATE**

- A. NEMA LD 3.
- B. Exposed decorative surfaces, both sides of cabinet doors, and for items having plastic laminate finish. General purpose Type HGL.
- C. Cabinet Interiors Including Shelving: Both of following options to comply with NEMA LD 3 as a minimum.
  - 1. Plastic laminate clad plywood or particleboard, MDF (excluding shelves).
  - 2. Low pressure laminate (LPL).
- D. Backing sheet on bottom of plastic laminate covered wood tops. Backer Type BKL.
- E. Post Forming Fabrication, Decorative Surface: Post forming Type HGP.

### **2.2 PLYWOOD, SOFTWOOD**

- A. Prod. Std. PS1, five (5) ply construction from 13 mm to 28 mm (1/2 inch to 1-1/8 inch) thickness, and seven (7) ply for 31 mm (1 1/4 inch) thickness.

**2.3 PARTICLEBOARD**

- A. CPA A208.1, Type 1, Grade M or medium density.

**2.4 MEDIUM DENSITY FIBERBOARD (MDF)**

- A. Fully waterproof bond conforming to CPA A208.1 and CPA A208.2.

**2.5 HARDWARE**

- A. Locks: Provide Combi-Cam Ultra - Combination Cam Lock With High Security Key Over-ride manufactured by FJM Security Products, Lynnwood, Washington, [www.fjmsecurity.com](http://www.fjmsecurity.com).
  - 1. 10,000 code combinations and 50,000 key combinations
  - 2. Locks shall incorporate code retrieval capabilities.
  - 3. Chrome finish
  - 4. Provide twelve (12) Master Keys.
  - 5. Provide twelve (12) Code Reset Pins.
  - 6. Provide twelve (12) Grand Master Keys.
  - 7. Furnish complete lock assembly including cylinders, cams and all other components necessary for a complete installation.
- B. Hinged Doors:
  - 1. Provide doors 915 mm (36 inches) and more in height with three (3) hinges and doors less than 915 mm (36 inches) in height is to have two (2) hinges. Each door is to close against two (2) rubber bumpers.
  - 2. Concealed Hinges: BHMA A156.9, Type B01602, 135 degrees of opening, self-closing.
  - 3. Fasteners: Provide full thread wood screws to fasten hinge leaves to door and cabinet frame. Finish screws to match finish of hinges.
- C. Door Catches:
  - 1. Friction or Magnetic type, fabricated with metal housing.
  - 2. Provide one (1) catch for cabinet doors 1220 mm (48 inches) high and under, and two (2) for doors over 1220 mm (48 inches) high.
- D. Drawer and Door Pulls:
  - 1. Doors and drawers to have flush pulls, fabricated of either chromium-plated brass, chromium plated steel, stainless steel, or anodized aluminum. Drawer and door pulls to be of a design that can be operated with a force of 22.2 N (5 pounds) or less, with one (1) hand and not require tight grasping, pinching or twisting of the wrist.

## E. Drawer Slides:

1. Full extension steel slides with nylon ball-bearing rollers.
2. Slides to have positive stop.
3. Equip drawers with rubber bumpers.

## F. Shelf Standards (Except For Fixed Shelves):

1. Bright zinc-plated steel for recessed mounting with screws, 16 mm (5/8 inch) wide by 5 mm (3/16 inch) high providing 13 mm (1/2 inch)

## G. Panel Mounting Hardware:

1. Provide the following hardware manufactured by C.R. Laurence, Co., or equal in design, function and appearance.
2. Ceiling Mount: Brushed Stainless Steel Single Pivot Glass-to-Wall/Floor Swivel Fitting, Catalog Number SGF63BGW with Surface Mount Glass Attachment, Catalog Number SGF36CAP.
3. Standoffs: Chrome 1-1/4" Diameter by 1" Standoff Base, Catalog Number SOB114BS with 1-1/4" Diameter Custom Standoff Cap Assembly, Catalog Number CAP114BS.
4. Provide all necessary screws, hanger bolts and other hardware required for a complete installation.

**2.6 MANUFACTURED PRODUCTS**

- A. When two (2) or more units are required, use products of one (1) manufacturer.
- B. Manufacturer of casework assemblies is to assume complete responsibility for the final assembled unit.
- C. Provide products of a single manufacturer for parts which are alike.

**2.7 FABRICATION**

- A. Casework to be of the flush overlay design and, except as otherwise specified, be of Premium Grade construction and of component thickness in conformance with AWI Quality Standards.
- B. Fabricate casework of plastic laminated covered plywood or particleboard as follows:
  1. Where shown, doors, drawers, shelves and all semi-concealed surfaces to be plastic laminated.
  2. Horizontal and vertical reveals between doors and drawer for reveal overlay design to be 19 mm (3/4 inch) unless otherwise shown.
- C. Support Members for Tops of Tables and Countertops:
  1. Construct as detailed on construction documents.
  2. Provide miscellaneous steel members and anchor as shown on construction drawings.

## 2.8 PRODUCTS OF OTHER COMPONENTS DIRECTLY RELATED TO CASEWORK

- A. Refer to Section 07 92 00, JOINT SEALANTS for work related to sealants used in conjunction with joints of countertops, casework systems, and adjacent materials.
- B. Refer to Section 09 65 13, RESILIENT BASE AND ACCESSORIES for work related to rubber base adhered to casework systems.
- C. Refer to Section 09 22 16, NON-STRUCTURAL METAL FRAMING for backing plates used in conjunction with wall assemblies for the attachment of casework systems.
- D. Refer to Section 12 36 00, COUNTERTOPS for work related to plastic laminate, acid-resistant plastic laminate, metal, molded resin, wood, and methyl methacrylic polymer countertops and/or shelving used in conjunction with casework systems. When countertop materials are provided by the casework manufacturer, they are to include the following features:
  - 1. Capable of being suspended from vertical support rails or horizontal wall strips or service modules.
  - 2. Provided with rounded corners and impact resistant material on exposed edges.
  - 3. Capable of being easily relocated and installed without tools.
  - 4. Capable of being suspended and easily changed under counter mounted storage units.
  - 5. Provide leveling adjustment capability so units can be brought into a level position.
  - 6. Secured using fasteners. Show detail on shop drawings.
- E. Refer to Section 12 36 00, COUNTERTOPS for work related to and integral with countertop systems.
- F. Refer to Division 22, PLUMBING for the following work related to casework systems:
  - 1. Sinks, faucets and other plumbing service fixtures, venting, and piping systems.
- G. Refer to Division 26, ELECTRICAL for the following work related to casework systems:
  - 1. Connections and wiring devices.
  - 2. Connections and lighting fixtures except when factory installed by the manufacturer.

**PART 3 - EXECUTION****3.1 COORDINATION**

- A. Begin only after work of other trades is complete, including wall and floor finish completed, ceilings installed, light fixtures and diffusers installed and connected and area free of trash and debris.
- B. Verify location and size of mechanical and electrical services as required and perform cutting of components of work installed by other trades.
- C. Verify reinforcement of walls and partitions for support and anchorage of casework.
- D. Coordinate with other Divisions and Sections of the specification for work related to installation of casework systems to avoid interference and completion of service connections.

**3.2 INSTALLATION**

- A. Install casework in accordance with manufacturer's written instructions and per SEFA 2.3 recommendations.
  - 1. Install in available space; arranged for safe and convenient operation and maintenance.
  - 2. Align cabinets for flush joints except where shown otherwise.
  - 3. Install with bottom of wall cabinets in alignment and tops of base cabinets aligned level, plumb, true, and straight to a tolerance of 3.2 mm in 2438 mm (1/8 inch in 96 inches).
  - 4. Install corner cabinets with hinges on corner side with filler or spacers sufficient to allow opening of drawers.
- B. Support Rails:
  - 1. Install true to horizontal at heights shown on construction documents; maximum tolerance for uneven floors is plus or minus 13 mm (1/2 inch).
  - 2. Shim as necessary to accommodate variations in wall surface not exceeding 5 mm (3/16 inch) at fastener.
- C. Wall Strips:
  - 1. Install true to vertical and spaced as shown on construction documents.
  - 2. Align slots to assure that hanging units will be level.

## D. Plug Buttons:

1. Install plug buttons in predrilled or prepunched perforations not used.
2. Use chromium plate plug buttons or buttons finish to match adjacent surfaces.

## E. Seal junctures of casework systems with mildew-resistant silicone sealants as specified in Section 07 92 00, JOINT SEALANTS.

**3.3. CLOSURES AND FILLER PLATES**

- A. Close openings larger than 6 mm (1/4 inch) wide between cabinets and adjacent walls with flat, steel closure strips, scribed to required contours, or machined formed steel fillers with returns, and secured with sheet metal screws to tubular or channel members of units, or bolts where exposed on inside.
- B. Where ceilings interfere with installation of sloping tops, omit sloping tops and provide flat steel filler plates.
- C. Secure filler plates to casework top members, unless shown otherwise on construction documents.
- D. Secure filler plates more than 152 mm (6 inches) in width top edge to a continuous 25 x 25 mm (1 x 1 inch) 0.889 mm (1/16 inch) thick steel formed steel angle with screws.
- E. Anchor angle to ceiling with toggle bolts.
- F. Install closure strips at exposed ends of pipe space and offset opening into concealed space.
- G. Finish closure strips and fillers with same finishes as cabinets.

**3.4 FASTENINGS AND ANCHORAGE**

- A. Do not anchor to wood ground strips.
- B. Provide hat shape metal spacers where fasteners span gaps or spaces.
- C. Use 6 mm (1/4 inch) diameter toggle or expansion bolts, or other appropriate size and type fastening device for securing casework to walls or floor. Use expansion bolts shields having holding power beyond tensile and shear strength of bolt and breaking strength of bolt head.
- D. Use 6 mm (1/4 inch) diameter hex bolts for securing cabinets together.
- E. Use 6 mm (1/4 inch) by minimum 38 mm (1-1/2 inch) length lag bolt anchorage to wood blocking for concealed fasteners.
- F. Use not less than No. 12 or 14 wood screws with not less than 38 mm (1-1/2 inch) penetration into wood blocking.
- G. Space fastening devices 305 mm (12 inches) on center with minimum of three (3) fasteners in 915 or 1220 mm (3 or 4 foot) unit width.



- H. Anchor floor mounted cabinets with a minimum of four (4) bolts through corner gussets. Anchor bolts may be combined with or separate from leveling device.
- I. Secure cabinets in alignment with hex bolts or other internal fastener devices removable from interior of cabinets without special tools. Do not use fastener devices which require removal of tops for access.
- J. Where units abut end to end, anchor together at top and bottom of sides at front and back. Where units are back to back, anchor backs together at corners with hex bolts placed inconspicuously inside casework.
- K. Where type, size, or spacing of fastenings is not shown on construction documents or specified, show on shop drawings proposed fastenings and method of installation.

### **3.5 ADJUSTMENTS**

- A. Adjust equipment to insure proper alignment and operation.
- B. Replace or repair damaged or improperly operating materials, components or equipment.

### **3.6 CLEANING**

- A. Immediately following installation, clean each item, removing finger marks, soil and foreign matter.
- B. Remove from job site trash, debris and packing materials.
- C. Leave installed areas clean of dust and debris.

### **3.7 INSTRUCTIONS**

- A. Provide operational and cleaning manuals and verbal instructions in accordance with Article INSTRUCTIONS, SECTION 01 00 00, GENERAL REQUIREMENTS.
- B. Provide in service training both prior to and after facility opening. Coordinate in service activities with COR.
- C. Commencing at least seven (7) days prior to opening of facility, provide one (1) four (4) hour day of on-site orientation and technical instruction on use and cleaning procedures application to products and systems specified herein.

- - - E N D - - -



**SECTION 12 36 00  
COUNTERTOPS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies casework countertops with integral accessories.
- B. Integral accessories include:
  - 1. Sinks with integral overflows.

**1.2 RELATED WORK**

- A. Color and Patterns of Plastic Laminate: SECTION 09 06 00, SCHEDULE FOR FINISHES.
- B. SECTION 12 32 00, MANUFACTURED WOOD CASEWORK
- C. DIVISION 22, PLUMBING.
- D. DIVISION 26, ELECTRICAL.
- E. Equipment Reference Manual for SECTION 12 36 00, COUNTERTOPS.

**1.3 SUBMITTALS**

- A. Submit in accordance with SECTION 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings:
  - 1. Show dimensions of section and method of assembly.
  - 2. Show details of construction at a scale of 1/2 inch to a foot.
- C. Samples:
  - 1. 150 mm (6 inch) square samples each top.
  - 2. Front edge, back splash, end splash and core with surface material and booking.

**1.4 APPLICABLE PUBLICATIONS**

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.
- B. American Hardboard Association (AHA):
  - A135.4-95.....Basic Hardboard
- C. Composite Panel Association (CPA):
  - A208.1-09.....Particleboard
- D. American Society of Mechanical Engineers (ASME):
  - A112.18.1-12.....Plumbing Supply Fittings
  - A112.1.2-12.....Air Gaps in Plumbing System
  - A112.19.3-08(R2004).....Stainless Steel Plumbing Fixtures (Designed for Residential Use)

## E. American Society for Testing and Materials (ASTM):

- A167-99 (R2009).....Stainless and Heat-Resisting Chromium-Nickel  
Steel Plate, Sheet and Strip
- A1008-10.....Steel, Sheet, Cold-Rolled, Carbon, Structural,  
High Strength, Low Alloy
- D256-10.....Pendulum Impact Resistance of Plastic
- D570-98(R2005).....Water Absorption of Plastics
- D638-10.....Tensile Properties of Plastics
- D785-08.....Rockwell Hardness of Plastics and Electrical  
Insulating Materials
- D790-10.....Flexural Properties of Unreinforced and  
Reinforced Plastics and Electrical Insulating  
Materials
- D4690-99(2005).....Urea-Formaldehyde Resin Adhesives

## F. Federal Specifications (FS):

- A-A-1936.....Adhesive, Contact, Neoprene Rubber

## G. U.S. Department of Commerce, Product Standards (PS):

- PS 1-95.....Construction and Industrial Plywood

## H. National Electrical Manufacturers Association (NEMA):

- LD 3-05.....High Pressure Decorative Laminates

**PART 2 - PRODUCTS****2.1 MATERIALS**

## A. Plastic Laminate: NEMA LD 3.

- 1. Concealed backing sheet Type BKL.
- 2. Decorative surfaces:
  - a. Flat components: Type GP-HGL.
  - b. Post forming: Type PF-HGP.

## B. Particleboard: CPA A208.1, Grade 2-M-2.

## C. Plywood: PS 1, Exterior type, veneer grade AC not less than five ply construction.

## D. Adhesive

- 1. For plastic laminate FS A-A-1936.
- 2. For wood products: ASTM D4690, unextended urea resin or unextended melamine resin, phenol resin, or resorcinol resin.

## 3. For Field Joints:

- a. Epoxy type, resistant to chemicals as specified for plastic laminate laboratory surfaces.
- b. Fungi resistant: ASTM G-21, rating of 0.

## E. Fasteners:

- 1. Metals used for welding same metal as materials joined.
- 2. Use studs, bolts, spaces, threaded rods with nuts or screws suitable for materials being joined with metal splice plates, channels or other supporting shape.

## F. Solid Polymer (Solid Surface) Material:

- 1. Filled Methyl Methacrylic Polymer.
- 2. Performance Properties Required:

Property	Result	Test
Elongation	0.3% min.	ASTM D638
Hardness	90 Rockwell M	ASTM D785
Gloss (60° Gordon)	5-20	NEMA LD3.1
Color stability	No change	NEMA LD3 except 200 hour
Abrasion resistance	No loss of pattern Max wear depth 0.0762 mm (0.003 in) - 10000 cycles	NEMA LD3
Water absorption weight (5 max)	24 hours 0.9	ASTM D-570
Izod impact	14 N·m/m (0.25 ft-lb/in)	ASTM D256 (Method A)
Impact resistance	No fracture	NEMA LD-3 900 mm (36") drop 1 kg (2 lb.) ball
Boiling water surface resistance	No visible change	NEMA LD3
High temperature resistance	Slight surface dulling	NEMA LD3

- 3. Cast into sheet form and bowl form.
- 4. Color throughout with subtle veining through thickness.
- 5. Joint adhesive and sealer: Manufacturers silicone adhesive and sealant for joining methyl methacrylic polymer sheet.
- 6. Bio-based products will be preferred.

**2.2 SINKS****A. Stainless Steel:**

1. Furnished and installed by Plumbing Trade.

**B. Sinks of Methyl Methacrylic Polymer:**

1. Minimum 19 mm (3/4 inch) thick, cast into bowl shape with overflow to drain.
2. Provide for underhung installation to countertop.
3. Provide openings for drain.

**2.3 COUNTERTOPS****A. Fabricate in largest sections practicable.****B. Fabricate with joints flush on top surface.****C. Fabricate countertops to overhang front of cabinets and end of assemblies 25 mm (one inch) except where against walls or cabinets.****D. Provide 1 mm (0.039 inch) thick metal plate connectors or fastening devices (except epoxy resin tops).****E. Join edges in a chemical resistant waterproof cement or epoxy cement, except weld metal tops.****F. Fabricate with end splashes where against walls or cabinets.****G. Splash Backs and End Splashes:**

1. Not less than 19 mm (3/4 inch) thick.
2. Height 100 mm (4 inches) unless noted otherwise.
3. Laboratories and pharmacy heights or where fixtures or outlets occur: Not less than 150 mm (6 inches) unless noted otherwise.
4. Fabricate epoxy splash back in maximum lengths practical of the same material.

**H. Drill or cutout for sinks, and penetrations.**

1. Accurately cut for size of penetration.

**I. Plastic Laminate Countertops:**

1. Fabricate plastic laminate on five-ply plywood or particleboard core 19 mm (3/4 inch) thick with plastic laminate backing sheet.
2. Front edge over cabinets not less than 38 mm (1-1/2 inches) thick except where plastic "T" insert is used, not less than 19 mm (3/4 inch) thick.
3. Exposed Surface and edges of decorative laminated plastic or laboratory chemical resistant surface.

J. Methyl Methacrylic Polymer Tops:

1. Fabricate countertop of methyl methacrylic polymer cast sheet, 19 mm (3/4 inch) thick.
2. Fabricate back splash and end splash to height shown.
3. Fabricate skirt to depth shown.
4. Fabricate with marine edge where sinks occur.
5. Fabricate in one piece for full length from corner to corner up to 3600 mm (12 feet).
6. Join pieces with adhesive sealant.
7. Cut out countertop for lavatories, plumbing trim.
8. Provide concealed fasteners and epoxy cement for anchorage of sinks to countertop.

**PART 3 - EXECUTION**

**3.1 INSTALLATION**

- A. Before installing countertops verify that wall surfaces have been finished as specified and that mechanical and electrical service locations are as required.
- B. Secure countertops to supporting rails of cabinets with metal fastening devices, or screws through pierced slots in rails.
  1. Where type, size or spacing of fastenings is not shown or specified, submit shop drawings showing proposed fastenings and method of installation.
  2. Use round head bolts or screws.
  3. Use wood or sheet metal screws for wood or plastic laminate tops; minimum penetration into top 16 mm (5/8 inch), screw size No. 8 or 10.
- C. Sinks
  1. Install methyl methacrylic polymer sinks in manufacturers recommended adhesive sealer or epoxy compound to underside of methyl methacrylic polymer countertop.
    - a. Bolt or screw to countertop to prevent separation of bowl and fracture of adhesive sealant joint.

**3.2 PROTECTION AND CLEANING**

- A. Tightly cover and protect against dirt, water, and chemical or mechanical injury.
- B. Clean at completion of work.

- - - E N D - - -





**SECTION 21 13 13**  
**WET-PIPE SPRINKLER SYSTEMS**

**\* SEE ALTERNATE BID NO. 8 FOR CLERESTORY DELETION.**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Design, installation, and testing shall be in accordance with NFPA 13.
- B. The design and installation of a hydraulically calculated automatic wet-pipe system complete and ready for operation, for all portions of work in Renovation Area and New Addition Area.
- C. Modification of the existing sprinkler system as indicated on the drawings and as further required by these specifications.

**1.2 RELATED WORK**

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Section 33 10 00, WATER UTILITIES.
- C. Section 07 84 00, FIRESTOPPING.
- D. Section 09 91 00, PAINTING.
- E. Section 22 05 23, GENERAL-DUTY VALVES FOR PLUMBING PIPING.
- F. Section 28 31 00, FIRE DETECTION AND ALARM.

**1.3 REFERENCE TO STANDARDS**

- A. All materials and equipment under this contract shall be in accordance with the following applicable Technical Society, Organization, or Body:

AIA	American Institute of Architects
AGA	American Gas Association
ANSI	American National Standards Institute
ASTM	American Society of Testing Materials
AWWA	American Water Works Association
AWS	American Welding Society
CGA	Compressed Gas Association
DHS	Department of Health Services
EPA	Environmental Protection Agency - United States
FM	Factory Mutual
ICC	International Code Council
MSS	Manufacturer's Standardization Society
NBS	National Bureau of Standards
NEC	National Electric Code

NEMA	National Electrical Manufacturers Association
NFPA	National Fire Protection Association
NICET	National Institute for Certification in Engineering Technologies
OSHA	Occupational Safety and Health Act
UL	Underwriters Laboratories Incorporated

#### 1.4 DESIGN CRITERIA

- A. This system shall include a complete wet pipe system, including mains, risers, valves, sprinklers and equipment as shown on the drawings, and installed in strict accordance with State and local requirements, as well as NFPA-13 and NFPA-14.
- B. The wet pipe sprinkler system, as indicated, shall be set up to be hydraulically designed system of mains, branch piping, sprinklers, and valves.
- C. Water supply shall be an extension from the existing 750 GPM/100 psig fire pump located in the present basement Fire Pump Room. **Verification of the water supply for final design purposes shall be responsibility of the Fire Protection Contractor.**
- D. Design Basis Information: Provide design, materials, equipment, installation, inspection, and testing of the automatic sprinkler system in accordance with the requirements of NFPA 13.
  1. Perform hydraulic calculations in accordance with NFPA 13 utilizing the Area/Density method. Do not restrict design area reductions permitted for using quick response sprinklers throughout by the required use of standard response sprinklers in the areas identified in this section.
  2. Sprinkler Protection: Sprinkler hazard classifications shall be in accordance with NFPA 13. The hazard classification examples of uses and conditions identified in the Annex of NFPA 13 shall be mandatory for areas not listed below. Request clarification from the Government for any hazard classification not identified. To determine spacing and sizing, apply the following coverage classifications:
    - a. Light Hazard Occupancies: Patient care, treatment, and customary access areas.
    - b. Ordinary Hazard Group 1 Occupancies: Mechanical Equipment Rooms, Transformer Rooms, Electrical Switchgear Rooms, Electric Closets.
    - c. Ordinary Hazard Group 2 Occupancies: Storage rooms, trash rooms, clean and soiled linen rooms, kitchens, storage areas, building management storage, and file storage areas for the entire area of the space up to 140 square meters (1500 square feet).

3. Hydraulic Calculations: Calculated demand including hose stream requirements shall fall no less than 10 percent below the available water supply curve. See Fire Pump Report at the end of this section.
4. Zoning:
  - a. For each sprinkler zone provide a control valve, flow switch, and a test and drain assembly with pressure gauge. For buildings greater than two stories, provide a check valve at each control valve.
  - b. Sprinkler zones shall conform to the smoke barrier zones shown on the drawings.
  - c. Zone Control Valve Assemblies:
    - 1) The valve assembly shall include, but not be limited to, an indicating control valve locked in correct position with supervisory switch, water flow switch, valved pressure gauge, and sectional drain valve.
    - 2) Install zone control valve assembly in an easily accessible location or where indicated on drawings and with all valve indicators/pressure gauges viewable from below.

#### **1.5 SUBMITTALS**

- A. Submit as one package in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Prepare detailed working drawings that are signed by a NICET Level III or Level IV Sprinkler Technician or stamped by a Registered Professional Engineer licensed in the field of Fire Protection Engineering. As the Government review is for technical adequacy only, the installer remains responsible for correcting any conflicts with other trades and building construction that arise during installation. Partial submittals will not be accepted. Material submittals shall be approved prior to the purchase or delivery to the job site. Suitably bind submittals in notebooks or binders and provide an index referencing the appropriate specification section. In addition to the hard copies, provide submittal items in Paragraphs 1.4(A)1 through 1.4(A)5 electronically in pdf format

on a compact disc or as directed by the COR. Submittals shall include, but not be limited to, the following:

1. Qualifications:

- a. Provide a copy of the installing contractor's fire sprinkler and state contractor's license.
- b. Provide a copy of the NICET certification for the NICET Level III or Level IV Sprinkler Technician who prepared and signed the detailed working drawings unless the drawings are stamped by a Registered Professional Engineer licensed in the field of Fire Protection Engineering.
- c. Provide documentation showing that the installer has been actively and successfully engaged in the installation of commercial automatic sprinkler systems for the past ten years.

2. Drawings: Submit detailed 1:100 (1/8 inch) scale (minimum) working drawings conforming to the Plans and Calculations chapter of NFPA

- 13. Drawings shall include graphical scales that allow the user to determine lengths when the drawings are reduced in size. Include a plan showing the piping to the water supply test location.

3. Manufacturer's Data Sheets: Provide data sheets for all materials and equipment proposed for use on the system. Include listing information and installation instructions in data sheets. Where data sheets describe items in addition to those proposed to be used for the system, clearly identify the proposed items on the sheet.

4. Calculation Sheets:

- a. Submit hydraulic calculation sheets in tabular form conforming to the requirements and recommendations of the Plans and Calculations chapter of NFPA 13.
- b. Submit calculations of loads for sizing of sway bracing in accordance with NFPA 13.

5. Valve Charts: Provide a valve chart that identifies the location of each control valve. Coordinate nomenclature and identification of control valves with COR. Where existing nomenclature does not exist, the chart shall include no less than the following: Tag ID No., Valve Size, Service (control valve, main drain, aux. drain, inspectors test valve, etc.), and Location.

6. Final Document Submittals: Provide as-built drawings, testing and maintenance instructions in accordance with the requirements in Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. In addition, submittals shall include, but not be limited to, the following:
- a. A complete set of as-built drawings showing the installed system with the specific interconnections between the system switches and the fire alarm equipment. Provide a complete set in the formats as follows. Submit items 2 and 3 below on a compact disc or as directed by the COR.
    - 1) One full size (or size as directed by the COR) printed copy.
    - 2) One complete set in electronic pdf format.
    - 3) One complete set in AutoCAD format or a format as directed by the COR.
  - b. Material and Testing Certificate: Upon completion of the sprinkler system installation or any partial section of the system, including testing and flushing, provide a copy of a completed Material and Testing Certificate as indicated in NFPA 13. Certificates shall be provided to document all parts of the installation.
  - c. Operations and Maintenance Manuals that include step-by-step procedures required for system startup, operation, shutdown, and routine maintenance and testing. The manuals shall include the manufacturer's name, model number, parts list, and tools that should be kept in stock by the owner for routine maintenance, including the name of a local supplier, simplified wiring and controls diagrams, troubleshooting guide, and recommended service organization, including address and telephone number, for each item of equipment.
  - d. One paper copy of the Material and Testing Certificates and the Operations and Maintenance Manuals above shall be provided in a binder. In addition, these materials shall be provided in pdf format on a compact disc or as directed by the COR.
  - e. Provide one additional copy of the Operations and Maintenance Manual covering the system in a flexible protective cover and mount in an accessible location adjacent to the riser or as directed by the COR.

**1.6 WELDER QUALIFICATIONS**

- A. Welding procedures, welders, and welding operators for all building service piping shall be in accordance with certified welding procedures of the National Certified Pipe Welding Bureau and Section 927.5 of ASME B31.9 Building Services Piping or AWS 10.9 Qualification of Welding Procedures and Welders for Piping and Tubing. Before any metallic welding is performed, Contractor shall submit his Standard Welding Procedure Specification together with the Procedure Qualification Record as required by Section 927.6 of ASME B31.9 Building Services Piping.
- B. The Architect or Engineer reserves the right to test the work of any welder employed on the project, at the Owner's expense. If the work of the welder is found to be unsatisfactory, the welder shall be prevented from doing further welding on the project and all defective welds replaced.
- C. Welding will not be permitted on this project. SHOP WELDING ONLY.

**1.7 QUALITY ASSURANCE**

- A. Installer Reliability: The installer shall possess a valid State of Michigan fire sprinkler contractor's license. The installer shall have been actively and successfully engaged in the installation of commercial automatic sprinkler systems for the past ten years.
- B. Materials and Equipment: All equipment and devices shall be of a make and type listed by UL or approved by FM, or other nationally recognized testing laboratory for the specific purpose for which it is used. All materials, devices, and equipment shall be approved by the VA. All materials and equipment shall be free from defect. All materials and equipment shall be new unless specifically indicated otherwise on the contract drawings.
- C. Only new materials and equipment, of first quality of manufacturers, shall be considered for use on this project. Materials shall be clearly marked or stamped with the manufacturer's name or stamp as well as conformance with the applicable ASTM Standard.
- D. All wet pipe sprinkler system piping, equipment, and fittings shall be UL listed and Factory Mutual approved.

## 1.8 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. National Fire Protection Association (NFPA):
  - 13-13.....Installation of Sprinkler Systems
  - 25-14.....Inspection, Testing, and Maintenance of  
Water-Based Fire Protection Systems
  - 101-15.....Life Safety Code
  - 170-15.....Fire Safety Symbols
- C. Underwriters Laboratories, Inc. (UL):
  - Fire Protection Equipment Directory (2011)
- D. Factory Mutual Engineering Corporation (FM):
  - Approval Guide

## 1.9 DATA AND DRAWINGS

- A. The information given herein and on the drawings is as exact as can be secured. Its accuracy is not guaranteed. Examination of site is required to verify all measurements, distances, levels, and elevations before starting the work.
- B. Existing and new sprinkler and piping locations and elevations are for reference. This Contractor is responsible for coordination with all trades and verifying existing conditions before installing the fire suppression systems.
- C. See Division 01 regarding examination of site and special provisions.
- D. In the event drawings and specifications are not in full accord and changes, alterations, additions, or deductions are necessary, or any exceptions in regard to size of equipment, pipe sizes, etc., or layout are taken by the Fire Suppression Contractor, notify the Architect immediately, in writing, and wait his decision. Such exceptions must be submitted 10 days prior to date set for receiving of proposal.

- E. The location of sprinklers, risers, main/branch piping, and equipment designate approximate locations. The Fire Suppression Contractor shall establish their final locations by reference to architectural, structural, mechanical, plumbing and electrical drawings, when available, and by field verification of conditions. THE DRAWING SHALL NOT BE SCALED FOR EXACT DIMENSIONS. Measurements and determination of routing must be completed prior to ordering any equipment or fabricating any materials. See Division 01 for availability of electronic files.
- F. The approximate locations of all equipment and piping are shown on the drawings. The Architect reserves the right to change the location of any equipment and sprinkler 5 feet and piping 10 feet in any direction without these changes being made subject of an extra charge, provided such changes are made before the rough-in, piping, or sleeves have been installed.
- G. Changes of the drawing necessary to make the fire suppression systems conform to the building as constructed and to fit the work of other trades shall be made without extra cost.
- H. Where demolition and remodeling work require removal and/or relocation of existing sprinklers, equipment, piping or trim, the Fire Suppression Contractor shall include same as part of his contract work.
- I. All sprinklers must be arranged symmetrically with walls, lights, ceiling grilles, etc., so as not to interfere with their placement, including related wiring or ductwork. Final location shall be verified with the final ceiling system layout and the Architect. Sprinklers shall be installed in the pendent, sidewall, or upright position as indicated on drawings or specified. All pendent style sprinklers shall be installed in center of ceiling tile and in symmetry with pattern layout and room dimensions. Final armovers and sprinkler drops shall be field cut and installed after ceiling pattern has been established.

## **PART 2 - PRODUCTS**

### **2.1 PIPING & FITTINGS**

- A. Piping and fittings for sprinkler systems shall be in accordance with NFPA 13.
  - 1. Acceptable Piping Manufacturers: Allied, Wheatland, Youngstown, Bull Moose Tube, or equal approved by Architect.
  - 2. Acceptable Fitting Manufacturers: Victaulic, Central, Star Pipe, Anvil, Tyco, or equal approved by Architect.



3. Plain-end pipe fittings with locking lugs or shear bolts are not permitted.
4. Piping sizes 50 mm (2 inches) and smaller shall be black steel Schedule 40 with threaded end connections.
5. Piping sizes 65 mm (2-1/2 inches) and larger shall be black steel Schedule 40 with grooved connections. Grooves in Schedule 40 piping shall be rolled grooved only.
6. Plastic piping shall not be permitted except for drain piping.
7. All piping shall be internally coated with a microbiologically influenced corrosion inhibitor.

## **2.2 VALVES**

### **A. General:**

1. Valves shall be in accordance with NFPA 13.
2. Do not use quarter turn ball valves for 50 mm (2 inch) or larger drain valves.
3. Valve model numbers have been selected from recent manufacturer's catalog of Nibco and are used to establish type and style of valves. Products of the following manufacturers determined to be equal by the Architect/Engineer will be acceptable: Kennedy, Victaulic, Star Pipe, Viking, Reliable, and Tyco.

### **B. Properly align piping before installation of valves**

### **C. Valves are to be installed in locations which allow access for operation, servicing, testing, and replacement.**

### **D. Install all valves with the operator in the upright or horizontal position. Valves installed with the stems down will not be acceptable.**

### **E. Control Valve: The control valves shall be a listed indicating type. Control valves shall be UL Listed or FM Approved for fire protection installations. System control valve shall be rated for normal system pressure but in no case less than 175 PSI.**

1. Install all control valves in easily accessible locations and with the valve position indicator viewable.
2. All system control valves shall be provided with a supervisory switch and shall be locked with chain and lock in the open position.
3. Provide valved pressure gauge in main fire protection riser/main.
4. Provide a riser shutoff valve and capped hose thread drain valve at bottom of each riser. Hard-pipe drain valve to floor drain in the Basement Mechanical Room.

## F. Check Valve:

1. Shall be of the swing type with a flanged cast iron body and flanged inspection plate.
2. 2-1/2" through 4": Cast or ductile iron body, grooved ends, wafer type, bronze seat, EPDM seal, stainless steel disc and spring, UL listed for 250 psi. Drilled and tapped for ball drip outlet.
  - a. Nibco Model Number: G-917-W (or equal)

## G. Ball Valve:

1. 2" and Smaller: Bronze ball valve, two-piece body, threaded ends, standard port, blowout proof stem, chrome plated ball, reinforced TFE seats, UL listed for 300 psi. Listed for trim and drain use.
  - a. Nibco Model Number: KT-580-70 UL (or equal)

## H. Angle Valve:

1. 1" through 2": Bronze angle valve, threaded ends, rubber disc-screw over bonnet, UL listed for 175 psi. Listed for trim and drain use.
  - a. Nibco Model Number: KT-67-UL (or equal)

## I. Butterfly Valve:

1. 2-1/2" through 4": Nylon coated ductile iron, grooved ends, geared operator, visible position indicator, elastomer encapsulated disc, internal supervisory switch, UL listed for 300 psi.
  - a. Nibco Model Number: GD-4765-8N (or equal)

## J. Drain Valves:

1. Provide inspector test valves for each individual zone/floor/system control valve.
  - a. Inspector's test drain shall include valve, 1" sight glass, and union sized identical to smallest sprinkler discharge orifice.
  - b. Provide AGF Model #1011 test and drain or equal approved by Architect.
  - b. Inspector's test drain piping shall discharge to the location indicated on the drawings.
2. Provide main drains for each individual zone/floor/system control valve.
  - a. Main drain shall be sized in accordance with NFPA-13, Standard for the Installation of Sprinkler Systems, and discharge to the location indicated on the drawings.
  - b. Main drains shall be sized to allow full flow testing in compliance with NFPA 25.

3. Provide auxiliary drains at all low points of the fire suppression piping, where the trapped section of pipe exceeds five gallons.
  - a. Auxiliary drains shall be sized in accordance with NFPA-13, Standard for the Installation of Sprinkler Systems, and discharge to the location indicated on the drawings.
- K. Automatic Ball Drips: Cast brass 20 mm (3/4 inch) in-line automatic ball drip with both ends threaded with iron pipe threads.
- L. Alarm Check Valve: Alarm check valve shall be UL Listed and Factory Mutual Approved. The alarm check valve shall be listed for installation in the vertical or horizontal position. The alarm check valve shall be equipped with a removable cover assembly, gauge connections on the system side and supply side of the valve clapper, variable pressure trim, and an external bypass to eliminate false water flow alarms. The alarm check valve trim piping shall be galvanized.

### **2.3 SPRINKLERS**

- A. All sprinklers shall be FM approved quick response.
- B. Temperature Ratings: In accordance with NFPA 13.
- C. Provide sprinkler guards in accordance with NFPA 13 and when the elevation of the sprinkler head is less than 7 feet 6 inches above finished floor. The sprinkler guard shall be UL listed or FM approved for use with the corresponding sprinkler.
- D. Sprinklers are to be located as indicated on the fire suppression plans and reflected ceiling plans maintaining minimum clearances from obstructions, ceilings and walls. Install sprinklers level in locations not subject to spray pattern interference. Provide fire sprinkler installations below ductwork, soffits, etc.
- E. All sprinklers to be installed in the pendent position in a ceiling tile system shall be installed in center of tile.
- F. Sprinkler Schedule:
  1. Standard Spray Upright - (Quick Response) Viking Model VK302 (or equal), 1/2" orifice, 155°F, K-factor 5.6, chrome finish. Escutcheons to be adjustable with chrome plated finish.
  2. Concealed Pendent - (Quick Response) Viking Model VK462 (or equal), 1/2" orifice, 155°F, K-factor 5.6, 135°F cover plate with factory white paint finish, #13504 (2-3/4" diameter).
  3. Standard Spray Horizontal Sidewall - (Quick Response) Viking Model VK305 (or equal), 1/2" orifice, 155°F, K-factor 5.6, white finish. Escutcheons to be adjustable with white finish.

4. Standard Spray Upright - (Quick Response) Viking Model VK350  
(or equal), 17/32" nominal orifice size, 3/4" nominal thread size,  
K-factor 8.0, 155°F, chrome finish. Escutcheons to be adjustable  
with chrome plated finish. For use in mechanical equipment rooms.
5. Standard Spray Pendent - (Quick Response) Viking Model VK464  
(or equal), 17/32" nominal orifice size, 3/4" nominal thread size,  
K-factor 8.0, 155°F, white finish. Escutcheons to be adjustable with  
white plated finish. For use in storage rooms.

#### **2.4 SPRINKLER CABINET**

- A. Provide sprinkler cabinet with the required number of sprinkler heads  
of all ratings and types installed, and a sprinkler wrench for each  
type of sprinkler in accordance with NFPA 13. Locate adjacent to the  
riser.
- B. Provide a list of sprinklers installed in the property in the cabinet.  
The list shall include the following:
  1. Manufacturer, model, orifice, deflector type, thermal sensitivity,  
and pressure for each type of sprinkler in the cabinet.
  2. General description of where each sprinkler is used.
  3. Quantity of each type present in the cabinet.
  4. Issue or revision date of list.

#### **2.5 SPRINKLER SYSTEM SIGNAGE**

Rigid plastic, steel or aluminum signs with white lettering on a red  
background with holes for easy attachment. Sprinkler system signage  
shall be attached to the valve or piping with chain.

#### **2.6 SWITCHES**

- A. OS&Y Valve Supervisory Switches shall be in a weatherproof die cast/red  
baked enamel, oil resistant, aluminum housing with tamper resistant  
screws, 13 mm (1/2 inch) conduit entrance and necessary facilities for  
attachment to the valves. Provide two SPDT switches rated at 2.5 amps  
at 24 VDC.
- B. Water Flow Alarm Switches: Mechanical, non-coded, non-accumulative  
retard and adjustable from 0 to 60 seconds minimum. Set flow switches  
at an initial setting between 20 and 30 seconds.
- C. Flow and Supervisory Switch:
  1. Acceptable Manufacturers: Potter Electric Signal Model "VSR-F" vane  
type flow detector.
- D. Zonecheck Flow Switch Tester: Supply and install one (1) Tyco Model  
#4340 (or equal) Zonecheck flow switch tester(s) where indicated on the  
drawings.

- E. Alarm Pressure Switches: Activation by any flow of water equal to or in excess of the discharge from one sprinkler. The alarm pressure switch shall be UL Listed or Factory Mutual Approved for the application in which it is used. Activation of the alarm pressure switch shall cause an alarm on the fire alarm system control unit.
- F. Valve Supervisory Switches for Ball and Butterfly Valves: May be integral with the valve.

## **2.7 GAUGES**

- A. Provide gauges as required by NFPA 13. Provide gauges where the normal pressure of the system is at the midrange of the gauge.

## **2.8 PIPE HANGERS, SUPPORTS AND RESTRAINT OF SYSTEM PIPING**

- A. Pipe hangers, supports, and restraint of system piping shall be in accordance with NFPA 13.
- B. Corrosive Atmosphere Coatings: Factory coat supports, hangers, hanger rods, and anchors used in basement mechanical room(s) with hot-dip galvanizing after fabrication. Field cuts and damaged finishes shall be field covered with zinc-enriched paint of comparable thickness to factory coating.
- C. Pipe Hangers and Supports:
  - 1. Hangers for pipe sizes 1/2" through 2" shall be carbon steel, adjustable swivel ring hangers with minimum 3/8" hanger rods.
    - a. Erico Model Number: 100 Series (or equal)
  - 2. Hangers for pipe sizes 2-1/2" and larger shall be carbon steel, adjustable swivel ring hangers with minimum 1/2" hanger rods.
    - a. Erico Model Number: 115 Series (or equal)
  - 3. Multiple or trapeze hangers shall be manufactured steel system with manufacturer's slotted interlocking pipe clamps with screw/nut securing and threaded hanger rods or steel channels with welded spacers and threaded hanger rods.
  - 4. Wall supports shall be carbon steel welded bracket with hanger.
    - a. B-Line Model Number: 060 Series
  - 5. Vertical supports shall be a carbon steel riser clamp for above floor use.
    - a. B-Line Model Number: B3373
  - 6. Floor supports shall be a carbon steel pipe saddle stand and bolted floor flange.
    - a. B-Line Model Number: B3088T or B3093 (or equal)

**D. Pipe Hanger Rods:**

1. Pipe hanger rods shall be carbon steel threaded on both ends or continuous threaded and be complete with adjusting and lock nuts.
2. Hanger rods for individual hangers and trapeze supports shall be sized as follows:

<u>Pipe Size</u>	<u>Rod Diameter</u>
1" to 4"	3/8" minimum

**E. Beam Clamps:**

1. Beam clamps shall be MSS SP-69 Types 19 and 23 malleable black iron clamp for attachment to beam flange to 0.62" thick with a retaining ring and threaded rod. Furnish with a hardened steel cup point set screw.
  - a. B-Line Model Number: B3036 or B3034
2. Beam clamps shall be MSS SP-69 Types 28 or 29 forged steel jaw type clamp with a tie rod to lock clamp in place, suitable for rod sizes to 1-1/2" diameter.
  - a. B-Line Model Number: B3054 (or equal)

**F. Concrete Inserts:**

1. Refer to Section 05 05 20 - Fasteners and Metal Fastenings.
2. Drop-in anchors are not approved and shall not be used.

G. Anchors: Welding steel shapes, plates and bars shall be used to secure the piping to the structure.

**2.09 WALL, FLOOR AND CEILING PLATES**

A. Provide chrome plated steel escutcheon plates.

**2.10 VALVE TAGS**

A. Engraved black filled numbers and letters not less than 15 mm (1/2 inch) high for number designation, and not less than 8 mm (1/4 inch) for service designation on 19 gage, 40 mm (1-1/2 inches) round brass disc, attached with brass "S" hook, brass chain, or nylon twist tie.

**PART 3 - EXECUTION****3.1 INSTALLATION**

A. Installation shall be accomplished by the licensed contractor. Provide a qualified technician, experienced in the installation and operation of the type of system being installed, to supervise the installation and testing of the system.

- B. This Contractor shall furnish all labor, materials, tools, equipment, and services required to execute and install a complete and fully supervised system of fire suppression including all test certificates, parts lists, operating instructions, electrical wiring diagrams, approved drawings, and approved calculations for each individual system.
- C. The above fire suppression systems shall be complete in every respect to the meaning and intent of the drawings, specifications, and referenced standards. Systems shall be fully functional and ready for satisfactory use.
- D. Installation of Piping:
1. Accurately cut pipe to measurements established by the installer and work into place without springing or forcing. In any situation where bending of the pipe is required, use a standard pipe-bending template. Concealed piping in spaces that have finished ceilings. Where ceiling mounted equipment exists, such as in operating and radiology rooms, install sprinklers so as not to obstruct the movement or operation of the equipment. Sidewall heads may need to be utilized. In stairways, locate piping as near to the ceiling as possible to prevent tampering by unauthorized personnel and to provide a minimum headroom clearance of 2250 mm (seven feet, six inches). Piping shall not obstruct the minimum means of egress clearances required by NFPA 101. Pipe hangers, supports, and restraint of system piping, and seismic bracing shall be installed accordance with NFPA 13.
  2. It is the intent of the sprinkler layout that the system be completely drainable with a minimum number of drains and valves. Drain valves shall have hose connections. Where building construction or other interferences require additional drops or risers, all auxiliary drains, valves, etc. required shall be provided by the Fire Protection Contractor under this contract.
  3. In installing piping, if additional offsets horizontal or vertical are required by job conditions, such offsets are part of this contract. If drains are required, they shall be installed also. **ALL** offsets shall be cleared with Architect's representative.

4. Install all piping parallel to building, walls and ceilings and at heights which do not obstruct any portion of a window, doorway, stairway or passageway. Where interferences develop in the field, offset or reroute piping as required to clear such interferences. Coordinate locations of fire protection piping with all piping, structural members, ductwork, conduit, and equipment of other trades to allow sufficient clearances. In all cases, consult drawings for exact location of pipe spaces, ceiling heights, ceiling grid layout, light fixtures, and grilles before installing piping.
5. Under no circumstances will a connection from the bottom of a main or branch line be allowed. All connections must be made from the top or side of the main or branch line (for example, the allowed connection positions are twelve, three and nine o'clock).  
**ANY** conflict with installing a connection to meet this requirement shall be rectified and approved by the Architect **BEFORE** installing the connection.
6. Under no circumstances will a direct connection between the sprinkler system and sewer or waste systems be permitted without vacuum breaker or other positive protection against contamination of the water supply by back syphonage or stoppage of the drainage lines. All such work shall be as approved by the Architect.
7. Prepare and install pipe and fittings with reference standards, manufacturer's recommendations, and recognized industry practices. At pipe ends, square and ream ends to remove burrs. Clean scale and dirt from interior and exterior of each section of pipe and fitting prior to assembly. Maintain piping in clean condition internally during construction. Remove all excess grease/lubrication from piping, couplings, and fittings.
  - a. Install all valves and piping specialties, including items furnished by others, as specified and/or detailed. Provide access to valves and specialties for maintenance. Make connections to all equipment, fixtures, and systems installed by others where same requires the piping services indicated in this section.
  - b. Make all welded joints by fusion welding in accordance with ASTM Codes, ANSI B31, and State Codes where applicable. Electrodes shall be Lincoln or approved equal, with coating and diameter as recommended by the manufacturer for the type and thickness of work being done.



- c. Use a thread lubricant or teflon tape when making joints; no hard setting pipe thread cement or caulking will be allowed.
  - d. Use pipe factory grooved in accordance with the coupling manufacturer's specifications or field grooved pipe in accordance with the same specifications using specially designed tools available for the application. Lubricate pipe and coupling gasket, align pipe, and secure joint in accordance with the coupling manufacturer's specifications.
  - e. Install a union or flange at each connection to each piece of equipment and at other items which may require removal for maintenance, repair, or replacement. Where a valve is located at a piece of equipment, locate the flange or union connection on the equipment side of the valve. Concealed unions or flanges are not acceptable.
- E. Welding: Conform to the requirements and recommendations of NFPA 13. See Article 1.6 - Welder Qualifications.
- F. Drains: Provide drips and drains, including low point drains, in accordance with NFPA 13. Pipe drains to discharge at safe points outside of the building or to sight cones attached to drains of adequate size to readily carry the full flow from each drain under maximum pressure. Do not provide a direct drain connection to sewer system or discharge into sinks. Install drips and drains where necessary and required by NFPA 13. The drain piping shall not be restricted or reduced and shall be of the same diameter as the drain collector.
- G. Supervisory Switches: Provide supervisory switches for sprinkler control valves.
- H. Waterflow Alarm Switches: Install waterflow alarm switches and valves in stairwells or other easily accessible locations.

I. Inspector's Test Connection:

1. Install and supply in accordance with NFPA 13, locate in a secured area, and discharge to the exterior of the building.

2. Test and Drain Valve:

a. The combination test and drain valve shall be UL listed for fire suppression use and rated for 300 psi and be of angled design to facilitate the rest of test water to the main drain. The unit shall have tamper resistant sight glass and test orifice, steel identification plate indicating the model number, orifice size, and current position in a three-position operating sequence of "Off-Test-Drain".

b. The unit shall perform the sprinkler flow test, act as the system main drain, and operate as the pressure relief in accordance with NFPA-13. The unit shall have a bronze body and stem, Teflon seat, F.I.P.T., and steel handle allowing for positive stops at "Test" and "Drain" positions.

1) AGF Model Number: 1011 TESTanDRAIN (or equal)

J. Affix cutout disks, which are created by cutting holes in the walls of pipe for flow switches and non-threaded pipe connections to the respective waterflow switch or pipe connection near to the pipe from where they were cut.

K. Provide escutcheon plates for exposed piping passing through walls, floors or ceilings.

L. Clearances: For systems requiring seismic protection, piping that passes through floors or walls shall have penetrations sized 50 mm (2 inches) nominally larger than the penetrating pipe for pipe sizes 25 mm (1 inch) to 90 mm (3-1/2 inches) and 100 mm (4 inches) nominally larger for penetrating pipe sizes 100 mm (4 inches) and larger.

M. Pipe Sleeves:

1. Provide for pipes passing through masonry or concrete.

Provide space between the pipe and the sleeve in accordance with NFPA 13. Seal this space with a UL Listed through penetration fire stop material in accordance with Section 07 84 00, FIRESTOPPING. Where core drilling is used in lieu of sleeves, also seal space. Seal penetrations of walls, floors and ceilings of other types of construction, in accordance with Section 07 84 00, FIRESTOPPING.

2. Provide galvanized sheet metal sleeves for all pipe penetrations through interior and exterior walls to provide a backing for sealant or firestopping. Patch wall around sleeve to match adjacent wall construction and finish. Grout area around sleeve in masonry construction. In finished spaces where pipe penetration through wall is exposed to view, sheet metal sleeve shall be installed flush with face of wall.
  3. Pipe sleeves are not required in interior non-rated drywall or wood partitions. Sleeves are not required in existing poured concrete walls or masonry walls where penetrations are core drilled.
  4. Pipe sleeves in new poured concrete construction shall be Schedule 40 steel pipe (sized to allow insulated pipe to run through sleeve), cast in place.
  5. Extend the top of sleeve 1" above the adjacent floor in piping floor penetrations located in the mechanical rooms and wet locations listed below. In finished areas, sleeves shall be flush with rough floor.
  6. For floor pipe penetrations through existing floors in mechanical rooms and wet locations listed below, core drill opening and provide 1-1/2" x 1-1/2" x 1/8" galvanized steel angles fastened to floor surrounding the penetration or group of penetrations to prevent water from getting to penetration. Provide urethane caulk between angles and floor and fasten angles to floor minimum 8" on center. Seal corners water tight with urethane caulk; or core drill sleeve opening large enough to insert Schedule 40 sleeve and grout area around sleeve with hydraulic setting, non-shrink grout. If the pipe penetrating the sleeve is supported by a pipe clamp resting on the sleeve, weld a collar or struts to the sleeve that will transfer weight to existing floor structure.
  7. Wet locations include:
    - Mechanical equipment rooms
  8. Sleeves for existing piping where new wall or slab construction creates a penetration shall include splitting a standard wall sleeve and installing same as specified above.
- N. Provide pressure gauges at each water flow alarm switch location and at each main drain connection.

- O. Firestopping shall be provided for all penetrations of fire resistance rated construction. Firestopping shall comply with Section 07 84 00, FIRESTOPPING.
- P. Painting of Pipe: In finished areas where walls and ceilings have been painted, paint primed surfaces with two coats of paint to match adjacent surfaces, except paint valves and operating accessories with two coats of gloss red enamel. Exercise care to avoid painting sprinklers. Painting of sprinkler systems above suspended ceilings and in crawl spaces is not required. Painting shall comply with Section 09 91 00, PAINTING. Any painted sprinkler shall be replaced with a new sprinkler.
- Q. Sprinkler System Signage: Provide rigid sprinkler system signage in accordance with NFPA 13 and NFPA 25. Sprinkler system signage shall include, but not limited to, the following:
  - 1. Identification Signs:
    - a. Provide signage for each control valve, drain valve, sprinkler cabinet, and inspector's test.
    - b. Provide valve tags for each operable valve. Coordinate nomenclature and identification of operable valves with COR. Where existing nomenclature does not exist, the Tag Identification shall include no less than the following:  
(FP-B-F/SZ-#) Fire Protection, Building Number, Floor Number/Smoke Zone (if applicable), and Valve Number.  
(E.g., FP-500-1E-001) Fire Protection, Building 500, First Floor East, Number 001.)
    - c. Valve tags shall be a minimum of 1-1/2" diameter with 1/4" high letters and 1/2" high numbers fastened to valves with brass "S" hook, jack chain, or one-piece nylon ties around valve stem.
    - d. All new piping in this section of the work exposed or in accessible spaces shall be identified with labeling systems as manufactured by Seton Name Plate Corporation, W.H. Brady Company, or approved equal.
      - 1) Identification shall occur at minimum intervals of 25 feet or less, at wall or floor penetrations, or as directed.
      - 2) Lettering shall be 3/4" high (minimum) and shall state pipe contents and size (2" SPRINKLER) with directional arrows indicating flow. All labels shall be snap-on or mechanically affixed to piping after pipe coverings have been painted.

2. Instruction/Information Signs:

- a. Provide signage for each control valve to indicate valve function and to indicate what system is being controlled.
- b. Provide signage indicating the number and location of low point drains.

3. Hydraulic Placards:

- a. Provide signage indicating hydraulic design information.  
The placard shall include location of the design area, discharge densities, required flow and residual pressure at the base of riser, occupancy classification, hose stream allowance, flow test information, and installing contractor. Locate hydraulic placard information signs at each alarm check valve.

R. Repairs:

- 1. Repair damage to the building or equipment resulting from the installation of the sprinkler system by the installer at no additional expense to the Government.
- 2. The Fire Protection Contractor shall protect his work from injury by keeping all piping, conduit, etc., capped, plugged, drained or otherwise protected, which includes damage done by freezing and/or stopping from building materials, sand, dirt, or concrete.
- 3. Upon substantial completion, the Fire Suppression Contractor shall verify that all piping, fittings, equipment, and sprinklers are free from defect, mechanical damage, paint, obstructions, debris, and overspray before charging or activation of any fire suppression system.

S. Interruption of Service:

- 1. There shall be no interruption of the existing sprinkler protection, water, electric, or fire alarm services without prior permission of the Contracting Officer. Contractor shall develop an interim fire protection program where interruptions involve occupied spaces. Request in writing at least one week prior to the planned interruption.
- 2. The existing buildings will be occupied and maintained in normal use by the Owner during the progress of these contracts.
- 3. Schedule work to reduce, to the minimum, the period of interruption or outages to the various services.

4. Temporarily turn up sprinkler heads during construction to keep area protected and minimize shutdown time if required.
5. Fire protection system to be operational at the end of each day.

Provide temporary piping and/or measures to keep system operational.

### 3.2 HANGER AND SUPPORT SPACING

- A. Hanger and supports are to be installed for Fire Protection only.  
No other Trade's equipment shall utilize Fire Protection hanger, supports, and/or piping for support, and/or bracing. Hangers and supports are to be stainless and/or Aluminum inside the tunnel areas.
- B. Where several pipes can be installed in parallel and at the same elevation, provide multiple or trapeze hangers.

- C. Vertical piping shall be supported independently of the horizontal piping.

- D. Supports shall be placed at each offset or change in direction and along straight runs of piping as outlined below:

<u>Pipe Material</u>	<u>Pipe Size</u>	<u>Max. Horizontal Spacing</u>	<u>Max. Vertical Spacing</u>
Steel	1" - 1-1/4"	12'-0"	15'-0"
Steel	1-1/2" - 4"	15'-0"	15'-0"

- E. The unsupported length from the last hanger and an end sprinkler shall be as follows:

1" piping	Not greater than 36"
1-1/4" piping	Not greater than 48"
1-1/2" or larger	Not greater than 60"

- F. The cumulative unsupported horizontal length of an armover to a sprinkler, sprinkler drop, or sprig-up shall not exceed 24" for steel pipe or 12" for copper tubing.
- G. Where system working pressures exceed 100 psi, the cumulative unsupported horizontal length of an armover to a sprinkler, sprig-up, or sprinkler drop shall not exceed 12" for steel pipe. The hanger closest to the sprinkler or sprinkler drop shall prevent upward movement of the piping.
- H. Support piping from concrete structure using inserts of malleable iron as scheduled under Part 2 Products. Where inserts are omitted, use two expansion shields per hanger of size and type for load approved to fasten angle supports for handling piping as noted under Part 2 Products. Ram set support may be used for light loads, 2" and smaller pipe, with written approval by Architect.

- I. Support piping from steel joist structure using the following methods:
  1. Piping 1-1/2" and smaller may be hung from the bottom chord of bar joists with C-clamps.
  2. All piping 1-1/2" to 4" hung from bar joists shall be hung from the top chord of joists as follows:
    - a. Piping 1-1/2" through 4" may be hung individually from the top chord of joists with top beam clamps.
    - b. Piping 1-1/2" through 4" may also be hung from 2" x 2" x 3/16" angles for joist spacing up through 2'-0" o.c., or 3" x 3" x 1/4" angles for joist spacing 2'-1" through 4'-6" o.c. Cope angles so angle rests on top of joist with leg down or in the case of composite, joist angle shall be welded to bottom of top angles. Length of angles shall be joist spacing plus 3".
  3. Where several pipes occur adjacent to one another, pipes may be racked on a trapeze, providing none of the pipes is larger than 5". Construct trapeze of 2" x 2" x 3/16" angles for spans of 2'-0" or less, and 3" x 3" x 1/4" angles for spans of 2'-1" through 4'-6". Suspend angle from 3/4" diameter rods. Support rods off top chords of joists with angles as specified above.
- J. Piping support for precast concrete plank/flat slab structures shall be as follows:
  1. Single pipes up to 1-1/2" may be supported with toggle bolt hangers installed into void of planks.
  2. Where piping runs are parallel with plank system, furnish steel support angles between a minimum of two (2) tee-bar hangers.
  3. Support angles shall be similar of sizes and lengths specified for steel joist construction.
  4. Where new precast concrete slab is used, this Contractor shall coordinate location of T-bar hangers with Concrete Trade for pipe 2" and larger.
  5. Where post-installed concrete anchors are required, the anchor shall not extend into the voids of the plank or the pre-stressed strands. The anchors shall be approved for use in cracked concrete.

**3.3 RISER CLAMPS**

- A. Vertical risers passing through one or more floors shall be anchored and clamped at each floor level. Where vertical thermal movement is expected, provide spring hangers at top and bottom of risers.
- B. Use method of securing the vertical risers to the building structure below in stairwell locations.

**3.4 WALL BRACKETS**

- A. Wall support brackets shall be a minimum of two (2) bolted with expansion anchors. Bolt and anchor sizes shall comply with manufacturer's recommendations.

**3.5 ANCHORS**

- A. Install where indicated on the drawings and details. Where not specifically indicated, install anchors at ends of principal pipe runs and at intermediate points of pipe runs. Make provisions for preset of anchors as required accommodating both expansion and contraction of piping.

**3.6 EQUIPMENT ACCESS**

- A. Install all piping and accessories to permit access to equipment and maintenance. Coordinate the exact location of wall and ceiling access panels and doors with the General Contractor, making sure that access is available for all equipment, valves, and specialties. Where access is required in plaster walls or ceilings, furnish the access doors to the General Contractor.

**3.7 PROTECTION OF EXISTING EQUIPMENT**

- A. Contractor shall not perform any pipe cutting, grinding, assembly, etc., without proper protection of the Owner's equipment.
- B. Protection to consist of poly visqueen film, minimum thickness 4 mil. Secure from bottom of structure to floor.
- C. Coordinate set-up staging area with the Owner.
- D. Owner's equipment to be cleaned or replaced by contractor at fault.

**3.8 INSPECTION AND TEST**

- A. Preliminary Testing: Flush newly installed systems prior to performing hydrostatic tests in order to remove any debris which may have been left as well as ensuring piping is unobstructed. Hydrostatically test system, including the fire department connections, as specified in NFPA 13, in the presence of the Contracting Officers Representative (COR) or his designated representative. Test and flush underground water line prior to performing these hydrostatic tests.



- B. Final Inspection and Testing: Subject system to tests in accordance with NFPA 13, and when all necessary corrections have been accomplished, advise COR to schedule a final inspection and test. Connection to the fire alarm system shall have been in service for at least ten days prior to the final inspection, with adjustments made to prevent false alarms. Furnish all instruments, labor and materials required for the tests and provide the services of the installation foreman or other competent representative of the installer to perform the tests. Correct deficiencies and retest system as necessary, prior to the final acceptance. Include the operation of all features of the systems under normal operations in test.

### **3.9 INSTRUCTIONS**

- A. Furnish the services of a competent instructor for not less than two hours for instructing personnel in the operation and maintenance of the system, on the dates requested by the COR.

### **3.10 ELECTRICAL COORDINATION**

- A. All relays, wire, conduit, pushbuttons, pilot lights, and other devices required for the control of motors or electrical equipment are furnished by the Electrical Contractor, except as specifically noted elsewhere in this division of specifications.
- B. Electrical drawings and/or specifications show number and horsepower rating of all motors furnished by This Contractor. Should any change in size, horsepower rating, or means of control be made to any motor or other electrical equipment after contracts are awarded, Contractor is to immediately notify the Electrical Contractor of this change and pay any costs due to this change.
- C. Electrical Contractor will provide all power wiring.
- D. Furnish wiring diagrams to Electrical Contractor for all equipment and devices furnished by This Contractor and indicated to be wired by the Electrical Contractor.

### **3.11 INSTALLATION**

- A. Fire protection piping to be installed clear of other trades' piping/ductwork, etc. Fire protection piping shall not be in contact with other trades' piping/ductwork/conduit, etc.
- B. Fire Protection Trade to provide their own hanger rods from structure. Fire protection piping shall not be supported from other trades' hangers/ductwork and/or Unistrut supports.
- C. Coordinate all installation with other trades. All work installed without coordination, in conflict, shall be replaced at no cost to the Owner.



**tyco****Fire &  
Security****SimplexGrinnell****FIRE PUMP REPORT OF INSPECTION**

Inspection Report No.

Inspection Contract No.

☐ BY OWNER☐ BY SIMPLEXGRINNELLCompany Name Iron Mountain V.ASimplexGrinnell Office Green Bay, WI 54304Address 325 H StreetAddress 1941 Holmgren WayCity, State, & Zip Iron Mountain, MI 49801Office Phone 800-451-5880

Attention \_\_\_\_\_

Date 6.27.2016

License # \_\_\_\_\_

**This Report is for an Annual Electric Fire Pump Inspection****SYSTEM LOCATION** BASEMENT**Equipment****Description**

Pump Manufacturer	Shaft Type	Model Number	Shop or Serial #	Rated GPM	Rated Head/Ft	NET PSI Gain	Rated RPM	
AC Pump ITT Industries	Centrifugal	8100	09-055924-01-01QKJ656	750	200	68	3550	
Driver Manufacturer	Type	Model Number	Shop or Serial #	Rated Volts	Oper. Volts	Horse Power	Rated RPM	
Weg		040360P3E286TS		480	480		3550	
Driver Rated Amps	Phase	Amps at 150%	Cycles	Service Factor	Rated PSI	Jockey Pump Start	J/P Stop	
	3 Phase		60 HZ			135	155	
Controller MFG.	Model Number	Shop or Serial #	Controller Auto Start PSI	Controller Stop PSI				
Metron	MP300-40-480C	PA-09N42539-11	120		Manual Off			
Supply	Connection Size	Tank Supply	Tank Height	Tank Capacity	QUARTER 1	QUARTER 2	QUARTER 3	QUARTER 4
Supply	8"	NA	NA	NA				

**QUARTERLY**

ELECTRICAL SYSTEM FREE OF WIRE CHAFING

**SEMI-ANNUAL**

MANUAL STARTING MEANS ON ELECTRICAL SYSTEM OPERATED

BOXES, PANELS &amp; CABINETS ON ELECT SYSTEMS INSPECTED

**ANNUAL**

INSPECT PUMP BEARING LUBRICATION

SHAFT END PLAY ACCEPTABLE

PUMP COUPLING ALIGNMENT ACCEPTABLE

INSPECT TRANSMISSION COUPLING, GEAR DRIVE, &amp; MECH PARTS

CIRCUIT BREAKERS PASSED TRIP TEST

EMERGENCY MANUAL STARTING OPERATED WITHOUT POWER

PRESSURE SWITCH SETTINGS INSPECTED

MOTOR BEARINGS INSPECTED

CONTROL &amp; POWER WIRING INSPECTED

Result Result Result Result

DATE LAST ANNUAL INSP. PERFORMED;

May-11

Pump Identifier

1. SimplexGrinnell bases this inspection on the fact that said systems were approved by the AHJ for the occupancy required for which it was designed and the Owner has not changed that occupancy classification.

2. SimplexGrinnell bases this fire protection systems inspection on the fact that the owner is performing any requirements of this applicable NFPA code for which the Owner has not contracted SimplexGrinnell to perform.

3. SimplexGrinnell bases this fire protection systems inspection on the fact that the Owner prior to the freezing season has secured and properly heated the building.

Additional Comments: Fire Pump is GREEN TAGGED.

ctor

Daryl KeimDate 6.27.2016

License # \_\_\_\_\_

Page Intentionally Left Blank

## FIRE PUMP TEST and GRAPHS

Inspection Report No.

Inspection Contract No.

☒ BY OWNER


☐ BY SIMPLEXGRINNELL

Company Name Iron Mountain VA


SimplexGrinnell Office Green Bay, WI

Pump Equipment ID												Pump Location							
Revolutions Per/minute		Discharge Pressure		Suction Pressure		Boost Pressure		Streams			Actual Flow	%	Orifice Coefficient	Voltage		Amp. Reading			
								No.	Size	Pilot Pressure									
3570	RPM	170	Psi	80	Psi	96	Psi												
3685	RPM	160	Psi	72	Psi	86	Psi	1	1.75	0	0	0%		473	Vac.	38	Amp.		
3544	RPM	140	Psi	67	Psi	66	Psi	2	1.75	1 @ 18	378	50%	0.97	473	Vac.	47	Amp.		
3543	RPM	115	Psi	58	Psi	41	Psi	3	1.75	2 @ 18	756	100%	0.97	471	Vac.	57	Amp.		
	RPM		Psi		Psi		Psi	3		3 @ 18	1134	151%	0.97	471	Vac.	58	Amp.		
	RPM		Psi		Psi		Psi	4				#REF!			Vac.		Amp.		
	RPM		Psi		Psi		Psi	5				#REF!			Vac.		Amp.		
	RPM		Psi		Psi		Psi	6				#REF!			Vac.		Amp.		

220

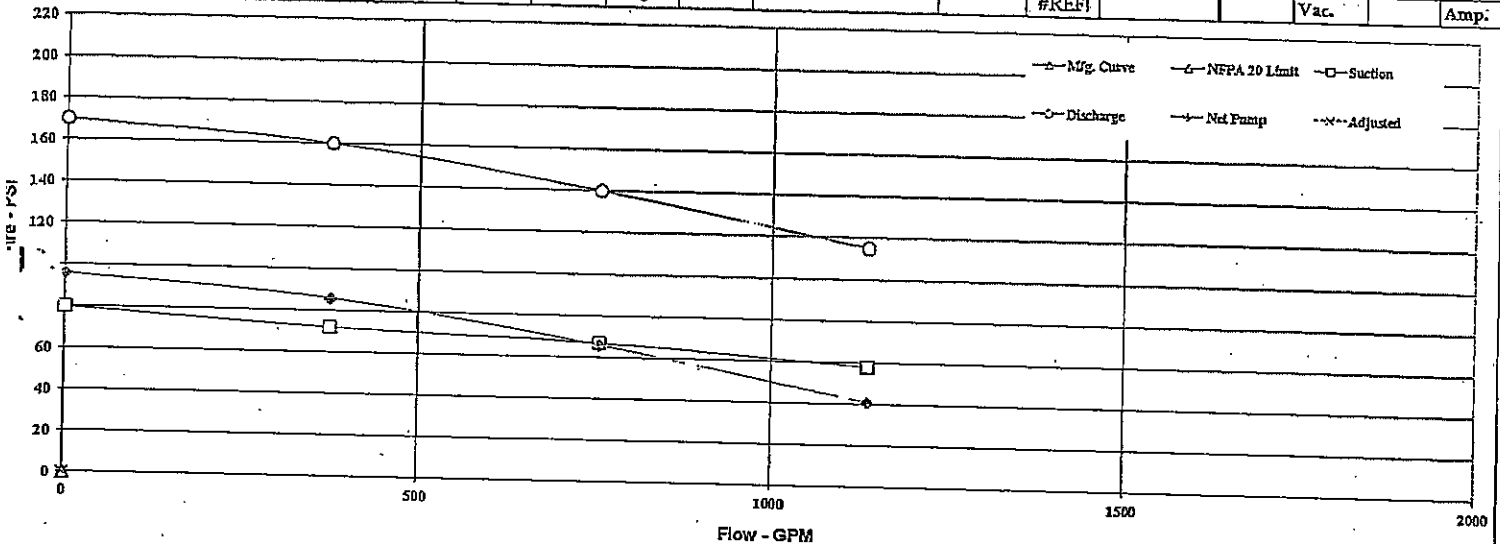


RPM's Rated to Actual

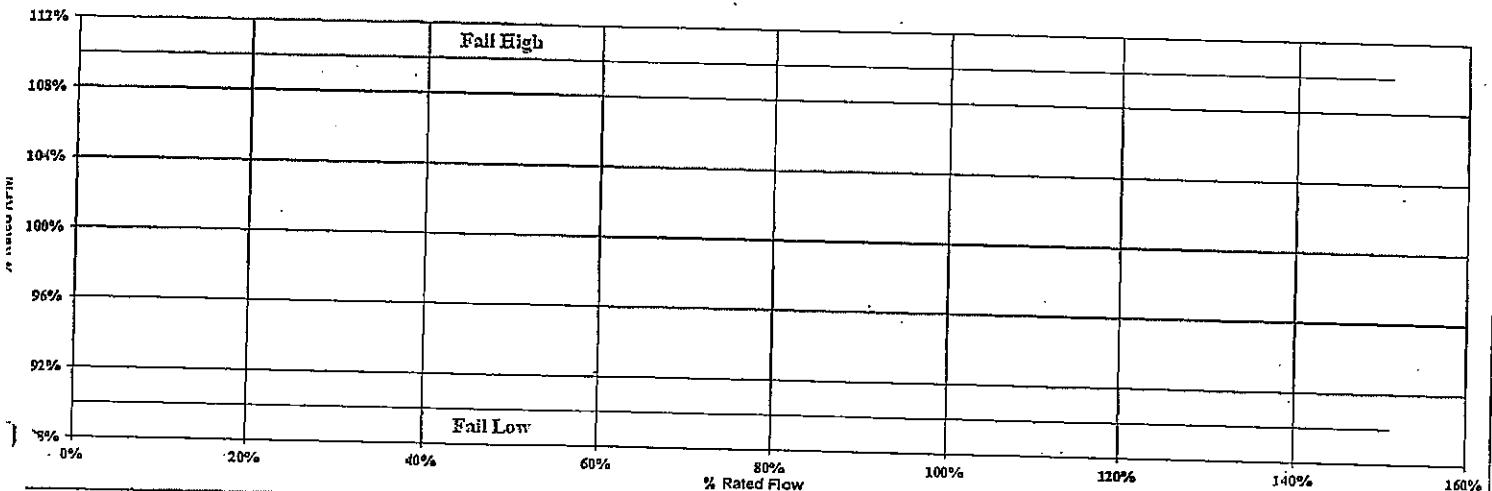


Page Intentionally Left Blank

Amps Rated to Actual

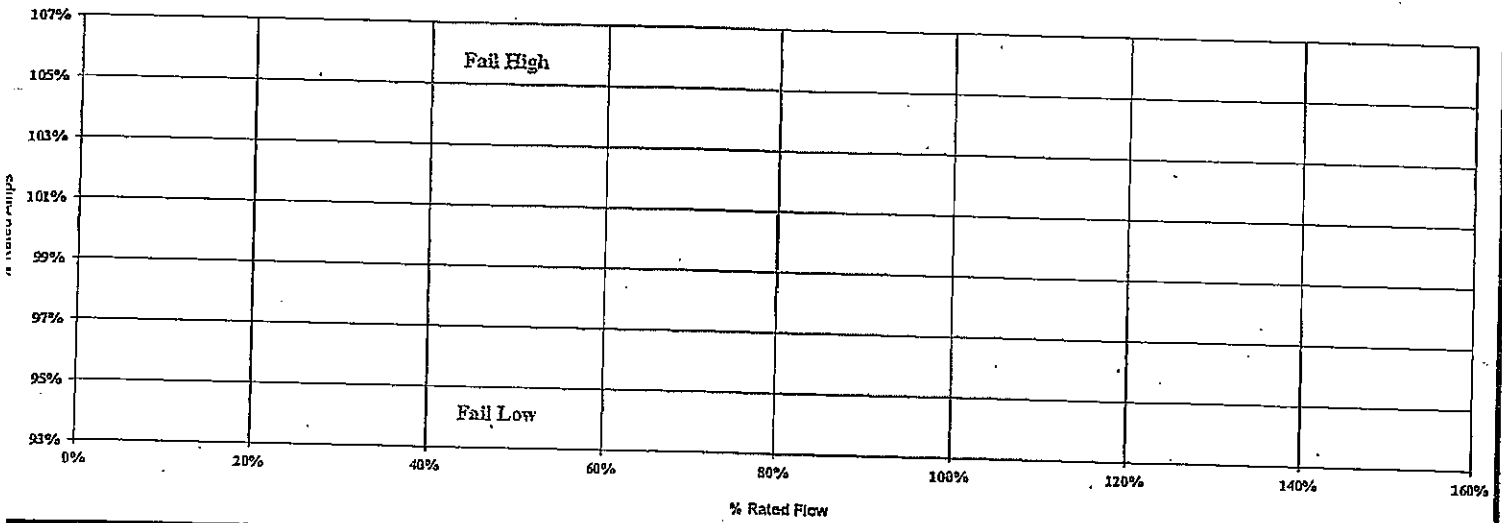

Fire Pump Performance Test

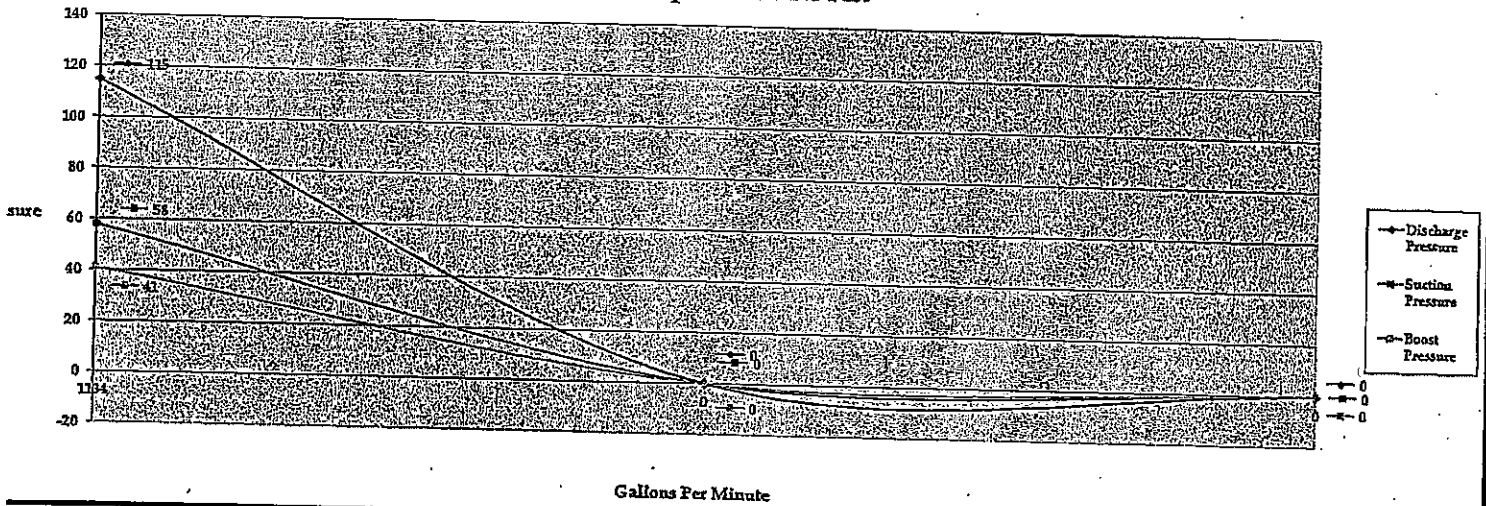

**Page Intentionally Left Blank**



.. Smarter. Tyco.™

LICENSE #

TR #

TASK/CALL #

PROJECT #

1941 Homgren Way  
Green Bay, WI 54304  
P 920-434-3711 F 920-434-8276

"PUT CUSTOMER STAMP ON ALL 3 PAGES"

Iron Mountain VA						
ADDRESS (OR ATTENTION OF)						
ADDRESS 325 H Street						
CITY Iron Mountain		STATE MI		ZIP 49801		
TR ARRIVAL DATE 06127116		BILL.	NON-BILL.	SERV. COMPL.	ACE CODE	NAT. ACCT.
NAME (BILL TO)						
ADDRESS						
CITY		STATE		ZIP		

CUSTOMER PURCHASE ORDER		
LABOR - REG.	LABOR - OT	LABOR - DT
TRAVEL - REG.	TRAVEL - OT	TRAVEL - DT
MIN.		INSP. MONTH
PHONE		MILES

WE STRONGLY RECOMMEND IMMEDIATE CORRECTION OF ANY DEFICIENCIES/IMPAIRMENTS IDENTIFIED. WE URGE YOU TO NOTIFY THE LOCAL AUTHORITY HAVING JURISDICTION AND YOUR INSURANCE CARRIER WITHOUT DELAY.

SimplexGrinnell proposes to furnish the work, and/or materials hereinafter described, subject to the terms and conditions outlined below.

I authorize SimplexGrinnell to proceed with the work as agreed to and outlined below:

Customer signature

Date \_\_\_\_\_

## PAYMENT TERMS

☐ Time and Material☐ Price Not to Exceed \$IMMEDIATE ☐

COD ☐

.NET 10 ☐

DEPOSIT \$

BALANCE DUE \$

☐ BILLABLE☐ NON-BILLABLE

SCOPE OF WORK / PROBLEM CODE

WORK PERFORMED / RESOLUTION CODE

WORK PERFORMED / RESOLUTION CODE This was an annual fire pump test. Tested 1 1/2" GPM fire pump.

No Deficiencies

GRP	PRODUCT I.D.	SERIAL # / DESCRIPTION	QTY.	COST	NO.	USG.	UNIT PRICE
SYSTEM TYPE/LOCATION			CONTACT NAME	TOTALS			

**IMPORTANT NOTICE TO CUSTOMER**

**CUSTOMER ACKNOWLEDGES AND AGREES TO THE TERMS AND CONDITIONS ON THE REVERSE SIDE OF THIS SERVICE REQUEST, AGREES THAT THE SERVICES HAVE BEEN COMPLETED TO CUSTOMER'S SATISFACTION AND THAT THE SYSTEM IS IN GOOD WORKING ORDER**  
**REPAIR, UNLESS SERVICES PERFORMED WERE OF A TEMPORARY NATURE, IN WHICH CASE CUSTOMER ACKNOWLEDGES THAT PART OF CUSTOMER'S SYSTEM MAY HAVE BEEN BYPASSED OR IS OTHERWISE INOPERABLE UNTIL SERVICE CAN BE COMPLETED.**  
**MEER'S ATTENTION IS DIRECTED TO THE LIMITATION OF LIABILITY, WARRANTY, INDEMNITY AND OTHER CONDITIONS ON THE REVERSE SIDE.**

## CUSTOMER ACCEPTANCE

Customer Acceptance)

(Int Name)

**SIMPLEX GRINNELL LP**

(SimplexGrinnell Representative)

(Print Name):

© SimplexGrinnell LP 2007

All rights reserved  
Service Request Form

Page Intentionally Left Blank

**SECTION 22 05 11**  
**COMMON WORK RESULTS FOR PLUMBING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. The requirements of this Section shall apply to all sections of Division 22.
- B. Definitions:
  - 1. Exposed: Piping and equipment exposed to view in finished rooms.
- C. Abbreviations/Acronyms:
  - 1. ABS: Acrylonitrile Butadiene Styrene
  - 2. AC: Alternating Current
  - 3. ACR: Air Conditioning and Refrigeration
  - 4. AISI: American Iron and Steel Institute
  - 5. AWG: American Wire Gauge
  - 6. BACnet: Building Automation and Control Network
  - 7. BAG: Silver-Copper-Zinc Brazing Alloy
  - 8. BAS: Building Automation System
  - 9. BCuP: Silver-Copper-Phosphorus Brazing Alloy
  - 10. CDA: Copper Development Association
  - 11. C: Celsius
  - 12. CLR: Color
  - 13. COR: Contracting Officer's Representative
  - 14. CRS: Corrosion Resistant Steel
  - 15. CWP: Cold Working Pressure
  - 16. CxA: Commissioning Agent
  - 17. DDC: Direct Digital Control
  - 18. DI: Digital Input
  - 19. DO: Digital Output
  - 20. DN: Diameter Nominal
  - 21. DWV: Drainage, Waste and Vent
  - 22. ECC: Engineering Control Center
  - 23. EPDM: Ethylene Propylene Diene Monomer
  - 24. F: Fahrenheit
  - 25. FAR: Federal Acquisition Regulations
  - 26. FD: Floor Drain
  - 27. FED: Federal
  - 28. FG: Fiberglass

- 29. FNPT: Female National Pipe Thread
- 30. GPM: Gallons Per Minute
- 31. HDPE: High Density Polyethylene
- 32. ID: Inside Diameter
- 33. IPS: Iron Pipe Size
- 34. lb: Pound
- 35. MAWP: Maximum Allowable Working Pressure
- 36. MAX: Maximum
- 37. MED: Medical
- 38. m: Meter
- 39. MFG: Manufacturer
- 40. MIN: Minimum
- 41. NF: Oil Free Dry (Nitrogen)
- 42. NPTF: National Pipe Thread Female
- 43. NPS: Nominal Pipe Size
- 44. NPT: Nominal Pipe Thread
- 45. OD: Outside Diameter
- 46. OSD: Open Sight Drain
- 47. OXY: Oxygen
- 48. PLC: Programmable Logic Controllers
- 49. PP: Polypropylene
- 50. PPM: Parts per Million
- 51. PSIG: Pounds per Square Inch
- 52. PVC: Polyvinyl Chloride
- 53. RAD: Radians
- 54. RPM: Revolutions Per Minute
- 55. SCFM: Standard Cubic Feet Per Minute
- 56. SPEC: Specification
- 57. STD: Standard
- 58. T/P: Temperature and Pressure
- 59. USDA: U.S. Department of Agriculture
- 60. V: Volt
- 61. VAC: Vacuum
- 62. VA: Veterans Administration
- 63. VAMC: Veterans Administration Medical Center
- 64. VAC: Voltage in Alternating Current
- 65. WOG: Water, Oil, Gas

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT.
- D. Section 05 50 00, METAL FABRICATIONS.
- E. Section 07 60 00, FLASHING AND SHEET METAL: Flashing for Wall and Roof Penetrations.
- F. Section 07 84 00, FIRESTOPPING.
- G. Section 07 92 00, JOINT SEALANTS.
- H. Section 09 91 00, PAINTING.
- I. Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT.
- J. Section 22 07 11, PLUMBING INSULATION.
- K. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
- L. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- M. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES.
- N. Section 26 29 11, MOTOR CONTROLLERS.

**1.3 APPLICABLE PUBLICATIONS**

- A. The publications listed below shall form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):  
 ASME Boiler and Pressure Vessel Code -  
 BPVC Section IX-2013....Welding, Brazing, and Fusing Qualifications  
 B31.1-2012.....Power Piping
- C. American Society for Testing and Materials (ASTM):  
 A36/A36M-2012.....Standard Specification for Carbon Structural Steel  
 A575-96(R2013)e1.....Standard Specification for Steel Bars, Carbon, Merchant Quality, M-Grades  
 E84-2013a.....Standard Test Method for Surface Burning Characteristics of Building Materials  
 E119-2012a.....Standard Test Methods for Fire Tests of Building Construction and Materials  
 F1760-01(R2011).....Standard Specification for Coextruded Poly(Vinyl Chloride) (PVC) Non-Pressure Plastic Pipe Having Reprocessed-Recycled Content

- D. International Code Council, (ICC):
  - IBC-2012.....International Building Code
  - IPC-2012.....International Plumbing Code
- E. Manufacturers Standardization Society (MSS) of the Valve and Fittings Industry, Inc:
  - SP-58-2009.....Pipe Hangers and Supports - Materials, Design, Manufacture, Selection, Application and Installation
  - SP-69-2003.....Pipe Hangers and Supports - Selection and Application
- F. National Electrical Manufacturers Association (NEMA):
  - MG 1-2011.....Motors and Generators
- G. National Fire Protection Association (NFPA):
  - 51B-2014.....Standard for Fire Prevention During Welding, Cutting and Other Hot Work
  - 70-2014.....National Electrical Code (NEC)
- H. NSF International (NSF):
  - 14-2012.....Plastic Piping System Components and Related Materials
  - 61-2012.....Drinking Water System Components - Health Effects
  - 372-2011.....Drinking Water System Components - Lead Content
- I. Department of Veterans Affairs (VA):
  - PG-18-10.....Plumbing Design Manual
  - PG-18-13-2011.....Barrier Free Design Guide
- J. Michigan Plumbing Code

#### **1.4 SUBMITTALS**

- A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 05 11, COMMON WORK RESULTS FOR PLUMBING", with applicable paragraph identification.
- C. Contractor shall make all necessary field measurements and investigations to assure that the equipment and assemblies will meet contract requirements and will fit the space available.

- D. If equipment is submitted which differs in arrangement from that shown, provide drawings that show the rearrangement of all associated systems. Approval will be given only if all features of the equipment and associated systems, including accessibility, are equivalent to that required by the contract.
- E. Prior to submitting shop drawings for approval, Contractor shall certify in writing that manufacturers of all major items of equipment have each reviewed drawings and specifications and have jointly coordinated and properly integrated their equipment and controls to provide a complete and efficient installation.
- F. Installing Contractor shall provide lists of previous installations for selected items of equipment. Contact persons who will serve as references, with telephone numbers and e-mail addresses shall be submitted with the references.
- G. Manufacturer's Literature and Data: Manufacturer's literature shall be submitted under the pertinent section rather than under this section.
  - 1. Equipment and materials identification.
  - 2. Firestopping materials.
  - 3. Hangers, inserts, supports and bracing. Provide load calculations for variable spring and constant support hangers.
- H. Submittals and shop drawings for interdependent items containing applicable descriptive information shall be furnished together and complete in a group. Coordinate and properly integrate materials and equipment in each group to provide a completely compatible and efficient installation. Final review and approvals will be made only by groups.
- I. Coordination Drawings: Complete consolidated and coordinated layout drawings shall be submitted for all new systems, and for existing systems that are in the same areas. The drawings shall include plan views, elevations and sections of all systems and shall be on a scale of not less than 1:32 (3/8 inch equal to one foot). Clearly identify and dimension the proposed locations of the principal items of equipment. The drawings shall clearly show the proposed location and adequate clearance for all equipment, controls, piping, valves and other items. All valves, water hammer arrestors, strainers, and equipment requiring service shall be provided with an access door sized

for the complete removal of plumbing device, component, or equipment. Equipment foundations shall not be installed until equipment or piping layout drawings have been approved. Detailed layout drawings shall be provided for all piping systems. In addition, details of the following shall be provided.

1. Mechanical equipment rooms.
2. Interstitial space / Tunnel spaces.
3. Hangers, inserts, supports, and bracing.
4. Pipe sleeves.
5. Equipment penetrations of floors, walls, ceilings, or roofs.

J. Maintenance Data and Operating Instructions:

1. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Article, INSTRUCTIONS, for systems and equipment. Include complete list indicating all components of the systems with diagrams of the internal wiring for each item of equipment.

## **1.5 QUALITY ASSURANCE**

A. Products Criteria:

1. Standard Products: Material and equipment shall be the standard products of a manufacturer regularly engaged in the manufacture, supply and servicing of the specified products for at least 5 years. However, digital electronics devices, software and systems such as controls, instruments, computer work station, shall be the current generation of technology and basic design that has a proven satisfactory service record of at least 5 years.
2. Equipment Service: There shall be permanent service organizations, authorized and trained by manufacturers of the equipment supplied, located within 160 km (100 miles) of the project. These organizations shall come to the site and provide acceptable service to restore operations within four hours of receipt of notification by phone, e-mail or fax in event of an emergency, such as the shutdown of equipment; or within 24 hours in a non-emergency. Names, mail and e-mail addresses and phone numbers of service organizations providing service under these conditions for (as applicable to the project): pumps, critical instrumentation, computer workstation and programming shall be submitted for project record and inserted into the operations and maintenance manual.



3. All items furnished shall be free from defects that would adversely affect the performance, maintainability and appearance of individual components and overall assembly.
  4. The products and execution of work specified in Division 22 shall conform to the referenced codes and standards as required by the specifications. Local codes and amendments enforced by the local code official shall be enforced, if required by local authorities. If the local codes are more stringent, then the local code shall apply. Any conflicts shall be brought to the attention of the Contracting Officers Representative (COR).
  5. Multiple Units: When two or more units of materials or equipment of the same type or class are required, these units shall be products of one manufacturer.
  6. Assembled Units: Manufacturers of equipment assemblies which use components made by others assume complete responsibility for the final assembled product.
  7. Nameplates: Nameplate bearing manufacturer's name or identifiable trademark shall be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.
  8. Asbestos products or equipment or materials containing asbestos shall not be used.
  9. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit <http://www.biopreferred.gov>.
- B. Welding: Before any welding is performed, Contractor shall submit a certificate certifying that welders comply with the following requirements:
1. Qualify welding processes and operators for piping according to ASME "Boiler and Pressure Vessel Code", Section IX, "Welding and Brazing Qualifications".
  2. Comply with provisions of ASME B31 series "Code for Pressure Piping".

3. Certify that each welder and welding operator has passed American Welding Society (AWS) qualification tests for the welding processes involved, and that certification is current.
  4. All welds shall be stamped according to the provisions of the American Welding Society.
- C. Manufacturer's Recommendations: Where installation procedures or any part thereof are required to be in accordance with the recommendations of the manufacturer of the material being installed, printed copies of these recommendations shall be furnished to the COR prior to installation. Installation of the item will not be allowed to proceed until the recommendations are received. Failure to furnish these recommendations can be cause for rejection of the material.
- D. Execution (Installation, Construction) Quality:
1. All items shall be applied and installed in accordance with manufacturer's written instructions. Conflicts between the manufacturer's instructions and the contract documents shall be referred to the COR for resolution. Printed copies or electronic files of manufacturer's installation instructions shall be provided to the COR at least 10 working days prior to commencing installation of any item.
  2. All items that require access, such as for operating, cleaning, servicing, maintenance, and calibration, shall be easily and safely accessible by persons standing at floor level or standing on permanent platforms without the use of portable ladders. Examples of these items include, but are not limited to: All types of valves, filters and strainers, transmitters, and control devices. Prior to commencing installation work, refer conflicts between this requirement and contract documents to COR for resolution.
  3. Complete layout drawings shall be required by Paragraph, SUBMITTALS. Construction work shall not start on any system until the layout drawings have been approved by VA.
  4. Installer Qualifications: Installer shall be licensed and shall provide evidence of the successful completion of at least five projects of equal or greater size and complexity. Provide tradesmen skilled in the appropriate trade.
  5. If an installation is unsatisfactory to the COR, the Contractor shall correct the installation at no additional cost or additional time to the Government.

- E. Guaranty: Warranty of Construction, FAR clause 52.246-21.
- F. Plumbing Systems: IPC, International Plumbing Code, Michigan Plumbing Code. Unless otherwise required herein, perform plumbing work in accordance with the latest version of the IPC. For IPC codes referenced in the contract documents, advisory provisions shall be considered mandatory, the word "should" shall be interpreted as "shall". Reference to the "code official" or "owner" shall be interpreted to mean the COR.
- G. Cleanliness of Piping and Equipment Systems:
  1. Care shall be exercised in the storage and handling of equipment and piping material to be incorporated in the work. Debris arising from cutting, threading and welding of piping shall be removed.
  2. Piping systems shall be flushed, blown or pigged as necessary to deliver clean systems.
  3. All piping shall be tested in accordance with the specifications and the International Plumbing Code (IPC). All filters, strainers, fixture faucets shall be flushed of debris prior to final acceptance.
  4. Contractor shall be fully responsible for all costs, damage, and delay arising from failure to provide clean systems.

#### **1.6 DELIVERY, STORAGE AND HANDLING**

- A. Protection of Equipment:
  1. Equipment and material placed on the job site shall remain in the custody of the Contractor until phased acceptance, whether or not the Government has reimbursed the Contractor for the equipment and material. The Contractor is solely responsible for the protection of such equipment and material against any damage.
  2. Damaged equipment shall be replaced with an identical unit as determined and directed by the COR. Such replacement shall be at no additional cost or additional time to the Government.
  3. Interiors of new equipment and piping systems shall be protected against entry of foreign matter. Both inside and outside shall be cleaned before painting or placing equipment in operation.
  4. Existing equipment and piping being worked on by the Contractor shall be under the custody and responsibility of the Contractor and shall be protected as required for new work.

**1.7 AS-BUILT DOCUMENTATION**

- A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.
- B. Submit operation and maintenance data updated to include submittal review comments, substitutions and construction revisions all of which shall be inserted into a three-ring binder. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices shall be included. A list of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the Owner will be required to employ shall be inserted into the As-Built documentation.
- C. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. As-built drawings are to be provided, and a copy of them on Auto-Cad version 2017 provided on compact disk or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.
- D. Certification documentation shall be provided prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and a certification that all results of tests were within limits specified.

**PART 2 - PRODUCTS****2.1 MATERIALS FOR VARIOUS SERVICES**

- A. Non-pressure PVC pipe shall contain a minimum of 25 percent recycled content. Steel pipe shall contain a minimum of 25 percent recycled content.
- B. Plastic pipe, fittings and solvent cement shall meet NSF 14 and shall bear the NSF seal "NSF-PW". Polypropylene pipe and fittings shall comply with NSF 14 and NSF 61. Solder or flux containing lead shall not be used with copper pipe.

- C. Material or equipment containing a weighted average of greater than 0.25 percent lead shall not be used in any potable water system intended for human consumption and shall be certified in accordance with NSF 61 or NSF 372.
- D. In-line devices such building valves, check valves, stops, valves, fittings, tanks and backflow preventers shall comply with NSF 61 and NSF 372.
- E. End point devices such as lavatory faucets, kitchen faucets, ice makers supply stops, and end-point control valves used to dispense drinking water must meet requirements of NSF 61 and NSF 372.

## **2.2 FACTORY-ASSEMBLED PRODUCTS**

- A. Standardization of components shall be maximized to reduce spare part requirements.
- B. Manufacturers of equipment assemblies that include components made by others shall assume complete responsibility for final assembled unit.
  - 1. All components of an assembled unit need not be products of same manufacturer.
  - 2. Constituent parts that are alike shall be products of a single manufacturer.
  - 3. Components shall be compatible with each other and with the total assembly for intended service.
  - 4. Contractor shall guarantee performance of assemblies of components and shall repair or replace elements of the assemblies as required to deliver specified performance of the complete assembly at no additional cost or time to the Government.
- C. Components of equipment shall bear manufacturer's name and trademark, model number, serial number and performance data on a name plate securely affixed in a conspicuous place, or cast integral with, stamped or otherwise permanently marked upon the components of the equipment.
- D. Major items of equipment which serve the same function shall be the same make and model.

## **2.3 COMPATIBILITY OF RELATED EQUIPMENT**

- A. Equipment and materials installed shall be compatible in all respects with other items being furnished and with existing items so that the result will be a complete and fully operational system that conforms to contract requirements.

## 2.4 LIFTING ATTACHMENTS

- A. Equipment shall be provided with suitable lifting attachments to enable equipment to be lifted in its normal position. Lifting attachments shall withstand any handling conditions that might be encountered, without bending or distortion of shape, such as rapid lowering and braking of load.

## 2.5 EQUIPMENT AND MATERIALS IDENTIFICATION

- A. Use symbols, nomenclature and equipment numbers specified, shown on the drawings, or shown in the maintenance manuals. Coordinate equipment and valve identification with local VAMC shops. In addition, provide bar code identification nameplate for all equipment which will allow the equipment identification code to be scanned into the system for maintenance and inventory tracking. Identification for piping is specified in Section 09 91 00, PAINTING.
- B. Interior (Indoor) Equipment: Engraved nameplates with letters not less than 7 mm (3/16 inch) high of brass with black-filled letters, or rigid black plastic with white letters specified in Section 09 91 00, PAINTING shall be permanently fastened to the equipment. Unit components such as pump(s), filters, etc. shall be identified.
- C. Control Items: All temperature, pressure, and controllers shall be labeled and the component's function identified. Identify and label each item as they appear on the control diagrams.
- D. Valve Tags and Lists:
  - 1. Plumbing: All valves shall be provided with valve tags and listed on a valve list (Fixture stops not included).
  - 2. Valve Tags: Engraved black filled numbers and letters not less than 15 mm (1/2 inch) high for number designation, and not less than 8 mm (1/4 inch) for service designation on 19 gage, 40 mm (1-1/2 inches) round brass disc, attached with brass "S" hook or brass chain. Valve tag(s) are being added to an existing system. Verify with Owner the starting valve tag number and abbreviation. This shall be verified before valve tags are ordered.

3. Valve Lists: Valve lists shall be created using a word processing program and printed on plastic coated cards. The plastic-coated valve list card(s), sized 215 mm (8-1/2 inches) by 275 mm (11 inches) shall show valve tag number, valve function and area of control for each service or system. The valve list shall be in a punched 3-ring binder notebook. An additional copy of the valve list shall be mounted in picture frames for mounting to a wall. COR shall instruct contractor where frames shall be mounted.
4. A detailed plan for each floor of the building indicating the location and valve number for each valve shall be provided in the 3-ring binder notebook. Each valve location shall be identified with a color-coded sticker or thumb tack in ceiling or access door.

## **2.6 FIRESTOPPING**

- A. Section 07 84 00, FIRESTOPPING specifies an effective barrier against the spread of fire, smoke and gases where penetrations occur for piping. Refer to Section 22 07 11, PLUMBING INSULATION, for pipe insulation.

## **2.7 PIPE AND EQUIPMENT SUPPORTS AND RESTRAINTS**

- A. In lieu of the paragraph which follows, suspended equipment support and restraints may be designed and installed in accordance with the International Building Code (IBC) requirements, or the following paragraphs of this Section shall be stamped and signed by a professional engineer registered in the state where the project is located. The Support system of suspended equipment over 227 kg (500 pounds) shall be submitted for approval of the COR in all cases. See the above specifications for lateral force design requirements.
- B. Type Numbers Specified: For materials, design, manufacture, selection, application and installation, refer to MSS SP-58. For selection and application, refer to MSS SP-69. Refer to Section 05 50 00, METAL FABRICATIONS, for miscellaneous metal support materials and prime coat painting.
- C. For Attachment to Concrete Construction:
  1. Concrete Insert: Type 18, MSS SP-58.
  2. Self-drilling Expansion Shields and Machine Bolt Expansion Anchors: Permitted in concrete not less than 100 mm (4 inches) thick when approved by the COR for each job condition.
  3. Power-Driven Fasteners: Permitted in existing concrete or masonry not less than 100 mm (4 inches) thick when approved by the COR for each job condition.

- D. For Attachment to Steel Construction: MSS SP-58.
  - 1. Welded Attachment: Type 22.
  - 2. Beam Clamps: Types 20, 21, 28 or 29. Type 23 C-clamp may be used for individual copper tubing up to 23 mm (7/8 inch) outside diameter.
- E. Attachment to Metal Pan or Deck: As required for materials specified in Section 05 36 00, COMPOSITE METAL DECKING.
- F. Hanger Rods: Hot-rolled steel, ASTM A36/A36M or ASTM A575 for allowable load listed in MSS SP-58. For piping, provide adjustment means for controlling level or slope. Types 13 or 15 turn-buckles shall provide 40 mm (1-1/2 inches) minimum of adjustment and incorporate locknuts. All-thread rods are acceptable.
- G. Multiple (Trapeze) Hangers: Galvanized, cold-formed, lipped steel channel horizontal member, not less than 43 mm by 43 mm (1-5/8 inches by 1-5/8 inches), 2.7 mm (No. 12 gage), designed to accept special spring held, hardened steel nuts.
  - 1. Allowable Hanger Load: Manufacturer's rating less 91kg (200 pounds).
  - 2. Guide individual pipes on the horizontal member of every other trapeze hanger with 8 mm (1/4 inch) U-bolt fabricated from steel rod. Provide Type 40 insulation shield, secured by two 15 mm (1/2 inch) galvanized steel bands, or insulated calcium silicate shield for insulated piping at each hanger.
- H. Pipe Hangers and Supports: (MSS SP-58), use hangers sized to encircle insulation on insulated piping. Refer to Section 22 07 11, PLUMBING INSULATION for insulation thickness. To protect insulation, provide Type 39 saddles for roller type supports or insulated calcium silicate shields. Provide Type 40 insulation shield or insulated calcium silicate shield at all other types of supports and hangers including those for insulated piping.
  - 1. General Types (MSS SP-58):
    - a. Standard Clevis Hanger: Type 1; provide locknut.
    - b. Riser Clamps: Type 8.
    - c. Wall Brackets: Types 31, 32 or 33.
    - d. Saddle Support: Type 36, 37 or 38.
    - e. U-bolt Clamp: Type 24.



## b. Copper Tube:

- 1) Hangers, clamps and other support material in contact with tubing shall be painted with copper colored epoxy paint, copper-coated, plastic coated or taped with isolation tape to prevent electrolysis.
- 2) For vertical runs, use epoxy painted, copper-coated or plastic coated riser clamps.
- 3) For supporting tube to strut, provide epoxy painted pipe straps for copper tube or plastic inserted vibration isolation clamps.
- 4) Insulated Lines: Provide pre-insulated calcium silicate shields sized for copper tube.

## c. Supports for Plastic: As recommended by the pipe manufacturer with black rubber tape extending one inch beyond steel support or clamp. Spring Supports (Expansion and contraction of vertical piping):

- 1) Movement up to 20 mm (3/4 inch): Type 51 or 52 variable spring unit with integral turn buckle and load indicator.
- 2) Movement more than 20 mm (3/4 inch): Type 54 or 55 constant support unit with integral adjusting nut, turn buckle and travel position indicator.

## 2. Plumbing Piping (Other Than General Types):

- a. Horizontal Piping: Type 1, 5, 7, 9, and 10.
- b. Hangers and Supports in Pipe Chase: Prefabricated system ABS self-extinguishing material, not subject to electrolytic action, to hold piping, prevent vibration and compensate for all static and operational conditions.
- c. Blocking, Stays and Bracing: Angle iron or preformed metal channel shapes, 1.3 mm (18 gage) minimum.

## I. Pre-insulated Calcium Silicate Shields:

1. Provide 360 degree water resistant high density 965 kPa (140 psig) compressive strength calcium silicate shields encased in galvanized metal.
2. Pre-insulated calcium silicate shields to be installed at the point of support during erection.
3. Shield thickness shall match the pipe insulation.

4. The type of shield is selected by the temperature of the pipe, the load it must carry, and the type of support it will be used with.
  - a. Shields for supporting cold water shall have insulation that extends a minimum of 25 mm (1 inch) past the sheet metal.
  - b. The insulated calcium silicate shield shall support the maximum allowable water filled span as indicated in MSS SP-69. To support the load, the shields shall have one or more of the following features: Structural inserts 4138 kPa (600 psig) compressive strength, an extra bottom metal shield, or formed structural steel (ASTM A36/A36M) wear plates welded to the bottom sheet metal jacket.
5. Shields may be used on steel clevis hanger type supports, trapeze hangers, roller supports or flat surfaces.

## **2.8 PIPE PENETRATIONS**

- A. Pipe penetration sleeves shall be installed for all pipe other than rectangular blocked out floor openings for risers in mechanical bays.
- B. Pipe penetration sleeve materials shall comply with all firestopping requirements for each penetration.
- C. To prevent accidental liquid spills from passing to a lower level, provide the following:
  1. For Sleeves: Extend sleeve 25 mm (1 inch) above finished floor and provide sealant for watertight joint.
  2. For Blocked Out Floor Openings: Provide 40 mm (1-1/2 inch) angle set in silicone adhesive around opening.
  3. For Drilled Penetrations: Provide 40 mm (1-1/2 inch) angle ring or square set in silicone adhesive around penetration.
- D. Penetrations are not allowed through beams or ribs, but may be installed in concrete beam flanges, with structural engineer prior approval. Any deviation from these requirements must receive prior approval of COR.
- E. Sheet metal, plastic, or moisture resistant fiber sleeves shall be provided for pipe passing through floors, interior walls, and partitions, unless brass or steel pipe sleeves are specifically called for below.
- F. Galvanized steel or an alternate black iron pipe with asphalt coating sleeves shall be for pipe passing through concrete beam flanges, except where brass pipe sleeves are called for. A galvanized steel sleeve shall be provided for pipe passing through floor of mechanical rooms

and laundry work rooms above basement. Except in mechanical rooms, sleeves shall be connected with a floor plate.

- G. Brass Pipe Sleeves shall be provided for pipe passing through quarry tile, terrazzo or ceramic tile floors. The sleeve shall be connected with a floor plate.
- H. Sleeve clearance through floors, walls, partitions, and beam flanges shall be 25 mm (1 inch) greater in diameter than external diameter of pipe. Sleeve for pipe with insulation shall be large enough to accommodate the insulation plus 25 mm (1 inch) in diameter. Interior openings shall be caulked tight with firestopping material and sealant to prevent the spread of fire, smoke, water and gases.
- I. Sealant and Adhesives: Shall be as specified in Section 07 92 00, JOINT SEALANTS. Bio-based materials shall be utilized when possible.

## **2.9 WALL, FLOOR AND CEILING PLATES**

- A. Material and Type: Chrome plated brass or chrome plated steel, one piece or split type with concealed hinge, with set screw for fastening to pipe, or sleeve. Use plates that fit tight around pipes, cover openings around pipes and cover the entire pipe sleeve projection.
- B. Thickness: Not less than 2.4 mm (3/32 inch) for floor plates. For wall and ceiling plates, not less than 0.64 mm (0.025 inch) for up to 75 mm (3 inch) pipe, 0.89 mm (0.035 inch) for larger pipe.
- C. Locations: Use where pipe penetrates floors, walls and ceilings in exposed locations, in finished areas only. Wall plates shall be used where insulation ends on exposed water supply pipe drop from overhead. A watertight joint shall be provided in spaces where brass or steel pipe sleeves are specified.

## **2.10 ASBESTOS**

- A. Materials containing asbestos are not permitted.

**PART 3 - EXECUTION****3.1 ARRANGEMENT AND INSTALLATION OF EQUIPMENT AND PIPING**

- A. Location of piping, sleeves, inserts, hangers, and equipment, access provisions shall be coordinated with the work of all trades. Piping, sleeves, inserts, hangers, and equipment shall be located clear of windows, doors, openings, light outlets, and other services and utilities. Equipment layout drawings shall be prepared to coordinate proper location and personnel access of all facilities. The drawings shall be submitted for review.
- B. Manufacturer's published recommendations shall be followed for installation methods not otherwise specified.
- C. Operating Personnel Access and Observation Provisions: All equipment and systems shall be arranged to provide clear view and easy access, without use of portable ladders, for maintenance, testing and operation of all devices including, but not limited to: All equipment items, valves, backflow preventers, filters, strainers, transmitters, sensors, meters and control devices. All gages and indicators shall be clearly visible by personnel standing on the floor or on permanent platforms. Maintenance and operating space and access provisions that are shown on the drawings shall not be changed nor reduced.
- D. Structural systems necessary for pipe and equipment support shall be coordinated to permit proper installation.
- E. Location of pipe sleeves, trenches and chases shall be accurately coordinated with equipment and piping locations.
- F. The approximate location of all fixtures, equipment and piping are shown on the drawings. The Architect reserves the right to change the location of any fixture 5 feet and piping 10 feet in any direction, without these changes being made subject of an extra charge, provided changes are made before the rough-in, piping or sleeves are installed.
- G. Cutting Holes:
  - 1. Holes shall be located to avoid interference with structural members such as beams or grade beams. Holes shall be laid out in advance and drilling done only after approval by COR. If the Contractor considers it necessary to drill through structural members, this matter shall be referred to COR for approval.
  - 2. Waterproof membrane shall not be penetrated. Pipe floor penetration block outs shall be provided outside the extents of the waterproof membrane.

3. Holes through concrete and masonry shall be cut by rotary core drill. Pneumatic hammer, impact electric, and hand or manual hammer type drill will not be allowed, except as permitted by COR where working area space is limited.
- H. Minor Piping: Generally, small diameter pipe runs from drips and drains, water cooling, and other services are not shown but must be provided. Provide copper tubing from unit to drain.
- I. Protection and Cleaning:
1. Equipment and materials shall be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations and as approved by the COR. Damaged or defective items in the opinion of the COR shall be replaced at no additional cost or time to the Government.
  2. Protect all finished parts of equipment, such as shafts and bearings where accessible, from rust prior to operation by means of protective grease coating and wrapping. Close pipe openings with caps or plugs during installation. Pipe openings, equipment, and plumbing fixtures shall be tightly covered against dirt or mechanical injury. At completion of all work thoroughly clean fixtures, exposed materials and equipment.
- J. Concrete and Grout: Concrete and shrink compensating grout 25 MPa (3000 psig) minimum, specified in Section 03 30 00, CAST-IN-PLACE CONCRETE, shall be used for all pad or floor mounted equipment.
- K. Gages, thermometers, valves and other devices shall be installed with due regard for ease in reading or operating and maintaining said devices. Thermometers and gages shall be located and positioned to be easily read by operator or staff standing on floor or walkway provided. Servicing shall not require dismantling adjacent equipment or pipe work.
- L. Many plumbing systems interface with the HVAC control system. Provide DDC connection for sanitary and drain tile alarm panels. See the HVAC control points list and Section 23 09 23, DIRECT DIGITAL CONTROL SYSTEM FOR HVAC.

M. Work in Existing Building:

1. Medical gas shutdown(s) and water connection(s) to be done at night/premium hours. Medical gas(es) to be re-certified and operational by 6:00 A.M. each day. Coordinate all shutdowns with the Owner. Provide isolation valve(s) as required. Provide temporary connection(s) to minimize shutdown time.
2. Perform as specified in Article, OPERATIONS AND STORAGE AREAS, Article, ALTERATIONS, and Article, RESTORATION of the Section 01 00 00, GENERAL REQUIREMENTS for relocation of existing equipment, alterations and restoration of existing building(s).
3. As specified in Section 01 00 00, GENERAL REQUIREMENTS, Article OPERATIONS AND STORAGE AREAS, make alterations to existing service piping at times that will cause the least interfere with normal operation of the facility.

N. Work to be completed in phases. See architectural plan for phasing limits. Provide isolation valves, shutdowns, certifications, temporary piping and connection(s) as required for phasing work, with minimal disruption and downtime.

O. Work in Bathrooms, Restrooms, Housekeeping Closets: All pipe penetrations behind escutcheons shall be sealed with plumbers putty.

P. Switchgear Drip Protection: Every effort shall be made to eliminate the installation of pipe above data equipment, and electrical and telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints. Drain valve shall be provided in low point of casement pipe.

Q. Inaccessible Equipment:

1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, equipment shall be removed and reinstalled or remedial action performed as directed at no additional cost or additional time to the Government.
2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders or without climbing or crawling under or over obstacles such as electrical conduit, motors, pumps, transformers, high voltage lines, piping, and ductwork.

### **3.2 TEMPORARY PIPING AND EQUIPMENT**

- A. Continuity of operation of existing facilities may require temporary installation or relocation of equipment and piping. Temporary equipment or pipe installation or relocation shall be provided to maintain continuity of operation of existing facilities.
- B. The Contractor shall provide all required facilities in accordance with the requirements of phased construction and maintenance of service. All piping and equipment shall be properly supported, sloped to drain, operate without excessive stress, and shall be insulated where injury can occur to personnel by contact with operating facilities. The requirements of paragraph 3.1 shall apply.
- C. Temporary facilities and piping shall be completely removed back to the nearest active distribution branch or main pipe line and any openings in structures sealed. Dead legs are not allowed in potable water, sanitary/vent systems. Necessary blind flanges and caps shall be provided to seal open piping remaining in service.
- D. Provide isolation valve(s) for water, medical gas to minimize downtime and disruption.

### **3.3 RIGGING**

- A. Openings in building structures shall be planned to accommodate design scheme.
- B. Alternative methods of equipment delivery may be offered and will be considered by Government under specified restrictions of phasing and service requirements as well as structural integrity of the building.
- C. All openings in the building shall be closed when not required for rigging operations to maintain proper environment in the facility for Government operation and maintenance of service.
- D. Contractor shall provide all facilities required to deliver specified equipment and place on foundations. Attachments to structures for rigging purposes and support of equipment on structures shall be Contractor's full responsibility.
- E. Contractor shall check all clearances, weight limitations and shall provide a rigging plan designed by a Registered Professional Engineer. All modifications to structures, including reinforcement thereof, shall be at Contractor's cost, time and responsibility.
- F. Rigging plan and methods shall be referred to COR for evaluation prior to actual work.

### 3.4 PIPE AND EQUIPMENT SUPPORTS

- A. Where hanger spacing does not correspond with joist or rib spacing, use structural steel channels secured directly to joist and rib structure that will correspond to the required hanger spacing, and then suspend the equipment and piping from the channels. Holes shall be drilled or burned in structural steel ONLY with the prior written approval of the COR.
- B. The use of chain pipe supports, wire or strap hangers; wood for blocking, stays and bracing, or hangers suspended from piping above shall not be permitted. Rusty products shall be replaced.
- C. Hanger rods shall be used that are straight and vertical. Turnbuckles for vertical adjustments may be omitted where limited space prevents use. A minimum of 15 mm (1/2 inch) clearance between pipe or piping covering and adjacent work shall be provided.
- D. For horizontal and vertical plumbing pipe supports, refer to the International Plumbing Code (IPC), Michigan Plumbing Code, and these specifications.
- E. Overhead Supports:
  - 1. The basic structural system of the building is designed to sustain the loads imposed by equipment and piping to be supported overhead.
  - 2. Provide steel structural members, in addition to those shown, of adequate capability to support the imposed loads, located in accordance with the final approved layout of equipment and piping.
  - 3. Tubing and capillary systems shall be supported in channel troughs.
- F. Floor Supports:
  - 1. Provide concrete bases, concrete anchor blocks and pedestals, and structural steel systems for support of equipment and piping. Concrete bases and structural systems shall be anchored and doweled to resist forces under operating and seismic conditions (if applicable) without excessive displacement or structural failure.
  - 2. Bases and supports shall not be located and installed until equipment mounted thereon has been approved. Bases shall be sized to match equipment mounted thereon plus 50 mm (2 inch) excess on all edges. Structural drawings shall be reviewed for additional requirements. Bases shall be neatly finished and smoothed, shall have chamfered edges at the top, and shall be suitable for painting.



3. All equipment shall be shimmed, leveled, firmly anchored, and grouted with epoxy grout. Anchor bolts shall be placed in sleeves, anchored to the bases. Fill the annular space between sleeves and bolts with a grout material to permit alignment and realignment.

### **3.5 PLUMBING SYSTEMS DEMOLITION**

- A. Rigging access, other than indicated on the drawings, shall be provided after approval for structural integrity by the COR. Such access shall be provided without additional cost or time to the Government.  
Where work is in an operating plant, approved protection from dust and debris shall be provided at all times for the safety of plant personnel and maintenance of plant operation and environment of the plant.
- B. In an operating plant, cleanliness and safety shall be maintained. The plant shall be kept in an operating condition. Government personnel will be carrying on their normal duties of operating, cleaning and maintaining equipment and plant operation. Work shall be confined to the immediate area concerned; maintain cleanliness and wet down demolished materials to eliminate dust. Dust and debris shall not be permitted to accumulate in the area to the detriment of plant operation. All flame cutting shall be performed to maintain the fire safety integrity of this plant. Adequate fire extinguishing facilities shall be available at all times. All work shall be performed in accordance with recognized fire protection standards including NFPA 51B. Inspections will be made by personnel of the VA Medical Center, and the Contractor shall follow all directives of the COR with regard to rigging, safety, fire safety, and maintenance of operations.
- C. Unless specified otherwise, all piping, wiring, conduit, and other devices associated with the equipment not re-used in the new work shall be completely removed from Government property per Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT. This includes all concrete equipment pads, pipe, valves, fittings, insulation, and all hangers including the top connection and any fastenings to building structural systems. All openings shall be sealed after removal of equipment, pipes, ducts, and other penetrations in roof, walls, floors, in an approved manner and in accordance with plans and specifications where specifically covered. Structural integrity of the building system shall be maintained. Reference shall also be made to the drawings and specifications of the other disciplines in the project for additional facilities to be demolished or handled.

- D. All valves including gate, globe, ball, butterfly and check, all pressure gages and thermometers with wells shall remain Government property and shall be removed and delivered to COR and stored as directed. The Contractor shall remove all other material and equipment, devices and demolition debris under these plans and specifications. Such material shall be removed from Government property expeditiously and shall not be allowed to accumulate. Coordinate with the COR and Infection Control.
- E. Asbestos Insulation Removal: To be completed by Owner. Plumbing Trade to re-insulate plumbing pipes in area of asbestos abatement.
- F. Work in the Existing Building: Protect existing equipment and areas. Provide required dust control. Any equipment not protected by the Contractor during construction shall be cleaned and/or replaced by the contractor at fault.
- G. **All piping, equipment, insulation, hangers, hanger rods, and wiring to be demolished and removed. Remove all associated hangers, support rods and anchors. No abandoned items shall be left above the ceilings.**

### 3.6 CLEANING AND PAINTING

- A. Prior to final inspection and acceptance of the plant and facilities for beneficial use by the Government, the plant facilities, equipment and systems shall be thoroughly cleaned and painted. Refer to Section 09 91 00, PAINTING.
- B. In addition, the following special conditions apply:
  - 1. Cleaning shall be thorough. Solvents, cleaning materials and methods recommended by the manufacturers shall be used for the specific tasks. All rust shall be removed prior to painting and from surfaces to remain unpainted. Scratches, scuffs, and abrasions shall be repaired prior to applying prime and finish coats.
  - 2. The following Material and Equipment shall NOT be painted:
    - a. Regulators.
    - b. Control valves and thermostatic elements.
    - c. Copper, brass, aluminum, stainless steel and bronze surfaces.
    - d. Valve stems and rotating shafts.
    - e. Pressure gages and thermometers.
    - f. Name plates.
  - 3. Control and instrument panels shall be cleaned and damaged surfaces repaired. Touch-up painting shall be made with matching paint type and color obtained from manufacturer or computer matched.

4. Pumps, motors, steel and cast iron bases, and coupling guards shall be cleaned and shall be touched-up with the same paint type and color as utilized by the pump manufacturer.
5. Temporary Facilities: Apply paint to surfaces that do not have existing finish coats per Section 09 91 00, Painting.
6. The final result shall be a smooth, even-colored, even-textured factory finish on all items. The entire piece of equipment shall be repainted, if necessary, to achieve this. Lead based paints shall not be used.

### **3.7 IDENTIFICATION SIGNS**

- A. Laminated plastic signs, with engraved lettering not less than 7 mm (3/16 inch) high, shall be provided that designates equipment function, for all equipment, switches, motor controllers, relays, meters, control devices, including automatic control valves. Nomenclature and identification symbols shall correspond to that used in maintenance manual, and in diagrams specified elsewhere. Attach by chain, adhesive, or screws.
- B. Factory Built Equipment: Metal plate, securely attached, with name and address of manufacturer, serial number, model number, size, and performance data shall be placed on factory built equipment.
- C. Pipe Identification: Refer to Section 09 91 00, PAINTING.

### **3.8 STARTUP AND TEMPORARY OPERATION**

- A. Startup of equipment shall be performed as described in the equipment specifications. Vibration within specified tolerance shall be verified prior to extended operation. Temporary use of equipment is specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT.
- B. The commissioning Agent will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with the Contracting Officer's Representative and Commissioning Agent. Provide a minimum of 2 weeks prior notice.

### **3.9 OPERATING AND PERFORMANCE TESTS**

- A. Prior to the final inspection, all required tests shall be performed as specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TESTS and submit the test reports and records to the COR.

- B. Should evidence of malfunction in any tested system, or piece of equipment or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost to the Government.
- C. When completion of certain work or systems occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then conduct such performance tests and finalize control settings during the first actual seasonal use of the respective systems following completion of work. Rescheduling of these tests shall be requested in writing to COR for approval.
- D. Perform tests as required for commissioning provisions in accordance with Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS and Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.

### **3.10 OPERATION AND MAINTENANCE MANUALS**

- A. All new and temporary equipment and all elements of each assembly shall be included.
- B. Data sheet on each device listing model, size, capacity, pressure, speed, horsepower, impeller size, and other information shall be included.
- C. Manufacturer's installation, maintenance, repair, and operation instructions for each device shall be included. Assembly drawings and parts lists shall also be included. A summary of operating precautions and reasons for precautions shall be included in the Operations and Maintenance Manual.
- D. Lubrication instructions, type and quantity of lubricant shall be included.
- E. Schematic diagrams and wiring diagrams of all control systems corrected to include all field modifications shall be included.
- F. Setpoints of all interlock devices shall be listed.
- G. Trouble-shooting guide for the control system troubleshooting shall be inserted into the Operations and Maintenance Manual.
- H. The control system sequence of operation corrected with submittal review comments shall be inserted into the Operations and Maintenance Manual.
- I. Emergency procedures for shutdown and startup of equipment and systems.

**3.11 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for two hours to instruct VA Personnel in operation and maintenance of the system. VA Personnel/Owner to sign-off on training. Provide sign-off letter with O&M submittal.

---END---



**SECTION 22 05 19**  
**METERS AND GAGES FOR PLUMBING PIPING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section describes the requirements for water meters and gages primarily used for troubleshooting the system and to indicate system performance.
- B. A complete listing of all acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.
- C. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

**1.3 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):  
 B40.100-2013.....Pressure Gauges and Gauge Attachments  
 B40.200-2008.....Thermometers, Direct Reading and Remote Reading
- C. Institute of Electrical and Electronics Engineers (IEEE):  
 C2-2012.....National Electrical Safety Code (NESC)
- D. International Code Council (ICC):  
 IPC-2012.....International Plumbing Code
- E. National Fire Protection Association (NFPA):  
 70-2011.....National Electrical Code (NEC)
- F. NSF International (NSF):  
 61-2012.....Drinking Water System Components - Health Effects  
 372-2011.....Drinking Water System Components - Lead Content

**1.4 SUBMITTALS**

- A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 05 19, METERS AND GAGES FOR PLUMBING PIPING", with applicable paragraph identification.

- C. Manufacturer's Literature and Data Including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.
  - 1. Pressure Gages.
  - 2. Thermometers.
  - 3. Product certificates for each type of meter and gage.
  - 4. BACnet communication protocol.
- D. Operations and Maintenance manual shall include:
  - 1. System Description.
  - 2. Major assembly block diagrams.
  - 3. Troubleshooting and preventive maintenance guidelines.
  - 4. Spare parts information.
- E. Shop Drawings shall include the following: One line, wiring and terminal diagrams including terminals identified, protocol or communication modules, and Ethernet connections.

#### **1.5 AS-BUILT DOCUMENTATION**

- A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.
- B. Submit copies of complete operation and maintenance data updated to include submittal review comments, substitutions and construction revisions shall be inserted into a three-ring binder per the requirements of Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual.  
The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. A list of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the Owner will be required to employ shall be inserted into the As-Built documentation.



## PART 2 - PRODUCTS

### 2.1 THERMOMETERS

- A. Manufacturers: Ashcroft, Trerice, Ametek, Weiss, Wika, Weksler
- B. Thermometers shall be straight stem, metal case, red liquid-filled thermometer, approximately 175 mm (7 inches) high, 4 degrees C to 100 degrees C (40 degrees F to 212 degrees F). Thermometers shall comply with ASME B40.200.

### 2.2 AIR VENTS

- A. Manufacturers: Amtrol/Thrush, Watson, McDaniel, Bell & Gossett Model #87 (or equal).
- B. Automatic type; brass body and cover, designed to vent air automatically with a float principle without allowing air to enter the system, rated at not less than 150 psi at 240°F.
- C. Install automatic air vents at the top of all vertical piping risers and at all high points of water distribution systems including cold, hot and hot recirculation piping. All locations to have a ball valve installed upstream of the vent for maintenance purposes.

### 2.3 PRESSURE GAUGES

- A. Manufacturers: Ametek/U.S. Gauge Division, Ashcroft, Marsh, Taylor, H.O. Trerice, Weiss, Wika, Weksler.
- B. Stainless steel (304) case of not less than 4.5" in diameter, double strength glass window, black lettering on a white background, phosphor bronze bourdon tube with bronze bushings, recalibration from the front of the dial, 99% accuracy over the middle half of the scale, 98.5% accuracy over the remainder of the scale.  
(Trerice #620B-FSL-SGW-100PSI-110 with #872-2 pressure snubber #735-2 needle valve)  
Scale range as follows:

Service	Hot Water	Cold Water	Compressed Air
Scale Range, psig	0-100	0-100	0-200
Increment, psig	1	1	2

- C. Pressure Snubbers: Bronze construction, 300 psig working pressure, 1/4" size.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Direct mounted pressure gages shall be installed in piping tees with pressure gage located on pipe at the most readable position.
- B. Valves and snubbers shall be installed in piping for each pressure gage.
- C. Test plugs shall be installed on the inlet and outlet pipes of all heat exchangers or water heaters serving more than one plumbing fixture.
- D. Pressure gages shall be installed where indicated on the drawings and at the following locations:
  - 1. Building water service entrance into building.
  - 2. Suction and discharge of each domestic water pump or re-circulating hot water return pump.
- E. Thermometers shall be installed on thermostatic mixing valve outlet piping and the hot water circulation pump inlet piping.
- F. If an installation is unsatisfactory to the COR, the Contractor shall correct the installation at no cost to the Government.

### **3.2 FIELD QUALITY CONTROL**

- A. The meter assembly shall be visually inspected and operationally tested. The correct multiplier placement on the face of the meter shall be verified.

### **3.3 TRAINING**

- A. A training course shall be provided to the medical center on meter configuration and maintenance. Training manuals shall be supplied for all attendees with four additional copies supplied. The training course shall cover meter configuration, troubleshooting, and diagnostic procedures.

---END---

**SECTION 22 05 23**  
**GENERAL-DUTY VALVES FOR PLUMBING PIPING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section describes the requirements for general-duty valves for domestic water and sewer systems.
- B. A complete listing of all acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.
- C. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

**1.3 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Sanitary Engineering (ASSE):
  - 1001-2008.....Performance Requirements for Atmospheric Type Vacuum Breakers
  - 1013-2011.....Performance Requirements for Reduced Pressure Principle Backflow Preventers and Reduced Pressure Principle Fire Protection Backflow Preventers
  - 1017-2009.....Performance Requirements for Temperature Actuated Mixing Valves for Hot Water Distribution Systems
  - 1069-2005.....Performance Requirements for Automatic Temperature Control Mixing Valves
  - 1070-2004.....Performance Requirements for Water Temperature Limiting Devices
  - 1071-2012.....Performance Requirements for Temperature Actuated Mixing Valves for Plumbed Emergency Equipment
- C. American Society for Testing and Materials (ASTM):
  - A126-2004 (R2009).....Standard Specification for Gray Iron Castings for Valves, Flanges, and Pipe Fittings
  - A536-1984 (R2009).....Standard Specification for Ductile Iron Castings

- B62-2009.....Standard Specification for Composition Bronze  
or Ounce Metal Castings
- B584-2013.....Standard Specification for Copper Alloy Sand  
Castings for General Applications
- D. International Code Council (ICC):
- IPC-2012.....International Plumbing Code
- E. Manufacturers Standardization Society of the Valve and Fittings  
Industry, Inc. (MSS):
- SP-25-2008.....Standard Marking Systems for Valves, Fittings,  
Flanges and Unions
- SP-67-2011.....Butterfly Valves
- SP-70-2011.....Gray Iron Gate Valves, Flanged and Threaded  
Ends
- SP-71-2011.....Gray Iron Swing Check Valves, Flanged and  
Threaded Ends
- SP-80-2013.....Bronze Gate, Globe, Angle, and Check Valves
- SP-85-2011.....Gray Iron Globe & Angle Valves, Flanged and  
Threaded Ends
- SP-110-2010.....Ball Valves Threaded, Socket-Welding, Solder  
Joint, Grooved and Flared Ends
- F. National Environmental Balancing Bureau (NEBB):
- 7th Edition 2005                      Procedural Standards for Testing, Adjusting,  
Balancing of Environmental Systems
- G. NSF International (NSF):
- 61-2012.....Drinking Water System Components - Health  
Effects
- 372-2011.....Drinking Water System Components - Lead Content
- H. University of Southern California Foundation for Cross Connection  
Control and Hydraulic Research (USC FCCCHR):
- 9th Edition.....Manual of Cross-Connection Control

#### **1.4 SUBMITTALS**

- A. Submittals, including number of required copies, shall be submitted  
in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA,  
and SAMPLES.
- B. Information and material submitted under this section shall be marked  
"SUBMITTED UNDER SECTION 22 05 23, GENERAL-DUTY VALVES FOR PLUMBING  
PIPING", with applicable paragraph identification.

- C. Manufacturer's Literature and Data Including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.
  - 1. Ball Valves.
  - 2. Butterfly Valves.
  - 3. Balancing Valves.
  - 4. Check Valves.
  - 5. Thermostatic Mixing Valves.
- D. Test and Balance reports for balancing valves.
- E. Complete operating and maintenance manuals including wiring diagrams, technical data sheets and information for ordering replaceable parts:
  - 1. Include complete list indicating all components of the systems.
  - 2. Include complete diagrams of the internal wiring for each item of equipment.
  - 3. Diagrams shall have their terminals identified to facilitate installation, operation and maintenance.
  - 4. Piping diagrams of thermostatic mixing valves to be installed.

#### **1.5 DELIVERY, STORAGE, AND HANDLING**

- A. Valves shall be prepared for shipping as follows:
  - 1. Protect internal parts against rust and corrosion.
  - 2. Protect threads, flange faces, grooves, and weld ends.
  - 3. Set ball and plug valves open to minimize exposure of functional surfaces.
  - 4. Set butterfly valves closed or slightly open.
  - 5. Block check valves in either closed or open position.
- B. Valves shall be prepared for storage as follows:
  - 1. Maintain valve end protection.
  - 2. Store valves indoors and maintain at higher than ambient dew point temperature.

### **PART 2 - PRODUCTS**

#### **2.1 VALVES, GENERAL**

- A. Asbestos packing and gaskets are prohibited.
- B. Bronze valves shall be made with dezincification resistant materials. Bronze valves made with copper alloy (brass) containing more than 15 percent zinc shall not be permitted.

- C. Valves in insulated piping shall have 50 mm or DN50 (2 inch) stem extensions and extended handles of non-thermal conductive material that allows operating the valve without breaking the vapor seal or disturbing the insulation. Memory stops shall be fully adjustable after insulation is applied.
- D. Exposed Valves over 65 mm or DN65 (2-1/2 inches) installed at an elevation over 3.6 m (12 feet) shall have a chain-wheel attachment to valve hand-wheel, stem, or other actuator.
- E. All valves used to supply potable water shall meet the requirements of NSF 61 and NSF 372.
- F. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit <http://www.biopreferred.gov>.

## **2.2 SHUT-OFF VALVES**

- A. Cold, Hot and Re-circulating Hot Water:
  - 1. 50 mm or DN50 (2 inches) and Smaller: Ball, MSS SP-110, Ball valve shall be full port three piece or two piece with a union design with adjustable stem package, chrome plated ball. Threaded stem designs are not allowed. The ball valve shall have a SWP rating of 1035 kPa (150 psig) and a CWP rating of 4138 kPa (600 psig). The body material shall be Bronze ASTM B584, Alloy C844. The ends shall be non-lead solder. Apollo 70LF-200; equal by Milwaukee, Nibco, Watts.
  - 2. Less Than 100 mm DN100 (4 inches): Butterfly shall have an iron body with EPDM seal and aluminum bronze disc. The butterfly valve shall meet MSS SP-67, type I standard. The butterfly valve shall have a SWP rating of 1380 kPa (200 psig). The valve design shall be lug type suitable for bidirectional dead-end service at rated pressure. The body material shall meet ASTM A536, ductile iron. Milwaukee M or C Series; equal by Hammond, Nibco, Victaulic, Watts.

### **2.3 BALANCING VALVES**

- A. Hot Water Re-circulating, 75 mm or DN75 (3 inches) and smaller manual balancing valve shall be of bronze body, brass ball construction with glass and carbon filled TFE seat rings and designed for positive shutoff. The manual balancing valve shall have differential pressure readout ports across the valve seat area. The readout ports shall be fitting with internal EPT inserts and check valves. The valve body shall have 8 mm or DN8 NPT (1/4 inch NPT) tapped drain and purge port. The valves shall have memory stops that allow the valve to close for service and then reopened to setpoint without disturbing the balance position. All valves shall have calibrated nameplates to assure specific valve settings. Armstrong CBV, Bell & Gossett Circuit Setter Plus, Griswald Quickset, Illinois 6000 Series, Nexus Orturi, Nibco 1710 Series, Taco Accu-Flo, Tour & Anderson STAS/STAD.

### **2.4 CHECK VALVES**

- A. 75 mm or DN75 (3 inches) and smaller shall be Class 125, bronze swing check valves with non-metallic disc suitable for type of service. The check valve shall meet MSS SP-80 Type 4 standard. The check valve shall have a CWP rating of 1380 kPa (200 psig). The check valve shall have a Y pattern horizontal body design with bronze body material conforming to ASTM B62, solder joints, and PTFE or TFE disc. Milwaukee UP509; equal by Hammond, Nibco, Watts, Apollo.
- B. Provide accessible check valve(s) on all shower piping, janitors curb, and HWR balancing assembly.

### **2.5 DRAIN VALVES**

- A. 3/4" ball valve with integral threaded hose adapter, sweat or threaded inlet connections, with threaded cap and chain on hose threads. Watts B-6000-CC/B-6001-CC Series.

### **2.6 BACKFLOW PREVENTERS**

- A. A backflow prevention assembly shall be installed at any point in the plumbing system where the potable water supply comes in contact with a potential source of contamination. The backflow prevention assembly shall be approved by the University of Southern California Foundation for Cross Connection Control and Hydraulic Research (USCFCCC).

- B. The pipe applied or integral atmospheric vacuum breaker shall be ASSE Listed 1001. The main body shall be cast bronze. The seat disc shall be the elastomer type suited for water service. The device shall be accessible for maintenance without removing the device from the service line. The installation shall not be in a concealed or inaccessible location or where the venting of water from the device during normal operation is deemed objectionable. Atmospheric vacuum breakers shall be installed in the following applications.
1. Hose bibs and sinks with threaded outlets.
  2. Showers (telephone/handheld type).
  3. Service sinks (integral with faucet only).
- C. The hose connection vacuum breaker shall be ASSE Listed 1011. The main body shall be cast brass with stainless steel working parts. The diaphragm and disc shall be the elastomer type suited for water service. The device shall permit the attachment of portable hoses to hose thread outlets. Hose connection vacuum breakers shall be installed in the following locations requiring non-continuous pressure:
1. Hose bibbs and wall hydrants.

## **2.7 THERMOSTATIC MIXING VALVES**

- A. Thermostatic Mixing Valves shall comply with the following general performance requirements:
1. Shall meet ASSE requirements for water temperature control.
  2. The body shall be cast bronze or brass with corrosion-resistant internal parts preventing scale and biofilm build-up. Provide chrome-plated finish in exposed areas.
  3. No special tool shall be required for temperature adjustment, maintenance, replacing parts and disinfecting operations.
  4. Valve shall be able to be placed in various positions without making temperature adjustment or reading difficult.
  5. Valve finish shall be chrome plated in exposed areas.
  6. Valve shall allow easy temperature adjustments to allow hot water circulation. Internal parts shall be able to withstand disinfecting operations of chemical and thermal treatment of water temperatures up to 82°C (180°F) for 30 minutes or 50 mg/L (50 ppm) chlorine residual concentration for 24 hours.
  7. Parts shall be easily removed or replaced without dismantling the valves, for easy scale removal and disinfecting of parts.



8. Valve shall have a manual adjustable temperature control with locking mechanism to prevent tampering by end user.  
Outlet temperature shall be visible to ensure outlet temperature does not exceed specified limits, particularly after thermal eradication procedures.
9. Provide mixing valves with integral check valves with screens and stop valves.

B. Water Temperature Limiting Devices:

1. Application: Single plumbing fixture point-of-use such as sinks or lavatories.
2. Standard: ASSE 1070.
3. Pressure Rating: 861 kPa (125 psig).
4. Type: Thermostatically controlled water mixing valve set at 43 degrees C (110 degrees F).
5. Connections: Threaded union, compression or soldered inlets and outlet.
6. Upon cold water supply failure, the hot water flow shall automatically be reduced to 0.2 gpm maximum.

C. Temperature Activated Mixing Valves:

1. Application: Emergency eye/face equipment.
2. Standard: ASSE 1071.
3. Pressure Rating: 861 kPa (125 psig).
4. Type: Thermostatically controlled water mixing valve set at 24-30 degrees C (75-85 degrees F).
5. Connections: Soldered or threaded union inlets and outlet.
6. Thermometers shall be provided to indicate mixed water temperature.
7. Upon cold water supply failure, the hot water flow shall automatically be reduced to 0.5 gpm maximum.
8. Provide thermostatic mixing valves at all sink/lavatories.

## **PART 3 - EXECUTION**

### **3.1 EXAMINATION**

- A. Valve interior shall be examined for cleanliness, freedom from foreign matter, and corrosion. Special packing materials shall be removed, such as blocks, used to prevent disc movement during shipping and handling.
- B. Valves shall be operated in positions from fully open to fully closed. Guides and seats shall be examined and made accessible by such operations.

- C. Threads on valve and mating pipe shall be examined for form and cleanliness.
- D. Mating flange faces shall be examined for conditions that might cause leakage. Bolting shall be checked for proper size, length, and material. Gaskets shall be verified for proper size and that its material composition is suitable for service and free from defects and damage.
- E. Do not attempt to repair defective valves; replace with new valves.

### **3.2 INSTALLATION**

- A. Install valves with unions or flanges at each piece of equipment arranged to allow service, maintenance, and equipment removal without system shutdown.
- B. Valves shall be located for easy access and shall be provided with separate support. Valves shall be accessible with access doors when installed inside partitions or above hard ceilings.
- C. Valves shall be installed in horizontal piping with stem at or above center of pipe.
- D. Valves shall be installed in a position to allow full stem movement.
- E. Check valves shall be installed for proper direction of flow and as follows:
  - 1. Swing Check Valves: In horizontal position with hinge pin level and on top of valve.
- F. Install backflow preventers in each water supply to mechanical equipment and systems and to other equipment and water systems that may be sources of contamination. Comply with authorities having jurisdiction. Locate backflow preventers in same room as connected equipment or system.
  - 1. Install drain for backflow preventers with atmospheric-vent drain connection with air-gap fitting, fixed air-gap fitting, or equivalent positive pipe separation of at least two pipe diameters in drain piping and pipe to floor drain. Locate air-gap device attached to or under backflow preventer. Simple air breaks are not acceptable for this application.
- G. Install pressure gages on outlet of backflow preventers.
- H. Do not install bypass piping around backflow preventers.
- I. Install temperature-actuated water mixing valves with check stops or shutoff valves on inlets.
  - 1. Install thermometers if specified.
- J. If an installation is unsatisfactory to the COR, the Contractor shall correct the installation at no cost to the Government.

**3.3 LABELING AND IDENTIFYING**

- A. Equipment Nameplates and Signs: Install engraved plastic-laminate equipment nameplate or sign on or near each of the following:
  - 1. Calibrated balancing valves.
  - 2. Thermostatic, water mixing valves.
  - 3. Thermostatic, water-mixing-valve assemblies.
- B. Distinguish among multiple units, inform operator of operational requirements, indicate safety and emergency precautions, and warn of hazards and improper operations, in addition to identifying unit.

**3.4 ADJUSTING**

- A. Valve packing shall be adjusted or replaced after piping systems have been tested and put into service but before final adjusting and balancing. Valves shall be replaced if persistent leaking occurs.
- B. Set field-adjustable flow setpoints of balancing valves and record data. Ensure recorded data represents actual measured or observed conditions. Permanently mark settings of valves and other adjustment devices allowing settings to be restored. Set and lock memory stops. After adjustment, take measurements to verify balance has not been disrupted or that such disruption has been rectified.
- C. Set field-adjustable temperature setpoints of temperature-actuated water mixing valves.
- D. Testing and adjusting of balancing valves shall be performed by an independent NEBB Accredited Test and Balance Contractor. A final settings and flow report shall be submitted to the VA Contracting Officer's Representative (COR).

**3.5 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for two hours to instruct VA Personnel in operation and maintenance of the system.

---END---



**SECTION 22 07 11  
PLUMBING INSULATION**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Field applied insulation for thermal efficiency and condensation control for the following:
1. Plumbing piping and equipment.
  2. Re-insulation of plumbing piping and equipment after asbestos abatement and/or replacement of any part of existing insulation system (insulation, vapor retarder jacket, protective coverings/jacket) damaged during construction.
- B. Definitions:
1. ASJ: All Service Jacket, Kraft paper, white finish facing or jacket.
  2. Air-Conditioned Space: Space having air temperature and/or humidity controlled by mechanical equipment.
  3. All insulation systems installed within supply, return, exhaust, relief and ventilation air plenums shall be limited to uninhabited tunnel/crawl spaces, areas above a ceiling or below the floor, attic spaces, interiors of air conditioned or heating ducts, and mechanical equipment rooms shall be non-combustible or shall be listed and labeled as having a flame spread indexes of not more than 25 and a smoke-developed index of not more than 50 when tested in accordance with ASTM E84 or UL 723. Note: ICC IMC, Section 602.2.1.
  4. Cold: Equipment or piping handling media at design temperature of 15 degrees C (60 degrees F) or below.
  5. Concealed: Piping above ceilings and in chases, interstitial space, tunnels, and pipe spaces.
  6. Exposed: Piping and equipment exposed to view in finished areas including mechanical equipment rooms or exposed to outdoor weather. Shafts, chases, interstitial spaces, unfinished attics, crawl spaces and pipe basements are not considered finished areas.
  7. Hot: Plumbing equipment or piping handling media above 40 degrees C (104 degrees F).
  8. Density: kg/m<sup>3</sup> - kilograms per cubic meter (Pcf - pounds per cubic foot).

9. Thermal Conductance: Heat flow rate through materials.
  - a. Flat Surface: Watts per square meter (BTU per hour per square foot).
  - b. Pipe or Cylinder: Watts per linear meter (BTU per hour per linear foot) for a given outside diameter.
10. Thermal Conductivity (k): Watts per meter, per degree K (BTU - inch thickness, per hour, per square foot, per degree F temperature difference).
11. Vapor Retarder (Vapor Barrier): A material which retards the transmission (migration) of water vapor. Performance of the vapor retarder is rated in terms of permeance (perms). For the purpose of this specification, vapor retarders/vapor barriers shall have a maximum published permeance of 0.02 perms.
12. HWR: Hot water recirculating.
13. CW: Cold water.
14. SW: Soft water.
15. HW: Hot water.
16. PVDC: Polyvinylidene chloride vapor retarder jacketing, white.

## **1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: General mechanical requirements and items, which are common to more than one section of Division 22.
- D. Section 22 05 19, METERS AND GAGES FOR PLUMBING PIPING: Hot and cold water piping.
- E. Section 22 05 23, GENERAL-DUTY VALVES FOR PLUMBING PIPING: Hot and cold water piping.

## **1.3 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only.
- B. American Society for Testing and Materials (ASTM):
 

B209-2014.....	Standard Specification for Aluminum and
	Aluminum-Alloy Sheet and Plate
C411-2011.....	Standard Test Method for Hot-Surface
	Performance of High-Temperature Thermal
	Insulation

C449-2007 (R2013).....Standard Specification for Mineral Fiber  
Hydraulic-Setting Thermal Insulating and  
Finishing Cement

C450-2008 (R2014).....Standard Practice for Fabrication of Thermal  
Insulating Fitting Covers for NPS Piping, and  
Vessel Lagging

Adjunct to C450.....Compilation of Tables that Provide Recommended  
Dimensions for Prefab and Field Thermal  
Insulating Covers, etc.

C533-2013.....Standard Specification for Calcium Silicate  
Block and Pipe Thermal Insulation

C534/C534M-2014.....Standard Specification for Preformed Flexible  
Elastomeric Cellular Thermal Insulation in  
Sheet and Tubular Form

C547-2015.....Standard Specification for Mineral Fiber Pipe  
Insulation

C552-2014.....Standard Specification for Cellular Glass  
Thermal Insulation

C553-2013.....Standard Specification for Mineral Fiber  
Blanket Thermal Insulation for Commercial and  
Industrial Applications

C591-2013.....Standard Specification for Unfaced Preformed  
Rigid Cellular Polyisocyanurate Thermal  
Insulation

C680-2014.....Standard Practice for Estimate of the Heat Gain  
or Loss and the Surface Temperatures of  
Insulated Flat, Cylindrical, and Spherical  
Systems by Use of Computer Programs

C612-2014.....Standard Specification for Mineral Fiber Block  
and Board Thermal Insulation

C1126-2014.....Standard Specification for Faced or Unfaced  
Rigid Cellular Phenolic Thermal Insulation

C1136-2012.....Standard Specification for Flexible, Low  
Permeance Vapor Retarders for Thermal  
Insulation

C1710-2011.....Standard Guide for Installation of Flexible  
Closed Cell Preformed Insulation in Tube and  
Sheet Form

- D1668/D1668M-1997a (2014)e1 Standard Specification for Glass Fabrics  
(Woven and Treated) for Roofing and  
Waterproofing
- E84-2015a.....Standard Test Method for Surface Burning  
Characteristics of Building Materials
- E2231-2015.....Standard Practice for Specimen Preparation and  
Mounting of Pipe and Duct Insulation to Assess  
Surface Burning Characteristics
- C. Federal Specifications (Fed. Spec.):
- L-P-535E-1979.....Plastic Sheet (Sheeting): Plastic Strip; Poly  
(Vinyl Chloride) and Poly (Vinyl Chloride -  
Vinyl Acetate), Rigid.
- D. International Code Council, (ICC):
- IMC-2012.....International Mechanical Code
- E. Military Specifications (Mil. Spec.):
- MIL-A-3316C (2)-1990....Adhesives, Fire-Resistant, Thermal Insulation
- MIL-A-24179A (2)-1987...Adhesive, Flexible Unicellular-Plastic Thermal  
Insulation
- MIL-PRF-19565C (1)-1988.Coating Compounds, Thermal Insulation, Fire-and  
Water-Resistant, Vapor-Barrier
- MIL-C-20079H-1987.....Cloth, Glass; Tape, Textile Glass; and Thread,  
Glass and Wire-Reinforced Glass
- F. National Fire Protection Association (NFPA):
- 90A-2015.....Standard for the Installation of  
Air-Conditioning and Ventilating Systems
- G. Underwriters Laboratories, Inc (UL):
- 723-2008 (R2013).....Standard for Test for Surface Burning  
Characteristics of Building Materials
- 1887-2004 (R2013).....Standard for Fire Test of Plastic Sprinkler  
Pipe for Visible Flame and Smoke  
Characteristics
- H. 3E Plus® version 4.1 Insulation Thickness Computer Program: Available  
from NAIMA with free download; <http://www.pipeinsulation.net>



**1.4 SUBMITTALS**

- A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 07 11, PLUMBING INSULATION", with applicable paragraph identification.
- C. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.
- D. Shop Drawings:
  - 1. All information, clearly presented, shall be included to determine compliance with drawings and specifications and ASTM Designation, Federal and Military specifications.
    - a. Insulation Materials: Specify each type used and state surface burning characteristics.
    - b. Insulation Facings and Jackets: Each type used and state surface burning characteristics.
    - c. Insulation Accessory Materials: Each type used.
    - d. Manufacturer's installation and fitting fabrication instructions for flexible unicellular insulation shall follow the guidelines in accordance with ASTM C1710.
    - e. Make reference to applicable specification paragraph numbers for coordination.
    - f. All insulation fittings (exception flexible unicellular insulation) shall be fabricated in accordance with ASTM C450 and the referenced Adjunct to ASTM C450.
- E. Samples:
  - 1. Each Type of Insulation: Minimum size 100 mm (4 inches) square for board/block/ blanket; 150 mm (6 inches) long, full diameter for round types.
  - 2. Each Type of Facing and Jacket: Minimum size 100 mm (4 inches square).
  - 3. Each Accessory Material: Minimum 120 ml (4 ounce) liquid container or 120 gram (4 ounce) dry weight for adhesives.

## 1.5 QUALITY ASSURANCE

A. Refer to article QUALITY ASSURANCE, in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

B. Criteria:

1. Comply with NFPA 90A, particularly paragraphs 4.3.3.1 through 4.3.3.6, 4.3.11.2.6, parts of which are quoted as follows:

**4.3.3.1** Pipe and duct insulation and coverings, vapor retarder facings, adhesives, fasteners, tapes, and supplementary materials added to plenums and panels shall have, in the form in which they are used, a maximum flame spread index of 25 without evidence of continued progressive combustion and a maximum smoke developed index of 50 when tested in accordance with ASTM E84 and appropriate mounting practice, e.g. ASTM E2231.

4.3.3.3 Coverings and linings for pipes, plenums and panels including all pipe insulation materials shall not flame, glow, smolder, or smoke when tested in accordance with a similar test for pipe covering, ASTM C411, Standard Test Method for Hot-Surface Performance of High-Temperature Thermal Insulation, at the temperature to which they are exposed in service. In no case shall the test temperature be below 121 degrees C (250 degrees F).

4.3.11.2.6.3 Nonferrous fire sprinkler piping shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with UL 1887, Standard for Safety Fire Test of Plastic Sprinkler Pipe for Visible Flame and Smoke Characteristics.

4.3.11.2.6.8 Smoke detectors shall not be required to meet the provisions of Section 4.3.

2. Test Methods: ASTM E84, UL 723, and ASTM E2231.
3. Specified k factors are at 24 degrees C (75 degrees F) mean temperature unless stated otherwise. Where optional thermal insulation material is used, select thickness to provide thermal conductance no greater than that for the specified material. For pipe, use insulation manufacturer's published heat flow tables. For domestic hot water supply and return, run out insulation and condensation control insulation, no thickness adjustment need be made.

4. All materials shall be compatible and suitable for service temperature and shall not contribute to corrosion or otherwise attack surface to which applied in either the wet or dry state.
- C. Every package or standard container of insulation or accessories delivered to the job site for use shall have a manufacturer's stamp or label giving the name of the manufacturer, description of the material, and the production date or code.
- D. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit <http://www.biopREFERRED.gov>.

#### **1.6 AS-BUILT DOCUMENTATION**

- A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.
- B. Submit operation and maintenance data updated to include submittal review comments, substitutions and construction revisions shall be in electronic version on compact disc or DVD inserted into a three-ring binder. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual.  
  
The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices such as damper and door closure interlocks shall be included. A list of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.
- C. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. As-built drawings are to be provided and a copy of them in Auto-CAD version provided on compact disc or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.

- D. Certification documentation shall be provided prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and certification that all results of tests were within limits specified.

#### **1.7 STORAGE AND HANDLING OF MATERIAL**

- A. Store materials in clean and dry environment. Pipe insulation jackets shall be clean and unmarred. Place adhesives in original containers. Maintain ambient temperatures and conditions as required by printed instructions of manufacturers of adhesives, mastics and finishing cements.

### **PART 2 - PRODUCTS**

#### **2.1 MINERAL FIBER OR FIBER GLASS**

- A. ASTM C612 (Board, Block), Class 1 or 2, density 48 kg/m<sup>3</sup> (nominal 3 pcf),  $k = 0.037$  (.26) at 24 degrees C (75 degrees F), external insulation for temperatures up to 204 degrees C (400 degrees F).
- B. ASTM C547 (Pipe Fitting Insulation and Preformed Pipe Insulation), Class 1,  $k = 0.037$  (0.26) at 24 degrees C (75 degrees F), for use at temperatures up to 230 degrees C (446 degrees F) with an all service vapor retarder jacket (ASJ) and with polyvinyl chloride (PVC) premolded fitting covering.

#### **2.2 MINERAL WOOL OR REFRACTORY FIBER**

- A. Comply with Standard ASTM C612, Class 3, 450 degrees C (842 degrees F).

#### **2.3 RIGID CELLULAR PHENOLIC FOAM**

- A. Preformed (molded) pipe insulation, ASTM C1126, Type III, Grade 1,  $k = 0.021$  (0.15) at 10 degrees C (50 degrees F), for use at temperatures up to 121 degrees C (250 degrees F) with vapor retarder and all service vapor retarder jacket (ASJ) and with PVC premolded fitting covering.
- B. Equipment Insulation, ASTM C1126, Type II, Grade 1,  $k = 0.021$  (0.15) at 10 degrees C (50 degrees F), for use at temperatures up to 121 degrees C (250 degrees F) with rigid cellular phenolic insulation and covering, and all service vapor retarder jacket (ASJ).

## **2.4 CELLULAR GLASS CLOSED-CELL**

- A. Comply with Standard ASTM C552, density 120 kg/m<sup>3</sup> (7.5 pcf) nominal,  $k = 0.033$  (0.29) at 24 degrees C (75 degrees F).
- B. Pipe insulation for use at process temperatures below ambient air to 482 degrees C (900 degrees F) with or without all service vapor retarder jacket (ASJ).
- C. Pipe insulation for use at process temperatures for pipe and tube below ambient air temperatures or where condensation control is necessary are to be installed with a vapor retarder/barrier system of with or without all service vapor retarder sealed jacket (ASJ) system. Without ASJ shall require all longitudinal and circumferential joints to be vapor sealed with vapor barrier mastic.
- D. Cellular glass thermal insulation intended for use on surfaces operating at temperatures between -268 and 482 degrees C (-450 and 900 degrees F). It is possible that special fabrication or techniques for pipe insulation, or both, shall be required for application in the temperature range from 121 to 427 degrees C (250 to 800 degrees F).

## **2.5 POLYISOCYANURATE CLOSED-CELL RIGID**

- A. Preformed (fabricated) pipe insulation, ASTM C591, Type IV,  $K=0.027$ (0.19) at 24 degrees C (75 degrees F), flame spread not over 25, smoke developed not over 50, for use at temperatures up to 149 degree C (300 degree F) with factory applied PVDC or all service vapor retarder jacket with PVC premolded fitting covers.
- B. Equipment insulation, ASTM C591, Type IV,  $K=0.027$ (0.19) at 24 degrees C (75 degrees F), for use at temperatures up to 149 degrees C (300 degrees F) with PVDC or all service jacket vapor retarder jacket.

## **2.6 FLEXIBLE ELASTOMERIC CELLULAR THERMAL**

- A. ASTM C534/C534M,  $k = 0.039$  (0.27) at 24 degrees C (75 degrees F), flame spread not over 25, smoke developed not over 50, for temperatures from minus 4 degrees C (40 degrees F) to 93 degrees C (199 degrees F). Under high humidity exposures for condensation control an external vapor retarder/barrier jacket is required. Consult ASTM C1710.

## **2.7 CALCIUM SILICATE**

- A. Preformed Pipe Insulation: ASTM C533, Type I and Type II with indicator denoting asbestos-free material.
- B. Premolded Pipe Fitting Insulation: ASTM C533, Type I and Type II with indicator denoting asbestos-free material.
- C. Equipment Insulation: ASTM C533, Type I and Type II.

## D. Characteristics:

Insulation Characteristics		
ITEMS	TYPE I	TYPE II
Surface Temperature, maximum degrees C (degrees F)	649 (1200)	927 (1700)
Density (dry), Kg/m <sup>3</sup> (lb/ ft <sup>3</sup> )	240 (15)	352 (22)
Thermal conductivity: Min W/ m K (Btu in/h ft <sup>2</sup> degrees F) @ mean temperature of 93 degrees C (199 degrees F)	0.065 (0.45)	0.078 (0.540)
Surface burning characteristics: Flame spread Index, Maximum	0	0
Smoke Density index, Maximum	0	0

**2.8 INSULATION FACINGS AND JACKETS**

- A. Vapor Retarder, higher strength with low water permeance = 0.02 or less perm rating, Beach puncture 50 units for insulation facing on pipe insulation jackets. Facings and jackets shall be ASJ or PVDC Vapor Retarder jacketing.
- B. ASJ shall be white finish (kraft paper) bonded to 0.025 mm (1 mil) thick aluminum foil, fiberglass reinforced, with pressure sensitive adhesive closure. Comply with ASTM C1136. Beach puncture is 50 units, suitable for painting without sizing. Jackets shall have minimum 40 mm (1-1/2 inch) lap on longitudinal joints and minimum 75 mm (3 inch) butt strip on end joints. Butt strip material shall be same as the jacket. Lap and butt strips shall be self-sealing type with factory-applied pressure sensitive adhesive.
- C. Vapor Retarder medium strength with low water vapor permeance of 0.02 or less perm rating), Beach puncture 25 units: FSK or PVDC type for concealed ductwork and equipment.
- D. Except for flexible elastomeric cellular thermal insulation (not for high humidity exposures), field applied vapor barrier jackets shall be provided, in addition to the specified facings and jackets, on interior piping. The vapor barrier jacket shall consist of a multi-layer laminated cladding with a maximum water vapor permeance of 0.001 perms. The minimum puncture resistance shall be 35 cm-kg (30 inch-pounds) for interior locations and 92 cm-kg (80 inch-pounds) for exterior or exposed locations or where the insulation is subject to damage.

- E. Except for cellular glass thermal insulation, when all longitudinal and circumferential joints are vapor sealed with a vapor barrier mastic or caulking, vapor barrier jackets may not be provided. For aesthetic and physical abuse applications, exterior jacketing is recommended. Otherwise field applied vapor barrier jackets shall be provided, in addition to the applicable specified facings and jackets, on all exterior piping as well as on interior piping. The vapor barrier jacket shall consist of a multi-layer laminated cladding with a maximum water vapor permeance of 0.001 perms. The minimum puncture resistance shall be 35 cm-kg (30 inch-pounds) for interior locations and 92 cm-kg (80 inch-pounds) for exposed locations or where the insulation is subject to damage.
- F. Glass Cloth Jackets: Presized, minimum 0.18 kg per square meter (7.8 ounces per square yard), 2070 kPa (300 psig) bursting strength with integral vapor retarder where required or specified.
- G. Pipe Fitting Insulation Covering (Jackets): Fitting covering shall be premolded to match shape of fitting and shall be PVC conforming to Fed Spec L-P-535E, composition A, Type II Grade GU, and Type III, minimum thickness 0.7 mm (0.03 inches). Provide color matching vapor retarder pressure sensitive tape. Staples, tacks, or any other attachment that penetrates the PVC covering is not allowed on any form of a vapor barrier system in below ambient process temperature applications.

## 2.9 PIPE COVERING PROTECTION SADDLES

- A. Cold Pipe Support: Premolded pipe insulation 180 degrees (half-shells) on bottom half of pipe at supports. Material shall be cellular glass or high density Polyisocyanurate insulation of the same thickness as adjacent insulation. Density of Polyisocyanurate insulation shall be a minimum of 48 kg/m<sup>3</sup> (3.0 pcf).

Nominal Pipe Size and Accessories Material (Insert Blocks)	
Nominal Pipe Size mm (inches)	Insert Blocks mm (inches)
Up through 125 (5)	150 (6) long
150 (6)	150 (6) long
200 (8), 250 (10), 300 (12)	225 (9) long
350 (14), 400 (16)	300 (12) long
450 through 600 (18 through 24)	350 (14) long

- B. Warm or Hot Pipe Supports: Premolded pipe insulation (180 degree half-shells) on bottom half of pipe at supports. Material shall be high density Polyisocyanurate (for temperatures up to 149 degrees C (300 degrees F)), cellular glass or calcium silicate. Insulation at supports shall have same thickness as adjacent insulation. Density of Polyisocyanurate insulation shall be a minimum of 48 kg/m<sup>3</sup> (3.0 pcf).

## **2.10 ADHESIVE, MASTIC, CEMENT**

- A. Mil. Spec. MIL-A-3316, Class 1: Jacket and lap adhesive and protective finish coating for insulation.
- B. Mil. Spec. MIL-A-3316, Class 2: Adhesive for laps and for adhering insulation to metal surfaces.
- C. Mil. Spec. MIL-A-24179A, Type II Class 1: Adhesive for installing flexible unicellular insulation and for laps and general use.
- D. Mil. Spec. MIL-PRF-19565C, Type I: Protective finish for outdoor use.
- E. Mil. Spec. MIL-PRFC-19565C, Type I or Type II: Vapor barrier compound for indoor use.
- F. ASTM C449: Mineral fiber hydraulic-setting thermal insulating and finishing cement.
- G. Other: Insulation manufacturers' published recommendations.

## **2.11 MECHANICAL FASTENERS**

- A. Pins, Anchors: Welded pins, or metal or nylon anchors with galvanized steel or fiber washer, or clips. Pin diameter shall be as recommended by the insulation manufacturer.
- B. Staples: Outward clinching galvanized steel. Staples are not allowed for below ambient vapor barrier applications.
- C. Wire: 1.3 mm thick (18 gage) soft annealed galvanized or 1.9 mm (14 gage) copper clad steel or nickel copper alloy or stainless steel.
- D. Bands: 13 mm (1/2 inch) nominal width, brass, galvanized steel, aluminum or stainless steel.
- E. Tacks, rivets, screws or any other attachment device capable of penetrating the vapor retarder shall NOT be used to attach/close the any type of vapor retarder jacketing. Thumb tacks sometimes used on PVC jacketing and preformed fitting covers closures are not allowed for below ambient vapor barrier applications.

## **2.12 REINFORCEMENT AND FINISHES**

- A. Glass Fabric, Open Weave: ASTM D1668/D1668M, Type III (resin treated) and Type I (asphalt or white resin treated).
- B. Glass Fiber Fitting Tape: Mil. Spec MIL-C-20079H, Type II, Class 1.



- C. Tape for Flexible Elastomeric Cellular Insulation: As recommended by the insulation manufacturer.
- D. Hexagonal Wire Netting: 25 mm (1 inch) mesh, 0.85 mm thick (22 gage) galvanized steel.
- E. Corner Beads: 50 mm (2 inch) by 50 mm (2 inch), 0.55 mm thick (26 gage) galvanized steel; or, 25 mm (1 inch) by 25 mm (1 inch), 0.47 mm thick (28 gage) aluminum angle adhered to 50 mm (2 inch) by 50 mm (2 inch) Kraft paper.
- F. PVC Fitting Cover: Fed. Spec L-P-535E, Composition A, 11-86 Type II, Grade GU, with Form B Mineral Fiber insert, for media temperature 10 to 121 degrees C (50 to 250 degrees F). Below 10 degrees C (50 degrees F) and above 121 degrees C (250 degrees F) provide mitered pipe insulation of the same type as insulating straight pipe. Provide double layer insert. Provide vapor barrier pressure sensitive tape matching the color of the PVC jacket.

#### **2.13 FIRESTOPPING MATERIAL**

- A. Other than pipe insulation, refer to Section 07 84 00, FIRESTOPPING.

#### **2.14 FLAME AND SMOKE**

- A. Unless shown otherwise, all assembled systems shall meet flame spread 25 and smoke developed 50 rating as developed under ASTM and UL standards and specifications. See paragraph "Quality Assurance".

### **PART 3 - EXECUTION**

#### **3.1 GENERAL REQUIREMENTS**

- A. Required pressure tests of piping joints and connections shall be completed and the work approved by the Contracting Officer's Representative (COR) for application of insulation. Surface shall be clean and dry with all foreign materials such as dirt, oil, loose scale and rust removed.
- B. Except for specific exceptions or as noted, insulate all specified equipment, and piping (pipe, fittings, valves, accessories). Insulate each pipe individually. Do not use scrap pieces of insulation where a full-length section will fit.
- C. Insulation materials shall be installed with smooth and even surfaces, with jackets and facings drawn tight and smoothly cemented down and sealed at all laps. Insulation shall be continuous through all sleeves and openings, except at fire dampers and duct heaters (NFPA 90A).

- D. Vapor retarders shall be continuous and uninterrupted throughout systems with operating temperature 15 degrees C (60 degrees F) and below. Lap and seal vapor barrier over ends and exposed edges of insulation. Anchors, supports and other metal projections through insulation on cold surfaces shall be insulated and vapor sealed for a minimum length of 150 mm (6 inches).
- E. Install vapor stops with operating temperature 15 degrees C (60 degrees F) and below at all insulation terminations on either side of valves, pumps, fittings, and equipment and particularly in straight lengths every 4.6 to 6.1 meters (approx. 15 to 20 feet) of pipe insulation. The annular space between the pipe and pipe insulation of approx. 25 mm (1 inch) in length at every vapor stop shall be sealed with appropriate vapor barrier sealant. Bio-based materials shall be utilized when possible.
- F. Install insulation with bolted 1 mm thick (20 gage) galvanized steel or aluminum covers as complete units, or in sections, with all necessary supports, and split to coincide with flange/split of the equipment. Do not insulate over equipment nameplate data.
- G. Insulation on hot piping and equipment shall be terminated square at items not to be insulated, access openings and nameplates. Cover all exposed raw insulation with white sealer coating (caution about coating's maximum temperature limit) or jacket material.
- H. Protect all insulations outside of buildings with aluminum jacket using lock joint or other approved system for a continuous weathertight system. Access doors and other items requiring maintenance or access shall be removable and sealable.
- I. Plumbing work not to be insulated unless otherwise noted:
  - 1. Piping and valves of fire protection system.
  - 2. Chromium plated brass piping.
  - 3. Water piping in contact with earth.
- J. Apply insulation materials subject to the manufacturer's recommended temperature limits. Apply adhesives, mastic and coatings at the manufacturer's recommended minimum wet or dry film thickness. Bio-based materials shall be utilized when possible.
- K. Elbows, flanges and other fittings shall be insulated with the same material as is used on the pipe straights. Use of polyurethane or polyisocyanurate spray-foam to fill a PVC elbow jacket is prohibited on cold applications.

L. Firestop Pipe insulation:

1. Provide firestopping insulation at fire and smoke barriers through penetrations. Firestopping insulation shall be UL listed as defined in Section 07 84 00, FIRESTOPPING.
2. Pipe penetrations requiring fire stop insulation including, but not limited to, the following:
  - a. Pipe risers through floors
  - b. Pipe chase walls and floors
  - c. Smoke partitions
  - d. Fire partitions
  - e. Hourly rated walls

M. Provide vapor barrier systems as follows:

1. All interior piping conveying fluids.

N. Provide PVC jackets over insulation as follows:

1. Piping exposed in building, within 1829 mm (6 feet) of the floor, on piping that is not precluded in previous sections.
2. A 50 mm (2 inch) jacket overlap is required at longitudinal and circumferential joints with the overlap at the bottom.

O. Insulate all vertical and horizontal storm/clearwater piping, including basement/tunnel space. Insulate roof drain bodies - as noted in schedule.

### **3.2 INSULATION INSTALLATION**

A. Mineral Fiber Board:

1. Vapor Retarder Faced Board: Apply board on pins spaced not more than 300 mm (12 inches) on center each way, and not less than 75 mm (3 inches) from each edge of board. In addition to pins, apply insulation bonding adhesive to entire underside of horizontal metal surfaces. (Bio-based materials shall be utilized when possible.) Butt insulation edges tightly and seal all joints with laps and butt strips. After applying speed clips, cut pins off flush and apply vapor seal patches over clips.

B. Molded Mineral Fiber Pipe and Tubing Covering:

1. Fit insulation to pipe, aligning all longitudinal joints. Seal longitudinal joint laps and circumferential butt strips by rubbing hard with a nylon sealing tool to assure a positive seal. Staples may be used to assist in securing insulation except for cold piping. Seal all vapor retarder penetrations on cold piping with a generous application of vapor barrier mastic. Provide cellar glass inserts and install with metal insulation shields at outside pipe supports. Install freeze protection insulation over heating cable.

2. Contractor's Options for Fitting, Flange and Valve Insulation:

- a. Insulating and finishing cement for sizes less than 100 mm (4 inches) operating at surface temperature of 15 degrees C (60 degrees F) or more.
- b. Factory premolded, one-piece PVC covers with mineral fiber, (Form B), inserts surface temperature of above 4 degrees C (40 degrees F) to 121 degrees C (250 degrees F). Provide mitered preformed insulation of the same type as the installed straight pipe insulation for pipe temperatures below 4 degrees C (40 degrees F). Secure first layer of mineral fiber insulation with twine. Seal seam edges with vapor barrier mastic and secure with fitting tape.
- c. Factory preformed, ASTM C547 or fabricated mitered sections, joined with adhesive or (hot only) wired in place. (Bio-based materials shall be utilized when possible.) For hot piping finish with a smoothing coat of finishing cement. For cold fittings, 15 degrees C (60 degrees F) or less, vapor seal with a layer of glass fitting tape imbedded between two 2 mm (1/16 inch) coats of vapor barrier mastic.
- d. Fitting tape shall extend over the adjacent pipe insulation and overlap on itself at least 50 mm (2 inches).

3. Nominal thickness in millimeters and inches specified in the schedule at the end of this section.

C. Rigid Cellular Phenolic Foam:

1. Rigid closed cell phenolic insulation may be provided, exterior only, for piping, ductwork and equipment for temperatures up to 121 degrees C (250 degrees F).
2. Note the ASTM E84 or UL 723 surface burning characteristics requirements of maximum 25/50 indexes in paragraph "Quality Assurance".
3. Provide secure attachment facilities such as welding pins.
4. Apply insulation with joints tightly drawn together.
5. Apply adhesives, coverings, neatly finished at fittings, and valves.
6. Final installation shall be smooth, tight, neatly finished at all edges.
7. Minimum thickness in millimeters (inches) specified in the schedule at the end of this section.

8. Condensation Control Insulation: Minimum 25 mm (1 inch) thick for all pipe sizes depending on high humidity exposures.

- a. Body of roof and overflow drains horizontal and vertical runs and offsets (including elbows) of interior storm/clearwater piping in all areas including the basement and tunnel spaces.
- b. Waste piping from electric water coolers and icemakers to drainage system.
- c. Waste piping located above basement floor from ice making equipment, from equipment (including trap) to main vertical waste pipe.

D. Cellular Glass Insulation:

- 1. Pipe and tubing, covering nominal thickness in millimeters and inches as specified in the schedule at the end of this section.
- 2. Underground piping other than or in lieu of that specified in Section 22 11 00, FACILITY WATER DISTRIBUTION: Type II, factory jacketed with a 3 mm laminate jacketing consisting of 3000 mm x 3000 mm (10 ft x 10 ft) asphalt impregnated glass fabric, bituminous mastic and outside protective plastic film.
  - a. 75 mm (3 inches) thick for hot water piping.
  - b. Underground Piping: Apply insulation with joints tightly butted. Seal longitudinal self-sealing lap. Use field fabricated or factory made fittings. Seal butt joints and fitting with jacketing as recommended by the insulation manufacturer. Use 100 mm (4 inch) wide strips to seal butt joints.
  - c. Provide expansion chambers for pipe loops, anchors and wall penetrations as recommended by the insulation manufacturer.
  - d. Underground insulation shall be inspected and approved by the COR as follows:
    - 1) Insulation in place before coating.
    - 2) After coating.
  - e. Sand Bed and Backfill: Minimum 75 mm (3 inches) all around insulated pipe or tank, applied after coating has dried.
  - f. All piping up to 482 degrees C (900 degrees F) requiring protection from physical heavy contact/abuse including in mechanical rooms and exposures to the public.
- 3. Cold Equipment: 50 mm (2 inch) thick insulation faced with ASJ.

E. Polyisocyanurate Closed-Cell Rigid Insulation:

1. Polyisocyanurate closed-cell rigid insulation (PIR) may be provided for exterior piping and equipment for temperature up to 149 degree C (300 degree F).
2. Install insulation, vapor retarder and jacketing per manufacturer's recommendations. Particular attention should be paid to recommendations for joint staggering, adhesive application, external hanger design, expansion/contraction joint design and spacing and vapor retarder integrity.
3. Install insulation with all joints tightly butted (except expansion joints in hot applications). Provide insulation contractions joints for very cold process temperatures.
4. If insulation thickness exceeds 65 mm (2-1/2 inches), install as a double layer system with longitudinal (lap) and butt joint staggering as recommended by manufacturer.
5. For cold applications, vapor retarder shall be installed in a continuous manner. No staples, rivets, screws or any other attachment device capable of penetrating the vapor retarder shall be used to attach the vapor retarder or jacketing. No wire ties capable of penetrating the vapor retarder shall be used to hold the insulation in place. Stainless steel banding shall be used for cold applications to attach PVC or metal jacketing.
6. Elbows, flanges and other fittings shall be insulated with the same material as is used on the pipe straights. The elbow/ fitting insulation shall be field-fabricated, mitered or factory prefabricated to the necessary size and shape to fit on the elbow/fitting. Use of polyurethane or polyisocyanurate spray-foam to fill PVC elbow jacket is prohibited on cold applications.
7. For cold applications, the vapor retarder on elbows/fittings shall be either mastic-fabric-mastic or 2 mil thick PVDC vapor retarder adhesive tape. Bio-based materials shall be utilized when possible.
8. All PVC jacketing shall be installed so as to naturally shed water. Joints shall point down and shall be sealed with either adhesive or caulking (except for periodic slip joints). Bio-based materials shall be utilized when possible.

9. Note the NFPA 90A burning characteristic requirements of 25/50 in paragraph "Quality Assurance". Refer to paragraph "General Requirements" for items not to be insulated.
10. Minimum thickness in millimeter (inches) specified in the schedule at the end of this section.

**F. Flexible Elastomeric Cellular Thermal Insulation:**

1. Apply insulation and fabricate fittings in accordance with the manufacturer's installation instructions and finish with two coats of weather resistant finish as recommended by the insulation manufacturer. External vapor barrier jacketing may be required for expected or anticipated high humidity exposures. See ASTM C1710.
2. Pipe and Tubing Insulation:
  - a. Use proper size material. Do not stretch or strain insulation.
  - b. To avoid undue compression of insulation, use supports as recommended by the elastomeric insulation manufacturer. Insulation shields are specified under Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
  - c. Where possible, slip insulation over the pipe or tubing prior to connection, and seal the butt joints with adhesive. Where the slip-on technique is not possible, slit the insulation and apply it to the pipe sealing the seam and joints with contact adhesive. Optional tape sealing, as recommended by the manufacturer, may be employed. Bio-based materials shall be utilized when possible.
3. Apply sheet insulation to flat or large curved surfaces with 100 percent adhesive coverage. For fittings and large pipe, apply adhesive to seams only.
4. Pipe Insulation: Nominal thickness in millimeters (inches as specified in the schedule at the end of this section).

**G. Calcium Silicate:**

1. Minimum thickness in millimeter (inches) specified below for piping:

<b>Nominal Thickness Of Calcium Silicate Insulation (Non-Boiler Plant)</b>				
Nominal Pipe Size Millimeters (Inches)	Thru 25 (1)	32 to 75 (1-1/4 to 3)	100-200 (4 to 8)	Greater than 200 (8)
93-260 degrees C (199-500 degrees F) (HPS, HPR)	100 (4)	125 (5)	150 (6)	Greater than 150 (6)

### 3.3 PIPE INSULATION SCHEDULE

A. Provide insulation for piping systems as scheduled below:

Insulation Thickness Millimeters (Inches)					
		Nominal Pipe Size Millimeters (Inches)			
Operating Temperature Range/Service	Insulation Material	Less than 25 (1)	25 - 32 (1 - 1¼)	38 - 75 (1½ - 3)	100 (4) and Greater
38-60 degrees C (100-140 degrees F) (Domestic Hot Water Supply and Return)	Mineral Fiber (Above ground piping only)	38 (1.5)	38 (1.5)	50 (2.0)	50 (2.0)
38-60 degrees C (100-140 degrees F) (Domestic Hot Water Supply and Return)	Rigid Cellular Phenolic Foam (Above ground piping only) (Exterior locations only)	38 (1.5)	38 (1.5)	50 (2.0)	50 (2.0)
38-60 degrees C (100-140 degrees F) (Domestic Hot Water Supply and Return)	Polyiso-cyanurate Closed-Cell Rigid (Exterior locations only)	38 (1.5)	38 (1.5)	50 (2.0)	50 (2.0)
38-60 degrees C (100-140 degrees F) (Domestic Hot Water Supply and Return)	Flexible Elastomeric Cellular Thermal (Above ground piping only)	38 (1.5)	38 (1.5)	50 (2.0)	50 (2.0)
38-60 degrees C (100-140 degrees F) (Domestic Hot Water Supply and Return)	Cellular Glass Thermal	38 (1.5)	38 (1.5)	50 (2.0)	50 (2.0)
4-15 degrees C (40-60 degrees F) (Ice Water Piping)	Rigid Cellular Phenolic Foam (Above ground piping only) (Exterior locations only)	25 (1.0)	25 (1.0)	25 (1.0)	25 (1.0)
4-15 degrees C (40-60 degrees F) (Ice Water Piping)	Polyiso-cyanurate Closed-Cell Rigid (Exterior locations only)	25 (1.0)	25 (1.0)	25 (1.0)	25 (1.0)



Insulation Thickness Millimeters (Inches)					
		Nominal Pipe Size Millimeters (Inches)			
Operating Temperature Range/Service	Insulation Material	Less than 25 (1)	25 - 32 (1 - 1¼)	38 - 75 (1½ - 3)	100 (4) and Greater
4-15 degrees C (40-60 degrees F) (Ice Water Piping)	Flexible Elastomeric Cellular Thermal (Above ground piping only)	25 (1.0)	25 (1.0)	25 (1.0)	25 (1.0)
4-15 degrees C (40-60 degrees F) (Ice Water Piping)	Cellular Glass Thermal	38 (1.5)	38 (1.5)	38 (1.5)	38 (1.5)

Service	Type	1" and smaller	1-1/4" to 2"	2-1/2" to 4"	5"-6"
All Horizontal and Vertical Storm Piping (including Basement, Tunnel)	Rigid Fiberglass	1"	1"	1"	1"
Roof Drain Bodies	Elastomeric	0.5"	0.5"	0.5"	0.5"
Clearwater Waste	Rigid Fiberglass	0.5"	0.5"	0.5"	0.5"
Water Piping in Base Cabinet, Shower Valve (Hot, Cold, Tepid)	Elastomeric	0.5"	0.5"	0.5"	0.5"

---END---



**SECTION 22 11 00**  
**FACILITY WATER DISTRIBUTION**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Domestic water systems, including piping, equipment and all necessary accessories as designated in this section.
- B. A complete listing of all acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 07 84 00, FIRESTOPPING.
- D. Section 07 92 00, JOINT SEALANTS.
- E. Section 09 91 00, PAINTING.
- F. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- G. Section 22 07 11, PLUMBING INSULATION.

**1.3 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):
  - A13.1-2007 (R2013).....Scheme for Identification of Piping Systems
  - B16.3-2011.....Malleable Iron Threaded Fittings: Classes 150 and 300
  - B16.9-2012.....Factory-Made Wrought Buttwelding Fittings
  - B16.11-2011.....Forged Fittings, Socket-Welding and Threaded
  - B16.12-2009 (R2014).....Cast Iron Threaded Drainage Fittings
  - B16.15-2013 .....Cast Copper Alloy Threaded Fittings: Classes 125 and 250
  - B16.18-2012.....Cast Copper Alloy Solder Joint Pressure Fittings
  - B16.22-2013.....Wrought Copper and Copper Alloy Solder-Joint Pressure Fittings
  - B16.24-2011.....Cast Copper Alloy Pipe Flanges and Flanged Fittings: Classes 150, 300, 600, 900, 1500, and 2500

## C. American Society of Sanitary Engineers (ASSE):

1010-2004.....Performance Requirements for Water Hammer  
Arresters

## D. American Society for Testing and Materials (ASTM):

A47/A47M-1999 (R2014)...Standard Specification for Ferritic Malleable  
Iron Castings

A183-2014.....Standard Specification for Carbon Steel Track  
Bolts and Nuts

A536-1984 (R2014).....Standard Specification for Ductile Iron  
Castings

A733-2013.....Standard Specification for Welded and Seamless  
Carbon Steel and Austenitic Stainless Steel  
Pipe Nipples

B32-2008 (R2014).....Standard Specification for Solder Metal

B43-2014.....Standard Specification for Seamless Red Brass  
Pipe, Standard Sizes

B62-2009.....Standard Specification for Composition Bronze  
or Ounce Metal Castings

B75/B75M-2011.....Standard Specification for Seamless Copper Tube

B88-2014.....Standard Specification for Seamless Copper  
Water Tube

B584-2014.....Standard Specification for Copper Alloy Sand  
Castings for General Applications

B687-1999 (R2011).....Standard Specification for Brass, Copper, and  
Chromium-Plated Pipe Nipples

## E. American Water Works Association (AWWA):

C110-2012.....Ductile-Iron and Gray-Iron Fittings

C151-2009.....Ductile Iron Pipe, Centrifugally Cast

C153-2011.....Ductile-Iron Compact Fitting

C651-2014.....Disinfecting Water Mains

## F. American Welding Society (AWS):

A5.8M/A5.8-2011-AMD1....Specification for Filler Metals for Brazing and  
Braze Welding

## G. International Code Council (ICC):

IPC-2012.....International Plumbing Code

## H. Manufacturers Specification Society (MSS):

SP-58-2009.....Pipe Hangers and Supports - Materials, Design,  
 Manufacture, Selection, Application, and  
 Installation

SP-72-2010a.....Ball Valves with Flanged or Butt-Welding Ends  
 for General Service

SP-110-2010.....Ball Valves Threaded, Socket-Welding, Solder  
 Joint, Grooved and Flared Ends

## I. NSF International (NSF):

61-2014a.....Drinking Water System Components - Health  
 Effects

372-2011.....Drinking Water System Components - Lead Content

## J. Plumbing and Drainage Institute (PDI):

PDI-WH 201-2010.....Water Hammer Arrestors

## K. Michigan Plumbing Code

**1.4 SUBMITTALS**

A. Submittals, including number of required copies, shall be submitted  
 in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA,  
 AND SAMPLES.

B. Information and material submitted under this section shall be marked  
 "SUBMITTED UNDER SECTION 22 11 00, FACILITY WATER DISTRIBUTIONS",  
 with applicable paragraph identification.

C. Manufacturer's Literature and Data including: Full item description  
 and optional features and accessories. Include dimensions, weights,  
 materials, applications, standard compliance, model numbers, size,  
 and capacity.

1. All items listed in Part 2 - Products.

D. Complete operating and maintenance manuals including wiring diagrams,  
 technical data sheets and information for ordering replacement parts:

1. Include complete list indicating all components of the systems.

2. Include complete diagrams of the internal wiring for each item  
 of equipment.

3. Diagrams shall have their terminals identified to facilitate  
 installation, operation and maintenance.

### 1.5 QUALITY ASSURANCE

- A. A certificate shall be submitted prior to welding of steel piping showing the Welder's certification. The certificate shall be current and no more than one year old. Welder's qualifications shall be in accordance with ASME BPVC Section IX.
- B. All grooved joint couplings, fittings, valves, and specialties shall be the products of a single manufacturer. Grooving tools shall be by the same manufacturer as the groove components.
- C. All pipe, couplings, fittings, and specialties shall bear the identification of the manufacturer and any markings required by the applicable referenced standards.
- D. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit <http://www.biopREFERRED.gov>.

### 1.6 AS-BUILT DOCUMENTATION

- A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.
- B. Submit operation and maintenance data updated to include submittal review comments, substitutions and construction revisions shall be in electronic version on compact disc or DVD inserted into a three-ring binder. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual.  
The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices shall be included. A list of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.

- C. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. As-built drawings are to be provided, and a copy of them in Auto-CAD version 2017 provided on compact disk or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.
- D. Certification documentation shall be provided to COR 10 working days prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and certificate if applicable that all results of tests were within limits specified. If a certificate is not available, all documentation shall be on the Certifier's letterhead.

## **PART 2 - PRODUCTS**

### **2.1 MATERIALS**

- A. Material or equipment containing a weighted average of greater than 0.25 percent lead are prohibited in any potable water system intended for human consumption and shall be certified in accordance with NSF 61 or NSF 372. Endpoint devices used to dispense water for drinking shall meet the requirements of NSF 61, Section 9.

### **2.2 ABOVE GROUND (INTERIOR) WATER PIPING**

- A. Pipe: Copper tube, ASTM B88, Type K or L, drawn.
- B. Fittings for Copper Tube:
  - 1. Wrought copper or bronze castings conforming to ASME B16.18 and B16.22. Unions shall be bronze, MSS SP-72, MSS SP-110, solder or braze joints. Use 95/5 tin and antimony for all soldered joints.
  - 2. Grooved fittings, 50 to 150 mm (2 to 6 inch) wrought copper ASTM B75/B75M C12200, 125 to 150 mm (5 to 6 inch) bronze casting ASTM B584, C84400. Mechanical grooved couplings, 2070 kpa (300 psig) minimum ductile iron, ASTM A536 Grade 448-310-12 (Grade 65-45-12), or malleable iron, ASTM A47/A47M Grade 22410 (Grade 32510) housing, with EPDM gasket, steel track head bolts, ASTM A183, coated with copper colored alkyd enamel.
  - 3. Flanged fittings, bronze, class 150, solder-joint ends conforming to ASME B16.24.
  - 4. Pulled tees, pro-press or hole cut connection(s) are not allowed.

- C. Adapters: Provide adapters for joining pipe or tubing with dissimilar end connections.
- D. Solder: ASTM B32 alloy type Sb5, HA or HB. Provide non-corrosive flux.
- E. Brazing Alloy: AWS A5.8M/A5.8, brazing filler metals shall be BCuP series for copper to copper joints and BAg series for copper to steel joints.

### **2.3 EXPOSED WATER PIPING**

- A. Finished Room: Use full iron pipe size chrome plated brass piping for exposed water piping connecting fixtures, casework, cabinets, equipment and when not concealed by apron including those furnished by the Government or specified in other sections.
  - 1. Pipe: ASTM B43, standard weight.
  - 2. Fittings: ASME B16.15 cast bronze threaded fittings with chrome finish.
  - 3. Nipples: ASTM B687, Chromium-plated.
  - 4. Unions: MSS SP-72, MSS SP-110, brass or bronze with chrome finish. Unions 65 mm (2-1/2 inches) and larger shall be flange type with approved gaskets.
- B. Unfinished Rooms, Mechanical Rooms and Kitchens: Chrome-plated brass piping is not required. Paint piping systems as specified in Section 09 91 00, PAINTING.

### **2.4 DIELECTRIC FITTINGS**

- A. Provide dielectric couplings or unions between pipe of dissimilar metals.

### **2.5 WATER HAMMER ARRESTER**

- A. Closed copper tube chamber with permanently sealed 413 kPa (60 psig) air charge above a Double O-ring piston. Two high heat Buna-N O-rings pressure packed and lubricated with FDA approved silicone compound. All units shall be designed in accordance with ASSE 1010. Access panel shall be provided where devices are concealed within partitions or above plaster ceilings. Size and install in accordance with PDI-WH 201 requirements. Provide water hammer arrestors at:
  - 1. All solenoid valves.
  - 2. All groups of one or more flush valves.
  - 3. All quick opening or closing valves.



**PART 3 - EXECUTION**

- \* **New water connection(s) to existing piping work to be done during night/premium hours. Coordinate all shutdowns with the Owner.**

**Provide isolation valve(s) to minimize downtime.**

**3.1 INSTALLATION**

A. General: Comply with the International Plumbing Code, Michigan Plumbing Code, and the following:

1. Install branch piping for water from the piping system and connect to all fixtures, valves, cocks, outlets, casework, cabinets and equipment, including those furnished by the Government or specified in other sections.
2. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe shall be reamed to remove burrs and a clean smooth finish restored to full pipe inside diameter.
3. All pipe runs shall be laid out to avoid interference with other work/trades.
4. Install union and shut-off valve on pressure piping at connections to equipment.
5. Pipe Hangers, Supports and Accessories:
  - a. All piping shall be supported per the IPC, MSS SP-58, and SMACNA as required.
  - b. Shop Painting and Plating: Hangers, supports, rods, inserts and accessories used for pipe supports shall be shop coated with zinc chromate primer paint. Electroplated copper hanger rods, hangers and accessories may be used with copper tubing.
  - c. Floor, Wall and Ceiling Plates, Supports, Hangers:
    - 1) Solid or split un-plated cast iron.
    - 2) All plates shall be provided with set screws.
    - 3) Pipe Hangers: Height adjustable clevis type.
    - 4) Adjustable Floor Rests and Base Flanges: Steel.
    - 5) Concrete Inserts: "Universal" or continuous slotted type.
    - 6) Hanger Rods: Mild, low carbon steel, fully threaded or Threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
    - 7) Pipe Hangers and Riser Clamps: Malleable iron or carbon steel. Pipe Hangers and riser clamps shall have a copper finish when supporting bare copper pipe or tubing.
    - 8) Rollers: Cast iron.

- 9) Self-drilling type expansion shields shall be "Phillips" type, with case hardened steel expander plugs.
  - 10) Hangers and supports utilized with insulated pipe and tubing shall have 180 degree (minimum) metal protection shield centered on and welded to the hanger and support. The shield thickness and length shall be engineered and sized for distribution of loads to preclude crushing of insulation without breaking the vapor barrier. The shield shall be sized for the insulation and have flared edges to protect vapor-retardant jacket facing. To prevent the shield from sliding out of the clevis hanger during pipe movement, center-ribbed shields shall be used.
  - 11) Hangers, supports, hanger rods to be stainless steel or aluminum in the Basement and Tunnel areas.
  - 12) With the installation of each flexible expansion joint, provide piping restraints for the upstream and downstream section of the piping at the flexible expansion joint. Provide calculations supporting the restraint length design and type of selected restraints. Restraint calculations shall be based on the criteria from the manufacturer regarding their restraint design.
6. Install chrome plated cast brass escutcheon with set screw at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
7. Penetrations:
- a. Firestopping: Where pipes pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke, and gases as specified in Section 07 84 00, FIRESTOPPING. Completely fill and seal clearances between raceways and openings with the firestopping materials.
  - b. Waterproofing: At floor penetrations, completely seal clearances around the pipe and make watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS. Bio-based materials shall be utilized when possible.
  - c. Acoustical Sealant: Where pipes pass through sound rated walls, seal around the pipe penetration with an acoustical sealant that is compliant with ASTM C919.

- B. Domestic Water piping shall conform to the following:
1. Grade all lines to facilitate drainage. Provide drain valves at bottom of risers and all low points in system. Design domestic hot water circulating lines with no traps.
  2. Connect branch lines at bottom of main serving fixtures below and pitch down so that main may be drained through fixture. Connect branch lines to top of main serving only fixtures located on floor above.

### **3.2 TESTS**

- A. General: Test system either in its entirety or in sections. Submit testing plan to COR 10 working days prior to test date.
- B. Potable Water System: Test after installation of piping and domestic water heaters but before piping is concealed, before covering is applied, and before plumbing fixtures are connected. Fill systems with water and maintain hydrostatic pressure of 1035 kPa (150 psig) gage for two hours. No decrease in pressure is allowed. Provide a pressure gage with a shutoff and bleeder valve at the highest point of the piping being tested. Pressure gauge shall have 1 psig increments.

### **3.3 STERILIZATION**

- A. After tests have been successfully completed, thoroughly flush and sterilize the interior domestic water distribution system in accordance with AWWA C651.
- B. Use liquid chlorine or hypochlorite for sterilization.

### **3.4 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for two hours to instruct VA Personnel in operation and maintenance of the system.

---END---



**SECTION 22 13 00  
FACILITY SANITARY AND VENT PIPING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section pertains to sanitary sewer and vent systems, including piping, equipment and all necessary accessories as designated in this section.
- B. A complete listing of all acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 07 84 00, FIRESTOPPING: Penetrations in rated enclosures.
- D. Section 07 92 00, JOINT SEALANTS: Sealant products.
- E. Section 09 91 00, PAINTING: Preparation and finish painting and identification of piping systems.
- F. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: Pipe Hangers and Supports, Materials Identification.
- G. Section 22 07 11, PLUMBING INSULATION.
- H. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS
- I. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS

**1.3 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):
  - A13.1-2007.....Scheme for the Identification of Piping Systems
  - A112.36.2M-1991(R 2012).Cleanouts
  - A112.6.3-2001 (R2007)...Standard for Floor and Trench Drains
  - B1.20.1-2013.....Pipe Threads, General Purpose (Inch)
  - B16.1-2010.....Gray Iron Pipe Flanges and Flanged Fittings
  - B16.4-2011.....Standard for Grey Iron Threaded Fittings
    - Classes 125 and 250
  - B16.21-2011.....Nonmetallic Flat Gaskets for Pipe Flanges
  - B16.39-2009.....Malleable Iron Threaded Pipe Unions Classes
    - 150, 250, and 300

- B18.2.1-2012.....Square, Hex, Heavy Hex, and Askew Head Bolts  
and Hex, Heavy Hex, Hex Flange, Lobed Head, and  
Lag Screws (Inch Series)
- C. American Society of Sanitary Engineers (ASSE):
- 1001-2008.....Performance Requirements for Atmospheric Type  
Vacuum Breakers
- 1079-2012.....Performance Requirements for Dielectric Pipe  
Unions
- D. American Society for Testing and Materials (ASTM):
- B828-2002 (R 2010).....Standard Practice for Making Capillary Joints  
by Soldering of Copper and Copper Alloy Tube  
and Fittings
- E. Cast Iron Soil Pipe Institute (CISPI):
- 2006.....Cast Iron Soil Pipe and Fittings Handbook
- 301-2012.....Standard Specification for Hubless Cast Iron  
Soil Pipe and Fittings for Sanitary and Storm  
Drain, Waste, and Vent Piping Applications
- 310-2012.....Specification for Coupling for Use in  
Connection With Hubless Cast Iron Soil Pipe and  
Fittings for Sanitary and Storm Drain, Waste,  
and Vent Piping Applications
- F. International Code Council (ICC):
- IPC-2012.....International Plumbing Code
- G. Manufacturers Standardization Society (MSS):
- SP-123-2013.....Non-Ferrous Threaded and Solder-Joint Unions  
for Use With Copper Water Tube
- H. National Fire Protection Association (NFPA):
- 70-2014.....National Electrical Code (NEC)
- I. Plumbing and Drainage Institute (PDI):
- WH-201 (R 2010).....Water Hammer Arrestors Standard
- J. Underwriters' Laboratories, Inc. (UL):
- 508-99 (R2013).....Standard for Industrial Control Equipment

#### **1.4 SUBMITTALS**

- A. Submittals, including number of required copies, shall be submitted  
in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA,  
and SAMPLES.

- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 13 00, FACILITY SANITARY AND VENT PIPING", with applicable paragraph identification.
- C. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.
  - 1. Piping.
  - 2. Floor Drains.
  - 3. Cleanouts.
  - 4. Trap Seal Protection.
  - 5. Penetration Sleeves.
  - 6. Pipe Fittings.
  - 7. Traps.
  - 8. Exposed Piping and Fittings.
- D. Detailed shop drawing of clamping device and extensions when required in connection with the waterproofing membrane or the floor drain.

#### **1.5 QUALITY ASSURANCE**

- A. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit <http://www.biopreferred.gov>.

#### **1.6 AS-BUILT DOCUMENTATION**

- A. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. As-built drawings are to be provided and a copy of them on Auto-Cad version 2017 provided on compact disk or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.
- B. Certification documentation shall be provided prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and a certification that all results of tests were within limits specified.

**PART 2 - PRODUCTS****2.1 SANITARY WASTE, DRAIN, AND VENT PIPING****A. Cast Iron Waste, Drain, and Vent Pipe and Fittings:**

1. Cast iron waste, drain, and vent pipe and fittings shall be used for the following applications:
  - a. Pipe buried in or in contact with earth.
  - b. Sanitary pipe extensions to a distance of approximately 1500 mm (5 feet) outside of the building.
  - c. Interior waste and vent piping above grade.
2. Cast iron pipe shall be bell and spigot or hubless (plain end or no-hub or hubless).
3. The material for all pipe and fittings shall be cast iron soil pipe and fittings and shall conform to the requirements of CISPI 301, ASTM A888, or ASTM A74.
4. Cast iron pipe and fittings shall be made from a minimum of 95 percent post-consumer recycled material.
5. Joints for hubless pipe and fittings shall conform to the manufacturer's installation instructions. Couplings for hubless joints shall conform to CISPI 310. Joints for hub and spigot pipe shall be installed with compression gaskets conforming to the requirements of ASTM C564.

**2.2 EXPOSED WASTE PIPING**

- A. Chrome plated brass piping of full iron pipe size shall be used in finished rooms for exposed waste piping connecting fixtures, casework, and cabinets when not concealed by apron including those furnished by the Owner or specified in other sections.
  1. The Pipe shall meet ASTM B43, regular weight.
  2. The Fittings shall conform to ASME B16.15 and ASTM D2665.
  3. Nipples shall conform to ASTM B687, Chromium-plated.
  4. Unions shall be brass or bronze with chrome finish. Unions 65 mm (2-1/2 inches) and larger shall be flange type with approved gaskets.
- B. In unfinished rooms such as mechanical rooms and kitchens, chrome-plated brass piping is not required. The pipe materials specified under the paragraph "Sanitary Waste, Drain, and Vent Piping" can be used. The sanitary pipe in unfinished rooms shall be painted as specified in Section 09 91 00, PAINTING.



### 2.3 SPECIALTY PIPE FITTINGS

- A. Transition pipe couplings shall join piping with small differences in outside diameters or different materials. End connections shall be of the same size and compatible with the pipes being joined. The transition coupling shall be elastomeric, sleeve type reducing or transition pattern and include shear and corrosion resistant metal, tension band and tightening mechanism on each end. The transition coupling sleeve coupling shall be of the following material:
1. For PVC soil pipes, the sleeve material shall be elastomeric seal or PVC, conforming to ASTM F477 or ASTM D5926.
  2. For dissimilar pipes, the sleeve material shall be PVC conforming to ASTM D5926 or other material compatible with the pipe materials being joined.
- B. The dielectric fittings shall conform to ASSE 1079 with a pressure rating of 861 kPa (125 psig) at a minimum temperature of 82 degrees C (180 degrees F). The end connection shall be solder joint copper alloy and threaded ferrous.
- C. Dielectric flange insulating kits shall be of non-conducting materials for field assembly of companion flanges with a pressure rating of 1035 kPa (150 psig). The gasket shall be neoprene or phenolic. The bolt sleeves shall be phenolic or polyethylene. The washers shall be phenolic with steel backing washers.
- D. The di-electric nipples shall be electroplated steel nipple complying with ASTM F1545 with a pressure rating of 2070 kPa (300 psig) at 107 degrees C (225 degrees F). The end connection shall be male threaded. The lining shall be inert and noncorrosive propylene.

### 2.4 CLEANOUTS

- A. Cleanouts shall be the same size as the pipe, up to 100 mm (4 inches); and not less than 100 mm (4 inches) for larger pipe. Cleanouts shall be easily accessible and shall be gastight and watertight. Minimum clearance of 600 mm (24 inches) shall be provided for clearing a clogged sanitary line.

- B. Floor cleanouts shall be gray iron housing with clamping device and round, secured, scoriated, gray iron cover conforming to ASME A112.36.2M. A gray iron ferrule with hubless, socket, inside calk or spigot connection and counter sunk, taper-thread, brass or bronze closure plug shall be included. The frame and cover material and finish shall be nickel-bronze copper alloy with a square shape. The cleanout shall be vertically adjustable for a minimum of 50 mm (2 inches). When a waterproof membrane is used in the floor system, clamping collars shall be provided on the cleanouts. Cleanouts shall consist of wye fittings and eighth bends with brass or bronze screw plugs. Cleanouts in the resilient tile floors, quarry tile and ceramic tile floors shall be provided with square top covers recessed for tile insertion. In the carpeted areas, carpet cleanout markers shall be provided. The loading classification for cleanouts in sidewalk areas or subject to vehicular traffic shall be heavy duty type. Cleanouts to be Zurn ZN-1400 Series or equal by J.R. Smith, Wade, Josam.
- C. Cleanouts shall be provided at or near the base of the vertical stacks with the cleanout plug located approximately 300 mm (12 inches) above the floor. If there are no fixtures installed on the lowest floor, the cleanout shall be installed at the base of the stack. The cleanouts shall be extended to the wall access cover. Cleanout shall consist of sanitary tees. Nickel-bronze square frame and stainless steel cover with minimum opening of 150 by 150 mm (6 by 6 inches) shall be furnished at each wall cleanout. Where the piping is concealed, a fixture trap or a fixture with integral trap, readily removable without disturbing concealed pipe, shall be accepted as a cleanout equivalent providing the opening to be used as a cleanout opening is the size required.
- D. In horizontal runs above grade, cleanouts shall consist of cast brass tapered screw plug in fitting or caulked/hubless cast iron ferrule. Plain end (hubless) piping in interstitial space or above ceiling may use plain end (hubless) blind plug and clamp.

## 2.5 FLOOR DRAINS

- A. General Data: floor drain shall comply with ASME A112.6.3. A caulking flange, inside gasket, or hubless connection shall be provided for connection to cast iron pipe, screwed or no hub outlets for connection to steel pipe. The drain connection shall be bottom outlet. A membrane clamp and extensions shall be provided, if required, where installed in connection with waterproof membrane. Puncturing membrane other than for drain opening will not be permitted. Double drainage pattern floor drains shall have integral seepage pan for embedding into floor construction, and weep holes to provide adequate drainage from pan to drain pipe. For drains not installed in connection with a waterproof membrane, a .45 kg (16-ounce) soft copper 1.1 to 1.8 Kg (2.5 to 4 lbs.) flashing membrane, 600 mm (24 inches) square or another approved waterproof membrane shall be provided. Floors will be pitched to floor drain(s) and FD strainer rim set lower than floor.
- B. Type A (FD-1/SD-1) medium duty (non-traffic) floor drain shall comply with ASME A112.6.3. The Type A floor drain shall have a cast iron body with flange for membrane type flooring, integral reversible clamping device, seepage openings and 175 mm (7 inch) diameter or square satin nickel bronze or satin bronze strainer with 100 mm (4 inch) flange for toilet rooms and showers. Provide in-line trap guard in FD-1, SD-1

## 2.6 TRAPS

- A. Traps shall be provided on all sanitary branch waste connections from fixtures or equipment not provided with traps. Exposed brass shall be polished brass chromium plated with nipple and set screw escutcheons. Concealed traps may be rough cast brass or same material as the piping they are connected to. Slip joints are not permitted on sewer side of trap. Traps shall correspond to fittings on cast iron soil pipe or steel pipe respectively, and size shall be as required by connected service or fixture.

## 2.7 TRAP GUARDS

- A. Manufacturer: ProSet Systems Trap Guard, JR Smith Quad Close, Sure Seal, or approved equal.
- B. Flexible elastomeric PVC construction diaphragm trap guard for installation in new and existing floor drains, hub drains, and trench drains. Trap guard to prevent trap evaporation and waste backflow. Size as applicable to the drain outlet size, up to 4" size.

## 2.8 PENETRATION SLEEVES

- A. A sleeve flashing device shall be provided at points where pipes pass through membrane waterproofed floors or walls. The sleeve flashing device shall be manufactured, cast iron fitting with clamping device that forms a sleeve for the pipe floor penetration of the floor membrane. A galvanized steel pipe extension shall be included in the top of the fitting that will extend 50 mm (2 inches) above finished floor and galvanized steel pipe extension in the bottom of the fitting that will extend through the floor slab. A waterproof caulked joint shall be provided at the top hub.

## 2.9 SAFINGS (WATERPROOF MEMBRANE)

- A. Manufacturers: Noble Seal TS system or equal.
- B. Chlorinated polyethylene, single sheet membrane, nominal 0.8 mm thick, ASTM C627 performance, use for thin-set tile applications. Install over latex based thin-set. Install per TCNA guidelines.
- C. Provide 36 inch diameter waterproofing disk for all drains located in floor construction and scheduled for waterproof membrane. Turn 1/2 inch edge up in topping to form pan.
- D. Install safing at floor/shower drains. Extend 18 inches beyond drains in all directions. Cover entire floor in toilet rooms and showers and extend 6 inches up in walls above curbs and to a height of 6 feet (3 inches wide each direction) in corners. General Trade to provide vapor retarder on shower walls - coordinate. Install on concrete floor that is smooth and free of debris. Seal all joints and connect to drain body clamp. Safing is subject to 24 hour standing water leak test. Install safing at all built-up shower installations. (Note: Spray-on and brush applied liquid safing is not acceptable.)
- E. General Trade to remove concrete topping for shower installation and waterproof membrane-safing throughout toilet room.

## PART 3 - EXECUTION

### 3.1 PIPE INSTALLATION

- A. The pipe installation shall comply with the requirements of the International Plumbing Code (IPC), Michigan Plumbing Code, and these specifications.
- B. 2 inch piping to have minimum pitch of 1/4 inch per foot. Piping 3 inch and larger to have minimum pitch of 1/8 inch per foot.

- C. Branch piping shall be installed for waste from the respective piping systems and connect to all fixtures, valves, cocks, outlets, casework, cabinets and equipment, including those furnished by the Owner or specified in other sections.
- D. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe shall be reamed to full size after cutting.
- E. All pipe runs shall be laid out to avoid interference with other work.
- F. The piping shall be installed above accessible ceilings where possible.
- G. The piping shall be installed to permit valve servicing or operation.
- H. The piping shall be installed free of sags and bends.
- I. Changes in direction for soil and waste drainage and vent piping shall be made using appropriate branches, bends and long sweep bends. Sanitary tees and short sweep quarter bends may be used on vertical stacks if change in direction of flow is from horizontal to vertical. Long turn double wye branch and eighth bend fittings shall be used if two fixtures are installed back to back or side by side with common drain pipe. Straight tees, elbows, and crosses may be used on vent lines. Do not change direction of flow more than 90 degrees. Proper size of standard increaser and reducers shall be used if pipes of different sizes are connected. Reducing size of drainage piping in direction of flow is prohibited.
- J. If an installation is unsatisfactory to the COR, the Contractor shall correct the installation at no cost to the Owner.

### **3.2 JOINT CONSTRUCTION**

- A. For threaded joints, thread pipe with tapered pipe threads according to ASME B1.20.1. The threads shall be cut full and clean using sharp disc cutters. Threaded pipe ends shall be reamed to remove burrs and restored to full pipe inside diameter. Pipe fittings and valves shall be joined as follows:
  - 1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is required by the pipe service.
  - 2. Pipe sections with damaged threads shall be replaced with new sections of pipe.

### **3.3 SPECIALTY PIPE FITTINGS**

- A. Transition coupling shall be installed at pipe joints with small differences in pipe outside diameters.
- B. Dielectric fittings shall be installed at connections of dissimilar metal piping and tubing.

### 3.4 PIPE HANGERS, SUPPORTS AND ACCESSORIES

- A. All piping shall be supported according to the International Plumbing Code (IPC), Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, and these specifications. Where conflicts arise between these the code and Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, the most restrictive or the requirement that specifies supports with highest loading or shortest spacing shall apply.
- B. Hangers, supports, rods, inserts and accessories used for pipe supports shall be painted according to Section 09 91 00, PAINTING.
- C. Horizontal piping and tubing shall be supported within 300 mm (12 inches) of each fitting or coupling.
- D. Vertical piping and tubing shall be supported at the base, at each floor, and at intervals no greater than 4.6 m (15 feet).
- E. In addition to the requirements in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, floor, wall and ceiling plates, supports, and hangers shall have the following characteristics:
  - 1. Solid or split unplated cast iron.
  - 2. All plates shall be provided with set screws.
  - 3. Height adjustable clevis type pipe hangers.
  - 4. Adjustable floor rests and base flanges shall be steel.
  - 5. Hanger rods shall be low carbon steel, fully threaded or threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
  - 6. Riser clamps shall be malleable iron or steel.
  - 7. Rollers shall be cast iron.
  - 8. See Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, for requirements on insulated pipe protective shields at hanger supports.
- F. Hangers, supports, and hanger rods to be stainless steel or aluminum in the basement and tunnel areas.
- G. Miscellaneous materials shall be provided as specified, required, directed or as noted on the drawings for proper installation of hangers, supports and accessories. If the vertical distance exceeds 6.1 m (20 feet), additional support shall be provided in the center of that span. All necessary auxiliary steel shall be provided to provide that support.
- H. Cast escutcheon with set screw shall be provided at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.

I. Penetrations:

1. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoke partitions or floors, a fire stop shall be installed that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING.  
Clearances between raceways and openings shall be completely filled and sealed with the fire stopping materials.
2. Water Proofing: At floor penetrations, clearances shall be completely sealed around the pipe and make watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS.

**3.5 TESTS**

- A. Sanitary waste and drain systems shall be tested either in its entirety or in sections.
- B. Waste System tests shall be conducted before trenches are backfilled or fixtures are connected. A water test or air test shall be conducted, as directed.
  1. If entire system is tested for a water test, tightly close all openings in pipes except highest opening and fill system with water to point of overflow. If the waste system is tested in sections, tightly plug each opening except highest opening of section under test, fill each section with water and test with at least a 3 m (10 foot) head of water. In testing successive sections, test at least upper 3 m (10 feet) of next preceding section so that each joint or pipe except upper most 3 m (10 feet) of system has been submitted to a test of at least a 3 m (10 foot) head of water. Water shall be kept in the system, or in portion under test, for at least 15 minutes before inspection starts. System shall then be tight at all joints.
  2. For an air test, an air pressure of 34 kPa (5 psig) gage shall be maintained for at least 15 minutes without leakage. A force pump and mercury column gage shall be used for the air test.
  3. After installing all fixtures and equipment, open water supply so that all p-traps can be observed. For 15 minutes of operation, all p-traps shall be inspected for leaks and any leaks found shall be corrected.

4. Final Tests: Either one of the following tests may be used.
  - a. Smoke Test: After fixtures are permanently connected and traps are filled with water, fill entire drainage and vent systems with smoke under pressure of 0.25 kPa (1 inch of water) with a smoke machine. Chemical smoke is prohibited.
  - b. Peppermint Test: Introduce 60 ml (2 ounces) of peppermint into each line or stack.

---END---



**SECTION 22 14 00  
FACILITY STORM DRAINAGE**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section describes the requirements for storm drainage systems, including piping and all necessary accessories as designated in this section.
- B. A complete listing of all acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 07 84 00, FIRESTOPPING: Penetrations in rated enclosures.
- D. Section 07 92 00, JOINT SEALANTS.
- E. Section 09 91 00, PAINTING: Preparation and finish painting and identification of piping systems.
- F. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: Pipe Hangers and Supports, Materials Identification.
- G. Section 22 07 11, PLUMBING INSULATION.

**1.3 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):
  - A112.6.4-2003 (R2012) ..Roof, Deck, and Balcony Drains
  - A13.1-2007 (R2013).....Scheme for Identification of Piping Systems
  - B1.20.1-2013.....Pipe Threads, General Purpose, Inch
  - B16.3-2011.....Malleable Iron Threaded Fittings: Classes 150 and 300
  - B16.9-2012.....Factory-Made Wrought Buttwelding Fittings
  - B16.11-2011.....Forged Fittings, Socket-Welding and Threaded
  - B16.12-2009 (R2014).....Cast Iron Threaded Drainage Fittings
- C. American Society of Sanitary Engineering (ASSE)
  - 1079-2012.....Performance Requirements for Dielectric Pipe Unions

## D. American Society for Testing and Materials (ASTM):

- A47/A47M-1999 (R2014)...Standard Specification for Ferritic Malleable Iron Castings
- A183-2014.....Standard Specification for Carbon Steel Track Bolts and Nuts
- A536-1984 (R2014).....Standard Specification for Ductile Iron Castings
- B61-2008 (R2013).....Standard Specification for Steam or Valve Bronze Castings
- B62-2009.....Standard Specification for Composition Bronze or Ounce Metal Castings
- B687-1999 (R2011).....Standard Specification for Brass, Copper, and Chromium-Plated Pipe Nipples
- B828-2002 (R2010).....Standard Practice for Making Capillary Joints by Soldering of Copper and Copper Alloy Tube and Fittings

## E. Cast Iron Soil Pipe Institute (CISPI):

- 2006.....Cast Iron Soil Pipe and Fittings Handbook
- 301-2012.....Standard Specification for Hubless Cast Iron Soil Pipe and Fittings for Sanitary and Storm Drain, Waste, and Vent Piping Applications
- 310-2012.....Specification for Coupling for Use in Connection With Hubless Cast Iron Soil Pipe and Fittings for Sanitary and Storm Drain, Waste, and Vent Piping Applications

## F. American Welding Society (AWS):

- A5.8M/A5.8 AMD1-2011....Specification for Filler Metals for Brazing and Braze Welding

## G. International Code Council (ICC):

- IPC-2012.....International Plumbing Code

## H. Manufacturers Standardization Society of the Valve and Fittings Industry, Inc. (MSS):

- SP-72-2010a.....Ball Valves with Flanged or Butt-Welding Ends for General Service
- SP-110-2010.....Ball Valves Threaded, Socket-Welding, Solder Joint, Grooved and Flared Ends

#### **1.4 SUBMITTALS**

- A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 14 00, FACILITY STORM DRAINAGE", with applicable paragraph identification.
- C. Manufacturer's Literature and Data Including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.
  - 1. Pipe and Fittings.
  - 2. Specialty Pipe Fittings.
  - 3. Cleanouts.
  - 4. Expansion Joints.
  - 5. Sleeve Flashing Devices.
- D. Detailed shop drawing of clamping device and extensions when required in connection with the waterproofing membrane.

#### **1.5 QUALITY ASSURANCE**

- A. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit <http://www.biopreferred.gov>.

#### **1.6 AS-BUILT DOCUMENTATION**

- A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.
- B. Submit operation and maintenance data updated to include submittal review comments, substitutions and construction revisions. It shall be in electronic version on compact disc or DVD inserted into a three-ring binder. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices such as damper and door closure interlocks

shall be included. A list of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the Owner will be required to employ shall be inserted into the As-Built documentation.

- C. The installing contractor shall maintain as-built drawings of each completed phase for verification and shall provide the complete set at the time of final systems certification testing. As-built drawings are to be provided and a copy of them in Auto-CAD version 2017 provided on compact disk or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.
- D. Certification documentation shall be provided to COR 10 working days prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and certification that all results of tests were within limits specified.

## **PART 2 - PRODUCTS**

### **2.1 STORM WATER DRAIN PIPING**

- A. Cast Iron Storm Pipe and Fittings:
  - 1. Cast iron storm pipe and fittings shall be used for the following applications:
    - a. Pipe buried in or in contact with earth.
    - b. Extension of pipe to a distance of approximately 1500 mm (5 feet) outside of building walls.
    - c. Interior storm piping above grade.
    - d. All mechanical equipment rooms or other areas containing mechanical air handling equipment.
  - 2. The cast iron storm pipe shall be bell and spigot, or hubless (plain end or no-hub) as required by selected jointing method.
  - 3. The material for all pipe and fittings shall be cast iron soil pipe and fittings and shall conform to the requirements of CISPI 301, ASTM A888, or ASTM A74.
  - 4. Joints for hubless pipe and fittings shall conform to the manufacturer's installation instructions. Couplings for hubless joints shall conform to CISPI 310. Joints for hub and spigot pipe shall be installed with compression gaskets and conforming to the requirements of ASTM C564.

## 2.2 SPECIALTY PIPE FITTINGS

- A. Transition pipe couplings shall join piping with small differences in outside diameters or be of different materials. End connections shall be of the same size and compatible with the pipes being joined. The transition coupling shall be unshielded, elastomeric, sleeve type reducing or transition pattern conforming with ASTM C1173 and include shear ring and corrosion resistant metal tension band and tightening mechanism on each end. The transition coupling sleeve coupling shall be of the following material:
  - 1. For dissimilar pipes, the sleeve material shall be PVC conforming to ASTM D5926, or other material compatible with the pipe materials being joined.
- B. Dielectric fittings shall conform to ASSE 1079 with a pressure rating of 1035 kPa (150 psig) at a minimum temperature of 82 degrees C (180 degrees F). The end connection shall be solder joint copper alloy and threaded ferrous.
- C. Dielectric flanges shall conform to ASSE 1079 with a pressure rating of 1035 kPa (150 psig). The flange shall be a factory fabricated, bolted, companion flange assembly. The end connection shall be threaded or solder-joint copper alloy and threaded ferrous.
- D. Dielectric flange insulating kits shall be of non-conducting materials for field assembly of companion flanges with a pressure rating of 1035 kPa (150 psig). The gasket shall be neoprene or phenolic. The bolt sleeves shall be phenolic or polyethylene. The washers shall be phenolic with steel backing washers.
- E. Dielectric nipples shall be electroplated steel and shall conform with ASTM F1545 with a pressure ratings of 2070 kPa (300 psig) at 107 degrees C (225 degrees F). The end connection shall be male threaded. The lining shall be inert and noncorrosive propylene. Bio-based materials shall be utilized when possible.

## 2.3 CLEANOUTS

- A. Cleanouts shall be the same size as the pipe, up to 100 mm (4 inches); not less than 100 mm (4 inches) for larger pipe. Cleanouts shall be easily accessible and shall be gastight and watertight. A minimum clearance of 600 mm (24 inches) shall be provided for clearing a clogged storm sewer line.

- B. Cleanouts shall be provided at or near the base of the vertical stacks with the cleanout plug located approximately 600 mm (24 inches) above the floor. The cleanouts shall be extended to the wall access cover. Cleanout shall consist of sanitary tees. Nickel bronze square frame and stainless steel cover with minimum opening of 150 mm by 150 mm (6 inch by 6 inch) shall be provided at each wall cleanout.
- C. In horizontal runs above grade, cleanouts shall consist of cast brass tapered screw plug in fitting or caulked/no hub cast iron ferrule. Plain end (no-hub) piping in interstitial space or above ceiling may use plain end (no-hub) blind plug and clamp.

## **2.4 WATERPROOFING**

- A. A sleeve flashing device shall be provided at points where pipes pass through membrane waterproofed floors or walls. The sleeve flashing device shall be manufactured, cast iron fitting with clamping device that forms a sleeve for the pipe floor penetration of the floor membrane. A galvanized steel pipe extension shall be included in the top of the fitting that will extend 50 mm (2 inches) above finished floor and galvanized steel pipe extension in the bottom of the fitting that will extend through the floor slab. A waterproofed caulked joint shall be provided at the top hub.

## **PART 3 - EXECUTION**

### **3.1 PIPE INSTALLATION**

- A. The pipe installation shall comply with the requirements of the IPC and these specifications.
- B. Branch piping shall be installed from the piping system and connect to all drains and outlets.
- C. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe shall be reamed to remove burrs and a clean smooth finish restored to full pipe inside diameter.
- D. All pipe runs shall be laid out to avoid interference with other work/trades.
- E. The piping shall be installed above accessible ceilings to allow for ceiling panel removal.
- F. Unless otherwise stated on the documents, minimum horizontal slope shall be 1 inch for every 2.44 m (8 feet) (1 percent slope) of pipe length.
- G. The piping shall be installed free of sags and bends.

- H. Changes in direction for storm drainage piping shall be made using appropriate branches, bends and long sweep bends. Sanitary tees and short sweep 1/4 bends may be used on vertical stacks if change in direction of flow is from horizontal to vertical. Long turn double wye branch and 1/8 bend fittings shall be used if two drains are installed back to back or side by side with common drain pipe. Do not change direction of flow more than 90 degrees. Proper size of standard increaser and reducers shall be used if pipes of different sizes are connected. Reducing size of drainage piping in direction of flow is prohibited.

### **3.2 JOINT CONSTRUCTION**

- A. For threaded joints, thread pipe with tapered pipe threads according to ASME B1.20.1. The threads shall be cut full and clean using sharp disc cutters. Threaded pipe ends shall be reamed to remove burrs and restored to full pipe inside diameter. Pipe fittings and valves shall be joined as follows:
1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is required by the pipe service
  2. Pipe sections with damaged threads shall be replaced with new undamaged sections of pipe at no additional time or cost to Owner.

### **3.3 SPECIALTY PIPE FITTINGS**

- A. Transition coupling shall be installed at pipe joints with small differences in pipe outside diameters.
- B. Dielectric fittings shall be installed at connections of dissimilar metal piping and tubing.

### **3.4 PIPE HANGERS, SUPPORTS AND ACCESSORIES**

- A. All piping shall be supported according to the IPC, Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, and these specifications.
- B. Hangers, supports, rods, inserts and accessories used for Pipe supports shall be shop coated with zinc Chromate primer paint. Electroplated copper hanger rods, hangers and accessories may be used with copper tubing.
- C. Horizontal piping and tubing shall be supported within 300 mm (12 inches) of each fitting or coupling.
- D. Hangers, supports, and hanger rods to be stainless steel or aluminum in the basement and tunnel areas.
- E. Vertical piping and tubing shall be supported at the base, at each floor, and at intervals no greater than 4.6 m (15 feet).

- F. In addition to the requirements in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, floor, wall and ceiling plates shall have the following characteristics:
1. Solid or split unplated cast iron.
  2. All plates shall be provided with set screws.
  3. Height adjustable clevis type pipe hangers.
  4. Adjustable Floor Rests and Base Flanges shall be steel.
  5. Hanger Rods shall be low carbon steel, fully threaded or threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
  6. Riser Clamps shall be malleable iron or steel.
  7. Roller shall be cast iron.
  8. Hangers and supports utilized with insulated pipe and tubing shall have 180 degree (minimum) metal protection shield centered on and welded to the hanger and support. The shield shall be 100 mm (4 inches) in length and be 1.6 mm (16 gage) steel. The shield shall be sized for the insulation.
- G. Miscellaneous materials shall be provided as specified, required, directed or as noted on the drawings for proper installation of hangers, supports and accessories. If the vertical distance exceeds 6.1 m (20 feet) for cast iron pipe, additional support shall be provided in the center of that span. All necessary auxiliary steel shall be provided to provide that support.
- H. Cast escutcheon with set screw shall be installed at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
- I. Penetrations:
1. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoke partitions, or floors, a fire stop shall be installed that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING. Clearances between raceways and openings shall be completely filled and sealed with the fire stopping materials.
  2. Water Proofing: At floor penetrations, clearances around the pipe shall be completely sealed and made watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS. Bio-based materials shall be utilized when possible.



### 3.5 INSULATION

- A. Insulate all horizontal and vertical storm piping. Install insulation in accordance with the requirements of Section 22 07 11, PLUMBING INSULATION.

### 3.6 TESTS

- A. Storm sewer system shall be tested either in its entirety or in sections.
- B. Storm Water Drain tests shall be conducted before trenches are backfilled or fixtures are connected. A water test or air test shall be conducted, as directed.
  - 1. If entire system is tested with water, tightly close all openings in pipes except the highest opening, and fill system with water to point of overflow. If system is tested in sections, tightly plug each opening except highest opening of section under test, fill each section with water and test with at least a 3 m (10 foot) head of water. In testing successive sections, test at least upper 3 m (10 feet) of next preceding section so that each joint or pipe except upper most 3 m (10 feet) of system has been submitted to a test of at least a 3 m (10 foot) head of water. Water shall be kept in the system, or in portion under test, for at least 15 minutes before inspection starts. System shall then be tight at all joints.
  - 2. For an air test, an air pressure of 34 kPa (5 psig) gage shall be maintained for at least 15 minutes without leakage. A force pump and mercury column gage shall be used for the test.
  - 3. Final Tests: While either one of the following tests may be used, Contractor shall check with VA as to which test will be performed.
    - a. Smoke Test: After fixtures are permanently connected and traps are filled with water, fill entire drainage and vent systems with smoke under pressure of 0.25 kPa (1 inch of water) with a smoke machine. **Chemical smoke is prohibited.**
    - b. Peppermint Test: Introduce 0.06 liters (2 ounces) of peppermint into each line or stack.
- C. COR shall witness all tests. Contractor shall coordinate schedules with the COR. Contractor shall provide a minimum of 10 working days prior to flushing, disinfection/sterilization, startup, and testing.

### **3.7 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for two hours to instruct VA Personnel in operation and maintenance of the system.

---END---

**SECTION 22 40 00  
PLUMBING FIXTURES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Plumbing fixtures, associated trim and fittings necessary to make a complete installation from wall or floor connections to rough piping, and certain accessories.
- B. A complete listing of all acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 07 92 00, JOINT SEALANTS: Sealing between fixtures and other finish surfaces.
- D. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- E. Section 22 13 00, FACILITY SANITARY AND VENT PIPING.

**1.3 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. The American Society of Mechanical Engineers (ASME):
  - A112.6.1M-1997 (R2012)..Supports for Off-the-Floor Plumbing Fixtures  
for Public Use
  - A112.19.1-2013.....Enameled Cast Iron and Enameled Steel Plumbing  
Fixtures
  - A112.19.2-2013.....Ceramic Plumbing Fixtures
  - A112.19.3-2008.....Stainless Steel Plumbing Fixtures
- C. American Society for Testing and Materials (ASTM):
  - A276-2013a.....Standard Specification for Stainless Steel Bars  
and Shapes
  - B584-2008.....Standard Specification for Copper Alloy Sand  
Castings for General Applications
- D. CSA Group:
  - B45.4-2008 (R2013).....Stainless Steel Plumbing Fixtures
- E. National Association of Architectural Metal Manufacturers (NAAMM):
  - AMP 500-2006.....Metal Finishes Manual

- A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 40 00, PLUMBING FIXTURES", with applicable paragraph identification.
- C. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, connections, and capacity.
- D. Operating Instructions: Comply with requirements in Section 01 00 00, GENERAL REQUIREMENTS.

A. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit <http://www.biopreferred.gov>.

## 1.6 AS-BUILT DOCUMENTATION

- A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.
- B. Submit operation and maintenance data updated to include submittal review comments, substitutions and construction revisions. It shall be in electronic version on compact disc or DVD inserted into a three-ring binder. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual.

The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices such as damper and door closure interlocks shall be included. A list of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.

- C. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. As-built drawings are to be provided and a copy of them in AutoCAD version 2017 provided on compact disc or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.
- D. Certification documentation shall be provided to COR 10 working days prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and certification that all results of tests were within limits specified.

## PART 2 - PRODUCTS

### 2.1 MATERIALS

- A. Material or equipment containing a weighted average of greater than 0.25 percent lead is prohibited in any potable water system intended for human consumption and shall be certified in accordance with NSF 61 or NSF 372. Endpoint devices used to dispense water for drinking shall meet the requirements of NSF 61.
- B. Plastic pipe, fittings, and solvent cement shall meet NSF 14 and shall be NSF listed for the service intended.

## 2.2 STAINLESS STEEL

- A. Corrosion-Resistant Steel (CRS):
  - 1. Plate, Sheet and Strip: CRS flat products shall conform to chemical composition requirements of any 300 series steel specified in ASTM A276.
  - 2. Finish: Exposed surfaces shall have standard polish (ground and polished) equal to NAAMM finish Number 4.
- B. Die-cast zinc alloy products are prohibited.

## 2.3 STOPS

- A. Provide lock-shield loose key or screw driver pattern angle stops, straight stops or stops integral with faucet, with each compression type faucet whether specifically called for or not, including sinks in solid-surface, wood and metal casework. Locate stops centrally above or below fixture in accessible location.
- B. Furnish keys for lock shield stops to the COR.
- C. Supply from stops not integral with faucet shall be chrome plated copper flexible tubing or flexible stainless steel with inner core of non-toxic polymer.
- D. Supply pipe from wall to valve stop shall be rigid threaded IPS copper alloy pipe, i.e. red brass pipe nipple, chrome plated where exposed.
- E. Stops to be brass stem(s). McGuire H171LK or equal. Plastic stem(s) are not allowed.

## 2.4 ESCUTCHEONS

- A. Heavy type, chrome plated, with set screws. Provide for piping serving plumbing fixtures and at each wall, ceiling and floor penetrations in exposed finished locations and within cabinets and millwork.

## 2.5 LAMINAR FLOW CONTROL DEVICE

- A. Smooth, bright stainless steel or satin finish, chrome plated metal laminar flow device shall provide non-aeration, clear, coherent laminar flow that will not splash in basin. Device shall also have a flow control restrictor and have vandal resistant housing. **Aerators are prohibited.**
- B. Flow Control Restrictor:
  - 1. Capable of restricting flow from 32 ml/s to 95 ml/s (0.5 gpm to 1.5 gpm) for lavatories; 125 ml/s to 140 ml/s (2.0 gpm to 2.2 gpm) for sinks P-505 through P-520, P-524 and P-528; and 174 ml/s to 190 ml/s (2.75 gpm to 3.0 gpm) for dietary food preparation and rinse sinks or as specified.

2. Compensates for pressure fluctuation maintaining flow rate specified above within 10 percent between 170 kPa and 550 kPa (25 psig and 80 psig).
3. Operates by expansion and contraction, eliminates mineral/sediment build-up with self-cleaning action, and is capable of easy manual cleaning.

## 2.6 CARRIERS

- A. ASME A112.6.1M, with adjustable gasket faceplate chair carriers for wall hung closets with auxiliary anchor foot assembly, hanger rod support feet, and rear anchor tie down.
- B. ASME A112.6.1M, lavatory, chair carrier for thin wall construction, concealed arm support. All lavatory chair carriers shall be capable of supporting the lavatory with a 250-pound vertical load applied at the front of the fixture.
- C. Where water closets, lavatories or sinks are installed back-to-back and carriers are specified, provide one carrier to serve both fixtures in lieu of individual carriers. The drainage fitting of the back to back carrier shall be so constructed that it prevents the discharge from one fixture from flowing into the opposite fixture.

## 2.7 WATER CLOSETS

- A. **(WC-1)** Water Closet: Floor mounted, bottom outlet, with offset bedpan washer ASME A112.19.2, floor outlet, with bed pan lugs-bedpan washer, flush valve operated, 6 L (1.6 gallons) per flush. Top of seat shall be 450 mm (18 inches) above finished floor. Provide standoff bracket support between studs for bedpan washer at height as recommended by manufacturer. Kohler K-96057-L (Highcliff Ultra) or equal.
  1. Seat: Institutional/Industrial, extra heavy duty, chemical resistant, solid plastic, open front less cover for elongated bowls, integrally molded bumpers, concealed check hinge with stainless steel post. Seat shall be posture contoured body design. Color shall be white. Church/Bemis 2155SSC (Duraguard) or equal.
  2. Fittings and Accessories: Floor Flange fittings-cast iron; gaskets-wax; bolts with chromium plated cap nuts and washers.

3. Flush Valve: Large chloramines resistant diaphragm, semi-red brass valve body, exposed chrome plated, non-hold open ADA approved side oscillating handle, offset top spud connection, adjustable tailpiece, one-inch IPS screwdriver back check angle stop with vandal resistant cap, sweat solder adapter with cover tube and cast set screw wall flange, solid-ring pipe support, and high back pressure vacuum breaker. Valve body, cover, tailpiece and control stop shall be in conformance with ASTM Alloy classification for semi-red brass. Set centerline of inlet 673 mm (26-1/2 inches) above seat. Seat bumpers shall be set in wall behind fixture at proper contact height. Sloan Royal BPW-1150-1.6 (Slimline).
- B. **(WC-2)** Water Closet: Floor mounted, back outlet, ASME A112.19.2, elongated bowl, bedpan lugs-bedpan washer, siphon jet, 6 L (1.6 gallons). Top of seat shall be 435 mm to 438 mm (17-1/8 inches to 17-1/4 inches) above finished floor. Kohler K-4352-L (Anglesey) or equal.
1. Seat: Institutional/Industrial, extra heavy duty, chemical resistant, solid plastic, open front less cover for elongated bowls, integrally molded bumpers, concealed check hinge with stainless steel post. Seat shall be posture contoured body design. Color shall be white. Church/Bemis 2155SSC (Duraguard) or equal.
  2. Fittings and Accessories: Floor flange fittings-cast iron; Gasket-wax; bolts with chromium plated cap nuts and washers.
  3. Flush Valve: Large chloramines resistant diaphragm, semi-red brass valve body, exposed chrome plated, dual flush non-hold open ADA water saver design per flush with maximum 10 percent variance, offset top spud connection, adjustable tailpiece, one-inch IPS screwdriver back check angle stop with vandal resistant cap, high back pressure vacuum breaker, solid-ring pipe support, and sweat solder adapter with cover tube and cast set screw wall flange. Set centerline of inlet 292 mm (11-1/2 inches) above seat. Seat bumpers shall be integral part of flush valve. Valve body, cover, tailpiece and control stop shall be in conformance with ASTM B584 Alloy classification for semi-red brass. Sloan Royal BPW-1150-1.6 (Slimline) or equal.
  4. Carrier: Reuse existing carrier in the wall chase. Verify bolt pattern to match. Provide new bolts, washers, nuts as required to connect.



- C. (**WC-3**) Bariatric Floor Mounted Water Closet ASME A112.19.2, with bedpan washer, integral bedpan lugs. Fully enclosed floor mounted with integral seat, siphon jet, stainless steel fixture with white-powder-coated, 14 gage Type 304 stainless steel construction with white powder coating and hinged seat with cover, flush valve operated, top of seat 450 mm (18 inches) above floor. Bio-based materials shall be utilized when possible. Rated for bariatric use - 1000 pound minimum capacity. Acorn DuraWare 2120-3-ADA-EG-HS-OFLLC-BL or equal.
1. Fittings and Accessories: Gaskets-neoprene, bolts with chromium plated cap nuts and washers, and extra heavy-duty carrier.
  2. Flush Valve: Offset bedpan washer, exposed chrome plated diaphragm type with low force ADA compliant 6 L (1.6 gallon) per flush, seat bumper, integral screwdriver stop and vacuum breaker, solid-ring pipe support, and escutcheon. Sloan Royal BPW-1150-1.6 (Slimline) or equal.

## 2.8 LAVATORIES

- A. Dimensions for lavatories are specified, Length by width (distance from wall) and depth.
- B. Brass components in contact with water shall contain no more than 0.25 percent lead content by dry weight. Faucet flow rates shall be 3.9 L/m (1.5 gpm) for private lavatories and either 1.9 L/m (0.5 gpm) or 1.0 liter (0.25 gallons) per cycle for public lavatories.
- C. (**L-1**) Lavatory (Counter Mounted ASME A112.19.2) integral with solid surface countertop, Corian/Meganite sink with integral overflow approximately 483 mm (19 inches) in diameter with punching for faucet on 203 mm (8 inches) centers. Unit integral in countertop.
  1. Faucet: Solid cast brass construction with washerless ceramic disc mixing cartridge type, rigid gooseneck spout with outlet 102 mm to 127 mm (4 inches to 5 inches) above slab with 102 mm (4 inches) wrist blade handles. Provide laminar flow control device. Faucet, wall and floor escutcheons shall be either copper alloy or CRS. Exposed metal parts shall be chrome plated with a smooth bright finish. Chicago Faucet 201-AGN2A-317CP-E35 or equal.
  2. Drain: cast or wrought brass with flat grid strainer, brass, chrome plated. Kohler K-7131-A-CP or equal.
  3. Stops: Angle type. See paragraph "Stops". Stop stem(s) to be brass-plastic is not allowed. McGuire H171LK or equal.

4. Trap: Cast copper alloy, 38 mm by 32 mm (1-1/2 inches by 1-1/4 inches) P-trap, adjustable with connected elbow and 1.4mm thick (17 gauge) tubing extension to wall. Exposed metal trap surface and connection hardware shall be chrome plated with a smooth bright finish. Set trap parallel to the wall. Kohler K8998 or equal.
  5. TMV: Watts Series LFMMV or equal.
  6. Provide safety covers for exposed piping, drain, stops and p-trap per A.D.A. Truebro 103-EZ or equal.
- D. (**L-2**) Lavatory, straight back, approximately 508 mm by 457 mm (20 inches by 18 inches) and a 102 mm (4 inches) maximum apron, first quality vitreous china. Punching for faucet on 204 mm (8 inches) centers. Set with rim 864 mm (34 inches) above finished floor. Kohler K-2006 (Kingston) or equal.
1. Faucet: Solid cast brass construction, vandal resistant, heavy-duty single lever handle, center set. Control shall be washerless ceramic disc cartridge type. Provide laminar flow control device, adjustable hot water limit stop, and vandal proof screws. Flow shall be limited to 5.7 L/m (1.5 gpm). Chicago Faucet 201-AGN2A-317CP-E35 or equal.
  2. Drain: Cast or wrought brass with flat grid strainer offset tailpiece, chrome plated. Provide cover per A.D.A 4-19.4. Kohler K-13885 offset or equal.
  3. Stops: Angle type, see paragraph "Stops". Stop stem(s) to be brass - plastic is not allowed. Provide cover per A.D.A 4-19.4. McGuire H171LK or equal.
  4. Trap: Cast copper alloy, 38 mm by 32 mm (1 1/2 inches by 1 1/4 inches) P-trap. Adjustable with connected elbow and 1.4 mm thick (17 gauge) tubing extensions to wall. Exposed metal trap surface and connection hardware shall be chrome plated with a smooth bright finish. Set trap parallel to wall. Provide safety cover on p-trap and water supplies per A.D.A 4-19.4. Kohler K-8998 or equal.
  5. TMV: Watts Series LFMMV or equal.
  6. Carrier: J.R. Smith 0700-Z floor mount, narrow sleeve, adjustable floor carrier.
  7. Safety Covers: Truebro 103-EZ or equal.

## 2.9 SINKS

- A. Dimensions for sinks are specified, length by width (distance from wall) and depth.
- B. (**S-1**) Sink (CRS, Single Compartment, Counter Top ASME A112.19.2, Kitchen Sinks) self-rimming, back faucet ledge, approximately 533 mm by 559 mm (20 inches by 17 inches) with single compartment inside dimensions approximately 406 mm by 483 mm by 191 mm (14 inches by 14 inches by 6 inches) deep. Shall be minimum of 1.3 mm thick (18 gauge) CRS. Corners and edges shall be well rounded. Elkay LR2219 or equal.
  - 1. Faucet: Solid cast brass construction, 8.3 L/m (2.2 gpm) deck mounted combination faucet with Monel or ceramic seats, removable replacement unit containing all parts subject to ware, swivel gooseneck spout with approximately 203 mm (8 inches) reach with spout outlet 152 mm (6 inches) above deck and 102 mm (4 inches) wrist blades. Faucet shall be polished chrome plated. Chicago Faucet 201-AGN2A-317CP-E35 or equal.
  - 2. Drain: Drain plug with grid strainer, stainless steel. Elkay LK-18B or equal.
  - 3. Trap: Cast copper alloy 38 mm (1-1/2 inches) p-trap with cleanout plug. Provide wall connection and escutcheon. Kohler K-9000 or equal.
  - 4. Stops: McGuire H171LK or equal.
  - 5. TMV: Watts Series LFMMV or equal.

## 2.10 SHOWER BATH FIXTURE

- A. (**SH-1**) Shower Bath Fixture (Detachable, Wall Mounted, Concealed Supplies, Type T/P Combination Valve):
  - 1. Shower Installation: Wall mounted detachable spray assembly, 600 mm (36 inch) wall bar, elevated vacuum breaker Zurn Z7000-VB or equal, solid lever handle and diverter supply elbow and flange and valve. All external trim, chrome plated metal. Symmons #9605-PLR Series with T36 vertical grab bar.

2. Shower Head Assembly/Stationary and Handheld: Metallic shower head with flow control to limit discharge to 9.5 l/m (2.5 gpm), 1524 mm (60 inches) length of rubber lined CRS, chrome plated metal flexible, or white vinyl reinforced hose and supply wall elbow. Design shower head to fit in palm of hand. Provide CRS or chrome plated metal wall bar with an adjustable swivel hanger for showerhead. Fasten wall bar securely to wall for hand support. Symmons Mode 3 hand shower with Symmons T36 vertical grab bar and Symmons Mode 3 stationary head, mounted at 6'-2" a.f.f.
3. Diverter: Symmons solid handle diverter
4. Built-up shower by General Trade. General Trade to furnish InPro shower base with SS grid drain, installed by Plumbing Trade. Coordinate installation with General Trade. Plumbing Trade to provide waterproof membrane - safing in room.
5. Valves: Type T/P combination thermostatic and pressure balancing, with chrome plated metal lever type operating handle adjustable for rough-in variations and chrome plated metal or CRS face plate. Valve body shall be any suitable copper alloy. Internal parts shall be copper, nickel alloy, CRS or thermoplastic material. Valve inlet and outlet shall be 13 mm (1/2 inch) IPS. Provide external screwdriver check stops, vacuum breaker and temperature limit stops. Set stops for a maximum temperature of 50 degrees C (122 degrees F). All exposed fasteners shall be vandal resistant. Valve shall provide a minimum of 9.5 l/m (2.5 gpm) at 310 kPa (45 psig) pressure drop.
6. Check Valves: Provide accessible in-line swing check valve(s) on the water supply piping.
7. General Trade to remove concrete topping for shower installation and waterproof membrane-safing throughout Toilet room.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Fixture Setting: Opening between fixture and floor and wall finish shall be sealed as specified under Section 07 92 00, JOINT SEALANTS. Bio-based materials shall be utilized when possible.
- B. Supports and Fastening: Secure all fixtures, equipment and trimmings to partitions, walls and related finish surfaces. Exposed heads of bolts and nuts in finished rooms shall be hexagonal, polished chrome plated brass with rounded tops.

- C. Toggle Bolts: For hollow masonry units, finished or unfinished.
- D. Expansion Bolts: For brick or concrete or other solid masonry. Shall be 6 mm (1/4 inch) diameter bolts, and to extend at least 76 mm (3 inches) into masonry and be fitted with loose tubing or sleeves extending into masonry. Wood plugs, fiber plugs, lead or other soft metal shields are prohibited.
- E. Power Set Fasteners: May be used for concrete walls, shall be 6 mm (1/4 inch) threaded studs, and shall extend at least 32 mm (1-1/4 inches) into wall.
- F. Tightly cover and protect fixtures and equipment against dirt, water and chemical or mechanical injury.
- G. Where water closet waste pipe has to be offset due to beam interference, provide correct and additional piping necessary to eliminate relocation of water closet.
- H. Aerators are prohibited on lavatories and sinks.
- I. If an installation is unsatisfactory to the COR, the Contractor shall correct the installation at no cost or additional time to the Government.

### **3.2 CLEANING**

- A. At completion of all work, fixtures, exposed materials and equipment shall be thoroughly cleaned.

### **3.3 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for two hours to instruct VA Personnel in operation and maintenance of the system.

---END---



**SECTION 22 62 00**  
**VACUUM SYSTEMS FOR HEALTHCARE FACILITIES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Healthcare Vacuum Systems: This section describes the labor, equipment, and services necessary for and incidental to the installation of piped medical vacuum systems and medical vacuum. Medical vacuum systems shall be installed, started, tested, and ready for use. The scope of work shall include all necessary piping, fittings, valves, cabinets, station outlets and inlets, rough-ins, gages, alarms including low voltage wiring, and all necessary parts, accessories, connections and equipment for a complete and operational system. Match existing station inlet quick-connect Series "B" terminal connections.
- B. The Contractor shall provide all elements and accessories required for a complete system according to the most recent edition of NFPA 99, Gas and Vacuum Systems.
- C. Electrical power and control wiring for alarm panels and modular accessories associated with the system(s) shall be included.
- D. Pressure testing, cross connection testing and final testing per NFPA 99 shall be performed.
- E. The Contractor shall retain a qualified third party medical vacuum verifier acceptable to the engineer of record and VA to perform and attest to final verification of the systems. The Contractor shall make all corrections as determined by this third-party verifier, including additional testing if necessary, to attain full and unqualified certification at no additional time or cost to the Government.
- F. Coordinate with Owner retained verifier for final verification of the systems. Make corrections as required, including additional testing if necessary to attain full certification.
- G. A complete listing of all acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 07 84 00, FIRESTOPPING: Sealing around pipe penetrations to maintain the integrity of time rated construction.
- D. Section 07 92 00, JOINT SEALANTS: Sealing around pipe penetrations through the floor to prevent moisture migration.
- E. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: General requirements and items common to more than one section of Division 22.
- F. Section 22 63 00, GAS SYSTEMS FOR HEALTHCARE FACILITIES: Healthcare gases and vacuum alarms.
- G. SECTION 22 63 00, GAS SYSTEMS FOR HEALTHCARE FACILITIES: Healthcare gas piping and equipment.
- H. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Alarm interface with BAS.
- I. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Control wiring.
- J. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduit.
- K. Section 26 27 26, WIRING DEVICES: Electrical wiring and accessories.

**1.3 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the test by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):
  - A13.1-2007 (R2013).....Scheme for the Identification of Piping Systems
  - B16.15-2013.....Cast Copper Alloy Threaded Fittings: Classes 125 and 250
  - B16.22-2013.....Wrought Copper and Copper Alloy Solder-Joint Pressure Fittings
  - B16.50-2013.....Wrought Copper and Copper Alloy Braze-Joint Pressure Fittings
  - B40.100-2013..... Pressure Gauges and Gauge Attachments
  - ASME Boiler and Pressure Code -
  - BPVC Section IX-2015....Welding, Brazing, and Fusing Qualifications
- C. American Society of Sanitary Engineers (ASSE):
  - 6000 Series-2012.....Professional Qualifications Standard for Medical Gas Systems Personnel



- D. American Society for Testing and Materials (ASTM):
  - B43-2014.....Standard Specification for Seamless Red Brass  
Pipe, Standard Sizes
  - B687-1999 (2011).....Standard Specification for Brass, Copper, and  
Chromium-Plated Pipe Nipples
  - B819-2000 (R2011).....Standard Specification for Seamless Copper Tube  
for Medical Gas Systems
- E. American Welding Society (AWS):
  - A5.8M/A5.8-2011-AMD1....Specification for Filler Metals for Brazing and  
Braze Welding
  - B2.2/B2.2M-2010.....Specification for Brazing Procedure and  
Performance Qualification
- F. Manufacturing Standardization Society (MSS):
  - SP-72-2010a.....Ball Valves with Flanged or Butt-Welding Ends  
for General Service
  - SP-110-2010.....Ball Valves Threaded, Socket-Welding, Solder  
Joint, Grooved and Flared Ends
- G. National Electrical Manufacturers Association (NEMA):
  - ICS 6-1993 (R2001, R2006) Industrial Control and Systems Enclosures
- H. National Fire Protection Association (NFPA):
  - 70-2014.....National Electrical Code
  - 99-2015.....Health Care Facilities Code

#### **1.4 SUBMITTALS**

- A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 62 00, VACUUM SYSTEMS FOR HEALTHCARE FACILITIES", with applicable paragraph identification.
- C. Manufacturer's Literature and Data Including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.
  - 1. Complete specifications for the product intended to be installed, dimensional drawings, and wiring schematics.
  - 2. Package drawing indicating package style, dimensions when complete, method of disassembly and sizes of subsections for rigging and installation.

3. Piping.
  4. Valves.
  5. Inlet and outlet cocks
  6. Valve cabinets.
  7. Gages.
  8. Station inlets, and rough in assemblies.
  9. Alarm controls and panels.
  10. Vacuum bottle slide brackets.
- D. Station Inlets: A letter from manufacturer shall be submitted stating that inlets are designed and manufactured to comply with NFPA 99. Inlet shall bear label of approval as an assembly, of Underwriters Laboratories, Inc., or Associated Factory Mutual Research Corporation.
- E. Certification: The completed systems have been installed, tested, purged and analyzed in accordance with the requirements of this specification. Certification shall be submitted to COR.
- F. A notarized affidavit from the verifier stating that the verifier undertakes to verify this project and thus agrees to disqualify themselves from supplying any equipment which shall be included in the scope of their verification. No verifier who supplies equipment shall be permitted to verify that equipment. Statement declaring that the vacuum system manufacturer has no fiduciary interest in the verifier and that the verifier is not an agent or representative of the vacuum system manufacturer. Statement declaring that the Contractor has no fiduciary interest in the third-party verifier and that the third-party verifier has no fiduciary interest in the contractor.

### **1.5 QUALITY ASSURANCE**

- A. Contractor shall include with submittals an affidavit attesting to compliance with all relevant paragraphs of NFPA 99 most recent edition. Personnel assembling medical vacuum and WAGD system shall meet NFPA 99 5.1.10.11.10 "Qualification of Installers" and hold medical gas endorsements as under ASSE Standard Series 6000. The Contractor shall, on company letterhead, furnish documentation attesting that all installed piping materials were purchased cleaned and complied with the requirements of NFPA 99 5.1.10.1 and 5.1.10.2. Electrical Control systems and Medical Vacuum Alarms are to be UL listed as assemblies with label affixed. Medical vacuum and WAGD controls are to be wired in accordance with NEC.

- B. Equipment Installer: The equipment installer shall provide documentation proving that the personnel installing the equipment meet the standards set by ASSE Standard Series 6000. Show technical qualifications and previous experience in installing medical gas equipment on three similar projects. Submit names, phone numbers, and addresses of referenced projects. The equipment installer shall perform the following coordination functions:
1. Coordinate with other trades to ensure timely installations and avoid conflicts and interferences.
  2. Coordinate and field verify with the metal stud partition installer and/or mason to ensure anchors, sleeves and similar items are provided in sufficient time to avoid delays; chases and openings are properly sized and prepared.
  3. Coordinate with VA to ensure medical vacuum inlets, whether Owner-supplied or Contractor-supplied, in walls and all equipment are provided by the same Medical Vacuum Equipment Manufacturer satisfactory to the Owner.
  4. The Contractor shall coordinate with the Medical Vacuum System verifier to deliver a complete, operational, and tested medical gas installation ready for Owner's use.
- C. Equipment Supplier: The Equipment supplier shall demonstrate evidence of installing equivalent product at three installations similar to this project that has been in satisfactory and efficient operation for three years. Names, phone numbers, and addresses where the product is installed shall be submitted for verification.
- D. Medical Gas System Testing Organization: The Medical vacuum verifier shall show documentation proving that the medical gas verifier meets the standards set by ASSE Standard Series 6000. The testing shall be conducted by a party technically competent and experienced in the field of medical gas pipeline testing. Such testing shall be performed by a third-party testing company independent of the installing and general contractor.
- E. Names of three projects where testing of vacuum systems has been performed by the testing agency shall be provided. The name of the project, names of such persons at that project who supervised the work for the project owner or who accepted the report for the project owner, and a written statement that the projects listed required work of similar scope to that set forth in this specification shall be included in the documentation.

- F. The testing agency's detailed procedure shall be followed in the testing of this project and submitted to COR 10 working days prior to testing. In the testing agency's procedure documentation, include details of the testing sequence, procedures for cross connection tests, outlet function tests, alarm tests, purity tests, etc., as required by this specification. For purity test procedures, data on test methods, types of equipment to be used, calibration sources and method references shall be submitted.
- G. Installation and Startup: The manufacturer shall provide factory authorized representatives to review the installation and perform the initial startup of the system. The factory authorized representatives shall submit a report to the COR and to the Contractor. The Contractor shall make all corrections identified by the factory authorized representative at no additional cost or time to the Government.
- H. Certification: The Final inspection documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and certification that all results of tests were within limits allowed by this specification.
- I. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit <http://www.biopreferred.gov>.

#### **1.6 MAINTENANCE SUPPORT**

- A. The medical vacuum equipment manufacturer shall demonstrate a national factory direct service capability able to perform major overhauls. The medical vacuum equipment manufacturer shall provide factory direct preventative maintenance contract. The medical vacuum equipment manufacturer shall provide formal maintenance training courses. See paragraph "Demonstration and Training" for additional requirements for training. Servicer shall be no more than 100 miles away, be capable of responding within 4 hours, and provide certified personnel to perform all work.

## **1.7 AS-BUILT DOCUMENTATION**

- A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.
- B. Submit operation and maintenance data updated to include submittal review comments, substitutions and construction revisions. It shall be in electronic version on compact disc or DVD inserted into a three-ring binder. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual.

The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices such as damper and door closure interlocks shall be included. A List of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the Owner shall be required to employ shall be inserted into the As-Built documentation.

- C. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. As-built drawings are to be provided, and a copy of them in Auto-CAD version 2017 provided on compact disc or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.
- D. Certification documentation shall be provided to COR 10 working days prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and certification that all results of tests were within limits specified.

## **PART 2 - PRODUCTS**

### **2.1 GENERAL PRODUCT REQUIREMENTS**

- A. A single Medical Vacuum Equipment Manufacturer shall supply the medical vacuum system(s) and equipment to include outlets, valves and gauges, valve boxes, alarm panels, manifolds, oxygen and vacuum sources.

## 2.2 PIPING

- A. Copper Tubing: Copper tubing shall be type "K" or "L", ASTM B819, seamless copper tube, hard drawn temper, with wrought copper fittings conforming to ASME B16.22 or brazing fittings complying with ASME B16.50. The copper tubing size designated reflects nominal inside diameter. All tubing and fittings shall be labeled "ACR/OXY", "OXY", "OXY/MED", "ACR/MED", or "MED".
- B. Brazing Alloy: The brazing alloy shall comply with AWS A5.8M/A5.8, Classification BCuP, greater than 538 degrees C (1000 degrees F) melting temperature. Flux shall be strictly prohibited for copper to copper connections.
- C. Screw Joints: Screw joints shall use polytetrafluoroethylene (Teflon) tape.
- D. Memory metal couplings shall have temperature and pressure ratings not less than that of a brazed joint.
- E. Piping identification labels shall be applied at time of installation in accordance with NFPA 99. Supplementary color identification shall be in accordance with CGA Pamphlet C-9.
- F. Special Fittings: The following special fittings shall be permitted to be used in lieu of brazed joints:
  - 1. Memory-metal couplings having temperature and pressure ratings joints not less than that of a brazed joint.
  - 2. Listed or approved metallic gas tube fittings that, when made up, provide a permanent joint having the mechanical, thermal, and sealing integrity of a brazed joint.
  - 3. Dielectric fittings where required by the manufacturer of special medical equipment to electrically isolate the equipment from the piping distribution system.
  - 4. Axially swaged, elastic strain preload fittings providing metal to metal seal having pressure and temperature ratings not less than that of a brazed joint and when complete are permanent and non-separable.

## 2.3 VALVES

A. Ball: Ball valves shall be in line, other than zone valves in cabinets.

1. 65 mm or DN65 (2-1/2 inches) and Less: Ball valves shall be bronze/brass body, MSS SP-72 and MSS SP-110, Type II, Class 150, Style 1, with tubing extensions for brazed connections, full ported, three piece or double union end connections, Teflon seat seals, full flow, 4138 kPa (600 psig) WOG minimum working pressure, with locking type handle.

Allied Healthcare Products (Chemetron)

<u>Type</u>	<u>Size</u>	<u>Pressure/Vacuum</u>	<u>Series Number</u>
Ball	2" and smaller	400 psi/29" Hg	77-03-0000 with 77-03-9200 latch lock

B. Check:

1. 75 mm or DN75 (3 inches) and Less: Check valves shall be brass and bronze body, straight through design for minimum pressure drop, spring loaded, self-aligning with Teflon cone seat, vibration-free, silent operation, supplied NPT female threads at each end with flow direction arrow permanently cast into body, 2758 kPa (400 psig) WOG minimum working pressure.

- C. Zone valve in cabinet shall be ball valve with bronze/brass body, double seal, three piece or double union end connections, replaceable Teflon seat seals, Teflon stem seal, 4138 kPa (600 psig) WOG, cold, non-shock gas working pressure or vacuum service to 100 kPa (29.5 inches Hg), blowout proof stem, one quarter turn of handle to completely open or close. Tubing extensions, factory brazed, pressure tested, cleaned for oxygen service shall be provided. A 3.2 mm (1/8 inch) NPT gauge port shall be provided for a 50 mm (2 inch) diameter monitoring gauge downstream of the shut-off valve. Zone valves shall be securely attached to the cabinet and provided with Type "K" copper tube extensions for making connection to system piping outside the cabinet. Zone valves shall be products of one manufacturer, and uniform throughout in pattern, overall size and appearance. Trim with color-coded plastic inserts or color-coded stick on labels.

Valves shall be in cabinets such that cover window cannot be in place when any valve is in the closed position. Color coding for identification plates and labels is as follows:

SERVICE LABEL	IDENTIFICATION COLORS	MFG. STD. CLR.
MEDICAL VACUUM	Black letters on white background	WHITE

#### 2.4 VALVE CABINETS

- A. Manufacturer: Allied Healthcare - Chemetron #77-82-0000 Series
- B. Valve cabinets shall be flush mounted, commercially available item for use with medical gas services, constructed from steel not lighter than 1.3 mm (18 gage) steel or extruded aluminum not lighter than 1.9 mm (14 gage). The valve cabinets shall be rigidly assembled, of adequate size to accommodate all valve(s) and fittings indicated. Holes shall be predrilled to receive pipe connections. These pipe connections shall be made outside of the valve box. Anchors shall be provided to secure cabinet to wall construction. Openings in cabinet shall be sealed to be dust tight. Bottom of cabinet shall be located 1375 mm (4 feet) above finished floor; coordinate with handrail.
- C. Engraved rigid plastic identification plate shall be mounted on the wall above or adjacent to the cabinet. Color code identification plate to match gas identification colors as indicated above. Identification plate shall be clearly visible at all times. Inscriptions shall be provided on plate to read in substance: "VALVE CONTROL SUPPLY TO ROOMS." The final wording shall be approved by the COR or VA facility.
- D. Cover Plate: The cover plate shall be fabricated from 1.3 mm (18 gage) sheet metal with satin chromed finish, extruded anodized aluminum, or 0.85 mm (22 gage) stainless steel. A cover window shall be provided of replaceable plastic, with a corrosion-resistant device or lever secured to window for emergency window removal. The following shall be permanently painted or stenciled on window: "FOR EMERGENCY SHUT-OFF VALVES ONLY, SHUT-OFF VALVES FOR PIPED GASES", or equivalent wording. The valve cabinet shall be configured such that it is not possible to install window with any valve in the closed position. Each valve shall have a pressure gauge upstream of valve and this pressure gauge shall be inside valve box.



- E. Cabinets and isolation valves shall be located and piped as shown on the contract documents and, at a minimum, so as to allow the isolation of each smoke compartment separately. Each cabinet shall serve no more than one smoke compartment.

## **2.5 GAGES**

### **A. Vacuum Gages:**

1. For vacuum line adjacent to source equipment, the vacuum gages shall comply with ASME B40.100, vacuum gage type, size 115 mm (4-1/2 inches), gage listed for vacuum, accurate to within 2-1/2 percent, with metal case. The vacuum gage range shall be 0 to 100 kPa (0 to 29.5 inches Hg). Dial graduations and figures shall be black on a white background, or white on a black background. Label shall be for vacuum service. A gage cock shall be installed. Dual scale gages shall be installed for vacuum system.
2. For vacuum service upstream of main shut-off valve, a 40 mm (1-1/2 inches) diameter gage shall be provided with steel case, bourdon tube and brass movement, dial range 0 to 100 kPa (0 to 29.5 inches Hg). Dual scale gages shall be provided for vacuum system.

## **2.6 STATION INLETS - ROOM #4262**

### **A. Vacuum Station Inlets:**

1. Manufacturer: Amico recessed locking stainless steel security console box and stainless steel door frame assembly #W-X-SEC-PCON-03 (3) outlets, each box/side of bed with Allied Healthcare - Chemetron Quick-Connect Series "B" #64-01-5002 or equal, compatible with locking panel.
2. Station inlets shall be for designated service, consisting of a quick coupler, quick disconnect type with inlet supply tube.
3. The outlet station shall be made, cleaned, and packaged to NFPA 99 standards and shall be UL listed and CSA certified.
4. A coupler shall be provided that is non-interchangeable with other services, and leak proof under three times normal working pressure.
5. Each station inlet shall be equipped with an automatic valve to conform with NFPA 99. Valves shall be placed in the assembly to provide easy access after installation for servicing and replacement, and to facilitate line blow-out, purging, and testing.

6. Each inlet shall be securely fastened to structure and provide each with a capped stub length of 7 mm (1/4 inches) (10 mm outside diameter) (3/8 inches outside diameter) tubing for connection to supply tubing. Stub tubing shall be labeled for appropriate service. Rough in shall be indexed and gas specified latch valve with non-interchangeable safety keying with color coded gas service identification.
7. Rough-in kits and test plugs for PBPU shall be furnished under this specification but installed by manufacturer of PBPU before initial test specified herein.
8. Completion kits (valve body and face plate) shall be installed for the remainder of required tests.

## **2.7 STATION INLET ROUGH-IN**

- A. Station inlet rough-in shall be flush mounted and protected against corrosion. Rough-in shall be anchored securely to unit or wall construction. Inlet to be compatible with stainless steel locking security console box.
- B. The modular cover plate shall be constructed from die cast plate, two-piece 0.85 mm (22 gage) stainless steel or 1.6 mm (16 gage) chromium plated metal, secured to rough-in with stainless steel or chromium plated countersunk screws. The latch mechanism shall be designed for one handed, single thrust mounting and one-handed fingertip release of secondary equipment.
- C. Cover Plate for PBPU shall be one piece with construction and material as indicated for modular cover plate.
- D. Permanent, metal or plastic, identification plates shall be provided securely fastened at each inlet opening, with inscription for appropriate service using color coded letters and background. Metal plates shall have letters embossed on baked on enamel background. Color coding for identification plates is as follows:

<b>SERVICE LABEL</b>	<b>IDENTIFICATION PLATE COLORS</b>
MEDICAL VACUUM	Black letters on white background

## **2.8 VACUUM SWITCHES**

- A. Vacuum switches shall be general purpose, contact or mercury type, allowing both high and low setpoints, with contact type provided with a protective dust cover. The vacuum switch shall have an adjustable range set by inside or outside adjustment. Vacuum switches shall activate when indicated by alarm requirements. One orifice nipple (or DISS demand check valve) shall be used for each sensor switch.

## **2.9 VACUUM BOTTLE SLIDE BRACKET**

- A. Manufacturer: Allied Healthcare - Chemetron Model #64-06-0001 (or equal)
- B. Vacuum bottle bracket shall be single plate of one piece, 0.85 mm (22 gage) stainless steel or 1.6 mm (16 gage) chromium plated metal or aluminum, finish matching cover of adjoining vacuum inlet. All components shall be of same material as plate and assembly and anchored securely to structure. The bracket shall be provided and plastic vacuum bottle holder for each vacuum wall inlet.

## **2.10 ALARM**

- A. Area Alarm: Allied Healthcare - Chemetron  
#74-15-OV Series (Impact) with gas specific transducers  
(or equal)  
#74-15 Impact with #74-14-9052 vacuum transducer  
(or equal)

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. All installation shall be performed in strict accordance with NFPA 99 5.1.10. Brazing procedures shall be as detailed in NFPA 99 5.1.10.4. Brazing shall be performed only by brazers qualified under NFPA 99 5.1.10.11.10.
- B. Med gas connection to existing vacuum pump to be done at night/premium hours. Coordinate shutdown with the Owner. Provide isolation valve to minimize downtime. System to be re-certified and operational by 6:00 A.M. each day.
- C. Cast escutcheon shall be installed with set screw at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
- D. Open ends of tube shall be capped or plugged at all times or otherwise sealed until final assembly to prevent infiltration of any foreign matter.

- E. Piping shall be cut square and accurately with a tube cutter (sawing is prohibited) to measurements determined at place of installation.  
The tubing shall be reamed to remove burrs, being careful not to expand tube, and so no chips of copper remain in the tube. The tubing shall be worked into place without springing or forcing. The tubing shall be bottomed in socket so there are no gaps between tube and fitting. Care shall be exercised in handling equipment and tools used in cutting or reaming of tube to prevent oil or grease from being introduced into the tubing. Where contamination has occurred, material shall be no longer suitable for vacuum service and new, sealed tube sections used.
- F. Piping shall be supported with pipe trays or hangers at intervals as shown on the contract drawings or as defined in NFPA 99. Piping shall not be supported by other piping. Isolation of copper piping from dissimilar metals shall be of a firm, positive nature. Duct tape is prohibited as an isolation material.
- G. Valves and other equipment shall be rigidly supported to prevent strain on tube or joints.
- H. Piping exposed to physical damage shall be protected.
- I. During any brazing operation, the interior of the pipe shall be purged continuously with oil free, dry nitrogen NF, following the procedure in NFPA 99 5.1.10.4.5. At the completion of any section, all open pipe ends shall be capped using an EXTERNAL cap. The flow of purged gas shall be maintained until joint is cool to touch. The use of flux is prohibited when making of joints between copper to copper pipes and fittings.
- J. Threaded joints in piping systems shall be avoided whenever possible. Where unavoidable, make up the male threads with polytetrafluoroethylene (such as Teflon) tape. Liquid sealants are prohibited.
- K. Tubing shall not be bent. Fittings shall be used in all change of direction or angle.
- L. After installation of the piping, but before installation of the outlet valves, blow lines clear using nitrogen NF per NFPA 99.
- M. Pressure and vacuum switches, transmitter and gauges shall be installed to be easily accessed and provide access panel where installed above plaster ceiling. Pressure switch and sensors shall be installed with orifice nipple between the pipe line and switches/sensors.

- N. Pipe labeling shall be applied during installation process and not after installation is completed. Size of legend letters shall be in accordance with ASME A13.1.
- O. After initial leakage testing is completed, the piping shall be allowed to remain pressurized with testing gas until testing agency performs final tests.
- P. Penetrations:
  - 1. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoked partitions, or floors, fire stopping shall be installed that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING. Clearances between raceways and openings with the fire stopping material shall be completely filled and sealed.
  - 2. Water Proofing: At floor penetrations, clearances shall be completely sealed around the pipe and made watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS.
- Q. A vacuum gage 40 mm (1-1/2 inch) diameter shall be installed in line downstream of each valve located in a zone valve cabinet.
- R. Zone valves shall be provided in cabinets where indicated and a minimum one zone valve assembly for each 18 outlets.
- S. Piping shall be labeled with name of service, identification color and direction of flow. Where non-standard pressures are piped, pressure shall be labeled. Labels shall be placed at least once every 6.1 m (20 feet) of linear run or once in each story (whichever is more frequent). A label shall additionally be placed immediately on each side of all wall or floor penetrations. Pipe labels shall be self-adhesive vinyl type or other water-resistant material with permanent adhesive colored in accordance with NFPA 99 Table 5.1.11 and shall be visible on all sides of the pipe. Each master alarm signal shall be labeled for function after ring out. Each zone valve shall be labeled and each area alarm labeled for the area of control or surveillance after test. Labels shall be permanent and of a type approved by the VAMC.
- T. Alarms and valves shall be labeled for service and areas monitored or controlled. Coordinate with the VAMC for final room or area designations. Valves shall be labeled with name and identification color of the gas and direction of flow.

### 3.2 INSTALLER TESTING

- A. Prior to declaring the lines ready for final verification, the installing contractor shall strictly follow the procedures for verification as described in NFPA 99 5.1.12.2 and attest in writing over the notarized signature of an officer of the installing company the following;
1. That all brazing was conducted by brazers qualified to ASSE Standard Series 6000 and holding current medical gas endorsements.
  2. That all brazing was conducted with nitrogen purging. (Procedure per NFPA 99 5.1.10.4.5).
  3. That the lines have been blown clear of any construction debris using oil free dry nitrogen or air are clean and ready for use. (Procedure per NFPA 99 5.1.12.2.2).
  4. That the assembled piping, prior to the installation of any devices, maintained a test pressure 1 1/2 times the standard pressures listed in NFPA 99 Table 5.1.11 without leaks. (Procedure per NFPA 99 5.1.12.2.3).
  5. That after installation of all devices, the pipeline was proven leak-free for 24 hours at a pressure 20 percent above the standard pressures listed in NFPA 99 Table 5.1.11. (Procedure per NFPA 99 5.1.12.2. 6)
  6. That the systems have been checked for cross connections and none were found. (Procedure per NFPA 99 5.1.12.2.4)
  7. That the manufacturer has started up all medical air compressors, medical vacuum pumps WAGD producers, liquid oxygen system(s) and manifolds, and that they are in operating order.
- B. Four originals of the affidavit, shall be distributed; (2) to the COR, (1) to the general contractor, and (1) to the verifier ([www.mgpho.org](http://www.mgpho.org)).

### 3.3 VERIFIER TESTING

A. Prior to handing over the systems to VAMC, the Contractor shall retain a verifier acceptable to the engineer of record and VA who shall follow strictly the procedures for verification as described in NFPA 99 5.1.12.3 and provide a written report and certificate bearing the notarized signature of an officer of the verification company on company letterhead which contains at least the following:

1. A current ACORD insurance certificate indicating professional liability coverage in the minimum amount of \$1 Million per occurrence, and general aggregate liability in the minimum amount of \$1 Million, valid and in force when the project is to be verified. General liability insurance alone is not acceptable.
2. An affidavit bearing the notarized signature of an officer of the verification company stating that the verification company is not the supplier of any equipment used on this project or tested in this report and that the verification contractor has no relationship to, or pecuniary interest in, the manufacturer, seller, or installer of any equipment used on this project or tested in this report.
3. A listing of all tests performed, listing each source, outlet, valve and alarm included in the testing.
4. An assertion that all tests were performed by a Medical Vacuum System Certified Medical Gas or vacuum Verifier or by individuals qualified to perform the work and holding valid qualifications to ASSE 6030 and under the immediate supervision a Verifier. Include the names, credential numbers and expiration dates for all individuals working on the project.
5. A statement that equipment used was calibrated at least within the last six months by a method traceable to a National Bureau of Standard Reference and enclosing certificates or other evidence of such calibration(s). Where outside laboratories are used in lieu of on-site equipment, those laboratories shall be named and their original reports enclosed.
6. A statement that, where and when needed, equipment was re-calibrated during the verification process and describing the method(s) used.
7. A statement that the systems were tested and found to be free of debris to a procedure per NFPA 99 5.1.12.3.7.
8. The flow from each outlet when tested to a procedure per NFPA 99 5.1.12.3.10.

9. A statement that the systems were tested and found to have no cross-connections to a procedure per NFPA 99 5.1.12.3.3.
  10. A statement that the systems were tested and found to be free of contaminants to a procedure per NFPA 99 5.1.12.3.8 except that the purity standard shall be 2 ppm difference for halogenated hydrocarbons and 1 ppm total hydrocarbons (as methane).
  11. A listing of area alarms, their function and activation pressures per NFPA 99 5.1.12.3.5.3.
  12. A statement that the sources include all alarms required by NFPA 99 Table A.5.1.9.5.
  13. The concentration of each gas at each outlet as specified in NFPA 99 5.1.12.3.11.
  14. A statement that all valves and alarms are accurately labeled as to zone of control.
- B. Perform and document all cross-connection tests, labeling verification, supply system operation, and valve and alarm operation tests as required by, and in accordance with NFPA 99 and the procedures set forth in pre-qualification documentation.
- C. Verify that the systems, as installed, meet or exceed the requirements of NFPA 99, this specification, and that the systems operate as required.
- D. Piping Purge Test: For each positive pressure gas system, verify cleanliness of piping system. Filter a minimum of 1000 liters (35 cubic feet) of gas through a clean white 0.45 micron filter at a minimum velocity of 100 mps (3.5 fpm). Filter shall show no discoloration and shall accrue no more than 0.1 mg of matter. Test each zone at the outlet most remote from the source. Perform test with the use of an inert gas as described in CGA P-9. Retest until all tests pass at no additional time or cost to the Government.
- E. Inlet Flow Test:
1. Test all inlets for flow. Perform test with the use of an inert gas as described in CGA P-9.
  2. Needle valve vacuum inlets shall draw no less than 1.0 SCFM with adjacent inlet flowing, at a dynamic inlet pressure of 40 kPa (12 inches Hg), and a static vacuum of 10 kPa (3 inches Hg).
  3. Vacuum inlets shall draw no less than 85 Lpm (3.0 SCFM) with adjacent inlet flowing, at a dynamic inlet pressure of 40 kPa (12 inches Hg), and a static vacuum of 50 kPa (15 inches Hg).



### **3.4 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for two hours to instruct VA Personnel in operation and maintenance of the system.

---END---



**SECTION 22 63 00**  
**GAS SYSTEMS FOR HEALTHCARE FACILITIES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Healthcare Gas Systems: Consisting of oxygen and medical air services; complete, ready for operation, including all necessary piping, fittings, valves, cabinets, station outlets, rough-ins, gages, alarms including low voltage wiring, pressure regulators, and all necessary parts, accessories, connections and equipment. Match existing station outlet and inlet terminal connections, quick-connect, style "B".
- B. Oxygen/Medical Air System: Connect to existing oxygen and medical air piping in Corridor.
- C. Healthcare gas system alarm wiring from equipment to alarm panels.
- D. A complete listing of all acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- D. Section 07 84 00, FIRESTOPPING: Sealing around pipe penetrations to maintain the integrity of time rated construction.
- E. Section 07 92 00, JOINT SEALANTS: Sealing around pipe penetrations through the floor to prevent moisture migration.
- G. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: General requirements and items common to more than one section of Division 22.
- J. SECTION 22 62 00, VACUUM SYSTEMS FOR HEALTHCARE FACILITIES: Vacuum Piping and Equipment.
- K. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Alarm interface with BAS.
- L. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Control wiring.
- M. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduit.
- N. Section 26 27 26, WIRING DEVICES: Electrical wiring and accessories.

**1.3 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

## B. American Society of Mechanical Engineers (ASME):

A13.1-2007 (R2013).....Scheme for the Identification of Piping Systems

B16.15-2013.....Cast Copper Alloy Threaded Fittings: Classes  
125 and 250B16.22-2013.....Wrought Copper and Copper Alloy Solder-Joint  
Pressure FittingsB16.50-2013.....Wrought Copper and Copper Alloy Braze-Joint  
Pressure Fittings

B40.100-2013.....Pressure Gauges and Gauge Attachments

ASME Boiler and Pressure Vessel Code -

BPVC Section VIII-2015..Rules for Construction of Pressure Vessels,  
Division I

BPVC Section IX-2015....Welding, Brazing, and Fusing Qualifications

## C. American Society of Sanitary Engineers (ASSE):

6000 Series-2012.....Professional Qualifications Standard for  
Medical Gas Systems Personnel

## D. American Society for Testing and Materials (ASTM):

B43-2014.....Standard Specification for Seamless Red Brass  
Pipe, Standard SizesB687-1999 (2011).....Standard Specification for Brass, Copper, and  
Chromium-Plated Pipe NipplesB819-2000 (R2011).....Standard Specification for Seamless Copper Tube  
for Medical Gas Systems

## E. American Welding Society (AWS):

A5.8M/A5.8-2011.....Specification for Filler Metals for Brazing and  
Braze WeldingB2.2/B2.2M-2010.....Specification for Brazing Procedure and  
Performance Qualification

## F. Compressed Gas Association (CGA):

C-9-2013.....Standard Color Marking of Compressed Gas  
Containers for Medical Use

G-4.1-2009.....Cleaning Equipment for Oxygen Service

V-1-2013.....Standard for Compressed Gas Cylinder Valve  
Outlet and Inlet Connections

## G. Manufacturing Standardization Society (MSS):

SP-72-2010a.....Ball Valves With Flanged or Butt-Welding Ends  
For General Service

SP-110-2010.....Ball Valves Threaded, Socket-Welding, Solder  
Joint, Grooved and Flared Ends

## H. National Electrical Manufacturers Association (NEMA):

ICS 6-1993 (R2001, R2006) Industrial Control and Systems Enclosures

## I. National Fire Protection Association (NFPA):

99-2015.....Health Care Facilities Code

**1.4 SUBMITTALS**

- A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 63 00, GAS SYSTEMS FOR HEALTHCARE FACILITIES", with applicable paragraph identification.
- C. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.
  - 1. Piping.
  - 2. Valves.
  - 3. Inlet and outlet cocks.
  - 4. Valve cabinets.
  - 5. Gages.
  - 6. Station outlets and rough-in assemblies.
  - 8. Alarm controls and panels.
  - 9. Pressure Switches.
- D. Station Outlets: Submit letter from manufacturer stating that outlets are designed and manufactured to comply with NFPA 99. Outlet shall bear label of approval as an assembly, of Underwriters Laboratories, Inc., or Associated Factory Mutual Research Corporation.
- E. Certification: The completed systems have been installed, tested, purged, analyzed and verified in accordance with the requirements of this specification. Certification shall be submitted to COR.

**1.5 QUALITY ASSURANCE**

- A. Materials and Installation: In accordance with NFPA 99 and as specified.
- B. Equipment Supplier: Provide evidence of equivalent product installed at three installations similar to this project that has been in satisfactory and efficient operation for three years. Submit names, phone numbers, and addresses where the product is installed.
- C. Healthcare System Testing Organization: The testing shall be conducted by a party technically competent and experienced in the field of healthcare pipeline testing. Testing and systems verification shall be performed by personnel meeting the qualifications of ASSE Standard Series 6000. Such testing shall be performed by a party other than the installing contractor.
- D. Provide the names of three projects where testing of medical gases systems has been performed by the testing agency. Include the name of the project, names of such persons at that project who supervised the work for the project owner, or who accepted the report for the project owner, and a written statement that the projects listed required work of similar scope to that set forth in this specification.
- E. Submit the testing agency's detailed procedure which shall be followed in the testing of this project. Include details of the testing sequence, procedures for cross connection tests, outlet function tests, alarm tests, purity tests, etc., as required by this specification. For purity test procedures, include data on test methods, types of equipment to be used, calibration sources and method references.
- F. Certification: Provide COR documentation 10 working days prior to submitting request for final inspection to include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and certification that all results of tests were within limits allowed by this specification.
- G. "Hot taps" are prohibited for operating medical oxygen systems. Methods for connection and extension of active and pressurized medical gas systems without subsequent medical gas testing and verification are prohibited.

**H. Medical gas(es) connections to existing piping to be completed during night/premium hours. Gas(es) to be re-certified and operational by 6:00 A.M. each day. Coordinate and schedule all shutdowns with Owner. Provide isolation valve at connection to minimize downtime.**

I. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit <http://www.biopreferred.gov>.

#### **1.6 AS-BUILT DOCUMENTATION**

A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.

B. Submit operation and maintenance data updated to include submittal review comments, substitutions and construction revisions shall be in electronic version on compact disc or DVD inserted into a three-ring binder. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual.

The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices such as damper and door closure interlocks shall be included. A List of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.

C. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. As-built drawings are to be provided, and a copy of them in Auto-CAD version 2017 provided on compact disc or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.

- D. Certification documentation shall be provided to COR 10 working days prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and certification that all results of tests were within limits specified.

## **PART 2 - PRODUCTS**

### **2.1 PIPING AND FITTINGS**

- A. Copper Tubing: Type "K", ASTM B819, seamless copper tube, hard drawn temper, with wrought copper fittings conforming to ASME B16.22 or brazing fittings complying with ASME B16.50. Size designated reflecting nominal inside diameter. All tubing and fittings shall be labeled "ACR/OXY", "OXY", "OXY/MED", "ACR/MED", or "MED".
- B. Brazing Alloy: AWS A5.8M/A5.8, Classification BCuP, greater than 538 degrees C (1000 degrees F) melting temperature. Flux is strictly prohibited for copper-to-copper connections.
- C. Threaded Joints: Polytetrafluoroethylene (Teflon) tape.
- D. Memory Metal Couplings: Temperature and pressure rating shall not be less than that of a brazed joint in accordance with NFPA 99, paragraph 5.1.10.6.1.
- E. Apply piping identification labels at the time of installation in accordance with NFPA 99. Apply supplementary color identification in accordance with CGA Pamphlet C-9.
- F. Special Fittings: The following special fittings shall be permitted to be used in lieu of brazed joints:
  - 1. Memory-metal couplings having temperature and pressure ratings joints not less than that of a brazed joint.
  - 2. Listed or approved metallic gas tube fittings that, when made up, provide a permanent joint having the mechanical, thermal, and sealing integrity of a brazed joint.
  - 3. Dielectric fittings where required by the manufacturer of special medical equipment to electrically isolate the equipment from the piping distribution system.
  - 4. Axially swaged, elastic strain preload fittings providing metal to metal seal having pressure and temperature ratings not less than that of a brazed joint and when complete are permanent and non-separable.



## 2.2 HEALTHCARE GASES PIPING

- A. Finished Room: Use iron pipe size (IPS) chrome plated brass or stainless steel piping for exposed healthcare gas piping connecting fixtures, casework, cabinets, equipment and reagent racks when not concealed by apron including those furnished by the Government or specified in other sections.
1. Pipe: ASTM B43, standard weight.
  2. Fittings: Fittings shall comply with ASME B16.15 cast bronze threaded fittings with chrome finish (125 and 250 psig Classes).
  3. Nipples: Nipples shall comply with ASTM B687, chromium-plated.
  4. Unions: Unions shall comply with MSS SP-72, MSS SP-110, brass or bronze with chrome finish. Unions 65 mm (2-1/2 inches) and greater shall be flange type with approved gaskets.
  5. Valves: Valves shall comply with MSS SP-72, MSS SP-110, brass or bronze with chrome finish.

## 2.3 VALVES

- A. Ball: In-line, Other Than Zone Valves in Cabinets:
1. 75 mm (3 inches) and Smaller: Bronze/ brass body, MSS SP-72, MSS SP-110, Type II, Class 150, Style 1, with tubing extensions for brazed connections, full port, three-piece or double union end connections, Teflon seat seals, full flow, 4138 kPa (600 psig) WOG minimum working pressure, with locking type handle, cleaned for oxygen use and labeled for intended service.

### Allied Healthcare Products (Chemetron)

<u>Type</u>	<u>Size</u>	<u>Pressure/Vacuum</u>	<u>Series Number</u>
Ball	2" and smaller	400 psi/29" Hg	77-03-0000 with 77-03-9200 latch lock

B. Check:

1. 75 mm (3 inches) and Smaller: Bronze/brass body, straight through design for minimum pressure drop, spring loaded, self-aligning with Teflon cone seat, vibration free, silent operation, supplied NPT female threads at each end with flow direction arrow permanently cast into, cleaned for oxygen use and labeled for intended service, 2758 kPa (400 psig) WOG minimum working pressure.

- C. Zone Valve in Cabinet: Ball valve, bronze/ brass body, double seal, three piece or double union end connections, replaceable Teflon seat seals, Teflon stem seal, 4138 kPa (600 psig) WOG, cold, non-shock gas working pressure service to 100 kPa (29 inches Hg), cleaned for oxygen use and labeled for intended service, blowout proof stem, one quarter turn of handle to completely open or close. Provide tubing extensions factory brazed, and pressure tested. Provide 3.2 mm (1/8 inch) NPT gauge port for a 50 mm (2 inch) diameter monitoring gauge downstream of the shutoff valve. Zone valves shall be securely attached to the cabinet and provided with type "K" copper tube extensions for making connection to system piping outside the cabinet. Zone valves shall be products of one manufacturer, and uniform throughout in pattern, overall size and appearance. Trim with color-coded plastic inserts or color-coded stick-on labels. Install valves in cabinets such that cover window cannot be in place when any valve is in the closed position. Color coding for identification plates and labels is as follows:

SERVICE LABEL	IDENTIFICATION COLORS	MFG. STD. CLR.
OXYGEN	White letters on green background	GREEN

Allied Healthcare - Chemetron

Double Valve #77-82-0000

#### 2.4 VALVE CABINETS

- A. Flush mounted commercially available item for use with healthcare services, not lighter than 1.3 mm (18 gage) steel or 1.9 mm (14 gage) extruded aluminum, rigidly assembled, of adequate size to accommodate valve(s) and fittings. Punch or drill sides to receive tubing. Provide anchors to secure cabinet to wall construction. Seal openings in cabinet to be dust tight. Locate bottom of cabinet 1375 mm (4 feet 6 inches) above finished floor.
- B. Mount engraved rigid plastic identification plate on wall above or adjacent to cabinet. Color code identification plate to match gas identification colors as indicated above. Identification plate shall be clearly visible at all times. Provide inscriptions on plate to read in substance: "VALVE CONTROL SUPPLY TO ROOMS."

- C. Cover Plate: Fabricate from 1.3 mm (18 gage) sheet metal with satin chromed finish, extruded anodized aluminum, or 0.85 mm (22 gage) stainless steel. Provide cover window of replaceable plastic, with a corrosion resistant device or lever secured to window for emergency window removal. Permanently paint or stencil on window: CAUTION-CLOSE ONLY IN EMERGENCY, SHUT-OFF VALVES FOR PIPED GASES", or equivalent wording. Configure such that it is not possible to install window with any valve in the closed position. Each valve shall have gauge upstream of valve inside valve box.
- D. Cabinets and isolation valves shall be located and piped as shown on drawings, and at a minimum, so as to allow the isolation of each smoke compartment separately. No cabinet shall serve more than one smoke compartment.

## **2.5 GAGES**

- A. Pressure Gages: Includes gages temporarily supplied for testing purposes.
1. For Line Pressure Use Adjacent to Source Equipment: ASME B40.1, pressure gage, single, size 115 mm (4-1/2 inches), for compressed air, nitrogen and oxygen, accurate to within 2 percent, with metal case. Range shall be two times operating pressure. Dial graduations and figures shall be black on a white background, or white on a black background. Gage shall be cleaned for oxygen use, labeled for appropriate service, and marked "USE NO OIL". Install with gage cock.
  2. For All Services Downstream of Main Shutoff Valve: Manufactured for oxygen use, labeled for the appropriate service and marked "USE NO OIL", 40 mm (1-1/2 inch) diameter gage with dial range 1 to 690 kPa (1 to 100 psig) for oxygen service.

## 2.6 STATION OUTLETS – ROOM #4262

- A. Manufacturer: Amico recessed locking stainless steel security console box and stainless steel door frame assembly #W-X-SEC-PCON-03 (3) outlets, each box/each side of bed with Allied Healthcare – Chemetron Quick-Connect Series "B" #64-01-5001, #64-01-5003 or equal, compatible with locking panel.
- B. For All Services: For designated service, consisting of a quick coupler and inlet supply tube. Provide coupler that is non-interchangeable with other services, and leak proof under three times the normal working pressure. Equip each station outlet with an automatic valve and a secondary check valve to conform with NFPA 99. Equip each station inlet with an automatic valve to conform with NFPA 99. Place valves in the assembly to provide easy access after installation for servicing and replacement, and to facilitate line blow-out, purging, and testing. Fasten each outlet and inlet securely to rough-in to prevent floating and provide each with a capped stub length of 6 mm (1/4-inch) (10 mm outside diameter) (3/8-inch outside diameter) tubing for connection to supply. Identification of each gas service shall be permanently cast into the back plate and shall be visible through a transparent plastic guard. Label stub tubing for appropriate service. Rough-in kits and test plugs for PBPU are furnished under this specification but installed by manufacturer of PBPU before initial test specified herein. Install completion kits (valve body and face plate) for the remainder of required tests.

## 2.7 STATION OUTLET ROUGH-IN

- A. Anchor flush mounted rough-in securely to unit or wall construction, compatible with locking stainless steel security console box.
- B. Modular Cover Plate: Die cast back plate, two-piece 0.85 mm (22 gage) stainless steel or 1.6 mm (16 gage) chromium plated metal, with mounting flanges on all four sides, secured to rough-in with stainless steel or chromium plated countersunk screws.
- C. Cover Plate for PBPU: One-piece with construction and material as indicated for modular cover plate.
- D. Provide permanent, metal or plastic, identification plates securely fastened at each outlet and inlet opening, with inscription for appropriate service using color coded letters and background. Metal plates shall have letters embossed on baked-on enamel background. Color coding for identification plates is as follows:

SERVICE LABEL	IDENTIFICATION PLATE COLORS
---------------	-----------------------------

SERVICE LABEL	IDENTIFICATION PLATE COLORS
OXYGEN	White letters on green background and vice versa

## 2.8 ALARMS

A. Provide all low voltage control wiring, including wiring from alarm relay interface control cabinet to BAS, required for complete, proper functioning system, in conformance with Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES. Run wiring in conduit, in conformance with Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS.

### B. Alarm Functions:

1. Oxygen, Pressure Alarms: Functions when pressure in branch drops below 275 kPa (40 psig),  $\pm 14$  kPa ( $\pm 2$  psig) or increases above 414 kPa (60 psig),  $\pm 14$  kPa ( $\pm 2$  psig) set points; operated by pressure switches or transmitters.
2. Vacuum Alarms: Low Vacuum Alarm: Functions when vacuum in branch drops below 40 kPa (12 inches Hg); operated by vacuum switch.

Allied Healthcare - Chemetron

Area Alarms: 374-15-OAV Series (Impact) with gas-specific transducers

(3) Module: #74-15-XXX Series (Impact) without gas-specific Transducers

Transducer #74-14-9051

### 3. Vacuum Alarms:

- a. Low Vacuum Alarm: Function when system vacuum upstream of main shutoff valve drops below 40 kPa (12 inches Hg); operated by vacuum switch.
- b. Filter Differential Pressure/Back Pressure Alarm: Functions when discharge oil filter differential rises to set level, or when back pressure is sensed; receives signal from pump control panel.

### C. Alarm Panels:

1. General: Modular design, easily serviced and maintained; alarms operate on alternating current (AC) low voltage control circuit; provide required number of transformers for efficient functioning of complete system. Alarm panels shall be integral units, reporting oxygen and vacuum services, as required.
2. Box: Flush mounted, sectional or one piece, corrosion resistant. Size box to accommodate required number of service functions for

- each location, and for one audible signal in each box. Anchor box securely. Provide spare capacity to accommodate 50 percent of the number of provided alarm points.
3. Cover Plate: Designed to accommodate required number of signals, visual and audible, for each location, and containing adequate operating instructions within the operator's view. Bezel shall be extruded aluminum, chromium plated metal, or plastic. Secure to the box with chromium plated or stainless steel countersunk screws.
  4. Service Indicator Lights: Red translucent plastic or LED with proper service identification inscribed thereon. Number of lights and service instruction shall be as required for each location. Provide each panel with a green test button of the same material, inscribed with "PUSH TO TEST" or similar message.
  5. Audible Signal: Provide one in each alarm panel and connect electrically with all service indicator light functions.
  6. Controls:
    - a. Visual Signal: When the condition occurs which any individual service indicator light is to report, button for particular service shall give a lighted visual signal which cannot be canceled until such condition is corrected.
    - b. Audible Signal: Alarm shall give an audible signal upon circuit energization of any visual signal. Audible signal shall be continuous until silenced by pushing a button. This shall cancel and reset audible only, and not affect the visual signal. After silencing, subsequent alarms shall reactivate the audible alarm.
    - c. Signal Tester: Test button or separate normal light shall be continuously lighted to indicate electrical circuit serving each individual alarm is energized. Pushing test button shall temporarily activate all visual signals and sound audible signal, thereby providing desired indications of status of system.
  - D. Alarm Relay Interface Control Cabinet: Design cabinet to transfer the closed-circuit alarm signals through relays to a set of terminals for monitoring signals at the BAS without interrupting the closed-circuit system. Constructed of 1.9 mm (14 gage) steel, conforming with NEMA ICS 6, Type 1, enclosures. Provide both normally open and normally closed contacts for output signals, with number of circuits required

for full alarm capability at the BAS. Refer to Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC for compatibility.

## **2.9 PRESSURE REGULATORS**

- A. For 690 kPa (100 psig) regulator, provide duplex in parallel, valve for maintenance shut-down without service interruption. For additional pressures, locate regulators remote from compressor near point of use, and provide with isolation valves and valve bypass.
- 1. For systems 5 L/s (10 SCFM) and below: Brass or bronze body and trim, reduced pressure range 170 to 850 kPa (25 to 123 psig) adjustable, spring type, diaphragm operated, relieving. Delivered pressure shall vary not more than 1.0 kPa (0.15 psig) for each 10 kPa (1.5 psig) variation in inlet pressure.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Install cast escutcheon with set screw at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
- B. Open ends of tube shall be capped or plugged at all times or otherwise sealed until final assembly to prevent infiltration of any foreign matter.
- C. Cut piping square and accurately with a tube cutter (sawing is prohibited) to measurements determined at place of installation. Ream tube to remove burrs, being careful not to expand tube, and so no chips of copper remain in the tube. Work into place without springing or forcing. Bottom tube in socket so there are no gaps between tube and fitting. Exercise care in handling equipment and tools used in cutting or reaming of tube to prevent oil or grease being introduced into tubing. Where contamination has occurred, material is no longer suitable for oxygen service.
- D. Spacing of hangers: NFPA 99.
- E. Rigidly support valves and other equipment to prevent strain on tube or joints.
- F. While being brazed, joints shall be continuously purged with oil-free nitrogen. The flow of purged gas shall be maintained until joint is cool to touch.
- G. Do not bend tubing. Use fittings.

- H. Install pressure switches, transmitter and gauges to be easily accessed, and provide access panel where installed above plaster ceiling. Install pressure switch and sensors with orifice nipple between the pipe line and switches/sensors.
- I. Apply pipe labeling during installation process and not after installation is completed. Size of legend letters shall be in accordance with ASME A13.1.
- J. After initial leakage testing is completed, allow piping to remain pressurized with testing gas until testing agency performs final tests.
- K. Penetrations:
  - 1. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoked partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING, with intumescent materials only. Completely fill and seal clearances between raceways and openings with the fire stopping material.
  - 2. Waterproofing: At floor penetrations, completely seal clearances around the pipe and make watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS. Bio-based materials shall be utilized when possible.
- L. Provide 40 mm (1-1/2 inch) diameter line pressure gage downstream of zone valve in cabinets.
- M. Provide zone valves in cabinets where indicated and a minimum one zone valve assembly for each 18 outlet set.

### **3.2 STARTUP AND TESTING**

- A. Initial Tests: Blow down and high and low pressure leakage tests as required by NFPA 99 with documentation.
- B. Healthcare testing agency shall perform the following:
  - 1. Perform and document all cross-connection tests, labeling verification, supply system operation, and valve and alarm operation tests as required by, and in accordance with NFPA 99 and the procedures set forth in pre-qualification documentation.
  - 2. Verify that the systems, as installed, meet or exceed the requirements of NFPA 99, this specification, and that the systems operate as required.



3. Piping Purge Test: For each positive pressure gas system, verify cleanliness of piping system. Filter a minimum of 1000 liters (35 cubic feet) of gas through a clean white 0.45 micron filter at a minimum velocity of 100 liters per minute (3.5 SCFM). Filter shall show no discoloration, and shall accrue no more than 0.1 mg (0.0000035 ounces) of matter. Test each zone at the outlet most remote from the source. Perform test with the use of an inert gas as described in CGA P-9.
4. Piping Purity Test: For each positive pressure system, verify purity of piping system. Test each zone at the most remote outlet for dew point, carbon monoxide, total hydrocarbons (as methane), and halogenated hydrocarbons, and compare with source gas. The two tests shall in no case exceed variation as specified in paragraph, "Maximum Allowable Variation". Perform test with the use of an inert gas as described in CGA P-9.
5. Outlet and Inlet Flow Test:
  - a. Test all outlets for flow. Perform test with the use of an inert gas as described in CGA P-9.
  - b. Oxygen outlets shall deliver 100 Lpm (3.5 SCFM) with a pressure drop of no more than 34 kPa (5 psig), and static pressure of 345 kPa (50 psig).
  - c. Needle valve air outlets shall deliver 1.5 SCFM with a pressure drop of no more than five psig, and static pressure of 345 kPa (50 psig).
6. Analysis Test:
  - a. Analyze each pressure gas source and outlet for concentration of gas, by volume.
  - b. Make analysis with instruments designed to measure the specific gas dispensed.
  - c. Allowable concentrations are within the following:
    - 1) 23.5 percent oxygen.

Oxygen	>=97% plus oxygen
--------	-------------------
- C. Coordinate the startup and contractor testing schedules with the COR. Contractor shall provide a minimum of 10 working days prior to startup and testing.

### 3.3 DEMONSTRATION AND TRAINING

- A. Provide services of manufacturer's technical representative for two hours to instruct VA Personnel in operation and maintenance of units.

---END---



**SECTION 23 05 11**  
**COMMON WORK RESULTS FOR HVAC**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. The requirements of this Section apply to all sections of Division 23.
- B. Definitions:
  - 1. Exposed: Piping, ductwork, and equipment exposed to view in finished rooms.
  - 2. Option or optional: Contractor's choice of an alternate material or method.
  - 3. RE: Resident Engineer
  - 4. COTR: Contracting Officer's Technical Representative.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES
- C. Section 07 84 00, FIRESTOPPING
- D. Section 07 92 00, JOINT SEALANTS
- E. Section 09 91 00, PAINTING
- F. Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC
- G. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS
- H. Section 26 05 19, LOW VOLTAGE ELECTRICAL POWER CONDUITS and CABLES

**1.3 QUALITY ASSURANCE**

- A. Mechanical, electrical and associated systems shall be safe, reliable, efficient, durable, easily and safely operable and maintainable, easily and safely accessible, and in compliance with applicable codes as specified. The systems shall be comprised of high quality institutional-class and industrial-class products of manufacturers that are experienced specialists in the required product lines. All construction firms and personnel shall be experienced and qualified specialists in industrial and institutional HVAC.
- B. Flow Rate Tolerance for HVAC Equipment: Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.
- C. Equipment Vibration Tolerance:
  - 1. Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT. Equipment shall be factory-balanced to this tolerance and re-balanced on site, as necessary.
  - 2. After HVAC air balance work is completed and permanent drive sheaves are in place, perform field mechanical balancing and adjustments required to meet the specified vibration tolerance.

D. Products Criteria:

1. Standard Products: Material and equipment shall be the standard products of a manufacturer regularly engaged in the manufacture of the products for at least 3 years (or longer as specified elsewhere). The design, model and size of each item shall have been in satisfactory and efficient operation on at least three installations for approximately three years. However, digital electronics devices, software and systems such as controls, instruments, computer work station, shall be the current generation of technology and basic design that has a proven satisfactory service record of at least three years. See other specification sections for any exceptions and/or additional requirements.
2. All items furnished shall be free from defects that would adversely affect the performance, maintainability and appearance of individual components and overall assembly.
3. Conform to codes and standards as required by the specifications. Conform to local codes, if required by local authorities such as the natural gas supplier, if the local codes are more stringent than those specified. Refer any conflicts to the Resident Engineer.
4. Multiple Units: When two or more units of materials or equipment of the same type or class are required, these units shall be products of one manufacturer.
5. Assembled Units: Manufacturers of equipment assemblies which use components made by others assume complete responsibility for the final assembled product.
6. Nameplates: Nameplate bearing manufacturer's name or identifiable trademark shall be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.
7. Asbestos products or equipment or materials containing asbestos shall not be used.

E. Equipment Service Organizations:

1. HVAC: Products and systems shall be supported by service organizations that maintain a complete inventory of repair parts and are located within 50 miles to the site.

F. HVAC Mechanical Systems Welding: Before any welding is performed, Contractor shall submit a certificate certifying that welders comply with the following requirements:

G. Execution (Installation, Construction) Quality:

1. Apply and install all items in accordance with manufacturer's written instructions. Refer conflicts between the manufacturer's instructions and the contract drawings and specifications to the Resident Engineer for resolution. Provide written hard copies or computer files of manufacturer's installation instructions to the Resident Engineer at least two weeks prior to commencing installation of any item. Installation of the item will not be allowed to proceed until the recommendations are received. Failure to furnish these recommendations is a cause for rejection of the material.

- H. Upon request by Government, provide lists of previous installations for selected items of equipment. Include contact persons who will serve as references, with telephone numbers and e-mail addresses.

**1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, and with requirements in the individual specification sections.
- B. Contractor shall make all necessary field measurements and investigations to assure that the equipment and assemblies will meet contract requirements.
- C. If equipment is submitted which differs in arrangement from that shown, provide drawings that show the rearrangement of all associated systems. Approval will be given only if all features of the equipment and associated systems, including accessibility, are equivalent to that required by the contract.
- D. Prior to submitting shop drawings for approval, Contractor shall certify in writing that manufacturers of all major items of equipment have each reviewed drawings and specifications, and have jointly coordinated and properly integrated their equipment and controls to provide a complete and efficient installation.
- E. Submittals and shop drawings for interdependent items, containing applicable descriptive information, shall be furnished together and complete in a group. Coordinate and properly integrate materials and equipment in each group to provide a completely compatible and efficient.

- F. Samples: Samples will not be required, except for insulation or where materials offered differ from specification requirements. Samples shall be accompanied by full description of characteristics different from specification. The Government, at the Government's expense, will perform evaluation and testing if necessary. The Contractor may submit samples of additional material at the Contractor's option; however, if additional samples of materials are submitted later, pursuant to Government request, adjustment in contract price and time will be made.
- G. Manufacturer's Literature and Data: Submit under the pertinent section rather than under this section.
1. Equipment and materials identification.
  2. Fire-stopping materials.
  3. Hangers, inserts, supports and bracing. Provide load calculations for constant support hangers.
  4. Wall, floor, and ceiling plates.
- H. HVAC Maintenance Data and Operating Instructions:
1. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Article, INSTRUCTIONS, for systems and equipment.
  2. Provide a listing of recommended replacement parts for keeping in stock supply, including sources of supply, for equipment. Include in the listing belts for equipment: Belt manufacturer, model number, size and style, and distinguished whether of multiple belt sets.
- I. Provide copies of approved HVAC equipment submittals to the Testing, Adjusting and Balancing Subcontractor.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Conditioning, Heating and Refrigeration Institute (AHRI):  
430-2009.....Central Station Air-Handling Units
- C. American National Standard Institute (ANSI):  
B31.1-2007.....Power Piping
- D. Air Movement and Control Association (AMCA):  
410-96.....Recommended Safety Practices for Air Moving  
Devices

- E. American Society of Mechanical Engineers (ASME):
  - Boiler and Pressure Vessel Code (BPVC):
  - Section IX-2007.....Welding and Brazing Qualifications
  - Code for Pressure Piping:
  - B31.1-2007.....Power Piping
- F. American Society for Testing and Materials (ASTM):
  - A36/A36M-08.....Standard Specification for Carbon Structural Steel
  - A575-96(2007).....Standard Specification for Steel Bars, Carbon, Merchant Quality, M-Grades
  - E84-10.....Standard Test Method for Surface Burning Characteristics of Building Materials
  - E119-09c.....Standard Test Methods for Fire Tests of Building Construction and Materials
- G. Manufacturers Standardization Society (MSS) of the Valve and Fittings Industry, Inc:
  - SP-58-2009.....Pipe Hangers and Supports-Materials, Design and Manufacture, Selection, Application, and Installation
  - SP 69-2003.....Pipe Hangers and Supports-Selection and Application
  - SP 127-2001.....Bracing for Piping Systems, Seismic - Wind - Dynamic, Design, Selection, Application
- H. National Electrical Manufacturers Association (NEMA):
  - MG-1-2009.....Motors and Generators
- I. National Fire Protection Association (NFPA):
  - 54-09.....National Fuel Gas Code
  - 70-08.....National Electrical Code
  - 90A-09.....Standard for the Installation of Air Conditioning and Ventilating Systems
  - 101-09.....Life Safety Code

**1.6 DELIVERY, STORAGE AND HANDLING****A. Protection of Equipment:**

1. Equipment and material placed on the job site shall remain in the custody of the Contractor until phased acceptance, whether or not the Government has reimbursed the Contractor for the equipment and material. The Contractor is solely responsible for the protection of such equipment and material against any damage.
2. Place damaged equipment in first class, new operating condition; or, replace same as determined and directed by the Resident Engineer. Such repair or replacement shall be at no additional cost to the Government.
3. Protect interiors of new equipment and piping systems against entry of foreign matter. Clean both inside and outside before painting or placing equipment in operation.
4. Existing equipment and piping being worked on by the Contractor shall be under the custody and responsibility of the Contractor and shall be protected as required for new work.

**B. Cleanliness of Piping and Equipment Systems:**

1. Exercise care in storage and handling of equipment and piping material to be incorporated in the work. Remove debris arising from cutting, threading and welding of piping.
2. Piping systems shall be flushed, blown or pigged as necessary to deliver clean systems.
3. Clean interior of all tanks prior to delivery for beneficial use by the Government.
4. Contractor shall be fully responsible for all costs, damage, and delay arising from failure to provide clean systems.

**1.7 JOB CONDITIONS - WORK IN EXISTING BUILDING**

- A. Building Operation: Government employees will be continuously operating and managing all facilities, including temporary facilities, that serve the medical center.
- B. Maintenance of Service: Schedule all work to permit continuous service as required by the medical center.
- C. Phasing of Work: Comply with all requirements shown on drawings or specified.



- D. Building Working Environment: Maintain the architectural and structural integrity of the building and the working environment at all times. Maintain the interior of building at 18 degrees C (65 degrees F) minimum. Limit the opening of doors, windows or other access openings to brief periods as necessary for rigging purposes. No storm water or ground water leakage permitted. Provide daily clean-up of construction and demolition debris on all floor surfaces and on all equipment being operated by VA.
- E. Acceptance of Work for Government Operation: As new facilities are made available for operation and these facilities are of beneficial use to the Government, inspections will be made and tests will be performed. Based on the inspections, a list of contract deficiencies will be issued to the Contractor. After correction of deficiencies as necessary for beneficial use, the Contracting Officer will process necessary acceptance and the equipment will then be under the control and operation of Government personnel.

#### **1.8 INSTRUCTIONS**

- A. Instructions: Contractor shall provide qualified, factory-trained manufacturers' representatives to give detailed training to assigned Department of Veterans Affairs personnel in the operation and complete maintenance for each piece of equipment. All such training will be at the job site. Instructions for different items of equipment that are component parts of a complete system shall be given in an integrated, progressive manner. All instructors for every piece of component equipment in a system shall be available until instructions for all items included in the system have been completed. This is to assure proper instruction in the operation of inter-related systems. All instruction periods shall be at such times as scheduled by the COR and shall be considered concluded only when the COR is satisfied in regard to complete and thorough coverage. The Contractor shall submit a course outline with associated material to the COR for review and approval prior to scheduling training to ensure the subject matter covers the expectations of the VA and the contractual requirements. The Department of Veterans Affairs reserves the right to request the removal of, and substitution for, any instructor who, in the opinion of the COR, does not demonstrate sufficient qualifications in accordance with requirements for instructors above.

**PART 2 - PRODUCTS****2.1 FACTORY-ASSEMBLED PRODUCTS**

- A. Provide maximum standardization of components to reduce spare part requirements.
- B. Manufacturers of equipment assemblies that include components made by others shall assume complete responsibility for final assembled unit.
  - 1. All components of an assembled unit need not be products of same manufacturer.
  - 2. Constituent parts that are alike shall be products of a single manufacturer.
  - 3. Components shall be compatible with each other and with the total assembly for intended service.
  - 4. Contractor shall guarantee performance of assemblies of components and shall repair or replace elements of the assemblies as required to deliver specified performance of the complete assembly.
- C. Components of equipment shall bear manufacturer's name and trademark, model number, serial number and performance data on a nameplate securely affixed in a conspicuous place, or cast integral with, stamped or otherwise permanently marked upon the components of the equipment.
- D. Major items of equipment which serve the same function must be the same make and model. Exceptions will be permitted if performance requirements cannot be met.

**2.2 COMPATIBILITY OF RELATED EQUIPMENT**

Equipment and materials installed shall be compatible in all respects with other items being furnished and with existing items so that the result will be a complete and fully operational plant that conforms to contract requirements.

**2.3 LIFTING ATTACHMENTS**

Provide equipment with suitable lifting attachments to enable equipment to be lifted in its normal position. Lifting attachments shall withstand any handling conditions that might be encountered, without bending or distortion of shape, such as rapid lowering and braking of load.

**2.4 EQUIPMENT AND MATERIALS IDENTIFICATION**

- A. Use symbols, nomenclature and equipment numbers specified, shown on the drawings and shown in the maintenance manuals. Identification for piping is specified in Section 09 91 00, PAINTING.

- B. Interior (Indoor) Equipment: Engraved nameplates, with letters not less than 48 mm (3/16-inch) high of brass with black-filled letters, or rigid black plastic with white letters specified in Section 09 91 00, PAINTING permanently fastened to the equipment. Identify unit components such as coils, filters, fans, etc.
- C. Exterior (Outdoor) Equipment: Brass nameplates, with engraved black filled letters, not less than 48 mm (3/16-inch) high riveted or bolted to the equipment.
- D. Control Items: Label all temperature and humidity sensors, controllers and control dampers. Identify and label each item as they appear on the control diagrams.
- E. Valve Tags and Lists:
  - 1. HVAC: Provide for all valves other than for equipment in Section 23 82 00, CONVECTION HEATING AND COOLING UNITS.
  - 2. Valve Tags: Engraved black filled numbers and letters not less than 13 mm (1/2-inch) high for number designation, and not less than 6.4 mm (1/4-inch) for service designation on 19 gage 38 mm (1-1/2 inches) round brass disc, attached with brass "S" hook or brass chain.
  - 3. Valve Lists: Typed or printed plastic coated card(s), sized 216 mm (8-1/2 inches) by 280 mm (11 inches) showing tag number, valve function and area of control, for each service or system. Punch sheets for a 3-ring notebook.
  - 4. Provide detailed plan for each floor of the building indicating the location and valve number for each valve. Identify location of each valve with a color-coded thumb tack in ceiling.

## **2.5 FIRESTOPPING**

Section 07 84 00, FIRESTOPPING specifies an effective barrier against the spread of fire, smoke and gases where penetrations occur for piping and ductwork. Refer to Section 23 07 11, HVAC AND PLUMBING INSULATION, for firestop pipe and duct insulation.

## **2.6 GALVANIZED REPAIR COMPOUND**

Mil. Spec. DOD-P-21035B, paint form.

## **2.7 HVAC PIPE AND EQUIPMENT SUPPORTS AND RESTRAINTS**

- A. Vibration Isolators: Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- B. Pipe Supports: Comply with MSS SP-58. Type Numbers specified refer to this standard. For selection and application, comply with MSS SP-69. Refer to Section 05 50 00, METAL FABRICATIONS, for miscellaneous metal support materials and prime coat painting requirements.

C. Attachment to Concrete Building Construction:

1. Concrete Insert: MSS SP-58, Type 18.
2. Self-Drilling Expansion Shields and Machine Bolt Expansion Anchors: Permitted in concrete not less than 102 mm (four inches) thick when approved by the Resident Engineer for each job condition.
3. Power-Driven Fasteners: Permitted in existing concrete or masonry not less than 102 mm (four inches) thick when approved by the Resident Engineer for each job condition.

D. Attachment to Steel Building Construction:

1. Welded Attachment: MSS SP-58, Type 22.
2. Beam Clamps: MSS SP-58, Types 20, 21, 28 or 29. Type 23 C-clamp may be used for individual copper tubing up to 23mm (7/8-inch) outside diameter.

E. Attachment to Metal Pan or Deck: As required for materials specified in Section 05 36 00, COMPOSITE METAL DECKING.

F. Attachment to Existing Structure: Support from existing floor/roof frame.

G. Hanger Rods: Hot-rolled steel, ASTM A36 or A575 for allowable load listed in MSS SP-58. For piping, provide adjustment means for controlling level or slope. Types 13 or 15 turn-buckles shall provide 38 mm (1-1/2 inches) minimum of adjustment and incorporate locknuts. All-thread rods are acceptable.

H. Hangers Supporting Multiple Pipes (Trapeze Hangers): Galvanized, cold formed, lipped steel channel horizontal member, not less than 41 mm by 41 mm (1-5/8 inches by 1-5/8 inches), 2.7 mm (No. 12 gage), designed to accept special spring held, hardened steel nuts. Not permitted for steam supply and condensate piping.

1. Allowable Hanger Load: Manufacturers rating less 91kg (200 pounds).
2. Guide individual pipes on the horizontal member of every other trapeze hanger with 6 mm (1/4-inch) U-bolt fabricated from steel rod. Provide Type 40 insulation shield, secured by two 13mm (1/2-inch) galvanized steel bands, or preinsulated calcium silicate shield for insulated piping at each hanger.

# I. Supports for Piping Systems:

1. Select hangers sized to encircle insulation on insulated piping.  
Refer to Section 23 07 11, HVAC AND PLUMBING INSULATION for insulation thickness. To protect insulation, provide Type 39 saddles for roller type supports or preinsulated calcium silicate shields. Provide Type 40 insulation shield or preinsulated calcium silicate shield at all other types of supports and hangers including those for preinsulated piping.
2. Piping Systems Except High and Medium Pressure Steam (MSS SP-58):
  - a. Standard Clevis Hanger: Type 1; provide locknut.
  - b. Riser Clamps: Type 8.
  - c. Wall Brackets: Types 31, 32 or 33.
  - d. Roller Supports: Type 41, 43, 44 and 46.
  - e. Saddle Support: Type 36, 37 or 38.
  - f. Turnbuckle: Types 13 or 15. Preinsulate.
  - g. U-bolt Clamp: Type 24.
  - h. Copper Tube:
    - 1) Hangers, clamps and other support material in contact with tubing shall be painted with copper colored epoxy paint, plastic coated or taped with non-adhesive isolation tape to prevent electrolysis.
    - 2) For Vertical Runs: Use epoxy painted or plastic coated riser clamps.
    - 3) Supporting Tube to Strut: Provide epoxy painted pipe straps for copper tube or plastic inserted vibration isolation clamps.
    - 4) Insulated Lines: Provide pre-insulated calcium silicate shields sized for copper tube.

# J. Pre-insulated Calcium Silicate Shields:

1. Provide 360 degree water resistant high density 965 kPa (140 psi) compressive strength calcium silicate shields encased in galvanized metal.
2. Pre-insulated calcium silicate shields to be installed at the point of support during erection.
3. Shield thickness shall match the pipe insulation.

4. The type of shield is selected by the temperature of the pipe, the load it must carry, and the type of support it will be used with.
  - a. Shields for supporting chilled or cold water shall have insulation that extends a minimum of 1 inch past the sheet metal. Provide for an adequate vapor barrier in chilled lines.
  - b. The pre-insulated calcium silicate shield shall support the maximum allowable water filled span as indicated in MSS-SP 69. To support the load, the shields may have one or more of the following features: structural inserts 4138 kPa (600 psi) compressive strength, an extra bottom metal shield, or formed structural steel (ASTM A36) wear plates welded to the bottom sheet metal jacket.
5. Shields may be used on steel clevis hanger type supports, roller supports or flat surfaces.

## **2.8 PIPE PENETRATIONS**

- A. Install sleeves during construction for other than blocked out floor openings for risers in mechanical bays.
- B. To prevent accidental liquid spills from passing to a lower level, provide the following:
  1. For Sleeves: Extend sleeve 25 mm (one inch) above finished floor and provide sealant for watertight joint.
  2. For Blocked Out Floor Openings: Provide 40 mm (1-1/2 inch) angle set in silicone adhesive around opening.
  3. For Drilled Penetrations: Provide 40 mm (1-1/2 inch) angle ring or square set in silicone adhesive around penetration.
- C. Penetrations are not allowed through beams or ribs, but may be installed in concrete beam flanges. Any deviation from these requirements must receive prior approval of Resident Engineer.
- D. Sheet Metal, Plastic, or Moisture-resistant Fiber Sleeves: Provide for pipe passing through floors, interior walls, and partitions, unless brass or steel pipe sleeves are specifically called for below.
- E. Cast Iron or Zinc Coated Pipe Sleeves: Provide for pipe passing through exterior walls below grade. Make space between sleeve and pipe watertight with a modular or link rubber seal. Seal shall be applied at both ends of sleeve.

- F. Galvanized Steel or an alternate Black Iron Pipe with asphalt coating  
Sleeves: Provide for pipe passing through concrete beam flanges, except where brass pipe sleeves are called for. Provide sleeve for pipe passing through floor of mechanical rooms, laundry work rooms, and animal rooms above basement. Except in mechanical rooms, connect sleeve with floor plate.
- G. Brass Pipe Sleeves: Provide for pipe passing through quarry tile, terrazzo or ceramic tile floors. Connect sleeve with floor plate.
- H. Sleeves are not required for wall hydrants for fire department connections or in drywall construction.
- I. Sleeve Clearance: Sleeve through floors, walls, partitions, and beam flanges shall be one inch greater in diameter than external diameter of pipe. Sleeve for pipe with insulation shall be large enough to accommodate the insulation. Interior openings shall be caulked tight with fire stopping material and sealant to prevent the spread of fire, smoke, and gases.
- J. Sealant and Adhesives: Shall be as specified in Section 07 92 00, JOINT SEALANTS.

## **2.9 DUCT PENETRATIONS**

- A. Provide firestopping for openings through fire and smoke barriers, maintaining minimum required rating of floor, ceiling or wall assembly. See Section 07 84 00, FIRESTOPPING.

## **2.10 SPECIAL TOOLS AND LUBRICANTS**

- A. Furnish, and turn over to the Resident Engineer, tools not readily available commercially, that are required for disassembly or adjustment of equipment and machinery furnished.
- B. Grease Guns with Attachments for Applicable Fittings: One for each type of grease required for each motor or other equipment.
- C. Tool Containers: Hardwood or metal, permanently identified for intended service and mounted, or located, where directed by the Resident Engineer.
- D. Lubricants: A minimum of 0.95 L (one quart) of oil, and 0.45 kg (one pound) of grease, of equipment manufacturer's recommended grade and type, in unopened containers and properly identified as to use for each different application.

## **2.11 WALL, FLOOR AND CEILING PLATES**

- A. Material and Type: Chrome plated brass or chrome plated steel, one piece or split type with concealed hinge, with set screw for fastening to pipe, or sleeve. Use plates that fit tight around pipes, cover openings around pipes and cover the entire pipe sleeve projection.
- B. Thickness: Not less than 2.4 mm (3/32-inch) for floor plates.  
For wall and ceiling plates, not less than 0.64 mm (0.025-inch) for up to 80 mm (3-inch pipe), 0.89 mm (0.035-inch) for larger pipe.
- C. Locations: Use where pipe penetrates floors, walls and ceilings in exposed locations, in finished areas only. Provide a watertight joint in spaces where brass or steel pipe sleeves are specified.

## **2.12 ASBESTOS**

Materials containing asbestos are not permitted.

## **2.13 ACCESS PANELS**

- A. Plaster Walls and Ceilings: 16 gauge frame with not less than a 20 gauge hinged door panel, prime coated steel for general applications, stainless steel for use in toilets, showers, and exterior wet areas, concealed hinges, screwdriver operated cam latch for general applications, UL listed for use in fire rated partitions if required by the application. Use the largest size access opening possible, consistent with the space and the equipment needing service; use 24" x 24" unless space limitations require a smaller panel. Panels installed by the General Trade.

# **PART 3 - EXECUTION**

## **3.1 ARRANGEMENT AND INSTALLATION OF EQUIPMENT AND PIPING**

- A. Coordinate location of piping, sleeves, inserts, hangers, ductwork and equipment. Locate piping, sleeves, inserts, hangers, ductwork and equipment clear of windows, doors, openings, light outlets, and other services and utilities. Prepare equipment layout drawings to coordinate proper location and personnel access of all facilities. Submit the drawings for review as required by Part 1. Follow manufacturer's published recommendations for installation methods not otherwise specified.



- B. Operating Personnel Access and Observation Provisions: Select and arrange all equipment and systems to provide clear view and easy access, without use of portable ladders, for maintenance and operation of all devices including, but not limited to: all equipment items, valves, filters, strainers, transmitters, sensors, control devices. All gages and indicators shall be clearly visible by personnel standing on the floor or on permanent platforms. Do not reduce or change maintenance and operating space and access provisions that are shown on the drawings.
- C. Equipment and Piping Support: Coordinate structural systems necessary for pipe and equipment support with pipe and equipment locations to permit proper installation.
- D. Location of pipe sleeves, trenches and chases shall be accurately coordinated with equipment and piping locations.
- E. Cutting Holes:
1. Cut holes through concrete and masonry by rotary core drill. Pneumatic hammer, impact electric, and hand or manual hammer type drill will not be allowed, except as permitted by Resident Engineer where working area space is limited.
  2. Locate holes to avoid interference with structural members such as beams or grade beams. Holes shall be laid out in advance and drilling done only after approval by Resident Engineer. If the Contractor considers it necessary to drill through structural members, this matter shall be referred to Resident Engineer for approval.
  3. Do not penetrate membrane waterproofing.
- F. Interconnection of Instrumentation or Control Devices: Generally, electrical and pneumatic interconnections are not shown but must be provided.
- G. Minor Piping: Generally, small diameter pipe runs from drips and drains, water cooling, and other service are not shown but must be provided.
- H. Electrical Interconnection of Controls and Instruments: This generally not shown but must be provided. This includes interconnections of sensors, transmitters, transducers, control devices, control and instrumentation panels, instruments and computer workstations. Comply with NFPA-70.

I. Protection and Cleaning:

1. Equipment and materials shall be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations and as approved by the Resident Engineer. Damaged or defective items, in the opinion of the Resident Engineer, shall be replaced.
2. Protect all finished parts of equipment, such as shafts and bearings where accessible, from rust prior to operation by means of protective grease coating and wrapping. Close pipe openings with caps or plugs during installation. Tightly cover and protect fixtures and equipment against dirt, water chemical, or mechanical injury. At completion of all work, thoroughly clean fixtures, exposed materials and equipment.

J. Concrete and Grout: Use concrete and shrink compensating grout 25 MPa (3000 psi) minimum, specified in Section 03 30 53, CAST-IN-PLACE CONCRETE.

K. Install gages, thermometers, valves and other devices with due regard for ease in reading or operating and maintaining said devices. Locate and position thermometers and gages to be easily read by operator or staff standing on floor or walkway provided. Servicing shall not require dismantling adjacent equipment or pipe work.

L. Install steam piping expansion joints as per manufacturer's recommendations.

M. Work in Existing Building:

1. Perform as specified in Article, OPERATIONS AND STORAGE AREAS, Article, ALTERATIONS, and Article, RESTORATION of the Section 01 00 00, GENERAL REQUIREMENTS for relocation of existing equipment, alterations and restoration of existing building(s).
2. As specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, OPERATIONS AND STORAGE AREAS, make alterations to existing service piping at times that will least interfere with normal operation of the facility.

3. Cut required openings through existing masonry and reinforced concrete using diamond core drills. Use of pneumatic hammer type drills, impact type electric drills, and hand or manual hammer type drills, will be permitted only with approval of the Resident Engineer. Locate openings that will least effect structural slabs, columns, ribs or beams. Refer to the Resident Engineer for determination of proper design for openings through structural sections and opening layouts approval, prior to cutting or drilling into structure. After Resident Engineer's approval, carefully cut opening through construction no larger than absolutely necessary for the required installation.
- N. Switchgear/Electrical Equipment Drip Protection: Every effort shall be made to eliminate the installation of pipe above electrical and telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints. Installation of piping, ductwork, leak protection apparatus or other installations foreign to the electrical installation shall be located in the space equal to the width and depth of the equipment and extending from to a height of 1.8 m (6 ft.) above the equipment to ceiling structure, whichever is lower (NFPA 70).
- O. Inaccessible Equipment:
1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, equipment shall be removed and reinstalled or remedial action performed as directed at no additional cost to the Government.
  2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as motors, fans, pumps, belt guards, transformers, high voltage lines, piping, and ductwork.

### **3.2 TEMPORARY PIPING AND EQUIPMENT**

- A. Continuity of operation of existing facilities will generally require temporary installation or relocation of equipment and piping.
- B. The Contractor shall provide all required facilities in accordance with the requirements of phased construction and maintenance of service. All piping and equipment shall be properly supported, sloped to drain, operate without excessive stress, and shall be insulated where injury can occur to personnel by contact with operating facilities. The requirements of Paragraph 3.1 apply.

- C. Temporary facilities and piping shall be completely removed and any openings in structures sealed. Provide necessary blind flanges and caps to seal open piping remaining in service.

### **3.3 RIGGING**

- A. Design is based on application of available equipment. Openings in building structures are planned to accommodate design scheme.
- B. Alternative methods of equipment delivery may be offered by Contractor and will be considered by Government under specified restrictions of phasing and maintenance of service as well as structural integrity of the building.
- C. Close all openings in the building when not required for rigging operations to maintain proper environment in the facility for Government operation and maintenance of service.
- D. Contractor shall provide all facilities required to deliver specified equipment and place on foundations. Attachments to structures for rigging purposes and support of equipment on structures shall be Contractor's full responsibility. Upon request, the Government will check structure adequacy and advise Contractor of recommended restrictions.
- E. Contractor shall check all clearances, weight limitations and shall offer a rigging plan designed by a Registered Professional Engineer. All modifications to structures, including reinforcement thereof, shall be at Contractor's cost, time and responsibility.
- F. Rigging plan and methods shall be referred to Resident Engineer for evaluation prior to actual work.
- G. Restore building to original condition upon completion of rigging work.

### **3.4 PIPE AND EQUIPMENT SUPPORTS**

- A. Where hanger spacing does not correspond with joist or rib spacing, use structural steel channels secured directly to joist and rib structure that will correspond to the required hanger spacing, and then suspend the equipment and piping from the channels. Drill or burn holes in structural steel only with the prior approval of the Resident Engineer.
- B. Use of chain, wire or strap hangers; wood for blocking, stays and bracing; or, hangers suspended from piping above will not be permitted. Replace or thoroughly clean rusty products and paint with zinc primer.

- C. Use hanger rods that are straight and vertical. Turnbuckles for vertical adjustments may be omitted where limited space prevents use. Provide a minimum of 15 mm (1/2-inch) clearance between pipe or piping covering and adjacent work.
- D. HVAC Horizontal Pipe Support Spacing: Refer to MSS SP-69. Provide additional supports at valves, strainers, in-line pumps and other heavy components. Provide a support within one foot of each elbow.
- E. HVAC Vertical Pipe Supports:
1. Up to 150 mm (6-inch pipe), 9 m (30 feet) long, bolt riser clamps to the pipe below couplings, or welded to the pipe and rests supports securely on the building structure.
  2. Vertical pipe larger than the foregoing, support on base elbows or tees, or substantial pipe legs extending to the building structure.
- F. Overhead Supports:
1. The basic structural system of the building is designed to sustain the loads imposed by equipment and piping to be supported overhead.
  2. Provide steel structural members, in addition to those shown, of adequate capability to support the imposed loads, located in accordance with the final approved layout of equipment and piping.
  3. Tubing and capillary systems shall be supported in channel troughs.
- G. Floor Supports:
1. Provide concrete bases, concrete anchor blocks and pedestals, and structural steel systems for support of equipment and piping. Anchor and dowel concrete bases and structural systems to resist forces under operating and seismic conditions (if applicable) without excessive displacement or structural failure.
  2. Do not locate or install bases and supports until equipment mounted thereon has been approved. Size bases to match equipment mounted thereon plus 50 mm (2 inch) excess on all edges. Bases shall be neatly finished and smoothed, shall have chamfered edges at the top, and shall be suitable for painting.
  3. All equipment shall be shimmed, leveled, firmly anchored, and grouted with epoxy grout. Anchor bolts shall be placed in sleeves, anchored to the bases. Fill the annular space between sleeves and bolts with a granular material to permit alignment and realignment.

### 3.5 MECHANICAL DEMOLITION

- A. Rigging access, other than indicated on the drawings, shall be provided by the Contractor after approval for structural integrity by the Resident Engineer. Such access shall be provided without additional cost or time to the Government. Where work is in an operating plant, provide approved protection from dust and debris at all times for the safety of plant personnel and maintenance of plant operation and environment of the plant.
- B. In an operating facility, maintain the operation, cleanliness and safety. Government personnel will be carrying on their normal duties of operating, cleaning and maintaining equipment and plant operation. Confine the work to the immediate area concerned; maintain cleanliness and wet down demolished materials to eliminate dust. Do not permit debris to accumulate in the area to the detriment of plant operation. Perform all flame cutting to maintain the fire safety integrity of this plant. Adequate fire extinguishing facilities shall be available at all times. Perform all work in accordance with recognized fire protection standards. Inspection will be made by personnel of the VA Medical Center, and Contractor shall follow all directives of the RE or COTR with regard to rigging, safety, fire safety, and maintenance of operations.
- C. Completely remove all piping, wiring, conduit, and other devices associated with the equipment not to be re-used in the new work. This includes all pipe, valves, fittings, insulation, and all hangers including the top connection and any fastenings to building structural systems. Seal all openings, after removal of equipment, pipes, ducts, and other penetrations in roof, walls, floors, in an approved manner and in accordance with plans and specifications where specifically covered. Structural integrity of the building system shall be maintained. Reference shall also be made to the drawings and specifications of the other disciplines in the project for additional facilities to be demolished or handled.

- D. All valves including gate, globe, ball, butterfly and check, all pressure gages and thermometers with wells shall remain Government property and shall be removed and delivered to Resident Engineer and stored as directed. The Contractor shall remove all other material and equipment, devices and demolition debris under these plans and specifications. Such material shall be removed from Government property expeditiously and shall not be allowed to accumulate.

### **3.6 CLEANING AND PAINTING**

- A. Prior to final inspection and acceptance of the plant and facilities for beneficial use by the Government, the plant facilities, equipment and systems shall be thoroughly cleaned and painted. Refer to Section 09 91 00, PAINTING.
- B. In addition, the following special conditions apply:
1. Cleaning shall be thorough. Use solvents, cleaning materials and methods recommended by the manufacturers for the specific tasks. Remove all rust prior to painting and from surfaces to remain unpainted. Repair scratches, scuffs, and abrasions prior to applying prime and finish coats.
  2. Material and Equipment Not To Be Painted Includes:
    - a. Motors, controllers, control switches, and safety switches.
    - b. Control and interlock devices.
    - c. Regulators.
    - d. Pressure reducing valves.
    - e. Control valves and thermostatic elements.
    - f. Lubrication devices and grease fittings.
    - g. Copper, brass, aluminum, stainless steel and bronze surfaces.
    - h. Valve stems and rotating shafts.
    - i. Pressure gauges and thermometers.
    - j. Glass.
    - k. Nameplates.
  3. Control and instrument panels shall be cleaned, damaged surfaces repaired, and shall be touched-up with matching paint obtained from panel manufacturer.
  4. Pumps, motors, steel and cast iron bases, and coupling guards shall be cleaned, and shall be touched-up with the same color as utilized by the pump manufacturer.
  5. Temporary Facilities: Apply paint to surfaces that do not have existing finish coats.

6. Paint shall withstand temperatures without peeling or discoloration.
7. Final result shall be smooth, even-colored, even-textured factory finish on all items. Completely repaint the entire piece of equipment if necessary to achieve this.

### **3.7 IDENTIFICATION SIGNS**

- A. Provide laminated plastic signs, with engraved lettering not less than 5 mm (3/16-inch) high, designating functions, for all equipment, switches, motor controllers, relays, meters, control devices, including automatic control valves. Nomenclature and identification symbols shall correspond to that used in maintenance manual, and in diagrams specified elsewhere. Attach by chain, adhesive, or screws.
- B. Factory Built Equipment: Metal plate, securely attached, with name and address of manufacturer, serial number, model number, size, performance.
- C. Pipe Identification: Refer to Section 09 91 00, PAINTING.

### **3.8 MOTOR AND DRIVE ALIGNMENT**

- A. Belt Drive: Set driving and driven shafts parallel and align so that the corresponding grooves are in the same plane.
- B. Direct-connect Drive: Securely mount motor in accurate alignment so that shafts are free from both angular and parallel misalignment when both motor and driven machine are operating at normal temperatures.

### **3.9 LUBRICATION**

- A. Lubricate all devices requiring lubrication prior to initial operation. Field-check all devices for proper lubrication.
- B. Equip all devices with required lubrication fittings or devices. Provide a minimum of one liter (one quart) of oil and 0.5 kg (one pound) of grease of manufacturer's recommended grade and type for each different application; also provide 12 grease sticks for lubricated plug valves. Deliver all materials to Resident Engineer in unopened containers that are properly identified as to application.
- C. Provide a separate grease gun with attachments for applicable fittings for each type of grease applied.
- D. All lubrication points shall be accessible without disassembling equipment, except to remove access plates.



**3.10 STARTUP AND TEMPORARY OPERATION**

Start up equipment as described in equipment specifications.

Verify that vibration is within specified tolerance prior to extended operation. Temporary use of equipment is specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT.

**3.11 OPERATING AND PERFORMANCE TESTS**

- A. Prior to the final inspection, perform required tests as specified in Section 01 00 00, GENERAL REQUIREMENTS and submit the test reports and records to the Resident Engineer.
- B. Should evidence of malfunction in any tested system, or piece of equipment or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost to the Government.
- C. When completion of certain work or system occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then make performance tests for heating systems and for cooling systems respectively during first actual seasonal use of respective systems following completion of work.

**3.12 INSTRUCTIONS TO VA PERSONNEL**

Provide in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS, and Section 23 08 11.

---END---



**SECTION 23 05 93**  
**TESTING, ADJUSTING, AND BALANCING FOR HVAC**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

A. Testing, adjusting, and balancing (TAB) of heating, ventilating and air conditioning (HVAC) systems. TAB includes the following:

1. Planning systematic TAB procedures.
2. Design Review Report.
3. Systems Inspection report.
4. Duct Air Leakage test report.
5. Systems Readiness Report.
6. Balancing air distribution systems for existing rooms as identified in the drawings; adjustment of total system to provide design performance; and testing performance of equipment and automatic controls.
7. Recording and reporting results.

B. Definitions:

1. Basic TAB used in this Section: Chapter 38, "Testing, Adjusting and Balancing" of 2011 ASHRAE Handbook, "HVAC Applications".
2. TAB: Testing, Adjusting and Balancing; the process of checking and adjusting HVAC systems to meet design objectives.
3. AABC: Associated Air Balance Council.
4. NEBB: National Environmental Balancing Bureau.
5. Hydronic Systems: Includes chilled water, heating hot water and glycol-water systems.
6. Air Systems: Includes all outside air, supply air, return air, exhaust air and relief air systems.
7. Flow rate tolerance: The allowable percentage variation, minus to plus, of actual flow rate from values (design) in the contract documents.

**1.2 RELATED WORK**

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- C. Section 23 31 00, HVAC DUCTS AND CASINGS.

### 1.3 QUALITY ASSURANCE

- A. Refer to Articles, Quality Assurance and Submittals, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Qualifications:
  1. TAB Agency: The TAB agency shall be a subcontractor of the General Contractor and shall report to and be paid by the General Contractor.
  2. The TAB agency shall be either a certified member of AABC or certified by the NEBB to perform TAB service for HVAC balancing and vibrations and sound testing of equipment. The certification shall be maintained for the entire duration of duties specified herein. If, for any reason, the agency loses subject certification during this period, the General Contractor shall immediately notify the Resident Engineer and submit another TAB firm for approval. Any agency that has been the subject of disciplinary action by either the AABC or the NEBB within the five years preceding Contract Award shall not be eligible to perform any work related to the TAB. All work performed in this Section and in other related Sections by the TAB agency shall be considered invalid if the TAB agency loses its certification prior to Contract completion, and the successor agency's review shows unsatisfactory work performed by the predecessor agency.
  3. TAB Specialist: The TAB specialist shall be either a member of AABC or an experienced technician of the Agency certified by NEBB. The certification shall be maintained for the entire duration of duties specified herein. If, for any reason, the Specialist loses subject certification during this period, the General Contractor shall immediately notify the Resident Engineer and submit another TAB Specialist for approval. Any individual that has been the subject of disciplinary action by either the AABC or the NEBB within the five years preceding Contract Award shall not be eligible to perform any duties related to the HVAC systems, including TAB. All work specified in this Section and in other related Sections performed by the TAB specialist shall be considered invalid if the TAB Specialist loses its certification prior to Contract completion and must be performed by an approved successor.

4. TAB Specialist shall be identified by the General Contractor within 60 days after the notice to proceed. The TAB specialist will be coordinating, scheduling and reporting all TAB work and related activities and will provide necessary information as required by the Resident Engineer. The responsibilities would specifically include:
    - a. Shall directly supervise all TAB work.
    - b. Shall sign the TAB reports that bear the seal of the TAB standard. The reports shall be accompanied by report forms and schematic drawings required by the TAB standard, AABC or NEBB.
    - c. Would follow all TAB work through its satisfactory completion.
    - d. Shall provide final markings of settings of all HVAC adjustment devices.
    - e. Permanently mark location of duct test ports.
  5. All TAB technicians performing actual TAB work shall be experienced and must have done satisfactory work on a minimum of 3 projects comparable in size and complexity to this project. Qualifications must be certified by the TAB agency in writing. The lead technician shall be certified by AABC or NEBB
- C. Test Equipment Criteria: The instrumentation shall meet the accuracy/calibration requirements established by AABC National Standards or by NEBB Procedural Standards for Testing, Adjusting and Balancing of Environmental Systems and instrument manufacturer. Provide calibration history of the instruments to be used for test and balance purpose.
- D. Tab Criteria:
1. One or more of the applicable AABC, NEBB or SMACNA publications, supplemented by ASHRAE Handbook "HVAC Applications" Chapter 38, and requirements stated herein shall be the basis for planning, procedures, and reports.
  2. Flow Rate Tolerance: Following tolerances are allowed.  
For tolerances not mentioned herein follow 2011 ASHRAE Handbook "HVAC Applications", Chapter 38, as a guideline. Air Filter resistance during tests, artificially imposed if necessary, shall be at least 100 percent of manufacturer recommended change over pressure drop values for pre-filters and after-filters.
    - a. Air Handling Unit and All Other Fans, Cubic Meters/Min  
(Cubic Feet Per Minute): Minus 0 percent to plus 10 percent.

- b. Air Terminal Units (maximum values): Minus 2 percent to plus 10 percent.
  - c. Minimum Outside Air: 0 percent to plus 10 percent.
  - d. Individual Room Air Outlets and Inlets, and Air Flow Rates Not Mentioned Above: Minus 5 percent to plus 10 percent except if the air to a space is 100 CFM or less the tolerance would be minus 5 to plus 5 percent.
- 3. Systems shall be adjusted for energy efficient operation as described in PART 3.
  - 4. Typical TAB procedures and results shall be demonstrated to the Resident Engineer for one air distribution system (including all fans, three terminal units, three rooms randomly selected by the Resident Engineer) and one hydronic system (pumps and three coils) as follows:
    - a. When field TAB work begins.
    - b. During each partial final inspection and the final inspection for the project if requested by VA.

#### **1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Submit names and qualifications of TAB agency and TAB specialists within 60 days after the notice to proceed. Submit information on three recently completed projects and a list of proposed test equipment.
- C. For use by the Resident Engineer staff, submit one complete set of applicable AABC or NEBB publications that will be the basis of TAB work.
- D. Submit Following for Review and Approval:
  - 1. Design Review Report within 90 days for conventional design projects after the system layout on air and water side is completed by the Contractor.
  - 2. Systems inspection report on equipment and installation for conformance with design.
  - 3. Duct Air Leakage Test Report.
  - 4. Systems Readiness Report.

5. Intermediate and Final TAB reports covering flow balance and adjustments, performance tests, vibration tests and sound tests.
  6. Include in final reports uncorrected installation deficiencies noted during TAB and applicable explanatory comments on test results that differ from design requirements.
- E. Prior to request for Final or Partial Final inspection, submit completed Test and Balance report for the area.

### **1.5 APPLICABLE PUBLICATIONS**

- A. The following publications form a part of this specification to the extent indicated by the reference thereto. In text the publications are referenced to by the acronym of the organization.
- B. American Society of Heating, Refrigerating and Air Conditioning Engineers, Inc. (ASHRAE):
- 2011 .....HVAC Applications ASHRAE Handbook, Chapter 38,  
Testing, Adjusting, and Balancing and Chapter  
48, Sound and Vibration Control
- C. Associated Air Balance Council (AABC):
- 2002.....AABC National Standards for Total System  
Balance
- D. National Environmental Balancing Bureau (NEBB):
- 7<sup>th</sup> Edition 2005 .....Procedural Standards for Testing, Adjusting,  
Balancing of Environmental Systems
- 2nd Edition 2006 .....Procedural Standards for the Measurement  
of Sound and Vibration
- 3<sup>rd</sup> Edition 2009 .....Procedural Standards for Whole Building Systems  
Commissioning of New Construction
- E. Sheet Metal and Air Conditioning Contractors National Association (SMACNA):
- 3<sup>rd</sup> Edition 2002 .....HVAC SYSTEMS Testing, Adjusting and Balancing

## **PART 2 - PRODUCTS**

### **2.1 PLUGS**

Provide plastic plugs to seal holes drilled in ductwork for test purposes.

### **2.2 INSULATION REPAIR MATERIAL**

See Section 23 07 11, HVAC INSULATION. Provide for repair of insulation removed or damaged for TAB work.

**PART 3 - EXECUTION****3.1 GENERAL**

- A. Refer to TAB Criteria in Article, Quality Assurance.
- B. Obtain applicable contract documents and copies of approved submittals for HVAC equipment and automatic control systems.

**3.2 DESIGN REVIEW REPORT**

The TAB Specialist shall review the Contract Plans and specifications and advise the Resident Engineer of any design deficiencies that would prevent the HVAC systems from effectively operating in accordance with the sequence of operation specified or prevent the effective and accurate TAB of the system. The TAB Specialist shall provide a report individually listing each deficiency and the corresponding proposed corrective action necessary for proper system operation.

**3.3 SYSTEMS INSPECTION REPORT**

- A. Inspect equipment and installation for conformance with design.
- B. The inspection and report is to be done after air distribution equipment is on site and duct installation has begun, but well in advance of performance testing and balancing work. The purpose of the inspection is to identify and report deviations from design and ensure that systems will be ready for TAB at the appropriate time.
- C. Reports: Follow check list format developed by AABC, NEBB or SMACNA, supplemented by narrative comments, with emphasis on air handling units and fans. Check for conformance with submittals. Verify that diffuser and register sizes are correct. Check air terminal unit installation including their duct sizes and routing.

**3.4 DUCT AIR LEAKAGE TEST REPORT**

TAB Agency shall perform the leakage test as outlined in "Duct leakage Tests and Repairs" in Section 23 31 00, HVAC DUCTS and CASINGS for TAB agency's role and responsibilities in witnessing, recording and reporting of deficiencies.

**3.5 SYSTEM READINESS REPORT**

- A. The TAB Contractor shall measure existing air and water flow rates associated with existing systems utilized to serve renovated areas as indicated on drawings. Submit report of findings to Resident Engineer.



- B. Inspect each system to ensure that it is complete including installation and operation of controls. Submit report to Resident Engineer in standard format and forms prepared and or approved by the Commissioning Agent.
- C. Verify that all items such as ductwork piping, ports, terminals, connectors, etc., that is required for TAB are installed. Provide a report to the Resident Engineer.

### **3.6 TAB REPORTS**

- A. Submit an intermediate report for 50 percent of systems and equipment tested and balanced to establish satisfactory test results.
- B. The TAB contractor shall provide raw data immediately in writing to the Resident Engineer if there is a problem in achieving intended results before submitting a formal report.
- C. If over 20 percent of readings in the intermediate report fall outside the acceptable range, the TAB report shall be considered invalid and all contract TAB work shall be repeated and re-submitted for approval at no additional cost to the Owner.
- D. Do not proceed with the remaining systems until intermediate report is approved by the Resident Engineer.

### **3.7 TAB PROCEDURES**

- A. Tab shall be performed in accordance with the requirement of the Standard under which TAB agency is certified by either AABC or NEBB.
- B. General: During TAB all related system components shall be in full operation. Fan and pump rotation, motor loads and equipment vibration shall be checked and corrected as necessary before proceeding with TAB. Set controls and/or block off parts of distribution systems to simulate design operation of variable volume air or water systems for test and balance work.
- C. Coordinate TAB procedures with existing systems and any phased construction completion requirements for the project. Provide TAB reports for each phase of the project prior to partial final inspections of each phase of the project.
- D. Allow 3 days time in construction schedule for TAB and submission of all reports for an organized and timely correction of deficiencies.

- E. Air Balance and Equipment Test: Include air handling units, fans, terminal units, fan coil units, and room diffusers/outlets/inlets.
1. Artificially load air filters by partial blanking to produce air pressure drop of manufacturer's recommended pressure drop.
  2. Adjust fan speeds to provide design air flow. V-belt drives, including fixed pitch pulley requirements, are specified in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
  3. Test and balance systems in all specified modes of operation, including variable volume, economizer, and fire emergency modes. Verify that dampers and other controls function properly.
  4. Record final measurements for air handling equipment performance data sheets.

### **3.8 MARKING OF SETTINGS**

Following approval of Tab final Report, the setting of all HVAC adjustment devices including valves, splitters and dampers shall be permanently marked by the TAB Specialist so that adjustment can be restored if disturbed at any time. Style and colors used for markings shall be coordinated with the Resident Engineer.

### **3.9 IDENTIFICATION OF TEST PORTS**

The TAB Specialist shall permanently and legibly identify the location points of duct test ports. If the ductwork has exterior insulation, the identification shall be made on the exterior side of the insulation. All penetrations through ductwork and ductwork insulation shall be sealed to prevent air leaks and maintain integrity of vapor barrier.

### **3.10 PHASING**

- A. Phased Projects: Testing and Balancing Work to follow project with areas shall be completed per the project phasing. Upon completion of the project, all areas shall have been tested and balanced per the contract documents.
- B. Existing Areas: The existing patient area will be partially remodeled. There is no requirement to rebalance this entire area.

---END---

**SECTION 23 09 23**  
**DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Provide (a) direct-digital control system(s) as indicated on the project documents, point list, interoperability tables, drawings and as described in these specifications. Include a complete and working direct-digital control system. Include all engineering, programming, controls and installation materials, installation labor, commissioning and start-up, training, final project documentation and warranty.
1. The direct-digital control system shall be Siemens PL-1 protocol. All controllers, devices and components shall be Siemens or approved by Siemens for use in a Siemens PL-1 protocol Network. All new workstations, controller, devices and components shall be accessible using a VPN interface and shall communicate exclusively using the Siemens PL-1 communications protocol without the use of gateways, unless otherwise allowed by this Section of the technical specifications, specifically shown on the design drawings and specifically requested otherwise by the VA.
  2. The work administered by this Section of the technical specifications shall include all labor, materials, special tools, equipment, enclosures, power supplies, software, software licenses, Project specific software configurations and database entries, interfaces, wiring, tubing, installation, labeling, engineering, calibration, documentation, submittals, testing, verification, training services, permits and licenses, transportation, shipping, handling, administration, supervision, management, insurance, Warranty, specified services and items required for complete and fully functional Controls Systems.
  3. The control systems shall be designed such that each mechanical system shall operate under stand-alone mode. The contractor administered by this Section of the technical specifications shall provide controllers for each mechanical system. In the event of a network communication failure, or the loss of any other controller, the control system shall continue to operate independently. Failure of the ECC shall have no effect on the field controllers, including those involved with global strategies.

- B. Some products are furnished but not installed by the contractor administered by this Section of the technical specifications. The Contractor administered by this Section of the technical specifications shall formally coordinate in writing and receive from other contractor's formal acknowledgements in writing prior to submission the installation of the products. These products include the following:
1. Control valves.
  2. Flow switches.
  3. Flow meters.
  4. Sensor wells and sockets in piping.
  5. Terminal unit controllers.
- C. Some products are installed but not furnished by the Contractor administered by this Section of the technical specifications. The Contractor administered by this Section of the technical specifications shall formally coordinate in writing and receive from other contractor's formal acknowledgements in writing prior to submission the procurement of the products. These products include the following:
1. Factory-furnished accessory thermostats and sensors furnished with unitary equipment.
- D. Some products are not provided by, but are nevertheless integrated with the work executed by, the contractor administered by this Section of the technical specifications. The contractor administered by this Section of the technical specifications shall formally coordinate in writing and receive from other contractor's formal acknowledgements in writing prior to submission the particulars of the products. These products include the following:
1. Terminal units' velocity sensors.

## E. Responsibility Table:

<b>Work/Item/System</b>	<b>Furnish</b>	<b>Install</b>	<b>Low Voltage Wiring</b>	<b>Line Power</b>
Control system low voltage and communication wiring	23 09 23	23 09 23	23 09 23	N/A
Terminal units	23	23	N/A	26
Controllers for terminal units	23 09 23	23	23 09 23	16
LAN conduits and raceway	23 09 23	23 09 23	N/A	N/A
Automatic dampers (not furnished with equipment)	23 09 23	23	N/A	N/A
Automatic damper actuators	23 09 23	23 09 23	23 09 23	23 09 23
Manual valves	23	23	N/A	N/A
Automatic valves	23 09 23	23	23 09 23	23 09 23
Pipe insertion devices and taps, flow and pressure stations.	23	23	N/A	N/A
Thermowells	23 09 23	23	N/A	N/A
Current Switches	23 09 23	23 09 23	23 09 23	N/A
Control Relays	23 09 23	23 09 23	23 09 23	N/A
Power distribution system monitoring interfaces	23 09 23	23 09 23	23 09 23	26
All control system nodes, equipment, housings, enclosures and panels.	23 09 23	23 09 23	23 09 23	26
Starters, HOA switches	23	23	N/A	26

F. This facility's existing direct-digital control system is manufactured by Siemens, and its ECC is located at Boiler Plant. The existing system's top-end communications is via wired devices. The existing system's ECC and top-end controllers were installed in 2014. The Contractor administered by this Section of the technical specifications shall observe the capabilities, communication network, services, spare capacity of the existing control system and its ECC prior to beginning work.

G. This campus has standardized on an existing standard ASHRAE Standard 135, IP Control System supported by a preselected controls service company. This entity is referred to as the "Control System Integrator" in this Section of the technical specifications. The Control system integrator is responsible for ECC system graphics and expansion. It also prescribes control system-specific commissioning/ verification procedures to the contractor administered by this Section of the technical specification. It lastly provides limited assistance to the contractor administered by this Section of the technical specification in its commissioning/verification work.

1. The General Contractor of this project shall directly hire the Control System Integrator in a contract separate from the contract procuring the controls contractor administered by this Section of the technical specifications.
2. The Contractor administered by this Section of the technical specifications shall provide a peer-to-peer networked, stand-alone, distributed control system. This direct digital control (DDC) system shall include one portable operator terminal - laptop, one digital display unit, microprocessor-based controllers, instrumentation, end control devices, wiring, piping, software, and related systems. This Contractor is responsible for all device mounting and wiring.

3. Responsibility Table:

Item/Task	Section 23 09 23 contractor	Control system integrator	VA
ECC expansion		X	
ECC programming		X	
Devices, controllers, control panels and equipment	X		
Point addressing: all hardware and software points including setpoint, calculated point, data point(analog/binary), and reset schedule point	X		
Point mapping		X	
Network Programming	X		
ECC Graphics		X	
Controller programming and sequences	X		
Integrity of LAN communications	X		
Electrical wiring	X		
Operator system training		X	
LAN connections to devices	X		
LAN connections to ECC		X	
IP addresses			X
Overall system verification		X	
Controller and LAN system verification	X		

- H. Unitary standalone systems including Unit Heaters, Cabinet Unit Heaters, Fan Coil Units, Base Board Heaters, thermal comfort ventilation fans, and similar units for control of room environment conditions may be equipped with integral controls furnished and installed by the equipment manufacturer or field mounted. Refer to equipment specifications and as indicated in project documents. Application of standalone unitary controls is limited to at least those systems wherein remote monitoring, alarm and start-up are not necessary. Examples of such systems include:
1. Vestibule Cabinet heater
  2. IT room Fan Coil.
- I. The direct-digital control system shall start and stop equipment, move (position) damper actuators and valve actuators, and vary speed of equipment to execute the mission of the control system. Use electricity as the motive force for all damper and valve actuators, unless use of pneumatics as motive force is specifically granted by the VA.

## **1.2 RELATED WORK**

- A. Section 23 09 93 Sequence of Operation
- B. Section 23 31 00, HVAC Ducts and Casings.
- C. Section 26 05 11, Requirements for Electrical Installations.
- D. Section 26 05 19, Low-Voltage Electrical Power Conductors and Cables (600 Volts and Below).
- E. Section 26 05 26, Grounding and Bonding for Electrical Systems.
- F. Section 26 05 33, Raceway and Boxes for Electrical Systems.

## **1.3 DEFINITION**

- A. Algorithm: A logical procedure for solving a recurrent mathematical problem; a prescribed set of well-defined rules or processes for the solution of a problem in a finite number of steps.
- B. Analog: A continuously varying signal value (e.g., temperature, current, velocity etc.)

- C. Baud: It is a signal change in a communication link. One signal change can represent one or more bits of information depending on type of transmission scheme. Simple peripheral communication is normally one bit per Baud. (e.g., Baud rate = 78,000 Baud/sec is 78,000 bits/sec, if one signal change = 1 bit).
- D. Binary: A two-state system where a high signal level represents an "ON" condition and an "OFF" condition is represented by a low signal level.
- E. BMP or bmp: Suffix, computerized image file, used after the period in a DOS-based computer file to show that the file is an image stored as a series of pixels.
- F. Bus Topology: A network topology that physically interconnects workstations and network devices in parallel on a network segment.
- G. Control Unit (CU): Generic term for any controlling unit, stand-alone, microprocessor based, digital controller residing on secondary LAN or Primary LAN, used for local controls or global controls
- H. Deadband: A temperature range over which no heating or cooling is supplied, i.e., 22-25 degrees C (72-78 degrees F), as opposed to a single point change over or overlap.
- I. Diagnostic Program: A software test program which is used to detect and report system or peripheral malfunctions and failures. Generally, this system is performed at the initial startup of the system.
- J. Direct Digital Control (DDC): Microprocessor based control including Analog/Digital conversion and program logic. A control loop or subsystem in which digital and analog information is received and processed by a microprocessor, and digital control signals are generated based on control algorithms and transmitted to field devices in order to achieve a set of predefined conditions.
- K. Distributed Control System: A system in which the processing of system data is decentralized and control decisions can and are made at the subsystem level. System operational programs and information are provided to the remote subsystems and status is reported back to the Engineering Control Center. Upon the loss of communication with the Engineering Control center, the subsystems shall be capable of operating in a stand-alone mode using the last best available data.
- L. Download: The electronic transfer of programs and data files from a central computer or operation workstation with secondary memory devices to remote computers in a network (distributed) system.



- M. DXF: An AutoCAD 2-D graphics file format. Many CAD systems import and export the DXF format for graphics interchange.
- N. Electrical Control: A control circuit that operates on line or low voltage and uses a mechanical means, such as a temperature sensitive bimetal or bellows, to perform control functions, such as actuating a switch or positioning a potentiometer.
- O. Electronic Control: A control circuit that operates on low voltage and uses solid-state components to amplify input signals and perform control functions, such as operating a relay or providing an output signal to position an actuator.
- P. Engineering Control Center (ECC): The centralized control point for the intelligent control network. The ECC comprises of personal computer and connected devices to form a single workstation.
- Q. Ethernet: A trademark for a system for exchanging messages between computers on a local area network using coaxial, fiber optic, or twisted-pair cables.
- R. Firmware: Firmware is software programmed into read only memory (ROM) chips. Software may not be changed without physically altering the chip.
- S. Gateway: Communication hardware connecting two or more different protocols. It translates one protocol into equivalent concepts for the other protocol.
- T. GIF: Abbreviation of Graphic interchange format.
- U. Graphic Program (GP): Program used to produce images of air handler systems, fans, chillers, pumps, and building spaces. These images can be animated and/or color-coded to indicate operation of the equipment.
- V. Graphic Sequence of Operation: It is a graphical representation of the sequence of operation, showing all inputs and output logical blocks.
- W. I/O Unit: The section of a digital control system through which information is received and transmitted. I/O refers to analog input (AI, digital input (DI), analog output (AO) and digital output (DO). Analog signals are continuous and represent temperature, pressure, flow rate etc, whereas digital signals convert electronic signals to digital pulses (values), represent motor status, filter status, on-off equipment etc.

- X. I/P: A method for conveying and routing packets of information over LAN paths. User Datagram Protocol (UDP) conveys information to "sockets" without confirmation of receipt. Transmission Control Protocol (TCP) establishes "sessions" which have end-to-end confirmation and guaranteed sequence of delivery.
- Y. JPEG: A standardized image compression mechanism stands for Joint Photographic Experts Group, the original name of the committee that wrote the standard.
- Z. Local Area Network (LAN): A communication bus that interconnects operator workstation and digital controllers for peer-to-peer communications, sharing resources and exchanging information.
- AA. Network Repeater: A device that receives data packet from one network and rebroadcasts to another network. No routing information is added to the protocol.
- BB. MS/TP: Master-slave/token-passing (ISO/IEC 8802, Part 3). It is not an acceptable LAN option for VA health-care facilities. It uses twisted-pair wiring for relatively low speed and low cost communication.
- CC. Network Number: A site-specific number assigned to each network segment to identify for routing.
- DD. Object: The concept of organizing information into standard components with various associated properties. Examples include analog input objects and binary output objects.
- EE. Object Identifier: An object property used to identify the object, including object type and instance. Object Identifiers must be unique within a device.
- FF. Object Properties: Attributes of an object. Examples include present value and high limit properties of an analog input object. Properties are defined in ASHRAE 135; some are optional and some are required. Objects are controlled by reading from and writing to object properties.
- GG. Operating System (OS): Software which controls the execution of computer application programs.
- HH. PCX: File type for an image file. When photographs are scanned onto a personal computer, they can be saved as PCX files and viewed or changed by a special application program as Photo Shop.
- II. Peripheral: Different components that make the control system function as one unit. Peripherals include monitor, printer, and I/O unit.

- JJ. Peer-to-Peer: A networking architecture that treats all network stations as equal partners- any device can initiate and respond to communication with other devices.
- KK. PID: Proportional, integral, and derivative control, used to control modulating equipment to maintain a setpoint.
- LL. Repeater: A network component that connects two or more physical segments at the physical layer.
- MM. Router: A component that joins together two or more networks using different LAN technologies.
- NN. Sensors: Devices measuring state points or flows which are then transmitted back to the DDC system.
- OO. Thermostats: Devices measuring temperatures which are used in control of standalone or unitary systems and equipment not attached to the DDC system.

#### **1.4 QUALITY ASSURANCE**

##### **A. Criteria:**

1. Single Source Responsibility of Subcontractor: The Contractor shall obtain hardware and software supplied under this Section and delegate the responsibility to a single source controls installation subcontractor. The controls subcontractor shall be responsible for the complete design, installation, and commissioning of the system. The controls subcontractor shall be in the business of design, installation and service of such building automation control systems similar in size and complexity.
2. Equipment and Materials: Equipment and materials shall be cataloged products of manufacturers regularly engaged in production and installation of HVAC control systems. Products shall be manufacturer's latest standard design and have been tested and proven in actual use.
3. The controls subcontractor shall provide a list of no less than five similar projects which have building control systems as specified in this Section. These projects must be on-line and functional such that the Department of Veterans Affairs (VA) representative would observe the control systems in full operation.

4. The controls subcontractor shall have minimum of three years experience in design and installation of building automation systems similar in performance to those specified in this Section. Provide evidence of experience by submitting resumes of the project manager, the local branch manager, project engineer, the application engineering staff, and the electronic technicians who would be involved with the supervision, the engineering, and the installation of the control systems. Training and experience of these personnel shall not be less than three years. Failure to disclose this information will be a ground for disqualification of the supplier.
5. Provide a competent and experienced Project Manager employed by the Controls Contractor. The Project Manager shall be supported as necessary by other Contractor employees in order to provide professional engineering, technical and management service for the work. The Project Manager shall attend scheduled Project Meetings as required and shall be empowered to make technical, scheduling and related decisions on behalf of the Controls Contractor.

B. Codes and Standards:

1. All work shall conform to the applicable Codes and Standards.
2. Electronic equipment shall conform to the requirements of FCC Regulation, Part 15, Governing Radio Frequency Electromagnetic Interference, and be so labeled.

## **1.5 PERFORMANCE**

A. The system shall conform to the following:

1. Graphic Display: The system shall display up to four (4) graphics on a single screen with a minimum of twenty (20) dynamic points per graphic. All current data shall be displayed within ten (10) seconds of the request.
2. Graphic Refresh: The system shall update all dynamic points with current data within eight (8) seconds. Data refresh shall be automatic, without operator intervention.
3. Object Command: The maximum time between the command of a binary object by the operator and the reaction by the device shall be two (2) seconds. Analog objects shall start to adjust within two (2) seconds.

4. Object Scan: All changes of state and change of analog values shall be transmitted over the high-speed network such that any data used or displayed at a controller or work-station will be current, within the prior six (6) seconds.
5. Alarm Response Time: The maximum time from when an object goes into alarm to when it is annunciated at the workstation shall not exceed (10) seconds.
6. Program Execution Frequency: Custom and standard applications shall be capable of running as often as once every (5) seconds. The Contractor shall be responsible for selecting execution times consistent with the mechanical process under control.
7. Multiple Alarm Annunciations: All workstations on the network shall receive alarms within five (5) seconds of each other.
8. Performance: Programmable Controllers shall be able to execute DDC PID control loops at a selectable frequency from at least once every one (1) second. The controller shall scan and update the process value and output generated by this calculation at this same frequency.
9. Reporting Accuracy: Listed below are minimum acceptable reporting end-to-end accuracies for all values reported by the specified system:

Measured Variable	Reported Accuracy
Space temperature	$\pm 0.5^{\circ}\text{C}$ ( $\pm 1^{\circ}\text{F}$ )
Ducted air temperature	$\pm 0.5^{\circ}\text{C}$ [ $\pm 1^{\circ}\text{F}$ ]
Outdoor air temperature	$\pm 1.0^{\circ}\text{C}$ [ $\pm 2^{\circ}\text{F}$ ]
Dew Point	$\pm 1.5^{\circ}\text{C}$ [ $\pm 3^{\circ}\text{F}$ ]
Water temperature	$\pm 0.5^{\circ}\text{C}$ [ $\pm 1^{\circ}\text{F}$ ]
Relative humidity	$\pm 2\%$ RH
Water flow	$\pm 1\%$ of reading
Air flow (terminal)	$\pm 10\%$ of reading
Air flow (measuring stations)	$\pm 5\%$ of reading
Carbon Dioxide ( $\text{CO}_2$ )	$\pm 50$ ppm
Air pressure (ducts)	$\pm 25$ Pa [ $\pm 0.1$ "w.c.]
Air pressure (space)	$\pm 0.3$ Pa [ $\pm 0.001$ "w.c.]
Water pressure	$\pm 2\%$ of full scale *Note 1
Electrical Power	$\pm 0.5\%$ of reading

Note 1: for both absolute and differential pressure

10. Control Stability and Accuracy: Control sequences shall maintain measured variable at setpoint within the following tolerances:

Controlled Variable	Control Accuracy	Range of Medium
Air Pressure	$\pm 50$ Pa ( $\pm 0.2$ in. w.g.)	0-1.5 kPa (0-6 in. w.g.)
Air Pressure	$\pm 3$ Pa ( $\pm 0.01$ in. w.g.)	-25 to 25 Pa (-0.1 to 0.1 in. w.g.)
Airflow	$\pm 10\%$ of full scale	
Space Temperature	$\pm 1.0^{\circ}\text{C}$ ( $\pm 2.0^{\circ}\text{F}$ )	
Duct Temperature	$\pm 1.5^{\circ}\text{C}$ ( $\pm 3^{\circ}\text{F}$ )	
Humidity	$\pm 5\%$ RH	
Fluid Pressure	$\pm 10$ kPa ( $\pm 1.5$ psi)	0-1 MPa (1-150 psi)
Fluid Pressure	$\pm 250$ Pa ( $\pm 1.0$ in. w.g.)	0-12.5 kPa (0-50 in. w.g.) differential

11. Extent of Direct Digital Control: Control design shall allow for at least the points indicated on the points lists on the drawings.

#### 1.6 WARRANTY

- A. Labor and materials for control systems shall be warranted for a period as specified under Warranty in FAR clause 52.246-21.
- B. Control system failures during the warranty period shall be adjusted, repaired, or replaced at no cost or reduction in service to the Owner. The system includes all computer equipment, transmission equipment, and all sensors and control devices.
- C. The on-line support service shall allow the Controls supplier to dial out over telephone lines to or connect via (through password-limited access) VPN through the internet monitor and control the facility's building automation system. This remote connection to the facility shall be within two (2) hours of the time that the problem is reported. This coverage shall be extended to include normal business hours, after business hours, weekend and holidays. If the problem cannot be resolved with on-line support services, the Controls supplier shall dispatch the qualified personnel to the job site to resolve the problem within 24 hours after the problem is reported.
- D. Controls and Instrumentation subcontractor shall be responsible for temporary operations and maintenance of the control systems during the construction period until final commissioning, training of facility operators and acceptance of the project by VA.

**1.7 SUBMITTALS**

- A. Submit shop drawings in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's literature and data for all components including the following:
  - 1. A wiring diagram for each type of input device and output device including DDC controllers, modems, repeaters, etc. Diagram shall show how the device is wired and powered, showing typical connections at the digital controllers and each power supply, as well as the device itself. Show for all field connected devices including, but not limited to, control relays, motor starters, electric or electronic actuators, and temperature pressure, flow and humidity sensors and transmitters.
  - 2. A diagram of each terminal strip, including digital controller terminal strips, terminal strip location, termination numbers and the associated point names.
  - 3. Control dampers and control valves schedule, including the size and pressure drop.
  - 4. Control air-supply components and computations for sizing compressors, receivers and main air-piping, if pneumatic controls are furnished.
  - 5. Catalog cut sheets of all equipment used. This includes, but is not limited to, software (by manufacturer and by third parties), DDC controllers, panels, peripherals, airflow measuring stations and associated components, and auxiliary control devices such as sensors, actuators, and control dampers. When manufacturer's cut sheets apply to a product series rather than a specific product, the data specifically applicable to the project shall be highlighted. Each submitted piece of literature and drawings should clearly reference the specification and/or drawings that it supposed to represent.
  - 6. Sequence of operations for each HVAC system and the associated control diagrams. Equipment and control labels shall correspond to those shown on the drawings.
  - 7. Color prints of proposed graphics with a list of points for display.

8. Schematic wiring diagrams for all control, communication and power wiring. Provide a schematic drawing of the central system installation. Label all cables and ports with computer manufacturers' model numbers and functions. Show all interface wiring to the control system.
  9. An instrumentation list for each controlled system. Each element of the controlled system shall be listed in table format. The table shall show element name, type of device, manufacturer, model number, and product data sheet number.
  10. Riser diagrams of wiring between central control unit and all control panels.
  11. Scaled plan drawings showing routing of LAN and locations of control panels, controllers, routers, gateways, ECC, and larger controlled devices.
  12. Construction details for all installed conduit, cabling, raceway, cabinets, and similar. Construction details of all penetrations and their protection.
  13. Quantities of submitted items may be reviewed but are the responsibility of the contractor administered by this Section of the technical specifications.
- C. Product Certificates: Compliance with Article, QUALITY ASSURANCE.
- D. Licenses: Provide licenses for all software residing on and used by the Controls Systems and transfer these licenses to the Owner prior to completion.
- E. As-Built Control Drawings:
1. Furnish three (3) copies of as-built drawings for each control system. The documents shall be submitted for approval prior to final completion.
  2. Furnish one (1) stick set of applicable control system prints for each mechanical system for wall mounting. The documents shall be submitted for approval prior to final completion.
  3. Furnish one (1) CD-ROM in CAD DWG and/or .DXF format for the drawings noted in subparagraphs above.



F. Operation and Maintenance (O/M) Manuals):

1. Submit in accordance with Article, INSTRUCTIONS, in Specification Section 01 00 00, GENERAL REQUIREMENTS.
2. Include the following documentation:
  - a. General description and specifications for all components including logging on/off, alarm handling, producing trend reports, overriding computer control, and changing set points and other variables.
  - b. Detailed illustrations of all the control systems specified for ease of maintenance and repair/replacement procedures, and complete calibration procedures.
  - c. One copy of the final version of all software provided including operating systems, programming language, operator workstation software, and graphics software.
  - d. Complete troubleshooting procedures and guidelines for all systems.
  - e. Complete operating instructions for all systems.
  - f. Recommended preventive maintenance procedures for all system components including a schedule of tasks for inspection, cleaning and calibration. Provide a list of recommended spare parts needed to minimize downtime.
  - g. Training Manuals: Submit the course outline and training material to the Owner for approval three (3) weeks prior to the training to VA facility personnel. These persons will be responsible for maintaining and the operation of the control systems, including programming. The Owner reserves the right to modify any or all of the course outline and training material.
  - h. Licenses, guaranty, and other pertaining documents for all equipment and systems.

G. Submit Performance Report to Resident Engineer prior to final inspection.

## 1.8 INSTRUCTIONS

A. Instructions to VA Operations Personnel: Perform in accordance with Article, INSTRUCTIONS, in Specification Section 01 00 00, GENERAL REQUIREMENTS, and as noted below. Contractor shall also video tape instruction sessions noted below.

1. First Phase: Formal instructions to the VA facilities personnel for a total of 16 hours, given in multiple training sessions (each no longer than four hours in length), conducted sometime between the completed installation and prior to the performance test period of the control system, at a time mutually agreeable to the Contractor and the VA.
2. Second Phase: This phase of training shall comprise of on the job training during start-up, checkout period, and performance test period. VA facilities personnel will work with the Contractor's installation and test personnel on a daily basis during start-up and checkout period. During the performance test period, controls subcontractor will provide 16 hours of instructions, given in multiple training sessions (each no longer than four hours in length), to the VA facilities personnel.
3. The O/M Manuals shall contain approved submittals as outlined in Article 1.7, SUBMITTALS. The Controls subcontractor will review the manual contents with VA facilities personnel during second phase of training.
4. Training shall be given by direct employees of the controls system subcontractor.

## 1.9 PROJECT CONDITIONS (ENVIRONMENTAL CONDITIONS OF OPERATION)

- A. The ECC and peripheral devices and system support equipment shall be designed to operate in ambient condition of 20 to 35°C (65 to 90°F) at a relative humidity of 20 to 80% non-condensing.
- B. The CUs used outdoors shall be mounted in NEMA 4 waterproof enclosures and shall be rated for operation at -40 to 65°C (-40 to 150°F).
- C. All electronic equipment shall operate properly with power fluctuations of plus 10 percent to minus 15 percent of nominal supply voltage.
- D. Sensors and controlling devices shall be designed to operate in the environment which they are sensing or controlling.

### 1.10 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE):
  - Standard 135-10.....Building Automation and Control Networks
- C. American Society of Mechanical Engineers (ASME):
  - B16.18-01.....Cast Copper Alloy Solder Joint Pressure Fittings.
  - B16.22-01.....Wrought Copper and Copper Alloy Solder Joint Pressure Fittings.
- D. American Society of Testing Materials (ASTM):
  - B32-08.....Standard Specification for Solder Metal
  - B88-09.....Standard Specifications for Seamless Copper Water Tube
  - B88M-09.....Standard Specification for Seamless Copper Water Tube (Metric)
  - B280-08.....Standard Specification for Seamless Copper Tube for Air-Conditioning and Refrigeration Field Service
  - D2737-03.....Standard Specification for Polyethylene (PE) Plastic Tubing
- E. Federal Communication Commission (FCC):
  - Rules and Regulations Title 47 Chapter 1-2001 Part 15: Radio Frequency Devices.
- F. Institute of Electrical and Electronic Engineers (IEEE):
  - 802.3-11.....Information Technology-Telecommunications and Information Exchange between Systems-Local and Metropolitan Area Networks- Specific Requirements-Part 3: Carrier Sense Multiple Access with Collision Detection (CSMA/CD) Access method and Physical Layer Specifications
- G. National Fire Protection Association (NFPA):
  - 70-11.....National Electric Code
  - 90A-09.....Standard for Installation of Air-Conditioning and Ventilation Systems
- H. Underwriter Laboratories Inc (UL):
  - 94-10.....Tests for Flammability of Plastic Materials for Parts and Devices and Appliances
  - 294-10.....Access Control System Units
  - 486A/486B-10.....Wire Connectors
  - 555S-11.....Standard for Smoke Dampers
  - 916-10.....Energy Management Equipment
  - 1076-10.....Proprietary Burglar Alarm Units and Systems

**PART 2 - PRODUCTS****2.1 MATERIALS**

- A. Use new products that the manufacturer is currently manufacturing and that have been installed in a minimum of 25 installations. Spare parts shall be available for at least five years after completion of this contract.

**2.2 CONTROLS SYSTEM ARCHITECTURE****A. General**

- 1. The Controls Systems shall consist of multiple Nodes and associated equipment connected by industry standard digital and communication network arrangements.
- 2. The ECC, building controllers and principal communications network equipment shall be standard products of recognized major manufacturers available through normal PC and computer vendor channels - not "Clones" assembled by a third-party subcontractor.
- 3. The networks shall, at minimum, comprise, as necessary, the following:
  - a. A fixed ECC and a portable operator's terminal.
  - b. Network computer processing and data storage, including Servers and digital data processors.
  - c. Addressable elements, sensors, transducers and end devices.
  - d. Third-party equipment interfaces and gateways as described and required by the Contract Documents.
  - e. Other components required for a complete and working Control Systems as specified.

- B. The specifications for the individual elements and component subsystems shall be minimum requirements and shall be augmented as necessary by the Contractor to achieve both compliance with all applicable codes, standards and to meet all requirements of the Contract Documents.

**C. Network Architecture**

- 1. The networks shall utilize only copper and optical fiber communication media as appropriate and shall comply with applicable codes, ordinances and regulations.
- 2. All necessary telephone lines, ISDN lines and internet Service Provider services and connections will be provided by the VA.

D. Third Party Interfaces:

1. The contractor administered by this Section of the technical specifications shall include necessary hardware, equipment, software and programming to allow data communications between the controls systems and building systems supplied by other trades.
2. Other manufacturers and contractors supplying other associated systems and equipment shall provide their necessary hardware, software and start-up at their cost and shall cooperate fully with the contractor administered by this Section of the technical specifications in a timely manner and at their cost to ensure complete functional integration.

E. Servers:

1. Data storage server(s) shall archive historical data including trends, alarm and event histories and transaction logs.
2. Existing servers shall be utilized for controls systems application configuration, for archiving, reporting and trending of data, for operator transaction archiving and reporting network information management, for alarm annunciation, for operator interface tasks, for controls application management and similar.
3. Access to all information on the data storage server(s) shall be through the same browser functionality used to access individual nodes. When logged onto a server, the operator will be able to also interact with any other controller on the control system as required for the functional operation of the controls systems.  
The Contractor administered by this Section of the technical specifications shall provide all necessary digital processor programmable data storage server(s).
4. These server(s) shall be utilized for controls systems application configuration, for archiving, reporting and trending of data, for operator transaction archiving and reporting, for network information management, for alarm annunciation, for operator interface tasks, for controls application management and similar. These server(s) shall utilize IT industry standard data base platforms which utilize a database declarative language designed for managing data in relational database management systems (RDBMS) such as SQL.

### 2.3 COMMUNICATION

- A. Control products, communication media, connectors, repeaters, hubs, and routers. Controller and operator interface communication shall conform to ANSI/ASHRAE Standard 135-2008.
- B. Each controller shall have a communication port for connection to an operator interface.
- C. Project drawings indicate remote buildings or sites to be connected by a nominal 56,000 baud modem over voice-grade telephone lines. In each remote location, a modem and field device connection shall allow communication with each controller on the internetwork as specified in Paragraph D.
- D. Internetwork operator interface and value passing shall be transparent to internetwork architecture.
  - 1. An operator interface connected to a controller shall allow the operator to interface with each internetwork controller as if directly connected. Controller information such as data, status, reports, system software, and custom programs shall be viewable and editable from each internetwork controller.
  - 2. Inputs, outputs, and control variables used to integrate control strategies across multiple controllers shall be readable by each controller on the internetwork. Program and test all cross-controller links required to execute specified control system operation. An authorized operator shall be able to edit cross-controller links by typing a standard object address.
- E. System shall be expandable to at least twice the required input and output objects with additional controllers, associated devices, and wiring. Expansion shall not require operator interface hardware additions or software revisions.
- F. ECCs and Controllers with real-time clocks shall use the Time Synchronization service. The system shall automatically synchronize system clocks daily from an operator-designated device via the internetwork. The system shall automatically adjust for daylight savings and standard time as applicable.

## 2.4 CONTROL CABLES

### A. General:

1. Ground cable shields, drain conductors, and equipment to eliminate shock hazard and to minimize ground loops, common-mode returns, noise pickup, cross talk, and other impairments. Comply with Sections 27 05 26 and 26 05 26.
2. Cable conductors to provide protection against induction in circuits. Crosstalk attenuation within the System shall be in excess of -80 dB throughout the frequency ranges specified.
3. Minimize the radiation of RF noise generated by the System equipment so as not to interfere with any audio, video, data, computer main distribution frame (MDF), telephone customer service unit (CSU), and electronic private branch exchange (EPBX) equipment the System may service.
4. The as-installed drawings shall identify each cable as labeled, used cable, and bad cable pairs.
5. Label system's cables on each end. Test and certify cables in writing to the VA before conducting proof-of-performance testing. Minimum cable test requirements are for impedance compliance, inductance, capacitance, signal level compliance, opens, shorts, cross talk, noise, and distortion, and split pairs on all cables in the frequency ranges used. Make available all cable installation and test records at demonstration to the VA. All changes (used pair, failed pair, etc.) shall be posted in these records as the change occurs.
6. Power wiring shall not be run in conduit with communications trunk wiring or signal or control wiring operating at 100 volts or less.

B. Analogue control cabling shall be not less than No. 18 AWG solid, with thermoplastic insulated conductors.

C. Copper digital communication cable between the ECC and the B-BC and B-AAC controllers shall be 100BASE-TX Ethernet, Category 5e or 6, not less than minimum 24 American Wire Gauge (AWG) solid, Shielded Twisted Pair (STP) or Unshielded Twisted Pair (UTP), with thermoplastic insulated conductors, enclosed in a thermoplastic outer jacket, as specified in Section 27 15 00.

1. Other types of media commonly used within IEEE Std 802.3 LANs (e.g., 10Base-T and 10Base-2) shall be used only in cases to interconnect with existing media.

- D. Optical digital communication fiber, if used, shall be Multimode or Singlemode fiber, 62.5/125 micron for multimode or 10/125 micron for singlemode micron with SC or ST connectors as specified in TIA-568-C.1. Terminations, patch panels, and other hardware shall be compatible with the specified fiber and shall be as specified in Section 27 15 00. Fiber-optic cable shall be suitable for use with the 100Base-FX or the 100Base-SX standard (as applicable) as defined in IEEE Std 802.3.

## **2.5 FINAL CONTROL ELEMENTS AND OPERATORS**

- A. Fail-Safe Operation: Control valves and dampers shall provide "fail-safe" operation in either the normally open or normally closed position as required for freeze, moisture, and smoke or fire protection.
- B. Spring Ranges: Range as required for system sequencing and to provide tight shut-off.
- C. Power Operated Control Dampers (Other Than VAV Boxes): Factory fabricated, balanced type dampers. All modulating dampers shall be opposed blade type and gasketed. Blades for two-position, duct-mounted dampers shall be parallel, airfoil (streamlined) type for minimum noise generation and pressure drop.
1. Leakage: Maximum leakage in closed position shall not exceed 7 L/S (15 CFMs) differential pressure for outside air and exhaust dampers and 200 L/S/ square meter (40 CFM/sq. ft.) at 50 mm (2 inches) differential pressure for other dampers.
  2. Frame shall be galvanized steel channel with seals as required to meet leakage criteria.
  3. Blades shall be galvanized steel or aluminum, 200 mm (8 inch) maximum width, with edges sealed as required.
  4. Bearing shall be nylon, bronze sleeve or ball type.
  5. Hardware shall be zinc-plated steel. Connected rods and linkage shall be non-slip. Working parts of joints shall be brass, bronze, nylon or stainless steel.
  6. Maximum Air Velocity and Pressure Drop Through the Dampers:
    - a. Smoke Damper in Air Handling Unit: 305 meters per minute (1000 fpm).
    - b. Duct Mounted Damper: 600 meters per minute (2000 fpm).
    - c. Maximum Static Pressure Loss: 50 Pascal (0.20 inches water gage).



D. Damper and Valve Operators and Relays:

1. Electric operator shall provide full modulating control of dampers and valves. A linkage and pushrod shall be furnished for mounting the actuator on the damper frame internally in the duct or externally in the duct or externally on the duct wall or shall be furnished with a direct-coupled design. Metal parts shall be aluminum, mill finish galvanized steel, or zinc plated steel or stainless steel. Provide actuator heads which allow for electrical conduit attachment. The motors shall have sufficient closure torque to allow for complete closure of valve or damper under pressure. Provide multiple motors as required to achieve sufficient close-off torque.
  - a. Minimum valve close-off pressure shall be equal to the system pump's dead-head pressure, minimum 50 psig for valves smaller than 4 inches.
2. Electronic Damper Operators: Metal parts shall be aluminum, mill finish galvanized steel, or zinc plated steel or stainless steel. Provide actuator heads which allow for electrical conduit attachment. The motors shall have sufficient closure torque to allow for complete closure of valve or damper under pressure. Provide multiple motors as required to achieve sufficient close-off torque.
  - a. VAV Box actuator shall be mounted on the damper axle or shall be of the air valve design and shall provide complete modulating control of the damper. The motor shall have a closure torque of 35-inch pounds minimum with full torque applied at close-off to attain minimum leakage.
3. See drawings for required control operation.

**2.6 AIR PIPING**

- A. Use ASTM B88 seamless, Type L, hard temper copper tube with ANSI B16.22 wrought copper solder-joint fittings in lieu of steel pipe for all sizes.
- B. Use ASTM A312 stainless steel, Type 304/304L, Schedule 10S pipe with couplings and fittings, suitable for working pressures to 500-psig CWP.

**PART 3 - EXECUTION****3.1 INSTALLATION****A. General:**

1. Examine project plans for control devices and equipment locations; and report any discrepancies, conflicts, or omissions to Resident Engineer for resolution before proceeding for installation.
2. Install equipment, piping, wiring /conduit parallel to or at right angles to building lines.
3. Install all equipment and piping in readily accessible locations. Do not run tubing and conduit concealed under insulation or inside ducts.
4. Mount control devices, tubing and conduit located on ducts and apparatus with external insulation on standoff support to avoid interference with insulation.
5. Provide sufficient slack and flexible connections to allow for vibration of piping and equipment.
6. Run tubing and wire connecting devices on or in control cabinets parallel with the sides of the cabinet neatly racked to permit tracing.
7. Install equipment level and plum.

**B. Electrical Wiring Installation:**

1. All wiring cabling shall be installed in conduits. Install conduits and wiring in accordance with Specification Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS. Conduits carrying control wiring and cabling shall be dedicated to the control wiring and cabling: these conduits shall not carry power wiring. Provide plastic end sleeves at all conduit terminations to protect wiring from burrs.
2. Install analog signal and communication cables in conduit and in accordance with Specification Section 26 05 21. Install digital communication cables in conduit and in accordance with Specification Section 27 15 00, Communications Horizontal Cabling.
3. Install conduit and wiring between operator workstation(s), digital controllers, electrical panels, indicating devices, instrumentation, miscellaneous alarm points, thermostats, and relays as shown on the drawings or as required under this section.

4. Install all electrical work required for a fully functional system and not shown on electrical plans or required by electrical specifications. Where low voltage (less than 50 volt) power is required, provide suitable Class B transformers.
5. Install all system components in accordance with local Building Code and National Electric Code.
  - a. Splices: Splices in shielded and coaxial cables shall consist of terminations and the use of shielded cable couplers. Terminations shall be in accessible locations. Cables shall be harnessed with cable ties.
  - b. Equipment: Fit all equipment contained in cabinets or panels with service loops, each loop being at least 300 mm (12 inches) long. Equipment for fiber optics system shall be rack mounted, as applicable, in ventilated, self-supporting, code gauge steel enclosure. Cables shall be supported for minimum sag.
  - c. Cable Runs: Keep cable runs as short as possible. Allow extra length for connecting to the terminal board. Do not bend flexible coaxial cables in a radius less than ten times the cable outside diameter.
  - d. Use vinyl tape, sleeves, or grommets to protect cables from vibration at points where they pass around sharp corners, through walls, panel cabinets, etc.
6. Conceal cables except in mechanical rooms and areas where other conduits and piping are exposed.
7. Permanently label or code each point of all field terminal strips to show the instrument or item served. Color-coded cable with cable diagrams may be used to accomplish cable identification.
8. Grounding: Ground electrical systems per manufacturer's written requirements for proper and safe operation.

C. Install Sensors and Controls:

1. Temperature Sensors:

- a. Install all sensors and instrumentation according to manufacturer's written instructions. Temperature sensor locations shall be readily accessible, permitting quick replacement and servicing of them without special skills and tools.
- b. Calibrate sensors to accuracy specified, if not factory calibrated.
- c. Use of sensors shall be limited to its duty, e.g., duct sensor shall not be used in lieu of room sensor.
- d. Install room sensors permanently supported on wall frame. They shall be mounted at 1.5 meter (5.0 feet) above the finished floor.
- e. Mount sensors rigidly and adequately for the environment within which the sensor operates. Separate extended-bulb sensors from contact with metal casings and coils using insulated standoffs.
- f. Sensors used in mixing plenum and hot and cold decks shall be of the averaging of type. Averaging sensors shall be installed in a serpentine manner horizontally across duct. Each bend shall be supported with a capillary clip.
- g. All pipe mounted temperature sensors shall be installed in wells.
- h. All wires attached to sensors shall be air sealed in their conduits or in the wall to stop air transmitted from other areas affecting sensor reading.
- i. Permanently mark terminal blocks for identification. Protect all circuits to avoid interruption of service due to short-circuiting or other conditions. Line-protect all wiring that comes from external sources to the site from lightning and static electricity.

2. Pressure Sensors:

- a. Install duct static pressure sensor tips facing directly downstream of airflow.
- b. Install high-pressure side of the differential switch between the pump discharge and the check valve.
- c. Install snubbers and isolation valves on steam pressure sensing devices.

### 3. Actuators:

- a. Mount damper and valve actuators according to manufacturer's written instructions.
- b. Check operation of damper/actuator combination to confirm that actuator modulates damper smoothly throughout stroke to both open and closed position.
- c. Check operation of valve/actuator combination to confirm that actuator modulates valve smoothly in both open and closed position.
- d. Do not link dampers off one actuator. All dampers shall have separate actuators.

### 4. Flow Switches:

- a. Install flow switch according to manufacturer's written instructions.
- b. Mount flow switch a minimum of 5 pipe diameters up stream and 5 pipe diameters downstream or 600 mm (2 feet) whichever is greater, from fittings and other obstructions.
- c. Assure correct flow direction and alignment.
- d. Mount in horizontal piping-flow switch on top of the pipe.

## **3.2 SYSTEM VALIDATION AND DEMONSTRATION**

- A. As part of final system acceptance, a system demonstration is required (see below). Prior to start of this demonstration, the Contractor is to perform a complete validation of all aspects of the controls and instrumentation system.
- B. Validation:
  1. Prepare and submit for approval a validation test plan including test procedures for the performance verification tests. Test Plan shall address all specified functions of the ECC and all specified sequences of operation. Explain in detail actions and expected results used to demonstrate compliance with the requirements of this specification. Explain the method for simulating the necessary conditions of operation used to demonstrate performance of the system. Test plan shall include a test check list to be used by the Installer's agent to check and initial that each test has been successfully completed. Deliver test plan documentation for the performance verification tests to the Owner's representative 30 days prior to start of performance verification tests. Provide draft copy of operation and maintenance manual with performance verification test.

2. After approval of the validation test plan, installer shall carry out all tests and procedures therein. Installer shall completely check out, calibrate, and test all connected hardware and software to ensure that system performs in accordance with approved specifications and sequences of operation submitted. Installer shall complete and submit Test Check List.

C. Demonstration:

1. System operation and calibration to be demonstrated by the installer in the presence of the Architect or VA's representative on random samples of equipment as dictated by the Architect or VA's representative. Should random sampling indicate improper commissioning, the Owner reserves the right to subsequently witness complete calibration of the system at no addition cost to the VA.
2. Demonstrate to authorities that all required safeties and life safety functions are fully functional and complete.
3. Make accessible, personnel to provide necessary adjustments and corrections to systems as directed by balancing agency.
4. The following witnessed demonstrations of field control equipment shall be included:
  - a. Observe HVAC systems in shut down condition. Check dampers and valves for normal position.
  - b. Test application software for its ability to communicate with digital controllers, operator workstation, and uploading and downloading of control programs.
  - c. Demonstrate the software ability to edit the control program off-line.
  - d. Demonstrate reporting of alarm conditions for each alarm and ensure that these alarms are received at the assigned location, including operator workstations.
  - e. Demonstrate ability of software program to function for the intended applications-trend reports, change in status etc.
  - f. Demonstrate via graphed trends to show the sequence of operation is executed in correct manner, and that the HVAC systems operate properly through the complete sequence of operation, e.g., seasonal change, occupied/unoccupied mode, and warm-up condition.
  - g. Demonstrate hardware interlocks and safeties functions, and that the control systems perform the correct sequence of operation after power loss and resumption of power loss.

- h. Prepare and deliver to the VA graphed trends of all control loops to demonstrate that each control loop is stable and the setpoints are maintained.
  - i. Demonstrate that each control loop responds to setpoint adjustment and stabilizes within one (1) minute. Control loop trend data shall be instantaneous and the time between data points shall not be greater than one (1) minute.
5. Witnessed demonstration of ECC functions shall consist of:
- a. Running each specified report.
  - b. Display and demonstrate each data entry to show site specific customizing capability. Demonstrate parameter changes.
  - c. Step through penetration tree, display all graphics, demonstrate dynamic update, and direct access to graphics.
  - d. Execute digital and analog commands in graphic mode.
  - e. Demonstrate DDC loop precision and stability via trend logs of inputs and outputs (6 loops minimum).
  - f. Demonstrate EMS performance via trend logs and command trace.
  - g. Demonstrate scan, update, and alarm responsiveness.
  - h. Demonstrate spreadsheet/curve plot software, and its integration with database.
  - i. Demonstrate on-line user guide and help function and mail facility.
  - j. Demonstrate digital system configuration graphics with interactive upline and downline load and demonstrate specified diagnostics.
  - k. Demonstrate multitasking by showing dynamic curve plot, and graphic construction operating simultaneously via split screen.
  - l. Demonstrate class programming with point options of beep duration, beep rate, alarm archiving, and color banding.

----- END -----





**SECTION 23 09 93**  
**SEQUENCE OF OPERATION FOR HVAC CONTROLS**

**PART 1 - GENERAL**

**1.1 SCOPE**

- A. This section includes control sequences for HVAC equipment as well as equipment furnished by others that may need monitoring or control. Included are the following topics:

PART 1 - GENERAL

Scope

Related Work

Description of Work

Submittals

Operation and Maintenance Data

Design Criteria

PART 2 - PRODUCTS

Not Applicable

PART 3 - EXECUTION

General Control

**1.2 RELATED WORK**

- A. Section 23 09 15, DDC POINTS
- B. Section 23 09 23, DIRECT DIGITAL CONTROLS (DDC)
- C. Section 23 05 93, TESTING, ADJUSTING, and BALANCING for HVAC COORDINATION
- D. Division 23, HVAC - Equipment provided to be controlled or monitored
- E. Division 26, ELECTRICAL - Equipment provided to be controlled or monitored
- F. Division 28, ELECTRONIC SAFETY AND SECURITY

**1.3 REFERENCE**

- A. Section 23 09 23 work includes furnishing and installing all field devices, including electronic sensors for the DDC of this section, equipment, and all related field wiring, interlocking control wiring between equipment, pneumatic tubing, sensor mounting, etc., that is covered in that section.
- B. Motorized control dampers and actuators, thermowells (temperature sensing wells), automatic control valves and their actuators are also covered in Section 23 09 23.

#### **1.4 DESCRIPTION OF WORK**

- A. Control sequences are hereby defined as the manner and method by which automatic controls function. Requirements for each type of operation are specified in this section.
- B. Operation equipment, devices and system components required for automatic control systems are specified in other Division 23 control sections of these specifications.
- C. All temperature, humidity, and pressure sensing, and all other control signal transportation for the control sequences shall be furnished under Section 23 09 23. All pneumatic, electronic, and electric input/output signals shall be extended under Section 23 09 23.
- D. Sequences for equipment controlled by Direct Digital Controls (DDC) as specified are accomplished by hardware and software provided under Section 23 09 23.

#### **1.5 SUBMITTALS**

- A. Refer to Division 01, General Conditions, Submittals, Section 23 05 11 and Section 23 09 23 for descriptions of what should be included in the submittals.
- B. Shop drawings shall be provided under Sections 23 09 23. The narrative of the sequence of operation shall not be a verbatim copy of the sequences contained herein, but shall reflect the actual operation as applied by the contractor.

#### **1.6 OPERATION AND MAINTENANCE DATA**

- A. All operations and maintenance data shall comply with the submission and content requirements specified under section GENERAL REQUIREMENTS.
- B. In addition to the general content specified under GENERAL REQUIREMENTS supply the following additional documentation:

#### **1.7 DESIGN CRITERIA**

- A. Reference Section 23 09 23.

#### **PART 2 - PRODUCTS**

- A. Not applicable to this Section - reference Section 23 09 23 for product descriptions.

## **PART 3 - EXECUTION**

### **3.1 CONTROL SEQUENCES**

#### **A. General:**

1. DDC Objects: All hardwired points listed in 23 09 15 and any setpoints, timers, or other control elements that are specified to be adjustable (adj.) in the following control sequences shall be mapped as DDC objects and be available on the user interface to be adjusted. Consult with the user agency HVAC and/or DDC personnel prior to programming to determine if there are any items that they do not want to have mapped as DDC objects. This is especially important for DDC controlled items that are duplicative, i.e. air terminal units.
2. DDC Addressing: ID's shall be coordinated with the agencies established ID addressing scheme. If there is not such a scheme in place, the contractor(s) providing DDC controllers shall work with the agency to establish such a scheme and document this in the as-built control drawings. IP addressing shall be coordinated with the agency prior to installation. Provide for consecutive addressing to provide for the best speed of response. Max Master address shall be set appropriately for speed of response.
3. User Interface/Feature Software: Consult with the user agency HVAC and/or DDC personnel prior to programming to determine DDC object naming conventions, user views, graphic layout, security matrix, alarming, trending, and scheduling preferences desired by the agency. Failure to consult and come to agreement prior to programming shall require the DDC contractor to make changes in the above listed items as desired by the user agency to the system at no cost. Section 23 09 15 feature software checkmarks are guides only and are not specific to what is required by the user agency.

4. Setpoints: All setpoints indicated in the control specification are to be adjustable. The setpoints shall be readily available to be modified in the mechanical system software system summary (either textual or graphic based) and under the same software level as hardware points. Some less used setpoints may be provided on a lower software level, if requested by the user Agency for clarity. The setpoints indicated herein are only specified as a calculated starting point (or initial system operation). It is expected that setpoint adjustments and control loop tuning shall be required to provide optimum system operation based on requirements of the building. The control contractor shall work with the balancing contractor and the user Agency to provide the final system setpoint adjustments and control loop tuning after the system is in operation and building is in use. Document all final setpoints on the as-built control drawings. Any questions regarding the intended operation of the HVAC equipment and control systems shall be referred to the HVAC design engineer through the appropriate construction communication process. The following setpoints should be used as initial setpoints unless otherwise specified in the individual control sequences or instructed by the user Agency. If the contractor fails to check with the user Agency for final setpoints, they shall adjust setpoints at no additional cost.

Occupied Space Terminal Unit Heating: 70°F

Occupied Space Terminal Unit Cooling: 72°F

Unoccupied Space Terminal Unit Heating: 62°F

Unoccupied Space Terminal Unit Cooling: 82°F

Entry Way Heating: 60°F

Mechanical or Unoccupied Space Ventilation: 82°F

Mechanical or Unoccupied Space Heating: 60°F

5. Anti-Cycling: When HVAC equipment or a sequence is specified to be started and stopped by a temperature, humidity, pressure setpoint or any other controlled variable, there shall be an adjustable differential setpoint that shall be set to prevent short cycling of the systems and equipment due to minor changes in the controlled variable. Temperature differential setpoints shall be set at 2°F and non-temperature setpoints shall be set at 10% of the controlled range unless otherwise specified. Setpoints shall indicate at when

the process should be turned on. Heating and cooling differentials shall be set for above setpoint and shall be used to turn the process off. For example, an economizer sequence called to switch at 68°F, would turn on at 68°F and off at 70°F since it is a cooling function. A heating lockout setpoint of 50°F would turn on heating control at 50°F and off at 52°F. Non-temperature differentials shall be set above setpoint if the setpoint is indicating a minimum value or below setpoint if the setpoint is indicating a maximum value. Provide minimum runtime timers for loads that are cycled to prevent over-cycling. Timers shall be set as specified or as needed to prevent damage or excessive wear to the equipment. Unless otherwise specified in the individual control sequences, fans and pumps shall have a minimum runtime on timers of 15 minutes (adj.) and off timers of 5 minutes (adj.). Safeties shall override runtime timers.

6. Deadbands: Provide deadbands for all DDC control loops to prevent constant hunting of output signals to controlled devices. Deadbands shall be set to provide adequate control around setpoint as follows unless otherwise specified in the individual control sequences:

Temperature Control:  $\pm 0.5^{\circ}\text{F}$

Humidity Control:  $\pm 1\%$  RH

Airflow Control:  $\pm 2\%$  of total flow

AHU Static Pressure Control:  $\pm 0.01$  in. w.c.

7. Alarms: Provide all alarmed points with adjustable time delays to prevent nuisance tripping under normal operation and on equipment start-up. For all commanded outputs that have status feedback, provide an alarm that shall indicate the commanded output is not in its commanded state. Provide alarms on all points as indicated on point charts. For existing campus automations systems, add/delete what is called on the point charts for after consultation with user Agency to provide consistent alarming throughout the automation system.
  - a. For devices that have form "C" contacts available for alarm monitoring, use closed contacts for the Normal condition and open contacts on Alarm condition. This shall provide a level of supervision by detecting a break in the wiring.

### **3.2 ISOLATION ROOM DAMPER CONTROL**

A. General: Disconnect and reconnect the isolation room control dampers as noted on the drawings.

---END---

**SECTION 23 31 00  
HVAC DUCTS AND CASINGS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Ductwork and accessories for HVAC including the following:
  - 1. Supply air, return air, outside air, exhaust, make-up air, and relief systems.
- B. Definitions:
  - 1. SMACNA Standards as used in this specification means the HVAC Duct Construction Standards, Metal and Flexible.
  - 2. Seal or Sealing: Use of liquid or mastic sealant, with or without compatible tape overlay, or gasketing of flanged joints, to keep air leakage at duct joints, seams and connections to an acceptable minimum.
  - 3. Duct Pressure Classification: SMACNA HVAC Duct Construction Standards, Metal and Flexible.
  - 4. Exposed Duct: Exposed to view in a finished room exposed to weather.

**1.2 RELATED WORK**

- A. Fire Stopping Material: Section 07 84 00, FIRESTOPPING.
- B. Outdoor and Exhaust Louvers: Section 08 90 00, LOUVERS and VENTS.
- C. General Mechanical Requirements: Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- D. Testing and Balancing of Air Flows: Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC.

**1.3 QUALITY ASSURANCE**

- A. Refer to article, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Fire Safety Code: Comply with NFPA 90A.
- C. Duct System Construction and Installation: Referenced SMACNA Standards are the minimum acceptable quality.
- D. Duct Sealing, Air Leakage Criteria, and Air Leakage Tests: Ducts shall be sealed as per duct sealing requirements of SMACNA HVAC Air Duct Leakage Test Manual for duct pressure classes shown on the drawings.
- E. Duct accessories exposed to the air stream, such as dampers of all types (except smoke dampers) and access openings, shall be of the same material as the duct or provide at least the same level of corrosion resistance.

**1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
  - 1. Rectangular Ducts:
    - a. Schedules of duct systems, materials and selected SMACNA construction alternatives for joints, sealing, gage and reinforcement.
    - b. Duct liner.
    - c. Sealants and gaskets.
    - d. Access doors.
  - 2. Round and Flat Oval Duct Construction Details:
    - a. Manufacturer's details for duct fittings.
    - b. Duct liner.
    - c. Sealants and gaskets.
    - d. Access sections.
    - e. Installation instructions.
  - 3. Volume dampers, back draft dampers.
  - 4. Upper hanger attachments.
  - 5. Flexible ducts and clamps, with manufacturer's installation instructions.
  - 6. Details and design analysis of alternate or optional duct systems.
  - 7. COMMON WORK RESULTS FOR HVAC.

**1.5 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Civil Engineers (ASCE):
  - ASCE7-05.....Minimum Design Loads for Buildings and Other Structures
- C. American Society for Testing and Materials (ASTM):
  - A167-99(2009).....Standard Specification for Stainless and Heat-Resisting Chromium-Nickel Steel Plate, Sheet, and Strip
  - A653-09.....Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy coated (Galvannealed) by the Hot-Dip process



- A1011-09a.....Standard Specification for Steel, Sheet and Strip, Hot rolled, Carbon, structural, High-Strength Low-Alloy, High Strength Low-Alloy with Improved Formability, and Ultra-High Strength
- B209-07.....Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate
- C1071-05e1.....Standard Specification for Fibrous Glass Duct Lining Insulation (Thermal and Sound Absorbing Material)
- E84-09a.....Standard Test Method for Surface Burning Characteristics of Building Materials
- D. National Fire Protection Association (NFPA):
- 90A-09.....Standard for the Installation of Air Conditioning and Ventilating Systems
- 96-08.....Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations
- E. Sheet Metal and Air Conditioning Contractors National Association (SMACNA):
- 2nd Edition - 2005.....HVAC Duct Construction Standards, Metal and Flexible
- 1st Edition - 1985.....HVAC Air Duct Leakage Test Manual
- 6th Edition - 2003.....Fibrous Glass Duct Construction Standards
- F. Underwriters Laboratories, Inc. (UL):
- 181-08.....Factory-Made Air Ducts and Air Connectors
- 555-06 .....Standard for Fire Dampers
- 555S-06 .....Standard for Smoke Dampers

## **PART 2 - PRODUCTS**

### **2.1 DUCT MATERIALS AND SEALANTS**

- A. General: Except for systems specified otherwise, construct ducts, casings, and accessories of galvanized sheet steel, ASTM A653, coating G90; or, aluminum sheet, ASTM B209, alloy 1100, 3003 or 5052.
- B. Specified Corrosion Resistant Systems: Stainless steel sheet, ASTM A167, Class 302 or 304, Condition A (annealed) Finish No. 4 for exposed ducts and Finish No. 2B for concealed duct or ducts located in mechanical rooms.

C. Joint Sealing: Refer to SMACNA HVAC Duct Construction Standards, paragraph S1.9.

1. Sealant: Elastomeric compound, gun or brush grade, maximum 25 flame spread and 50 smoke developed (dry state) compounded specifically for sealing ductwork as recommended by the manufacturer.

Generally, provide liquid sealant, with or without compatible tape, for low clearance slip joints and heavy, permanently elastic, mastic type where clearances are larger. Oil base caulking and glazing compounds are not acceptable because they do not retain elasticity and bond.

2. Tape: Use only tape specifically designated by the sealant manufacturer and apply only over wet sealant. Pressure sensitive tape shall not be used on bare metal or on dry sealant.

3. Gaskets in Flanged Joints: Soft neoprene.

D. Approved factory made joints may be used.

## **2.2 DUCT CONSTRUCTION AND INSTALLATION**

A. Regardless of the pressure classifications outlined in the SMACNA Standards, fabricate and seal the ductwork in accordance with the following pressure classifications:

B. Duct Pressure Classification:

0 to 50 mm (2 inch)

> 50 mm to 75 mm (2 inch to 3 inch)

> 75 mm to 100 mm (3 inch to 4 inch)

Show pressure classifications on the floor plans.

C. Seal Class: All ductwork shall receive Class A Seal.

D. Round and Flat Oval Ducts: Furnish duct and fittings made by the same manufacturer to insure good fit of slip joints. When submitted and approved in advance, round and flat oval duct, with size converted on the basis of equal pressure drop, may be furnished in lieu of rectangular duct design shown on the drawings.

1. Elbows: Diameters 80 through 200 mm (3 through 8 inches) shall be two sections die stamped, all others shall be gored construction, maximum 18 degree angle, with all seams continuously welded or standing seam. Coat galvanized areas of fittings damaged by welding with corrosion resistant aluminum paint or galvanized repair compound.

2. Provide bell mouth, conical tees or taps, laterals, reducers, and other low loss fittings as shown in SMACNA HVAC Duct Construction Standards.

3. Ribbed Duct Option: Lighter gage round/oval duct and fittings may be furnished provided certified tests indicating that the rigidity and performance is equivalent to SMACNA standard gage ducts are submitted.
  - a. Ducts: Manufacturer's published standard gage, G90 coating, spiral lock seam construction with an intermediate standing rib.
  - b. Fittings: May be manufacturer's standard as shown in published catalogs, fabricated by spot welding and bonding with neoprene base cement or machine formed seam in lieu of continuous welded seams.
4. Provide flat side reinforcement of oval ducts as recommended by the manufacturer and SMACNA HVAC Duct Construction Standard S3.13.  
Because of high pressure loss, do not use internal tie-rod reinforcement unless approved by the Resident Engineer.
- F. Casings and Plenums: Construct in accordance with SMACNA HVAC Duct Construction Standards Section 6, including curbs, access doors, pipe penetrations, eliminators and drain pans. Access doors shall be hollow metal, insulated, with latches and door pulls, 500 mm (20 inches) wide by 1200 - 1350 mm (48 - 54 inches) high. Provide view port in the doors where shown. Provide drain for outside air louver plenum. Outside air plenum shall have exterior insulation. Drain piping shall be routed to the nearest floor drain.
- G. Volume Dampers: Single blade or opposed blade, multi-louver type as detailed in SMACNA Standards. Refer to SMACNA Detail Figure 2-12 for Single Blade and Figure 2.13 for Multi-blade Volume Dampers.
- H. Duct Hangers and Supports: Refer to SMACNA Standards Section IV.  
Avoid use of trapeze hangers for round duct.

### **2.3 DUCT LINER (WHERE INDICATED ON DRAWINGS)**

- A. Duct sizes shown on drawings for lined duct are clear opening inside lining.
- B. Duct liner is only permitted to be used for return, relief and general exhaust ducts. Duct liner is not permitted for outside air ducts, supply air ducts or any other positive pressure ductwork (provide exterior insulation only).
- C. Rectangular Duct or Casing Liner: ASTM C1071, Type I (flexible), or Type II (board), 25 mm (one inch) minimum thickness, applied with mechanical fasteners and 100 percent coverage of adhesive in conformance with SMACNA, Duct Liner Application Standard.

- D. Round and Oval Duct Liner: Factory fabricated double-walled with 1 inch thick sound insulation and inner perforated galvanized metal liner. Construction shall comply with flame and smoke rating required by NFPA 90A. Metal liner shall be 1.0 to 0.60 mm (20 to 24 gage) having perforations not exceeding 2.4 mm (3/32 inch) diameter and approximately 22 percent free area. Metal liner for fittings need not be perforated. Assemblies shall be complete with continuous sheet Mylar liner, 2 mil thickness, between the perforated liner and the insulation to prevent erosion of the insulation. Provide liner couplings/spacer for metal liner. At the end of insulated sections, provide insulation end fittings to reduce outer shell to liner size. Provide liner spacing/concentricity leaving airway unobstructed.

#### **2.4 DUCT ACCESS DOORS, PANELS AND SECTIONS**

- A. Provide access doors, sized and located for maintenance work, upstream, in the following locations:
1. Every 20 feet and at each elbow for duct cleaning on the supply and return systems.
- B. Openings shall be as large as feasible in small ducts, 300 mm by 300 mm (12 inch by 12 inch) minimum where possible. Access sections in insulated ducts shall be double-wall, insulated. Transparent shatterproof covers are preferred for uninsulated ducts.
1. For rectangular ducts: Refer to SMACNA HVAC Duct Construction Standards (Figure 2-12).
  2. For round and flat oval duct: Refer to SMACNA HVAC duct Construction Standards (Figure 2-11).

#### **2.5 FLEXIBLE AIR DUCT**

- A. General: Factory fabricated, complying with NFPA 90A for connectors not passing through floors of buildings. Flexible ducts shall not penetrate any fire or smoke barrier which is required to have a fire resistance rating of one hour or more. Flexible duct length shall not exceed 1.5 m (5 feet). Provide insulated acoustical air duct connectors in supply air duct systems and elsewhere as shown.
- B. Flexible ducts shall be listed by Underwriters Laboratories, Inc., complying with UL 181. Ducts larger than 200 mm (8 inches) in diameter shall be Class 1. Ducts 200 mm (8 inches) in diameter and smaller may be Class 1 or Class 2.

- C. Insulated Flexible Air Duct: Factory made including mineral fiber insulation with maximum C factor of 0.25 at 24 degrees C (75 degrees F) mean temperature, encased with a low permeability moisture barrier outer jacket, having a puncture resistance of not less than 50 Beach Units. Acoustic insertion loss shall not be less than 3 dB per 300 mm (foot) of straight duct, at 500 Hz, based on 150 mm (6 inch) duct, of 750 m/min (2500 fpm).
- D. Application Criteria:
  - 1. Temperature Range: -18 to 93 degrees C (0 to 200 degrees F) internal.
  - 2. Maximum Working Velocity: 1200 m/min (4000 feet per minute).
  - 3. Minimum Working Pressure, Inches of Water Gage: 2500 Pa (10 inches) positive, 500 Pa (2 inches) negative.
- E. Duct Clamps: 100 percent nylon strap, 80 kg (175 pounds) minimum loop tensile strength manufactured for this purpose or stainless steel strap with cadmium plated worm gear tightening device. Apply clamps with sealant and as approved for UL 181, Class 1 installation.

## **2.6 FLEXIBLE DUCT CONNECTIONS**

Where duct connections are made to fans, air terminal units, and air handling units, install a non-combustible flexible connection of 822 g (29 ounce) neoprene coated fiberglass fabric approximately 150 mm (6 inches) wide. For connections exposed to sun and weather, provide hypalon coating in lieu of neoprene. Burning characteristics shall conform to NFPA 90A. Securely fasten flexible connections to round ducts with stainless steel or zinc-coated iron draw bands with worm gear fastener. For rectangular connections, crimp fabric to sheet metal and fasten sheet metal to ducts by screws 50 mm (2 inches) on center. Fabric shall not be stressed other than by air pressure. Allow at least 25 mm (1 inch) slack to ensure that no vibration is transmitted.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Comply with provisions of Section 23 05 11, COMMON WORK RESULTS FOR HVAC, particularly regarding coordination with other trades and work in existing buildings.
- B. Fabricate and install ductwork and accessories in accordance with referenced SMACNA Standards:
  - 1. Drawings show the general layout of ductwork and accessories but do not show all required fittings and offsets that may be necessary to connect ducts to equipment, boxes, diffusers, grilles, etc., and to coordinate with other trades. Fabricate ductwork based on field measurements. Provide all necessary fittings and offsets at no

- additional cost to the government. Coordinate with other trades for space available and relative location of HVAC equipment and accessories on ceiling grid. Duct sizes on the drawings are inside dimensions which shall be altered by Contractor to other dimensions with the same air handling characteristics where necessary to avoid interferences and clearance difficulties.
2. Provide duct transitions, offsets and connections to dampers, coils, and other equipment in accordance with SMACNA Standards, Section II. Provide streamliner, when an obstruction cannot be avoided and must be taken in by a duct. Repair galvanized areas with galvanizing repair compound.
  3. Provide bolted construction and tie-rod reinforcement in accordance with SMACNA Standards.
  4. Construct casings, eliminators, and pipe penetrations in accordance with SMACNA Standards, Chapter 6. Design casing access doors to swing against air pressure so that pressure helps to maintain a tight seal.
- C. Install duct hangers and supports in accordance with SMACNA Standards, Chapter 4.
- D. Flexible Duct Installation: Refer to SMACNA Standards, Chapter 3. Ducts shall be continuous, single pieces not over 1.5 m (5 feet) long (NFPA 90A), as straight and short as feasible, adequately supported. Centerline radius of bends shall be not less than two duct diameters. Make connections with clamps as recommended by SMACNA. Clamp per SMACNA with one clamp on the core duct and one on the insulation jacket. Flexible ducts shall not penetrate floors, or any chase or partition designated as a fire or smoke barrier, including corridor partitions fire rated one hour or two hour. Support ducts SMACNA Standards.
- E. Where diffusers, registers and grilles cannot be installed to avoid seeing inside the duct, paint the inside of the duct with flat black paint to reduce visibility.
- F. Low Pressure Duct Liner: Install in accordance with SMACNA, Duct Liner Application Standard.
- G. Protection and Cleaning: Adequately protect equipment and materials against physical damage. Place equipment in first class operating condition or return to source of supply for repair or replacement, as determined by Resident Engineer. Protect equipment and ducts during construction against entry of foreign matter to the inside and clean both inside and outside before operation and painting. When new ducts are connected to existing ductwork, clean both new and existing ductwork by mopping and vacuum cleaning inside and outside before operation.

**3.2 DUCT LEAKAGE TESTS AND REPAIR**

- A. Ductwork leakage testing shall be performed by the Testing and Balancing Contractor directly contracted by the General Contractor and independent of the Sheet Metal Contractor.
- B. Ductwork leakage testing shall be performed for the entire air distribution system (including all supply, return, exhaust and relief ductwork), section by section, including fans, coils and filter sections. Based upon satisfactory initial duct leakage test results, the scope of the testing may be reduced by the Resident Engineer on ductwork constructed to the 500 Pa (2" WG) duct pressure classification. In no case shall the leakage testing of ductwork constructed above the 500 Pa (2" WG) duct pressure classification or ductwork located in shafts or other inaccessible areas be eliminated.
- C. Test procedure, apparatus and report shall conform to SMACNA Leakage Test manual. The maximum leakage rate allowed is 4 percent of the design air flow rate.
- D. All ductwork shall be leak tested first before enclosed in a shaft or covered in other inaccessible areas.
- E. All tests shall be performed in the presence of the Resident Engineer and the Test and Balance agency. The Test and Balance agency shall measure and record duct leakage and report to the Resident Engineer and identify leakage source with excessive leakage.
- F. If any portion of the duct system tested fails to meet the permissible leakage level, the Contractor shall rectify sealing of ductwork to bring it into compliance and shall retest it until acceptable leakage is demonstrated to the Resident Engineer.
- G. All tests and necessary repairs shall be completed prior to insulation or concealment of ductwork.
- H. Make sure all openings used for testing flow and temperatures by TAB Contractor are sealed properly.

**3.3 TESTING, ADJUSTING AND BALANCING (TAB)**

Refer to Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC.

**3.4 OPERATING AND PERFORMANCE TESTS**

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

---END---





**SECTION 23 37 00**  
**AIR OUTLETS AND INLETS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Air Outlets and Inlets: Diffusers, Registers, and Grilles.

**1.2 RELATED WORK**

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.  
 B. Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC.

**1.3 QUALITY ASSURANCE**

- A. Refer to article, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.  
 B. Fire Safety Code: Comply with NFPA 90A.

**1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.  
 B. Manufacturer's Literature and Data:  
     1. Diffusers, registers, grilles and accessories.  
 C. Coordination Drawings: Refer to article, SUBMITTALS, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

**1.5 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.  
 B. Air Diffusion Council Test Code:  
     1062 GRD-84.....Certification, Rating, and Test Manual  
                                     4<sup>th</sup> Edition  
 C. American Society of Civil Engineers (ASCE):  
     ASCE7-05.....Minimum Design Loads for Buildings and Other Structures  
 D. American Society for Testing and Materials (ASTM):  
     A167-99 (2004).....Standard Specification for Stainless and Heat-Resisting Chromium-Nickel Steel Plate, Sheet and Strip  
     B209-07.....Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate

## E. National Fire Protection Association (NFPA):

90A-09.....Standard for the Installation of Air  
Conditioning and Ventilating Systems

## F. Underwriters Laboratories, Inc. (UL):

181-08.....UL Standard for Safety Factory-Made Air Ducts  
and Connectors

**PART 2 - PRODUCTS****2.1 EQUIPMENT SUPPORTS**

Refer to Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, and Section  
23 05 11, COMMON WORK RESULTS FOR HVAC.

**2.2 AIR OUTLETS AND INLETS**

## A. Materials:

1. Steel or aluminum. Exhaust air registers located in combination  
toilets and shower stalls shall be constructed from aluminum.  
Provide manufacturer's standard gasket.
2. Exposed Fastenings: The same material as the respective inlet  
or outlet. Fasteners for aluminum may be stainless steel.
3. Contractor shall review all ceiling drawings and details and provide  
all ceiling mounted devices with appropriate dimensions and trim for  
the specific locations.

B. Performance Test Data: In accordance with Air Diffusion Council Code  
1062GRD. Refer to Section 23 05 41, NOISE and VIBRATION CONTROL FOR  
HVAC PIPING AND EQUIPMENT for NC criteria.

## C. Air Supply Outlets:

1. Ceiling Diffusers: Suitable for surface mounting, exposed T-bar  
or special tile ceilings, off-white finish, square or round neck  
connection as shown on the drawings. Provide plaster frame for units  
in plaster ceilings.
  - a. Square, Plaque, Fixed 4-Way Pattern: Round neck, surface mounting  
unless shown otherwise on the drawings.
  - b. Louver Face Type: Square, removable core for 2-way directional  
pattern.

- D. Return and Exhaust Registers and Grilles: Provide opposed blade damper without removable key operator for registers as noted.
1. Finish: Off-white baked enamel for ceiling mounted units. Wall units shall have a prime coat for field painting.
  2. Standard Type: Fixed horizontal face bars set at 30 to 45 degrees, approximately 30 mm (1-1/4 inch) margin. Provide plaster frame for sidewall applications. Toilet room exhaust grilles shall be hinged type to aid in cleaning.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Comply with provisions of Section 23 05 11, COMMON WORK RESULTS FOR HVAC, particularly regarding coordination with other trades and work in existing buildings.
- B. Protection and Cleaning: Protect equipment and materials against physical damage. Place equipment in first class operating condition or return to source of supply for repair or replacement, as determined by Resident Engineer. Protect equipment during construction against entry of foreign matter to the inside and clean both inside and outside before operation and painting.

#### **3.2 TESTING, ADJUSTING AND BALANCING (TAB)**

Refer to Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC.

#### **3.3 OPERATING AND PERFORMANCE TESTS**

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

---END---



**SECTION 26 05 02**  
**ELECTRICAL DEMOLITION FOR REMODELING**

**PART 1 - GENERAL**

**1.1 WORK INCLUDED**

- A. Demolition, removal, abandonment, and revision to electrical systems to accommodate the project.

**1.2 RELATED WORK**

- A. Applicable provisions of Division 01 shall govern all work under this Section.

**PART 2 - PRODUCTS**

**2.1 MATERIALS AND EQUIPMENT**

- A. Materials and equipment for patching and extending work as specified in the individual Sections.

**PART 3 - EXECUTION**

**3.1 EXAMINATION**

- A. Verify field measurements and circuiting arrangements are as shown on Drawings.
- B. Verify that abandoned wiring and equipment serve only abandoned facilities.
- C. Verify whether or not PCB ballasts exist in light fixtures which will be disposed of. If PCB light fixture ballasts exist, then follow requirements in **PCB BALLAST HANDLING AND DISPOSAL** below.
- D. Beginning of demolition means installer accepts existing conditions.
- E. Demolition drawings are based on casual field observation and/or existing record documents. Report discrepancies to Owner and Architect/Engineer before disturbing existing installation.

**3.2 PREPARATION**

- A. Disconnect electrical systems in walls, floors, and ceiling scheduled for removal.
- B. Coordinate service outages with the Owner and Architect/Engineer.

- C. Provide temporary wiring and connections to maintain existing systems in service during construction. When work must be performed on energized equipment or circuits, use personnel experienced in such operations. In particular, all security and life safety systems must be maintained in operation at all times as required by the Owner. This includes security and safety lighting, fire alarms and smoke/heat detectors, and public address systems.

### **3.3 DEMOLITION AND EXTENSION OF EXISTING ELECTRICAL WORK**

- A. Demolish and extend existing electrical work to meet all requirements of these specifications.
- B. If certain raceways and boxes are abandoned but not scheduled for removal, those items must be shown on the "As-Built Drawings".
- C. Remove, relocate, and extend existing installations to accommodate new construction.
- D. Remove abandoned wiring to source of supply.
- E. Remove exposed abandoned conduit, including abandoned conduit above accessible ceiling finishes. Cut conduit flush with walls and floors, and patch surfaces.
- F. Disconnect abandoned outlets and remove devices. Remove abandoned outlets if conduit servicing them is abandoned and removed. Provide blank cover for abandoned outlets which are not removed.
- G. Disconnect and remove electrical devices and equipment serving utilization equipment that has been removed.
- H. Repair adjacent construction and finishes damaged during demolition and extension work.
- I. Maintain access to existing electrical installations which remain active. Modify installation or provide access panel as appropriate.
- J. Extend existing installations using materials and methods compatible with existing electrical installations, or as specified. This includes the extension of the circuit from the last active device to the next device in the system to be activated.

### 3.4 PCB BALLAST HANDLING AND DISPOSAL

- A. Generally, all high power factor fluorescent light ballasts manufactured before 1978 and some HID ballasts contain PCB compounds in their capacitors. The Contractor shall inspect all ballasts in all light fixtures (which will become the property of the Contractor and will be removed from the project site as part of this project) and take the actions described below.
1. All ballasts labeled as "NON-PCBs" or "NO PCBs" shall become the property of the Contractor. If the PCB content is not stated on the ballast label, the ballast shall be handled as a PCB ballast.
  2. All PCB ballasts shall be removed from the light fixtures and shall have the wires clipped off. However, before removal, all PCB ballasts shall be carefully inspected for leaks. If a ballast appears to be leaking (evidenced by potting compound leaking out or by an oily film on the ballast surface), the ballast must be handled per EPA and DNR PCB regulations. Basically, this means the ballast is to be carefully removed from the fixture and placed in an approved drum. See paragraph below for the drum specifications. The person removing the ballast from the fixture shall wear protective gloves, eye protection, and protective clothing as necessary.
  3. If the fixture has also been contaminated, it must be cleaned to less than 10 micrograms/100 square centimeters contamination before disposal. This cleaning must be done by an approved PCB contractor and is not considered a part of this contract. Contact Architect/Engineer for contractor approval before commencing with the cleanup.
  4. The ballasts shall then be placed in US DOT approved type 17C or type 17H drums (barrels) furnished by the Contractor. 55 gallon and 30 gallon drums are available from most drum suppliers. The quantity and size of the drums will be determined by the Contractor at the time of construction.
  5. These barrels shall be placed in storage with the cover that came with the barrels, in a location within a building, as designated by the Owner or Architect/Engineer project representative. The barrels are not to be placed outside where they are exposed to weather.

6. THESE BALLASTS ARE NOT TO BE REMOVED FROM THE WORK SITE BY THE CONTRACTOR. To do so would be a violation of DNR and DOT hazardous waste regulations and may result in a fine to the Contractor.
  7. The Contractor shall label and mark the PCB storage drums with EPA approved PCB labels and the storage area with signs, marks and lines to meet the regulations of Michigan Code.
  8. The Contractor shall also provide approved PCB absorbent materials to be stored immediately adjacent to the drum storage area. Do not place loose absorbent material in the drums.
  9. The Contractor shall provide to the Architect/Engineer project representative, in written form, a total count of these ballasts (or their total weight by barrel) and where they are stored.
- B. When the ballast demolition is completed and all PCB ballasts are placed in drums ready to be picked up for disposal, the Contractor project representative will advise the Architect/Engineer that the ballasts are ready for disposal together with the ballast quantity (or drum weight). The Architect/Engineer will then make arrangements for pickup and disposal of the PCB ballasts.

### **3.5 LAMP HANDLING AND DISPOSAL**

- A. All lamps (fluorescent, incandescent, and HID) contain mercury and/or lead (in the base) as well as other heavy metals and compounds which are regulated by the EPA and DNR during the disposal process. As a result, regulations have been issued covering the handling and disposal of all lamps. Therefore, lamps which have been removed from service for disposal shall be handled as follows by the Contractor.
1. The Contractor shall very carefully remove all lamps (fluorescent, incandescent, and HID) from light fixtures before removal of the fixture from its mounted position. This is to reduce the likelihood that the lamp(s) will be broken.
  2. Removed lamps shall be placed in containers provided by the Contractor and placed in storage in a location on the Owner's property (this may be in another building) arranged by the Architect/Engineer field representative. The Contractor shall label the area as "Hazardous Material Storage - Mercury".
  3. The Contractor shall make arrangements for the lamps to be picked up.



### **3.6 CLEANING AND REPAIR**

- A. Clean and repair existing materials and equipment which remain or are to be reused.
- B. Panelboards: Clean exposed surfaces and check tightness of electrical connections. Replace damaged circuit breakers and provide closure plates for vacant positions. Provide typed circuit directory showing revised circuiting arrangement.
- C. Luminaires: Remove existing luminaires for cleaning. Use mild detergent to clean all exterior and interior surfaces; rinse with clean water and wipe dry. Replace lamps.

### **3.7 INSTALLATION**

- A. Install relocated materials and equipment under the provisions of other Sections.

---END---



**SECTION 26 05 11**  
**REQUIREMENTS FOR ELECTRICAL INSTALLATIONS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section applies to all sections of Division 26.
- B. Furnish and install electrical systems, materials, equipment, and accessories in accordance with the specifications and drawings. Capacities and ratings of motors, conductors and cable, switchboards, switchgear, panelboards, and other items and arrangements for the specified items are shown on the drawings.
- C. Conductor ampacities specified or shown on the drawings are based on copper conductors, with the conduit and raceways sized per NEC. Aluminum conductors are prohibited.

**1.2 MINIMUM REQUIREMENTS**

- A. The latest International Building Code (IBC), Underwriters Laboratories, Inc. (UL), Institute of Electrical and Electronics Engineers (IEEE), and National Fire Protection Association (NFPA) codes and standards are the minimum requirements for materials and installation.
- B. The drawings and specifications shall govern in those instances where requirements are greater than those stated in the above codes and standards.

**1.3 TEST STANDARDS**

- A. All materials and equipment shall be listed, labeled, or certified by a Nationally Recognized Testing Laboratory (NRTL) to meet Underwriters Laboratories, Inc. (UL), standards where test standards have been established. Materials and equipment which are not covered by UL standards will be accepted, providing that materials and equipment are listed, labeled, certified or otherwise determined to meet the safety requirements of a NRTL. Materials and equipment which no NRTL accepts, certifies, lists, labels, or determines to be safe, will be considered if inspected or tested in accordance with national industrial standards, such as ANSI, NEMA, and NETA. Evidence of compliance shall include certified test reports and definitive shop drawings.

B. Definitions:

1. Listed: Materials and equipment included in a list published by an organization that is acceptable to the Authority Having Jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production or listed materials and equipment or periodic evaluation of services, and whose listing states that the materials and equipment either meets appropriate designated standards or has been tested and found suitable for a specified purpose.
2. Labeled: Materials and equipment to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the Authority Having Jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled materials and equipment, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.
3. Certified: Materials and equipment which:
  - a. Have been tested and found by a NRTL to meet nationally recognized standards or to be safe for use in a specified manner.
  - b. Are periodically inspected by a NRTL.
  - c. Bear a label, tag, or other record of certification.
4. Nationally Recognized Testing Laboratory: Testing laboratory which is recognized and approved by the Secretary of Labor in accordance with OSHA regulations.

**1.4 QUALIFICATIONS (PRODUCTS AND SERVICES)**

- A. Manufacturer's Qualifications: The manufacturer shall regularly and currently produce, as one of the manufacturer's principal products, the materials and equipment specified for this project, and shall have manufactured the materials and equipment for at least three years.
- B. Product Qualification:
  1. Manufacturer's materials and equipment shall have been in satisfactory operation, on three installations of similar size and type as this project, for at least three years.
  2. The Government reserves the right to require the Contractor to submit a list of installations where the materials and equipment have been in operation before approval.

- C. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within four hours of receipt of notification that service is needed. Submit name and address of service organizations.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. Applicable publications listed in all Sections of Division 26 shall be the latest issue, unless otherwise noted.
- B. Products specified in all sections of Division 26 shall comply with the applicable publications listed in each section.

#### **1.6 MANUFACTURED PRODUCTS**

- A. Materials and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items, and for which replacement parts shall be available. Materials and equipment furnished shall be new and shall have superior quality and freshness.
- B. When more than one unit of the same class or type of materials and equipment is required, such units shall be the product of a single manufacturer.
- C. Equipment Assemblies and Components:
1. Components of an assembled unit need not be products of the same manufacturer.
  2. Manufacturers of equipment assemblies, which include components made by others, shall assume complete responsibility for the final assembled unit.
  3. Components shall be compatible with each other and with the total assembly for the intended service.
  4. Constituent parts which are similar shall be the product of a single manufacturer.
- D. Factory wiring and terminals shall be identified on the equipment being furnished and on all wiring diagrams.

E. When Factory Tests are specified, factory tests shall be performed in the factory by the equipment manufacturer and witnessed by the contractor. In addition, the following requirements shall be complied with:

1. The Government shall have the option of witnessing factory tests. The Contractor shall notify the Government through the COR a minimum of thirty (30) days prior to the manufacturer performing the factory tests.
2. When factory tests are successful, Contractor shall furnish four (4) copies of the equipment manufacturer's certified test reports to the COR fourteen (14) days prior to shipment of the equipment and not more than ninety (90) days after completion of the factory tests.
3. When factory tests are not successful, factory tests shall be repeated in the factory by the equipment manufacturer and witnessed by the Contractor. The Contractor shall be liable for all additional expenses for the Government to witness factory re-testing.

#### **1.7 VARIATIONS FROM CONTRACT REQUIREMENTS**

A. Where the Government or the Contractor requests variations from the contract requirements, the connecting work and related components shall include, but not be limited to, additions or changes to branch circuits, circuit protective devices, conduits, wire, feeders, controls, panels and installation methods.

#### **1.8 MATERIALS AND EQUIPMENT PROTECTION**

A. Materials and equipment shall be protected during shipment and storage against physical damage, vermin, dirt, corrosive substances, fumes, moisture, cold and rain.

1. Store materials and equipment indoors in clean dry space with uniform temperature to prevent condensation.
2. During installation, equipment shall be protected against entry of foreign matter, and be vacuum-cleaned both inside and outside before testing and operating. Compressed air shall not be used to clean equipment. Remove loose packing and flammable materials from inside equipment.
3. Damaged equipment shall be repaired or replaced, as determined by the COR.

4. Painted surfaces shall be protected with factory installed removable heavy kraft paper, sheet vinyl, or equal.
5. Damaged paint on equipment shall be refinished with the same quality of paint and workmanship as used by the manufacturer so repaired areas are not obvious.

#### **1.9 WORK PERFORMANCE**

- A. All electrical work shall comply with requirements of the latest NFPA 70 (NEC), NFPA 70B, NFPA 70E, NFPA 99, NFPA 110, OSHA Part 1910 Subpart J - General Environmental Controls, OSHA Part 1910 Subpart K - Medical and First Aid, and OSHA Part 1910 subpart S - Electrical, in addition to other references required by contract.
- B. Job site safety and worker safety is the responsibility of the Contractor.
- C. Electrical work shall be accomplished with all affected circuits or equipment de-energized. However, energized electrical work may be performed only for the non-destructive and non-invasive diagnostic testing(s), or when scheduled outage poses an imminent hazard to patient care, safety, or physical security. In such case, all aspects of energized electrical work, such as the availability of appropriate/correct personal protective equipment (PPE) and the use of PPE, shall comply with the latest NFPA 70E, as well as the following requirements:
  1. Only Qualified Person(s) shall perform energized electrical work. Supervisor of Qualified Person(s) shall witness the work of its entirety to ensure compliance with safety requirements and approved work plan.
  2. At least two weeks before initiating any energized electrical work, the Contractor and the Qualified Person(s) who is designated to perform the work shall visually inspect, verify, and confirm that the work area and electrical equipment can safely accommodate the work involved.

3. At least two weeks before initiating any energized electrical work, the Contractor shall develop and submit a job specific work plan, and energized electrical work request to the COR, and Medical Center's Chief Engineer or his/her designee. At the minimum, the work plan must include relevant information such as proposed work schedule, area of work, description of work, name(s) of Supervisor and Qualified Person(s) performing the work, equipment to be used, procedures to be used on and near the live electrical equipment, barriers to be installed, safety equipment to be used, and exit pathways.
4. Energized electrical work shall begin only after the Contractor has obtained written approval of the work plan, the energized electrical work request from the COR, and Medical Center's Chief Engineer or his/her designee. The Contractor shall make these approved documents present and available at the time and place of energized electrical work.
5. Energized electrical work shall begin only after the Contractor has invited and received acknowledgment from the COR and Medical Center's Chief Engineer or his/her designee to witness the work.
- D. For work that affects existing electrical systems, arrange, phase and perform work to assure minimal interference with normal functioning of the facility. Refer to Article OPERATIONS AND STORAGE AREAS under Section 01 00 00, GENERAL REQUIREMENTS.
- E. New work shall be installed and connected to existing work neatly, safely, and professionally. Disturbed or damaged work shall be replaced or repaired to its prior conditions, as required by Section 01 00 00, GENERAL REQUIREMENTS.
- F. Coordinate location of equipment and conduit with other trades to minimize interference.

#### **1.10 EQUIPMENT INSTALLATION AND REQUIREMENTS**

- A. Equipment location shall be as close as practical to locations shown on the drawings.
- B. Working clearances shall not be less than specified in the NEC.
- C. Inaccessible Equipment:
  1. Where the Government determines that the Contractor has installed equipment not readily accessible for operation and maintenance, the equipment shall be removed and reinstalled as directed at no additional cost to the Government.



2. "Readily accessible" is defined as being capable of being reached quickly for operation, maintenance, or inspections without the use of ladders or without climbing or crawling under or over obstacles such as, but not limited to, motors, pumps, belt guards, transformers, piping, ductwork, conduit and raceways.

#### **1.11 EQUIPMENT IDENTIFICATION**

- A. In addition to the requirements of the NEC, install an identification sign which clearly indicates information required for use and maintenance of items such as switchboards and switchgear, panelboards, cabinets, motor controllers, fused and non-fused safety switches, generators, automatic transfer switches, separately enclosed circuit breakers, individual breakers and controllers in switchboards, switchgear and motor control assemblies, control devices and other significant equipment.
- B. Identification signs for Normal Power System equipment shall be laminated black phenolic resin with a white core with engraved lettering. Identification signs for Essential Electrical System (EES) equipment, as defined in the NEC, shall be laminated red phenolic resin with a white core with engraved lettering. Lettering shall be a minimum of 12 mm (1/2 inch) high. Identification signs shall indicate equipment designation, rated bus amperage, voltage, number of phases, number of wires, and type of EES power branch as applicable. Secure nameplates with screws.
- C. Install adhesive arc flash warning labels on all equipment as required by the latest NFPA 70E. Label shall show specific and correct information for specific equipment based on its arc flash calculations. Label shall show the followings:
  1. Nominal system voltage.
  2. Equipment/bus name, date prepared, and manufacturer name and address.
  3. Arc flash boundary.
  4. Available arc flash incident energy and the corresponding working distance.
  5. Minimum arc rating of clothing.
  6. Site-specific level of PPE.

**1.12 SUBMITTALS**

- A. Submit to the COR in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. The Government's approval shall be obtained for all materials and equipment before delivery to the job site. Delivery, storage, or installation of materials and equipment which has not had prior approval will not be permitted.
- C. All submittals shall include six copies of adequate descriptive literature, catalog cuts, shop drawings, test reports, certifications, samples, and other data necessary for the Government to ascertain that the proposed materials and equipment comply with drawing and specification requirements. Catalog cuts submitted for approval shall be legible and clearly identify specific materials and equipment being submitted.
- D. Submittals for individual systems and equipment assemblies which consist of more than one item or component shall be made for the system or assembly as a whole. Partial submittals will not be considered for approval.
  - 1. Mark the submittals, "SUBMITTED UNDER SECTION\_\_\_\_\_".
  - 2. Submittals shall be marked to show specification reference including the section and paragraph numbers.
  - 3. Submit each section separately.
- E. The submittals shall include the following:
  - 1. Information that confirms compliance with contract requirements. Include the manufacturer's name, model or catalog numbers, catalog information, technical data sheets, shop drawings, manuals, pictures, nameplate data, and test reports as required.
  - 2. Elementary and interconnection wiring diagrams for communication and signal systems, control systems, and equipment assemblies. All terminal points and wiring shall be identified on wiring diagrams.
  - 3. Parts list which shall include information for replacement parts and ordering instructions as recommended by the equipment manufacturer.

F. Maintenance and Operation Manuals:

1. Submit as required for systems and equipment specified in the technical sections. Furnish in hardcover binders or an approved equivalent.
2. Inscribe the following identification on the cover: The words "MAINTENANCE AND OPERATION MANUAL," the name and location of the system, material, equipment, building, name of Contractor, and contract name and number. Include in the manual the names, addresses, and telephone numbers of each subcontractor installing the system or equipment, and the local representatives for the material or equipment.
3. Provide a table of contents and assemble the manual to conform to the table of contents, with tab sheets placed before instructions covering the subject. The instructions shall be legible and easily read, with large sheets of drawings folded in.
4. The manuals shall include:
  - a. Internal and interconnecting wiring and control diagrams with data to explain detailed operation and control of the equipment.
  - b. A control sequence describing start-up, operation, and shutdown.
  - c. Description of the function of each principal item of equipment.
  - d. Installation instructions.
  - e. Safety precautions for operation and maintenance.
  - f. Diagrams and illustrations.
  - g. Periodic maintenance and testing procedures and frequencies, including replacement parts numbers.
  - h. Performance data.
  - i. Pictorial "exploded" parts list with part numbers. Emphasis shall be placed on the use of special tools and instruments. The list shall indicate sources of supply, recommended spare and replacement parts, and name of servicing organization.
  - j. List of factory approved or qualified permanent servicing organizations for equipment repair and periodic testing and maintenance, including addresses and factory certification qualifications.

- G. Approvals will be based on complete submission of shop drawings, manuals, test reports, certifications, and samples as applicable.

- H. After approval and prior to installation, furnish the COR with one sample of each of the following:
1. A minimum 300 mm (12 inches) length of each type and size of wire and cable along with the tag from the coils or reels from which the sample was taken. The length of the sample shall be sufficient to show all markings provided by the manufacturer.
  2. Each type of conduit coupling, bushing, and termination fitting.
  3. Conduit hangers, clamps, and supports.
  4. Duct sealing compound.
  5. Each type of receptacle, toggle switch, lighting control sensor, outlet box, manual motor starter, device wall plate, engraved nameplate, wire and cable splicing and terminating material, and branch circuit single pole molded case circuit breaker.

#### **1.13 SINGULAR NUMBER**

- A. Where any device or part of equipment is referred to in these specifications in the singular number (e.g., "the switch"), this reference shall be deemed to apply to as many such devices as are required to complete the installation as shown on the drawings.

#### **1.14 ACCEPTANCE CHECKS AND TESTS**

- A. The Contractor shall furnish the instruments, materials, and labor for tests.
- B. Where systems are comprised of components specified in more than one section of Division 26, the Contractor shall coordinate the installation, testing, and adjustment of all components between various manufacturer's representatives and technicians so that a complete, functional, and operational system is delivered to the Government.
- C. When test results indicate any defects, the Contractor shall repair or replace the defective materials or equipment and repeat the tests for the equipment. Repair, replacement, and re-testing shall be accomplished at no additional cost to the Government.

#### **1.15 WARRANTY**

- A. All work performed and all equipment and material furnished under this Division shall be free from defects and shall remain so for a period of one year from the date of acceptance of the entire installation by the Contracting Officer for the Government.

**1.16 INSTRUCTION**

- A. Instruction to designated Government personnel shall be provided for the particular equipment or system as required in each associated technical specification section.
- B. Furnish the services of competent and factory-trained instructors to give full instruction in the adjustment, operation, and maintenance of the specified equipment and system, including pertinent safety requirements. Instructors shall be thoroughly familiar with all aspects of the installation and shall be factory-trained in operating theory as well as practical operation and maintenance procedures.
- C. Instructions: Contractor shall provide qualified, factory-trained manufacturers' representatives to give detailed training to assigned Department of Veterans Affairs personnel in the operation and complete maintenance for each piece of equipment. All such training will be at the job site. Instructions for different items of equipment that are component parts of a complete system shall be given in an integrated, progressive manner. All instructors for every piece of component equipment in a system shall be available until instructions for all items included in the system have been completed. This is to assure proper instruction in the operation of inter-related systems. All instruction periods shall be at such times as scheduled by the COR and shall be considered concluded only when the COR is satisfied in regard to complete and thorough coverage. The Contractor shall submit a course outline with associated material to the COR for review and approval prior to scheduling training to ensure the subject matter covers the expectations of the VA and the contractual requirements. The Department of Veterans Affairs reserves the right to request the removal of, and substitution for, any instructor who, in the opinion of the COR, does not demonstrate sufficient qualifications in accordance with requirements for instructors above.
- D. A training schedule shall be developed and submitted by the Contractor and approved by the COR at least 30 days prior to the planned training.

**PART 2 - PRODUCTS (NOT USED)****PART 3 - EXECUTION (NOT USED)**

---END---



**SECTION 26 05 19**  
**LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, connection, and testing of the electrical conductors and cables for use in electrical systems rated 600 V and below, indicated as cable(s), conductor(s), wire, or wiring in this section.

**1.2 RELATED WORK**

- A. Section 07 84 00, FIRESTOPPING: Sealing around penetrations to maintain the integrity of fire-resistant rated construction.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits for conductors and cables.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 FACTORY TESTS**

- A. Conductors and cables shall be thoroughly tested at the factory per NEMA to ensure that there are no electrical defects. Factory tests shall be certified.

**1.5 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Submit the following data for approval:
      - 1) Electrical ratings and insulation type for each conductor and cable.
      - 2) Splicing materials and pulling lubricant.

2. Certifications: Two weeks prior to final inspection, submit the following.
  - a. Certification by the manufacturer that the conductors and cables conform to the requirements of the drawings and specifications.
  - b. Certification by the Contractor that the conductors and cables have been properly installed, adjusted, and tested.

#### **1.6 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are reference in the text by designation only.
- B. American Society of Testing Material (ASTM):
  - D2301-10.....Standard Specification for Vinyl Chloride  
Plastic Pressure-Sensitive Electrical  
Insulating Tape
  - D2304-10.....Test Method for Thermal Endurance of Rigid  
Electrical Insulating Materials
  - D3005-10.....Low-Temperature Resistant Vinyl Chloride  
Plastic Pressure-Sensitive Electrical  
Insulating Tape
- C. National Electrical Manufacturers Association (NEMA):
  - WC 70-09.....Power Cables Rated 2000 Volts or Less for the  
Distribution of Electrical Energy
- D. National Fire Protection Association (NFPA):
  - 70-11.....National Electrical Code (NEC)
- E. Underwriters Laboratories, Inc. (UL):
  - 44-10.....Thermoset-Insulated Wires and Cables
  - 83-08.....Thermoplastic-Insulated Wires and Cables
  - 467-07.....Grounding and Bonding Equipment
  - 486A-486B-03.....Wire Connectors
  - 486C-04.....Splicing Wire Connectors
  - 486D-05.....Sealed Wire Connector Systems
  - 486E-09.....Equipment Wiring Terminals for Use with  
Aluminum and/or Copper Conductors
  - 493-07.....Thermoplastic-Insulated Underground Feeder and  
Branch Circuit Cables
  - 514B-04.....Conduit, Tubing, and Cable Fittings



**PART 2 - PRODUCTS****2.1 CONDUCTORS AND CABLES**

- A. Conductors and cables shall be in accordance with NEMA, UL, as specified herein, and as shown on the drawings.
- B. All conductors shall be copper.
- C. Single Conductor and Cable:
  - 1. No. 12 AWG: Minimum size, except where smaller sizes are specified herein or shown on the drawings.
  - 2. No. 8 AWG and Larger: Stranded.
  - 3. No. 10 AWG and Smaller: Stranded; except shall be stranded for final connection to motors, transformers, and vibrating equipment.
  - 4. Insulation: THHN-THWN and XHHW-2. XHHW-2 shall be used for isolated power systems.
- D. Color Code:
  - 1. No. 10 AWG and Smaller: Solid color insulation or solid color coating.
  - 2. No. 8 AWG and Larger: Color-coded using one of the following methods:
    - a. Solid color insulation or solid color coating.
    - b. Stripes, bands, or hash marks of color specified.
    - c. Color using 19 mm (0.75 inches) wide tape.
  - 4. For modifications and additions to existing wiring systems, color coding shall conform to the existing wiring system.
  - 5. Conductors shall be color-coded as follows:

208/120 V	Phase	480/277 V
Black	A	Brown
Red	B	Orange
Blue	C	Yellow
White	Neutral	Gray *
* or white with colored (other than green) tracer.		

- 6. Lighting circuit "switch legs", and 3-way and 4-way switch "traveling wires" shall have color coding that is unique and distinct (e.g., pink and purple) from the color coding indicated above. The unique color codes shall be solid and in accordance with the NEC. Coordinate color coding in the field with the COTR.
- 7. Color code for isolated power system wiring shall be in accordance with the NEC.

## 2.2 SPLICES

- A. Splices shall be in accordance with NEC and UL.
- B. Above Ground Splices for No. 10 AWG and Smaller:
  - 1. Solderless, screw-on, reusable pressure cable type, with integral insulation, approved for copper and aluminum conductors.
  - 2. The integral insulator shall have a skirt to completely cover the stripped conductors.
  - 3. The number, size, and combination of conductors used with the connector, as listed on the manufacturer's packaging, shall be strictly followed.
- C. Above Ground Splices for No. 8 AWG to No. 4/0 AWG:
  - 1. Compression, hex screw, or bolt clamp-type of high conductivity and corrosion-resistant material, listed for use with copper and aluminum conductors.
  - 2. Insulate with materials approved for the particular use, location, voltage, and temperature. Insulation level shall be not less than the insulation level of the conductors being joined.
  - 3. Splice and insulation shall be product of the same manufacturer.
  - 4. All bolts, nuts, and washers used with splices shall be zinc-plated steel.
- D. Above Ground Splices for 250 kcmil and Larger:
  - 1. Long barrel "butt-splice" or "sleeve" type compression connectors, with minimum of two compression indents per wire, listed for use with copper and aluminum conductors.
  - 2. Insulate with materials approved for the particular use, location, voltage, and temperature. Insulation level shall be not less than the insulation level of the conductors being joined.
  - 3. Splice and insulation shall be product of the same manufacturer.

## 2.3 CONNECTORS AND TERMINATIONS

- A. Mechanical type of high conductivity and corrosion-resistant material, listed for use with copper and aluminum conductors.
- B. Long barrel compression type of high conductivity and corrosion-resistant material, with minimum of two compression indents per wire, listed for use with copper and aluminum conductors.
- C. All bolts, nuts, and washers used to connect connections and terminations to bus bars or other termination points shall be zinc-plated steel.

## **2.4 CONTROL WIRING**

- A. Unless otherwise specified elsewhere in these specifications, control wiring shall be as specified herein, except that the minimum size shall be not less than No. 14 AWG.
- B. Control wiring shall be sized such that the voltage drop under in-rush conditions does not adversely affect operation of the controls.

## **2.5 WIRE LUBRICATING COMPOUND**

- A. Lubricating compound shall be suitable for the wire insulation and conduit and shall not harden or become adhesive.
- B. Shall not be used on conductors for isolated power systems.

## **PART 3 - EXECUTION**

### **3.1 GENERAL**

- A. Install conductors in accordance with the NEC, as specified, and as shown on the drawings.
- B. Install all conductors in raceway systems.
- C. Splice conductors only in outlet boxes, junction boxes, pullboxes, manholes, or handholes.
- D. Conductors of different systems (e.g., 120 V and 277 V) shall not be installed in the same raceway.
- E. Install cable supports for all vertical feeders in accordance with the NEC. Provide split wedge type which firmly clamps each individual cable and tightens due to cable weight.
- F. In panelboards, cabinets, wireways, switches, enclosures, and equipment assemblies, neatly form, train, and tie the conductors with non-metallic ties.
- G. For connections to motors, transformers, and vibrating equipment, stranded conductors shall be used only from the last fixed point of connection to the motors, transformers, or vibrating equipment.
- H. Use expanding foam or non-hardening duct-seal to seal conduits entering a building, after installation of conductors.
- I. Conductor and Cable Pulling:
  - 1. Provide installation equipment that will prevent the cutting or abrasion of insulation during pulling. Use lubricants approved for the cable.
  - 2. Use non-metallic pull ropes.
  - 3. Attach pull ropes by means of either woven basket grips or pulling eyes attached directly to the conductors.

4. All conductors in a single conduit shall be pulled simultaneously.
5. Do not exceed manufacturer's recommended maximum pulling tensions and sidewall pressure values.

J. When stripping stranded conductors, use a tool that does not damage the conductor or remove conductor strands.

### **3.2 SPLICE AND TERMINATION INSTALLATION**

- A. Splices and terminations shall be mechanically and electrically secure and tightened to manufacturer's published torque values using a torque screwdriver or wrench.
- B. Where the Government determines that unsatisfactory splices or terminations have been installed, replace the splices or terminations at no additional cost to the Government.

### **3.3 CONDUCTOR IDENTIFICATION**

- A. When using colored tape to identify phase, neutral, and ground conductors larger than No. 8 AWG, apply tape in half-overlapping turns for a minimum of 75 mm (3 inches) from terminal points and in junction boxes, pullboxes, and manholes. Apply the last two laps of tape with no tension to prevent possible unwinding. Where cable markings are covered by tape, apply tags to cable stating size and insulation type.

### **3.4 FEEDER CONDUCTOR IDENTIFICATION**

- A. In each interior pullbox and each underground manhole and handhole, install brass tags on all feeder conductors to clearly designate their circuit identification and voltage. The tags shall be the embossed type, 40 mm (1-1/2 inches) in diameter and 40 mils thick. Attach tags with plastic ties.

### **3.5 CONTROL WIRING INSTALLATION**

- A. Unless otherwise specified in other sections, install control wiring and connect to equipment to perform the required functions as specified or as shown on the drawings.
- B. Install a separate power supply circuit for each system, except where otherwise shown on the drawings.

### **3.6 CONTROL WIRING IDENTIFICATION**

- A. Install a permanent wire marker on each wire at each termination.
- B. Identifying numbers and letters on the wire markers shall correspond to those on the wiring diagrams used for installing the systems.
- C. Wire markers shall retain their markings after cleaning.
- D. In each manhole and handhole, install embossed brass tags to identify the system served and function.

**3.7 ACCEPTANCE CHECKS AND TESTS**

A. Perform in accordance with the manufacturer's recommendations.

In addition, include the following:

1. Visual Inspection and Tests: Inspect physical condition.
2. Electrical Tests:
  - a. After installation, but before connection to utilization devices, such as fixtures, motors, or appliances, test conductors phase-to-phase and phase-to-ground resistance with an insulation resistance tester. Existing conductors to be reused shall also be tested.
  - b. Applied voltage shall be 500VDC for 300V rated cable, and 1000VDC for 600V rated cable. Apply test for one minute or until reading is constant for 15 seconds, whichever is longer. Minimum insulation resistance values shall not be less than 25 megohms for 300V rated cable and 100 megohms for 600V rated cable.
  - c. Perform phase rotation test on all three-phase circuits.

---END---



**SECTION 26 05 26**  
**GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, connection, and testing of grounding and bonding equipment, indicated as grounding equipment in this section.
- B. "Grounding electrode system" refers to grounding electrode conductors and all electrodes required or allowed by NEC, as well as made, supplementary, and lightning protection system grounding electrodes.
- C. The terms "connect" and "bond" are used interchangeably in this section and have the same meaning.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS:  
Requirements that apply to all sections of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES:  
Low-voltage conductors.
- C. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduit and boxes.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American Society for Testing and Materials (ASTM):
  - B1-07.....Standard Specification for Hard-Drawn Copper Wire
  - B3-07.....Standard Specification for Soft or Annealed Copper Wire
  - B8-11.....Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft

- C. Institute of Electrical and Electronics Engineers, Inc. (IEEE):
  - 81-83.....IEEE Guide for Measuring Earth Resistivity,  
Ground Impedance, and Earth Surface Potentials  
of a Ground System Part 1: Normal Measurements
- D. National Fire Protection Association (NFPA):
  - 70-11.....National Electrical Code (NEC)
  - 70E-12.....National Electrical Safety Code
  - 99-12.....Health Care Facilities
- E. Underwriters Laboratories, Inc. (UL):
  - 44-10 .....Thermoset-Insulated Wires and Cables
  - 83-08 .....Thermoplastic-Insulated Wires and Cables
  - 467-07 .....Grounding and Bonding Equipment

## **PART 2 - PRODUCTS**

### **2.1 GROUNDING AND BONDING CONDUCTORS**

- A. Equipment grounding conductors shall be insulated stranded copper. Insulation color shall be continuous green for all equipment grounding conductors, except that wire sizes No. 4 AWG and larger shall be identified per NEC.
- B. Bonding conductors shall be bare stranded copper. Bonding conductors shall be stranded for final connection to motors, transformers, and vibrating equipment.
- C. Conductor sizes shall not be less than shown on the drawings or not less than required by the NEC, whichever is greater.
- D. Insulation: THHN-THWN and XHHW-2. XHHW-2 shall be used for isolated power systems.

### **2.2 GROUND CONNECTIONS**

- A. Below Grade and Inaccessible Locations: Exothermic-welded type connectors.
- B. Above Grade:
  - 1. Bonding Jumpers: Listed for use with aluminum and copper conductors. For wire sizes No. 8 AWG and larger, use compression-type connectors. For wire sizes smaller than No. 8 AWG, use mechanical type lugs. Connectors or lugs shall use zinc-plated steel bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.
  - 2. Connection to Building Steel: Exothermic-welded type connectors.



3. Connection to Grounding Bus Bars: Listed for use with aluminum and copper conductors. Use mechanical type lugs, with zinc-plated steel bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.
4. Connection to Equipment Rack and Cabinet Ground Bars: Listed for use with aluminum and copper conductors. Use mechanical type lugs, with zinc-plated steel bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.

### **2.3 GROUND TERMINAL BLOCKS**

- A. At any equipment mounting location (e.g., backboards and hinged cover enclosures) where rack-type ground bars cannot be mounted, provide mechanical type lugs, with zinc-plated steel bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.

## **PART 3 - EXECUTION**

### **3.1 GENERAL**

- A. Install grounding equipment in accordance with the NEC, as shown on the drawings, and as specified herein.
- B. Equipment Grounding: Metallic piping, building structural steel, electrical enclosures, raceways, junction boxes, outlet boxes, cabinets, machine frames, and other conductive items in close proximity with electrical circuits, shall be bonded and grounded.
- C. For patient care area electrical power system grounding, conform to NFPA 99 and NEC.

### **3.2 INACCESSIBLE GROUNDING CONNECTIONS**

- A. Make grounding connections which are normally buried or otherwise inaccessible, by exothermic weld.

### **3.3 RACEWAY**

- A. Conduit Systems:
  1. Ground all metallic conduit systems. All metallic conduit systems shall contain an equipment grounding conductor.
  2. Non-metallic conduit systems, except non-metallic feeder conduits that carry a grounded conductor from exterior transformers to interior or building-mounted service entrance equipment, shall contain an equipment grounding conductor.
  3. Metallic conduit that only contains a grounding conductor and is provided for its mechanical protection shall be bonded to that conductor at the entrance and exit from the conduit.

4. Metallic conduits which terminate without mechanical connection to an electrical equipment housing by means of locknut and bushings or adapters shall be provided with grounding bushings. Connect bushings with a equipment grounding conductor to the equipment ground bus.
- B. Feeders and Branch Circuits: Install equipment grounding conductors with all feeders and power and lighting branch circuits.
- C. Boxes, Cabinets, Enclosures, and Panelboards:
  1. Bond the equipment grounding conductor to each pullbox, junction box, outlet box, device box, cabinets, and other enclosures through which the conductor passes (except for special grounding systems for intensive care units and other critical units shown).
  2. Provide lugs in each box and enclosure for equipment grounding conductor termination.
- D. Wireway Systems:
  1. Bond the metallic structures of wireway to provide electrical continuity throughout the wireway system, by connecting a No. 6 AWG bonding jumper at all intermediate metallic enclosures and across all section junctions.
  2. Install insulated No. 6 AWG bonding jumpers between the wireway system, bonded as required above, and the closest building ground at each end and approximately every 16 M (50 feet).
  3. Use insulated No. 6 AWG bonding jumpers to ground or bond metallic wireway at each end for all intermediate metallic enclosures and across all section junctions.
  4. Use insulated No. 6 AWG bonding jumpers to ground cable tray to column-mounted building ground plates (pads) at each end and approximately every 15 M (49 feet).
- E. Receptacles shall not be grounded through their mounting screws. Ground receptacles with a jumper from the receptacle green ground terminal to the device box ground screw and a jumper to the branch circuit equipment grounding conductor.
- F. Ground lighting fixtures to the equipment grounding conductor of the wiring system. Fixtures connected with flexible conduit shall have a green ground wire included with the power wires from the fixture through the flexible conduit to the first outlet box.

- G. Fixed electrical appliances and equipment shall be provided with a ground lug for termination of the equipment grounding conductor.
- H. Panelboard Bonding in Patient Care Areas: The equipment grounding terminal buses of the normal and essential branch circuit panel boards serving the same individual patient vicinity shall be bonded together with an insulated continuous copper conductor not less than No. 10 AWG, installed in rigid metal conduit.

#### **3.4 CORROSION INHIBITORS**

- A. When making grounding and bonding connections, apply a corrosion inhibitor to all contact surfaces. Use corrosion inhibitor appropriate for protecting a connection between the metals used.

#### **3.5 CONDUCTIVE PIPING**

- A. Bond all conductive piping systems, interior and exterior, to the grounding electrode system. Bonding connections shall be made as close as practical to the equipment ground bus.

---END---



## **SECTION 26 05 29**

### **HANGERS AND SUPPORTS FOR ELECTRICAL PIPING AND CONDUIT**

#### **PART 1 - GENERAL**

##### **1.1 WORK INCLUDED**

- A. Conduit and equipment supports, straps, clamps, steel channel, etc. and fastening hardware for supporting electrical work.

##### **1.2 RELATED WORK**

- A. Applicable provisions of Division 01 shall govern all work under this Section.
- B. Section 05 05 20 - Fasteners and Metal Fastenings
- C. Section 26 05 33 - Raceway and Boxes for Electrical Systems

##### **1.3 QUALITY ASSURANCE**

- A. Support systems shall be adequate for weight of equipment and conduit, including wiring, which they carry.

#### **PART 2 - PRODUCTS (Reference NFPA 70)**

##### **2.1 MATERIAL**

- A. Support Channel: Steel, galvanized, enameled or other corrosion-resistant; sized to support the load.
- B. Hardware: Corrosion-resistant.
- C. Minimum sized threaded rod for supports shall be 3/8" for trapezes and single conduits 1-1/4" and larger, and 1/4" for single conduits 1" and smaller.
- D. Conduit clamps, straps, supports, etc. shall be steel or malleable iron. One-hole straps shall be heavy duty type. All straps shall have steel or malleable iron backing plates where rigid steel conduit is installed on the interior or exterior surface of any exterior building wall.

#### **PART 3 - EXECUTION (Reference NFPA 70)**

##### **3.1 INSTALLATION**

- A. Fasten hanger rods, conduit clamps, outlet, junction and pull boxes to building structure using pre-cast insert system, preset inserts, beam clamps, expansion anchors, or spring steel clips (interior metal stud walls only).

- B. Use toggle bolts or hollow wall fasteners in hollow masonry, plaster, or gypsum board partitions and walls; expansion anchors or preset inserts in solid masonry walls; self-drilling anchors or expansion anchor on concrete surfaces; sheet metal screws in sheet metal studs; and wood screws in wood construction. If nail-in anchors are used, they must be removable type anchors.
- C. Do not use powder-actuated or plastic anchors.
- D. File and de-bur cut ends of support channel and spray paint with cold galvanized paint to prevent rusting.
- E. Do not fasten supports to piping, ductwork, mechanical equipment, cable tray or conduit. Do not fasten to suspended ceiling grid system.
- F. Do not drill structural steel members unless approved by Architect/Engineer.
- G. Fabricate supports from galvanized structural steel or steel channel, rigidly welded or bolted to present a neat appearance. Use hexagon head bolts with spring lock washers under all nuts.
- H. In wet locations, mechanical rooms and electrical rooms, install free-standing electrical equipment on 4" concrete pads.
- I. Install surface-mounted cabinets and panelboards with minimum of four anchors. Provide steel channel supports to stand cabinet 1" (25 mm) off wall (7/8" Uni-Strut or 3/4" painted, fire-retardant plywood is acceptable).
- J. Bridge studs top and bottom with channels to support flush-mounted cabinets and panelboards in stud walls.
- K. Furnish and install all supports as required to fasten all electrical components required for the project, including free standing supports required for those items remotely mounted from the building structure, catwalks, walkways etc.

---END---

**SECTION 26 05 33**  
**RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, and connection of conduit, fittings, and boxes, to form complete, coordinated, grounded raceway systems. Raceways are required for all wiring unless shown or specified otherwise.

**1.2 RELATED WORK**

- A. Section 06 10 00, ROUGH CARPENTRY: Mounting board for Data Rooms.
- B. Section 07 60 00, FLASHING AND SHEET METAL: Fabrications for the deflection of water away from the building envelope at penetrations.
- C. Section 07 84 00, FIRESTOPPING: Sealing around penetrations to maintain the integrity of fire rated construction.
- D. Section 07 92 00, JOINT SEALANTS: Sealing around conduit penetrations through the building envelope to prevent moisture migration into the building.
- E. Section 09 91 00, PAINTING: Identification and painting of conduit and other devices.
- F. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- G. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.

**1.3 QUALITY ASSURANCE**

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American National Standards Institute (ANSI):
  - C80.1-05.....Electrical Rigid Steel Conduit
  - C80.3-05.....Steel Electrical Metal Tubing
  - C80.6-05.....Electrical Intermediate Metal Conduit

## C. National Fire Protection Association (NFPA):

70-11.....National Electrical Code (NEC)

## D. Underwriters Laboratories, Inc. (UL):

1-05.....Flexible Metal Conduit

5-11.....Surface Metal Raceway and Fittings

6-07.....Electrical Rigid Metal Conduit - Steel

50-95.....Enclosures for Electrical Equipment

360-13.....Liquid-Tight Flexible Steel Conduit

467-13.....Grounding and Bonding Equipment

514A-13.....Metallic Outlet Boxes

514B-12.....Conduit, Tubing, and Cable Fittings

514C-07.....Nonmetallic Outlet Boxes, Flush-Device Boxes  
and Covers651-11.....Schedule 40 and 80 Rigid PVC Conduit and  
Fittings651A-11.....Type EB and A Rigid PVC Conduit and HDPE  
Conduit

797-07.....Electrical Metallic Tubing

1242-06.....Electrical Intermediate Metal Conduit - Steel

## E. National Electrical Manufacturers Association (NEMA):

TC-2-13.....Electrical Polyvinyl Chloride (PVC) Tubing and  
ConduitTC-3-13.....PVC Fittings for Use with Rigid PVC Conduit and  
TubingFB1-12.....Fittings, Cast Metal Boxes and Conduit Bodies  
for Conduit, Electrical Metallic Tubing and  
CableFB2.10-13.....Selection and Installation Guidelines for  
Fittings for use with Non-Flexible Conduit  
or Tubing (Rigid Metal Conduit, Intermediate  
Metallic Conduit, and Electrical Metallic  
Tubing)FB2.20-12.....Selection and Installation Guidelines for  
Fittings for use with Flexible Electrical  
Conduit and Cable

## F. American Iron and Steel Institute (AISI):

S100-2007.....North American Specification for the Design  
of Cold-Formed Steel Structural Members



**PART 2 - PRODUCTS****2.1 MATERIAL**

- A. Conduit Size: In accordance with the NEC but not less than 13 mm (0.5-inch) unless otherwise shown. Where permitted by the NEC, 13 mm (0.5-inch) flexible conduit may be used for tap connections to recessed lighting fixtures.
- B. Conduit:
  - 1. Size: In accordance with the NEC but not less than 13 mm (0.5-inch).
  - 2. Rigid Steel Conduit (RMC): Shall conform to UL 6 and ANSI C80.1.
  - 3. Electrical Metallic Tubing (EMT): Shall conform to UL 797 and ANSI C80.3. Maximum size not to exceed 105 mm (4 inches) and shall be permitted only with cable rated 600 V or less.
  - 4. Flexible Metal Conduit: Shall conform to UL 1.
  - 5. Liquid-tight Flexible Metal Conduit: Shall conform to UL 360.
  - 6. Direct Burial Plastic Conduit: Shall conform to UL 651 and UL 651A, heavy wall PVC or high density polyethylene (PE).
  - 7. Surface Metal Raceway: Shall conform to UL 5.
- C. Conduit Fittings:
  - 1. Rigid Steel Metallic Conduit Fittings:
    - a. Fittings shall meet the requirements of UL 514B and NEMA FB1.
    - b. Standard Threaded Couplings, Locknuts, Bushings, Conduit Bodies, and Elbows: Only steel or malleable iron materials are acceptable. Integral retractable type IMC couplings are also acceptable.
    - c. Locknuts: Bonding type with sharp edges for digging into the metal wall of an enclosure.
    - d. Bushings: Metallic insulating type, consisting of an insulating insert, molded or locked into the metallic body of the fitting.
    - e. Erickson (Union-Type) and Set Screw Type Couplings: Approved for use in concrete are permitted for use to complete a conduit run where conduit is installed in concrete. Use set screws of case-hardened steel with hex head and cup point to firmly seat in conduit wall for positive ground. Tightening of set screws with pliers is prohibited.
    - f. Sealing Fittings: Threaded cast iron type. Use continuous drain-type sealing fittings to prevent passage of water vapor. In concealed work, install fittings in flush steel boxes with blank cover plates having the same finishes as that of other electrical plates in the room.

2. Electrical Metallic Tubing Fittings:
  - a. Fittings and conduit bodies shall meet the requirements of UL 514B, ANSI C80.3, and NEMA FB1.
  - b. Only steel or compression type connectors and fittings; throated connectors are acceptable.
  - c. Setscrew Couplings and Connectors: Use setscrews of case-hardened steel with hex head and cup point, to firmly seat in wall of conduit for positive grounding.
  - d. Indent-type connectors or couplings are prohibited.
3. Flexible Metal Conduit Fittings:
  - a. Conform to UL 514B. Only steel or malleable iron materials are acceptable.
  - b. Clamp-type, with insulated throat.
4. Liquid-tight Flexible Metal Conduit Fittings:
  - a. Fittings shall meet the requirements of UL 514B and NEMA FB1.
  - b. Only steel or malleable iron materials are acceptable.
  - c. Fittings must incorporate a threaded grounding cone, a steel or plastic compression ring, and a gland for tightening. Connectors shall have insulated throats.
5. Surface Metal Raceway Fittings: As recommended by the raceway manufacturer. Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, conduit entry fittings, accessories, and other fittings as required for complete system.
6. Expansion and Deflection Couplings:
  - a. Conform to UL 467 and UL 514B.
  - b. Accommodate a 19 mm (0.75-inch) deflection, expansion, or contraction in any direction, and allow 30 degree angular deflections.
  - c. Include internal flexible metal braid, sized to guarantee conduit ground continuity and a low-impedance path for fault currents, in accordance with UL 467 and the NEC tables for equipment grounding conductors.
  - d. Jacket: Flexible, corrosion-resistant, watertight, moisture and heat-resistant molded rubber material with stainless steel jacket clamps.

**D. Conduit Supports:**

1. Parts and Hardware: Zinc-coat or provide equivalent corrosion protection.
2. Individual Conduit Hangers: Designed for the purpose, having a pre-assembled closure bolt and nut, and provisions for receiving a hanger rod.
3. Multiple Conduit (Trapeze) Hangers: Not less than 38 mm x 38 mm (1.5 x 1.5 inches), 12-gauge steel, cold-formed, lipped channels; with not less than 9 mm (0.375-inch) diameter steel hanger rods.
4. Solid Masonry and Concrete Anchors: Self-drilling expansion shields, or machine bolt expansion.

**E. Outlet, Junction, and Pull Boxes:**

1. UL-50 and UL-514A.
2. Rustproof cast metal where required by the NEC or shown on drawings.
3. Sheet Metal Boxes: Galvanized steel, except where shown on drawings.

**F. Metal Wireways: Equip with hinged covers, except as shown on drawings. Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, and other fittings to match and mate with wireways as required for a complete system.****PART 3 - EXECUTION****3.1 PENETRATIONS****A. Cutting or Holes:**

1. Cut holes in advance where they should be placed in the structural elements, such as ribs or beams. Obtain the approval of the COR prior to drilling through structural elements.
2. Cut holes through concrete and masonry in new and existing structures with a diamond core drill or concrete saw. Pneumatic hammers, impact electric, hand, or manual hammer-type drills are not allowed, except when permitted by the COR where working space is limited.

**B. Firestop: Where conduits, wireways, and other electrical raceways pass through fire partitions, fire walls, smoke partitions or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING.****C. Waterproofing: At floor, exterior wall, and roof conduit penetrations, completely seal the gap around conduit to render it watertight, as specified in Section 07 92 00, JOINT SEALANTS.**

### 3.2 INSTALLATION, GENERAL

- A. In accordance with UL, NEC, NEMA, as shown on drawings, and as specified herein.
- B. Raceway systems used for Essential Electrical Systems (EES) shall be entirely independent of other raceway systems.
- C. Install conduit as follows:
  - 1. In complete mechanically and electrically continuous runs before pulling in cables or wires.
  - 2. Unless otherwise indicated on the drawings or specified herein, installation of all conduits shall be concealed within finished walls, floors, and ceilings.
  - 3. Flattened, dented, or deformed conduit is not permitted. Remove and replace the damaged conduits with new conduits.
  - 4. Assure conduit installation does not encroach into the ceiling height head room, walkways, or doorways.
  - 5. Cut conduits square, ream, remove burrs, and draw up tight.
  - 6. Do not use suspended ceilings, suspended ceiling supporting members, lighting fixtures, other conduits, cable tray, boxes, piping, or ducts to support conduits and conduit runs.
  - 7. Close ends of empty conduits with plugs or caps at the rough-in stage until wires are pulled in to prevent entry of debris.
  - 8. Conduit installations under fume and vent hoods are prohibited.
  - 9. Secure conduits to cabinets, junction boxes, pull-boxes, and outlet boxes with bonding type locknuts. For rigid steel and IMC conduit installations, provide a locknut on the inside of the enclosure, made up wrench tight. Do not make conduit connections to junction box covers.
  - 10. Flashing of penetrations of the roof membrane is specified in Section 07 60 00, FLASHING AND SHEET METAL.
- D. Conduit Bends:
  - 1. Make bends with standard conduit bending machines.
  - 2. Conduit hickey may be used for slight offsets and for straightening stubbed out conduits.
  - 3. Bending of conduits with a pipe tee or vise is prohibited.

E. Layout and Homeruns:

1. Install conduit with wiring, including homeruns, as shown on drawings.
2. Deviations: Make only where necessary to avoid interferences and only after drawings showing the proposed deviations have been submitted and approved by the COR.

### 3.3 CONCEALED WORK INSTALLATION

A. In Concrete:

1. Conduit: Rigid steel or PVC.
2. Align and run conduit in direct lines.
3. Install conduit through concrete beams only:
  - a. Where shown on the structural drawings.
  - b. As approved by the COR prior to construction, and after submittal of drawing showing location, size, and position of each penetration.
4. Installation of conduit in concrete that is less than 75 mm (3 inches) thick is prohibited.
  - a. Conduit outside diameter larger than one-third of the slab thickness is prohibited.
  - b. Space Between Conduits in Slabs: Approximately six conduit diameters apart, and one conduit diameter at conduit crossings.
  - c. Install conduits approximately in the center of the slab so that there will be a minimum of 19 mm (0.75-inch) of concrete around the conduits.
5. Make couplings and connections watertight. Use thread compounds that are UL approved conductive type to ensure low resistance ground continuity through the conduits. Tightening setscrews with pliers is prohibited.

B. Above Furred or Suspended Ceilings and in Walls:

1. Conduit for Conductors 600 V and Below: Rigid steel or EMT.  
Mixing different types of conduits in the same system is prohibited.
2. Align and run conduit parallel or perpendicular to the building lines.
3. Connect recessed lighting fixtures to conduit runs with maximum 1.8 M (6 feet) of flexible metal conduit extending from a junction box to the fixture.

4. Tightening set screws with pliers is prohibited.
5. For conduits running through metal studs, limit field cut holes to no more than 70% of web depth. Spacing between holes shall be at least 457 mm (18 inches). Cuts or notches in flanges or return lips shall not be permitted.

### **3.4 EXPOSED WORK INSTALLATION**

- A. Unless otherwise indicated on drawings, exposed conduit is only permitted in mechanical and electrical rooms.
- B. Conduit for Conductors Above 600 V: Rigid steel. Mixing different types of conduits in the system is prohibited.
- C. Conduit for Conductors 600 V and Below: Rigid steel or EMT. Mixing different types of conduits in the system is prohibited.
- D. Align and run conduit parallel or perpendicular to the building lines.
- E. Install horizontal runs close to the ceiling or beams and secure with conduit straps.
- F. Support horizontal or vertical runs at not over 2.4 M (8 feet) intervals.
- G. Surface Metal Raceways: Use only where shown on drawings.
- H. Painting:
  1. Paint exposed conduit as specified in Section 09 91 00, PAINTING.
  2. Paint all conduits containing cables rated over 600 V safety orange. Refer to Section 09 91 00, PAINTING for preparation, paint type, and exact color. In addition, paint legends, using 50 mm (2 inch) high black numerals and letters, showing the cable voltage rating. Provide legends where conduits pass through walls and floors and at maximum 6 M (20 feet) intervals in between.

### **3.5 HAZARDOUS LOCATIONS**

- A. Use rigid steel conduit only.
- B. Install UL approved sealing fittings that prevent passage of explosive vapors in hazardous areas equipped with explosion-proof lighting fixtures, switches, and receptacles, as required by the NEC.

### **3.6 WET OR DAMP LOCATIONS**

- A. Use rigid steel or IMC conduits unless as shown on drawings.
- B. Provide sealing fittings to prevent passage of water vapor where conduits pass from warm to cold locations, i.e., refrigerated spaces, constant-temperature rooms, air-conditioned spaces, building exterior walls, roofs, or similar spaces.

- C. Use rigid steel conduit within 1.5 M (5 feet) of the exterior and below concrete building slabs in contact with soil, gravel, or vapor barriers, unless as shown on drawings. Conduit shall be half-lapped with 10 mil PVC tape before installation. After installation, completely recoat or retape any damaged areas of coating.
- D. Conduits run on roof shall be supported with integral galvanized lipped steel channel, attached to UV-inhibited polycarbonate or polypropylene blocks every 2.4 M (8 feet) with 9 mm (3/8-inch) galvanized threaded rods, square washer and locknut. Conduits shall be attached to steel channel with conduit clamps.

### **3.7 EXPANSION JOINTS**

- A. Conduits 75 mm (3 inch) and larger that are secured to the building structure on opposite sides of a building expansion joint require expansion and deflection couplings. Install the couplings in accordance with the manufacturer's recommendations.
- B. Provide conduits smaller than 75 mm (3 inch) with junction boxes on both sides of the expansion joint. Connect flexible metal conduits to junction boxes with sufficient slack to produce a 125 mm (5 inch) vertical drop midway between the ends of the flexible metal conduit. Flexible metal conduit shall have a green insulated copper bonding jumper installed. In lieu of this flexible metal conduit, expansion and deflection couplings as specified above are acceptable.
- C. Install expansion and deflection couplings where shown.

### **3.8 CONDUIT SUPPORTS (REFERENCE NFPA 70) (ALSO REFERENCE SECTION 26 05 29 - HANGERS & SUPPORTS)**

- A. Safe working load shall not exceed one-quarter of proof test load of fastening devices.
- B. Use pipe straps or individual conduit hangers for supporting individual conduits.
- C. Support multiple conduit runs with trapeze hangers. Use trapeze hangers that are designed to support a load equal to or greater than the sum of the weights of the conduits, wires, hanger itself, and an additional 90 kg (200 lbs). Attach each conduit with U-bolts or other approved fasteners.
- D. Support conduit independently of junction boxes, pull-boxes, fixtures, suspended ceiling T-bars, angle supports, and similar items.

- E. Fasteners and Supports in Solid Masonry and Concrete:
  - 1. New Construction: Use steel or malleable iron concrete inserts set in place prior to placing the concrete.
  - 2. Existing Construction:
    - a. Steel expansion anchors not less than 6 mm (0.25-inch) bolt size and not less than 28 mm (1.125 inch) in embedment.
    - b. Power set fasteners not less than 6 mm (0.25-inch) diameter with depth of penetration not less than 75 mm (3 inch).
    - c. Use vibration and shock-resistant anchors and fasteners for attaching to concrete ceilings.
- F. Hollow Masonry: Toggle bolts.
- G. Bolts supported only by plaster or gypsum wallboard are not acceptable.
- H. Metal Structures: Use machine screw fasteners or other devices specifically designed and approved for the application.
- I. Attachment by wood plugs, rawl plug, plastic, lead or soft metal anchors, or wood blocking and bolts supported only by plaster is prohibited.
- J. Chain, wire, or perforated strap shall not be used to support or fasten conduit.
- K. Spring steel type supports or fasteners are prohibited for all uses except horizontal and vertical supports/fasteners within walls.
- L. Vertical Supports: Vertical conduit runs shall have riser clamps and supports in accordance with the NEC and as shown. Provide supports for cable and wire with fittings that include internal wedges and retaining collars.

### **3.9 BOX INSTALLATION**

- A. Boxes for Concealed Conduits:
  - 1. Flush-mounted.
  - 2. Provide raised covers for boxes to suit the wall or ceiling, construction, and finish.
- B. In addition to boxes shown, install additional boxes where needed to prevent damage to cables and wires during pulling-in operations or where more than the equivalent of 4-90 degree bends are necessary.
- C. Locate pullboxes so that covers are accessible and easily removed. Coordinate locations with piping and ductwork where installed above ceilings.



- D. Remove only knockouts as required. Plug unused openings. Use threaded plugs for cast metal boxes and snap-in metal covers for sheet metal boxes.
- E. Flush-mounted wall or ceiling boxes shall be installed with raised covers so that the front face of raised cover is flush with the wall. Surface-mounted wall or ceiling boxes shall be installed with surface-style flat or raised covers.
- F. Stencil or install labels on covers of the boxes identified on riser diagrams; for example "SIG-FA JB No. 1."
- G. On all branch circuit junction box covers, identify the circuits with black marker.

---END---



**SECTION 26 27 26**  
**WIRING DEVICES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, connection, and testing of wiring devices.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements that are common to more than one section of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Cables and wiring.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduit and boxes.
- E. Section 26 51 00, INTERIOR LIGHTING: Fluorescent ballasts and LED drivers for use with manual dimming controls.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS:
  - 1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Include electrical ratings, dimensions, mounting details, construction materials, grade, and termination information.
  - 2. Manuals:
    - a. Submit, simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals, including technical data sheets and information for ordering replacement parts.
    - b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.

3. Certifications: Two weeks prior to final inspection, submit the following.
  - a. Certification by the manufacturer that the wiring devices conform to the requirements of the drawings and specifications.
  - b. Certification by the Contractor that the wiring devices have been properly installed and adjusted.

## **1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by basic designation only.
- B. National Fire Protection Association (NFPA):
  - 70-14.....National Electrical Code (NEC)
  - 99-15.....Health Care Facilities
- C. National Electrical Manufacturers Association (NEMA):
  - WD 1-10.....General Color Requirements for Wiring Devices
  - WD 6-12 .....Wiring Devices - Dimensional Specifications
- D. Underwriter's Laboratories, Inc. (UL):
  - 5-11.....Surface Metal Raceways and Fittings
  - 20-10.....General-Use Snap Switches
  - 231-08.....Power Outlets
  - 467-13.....Grounding and Bonding Equipment
  - 498-12.....Attachment Plugs and Receptacles
  - 943-15.....Ground-Fault Circuit-Interrupters
  - 1449-14.....Surge Protective Devices
  - 1472-15.....Solid State Dimming Controls

## **PART 2 - PRODUCTS**

### **2.1 RECEPTACLES**

- A. General: All receptacles shall comply with NEMA, NFPA, UL, and as shown on the drawings.
  1. Mounting straps shall be nickel plated brass, brass, nickel plated steel or galvanize steel with break-off plaster ears and shall include a self-grounding feature. Terminal screws shall be brass, brass plated, or a copper alloy metal.
  2. Receptacles shall have provisions for back wiring with separate metal clamp type terminals (four minimum) and side wiring from four captively held binding screws.

- B. Duplex Receptacles - Hospital-grade: Shall be listed for hospital grade, single phase, 20 ampere, 120 volts, 2-pole, 3-wire, NEMA 5-20R, with break-off feature for two-circuit operation.
1. Bodies shall be ivory in color.
  2. Switched duplex receptacles shall be wired so that only the top receptacle is switched. The lower receptacle shall be unswitched.
  3. Duplex Receptacles on Emergency Circuit:
    - a. In rooms without emergency powered general lighting, the emergency receptacles shall be of the self-illuminated type.
  4. Ground Fault Current Interrupter (GFCI) Duplex Receptacles: Shall be an integral unit, hospital-grade, suitable for mounting in a standard outlet box, with end-of-life indication and provisions to isolate the face due to improper wiring. GFCI receptacles shall be self-test receptacles in accordance with UL 943.
    - a. Ground fault interrupter shall consist of a differential current transformer, self-test, solid state sensing circuitry and a circuit interrupter switch. Device shall have nominal sensitivity to ground leakage current of 4-6 milliamperes and shall function to interrupt the current supply for any value of ground leakage current above five milliamperes (+ or - 1 milliampere) on the load side of the device. Device shall have a minimum nominal tripping time of 0.025 second.
    - b. Self-test function shall be automatically initiated within 5 seconds after power is activated to the receptacles. Self-test function shall be periodically and automatically performed every 3 hours or less.
    - c. End-of-life indicator light shall be a persistent flashing or blinking light to indicate that the GFCI receptacle is no longer in service.
  5. Tamper-Resistant Duplex Receptacles:
    - a. Bodies shall be gray in color.
      - 1) Shall permit current to flow only while a standard plug is in the proper position in the receptacle.
      - 2) Screws exposed while the wall plates are in place shall be the tamperproof type.

C. Duplex Receptacles - Non-hospital Grade: Shall be the same as duplex receptacles - hospital grade in accordance with sections 2.1A and 2.1B of this specification, except for the hospital grade listing.

1. Bodies shall be brown nylon.

D. Receptacles - 20, 30, and 50 Ampere, 250 Volts: Shall be complete with appropriate cord grip plug.

E. Receptacles With USB - Shall be the same as described above with two USB ports in the center.

## **2.2 TOGGLE SWITCHES**

A. Toggle switches shall be totally enclosed tumbler type with nylon bodies. Handles shall be ivory in color unless otherwise specified or shown on the drawings.

1. Switches installed in hazardous areas shall be explosion-proof type in accordance with the NEC and as shown on the drawings.

2. Shall be single unit toggle, butt contact, quiet AC type, heavy-duty general-purpose use with an integral self-grounding mounting strap with break-off plaster ears and provisions for back wiring with separate metal wiring clamps and side wiring with captively held binding screws.

3. Switches shall be rated 20 amperes at 120-277 Volts AC.

## **2.3 MANUAL DIMMING CONTROL (LED RATING)**

A. Electronic full-wave manual slide dimmer with on/off switch and audible frequency and EMI/RFI suppression filters.

B. Manual dimming controls shall be fully compatible with LED dimming driver and be approved by the driver manufacturer, shall operate over full specified dimming range, and shall not degrade the performance or rated life of the electronic dimming ballast and lamp.

C. Provide single-pole, three-way or four-way as shown on the drawings.

D. Manual dimming control and faceplates shall be ivory in color unless otherwise specified.

## **2.4 WALL PLATES**

A. Wall plates for switches and receptacles shall be smooth nylon. Oversize plates are not acceptable.

B. Color shall be ivory unless otherwise specified.

C. For receptacles or switches mounted adjacent to each other, wall plates shall be common for each group of receptacles or switches.

- D. In areas requiring tamperproof wiring devices, wall plates shall be Type 302 stainless steel, and shall have tamperproof screws and beveled edges.
- E. Duplex Receptacles on Emergency Circuit: Wall plates shall be red nylon with the word "EMERGENCY" labeled in 6 mm (1/4 inch) white letters.

## **2.5 SURFACE MULTIPLE-OUTLET ASSEMBLIES**

- A. Shall have the following features:
  - 1. Enclosures:
    - a. Thickness of steel shall be not less than 1 mm (0.040 inch) for base and cover. Nominal dimensions shall be 40 mm x 70 mm (1-1/2 inches by 2-3/4 inches) with inside cross sectional area not less than 2250 square mm (3-1/2 square inches). The enclosures shall be thoroughly cleaned, phosphatized, and painted at the factory with primer and the manufacturer's standard baked enamel finish.
  - 2. Receptacles shall be duplex, hospital grade. See paragraph 'RECEPTACLES' in this Section. Device cover plates shall be the manufacturer's standard corrosion-resistant finish and shall not exceed the dimensions of the enclosure.
  - 3. Unless otherwise shown on drawings, receptacle spacing shall be 600 mm (24 inches) on centers.
  - 4. Conductors shall be as specified in Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLE.
  - 5. Installation fittings shall be the manufacturer's standard bends, offsets, device brackets, inside couplings, wire clips, elbows, and other components as required for a complete system.
  - 6. Bond the assemblies to the branch circuit conduit system.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Installation shall be in accordance with the NEC and as shown as on the drawings.
- B. Install wiring devices after wall construction and painting is complete.
- C. The ground terminal of each wiring device shall be bonded to the outlet box with an approved green bonding jumper, and also connected to the branch circuit equipment grounding conductor.

- D. Outlet boxes for toggle switches and manual dimming controls shall be mounted on the strike side of doors.
- E. Provide barriers in multi-gang outlet boxes to comply with the NEC.
- F. Coordinate the electrical work with the work of other trades to ensure that wiring device flush outlets are positioned with box openings aligned with the face of the surrounding finish material. Pay special attention to installations in cabinet work, and in connection with laboratory equipment.
- G. Exact field locations of floors, walls, partitions, doors, windows, and equipment may vary from locations shown on the drawings. Prior to locating sleeves, boxes and chases for roughing-in of conduit and equipment, the Contractor shall coordinate exact field location of the above items with other trades.
- H. Install wall switches 1.2 M (45 inches to center) above floor, with the toggle OFF position down.
- I. Install wall dimmers 1.2 M (45 inches to center) above floor.
- J. Install receptacles 450 mm (18 inches to center) above floor, and 152 mm (4 inches) above counter backsplash or workbenches. Install specific-use receptacles at heights shown on the drawings.
- K. Install horizontally mounted receptacles with the ground pin to the right and vertically mounted receptacles with the ground down.
- L. When required or recommended by the manufacturer, use a torque screwdriver. Tighten unused terminal screws.
- M. Label device plates with a permanent adhesive label listing panel and circuit feeding the wiring device.

### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Perform manufacturer's required field checks in accordance with the manufacturer's recommendations and the latest NFPA 99. In addition, include the following:
  - 1. Visual Inspection and Tests:
    - a. Inspect physical and electrical conditions.
    - b. Vacuum-clean surface metal raceway interior. Clean metal raceway exterior.



- c. Test wiring devices for damaged conductors, high circuit resistance, poor connections, inadequate fault current path, defective devices, or similar problems using a portable receptacle tester. Correct circuit conditions, remove malfunctioning units and replace with new, and retest as specified above.
  - d. Test GFCI receptacles.
2. Receptacle testing in the Patient Care Spaces, such as retention force of the grounding blade of each receptacle, shall comply with the latest NFPA 99.

---END---



**SECTION 26 51 00  
INTERIOR LIGHTING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION:**

- A. This section specifies the furnishing, installation, and connection of the interior lighting systems. The terms "lighting fixture," "fixture," and "luminaire" are used interchangeably.

**1.2 RELATED WORK**

- A. Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT: Disposal of lamps.
- B. Section 26 05 02, DEMOLITION: Removal and disposal of lamps and ballasts.
- C. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- D. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Low-voltage conductors.
- E. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.
- F. Section 26 27 26, WIRING DEVICES: Wiring devices used for control of the lighting systems.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS:
  - 1. Shop Drawings:
    - a. Submit the following information for each type of lighting fixture designated on the LIGHTING FIXTURE SCHEDULE, arranged in order of lighting fixture designation.
    - b. Material and construction details; include information on housing and optics system.
    - c. Physical dimensions and description.
    - d. Wiring schematic and connection diagram.
    - e. Installation details.
    - f. Energy efficiency data.

- g. Photometric data based on laboratory tests complying with IES Lighting Measurements testing and calculation guides.
  - h. Lamp data including lumen output (initial and mean), color rendition index (CRI), rated life (hours), and color temperature (degrees Kelvin).
  - i. Ballast data including ballast type, starting method, ambient temperature, ballast factor, sound rating, system watts, and total harmonic distortion (THD).
  - j. For LED lighting fixtures, submit US DOE LED Lighting Facts label and IES L70 rated life.
2. Manuals:
- a. Submit, simultaneously with the shop drawings, complete maintenance and operating manuals, including technical data sheets, wiring diagrams, and information for ordering replacement parts.
  - b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
3. Certifications: Two weeks prior to final inspection, submit the following.
- a. Certification by the Contractor that the interior lighting systems have been properly installed and tested.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American National Standards Institute (ANSI):
  - C78.1-91.....Fluorescent Lamps - Rapid-Start Types -  
Dimensional and Electrical Characteristics
  - C78.376-01.....Chromaticity of Fluorescent Lamps
- C. American Society for Testing and Materials (ASTM):
  - C635-07.....Manufacture, Performance, and Testing of Metal  
Suspension Systems for Acoustical Tile and  
Lay-in Panel Ceilings
- D. Environmental Protection Agency (EPA):
  - 40 CFR 261.....Identification and Listing of Hazardous Waste

- E. Federal Communications Commission (FCC):
  - CFR Title 47, Part 15...Radio Frequency Devices
  - CFR Title 47, Part 18...Industrial, Scientific, and Medical Equipment
- F. Illuminating Engineering Society (IES):
  - LM-79-08.....Electrical and Photometric Measurements  
of Solid-State Lighting Products
  - LM-80-08.....Measuring Lumen Maintenance of LED Light  
Sources
  - LM-82-12.....Characterization of LED Light Engines and LED  
Lamps for Electrical and Photometric Properties  
as a Function of Temperature
- G. Institute of Electrical and Electronic Engineers (IEEE):
  - C62.41-91.....Surge Voltages in Low Voltage AC Power Circuits
- H. International Code Council (ICC):
  - IBC-12.....International Building Code
- I. National Fire Protection Association (NFPA):
  - 70-11.....National Electrical Code (NEC)
  - 101-12.....Life Safety Code
- J. National Electrical Manufacturer's Association (NEMA):
  - C82.1-04.....Lamp Ballasts - Line Frequency Fluorescent Lamp  
Ballasts
  - C82.2-02.....Method of Measurement of Fluorescent Lamp  
Ballasts
  - C82.4-02.....Lamp Ballasts - Ballasts for High-Intensity  
Discharge and Low-Pressure Sodium (LPS) Lamps  
(Multiple-Supply Type)
  - C82.11-11.....Lamp Ballasts - High Frequency Fluorescent Lamp  
Ballasts
  - LL-9-09.....Dimming of T8 Fluorescent Lighting Systems
  - SSL-1-10.....Electronic Drivers for LED Devices, Arrays,  
or Systems
- K. Underwriters Laboratories, Inc. (UL):
  - 496-08.....Lampholders
  - 542-0599.....Fluorescent Lamp Starters
  - 844-12.....Luminaires for Use in Hazardous (Classified)  
Locations
  - 924-12.....Emergency Lighting and Power Equipment
  - 935-01.....Fluorescent-Lamp Ballasts

1029-94.....	High-Intensity-Discharge Lamp Ballasts
1029A-06.....	Ignitors and Related Auxiliaries for HID Lamp Ballasts
1598-08.....	Luminaires
1574-04.....	Track Lighting Systems
2108-04.....	Low-Voltage Lighting Systems
8750-09.....	Light Emitting Diode (LED) Light Sources for Use in Lighting Products

## **PART 2 - PRODUCTS**

### **2.1 LIGHTING FIXTURES**

- A. Shall be in accordance with NFPA, UL, as shown on drawings, and as specified.
- B. Sheet Metal:
  - 1. Shall be formed to prevent warping and sagging. Housing, trim and lens frame shall be true, straight (unless intentionally curved), and parallel to each other as designed.
  - 2. Wireways and fittings shall be free of burrs and sharp edges, and shall accommodate internal and branch circuit wiring without damage to the wiring.
  - 3. When installed, any exposed fixture housing surface, trim frame, door frame, and lens frame shall be free of light leaks.
  - 4. Hinged door frames shall operate smoothly without binding.  
Latches shall function easily by finger action without the use of tools.
- C. Drivers and LED's shall be serviceable while the fixture is in its normally installed position. Ballasts shall not be mounted to removable reflectors or wireway covers unless so specified.
- D. Recessed fixtures mounted in an insulated ceiling shall be listed for use in insulated ceilings.
- E. Mechanical Safety: Lighting fixture closures (lens doors, trim frame, hinged housings, etc.) shall be retained in a secure manner by captive screws, chains, aircraft cable, captive hinges, or fasteners such that they cannot be accidentally dislodged during normal operation or routine maintenance.

F. Metal Finishes:

1. The manufacturer shall apply standard finish (unless otherwise specified) over a corrosion-resistant primer, after cleaning to free the metal surfaces of rust, grease, dirt and other deposits. Edges of pre-finished sheet metal exposed during forming, stamping or shearing processes shall be finished in a similar corrosion resistant manner to match the adjacent surface(s). Fixture finish shall be free of stains or evidence of rusting, blistering, or flaking, and shall be applied after fabrication.
2. Interior light reflecting finishes shall be white with not less than 85 percent reflectances, except where otherwise shown on the drawing.
3. Exterior finishes shall be as shown on the drawings.

G. Lighting fixtures shall have a specific means for grounding metallic wireways and housings to an equipment grounding conductor.

H. Lighting fixtures in hazardous areas shall be suitable for installation in Class and Division areas as defined in NFPA 70.

## 2.2 LED LIGHT FIXTURES

A. General:

1. LED light fixtures shall be in accordance with IES, NFPA, UL, as shown on the drawings, and as specified.
2. LED light fixtures shall be Reduction of Hazardous Substances (RoHS)-compliant.
3. LED drivers shall include the following features unless otherwise indicated:
  - a. Minimum Efficiency: 85% at full load.
  - b. Minimum Operating Ambient Temperature: -20° C. (-4° F.)
  - c. Input Voltage: 120 - 277V (±10%) at 60 Hz.
  - d. Integral short circuit, open circuit, and overload protection.
  - e. Power Factor: ≥ 0.95.
  - f. Total Harmonic Distortion: ≤ 20%.
  - g. Comply with FCC 47 CFR Part 15.
4. LED modules shall include the following features unless otherwise indicated:
  - a. Comply with IES LM-79 and LM-80 requirements.
  - b. Minimum CRI 80 and color temperature 3000°K unless otherwise specified in LIGHTING FIXTURE SCHEDULE.
  - c. Minimum Rated Life: 50,000 hours per IES L70.
  - d. Light output lumens as indicated in the LIGHTING FIXTURE SCHEDULE.

B. LED Downlights:

1. Housing, LED driver, and LED module shall be products of the same manufacturer.

C. LED Troffers:

1. LED drivers, modules, and reflector shall be accessible, serviceable, and replaceable from below the ceiling.
2. Housing, LED driver, and LED module shall be products of the same manufacturer.

**PART 3 - EXECUTION**

**3.1 INSTALLATION**

- A. Installation shall be in accordance with the NEC, manufacturer's instructions, and as shown on the drawings or specified.
- B. Align, mount, and level the lighting fixtures uniformly.
- C. Wall-mounted fixtures shall be attached to the studs in the walls, or to a 20 gauge metal backing plate that is attached to the studs in the walls. Lighting fixtures shall not be attached directly to gypsum board.
- D. Lighting Fixture Supports:
  1. Shall provide support for all of the fixtures. Supports may be anchored to channels of the ceiling construction, to the structural slab or to structural members within a partition, or above a suspended ceiling.
  2. Shall maintain the fixture positions after cleaning and relamping.
  3. Shall support the lighting fixtures without causing the ceiling or partition to deflect.
  4. Hardware for Recessed Lighting Fixtures:
    - a. All fixture mounting devices connecting fixtures to the ceiling system or building structure shall have a capacity for a horizontal force of 100 percent of the fixture weight and a vertical force of 400 percent of the fixture weight.



- b. Mounting devices shall clamp the fixture to the ceiling system structure (main grid runners or fixture framing cross runners) at four points in such a manner as to resist spreading of these supporting members. Each support point device shall utilize a screw or approved hardware to "lock" the fixture housing to the ceiling system, restraining the fixture from movement in any direction relative to the ceiling. The screw (size No. 10 minimum) or approved hardware shall pass through the ceiling member (T-bar, channel or spline), or it may extend over the inside of the flange of the channel (or spline) that faces away from the fixture, in a manner that prevents any fixture movement.
  - c. In addition to the above, the following is required for fixtures exceeding 9 kg (20 pounds) in weight:
    - 1) Where fixtures mounted in ASTM Standard C635 "Intermediate Duty" and "Heavy Duty" ceilings and weigh between 9 kg and 25 kg (20 pounds and 56 pounds), provide two 12 gauge safety hangers hung slack between diagonal corners of the fixture and the building structure.
    - 2) Where fixtures weigh over 25 kg (56 pounds), they shall be independently supported from the building structure by approved hangers. Two-way angular bracing of hangers shall be provided to prevent lateral motion.
  - d. Where ceiling cross runners are installed for support of lighting fixtures, they must have a carrying capacity equal to that of the main ceiling runners and be rigidly secured to the main runners.
5. Surface Mounted Lighting Fixtures:
- a. Fixtures shall be bolted against the ceiling independent of the outlet box at four points spaced near the corners of each unit. The bolts (or stud-clips) shall be minimum 6 mm (1/4 inch) bolt, secured to main ceiling runners and/or secured to cross runners. Non-turning studs may be attached to the main ceiling runners and cross runners with special non-friction clip devices designed for the purpose, provided they bolt through the runner, or are also secured to the building structure by 12 gauge safety hangers. Studs or bolts securing fixtures weighing in excess of 25 kg (56 pounds) shall be supported directly from the building structure.

- b. Where ceiling cross runners are installed for support of lighting fixtures, they must have a carrying capacity equal to that of the main ceiling runners and be rigidly secured to the main runners.
  - c. Fixtures less than 6.8 kg (15 pounds) in weight and occupying less than 3715 sq cm (two square feet) of ceiling area may, when designed for the purpose, be supported directly from the outlet box when all the following conditions are met.
    - 1) Screws attaching the fixture to the outlet box pass through round holes (not key-hole slots) in the fixture body.
    - 2) The outlet box is attached to a main ceiling runner (or cross runner) with approved hardware.
    - 3) The outlet box is supported vertically from the building structure.
  - d. Fixtures mounted in open construction shall be secured directly to the building structure with approved bolting and clamping devices.
6. Single or Double Pendant-Mounted Lighting Fixtures:
- a. Each stem shall be supported by an approved outlet box mounted swivel joint and canopy which holds the stem captive and provides spring load (or approved equivalent) dampening of fixture oscillations. Outlet box shall be supported vertically from the building structure.
7. Outlet boxes for support of lighting fixtures (where permitted) shall be secured directly to the building structure with approved devices or supported vertically in a hung ceiling from the building structure with a nine gauge wire hanger, and be secured by an approved device to a main ceiling runner or cross runner to prevent any horizontal movement relative to the ceiling.
- E. Furnish and install the new lamps as specified for all lighting fixtures installed under this project and for all existing lighting fixtures reused under this project.
- F. The electrical and ceiling trades shall coordinate to ascertain that approved lighting fixtures are furnished in the proper sizes and installed with the proper devices (hangers, clips, trim frames, flanges, etc.), to match the ceiling system being installed.
- G. Bond lighting fixtures to the grounding system as specified in Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.

- H. At completion of project, replace all defective components of the lighting fixtures at no cost to the Government.
- I. Dispose of lamps per requirements of Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT, and Section 26 05 02, DEMOLITION.

### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Perform the following:
  - 1. Visual Inspection:
    - a. Verify proper operation by operating the lighting controls.
    - b. Visually inspect for damage to fixtures, lenses, reflectors, diffusers, and louvers. Clean fixtures, lenses, reflectors, diffusers, and louvers that have accumulated dust, dirt, or fingerprints during construction.
  - 2. Electrical Tests:
    - a. Exercise dimming components of the lighting fixtures over full range of dimming capability by operating the control devices(s) in the presence of the COR. Observe for visually detectable flicker over full dimming range, and replace defective components at no cost to the Government.
    - b. Burn-in all lamps that require specific aging period to operate properly, prior to occupancy by Government. Burn-in period to be 40 hours minimum, unless specifically recommended otherwise by the lamp manufacturer. Burn-in dimmed fluorescent and compact fluorescent lamps for at least 100 hours at full voltage, unless specifically recommended otherwise by the lamp manufacturer. Replace any lamps and ballasts which fail during burn-in.

### **3.3 FOLLOW-UP VERIFICATION**

- A. Upon completion of acceptance checks and tests, the Contractor shall show by demonstration in service that the lighting systems are in good operating condition and properly performing the intended function.

---END---

