


- MECHANICAL GENERAL NOTES
- REFER TO M-001 FOR MECHANICAL ABBREVIATIONS AND SYMBOLS.
 - REFER TO M-501 THROUGH M-504 FOR MECHANICAL DETAILS
 - REFER TO M-601 THROUGH M-605 FOR MECHANICAL CONTROLS DIAGRAMS.
 - REFER TO M-701 THROUGH M-708 FOR MECHANICAL SCHEDULES.
 - PROVIDE CONSTANT AIRFLOW REGULATOR FOR EACH OUTDOOR AIR AND EXHAUST AIR TERMINAL BRANCH UNLESS OTHERWISE INDICATED. PROVIDE VOLUME DAMPER FOR EACH SUPPLY AIR AND RETURN AIR BRANCH TERMINAL UNLESS OTHERWISE INDICATED. REFER TO DETAIL 16/M-502.
 - PROVIDE 3/4" CONDENSATE PIPING FROM EACH FCU AND ACU TO CLOSEST OPEN SITE DRAIN OR SINK TAIL PIECE.

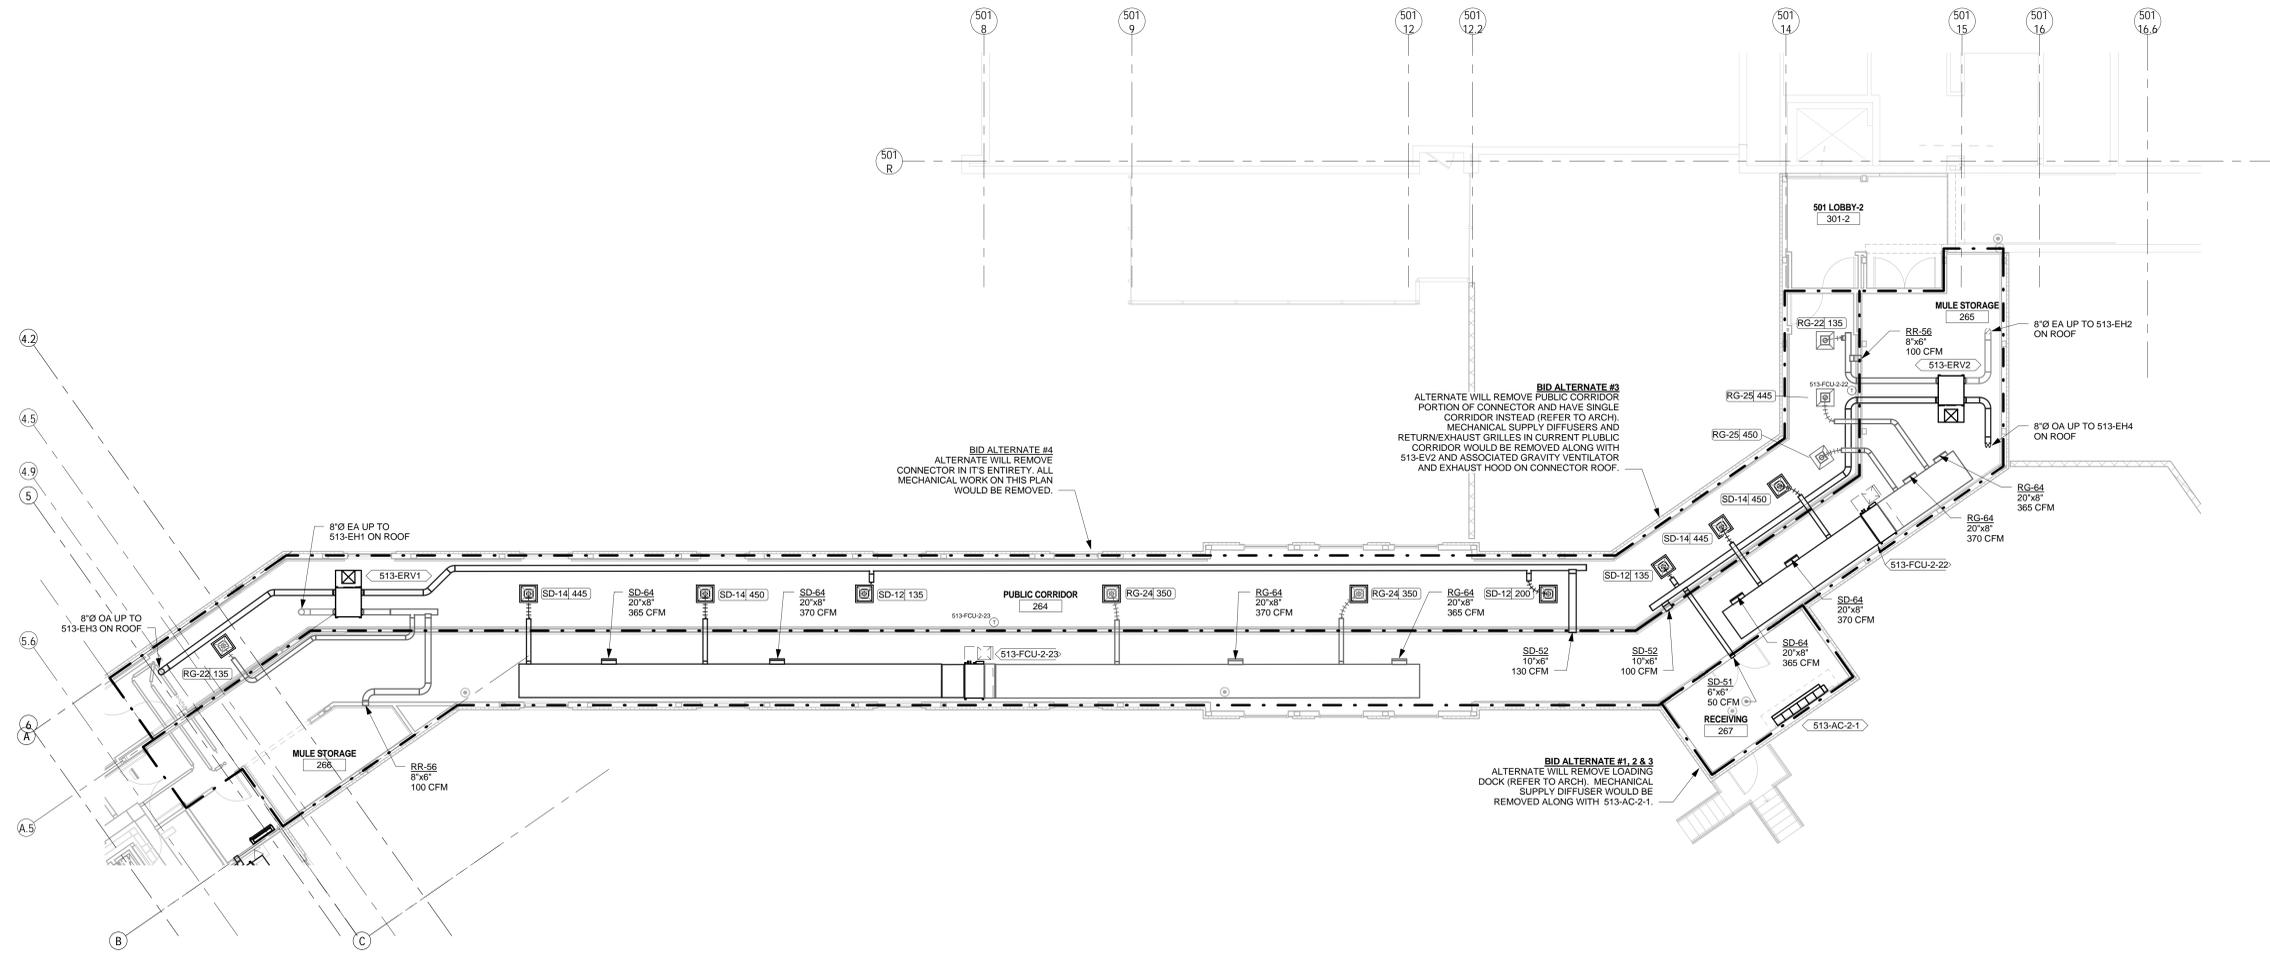

1 2ND FLOOR CORRIDOR LINK MECHANICAL FLOOR PLAN
1/8" = 1'-0"

one and one half inches = one foot
 one inch = one foot
 one inch = one foot
 three quarters inch = one foot
 one half inch = one foot
 one quarter inch = one foot
 one eighth inch = one foot

BID DOCUMENTS
FULLY SPRINKLERED

Revisions:	Date	ARCHITECT:	ENGINEERS:	Drawing Title	Project Title	Project Number	Office of Construction and Facilities Management
		C.C. HODGSON ARCHITECTURAL GROUP	Westlake Reed Leskosky	MECHANICAL NEW WORK CORRIDOR LINK FLOOR PLAN	RELOCATE DEMENTIA UNIT	VA PN 613-207	
		1634 EYE ST, NW, STE 900 WASHINGTON, DC 20006		Approved: Project Director	Location	Building Number	Department of Veterans Affairs
					VAMC MARTINSBURG	513	
					Date	Dwg. of	
					08/06/2012	Checked	
						Drawn	
						CJW	
						M-103	