


- MECHANICAL GENERAL NOTES
- 1 REFER TO M-001 FOR MECHANICAL ABBREVIATIONS AND SYMBOLS.
  - 2 REFER TO M-501 THROUGH M-504 FOR MECHANICAL DETAILS
  - 3 REFER TO M-601 THROUGH M-605 FOR MECHANICAL CONTROLS DIAGRAMS.
  - 4 REFER TO M-701 THROUGH M-708 FOR MECHANICAL SCHEDULES.
  - 5 PROVIDE CONSTANT AIRFLOW REGULATOR FOR EACH OUTDOOR AIR AND EXHAUST AIR TERMINAL BRANCH UNLESS OTHERWISE INDICATED. PROVIDE VOLUME DAMPER FOR EACH SUPPLY AIR AND RETURN AIR BRANCH TERMINAL UNLESS OTHERWISE INDICATED. REFER TO DETAIL 16/M-502.
  - 6 PROVIDE 3/4" CONDENSATE PIPING FROM EACH FCU AND ACU TO CLOSEST OPEN SITE DRAIN OR SINK TAIL PIECE.

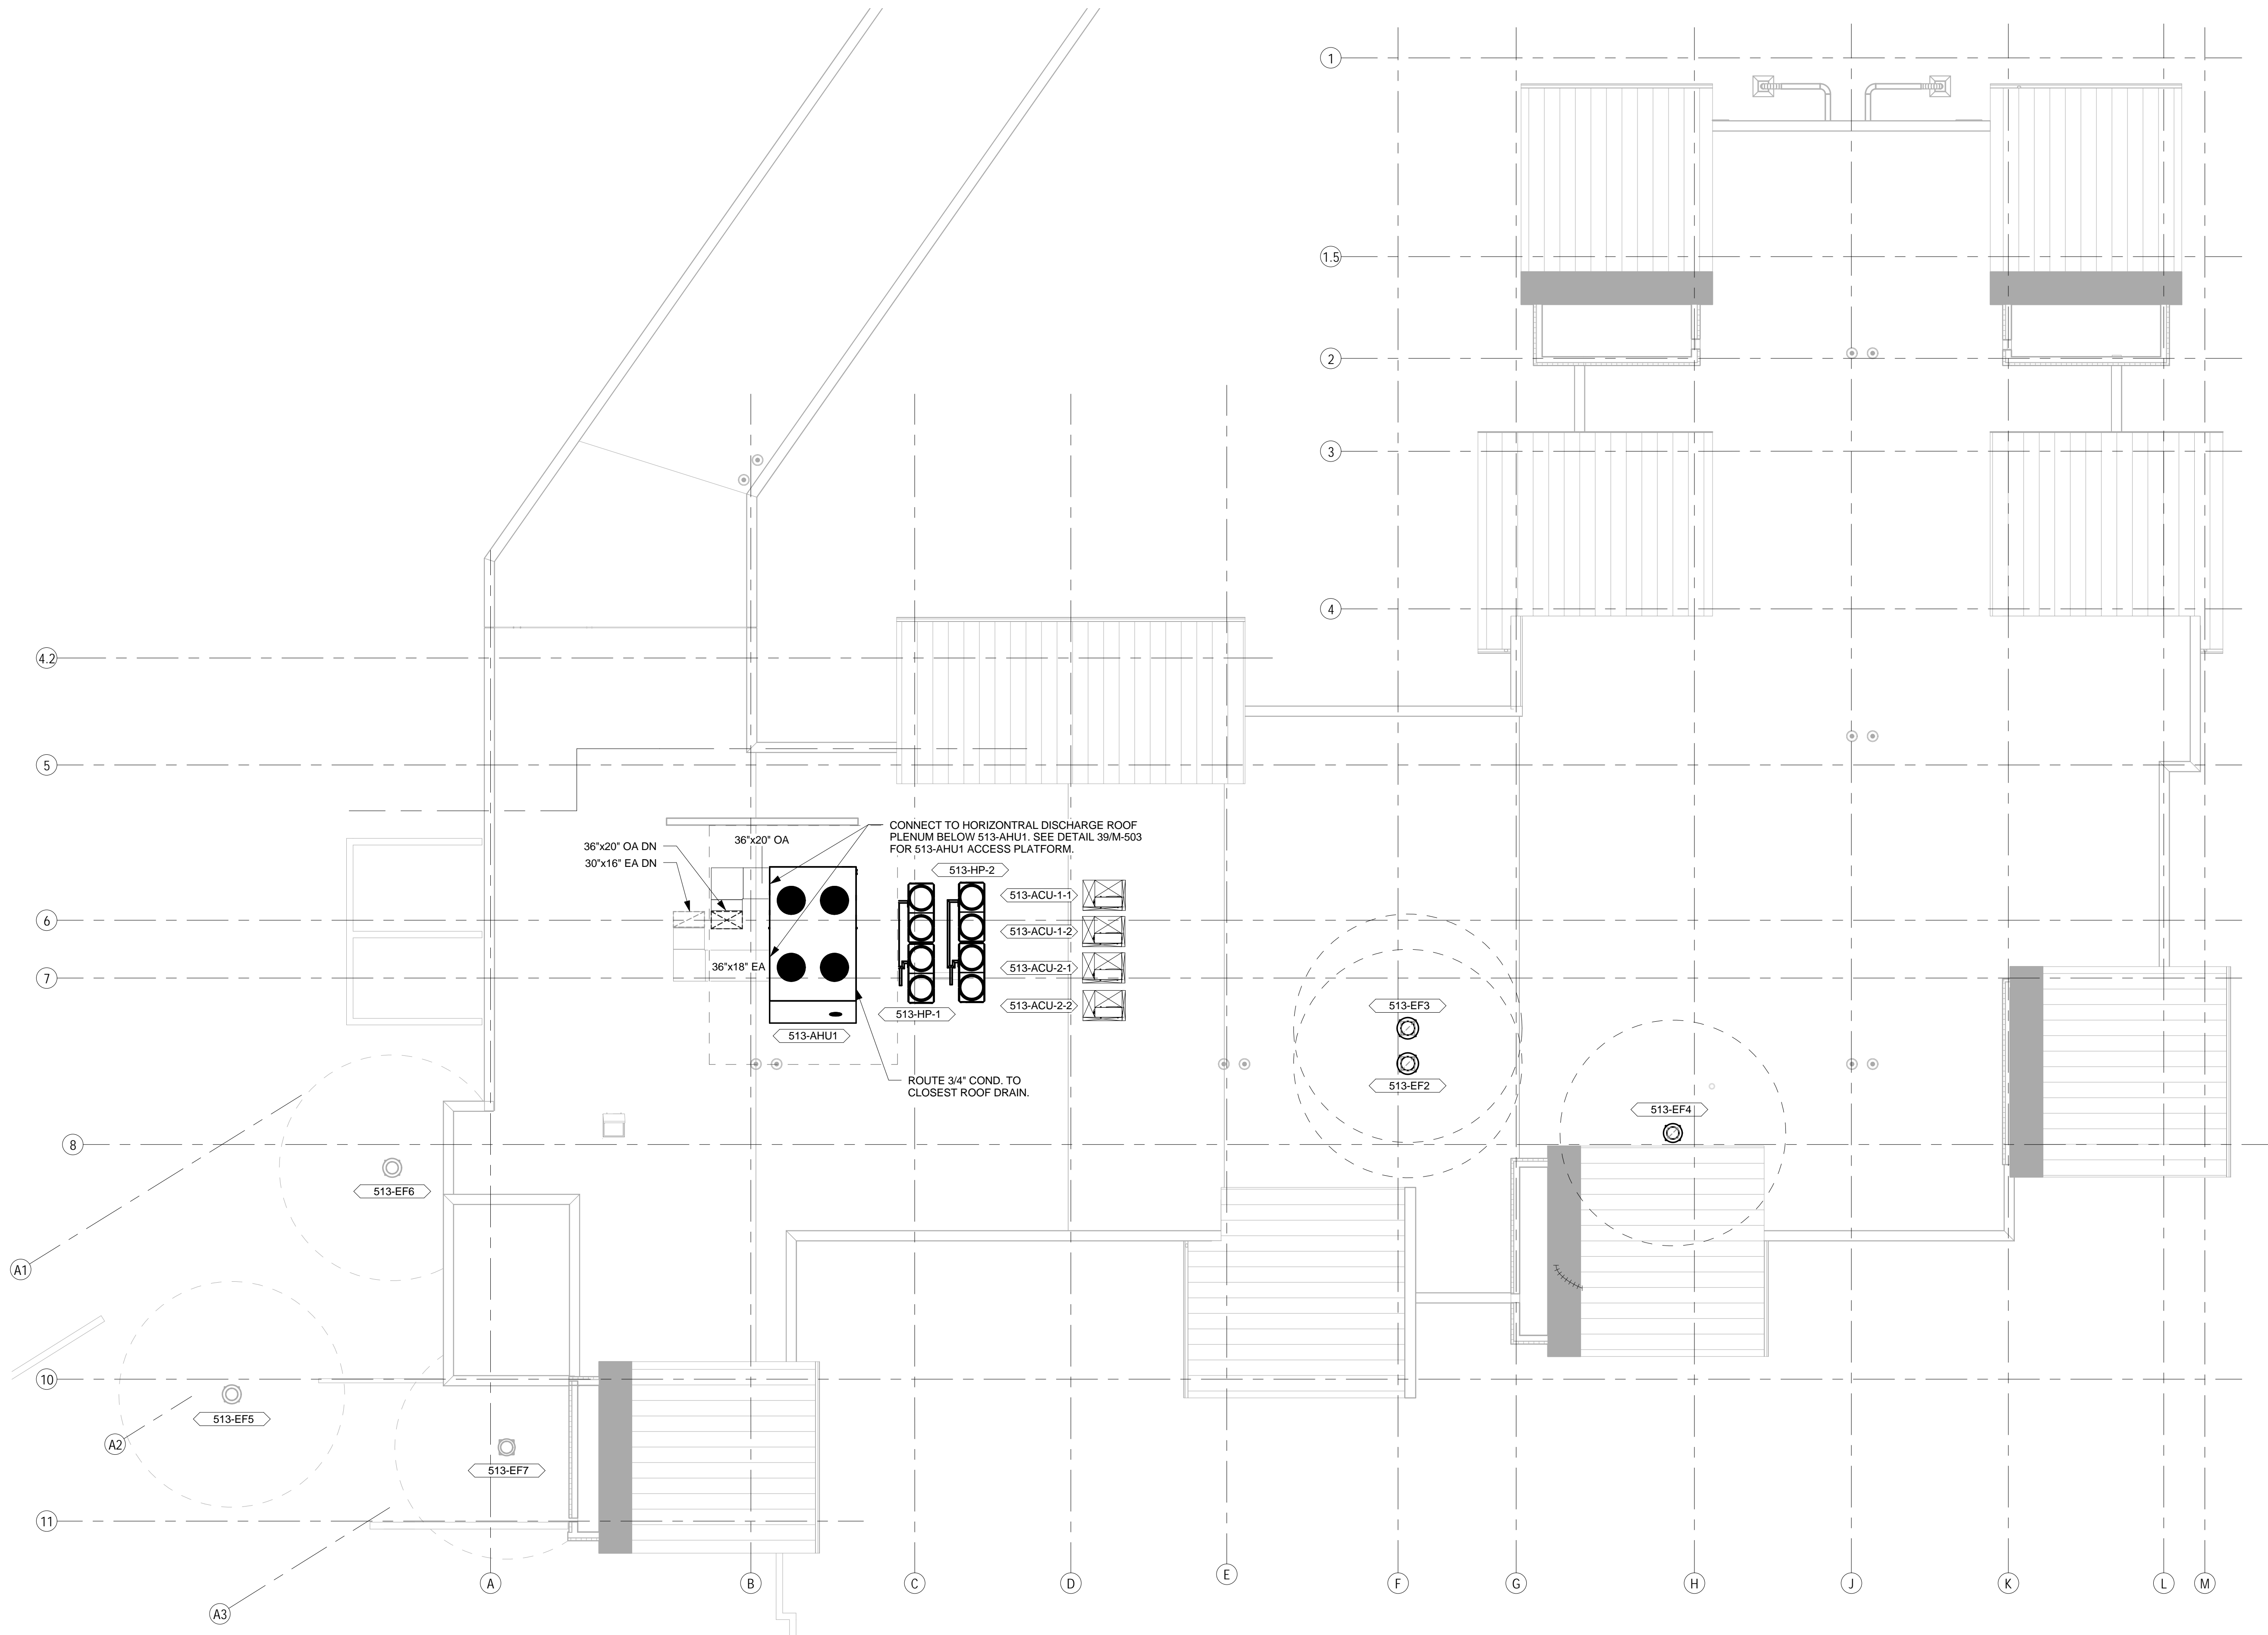

Revisions:	Date

ARCHITECT:

**C.C. HODGSON**  
ARCHITECTURAL GROUP



ENGINEERS:

**Westlake  
Reed  
Leskosky**

1634 EYE ST, NW, STE 900  
WASHINGTON, DC 20006

Drawing Title

MECHANICAL NEW WORK ROOF LEVEL PLAN

Approved: Project Director

Project Title

RELOCATE DEMENTIA UNIT

Project Number  
VA PN 613-207

Building Number  
513

Drawing Number  
**M-104**

Location  
VAMC MARTINSBURG

Date  
08/06/2012

Checked  
SCS

Drawn  
Author

Dwg. of --

Office of  
Construction  
and Facilities  
Management

Department of  
Veterans Affairs