

one-eighth inch = one foot  
one-quarter inch = one foot  
three-eighths inch = one foot  
one-half inch = one foot  
three-quarters inch = one foot  
one inch = one foot  
one and one-half inches = one foot  
three inches = one foot



- DRAWING NOTES:**
- REFER TO 2.3S000 SERIES DRAWINGS FOR GENERAL NOTES AND TYPICAL DETAILS.
  - REFER TO 2.3S300 SERIES DRAWINGS FOR FRAMING DETAILS.
  - REFER TO 2.3S400 SERIES DRAWINGS FOR STEEL COLUMN SCHEDULE.
  - REFER TO 2.3S400 SERIES DRAWINGS FOR VERTICAL BRACING ELEVATIONS AND DETAILS.
- KEY NOTES:**
- T/PIER ELEVATION = 727'-5".
  - SEE TYPICAL BARS AT SLAB CORNER 2.3S001.
  - METAL DECK SHALL BE PROTECTED WITH SPRAY FIBER FIRE RESISTIVE MATERIALS TO ACHIEVE 2 HOUR FIRE RATING. REFER TO ARCH PER LOCATION OF DEPRESSION.
  - SEE TYPICAL EMBEDDED PLATE CONNECTION ON 2.3S002.
  - 6 1/2" CONCRETE SLAB (NO DECK) #6 AT 12" O.C. EACH WAY. BOTTOM BARS EAST/WEST. TISLAB = 727'-4".
  - T/PIER 725'-0" TYPICAL UNLESS NOTED OTHERWISE.
  - FOR BEAM TO WALL CONNECTION SEE TYPICAL EMBEDDED PLATE CONNECTION ON 2.3S002.
  - PERIPHERAL REINFORCEMENT (8) #8 BARS AT 3 1/2" SPACING. SEE TYPICAL LONGITUDINAL / TRANSVERSE / PERIPHERAL REINFORCEMENT DETAIL 16/2.3S302. HOOK PERIPHERAL REINFORCING TO INTERSECTING PERIPHERAL REINFORCEMENT AT ENDS SIMILAR TO DETAIL 16/2.3S302.
  - LONGITUDINAL REINFORCEMENT. #5 AT 13" SPACING. SEE DETAILS 16, 17, 18/2.3S302.
  - TRANSVERSE REINFORCEMENT. #5 AT 10" SPACING. SEE DETAILS 16, 17, 18/2.3S302.
  - TRANSVERSE REINFORCEMENT. #5 AT 13" SPACING. SEE DETAILS 16, 17, 18/2.3S302.
  - PERIPHERAL REINFORCEMENT. (6) #5 BARS AT 6" SPACING. SEE DETAIL 16/2.3S302. HOOK PERIPHERAL REINFORCING TO INTERSECTING PERIPHERAL REINFORCEMENT AT ENDS SIMILAR TO DETAIL 16/2.3S302.
  - LONGITUDINAL REINFORCEMENT. #5 AT 6" SPACING SEE DETAILS 16, 17, 18/2.3S302.
  - TRANSVERSE REINFORCEMENT. #5 AT 9" SPACING. SEE DETAILS 16, 17, 18/2.3S302.
  - FOR RETAINING WALL ALONG PERIMETER OF COURTYARD, USE #5 AT 12" CENTERED ON WALL WITH 90 DEGREE BEND, 30" LONG HORIZONTAL LEG TURNED BENEATH PLANTER. FOR LOCATION OF RETAINING WALL, SEE ARCHITECTURAL DRAWINGS.
  - FOR RETAINING WALL IN COURTYARD, USE #5 AT 12" CENTERED ON WALL WITH 90 DEGREE BEND, 30" LONG HORIZONTAL LEG TURNED BENEATH PLANTER. FOR LOCATION OF RETAINING WALL, SEE ARCHITECTURAL DRAWINGS.
  - SEE ARCH FOR SLAB EDGE DETAIL AT ENTRYWAY.
  - MOMENT CONNECTION TO DEVELOP FULL CAPACITY OF BEAM.
  - SEE DETAIL 44/2.3S202 FOR PLASTER DIMENSIONS.
- LEGEND:**
- (#) INDICATES DECK BEARING (OR T/STEEL) ELEVATION RELATIVE TO DATUM ELEVATION.
  - /— INDICATES SHEAR SPLICE, TYPICAL U.N.O. REFER TO TYPICAL DETAIL ON 2.3S003.


Revisions		
1	ADDENDUM #1	09.04.12
	BID DOCUMENTS	01.30.12
	100% REVIEW	01.10.12
	DESIGN DEVELOPMENT	11.15.11
	SCHEMATIC DESIGN	9.17.11
	Date	

CONSULTANTS:



**THP Limited, Inc.**  
100 East Eighth Street  
Cincinnati, Ohio 45202  
Phone: 513.241.3222  
Fax: 513.241.2961  
www.thpltd.com

ARCHITECT/ENGINEERS:

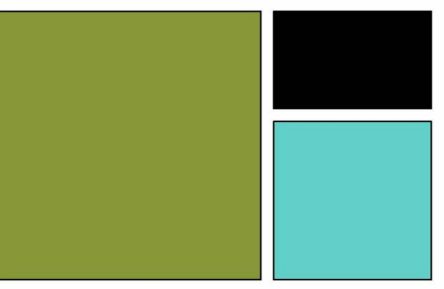

**CHAMPLIN ARCHITECTURE**  
thinkchamplin.com  
424 East Fourth Street  
Cincinnati, OH 45202  
T 513.241.4474 F 513.241.0081  
THINK CREATE REALIZE

Drawing Title

**LEVEL 1 FRAMING PLAN**

PHASE 3

Approved: Project Director

Project Title

**RELOCATE SHORT TERM REHAB COMMUNITY LIVING CENTER**

Location

Enter address here

Date

9/4/12

Checked

STE

Drawn

VLB

Project No.

VA Project No. 539-324  
THP Project No. 08260.XX

Building Number

**2**

Drawing Number

**2.3S101**

Office of Construction and Facilities Management

Department of Veterans Affairs