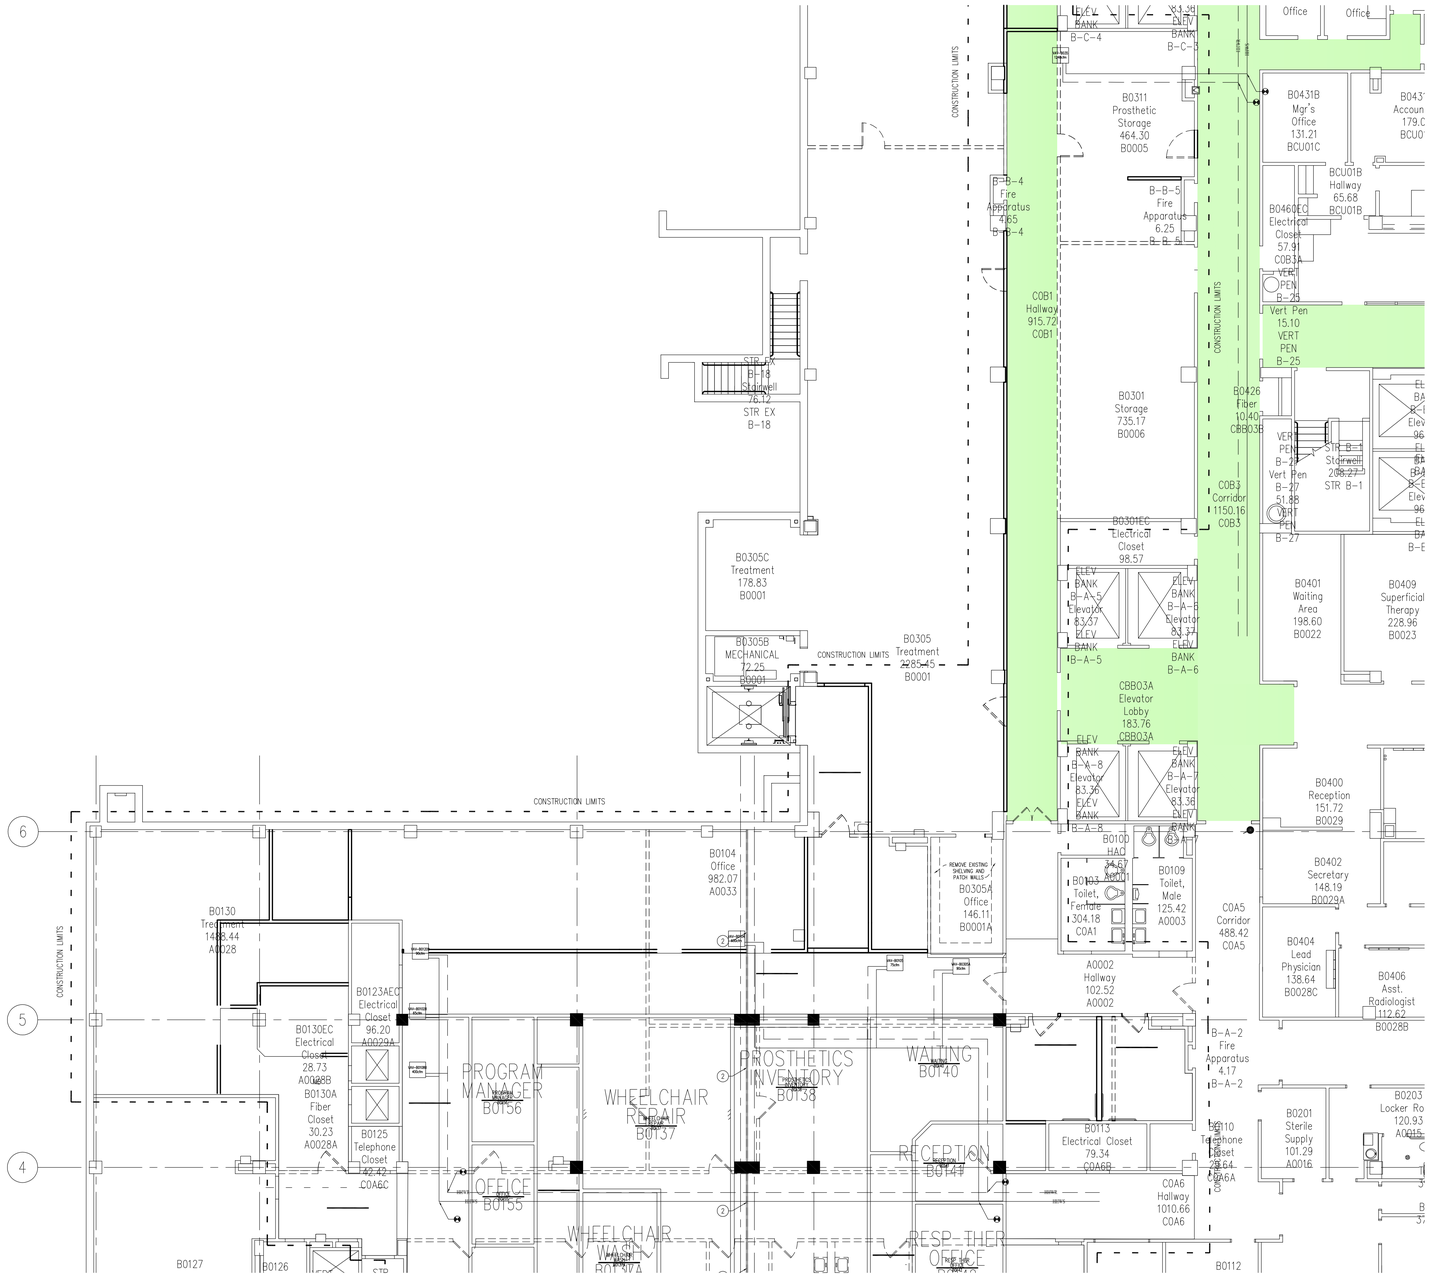

GENERAL NOTES:

1. CONTRACTOR IS RESPONSIBLE FOR ALL REQUIRED CUTTING AND PATCHING ASSOCIATED WITH WORK. PATCHING TO MATCH EXISTING ADJACENT CONSTRUCTION.
2. UNLESS OTHERWISE NOTED, DUCT RUNOUTS TO DIFFUSERS TO MATCH DIFFUSER NECK SIZE.
3. UNLESS OTHERWISE NOTED, DUCT RUNOUTS TO VAV TERMINAL UNITS TO MATCH INLET SIZE ON VAV TERMINAL UNITS.
4. VAV TAGS TO BE COMPLETED UPON RECEIPT OF ROOM NUMBERS FROM USER.

LEGEND

- RETURN GRILLE
- SUPPLY GRILLE.
- VAV-B830B 400cfm — VAV TERMINAL UNIT

GRAPHIC SCALE 0 4' 8' 16'

DEMOLITION PLAN

1/8"=1'-0"

Revisions	Date

Dept. of Veterans Affairs
Medical Center
5000 W. National Avenue
Milwaukee, WI

P:\10007-07\Production\Images\plotsized2.bmp

KEY PLAN:

ENGINEER:

ARCHITECT:

Drawing Title: Partial Basement Floor Plan HVAC Plumbing

Approved Project Director

Project Title: 111 Upgrade Prosthetics Product Line Improvements

Location: VA Medical Center,Milwaukee, WI

Date: 31 May 2012 | Checked: - | Drawn: -

Project Number: 695-11-115

Building Number: Building 111

Drawing Number: MP100V

Office of Construction and Facilities Management

Department of Veterans Affairs

VA FORM 08-6231