

NOTE:


BASE BID:

AIR HANDLER AHU1
 AIR HANDLER AHU2
 WATER SOURCE HEAT PUMP WSHP1-5 PACKAGE
 ENERGY RECOVERY UNIT ERV1
 ENERGY RECOVERY UNIT ERV2
 CHILLER
 VAV1-57
 PUMP P1, 2, 3, 4 & 6-15
 GEOTHERMAL LOOP

BID ALTERNATE 1:

AIR HANDLER AHU1
 AIR HANDLER AHU2
 WATER SOURCE HEAT PUMP WSHP1-5 PACKAGE
 ENERGY RECOVERY UNIT ERV1
 ENERGY RECOVERY UNIT ERV2
 CHILLER
 VAV1-57
 PUMP P1 TO P15
 BOILER B-1
 COOLING TOWER CT

NOTE:
 WSHP ENCLOSURE TO BE
 PROVIDED BY MANUFACTURER
 OF PACKAGE

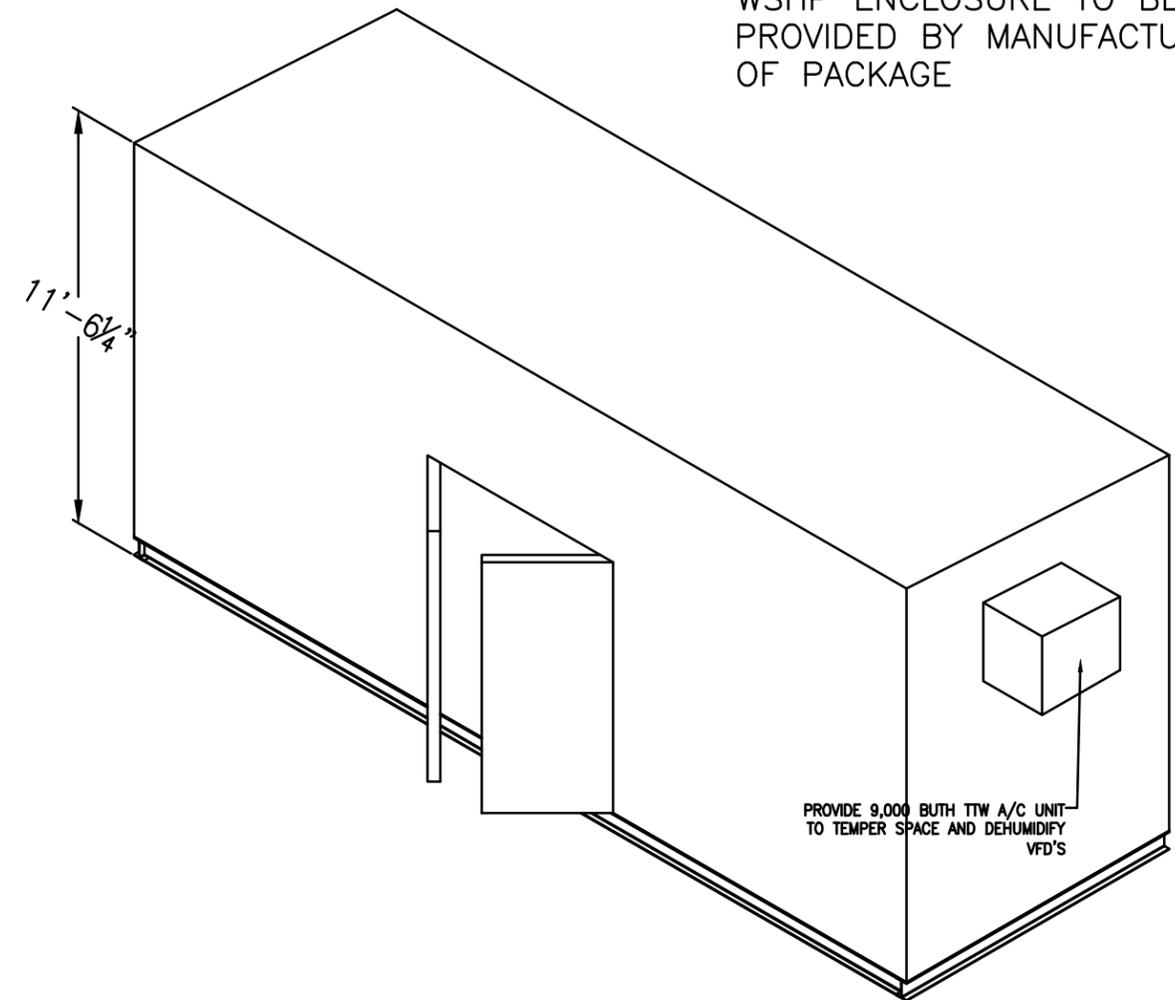

PROVIDE 9,000 BUTH TTW A/C UNIT
 TO TEMPER SPACE AND DEHUMIDIFY
 VFD'S

WSHP ENCLOSURE
 SCALE: NTS

Scale: AS SHOWN

	ARCHITECT/ENGINEERS:	Drawing Title AMENDMENT #4 MH006-3		Project Title PANAMA CITY JOINT OUTPATIENT CLINIC VA GULF COAST HEALTH CARE		Project Number		Office of Construction and Facilities Management  Department of Veterans Affairs
		Approved: Project Director		Location PANAMA CITY, FLORIDA		Building Number		
		Date 09-14-12	Checked	Drawn	Drawing Number MH006-3			
				Dwg. of				