

PROJECT NO. 655-14-110



**DEPARTMENT OF
VETERANS AFFAIRS**

TECHNICAL SPECIFICATIONS

FOR

Building 1 Sprinkler System

AT

**Aleda E. Lutz
VA Medical Center
1500 Weiss Street
Saginaw, MI 48602**

ISSUE DATE: 04/10/2019

DEPARTMENT OF VETERANS AFFAIRS
VHA MASTER SPECIFICATIONS
TABLE OF CONTENTS
Section 00 01 10

	DIVISION 00 - SPECIAL SECTIONS	DATE
00 01 10	Table of Contents	04-19
00 01 15	List of Drawing Sheets	07-15
	DIVISION 01 - GENERAL REQUIREMENTS	
01 00 00	General Requirements	03-19
01 01 10IC	Infection Control	04-19
01 01 10FSS	Fire Safety	04-19
01 33 23	Shop Drawings, Product data and Samples	05-17
01 35 26	Safety Requirements	02-17
01 42 19	Referenced Standards	05-16
01 74 19	Construction Waste Management	09-13
	DIVISION 07 - THERMAL AND MOISTURE PROTECTION	
07 84 00	Firestopping	03-19
	DIVISION 09 - FINISHES	
09 91 00	Painting	01-16
	DIVISION 21 - FIRE SUPPRESSION	
21 08 00	Commissioning of Fire Suppression Systems	11-16
21 13 13	Wet-Pipe Sprinkler Systems	06-15
21 13 16	Dry-Pipe Sprinkler System	01-15
21 22 00	Clean Agent Fire Suppression Systems	05-15
	DIVISION 26 - ELECTRICAL	
26 05 11	Requirements for Electrical Installations	01-16
26 05 19	Low-Voltage Electrical Power Conductors and Cables	01-17
26 05 33	Raceway and Boxes for Electrical Systems	05-14
	DIVISION 28 - ELECTRONIC SAFETY & SECURITY	

Building 1 Sprinkler System
Aleda E. Lutz VA Medical Center
Saginaw, MI

655-14-110
Version 04-19

28 31 00	Fire Detection and Alarm	10-11

SECTION 00 01 15
LIST OF DRAWING SHEETS

The drawings listed below accompanying this specification form a part of the contract.

<u>Drawing No.</u>	<u>Title</u>
1-G 000	TITLE SHEET
1-G 001	NOTES AND DETAIL
1-G 010	BUILDING 1 BASEMENT-1 STANDPIPE PLAN
1-FX 011	BUILDING 1 BASEMENT-SOUTH SPRINKLER PLAN
1-FX 012	BUILDING 1 BASEMENT-NORTH SPRINKLER PLAN
1-FX 100	BUILDING 1 FIRST FLOOR-SOUTH SPRINKLER PLAN
1-FX 101	BUILDING 1 FIRST FLOOR-NORTH SPRINKLER PLAN
1-FX 200	BUILDING 1 SECOND FLOOR-SPRINKLER PLAN
1-FX 300	BUILDING 1 THIRD FLOOR-SPRINKLER PLAN
1-FX 400	BUILDING 1 FOURTH FLOOR-SPRINKLER PLAN
1-FX 500	BUILDING 1 FIFTH FLOOR-SPRINKLER PLAN
1-FX 600	BUILDING 1 SIXTH FLOOR/PENTHOUSE-SPRINKLER PLAN

- - - END - - -

SECTION 01 00 00
GENERAL REQUIREMENTS

1.1 SAFETY REQUIREMENTS

Refer to section 01 35 26, SAFETY REQUIREMENTS for safety and infection control requirements.

1.2 GENERAL INTENTION

- A. Contractor shall furnish labor and materials and perform work for Building 1 sprinkler replacement as required by drawings and specifications.
- B. Visits to the site by Bidders may be made only by appointment with the Medical Center Engineering Officer.
- C. Offices of Fire Protection & Code Consultants, LLC, as Architect-Engineers, will render certain technical services during construction. Such services shall be considered as advisory to the Government and shall not be construed as expressing or implying a contractual act of the Government without affirmations by Contracting Officer or his duly authorized representative.
- D. Before placement and installation of work subject to tests by testing laboratory retained by Department of Veterans Affairs, the Contractor shall notify the COR in sufficient time to enable testing laboratory personnel to be present at the site in time for proper taking and testing of specimens and field inspection. Such prior notice shall be not less than three work days unless otherwise designated by the COR.
- E. All employees of general contractor and subcontractors shall comply with VA security management program and obtain permission of the VA police, be identified by project and employer, and restricted from unauthorized access.
- D. Contractor shall provide signage for the shut-off valves for each individual zone, these are to be 3x5 laminated cards, red in color, attached to the valve using brass chain. The signage will indicate the zone that the shut-off controls on one side and will have an enlarged view of the zone (shaded) on the opposing side.

- E. Contractor shall label on the ceiling grid below zone shut-off valves stating the presence of a shut-off valve above, and the zone it controls.

1.3 STATEMENT OF BID ITEM(S)

- A. BID ITEM NO.1: All work as described in the specifications and as shown on the drawings. Modify existing sprinkler system zones to coincide with unit boundaries. Modify some existing systems to improve system hydraulics. Replace all existing sprinklers in entire sprinkler zones as noted. Minor modifications to existing building fire alarm system. Various related general construction items including; infection control measures, demolition and repair of existing wall and ceiling finishes, and assorted patching and painting. **COMPLETION TIME: 240 DAYS.**
- B. BID ITEM NO. 2: Same as BID ITEM NO. 1 except delete work on the fifth floor. **COMPLETION TIME: 210 DAYS.**
- C. BID ITEM NO. 3: _Same as BID ITEM NO. 2 except also delete work on the third floor. **COMPLETION TIME: 180 DAYS.**

1.4 SPECIFICATIONS AND DRAWINGS FOR CONTRACTOR

- A. Drawings and contract documents may be obtained from the website where the solicitation is posted. Additional copies will be at Contractor's expense.

1.5 CONSTRUCTION SECURITY REQUIREMENTS

- A. Security Plan:
 - 1. The security plan defines both physical and administrative security procedures that will remain effective for the entire duration of the project.
 - 2. The General Contractor is responsible for assuring that all sub-contractors working on the project and their employees also comply with these regulations.
- B. Security Procedures:
 - 1. General Contractor's employees shall not enter the project site without appropriate badge. They may also be subject to inspection of their personal effects when entering or leaving the project site.

2. Before starting work the General Contractor shall give one week's notice to the Contracting Officer so that security arrangements can be provided for the employees. This notice is separate from any notices required for utility shutdown described later in this section.
3. No photography of VA premises is allowed without written permission of the Contracting Officer.
4. VA reserves the right to close down or shut down the project site and order General Contractor's employees off the premises in the event of a national emergency. The General Contractor may return to the site only with the written approval of the Contracting Officer.

C. Key Control:

1. The General Contractor shall provide duplicate keys and lock combinations to the COR for the purpose of security inspections of every area of project including tool boxes and parked machines and take any emergency action.
2. The General Contractor shall turn over all permanent lock cylinders to the VA locksmith for permanent installation.

D. Document Control:

1. Before starting any work, the General Contractor/Sub Contractors shall submit an electronic security memorandum describing the approach to following goals and maintaining confidentiality of "sensitive information".
2. The General Contractor is responsible for safekeeping of all drawings, project manual and other project information. This information shall be shared only with those with a specific need to accomplish the project.
3. Certain documents, sketches, videos or photographs and drawings may be marked "Law Enforcement Sensitive" or "Sensitive Unclassified". Secure such information in separate containers and limit the access to only those who will need it for the project. Return the information to the Contracting Officer upon request.
4. These security documents shall not be removed or transmitted from the project site without the written approval of Contracting Officer.
5. All paper waste or electronic media such as CD's and diskettes shall be shredded and destroyed in a manner acceptable to the VA.

6. Notify Contracting Officer and Site Security Officer immediately when there is a loss or compromise of "sensitive information".
7. All electronic information shall be stored in specified location following VA standards and procedures using an Engineering Document Management Software (EDMS).
 - a. Security, access and maintenance of all project drawings, both scanned and electronic shall be performed and tracked through the EDMS system.
 - b. "Sensitive information" including drawings and other documents may be attached to e-mail provided all VA encryption procedures are followed.

E. Motor Vehicle Restrictions

1. Vehicle authorization request shall be required for any vehicle entering the site and such request shall be submitted 24 hours before the date and time of access. Access shall be restricted to picking up and dropping off materials and supplies.
2. A limited number of (2 to 5) permits shall be issued for General Contractor and its employees for parking in designated areas only.

1.6 OPERATIONS AND STORAGE AREAS

- A. The Contractor shall confine all operations (including storage of materials) on Government premises to areas authorized or approved by the Contracting Officer. The Contractor shall hold and save the Government, its officers and agents, free and harmless from liability of any nature occasioned by the Contractor's performance.
- B. Temporary buildings (e.g., storage sheds, shops, offices) and utilities may be erected by the Contractor only with the approval of the Contracting Officer and shall be built with labor and materials furnished by the Contractor without expense to the Government. The temporary buildings and utilities shall remain the property of the Contractor and shall be removed by the Contractor at its expense upon completion of the work. With the written consent of the Contracting Officer, the buildings and utilities may be abandoned and need not be removed.
- C. The Contractor shall, under regulations prescribed by the Contracting Officer, use only established roadways, or use temporary roadways constructed by the Contractor when and as authorized by the Contracting

Officer. When materials are transported in prosecuting the work, vehicles shall not be loaded beyond the loading capacity recommended by the manufacturer of the vehicle or prescribed by any Federal, State, or local law or regulation. When it is necessary to cross curbs or sidewalks, the Contractor shall protect them from damage. The Contractor shall repair or pay for the repair of any damaged curbs, sidewalks, or roads.

- D. Working space and space available for storing materials shall be as shown on the drawings or as determined by the COR.
- E. Workmen are subject to rules of Medical Center applicable to their conduct.
- F. Execute work so as to interfere as little as possible with normal functioning of Medical Center as a whole, including operations of utility services, fire protection systems and any existing equipment, and with work being done by others. Use of equipment and tools that transmit vibrations and noises through the building structure, are not permitted in buildings that are occupied, during construction, jointly by patients or medical personnel, and Contractor's personnel, except as permitted by the COR.
 - 1. Do not store materials and equipment in other than assigned areas.
 - 2. Schedule delivery of materials and equipment to immediate construction working areas within buildings in use by Department of Veterans Affairs in quantities sufficient for not more than two work days. Provide unobstructed access to Medical Center areas required to remain in operation.
 - 3. Where access by Medical Center personnel to vacated portions of buildings is not required, storage of Contractor's materials and equipment will be permitted subject to fire and safety requirements.
- G. Phasing:

The Medical Center must maintain its operation 24 hours a day 7 days a week. Therefore, any interruption in service must be scheduled and coordinated with the COR to ensure that no lapses in operation occur. It is the CONTRACTOR'S responsibility to develop a work plan and schedule detailing, at a minimum, the procedures to be employed, the equipment and materials to be used, the interim life safety measure to

be used during the work, and a schedule defining the duration of the work with milestone subtasks.

To insure such executions, Contractor shall furnish the COR with a schedule of approximate phasing dates on which the Contractor intends to accomplish work in each specific area of site, building or portion thereof. In addition, Contractor shall notify the COR two weeks in advance of the proposed date of starting work in each specific area of site, building or portion thereof. Arrange such phasing dates to insure accomplishment of this work in successive phases mutually agreeable to the COR and Contractor, as follows:

- H. Utilities Services: Maintain existing utility services for the Medical Center at all times. Provide temporary facilities, labor, materials, equipment, connections, and utilities to assure uninterrupted services. Where necessary to cut existing water, steam, gases, sewer or air pipes, or conduits, wires, cables, etc. of utility services or of fire protection systems and communications systems (including telephone), they shall be cut and capped at suitable places where shown; or, in absence of such indication, where directed by COR.
1. No utility service such as water, gas, steam, sewers or electricity, or fire protection systems and communications systems may be interrupted without prior approval of the COR. Electrical work shall be accomplished with all affected circuits or equipment de-energized. When an electrical outage cannot be accomplished, work on any energized circuits or equipment shall not commence without a detailed work plan.
 2. Contractor shall submit a request to interrupt any such services to the COR, in writing, 7 days in advance of proposed interruption. Request shall state reason, date, exact time of, and approximate duration of such interruption.
 3. Contractor will be advised (in writing) of approval of request, or of which other date and/or time such interruption will cause least inconvenience to operations of Medical Center. Interruption time approved by Medical Center may occur at other than Contractor's normal working hours.

4. Major interruptions of any system must be requested, in writing, at least 15 calendar days prior to the desired time and shall be performed as directed by the COR.
 5. In case of a contract construction emergency, service will be interrupted on approval of the COR. Such approval will be confirmed in writing as soon as practical.
 6. Whenever it is required that a connection fee be paid to a public utility provider for new permanent service to the construction project, for such items as water, sewer, electricity, gas or steam, payment of such fee shall be the responsibility of the Government and not the Contractor.
- I. Abandoned Lines: All service lines such as wires, cables, conduits, ducts, pipes and the like, and their hangers or supports, which are to be abandoned but are not required to be entirely removed, shall be sealed, capped or plugged at the main, branch or panel they originate from. The lines shall not be capped in finished areas, but shall be removed and sealed, capped or plugged in ceilings, within furred spaces, in unfinished areas, or within walls or partitions; so that they are completely behind the finished surfaces.
- J. To minimize interference of construction activities with flow of Medical Center traffic, comply with the following:
1. Keep roads, walks and entrances to grounds, to parking and to occupied areas of buildings clear of construction materials, debris and standing construction equipment and vehicles. Wherever excavation for new utility lines cross existing roads, at least one lane must be open to traffic at all times with approval.
 2. Method and scheduling of required cutting, altering and removal of existing roads, walks and entrances must be approved by the COR.
- K. Coordinate the work for this contract with other construction operations as directed by the COR. This includes the scheduling of traffic and the use of roadways, as specified in Article, USE OF ROADWAYS.

1.7 ALTERATIONS

- A. Survey: Before any work is started, the Contractor shall make a thorough survey with the COR of buildings in which alterations occur and areas which are anticipated routes of access, and furnish a report,

signed by both, to the Contracting Officer. This report shall list by rooms and spaces:

1. Existing condition and types of resilient flooring, doors, windows, walls and other surfaces not required to be altered throughout affected areas of buildings.
 2. Existence and conditions of items such as plumbing fixtures and accessories, electrical fixtures, equipment, venetian blinds, shades, etc., required by drawings to be either reused or relocated, or both.
 3. Shall note any discrepancies between drawings and existing conditions at site.
 4. Shall designate areas for working space, materials storage and routes of access to areas within buildings where alterations occur and which have been agreed upon by Contractor and COR.
- B. Any items required by drawings to be either reused or relocated or both, found during this survey to be nonexistent, or in opinion of COR, to be in such condition that their use is impossible or impractical, shall be furnished and/or replaced by Contractor with new items in accordance with specifications which will be furnished by Government. Provided the contract work is changed by reason of this subparagraph B, the contract will be modified accordingly, under provisions of clause entitled "DIFFERING SITE CONDITIONS" (FAR 52.236-2) and "CHANGES" (FAR 52.243-4 and VAAR 852.236-88).
- C. Re-Survey: Thirty days before expected partial or final inspection date, the Contractor and COR together shall make a thorough re-survey of the areas of buildings involved. They shall furnish a report on conditions then existing, of resilient flooring, doors, windows, walls and other surfaces as compared with conditions of same as noted in first condition survey report:
1. Re-survey report shall also list any damage caused by Contractor to such flooring and other surfaces, despite protection measures; and, will form basis for determining extent of repair work required of Contractor to restore damage caused by Contractor's workmen in executing work of this contract.
- D. Protection: Provide the following protective measures:

1. Wherever existing roof surfaces are disturbed they shall be protected against water infiltration. In case of leaks, they shall be repaired immediately upon discovery.
2. Temporary protection against damage for portions of existing structures and grounds where work is to be done, materials handled and equipment moved and/or relocated.
3. Protection of interior of existing structures at all times, from damage, dust and weather inclemency. Wherever work is performed, floor surfaces that are to remain in place shall be adequately protected prior to starting work, and this protection shall be maintained intact until all work in the area is completed.

1.8 DISPOSAL AND RETENTION

- A. Materials and equipment accruing from work removed and from demolition of buildings or structures, or parts thereof, shall be disposed of as follows:
 1. Reserved items which are to remain property of the Government are noted on drawings or in specifications as items to be stored. Items that remain property of the Government shall be removed or dislodged from present locations in such a manner as to prevent damage which would be detrimental to re-installation and reuse. Store such items where directed by the COR.
 2. Items not reserved shall become property of the Contractor and be removed by Contractor from Medical Center.
 3. Items of portable equipment and furnishings located in rooms and spaces in which work is to be done under this contract shall remain the property of the Government. When rooms and spaces are vacated by the Department of Veterans Affairs during the alteration period, such items which are NOT required by drawings and specifications to be either relocated or reused will be removed by the Government in advance of work to avoid interfering with Contractor's operation.

1.9 PROTECTION OF EXISTING VEGETATION, STRUCTURES, EQUIPMENT, UTILITIES, AND IMPROVEMENTS

- A. The Contractor shall preserve and protect all structures, equipment, and vegetation (such as trees, shrubs, and grass) on or adjacent to the work site, which are not to be removed and which do not unreasonably interfere with the work required under this contract. The Contractor

shall only remove trees when specifically authorized to do so, and shall avoid damaging vegetation that will remain in place. If any limbs or branches of trees are broken during contract performance, or by the careless operation of equipment, or by workmen, the Contractor shall trim those limbs or branches with a clean cut and paint the cut with a tree-pruning compound as directed by the Contracting Officer.

- B. The Contractor shall protect from damage all existing improvements and utilities at or near the work site and on adjacent property of a third party, the locations of which are made known to or should be known by the Contractor. The Contractor shall repair any damage to those facilities, including those that are the property of a third party, resulting from failure to comply with the requirements of this contract or failure to exercise reasonable care in performing the work. If the Contractor fails or refuses to repair the damage promptly, the Contracting Officer may have the necessary work performed and charge the cost to the Contractor.

(FAR 52.236-9)

- C. Refer to Articles, "Alterations", "Restoration", and "Operations and Storage Areas" for additional instructions concerning repair of damage to structures and site improvements.
- D. Refer to FAR clause 52.236-7, "Permits and Responsibilities," which is included in General Conditions. A National Pollutant Discharge Elimination System (NPDES) permit is required for this project. The Contractor is considered an "operator" under the permit and has extensive responsibility for compliance with permit requirements. VA will make the permit application available at the (appropriate medical center) office. The apparent low bidder, contractor and affected subcontractors shall furnish all information and certifications that are required to comply with the permit process and permit requirements. Many of the permit requirements will be satisfied by completing construction as shown and specified. Some requirements involve the Contractor's method of operations and operations planning and the Contractor is responsible for employing best management practices. The affected activities often include, but are not limited to the following:

- Designating areas for equipment maintenance and repair;
- Providing waste receptacles at convenient locations and provide regular collection of wastes;
- Locating equipment wash down areas on site, and provide appropriate control of wash-waters;
- Providing protected storage areas for chemicals, paints, solvents, fertilizers, and other potentially toxic materials; and
- Providing adequately maintained sanitary facilities.

1.10 RESTORATION

- A. Remove, cut, alter, replace, patch and repair existing work as necessary to install new work. Except as otherwise shown or specified, do not cut, alter or remove any structural work, and do not disturb any ducts, plumbing, steam, gas, or electric work without approval of the COR. Existing work to be altered or extended and that is found to be defective in any way, shall be reported to the COR before it is disturbed. Materials and workmanship used in restoring work, shall conform in type and quality to that of original existing construction, except as otherwise shown or specified.
- B. Upon completion of contract, deliver work complete and undamaged. Existing work (walls, ceilings, partitions, floors, mechanical and electrical work, lawns, paving, roads, walks, etc.) disturbed or removed as a result of performing required new work, shall be patched, repaired, reinstalled, or replaced with new work, and refinished and left in as good condition as existed before commencing work.
- C. At Contractor's own expense, Contractor shall immediately restore to service and repair any damage caused by Contractor's workmen to existing piping and conduits, wires, cables, etc., of utility services or of fire protection systems and communications systems (including telephone) which are not scheduled for discontinuance or abandonment.
- D. Expense of repairs to such utilities and systems not shown on drawings or locations of which are unknown will be covered by adjustment to contract time and price in accordance with clause entitled "CHANGES" (FAR 52.243-4 and VAAR 852.236-88) and "DIFFERING SITE CONDITIONS" (FAR 52.236-2).

1.11 PHYSICAL DATA (NOT USED)

1.12 PROFESSIONAL SURVEYING SERVICES (NOT USED)

1.13 LAYOUT OF WORK (NOT USED)

1.14 AS-BUILT DRAWINGS

- A. The contractor shall maintain two full size sets of as-built drawings which will be kept current during construction of the project, to include all contract changes, modifications and clarifications.
- B. All variations shall be shown in the same general detail as used in the contract drawings. To insure compliance, as-built drawings shall be made available for the COR's review, as often as requested.
- C. Contractor shall deliver two approved completed sets of as-built drawings in the electronic version (scanned PDF) to the COR within 15 calendar days after each completed phase and after the acceptance of the project by the COR.
- D. Paragraphs A, B, & C shall also apply to all shop drawings.

1.15 USE OF ROADWAYS

- A. For hauling, use only established public roads and roads on Medical Center property and, when authorized by the COR, such temporary roads which are necessary in the performance of contract work. Temporary roads shall be constructed and restoration performed by the Contractor at Contractor's expense. When necessary to cross curbing, sidewalks, or similar construction, they must be protected by well-constructed bridges.
- B. When new permanent roads are to be a part of this contract, Contractor may construct them immediately for use to facilitate building operations. These roads may be used by all who have business thereon within zone of building operations.
- C. When certain buildings (or parts of certain buildings) are required to be completed in advance of general date of completion, all roads leading thereto must be completed and available for use at time set for completion of such buildings or parts thereof.

1.16 RESIDENT ENGINEER'S FIELD OFFICE (NOT USED)

1.17 TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT

- A. Use of new installed mechanical and electrical equipment to provide heat, ventilation, plumbing, light and power will be permitted subject to written approval and compliance with the following provisions:
1. Permission to use each unit or system must be given by the COR in writing. If the equipment is not installed and maintained in accordance with the written agreement and following provisions, the COR will withdraw permission for use of the equipment.
 2. Electrical installations used by the equipment shall be completed in accordance with the drawings and specifications to prevent damage to the equipment and the electrical systems, i.e. transformers, relays, circuit breakers, fuses, conductors, motor controllers and their overload elements shall be properly sized, coordinated and adjusted. Installation of temporary electrical equipment or devices shall be in accordance with NFPA 70, National Electrical Code, (2014 Edition), Article 590, *Temporary Installations*. Voltage supplied to each item of equipment shall be verified to be correct and it shall be determined that motors are not overloaded. The electrical equipment shall be thoroughly cleaned before using it and again immediately before final inspection including vacuum cleaning and wiping clean interior and exterior surfaces.
 3. Units shall be properly lubricated, balanced, and aligned. Vibrations must be eliminated.

1.18 TEMPORARY USE OF EXISTING ELEVATORS

- A. Contractor will not be allowed the use of existing elevators. Outside type hoist shall be used by Contractor for transporting materials and equipment.

1.19 TEMPORARY USE OF NEW ELEVATORS (NOT USED)

1.20 TEMPORARY TOILETS

- A. Contractor may have for use of Contractor's workmen, such toilet accommodations as may be assigned to Contractor by Medical Center. Contractor shall keep such places clean and be responsible for any damage done thereto by Contractor's workmen. Failure to maintain

satisfactory condition in toilets will deprive Contractor of the privilege to use such toilets.

1.21 AVAILABILITY AND USE OF UTILITY SERVICES

- A. The Government shall make all reasonably required amounts of utilities available to the Contractor from existing outlets and supplies, as specified in the contract. The amount to be paid by the Contractor for chargeable electrical services shall be the prevailing rates charged to the Government. The Contractor shall carefully conserve any utilities furnished without charge.
- B. The Contractor, at Contractor's expense and in a workmanlike manner, in compliance with code and as satisfactory to the Contracting Officer, shall install and maintain all necessary temporary connections and distribution lines, and all meters required to measure the amount of electricity used for the purpose of determining charges. Before final acceptance of the work by the Government, the Contractor shall remove all the temporary connections, distribution lines, meters, and associated paraphernalia and repair restore the infrastructure as required.

1.22 NEW TELEPHONE EQUIPMENT (NOT USED)

1.23 TESTS (NOT USED)

1.24 INSTRUCTIONS

- A. Contractor shall furnish Maintenance and Operating manuals (hard copies and electronic) and verbal instructions when required by the various sections of the specifications and as hereinafter specified.
- B. Manuals: Maintenance and operating manuals and one compact disc (four hard copies and one electronic copy each) for each separate piece of equipment shall be delivered to the COR coincidental with the delivery of the equipment to the job site. Manuals shall be complete, detailed guides for the maintenance and operation of equipment. They shall include complete information necessary for starting, adjusting, maintaining in continuous operation for long periods of time and dismantling and reassembling of the complete units and sub-assembly components. Manuals shall include an index covering all component parts clearly cross-referenced to diagrams and illustrations. Illustrations

shall include "exploded" views showing and identifying each separate item. Emphasis shall be placed on the use of special tools and instruments. The function of each piece of equipment, component, accessory and control shall be clearly and thoroughly explained. All necessary precautions for the operation of the equipment and the reason for each precaution shall be clearly set forth. Manuals must reference the exact model, style and size of the piece of equipment and system being furnished. Manuals referencing equipment similar to but of a different model, style, and size than that furnished will not be accepted.

- C. Instructions: Contractor shall provide qualified, factory-trained manufacturers' representatives to give detailed training to assigned Department of Veterans Affairs personnel in the operation and complete maintenance for each piece of equipment. All such training will be at the job site. These requirements are more specifically detailed in the various technical sections. Instructions for different items of equipment that are component parts of a complete system, shall be given in an integrated, progressive manner. All instructors for every piece of component equipment in a system shall be available until instructions for all items included in the system have been completed. This is to assure proper instruction in the operation of inter-related systems. All instruction periods shall be at such times as scheduled by the COR and shall be considered concluded only when the COR is satisfied in regard to complete and thorough coverage. The contractor shall submit a course outline with associated material to the COR for review and approval prior to scheduling training to ensure the subject matter covers the expectations of the VA and the contractual requirements. The Department of Veterans Affairs reserves the right to request the removal of, and substitution for, any instructor who, in the opinion of the COR, does not demonstrate sufficient qualifications in accordance with requirements for instructors above.

1.25 GOVERNMENT FURNISHED PROPERTY (NOT USED)

1.26 RELOCATED EQUIPMENT (NOT USED)

1.27 STORAGE SPACE FOR VA EQUIPMENT (NOT USED)

1.28 CONSTRUCTION SIGN (NOT USED)

1.29 SAFETY SIGN (NOT USED)

1.30 PHOTOGRAPHIC DOCUMENTATION (NOT USED)

1.31 FINAL ELEVATION DIGITAL IMAGES (NOT USED)

1.32 HISTORIC PRESERVATION (NOT USED)

1.33 VA TRIVIGA CPMS (NOT USED)

1.34 CONTRACTOR'S SCHEDULE

- A. Contractor shall submit to the COR for approval three copies of their construction schedule in Microsoft Project format. As a minimum, the schedule shall be in a bar chart format and include the construction activities in each specific building or portion thereof with at least 1 printed copy.
- B. The construction activities listed on the schedule will be the basis of the work descriptions on the contractor's monthly invoice.
- C. The contractor shall update their schedule to reflect actual dates and submit via Microsoft Outlook or Project, an updated schedule biweekly and with the monthly invoice.
- D. Wall channeling work shall be conducted between 5:00 P.M. and 12:00 A.M. each day.
- E. All normal shift work shall be conducted between 7:00 A.M. and 5:00 P.M., Monday through Friday, Federal holiday excepted.
- F. Second shift work shall be performed, 4:30 P.M. to 12:00 A.M., Monday through Friday, Federal holidays excepted. This work includes all areas that would affect patient care.
- G. Weekend work shall be performed between 3:30 P.M., Friday and 11:50 P.M., Sunday.
- H. The contractor will be allowed to work in two sprinkler zones. Contractor may work in mechanical/electrical rooms, stairways, attics, and crawl spaces in an additional building with the approval of the COR.

- I. Fire sprinkler system shall be in service at all times. The existing system may be taken out on a single floor and shall be put back into service at the end of each day.
- J. No areas will be vacated by the VA for construction purposes. Temporary relocation protection and replacement of furniture and equipment shall be provided by the contractor. Contractor shall maintain one side of corridors clear at all times for access of VA personnel and patients.
- K. Existing fire pump, standpipe system, and sprinkler systems may be taken out of service each day but shall be restored to normal conditions at the end of each day.

- - - E N D - - -

THIS PAGE INTENTIONALLY LEFT BLANK

**SECTION 01 01 10 - IC
 INFECTION CONTROL**

DESCRIPTION

This section specifies the environmental infection and risk assessment controls that the contractor shall consider prior to starting construction & renovation projects in the Aleda E. Lutz VA medical facility. Controls shall include precautionary management and inspections of noninvasive activities, small scale short duration activities that create minimal dust, major demolition and construction projects that generate a moderate to high level of dust and movement of materials, equipment and resources that are encountered or generated by the contractor. The contractor shall review the **Infection Control Risk Assessment Matrix of Precautions** for construction and renovation activities and using the following tables shall **identify the Patient Risk Groups** that will be affected. If more than one risk group will be affected, select the higher risk group:

TYPE A	<p>Inspections and Non-Invasive Activities or Small Scale, Short Duration Activities. Includes, but is not limited to:</p> <ul style="list-style-type: none"> ▪ Small scale removal of ceiling tiles for visual inspection or minor installation. ▪ Painting (but not sanding) ▪ Wall covering, electrical trim work, minor plumbing, and activities that do not generate dust or require cutting of walls – describe work to be done.
TYPE B	<p>Small Scale, Short Duration Activities that create minimal dust. Includes, but is not limited to:</p> <ul style="list-style-type: none"> ▪ Access to chase spaces. Installation of telephone and computer cabling. ▪ Sanding or cutting of walls or ceiling where dust migration can be controlled.
TYPE C	<p>Any work that generates a moderate to high level of dust or requires demolition or removal of any fixed building components and assemblies or new construction. Includes, but is not limited to:</p> <ul style="list-style-type: none"> ▪ Sanding of walls for painting or wall covering. ▪ Removal of floor coverings, ceiling tiles, casework. ▪ Cutting of walls or ceiling. ▪ New wall construction. ▪ Minor ductwork or electrical work above ceilings. ▪ Major cabling activities. ▪ Activity where high levels of dust are generated and cannot be completed with a single work shift.

Group 1 Lowest	Group 2 Medium	Group 3 High
Office areas. Lobbies. Public corridors. Elevators. Canteen Retail Store.	ACT, CLC Radiology/Nuclear Med Respiratory Therapy Physical Therapy. Outpatient Clinics Pharmacy Food Service	Ambulatory Surgery Intensive Care Units. Laboratories. SPS Storage/Sterilization TB Negative Pressure Isolation Rooms

Contact Infection Control for assessment of any area not listed above.

CONSTRUCTION ACTIVITY →	TYPE "A"	TYPE "B"	TYPE "C"
INFECTION CONTROL RISK GROUP ↓			
Group 1	I	I	II
Group 2	I	I	III
Group 3	II	III	III/IV
CLASS I	<ol style="list-style-type: none"> Execute work by methods to minimize raising dust from construction operations. Immediately replace any ceiling tile displaced for visual inspection. 		
CLASS II	<ol style="list-style-type: none"> Notify staff in the immediate area. Provide active means to prevent air-borne dust from dispersing in atmosphere. Water mist work surfaces to control dust while cutting. Seal unused doors with duct tape. Block off and seal air vents. Place dust mat at entrance/exit of work area. Contain construction waste before and during transport in tightly covered containers. Upon completion, wipe work surfaces with disinfectant, wet mop and/or vacuum with HEPA filtered vacuum before leaving work area; and remove isolation of HVAC system. 		
CLASS III	<ol style="list-style-type: none"> Obtain Safety/Infection Control concurrence before construction begins. Complete all critical barriers, i.e. sheetrock, fire rated plywood or plastic, to seal from non-work area before construction begins. Isolate HVAC system in area and maintain negative air pressure within work site utilizing HEPA equipped air filtration units. Contain construction waste before and during transport in tightly covered containers. Seal holes, pipes, conduits, punctures, etc. appropriately. Place dust mat at entrance and exit of work area. Replace as needed. Personnel required to ensure shoes are not tracking when leaving the work site. Upon completion, do not remove barriers from work area until completed project is thoroughly cleaned by NES and inspected by Safety and Infection Control. 		

	<p>AFTER WORK IS COMPLETED:</p> <ol style="list-style-type: none">8. Remove barrier materials carefully to minimize spreading of dirt and debris associated with construction.9. Remove isolation of HVAC system.
--	---

A. Infection Control Risk and damage is defined as the presence of chemical, physical, or biological elements or agents which:

- a. Adversely affect human health or welfare, unfavorably alter ecological balances of importance to human life,

B. Identify the area surrounding the project area, assessing potential impact.

C. Application of Association for Professionals in Infection Control and Epidemiology (APIC) standards for infection control during construction in health care facilities and the following criteria are required in order to maintain infection control standards during all construction activity:

- The air supply is 100% fresh air and the site and adjacent areas can be kept under negative pressure at all times.
- There is no re circulated air in this section
- There is no duct work involved in this section of the demolition
- The site can never be positive to the adjacent areas (i.e. keep the negative air machines on at all times or for 1-2 hours post site work until the negative action can be maintained.
- A log is maintained to document that the negative pressure is checked and has been maintained during those hours when the negative air machines are turned off. (An alarmed device is recommended for this purpose and should be maintained and monitored by the construction personnel).

PART 2.1 - PRODUCTS, MATERIALS AND EQUIPMENT

2.1.1 MATERIALS AND EQUIPMENT

GENERAL REQUIREMENTS

A. All materials shall be delivered in their original package, container or bundle bearing the name of the manufacturer and the

- brand name (where applicable). When transporting new materials & equipment through the hospital, use 4 mil Poly sheeting encasing materials, tools and equipment, or use a totally enclosed cart.
- B. Store all materials subject to damage off the ground, away from wet or damp surfaces and under cover sufficient enough to prevent damage or contamination. Flammable materials shall not be stored inside VA buildings. Replacement materials shall be stored outside of the regulated/work area until construction is completed.
 - C. The Contractor shall not block or hinder use of buildings by patients, staff, and visitors to the VA in partially occupied buildings by placing materials/equipment in any unauthorized place.
 - D. The Competent Person shall inspect for damaged, deteriorating or previously used materials. Such materials shall not be used and shall be removed from the worksite and disposed of properly.
 - E. The contractor shall not haul debris through patient-care areas without prior approval of the VA COR and the Medical Center. When, approved, debris shall be hauled in enclosed dust proof containers or wrapped in plastic and sealed with duct tape. No sharp objects should be allowed to cut through the plastic. Wipe down the exterior of the containers with a damp rag to remove dust. All equipment, tools, and materials transported through occupied areas shall be made free from dust and moisture by vacuuming and wipe down.
- 1) Demolition on above ground floors may use a window debris chute to convey materials to an enclosed dumpster that provides dust and noise control. The contractor is responsible to maintain the original appearance of the building fascia.
 - 2) Dampen debris to keep down dust and provide temporary construction partitions in existing structures where directed by VA COR. Blank off ducts and diffusers to prevent circulation of dust into occupied areas during construction.

2.1.2 NEGATIVE PRESSURE FILTRATION SYSTEM

The Contractor shall provide enough negative air machines to completely exchange the regulated area air volume 4 actual times per hour. The Competent Person shall determine the number of units needed for each regulated area by dividing the cubic feet in the regulated area by 15 and then dividing that result by the actual cubic feet per minute (cfm) for each unit to determine the number of units needed to effect 4 air changes per hour. Provide a standby unit in the event of machine failure and/or emergency in an adjacent area.

2.1.3 DESIGN AND LAYOUT

Before start of work submit the design and layout of the regulated area and the negative air machines, type of construction barriers to be used. The submittal shall indicate the number of, location of and size of negative air machines and exhaust route & location of the windows to be used. The point(s) of exhaust, air flow within the regulated area, anticipated negative pressure differential, and supporting calculations for sizing shall be provided. In addition, submit the following:

- 1) Manufacturer's information on the negative air machine(s).
- 2) Method of supplying power to the units and designation/location of the panels.
- 3) Description of testing method(s) for correct air volume and pressure differential. Provide manufacturer's product data on the pressure differential measuring device used.
- 4) Location of isolation negative air pressure monitor.

2.1.4 NEGATIVE AIR MACHINES

- A. Negative Air Machine Cabinet: The cabinet shall be constructed of steel or other durable material capable of withstanding any potential damage from rough handling and transportation. The width of the cabinet shall be less than 30" in order to fit in standard doorways. The cabinet must be factory sealed to prevent dust from being released during use, transport, or maintenance. Any access to and replacement of filters shall be from the inlet end. The unit shall be on casters or wheels.

- B. Negative Air Machine Fan: The rating capacity of the fan shall match the air moving capacity under actual operating conditions. Manufacturer's typically use "free-air" (no resistance) conditions when rating fans. The fan shall be a centrifugal type fan.
- C. Negative Air Machine Final Filter:
- 1) When exhausting directly to the outside from a window or penetration the filter shall be a minimum MERV 8 pleated filter media completely sealed on all edges within a structurally rigid frame.
 - 2) When exhausting to an exhaust duct: the final filter shall be a HEPA filter. The filter media must be completely sealed on all edges within a structurally rigid frame. The filter shall align with a continuous flexible gasket material in the negative air machine housing to form an air tight seal. Each **HEPA** filter shall be individually tested and certified by the manufacturer to have an efficiency of not less than 99.97% when challenged with 0.3 μm dioctylphthalate (DOP) particles. Testing shall have been done in accordance with Military Standard MIL- STD-282 and Army Instruction Manual 136-300-175A. Each filter must bear a UL586 label to indicate ability to perform under specified conditions. Each filter shall be marked with the name of the manufacturer, serial number, air flow rating, efficiency and resistance, and the direction of test air flow.
- D. Negative Air Machine Pre-filters: The pre-filters, which protect the final HEPA filter by removing larger particles, are required to prolong the operating life of the HEPA filter. Two stages of pre-filtration are required. A first stage pre-filter shall be a low efficiency type for particles 10 μm or larger. A second stage pre-filter shall have a medium efficiency effective for particles down to 5 μm or larger. Pre-filters shall be installed either on or in the intake grid of the unit and held in place with a special housing or clamps.
- F. Negative Air Machine Safety and Warning Devices: An electrical/mechanical lockout must be provided to prevent the fan from being

operated without a HEPA filter. Units must be equipped with an automatic shutdown device to stop the fan in the event of a rupture in the HEPA filter or blockage in the discharge of the fan. Warning lights are required to indicate normal operation; too high a pressure drop across filters or too low of a pressure drop across filters.

- G. Negative Air Machine Electrical: All electrical components shall be approved by the National Electrical Manufacturer's Association (NEMA) and Underwriter's Laboratories (UL). Each unit must be provided with overload protection and the motor, fan, fan housing, and cabinet must be grounded.

2.1.5 PRESSURE DIFFERENTIAL

The fully operational negative air system within the regulated area shall continuously maintain a pressure differential of - 0.02" water column. Before any disturbance of any material or building system, this shall be demonstrated to the VA COR by use of a pressure differential meter/manometer as required by OSHA 29 CFR 1926.1101(e) (5) (i). The Competent Person shall be responsible for providing and maintaining the negative pressure and air changes as required by OSHA and this specification.

2.1.9 TESTING THE SYSTEM

The negative pressure system must be tested before any disturbance. After the regulated area has been completely prepared, the decontamination units set up, and the negative air machines installed, start the units up one at a time. Demonstrate and document the operation and testing of the negative pressure system to the VA using smoke tubes and a negative pressure gauge. Testing must also be done at the start of each work shift.

2.1.10 DEMONSTRATION OF THE NEGATIVE AIR PRESSURE SYSTEM

The demonstration of the operation of the negative pressure system to the VA shall include, but not be limited to, the following:

- A. Contractor to install Triatek (Web site www.Ttk.com) negative air isolation monitoring stations at the sites access doors or at opposite sides of the construction area; check with COR for # of units and location.

- B. Curtains of the decontamination units move in toward regulated area.
- D. The use of smoke tubes to demonstrate air is moving air across all areas in which work is to be done.
- E. Plastic barriers and sheeting move lightly in toward the regulated area.

2.1.11 USE OF SYSTEM DURING CONSTRUCTION OPERATIONS

- A. Start units before beginning any disturbance occurs. After work begins, the units shall run continuously, maintaining 4 actual air changes per hour at a negative pressure differential of 5.0 Pa (-0.02") water column, for the duration of the work until a final visual clearance and final air clearance has been completed.
- B. The negative air machines shall not be shut down for the duration of the project unless authorized by the VA COR, in writing.
- C. Construction work shall begin at a location closest from the units and proceed away from them. If an electric failure occurs, the contractor's Competent Person shall stop all work and not resume until power is restored and all units necessary are operating properly again.
- D. The negative air machines shall continue to run after all work is completed and until a final visual clearance and a final air clearance has been completed for that regulated area.

PART 2.2 - CONTAINMENT BARRIERS AND COVERINGS IN THE CONSTRUCTION AREA

2.2.1 GENERAL

- A. Seal off the perimeter to the regulated area to completely isolate the regulated area from adjacent spaces. All surfaces in the regulated area must be covered to prevent contamination and to facilitate clean-up. Should adjacent areas become contaminated, immediately stop work and clean up the contamination at no additional cost to the Government.

2.2.2 CONTROLLING ACCESS TO THE REGULATED AREA

- A. Access to the regulated area is allowed only through the construction barrier. All other means of access shall be eliminated and OSHA warning signs posted as required by OSHA. If the regulated area is adjacent to or within view of an occupied


area, provide a visual barrier of opaque fire retardant poly sheeting at least 4 mils thick to prevent building occupant observation. If the adjacent area is accessible to the public, the barrier must be solid and capable of withstanding the negative pressure.

2.2.3 CRITICAL BARRIERS

- A. Completely separate the regulated area from adjacent areas using fire retardant poly at least 4 mils thick and duct tape. Individually seal with two layers of 6 mil poly and duct tape all HVAC openings, cap off exhaust into the regulated area. Individually seal all lighting fixtures, clocks, doors, windows, convectors, speakers, or any other objects in the regulated area. Use care with hot/warm surfaces see fig 1.

2.2.4 PRIMARY BARRIERS

- A. Temporary Construction Partitions:
 - 1) Install and maintain temporary construction partitions to provide dust-proof separations between construction areas and adjoining areas. Construct partitions of fire-rated gypsum board or fire-rated plywood (flame spread rating of 25 or less in accordance with ASTM E84) on one side of wood or metal steel studs. Seal with one layer of 4 mil fire-retardant poly for a vapor barrier under gypsum or plywood. Extend the Poly through suspended ceilings to floor slab or roof. Seal penetrations at door openings; install tight-fitting fire-rated door system with self-closing devices see figure below for barrier construction. Door hardware to accept VA BEST core.

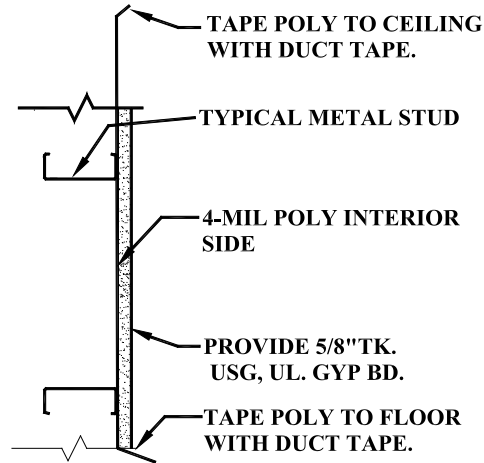

TEMPORARY IC BARRIER WALL CONSTRUCTION

2.2.5 CONTRACTOR SPILL RESPONSE KIT

- A. The kit shall be a Universal Spill kit including the following:
1. HEPA Shop Vacuum.
 2. UN Rated over-pack drum container for shipping waste after spill cleanup
 3. Universal Spill Control absorbent to absorb liquids up to 30 gallons.
 4. Absorbent pillows, socks, mat pads, disposal bags.
 5. Pipe leak clamps for copper & steel pipe in sufficient size range and quantity base on project piping scope.
 6. Water resistant duct tape.

2.2.6 Construction Area Barrier Maintenance

- A. Adhesive Walk-off/Carpet Walk-off Mats, minimum 600mm x 900mm (24" x 36"), shall be used at all interior transitions from the construction area to occupied medical center area. These mats shall be changed as often as required to maintain clean work areas directly outside construction area at all times.
- B. Vacuum and wet mop all transition areas from construction to the occupied medical center as needed to maintain dust free, at the end of shift at a minimum. Vacuum shall utilize HEPA filtration.

Maintain surrounding area frequently. Remove debris as they are created. Transport these outside the construction area in containers with tightly fitting lids.

- C. Using a HEPA vacuum, clean inside the barrier and vacuum ceiling tile prior to replacement. Any ceiling access panels opened for investigation beyond sealed areas shall be sealed immediately when unattended.

2.2.7 Construction Area Standing Water

- A. There shall be no standing water during construction. This includes water in equipment drip pans and open containers within the construction areas. All accidental spills must be cleaned up and dried immediately. Remove and dispose of porous materials that remain damp for more than 48 hours.

2.2.8 Construction Area Final Cleanup

- A. At completion, remove construction barriers and ceiling protection carefully, outside of normal work hours. Vacuum and clean all surfaces free of dust after the removal.
- B. Final Cleanup:
 - 1) Upon completion of project, or as work progresses, remove all construction debris from above ceiling, vertical shafts and utility chases that have been part of the construction.
 - 2) Perform HEPA vacuum cleaning of all surfaces in the construction area. This includes walls, ceilings, cabinets, furniture (built-in or free standing), partitions, and flooring.
 - 3) All new air ducts shall be cleaned prior to final inspection.

- - - E N D - - -

**SECTION 01 01 10-FSS
FIRE SAFETY SECTION**

PART 1 - GENERAL

1.1 DESCRIPTION:

This section covers safety precautions required by all contractor personnel to safeguard patients, visitors, contractors, and Department of Veteran Affairs employees.

1.2 RELATED SECTION









A. Section 01 00 00 - GENERAL REQUIREMENTS

1.3 APPLICABLE PUBLICATIONS

- A. NFPA standard No. 241 - Safeguarding Construction, Alteration, and Demolition Operations.
- B. NFPA Standard No. 51B - Fire Protection in use of cutting and welding Processes.
- C. NFPA Standard No. 101 - Life Safety Code (Current Edition)
- D. OSHA Regulations 29CFR1926 - Construction Industry Standards.
 - 1. Sub-part P- Fire Protection and Prevention
 - 2. Sub-part J- welding and Cutting

PART 2 - PRODUCTS

2.1 PRODUCTS:

Table F-1 FIRE EXTINGUISHERS DATA					
TYPE OF AGENT	Multi-Purpose (ABC) Dry Chemical Monoammonium Phosphate	Regular Dry Chemical Sodium Phosphate	Halon 1211 Bromoclorodi-Fluoromethane	Carbon Dioxide (CO ₂)	Water
 Fires in ordinary combustible materials - paper, wood, and many plastics. Quenching by water or insulating by Multi-Purpose (ABC), dry chemical is effective	Yes-excellent Adheres to burning materials and forms a coating which will smother the fire and minimize reflash.	<u>NO</u>	Yes-excellent Halon 1211 leaves no residue. May not normally affect equipment.	<u>NO</u>	Yes Water saturates materials and prevents rekindling.
 Fires in flammable liquids such as gasoline, oils, grease, tars, paints, lacquers and flammable gases. Multi-Purpose (ABC), Regular Dry Chemical, Halon 1211, and Carbon Dioxide agents smother these fires.	Yes-excellent Dry chemical agent smothers fire. Screen of agent shields user from heat.	Yes-excellent Dry chemical agent smothers fire. Screen of agent shields user from heat.	Yes-excellent Halon 1211 leaves no residue. May not normally affect equipment.	Yes-excellent Carbon Dioxide leaves no residue, may not normally affect or damage equipment.	<u>NO</u> Water will spread flammable liquids and not put it out.
 Fires in electrical equipment.. Motors, generators, switches and appliances.. where a non conducting extinguishing agent Multi-Purpose (ABC), Regular Dry Chemical, Halon 1211 or Carbon Dioxide is required.	Yes-excellent Dry chemical agent is non-conductive. Screen of agent shields user from heat.	Yes-excellent Dry chemical agent is non-conductive. Screen of agent shields user from heat.	Yes-excellent Halon 1211 is a non-conductor, leaves no residue, may not normally affect or damage electrical equipment.	Yes-excellent Carbon Dioxide is a non-conductor, leaves no residue, may not normally affect or damage electrical equipment.	<u>NO</u> Water, a conductor, should never be used on live electrical fires.
RANGE ----- Discharge Time ---	5 to 20 feet 10 to 25 seconds	5 to 20 feet 10 to 25 seconds	8 to 18 feet 8 to 18 seconds Depending on size	3 to 8 feet 8 to 30 seconds	Up to 40 feet Up to 60 seconds

PART 3 - EXECUTION

3.1 LOCATION OF CONTRACTOR WORK AREAS

Construction offices and trailers used as storage are required to a located minimum distance from permanent structures. VA COR approval of location does not relieve the contractor at this ultimate responsibility of meeting OSHA and NFPA Regulation.

3.2 CONTRACTOR FIRE EXTINGUISHER

Contractors are required to have fire extinguishers on jobsite. All fire extinguishers shall be checked monthly and recorded.

3.3 HOT WORK AND FIRE ALARM SHUTDOWN PERMIT

Contractor is required to obtain a permit from the VA COR prior to start of each hot work operation or if the fire alarm needs to be shutdown. The following form shall be used for obtaining approval and may be reproduced at contractor's expense. Other form must be submitted for approval by the Contracting Officer's Representative (COR) prior to use.

3.4 CHECKLIST

The following checklist is provided to the contractor as a quick reference only. NFPA 513 should be consulted for official requirements for protection of the area.

3.5 STEPS TO OBTAIN PERMIT

- A. Bring filled in permit to the project COR. If they are unavailable, you may see any of the following VAMC personnel listed below:
 - a. Tom Belongia, COR
 - b. Gordon Heinzman, COR
 - c. Calvin Hugo, COR
 - d. Kevin Russell, Assistant Chief of Facilities
 - e. Sheila Taylor, Safety Manager
 - f. Larry Unrein, M&R Supervisor
 - g. Pete Damsen, Utilities Supervisor
- B. After receiving their signature, make a copy of the permit at the FMS copier.
- C. This copy must be posted at the Work Permit Bulletin Board located in FMS Office area.
- D. When the work is completed or the permit expires, the original permit and the copy of the permit must be signed off, remove the signed copy of the permit from the board and place the copy in the closed permit mailbox. The original permit shall be returned to the general contractor for filing.

SAFE WORK/HOT WORK PERMIT

Emergency No.: 989-321-4222

**BEFORE INITIATING HOT WORK, ENSURE PRECAUTIONS ARE IN PLACE!
MAKE SURE AN APPROPRIATE FIRE EXTINGUISHER IS READILY AVAILABLE!**

This Permit is required for any operation involving open flames, producing heat and/or sparks, and any operation that would affect the fire alarm system. This includes, but is not limited to: Brazing, Cutting, Grinding, Soldering, Thawing Pipe, Torch-Applied Roofing², and Cadwelding.

<p>INSTRUCTIONS A. Verify precautions listed at right (or do not proceed with the work). B. Complete and retain this permit.</p>		<p align="center">Required Precautions Checklist</p>	
<p>HOT WORK BEING DONE BY:</p> <p><input type="checkbox"/> EMPLOYEE <input type="checkbox"/> CONTRACTOR _____</p>		<p><input type="checkbox"/> Available sprinklers, hose streams, and extinguishers are in service/operable. <input type="checkbox"/> Hot work equipment in good repair. <input type="checkbox"/> Confined space entry permit when required. <input type="checkbox"/> Lockout/tagout required. <input type="checkbox"/> Ensure all conditions are safe and remain unchange. <input type="checkbox"/> Work not conducted on pipes or other metal in contact with combustible material if close enough to cause ignition by conduction.</p>	
<p>DATE:</p>	<p>TIME:</p>	<p>Requirements within 35 ft. (10 m) of work: <input type="checkbox"/> Flammable liquids, dust, lint, and oil deposits removed. <input type="checkbox"/> Explosive atmosphere in area eliminated. <input type="checkbox"/> Floors swept clean. <input type="checkbox"/> Combustible floors wet down, covered with damp sand or fire resistant sheets. <input type="checkbox"/> Remove other combustibles where possible. Otherwise protect with fire resistant tarpaulins or welding screens. <input type="checkbox"/> All wall and floor openings covered. <input type="checkbox"/> Fire resistant tarpaulins suspended beneath work.</p>	
<p>BUILDING - FLOOR - LOCATION:</p>		<p>Work on walls or ceilings/enclosed equipment: <input type="checkbox"/> Construction is noncombustible and without combustible covering insulation. <input type="checkbox"/> Combustibles are moved 30 feet away from any wall (both sides). <input type="checkbox"/> Danger does not exist by conduction of heat into another area. <input type="checkbox"/> Enclosed equipment cleaned of all combustibles. <input type="checkbox"/> Containers purged of all flammable liquids/ vapors. (verified by gas detection instrument).</p>	
<p>TYPE OF WORK / JOB:</p>		<p>Fire watch/hot work monitor: Name: _____ <input type="checkbox"/> Fire watch will be provided during and for 30 minutes after work including any breaks. <input type="checkbox"/> Firewatch is supplied with suitable extinguishers. <input type="checkbox"/> Firewatch is trained in use of this equipment and sounding alarms. <input type="checkbox"/> Fire watch may be required for adjoining areas above, and below. <input type="checkbox"/> Ample ventilation to remove smoke/ vapor from work area.</p>	
<p>PERSON PERFORMING HOT WORK:</p>		<p>Final Check-up List: <input type="checkbox"/> Monitor hot work area for 30 minutes after job is complete. <input type="checkbox"/> Clean up work space / sweep area. <input type="checkbox"/> Sign and turn in permits.</p>	
<p>PHONE NUMBER:</p>		<p>VAMC USE BELOW THIS LINE</p>	
<p>PERMIT NO.:</p>		<p>PROJECT NO.:</p>	
<p>I verify the above location has been examined, the precautions checked on the Required Precautions Checklist have been taken to prevent fire, and permission is authorized for work.</p>			
<p>SIGNATURE: _____</p>			
<p>PERMIT EXPIRES: Date: _____ Time: _____</p>		<p>FIRE WATCH REQUIRED: <input type="checkbox"/> YES <input type="checkbox"/> NO</p>	
<p>FIRE ALARM SHUTDOWN REQUIRED: <input type="checkbox"/> YES <input type="checkbox"/> NO</p>		<p>COVER SMOKE DETECTORS: <input type="checkbox"/> YES <input type="checkbox"/> NO</p>	
<p align="center">THIS PERMIT IS GOOD FOR ONE SHIFT ONLY IF ALARM SOUNDS, THIS PERMIT IS VOID, MUST HAVE NEW PERMIT ISSUED</p>		<p>FINAL CHECK-UP (PERMIT REQUESTER) Work area and all adjacent areas to which sparks and heat might have spread (including floors above and below and on opposite sides of walls) were inspected thirty (30) minutes after the work was completed and were found fire safe.</p>	
<p>Notes:</p>		<p>SIGNATURE: _____ Time: _____</p>	
<p>1. When used in accordance with NFPA 51B, this permit is to be used for, but not limited to, the following: welding, cutting, grinding, open-flame soldering, and thawing pipe. 2. Torch applied roofing is exempt from NFPA 51B per 1-2.3.</p>			

SECTION 01 33 23

SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This specification defines the general requirements and procedures for submittals. A submittal is information submitted for VA review to establish compliance with the contract documents.
- B. Detailed submittal requirements are found in the technical sections of the contract specifications. The Contracting Officer may request submittals in addition to those specified when deemed necessary to adequately describe the work covered in the respective technical specifications at no additional cost to the government.
- C. VA approval of a submittal does not relieve the Contractor of the responsibility for any error which may exist. The Contractor is responsible for fully complying with all contract requirements and the satisfactory construction of all work, including the need to check, confirm, and coordinate the work of all subcontractors for the project. Non-compliant material incorporated in the work will be removed and replaced at the Contractor's expense.

1.2 DEFINITIONS

- A. Preconstruction Submittals: Submittals which are required prior to issuing contract notice to proceed or starting construction. For example, Certificates of insurance; Surety bonds; Site-specific safety plan; Construction progress schedule; Schedule of values; Submittal register; List of proposed subcontractors.
- B. Shop Drawings: Drawings, diagrams, and schedules specifically prepared to illustrate some portion of the work. Drawings prepared by or for the Contractor to show how multiple systems and interdisciplinary work will be integrated and coordinated.
- C. Product Data: Catalog cuts, illustrations, schedules, diagrams, performance charts, instructions, and brochures, which describe and illustrate size, physical appearance, and other characteristics of materials, systems, or equipment for some portion of the work. Samples of warranty language when the contract requires extended product warranties.

- D. Samples: Physical examples of materials, equipment, or workmanship that illustrate functional and aesthetic characteristics of a material or product and establish standards by which the work can be judged. Color samples from the manufacturer's standard line (or custom color samples if specified) to be used in selecting or approving colors for the project. Field samples and mock-ups constructed to establish standards by which the ensuing work can be judged.
- E. Design Data: Calculations, mix designs, analyses, or other data pertaining to a part of work.
- F. Test Reports: Report which includes findings of a test required to be performed by the Contractor on an actual portion of the work. Report which includes finding of a test made at the job site or on sample taken from the job site, on portion of work during or after installation.
- G. Certificates: Document required of Contractor, or of a manufacturer, supplier, installer, or subcontractor through Contractor. The purpose is to document procedures, acceptability of methods, or personnel qualifications for a portion of the work.
- H. Manufacturer's Instructions: Pre-printed material describing installation of a product, system, or material, including special notices and MSDS concerning impedances, hazards, and safety precautions.
- I. Manufacturer's Field Reports: Documentation of the testing and verification actions taken by manufacturer's representative at the job site on a portion of the work, during or after installation, to confirm compliance with manufacturer's standards or instructions. The documentation must indicate whether the material, product, or system has passed or failed the test.
- J. Operation and Maintenance Data: Manufacturer data that is required to operate, maintain, troubleshoot, and repair equipment, including manufacturer's help, parts list, and product line documentation. This data shall be incorporated in an operations and maintenance manual.
- K. Closeout Submittals: Documentation necessary to properly close out a construction contract. For example, Record Drawings and as-built drawings. Also, submittal requirements necessary to properly close out a phase of construction on a multi-phase contract.

1.3 SUBMITTAL REGISTER

- A. The submittal register will list items of equipment and materials for which submittals are required by the specifications. This list may not be all inclusive and additional submittals may be required by the specifications. The Contractor is not relieved from supplying submittals required by the contract documents but which have been omitted from the submittal register.
- B. The submittal register will serve as a scheduling document for submittals and will be used to control submittal actions throughout the contract period.
- C. The VA will provide the initial submittal register in electronic format. Thereafter, the Contractor shall track all submittals by maintaining a complete list, including completion of all data columns, including dates on which submittals are received and returned by the VA.
- D. The Contractor shall update the submittal register as submittal actions occur and maintain the submittal register at the project site until final acceptance of all work by Contracting Officer.
- E. The Contractor shall submit formal monthly updates to the submittal register in electronic format. Each monthly update shall document actual submission and approval dates for each submittal.

1.4 SUBMITTAL SCHEDULING

- A. Submittals are to be scheduled, submitted, reviewed, and approved prior to the acquisition of the material or equipment.
- B. Coordinate scheduling, sequencing, preparing, and processing of submittals with performance of work so that work will not be delayed by submittal processing. Allow time for potential resubmittal.
- C. No delay costs or time extensions will be allowed for time lost in late submittals or resubmittals.
- D. All submittals are required to be approved prior to the start of the specified work activity.

1.5 SUBMITTAL PREPARATION

- A. Each submittal is to be complete and in sufficient detail to allow ready determination of compliance with contract requirements.
- B. Collect required data for each specific material, product, unit of work, or system into a single submittal. Prominently mark choices, options, and portions applicable to the submittal. Partial submittals will not be

- accepted for expedition of construction effort. Submittal will be returned without review if incomplete.
- C. If available product data is incomplete, provide Contractor-prepared documentation to supplement product data and satisfy submittal requirements.
 - D. All irrelevant or unnecessary data shall be removed from the submittal to facilitate accuracy and timely processing. Submittals that contain the excessive amount of irrelevant or unnecessary data will be returned with review.
 - E. Provide a transmittal form for each submittal with the following information:
 - 1. Project title, location and number.
 - 2. Construction contract number.
 - 3. Date of the drawings and revisions.
 - 4. Name, address, and telephone number of subcontractor, supplier, manufacturer, and any other subcontractor associated with the submittal.
 - 5. List paragraph number of the specification section and sheet number of the contract drawings by which the submittal is required.
 - 6. When a resubmission, add alphabetic suffix on submittal description. For example, submittal 18 would become 18A, to indicate resubmission.
 - 7. Product identification and location in project.
 - F. The Contractor is responsible for reviewing and certifying that all submittals are in compliance with contract requirements before submitting for VA review. Proposed deviations from the contract requirements are to be clearly identified. All deviations submitted must include a side by side comparison of item being proposed against item specified. Failure to point out deviations will result in the VA requiring removal and replacement of such work at the Contractor's expense.
 - G. Stamp, sign, and date each submittal transmittal form indicating action taken.
 - H. Stamp used by the Contractor on the submittal transmittal form to certify that the submittal meets contract requirements is to be similar to the following:

CONTRACTOR
(Firm Name)
_____ Approved
_____ Approved with corrections as noted on submittal data and/or attached sheets(s)
SIGNATURE: _____
TITLE: _____
DATE: _____

1.6 SUBMITTAL FORMAT AND TRANSMISSION

- A. Provide submittals in electronic format, with the exception of material samples. Use PDF as the electronic format, unless otherwise specified or directed by the Contracting Officer.
- B. Compile the electronic submittal file as a single, complete document. Name the electronic submittal file specifically according to its contents.
- C. Electronic files must be of sufficient quality that all information is legible. Generate PDF files from original documents so that the text included in the PDF file is both searchable and can be copied. If documents are scanned, Optical Character Resolution (OCR) routines are required.

- D. E-mail electronic submittal documents smaller than 5MB in size to e-mail addresses as directed by the Contracting Officer.
- E. Provide electronic documents over 5MB through an electronic FTP file sharing system. Confirm that the electronic FTP file sharing system can be accessed from the VA computer network. The Contractor is responsible for setting up, providing, and maintaining the electronic FTP file sharing system for the construction contract period of performance.
- F. Provide hard copies of submittals when requested by the Contracting Officer. Up to 3 additional hard copies of any submittal may be requested at the discretion of the Contracting Officer, at no additional cost to the VA.

1.7 SAMPLES

- A. Submit two sets of physical samples showing range of variation, for each required item.
- B. Where samples are specified for selection of color, finish, pattern, or texture, submit the full set of available choices for the material or product specified.
- C. When color, texture, or pattern is specified by naming a particular manufacturer and style, include one sample of that manufacturer and style, for comparison.
- D. Before submitting samples, the Contractor is to ensure that the materials or equipment will be available in quantities required in the project. No change or substitution will be permitted after a sample has been approved.
- E. The VA reserves the right to disapprove any material or equipment which previously has proven unsatisfactory in service.
- F. Physical samples supplied maybe requested back for use in the project after reviewed and approved.

1.8 OPERATION AND MAINTENANCE DATA

- A. Submit data specified for a given item within 30 calendar days after the item is delivered to the contract site.
- B. In the event the Contractor fails to deliver O&M Data within the time limits specified, the Contracting Officer may withhold from progress payments 50 percent of the price of the item with which such O&M Data are applicable.

1.9 TEST REPORTS

SRE may require specific test after work has been installed or completed which could require contractor to repair test area at no additional cost to contract.

1.10 VA REVIEW OF SUBMITTALS AND RFIS

- A. The VA will review all submittals for compliance with the technical requirements of the contract documents. The Architect-Engineer for this project will assist the VA in reviewing all submittals and determining contractual compliance. Review will be only for conformance with the applicable codes, standards and contract requirements.
- B. Period of review for submittals begins when the VA COR receives submittal from the Contractor.
- C. Period of review for each resubmittal is the same as for initial submittal.
- D. VA review period is 15 working days for submittals.
- E. VA review period is 10 working days for RFIs.
- F. The VA will return submittals to the Contractor with the following notations:
 - 1. "Approved": authorizes the Contractor to proceed with the work covered.
 - 2. "Approved as noted": authorizes the Contractor to proceed with the work covered provided the Contractor incorporates the noted comments and makes the noted corrections.
 - 3. "Disapproved, revise and resubmit": indicates noncompliance with the contract requirements or that submittal is incomplete. Resubmit with appropriate changes and corrections. No work shall proceed for this item until resubmittal is approved.
 - 4. "Not reviewed": indicates submittal does not have evidence of being reviewed and approved by Contractor or is not complete. A submittal marked "not reviewed" will be returned with an explanation of the reason it is not reviewed. Resubmit submittals after taking appropriate action.

1.11 APPROVED SUBMITTALS

- A. The VA approval of submittals is not to be construed as a complete check, and indicates only that the general method of construction, materials, detailing, and other information are satisfactory.
- B. VA approval of a submittal does not relieve the Contractor of the responsibility for any error which may exist. The Contractor is

responsible for fully complying with all contract requirements and the satisfactory construction of all work, including the need to check, confirm, and coordinate the work of all subcontractors for the project. Non-compliant material incorporated in the work will be removed and replaced at the Contractor's expense.

- C. After submittals have been approved, no resubmittal for the purpose of substituting materials or equipment will be considered unless accompanied by an explanation of why a substitution is necessary.
- D. Retain a copy of all approved submittals at project site, including approved samples.

1.12 WITHHOLDING OF PAYMENT

Payment for materials incorporated in the work will not be made if required approvals have not been obtained.

1.13 Architect/Engineer

At the time of transmittal to the COR, the contractor shall also send a copy of the complete submittal directly to the Architect/Engineer:

Frank Van Overmeiren
Fire Protection & Code Consultants, LLC
Indianapolis, IN 46224
Phone: (317) 486-5188
fvanovermeiren@fpc-consultants.com

- - - E N D - - -

SECTION 01 35 26
SAFETY REQUIREMENTS

1.1 APPLICABLE PUBLICATIONS:

A. Latest publications listed below form part of this Article to extent referenced. Publications are referenced in text by basic designations only.

B. American Society of Safety Engineers (ASSE):

A10.1-2011.....Pre-Project & Pre-Task Safety and Health
Planning

A10.34-2012.....Protection of the Public on or Adjacent to
Construction Sites

A10.38-2013.....Basic Elements of an Employer's Program to
Provide a Safe and Healthful Work Environment
American National Standard Construction and
Demolition Operations

C. American Society for Testing and Materials (ASTM):

E84-2013.....Surface Burning Characteristics of Building
Materials

D. The Facilities Guidelines Institute (FGI):

FGI Guidelines- 2014 Guidelines for Design and Construction of
Hospitals and Outpatient Facilities

E. National Fire Protection Association (NFPA):

10-2016.....Standard for Portable Fire Extinguishers

30-2015.....Flammable and Combustible Liquids Code

51B-2014.....Standard for Fire Prevention During Welding,
Cutting and Other Hot Work

70-2017.....National Electrical Code

70B-2017.....Recommended Practice for Electrical Equipment
Maintenance

70E-2015Standard for Electrical Safety in the Workplace

99-2012.....Health Care Facilities Code

241-2013.....Standard for Safeguarding Construction,
Alteration, and Demolition Operations

F. The Joint Commission (TJC)

TJC ManualComprehensive Accreditation and Certification
Manual

G. U.S. Nuclear Regulatory Commission

10 CFR 20Standards for Protection Against Radiation

H. U.S. Occupational Safety and Health Administration (OSHA):

29 CFR 1904Reporting and Recording Injuries & Illnesses

29 CFR 1910Safety and Health Regulations for General
Industry

29 CFR 1926Safety and Health Regulations for Construction
Industry

CPL 2-0.124.....Multi-Employer Citation Policy

I. VHA Directive 2005-007

1.2 DEFINITIONS:

A. Critical Lift. A lift with the hoisted load exceeding 75% of the crane's maximum capacity; lifts made out of the view of the operator (blind picks); lifts involving two or more cranes; personnel being hoisted; and special hazards such as lifts over occupied facilities, loads lifted close to power-lines, and lifts in high winds or where other adverse environmental conditions exist; and any lift which the crane operator believes is critical.

B. OSHA "Competent Person" (CP). One who is capable of identifying existing and predictable hazards in the surroundings and working conditions which are unsanitary, hazardous or dangerous to employees, and who has the authorization to take prompt corrective measures to eliminate them (see 29 CFR 1926.32(f)).

- C. "Qualified Person" means one who, by possession of a recognized degree, certificate, or professional standing, or who by extensive knowledge, training and experience, has successfully demonstrated his ability to solve or resolve problems relating to the subject matter, the work, or the project.
- D. High Visibility Accident. Any mishap which may generate publicity or high visibility.
- E. Accident/Incident Criticality Categories:

No impact - near miss incidents that should be investigated but are not required to be reported to the VA;

Minor incident/impact - incidents that require first aid or result in minor equipment damage (less than \$5000). These incidents must be investigated but are not required to be reported to the VA;

Moderate incident/impact - Any work-related injury or illness that results in:

1. Days away from work (any time lost after day of injury/illness onset);
2. Restricted work;
3. Transfer to another job;
4. Medical treatment beyond first aid;
5. Loss of consciousness;
6. A significant injury or illness diagnosed by a physician or other licensed health care professional, even if it did not result in (1) through (5) above or,
7. any incident that leads to major equipment damage (greater than \$5000). These incidents must be investigated and are required to be reported to the VA; major incident/impact - Any mishap that leads to fatalities, hospitalizations, amputations, and losses of an eye as a result of contractors' activities. Or any incident which leads to major property damage (greater than \$20,000) and/or may generate publicity or high visibility. These incidents must be investigated and are required to be reported to the VA

as soon as practical, but not later than 2 hours after the incident.

- E. Medical Treatment. Treatment administered by a physician or by registered professional personnel under the standing orders of a physician. Medical treatment does not include first aid treatment even through provided by a physician or registered personnel.

1.3 REGULATORY REQUIREMENTS:

- A. In addition to the detailed requirements included in the provisions of this contract, comply with 29 CFR 1926, comply with 29 CFR 1910 as incorporated by reference within 29 CFR 1926, comply with ASSE A10.34, and all applicable [federal, state, and local] laws, ordinances, criteria, rules and regulations. Submit matters of interpretation of standards for resolution before starting work. Where the requirements of this specification, applicable laws, criteria, ordinances, regulations, and referenced documents vary, the most stringent requirements govern except with specific approval and acceptance by the COR.

1.4 ACCIDENT PREVENTION PLAN (APP):

- A. The APP (aka Construction Safety & Health Plan) shall interface with the Contractor's overall safety and health program. Include any portions of the Contractor's overall safety and health program referenced in the APP in the applicable APP element and ensure it is site-specific. The Government considers the Prime Contractor to be the "controlling authority" for all worksite safety and health of each subcontractor(s). Contractors are responsible for informing their subcontractors of the safety provisions under the terms of the contract and the penalties for noncompliance, coordinating the work to prevent one craft from interfering with or creating hazardous working conditions for other crafts, and inspecting subcontractor operations to ensure that accident prevention responsibilities are being carried out.
- B. The APP shall be prepared as follows:
 - 1. Written in English by a qualified person who is employed by the Prime Contractor articulating the specific work and hazards pertaining to the contract (model language can be found in ASSE

- A10.33). Specifically articulating the safety requirements found within these VA contract safety specifications.
2. Address both the Prime Contractors and the subcontractors work operations.
 3. State measures to be taken to control hazards associated with materials, services, or equipment provided by suppliers.
 4. Address all the elements/sub-elements and in order as follows:
 - a. SIGNATURE SHEET. Title, signature, and phone number of the following:
 - 1) Plan preparer (Qualified Person such as corporate safety staff person or contracted Certified Safety Professional with construction safety experience);
 - 2) Plan approver (company/corporate officers authorized to obligate the company);
 - 3) Plan concurrence (e.g., Chief of Operations, Corporate Chief of Safety, Corporate Industrial Hygienist, project manager or superintendent, project safety professional). Provide concurrence of other applicable corporate and project personnel (Contractor).
 - b. BACKGROUND INFORMATION. List the following:
 - 1) Contractor;
 - 2) Contract number;
 - 3) Project name;
 - 4) Brief project description, description of work to be performed, and location; phases of work anticipated (these will require an AHA).
 - c. STATEMENT OF SAFETY AND HEALTH POLICY. Provide a copy of current corporate/company Safety and Health Policy Statement, detailing commitment to providing a safe and healthful workplace for all employees. The Contractor's written safety program goals, objectives, and accident experience goals for this contract should be provided.
 - d. RESPONSIBILITIES AND LINES OF AUTHORITIES. Provide the following:
 - 1) A statement of the employer's ultimate responsibility for the implementation of his SOH program;

- 2) Identification and accountability of personnel responsible for safety at both corporate and project level. Contracts specifically requiring safety or industrial hygiene personnel shall include a copy of their resumes.
 - 3) The names of Competent and/or Qualified Person(s) and proof of competency/qualification to meet specific OSHA Competent/Qualified Person(s) requirements must be attached.;
 - 4) Requirements that no work shall be performed unless a designated competent person is present on the job site;
 - 5) Requirements for pre-task Activity Hazard Analysis (AHAs);
 - 6) Lines of authority;
 - 7) Policies and procedures regarding noncompliance with safety requirements (to include disciplinary actions for violation of safety requirements) should be identified;
- e. SUBCONTRACTORS AND SUPPLIERS. If applicable, provide procedures for coordinating SOH activities with other employers on the job site:
- 1) Identification of subcontractors and suppliers (if known);
 - 2) Safety responsibilities of subcontractors and suppliers.
- f. TRAINING.
- 1) Site-specific SOH orientation training at the time of initial hire or assignment to the project for every employee before working on the project site is required.
 - 2) Mandatory training and certifications that are applicable to this project (e.g., explosive actuated tools, crane operator, rigger, crane signal person, fall protection, electrical lockout/NFPA 70E, machine/equipment lockout, confined space, etc.) and any requirements for periodic retraining/recertification are required.
 - 3) Procedures for ongoing safety and health training for supervisors and employees shall be established to address changes in site hazards/conditions.

- 4) OSHA 10-hour training is required for all workers on site and the OSHA 30-hour training is required for Trade Competent Persons (CPs)
- g. SAFETY AND HEALTH INSPECTIONS.
- 1) Specific assignment of responsibilities for a minimum daily job site safety and health inspection during periods of work activity: Who will conduct (e.g., "Site Safety and Health CP"), proof of inspector's training/qualifications, when inspections will be conducted, procedures for documentation, deficiency tracking system, and follow-up procedures.
 - 2) Any external inspections/certifications that may be required (e.g., contracted CSP or CSHT)
- h. ACCIDENT/INCIDENT INVESTIGATION & REPORTING. The Contractor shall conduct mishap investigations of all Moderate and Major as well as all High Visibility Incidents. The APP shall include accident/incident investigation procedure and identify person(s) responsible to provide the following to COR:
- 1) Exposure data (man-hours worked);
 - 2) Accident investigation reports;
 - 3) Project site injury and illness logs.
- i. PLANS (PROGRAMS, PROCEDURES) REQUIRED. Based on a risk assessment of contracted activities and on mandatory OSHA compliance programs, the Contractor shall address all applicable occupational, patient, and public safety risks in site-specific compliance and accident prevention plans. These Plans shall include but are not be limited to procedures for addressing the risks associates with the following:
- 1) Emergency response;
 - 2) Contingency for severe weather;
 - 3) Fire Prevention;
 - 4) Medical Support;
 - 5) Posting of emergency telephone numbers;
 - 6) Prevention of alcohol and drug abuse;

- 7) Site sanitation housekeeping, drinking water, toilets);
- 8) Night operations and lighting;
- 9) Hazard communication program;
- 10) Welding/Cutting "Hot" work;
- 11) Electrical Safe Work Practices (Electrical LOTO/NFPA 70E);
- 12) General Electrical Safety;
- 13) Hazardous energy control (Machine LOTO);
- 14) Site-Specific Fall Protection & Prevention;
- 15) Excavation/trenching;
- 16) Asbestos abatement;
- 17) Lead abatement;
- 18) Crane Critical lift;
- 19) Respiratory protection;
- 20) Health hazard control program;
- 21) Radiation Safety Program;
- 22) Abrasive blasting;
- 23) Heat/Cold Stress Monitoring;
- 24) Crystalline Silica Monitoring (Assessment);
- 25) Demolition plan (to include engineering survey);
- 26) Formwork and shoring erection and removal;
- 27) Pre-Cast Concrete;
- 28) Public (Mandatory compliance with ANSI/ASSE A10.34-2012).

C. Submit the APP to the COR for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES 15 [fifteen] calendar days prior to the date of the preconstruction conference for acceptance. Work cannot proceed without an accepted APP.

- D. Once accepted by the COR, the APP and attachments will be enforced as part of the contract. Disregarding the provisions of this contract or the accepted APP will be cause for stopping of work, at the discretion of the Contracting Officer in accordance with FAR Clause 52.236-13, *Accident Prevention*, until the matter has been rectified.
- E. Once work begins, changes to the accepted APP shall be made with the knowledge and concurrence of the COR. Should any severe hazard exposure, i.e. imminent danger, become evident, stop work in the area, secure the area, and develop a plan to remove the exposure and control the hazard. Notify the Contracting Officer within 24 hours of discovery. Eliminate/remove the hazard. In the interim, take all necessary action to restore and maintain safe working conditions in order to safeguard onsite personnel, visitors, the public and the environment.

1.5 ACTIVITY HAZARD ANALYSES (AHAS) :

- A. AHAs are also known as Job Hazard Analyses, Job Safety Analyses, and Activity Safety Analyses. Before beginning each work activity involving a type of work presenting hazards not experienced in previous project operations or where a new work crew or sub-contractor is to perform the work, the Contractor(s) performing that work activity shall prepare an AHA (Example electronic AHA forms can be found on the US Army Corps of Engineers web site)
- B. AHAs shall define the activities being performed and identify the work sequences, the specific anticipated hazards, site conditions, equipment, materials, and the control measures to be implemented to eliminate or reduce each hazard to an acceptable level of risk.
- C. Work shall not begin until the AHA for the work activity has been accepted by the COR and discussed with all engaged in the activity, including the Contractor, subcontractor(s), and Government on-site representatives at preparatory and initial control phase meetings.
 - 1. The names of the Competent/Qualified Person(s) required for a particular activity (for example, excavations, scaffolding, fall protection, other activities as specified by OSHA and/or other State and Local agencies) shall be identified and included in the AHA.

- Certification of their competency/qualification shall be submitted to the Government Designated Authority (GDA) for acceptance prior to the start of that work activity.
2. The AHA shall be reviewed and modified as necessary to address changing site conditions, operations, or change of competent/qualified person(s).
 - a. If more than one Competent/Qualified Person is used on the AHA activity, a list of names shall be submitted as an attachment to the AHA. Those listed must be Competent/Qualified for the type of work involved in the AHA and familiar with current site safety issues.
 - b. If a new Competent/Qualified Person (not on the original list) is added, the list shall be updated (an administrative action not requiring an updated AHA). The new person shall acknowledge in writing that he or she has reviewed the AHA and is familiar with current site safety issues.
 3. Submit AHAs to the COR for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES for review at least 15 [fifteen] calendar days prior to the start of each phase. Subsequent AHAs as shall be formatted as amendments to the APP. The analysis should be used during daily inspections to ensure the implementation and effectiveness of the activity's safety and health controls.
 4. The AHA list will be reviewed periodically (at least monthly) at the Contractor supervisory safety meeting and updated as necessary when procedures, scheduling, or hazards change.
 5. Develop the activity hazard analyses using the project schedule as the basis for the activities performed. All activities listed on the project schedule will require an AHA. The AHAs will be developed by the contractor, supplier, or subcontractor and provided to the prime contractor for review and approval and then submitted to the COR.

1.6 PRECONSTRUCTION CONFERENCE:

- A. Contractor representatives who have a responsibility or significant role in implementation of the accident prevention program, as required by 29 CFR 1926.20(b)(1), on the project shall attend the preconstruction conference to gain a mutual understanding of its implementation. This includes the project superintendent, subcontractor superintendents, and any other assigned safety and health professionals.
- B. Discuss the details of the submitted APP to include incorporated plans, programs, procedures and a listing of anticipated AHAs that will be developed and implemented during the performance of the contract. This list of proposed AHAs will be reviewed at the conference and an agreement will be reached between the Contractor and the Contracting Officer's representative as to which phases will require an analysis. In addition, establish a schedule for the preparation, submittal, review, and acceptance of AHAs to preclude project delays.

1.7 "SITE SAFETY AND HEALTH OFFICER" (SSHO) AND "COMPETENT PERSON" (CP):

- A. The Prime Contractor shall designate a minimum of one SSHO at each project site that will be identified as the SSHO to administer the Contractor's safety program and government-accepted Accident Prevention Plan. Each subcontractor shall designate a minimum of one CP in compliance with 29 CFR 1926.20 (b)(2) that will be identified as a CP to administer their individual safety programs.
- B. Further, all specialized Competent Persons for the work crews will be supplied by the respective contractor as required by 29 CFR 1926 (i.e. Asbestos, Electrical, Cranes, & Derricks, Demolition, Fall Protection, Fire Safety/Life Safety, Ladder, Rigging, Scaffolds, and Trenches/Excavations).
- C. These Competent Persons can have collateral duties as the subcontractor's superintendent and/or work crew lead persons as well as fill more than one specialized CP role (i.e. Asbestos, Electrical, Cranes, & Derricks, Demolition, Fall Protection, Fire Safety/Life Safety, Ladder, Rigging, Scaffolds, and Trenches/Excavations).

- D. The SSHO or an equally-qualified Designated Representative/alternate will maintain a presence on the site during construction operations in accordance with FAR Clause 52.236-6: *Superintendence by the Contractor*. CPs will maintain presence during their construction activities in accordance with above mentioned clause. A listing of the designated SSHO and all known CPs shall be submitted prior to the start of work as part of the APP with the training documentation and/or AHA as listed in Section 1.8 below.
- E. The repeated presence of uncontrolled hazards during a contractor's work operations will result in the designated CP as being deemed incompetent and result in the required removal of the employee in accordance with FAR Clause 52.236-5: Material and Workmanship, Paragraph (c).

1.8 TRAINING:

- A. The designated Prime Contractor SSHO must meet the requirements of all applicable OSHA standards and be capable (through training, experience, and qualifications) of ensuring that the requirements of 29 CFR 1926.16 and other appropriate Federal, State and local requirements are met for the project. As a minimum the SSHO must have completed the OSHA 30-hour Construction Safety class and have five (5) years of construction industry safety experience or three (3) years if he/she possesses a Certified Safety Professional (CSP) or certified Construction Safety and Health Technician (CSHT) certification or have a safety and health degree from an accredited university or college.
- B. All designated CPs shall have completed the OSHA 30-hour Construction Safety course within the past 5 years.
- C. In addition to the OSHA 30 Hour Construction Safety Course, all CPs with high hazard work operations such as operations involving asbestos, electrical, cranes, demolition, work at heights/fall protection, fire safety/life safety, ladder, rigging, scaffolds, and trenches/excavations shall have a specialized formal course in the hazard recognition & control associated with those high hazard work operations. Documented "repeat" deficiencies in the execution of safety requirements will require retaking the requisite formal course.

- D. All other construction workers shall have the OSHA 10-hour Construction Safety Outreach course and any necessary safety training to be able to identify hazards within their work environment.
- E. Submit training records associated with the above training requirements to the COR for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES 15 calendar days prior to the date of the preconstruction conference for acceptance.
- F. Prior to any worker for the contractor or subcontractors beginning work, they shall undergo a safety briefing provided by the SSHO or his/her designated representative. As a minimum, this briefing shall include information on the site-specific hazards, construction limits, VAMC safety guidelines, means of egress, break areas, work hours, locations of restrooms, use of VAMC equipment, emergency procedures, accident reporting etc... Documentation shall be provided to the Resident Engineer that individuals have undergone contractor's safety briefing.
- G. Ongoing safety training will be accomplished in the form of weekly documented safety meeting.

1.9 INSPECTIONS:

- A. The SSHO shall conduct frequent and regular safety inspections (daily) of the site and each of the subcontractors CPs shall conduct frequent and regular safety inspections (daily) of their work operations as required by 29 CFR 1926.20(b)(2). Each week, the SSHO shall conduct a formal documented inspection of the entire construction areas with the subcontractors' "Trade Safety and Health CPs" present in their work areas. Coordinate with, and report findings and corrective actions weekly to COR.
- B. A Certified Safety Professional (CSP) with specialized knowledge in construction safety or a certified Construction Safety and Health Technician (CSHT) shall randomly conduct a monthly site safety inspection. The CSP or CSHT can be a corporate safety professional or independently contracted. The CSP or CSHT will provide their

certificate number on the required report for verification as necessary.

1. Results of the inspection will be documented with tracking of the identified hazards to abatement.
2. The COR will be notified immediately prior to start of the inspection and invited to accompany the inspection.
3. Identified hazard and controls will be discussed to come to a mutual understanding to ensure abatement and prevent future reoccurrence.
4. A report of the inspection findings with status of abatement will be provided to the COR within one week of the onsite inspection.

1.10 ACCIDENTS, OSHA 300 LOGS, AND MAN-HOURS:

- A. The prime contractor shall establish and maintain an accident reporting, recordkeeping, and analysis system to track and analyze all injuries and illnesses, high visibility incidents, and accidental property damage (both government and contractor) that occur on site. Notify the COR as soon as practical, but no more than four hours after any accident meeting the definition of a Moderate or Major incidents, High Visibility Incidents, or any weight handling and hoisting equipment accident. Within notification include contractor name; contract title; type of contract; name of activity, installation or location where accident occurred; date and time of accident; names of personnel injured; extent of property damage, if any; extent of injury, if known, and brief description of accident (to include type of construction equipment used, PPE used, etc.). Preserve the conditions and evidence on the accident site until the COR determines whether a government investigation will be conducted.
- B. Conduct an accident investigation for all Minor, Moderate and Major incidents as defined in paragraph DEFINITIONS, and property damage accidents resulting in at least \$20,000 in damages, to establish the root cause(s) of the accident. Complete the VA Form 2162 (or equivalent), and provide the report to the COR within 5 calendar days of the accident. The COR will provide copies of any required or special forms.

- C. A summation of all man-hours worked by the contractor and associated sub-contractors for each month will be reported to the COR monthly.
- D. A summation of all Minor, Moderate, and Major incidents experienced on site by the contractor and associated sub-contractors for each month will be provided to the COR monthly. The contractor and associated sub-contractors' OSHA 300 logs will be made available to the COR as requested.

1.11 PERSONAL PROTECTIVE EQUIPMENT (PPE) :

- A. PPE is governed in all areas by the nature of the work the employee is performing. For example, specific PPE required for performing work on electrical equipment is identified in NFPA 70E, Standard for Electrical Safety in the Workplace.
- B. Mandatory PPE includes:
 - 1. Hard Hats - unless written authorization is given by the COR in circumstances of work operations that have limited potential for falling object hazards such as during finishing work or minor remodeling. With authorization to relax the requirement of hard hats, if a worker becomes exposed to an overhead falling object hazard, then hard hats would be required in accordance with the OSHA regulations.
 - 2. Safety glasses - unless written authorization is given by the COR in circumstances of no eye hazards, appropriate safety glasses meeting the ANSI Z.87.1 standard must be worn by each person on site.
 - 3. Appropriate Safety Shoes - based on the hazards present, safety shoes meeting the requirements of ASTM F2413-11 shall be worn by each person on site unless written authorization is given by the COR in circumstances of no foot hazards.
 - 4. Hearing protection - Use personal hearing protection at all times in designated noise hazardous areas or when performing noise hazardous tasks.

1.12 INFECTION CONTROL

- A. Infection Control is critical in all medical center facilities. Interior construction activities causing disturbance of existing dust, or creating new dust, must be conducted within ventilation-controlled areas that minimize the flow of airborne particles into patient areas. Exterior construction activities causing disturbance of soil or creates dust in some other manner must be controlled.
- B. An AHA associated with infection control will be performed by VA personnel in accordance with FGI Guidelines (i.e. Infection Control Risk Assessment (ICRA)). The ICRA procedure found on the American Society for Healthcare Engineering (ASHE) website will be utilized. Risk classifications of Class II or lower will require approval by the COR before beginning any construction work. Risk classifications of Class III or higher will require a permit before beginning any construction work. Infection Control permits will be issued by the COR. The Infection Control Permits will be posted outside the appropriate construction area. More than one permit may be issued for a construction project if the work is located in separate areas requiring separate classes.

The primary project scope area for this project is: **Class [II]**, however, work outside the primary project scope area may vary. The required infection control precautions with each class are as follows:

1. Class I requirements:

a. During Construction Work:

- 1) Notify the COR.
- 2) Execute work by methods to minimize raising dust from construction operations.
- 3) Ceiling tiles: Immediately replace a ceiling tiles displaced for visual inspection.

b. Upon Completion:

- 1) Clean work area upon completion of task
- 2) Notify the COR.

2. Class II requirements:

a. During Construction Work:

- 1) Notify the COR.
- 2) Provide active means to prevent airborne dust from dispersing into atmosphere such as wet methods or tool mounted dust collectors where possible.
- 3) Water mist work surfaces to control dust while cutting.
- 4) Seal unused doors with duct tape.
- 5) Block off and seal air vents.
- 6) Remove or isolate HVAC system in areas where work is being performed.

b. Upon Completion:

- 1) Wipe work surfaces with cleaner/disinfectant.
- 2) Contain construction waste before transport in tightly covered containers.
- 3) Wet mop and/or vacuum with HEPA filtered vacuum before leaving work area.
- 4) Upon completion, restore HVAC system where work was performed
- 5) Notify the COR.

3. Class III requirements:

a. During Construction Work:

- 1) Obtain permit from the COR.
- 2) Remove or Isolate HVAC system in area where work is being done to prevent contamination of duct system.
- 3) Complete all critical barriers i.e. sheetrock, plywood, plastic, to seal area from non-work area or implement control cube method (cart with plastic covering and sealed connection to work site with HEPA vacuum for vacuuming prior to exit) before construction begins. Install construction barriers and ceiling protection carefully, outside of normal work hours.
- 4) Maintain negative air pressure, 0.01 inches of water gauge, within work site utilizing HEPA equipped air filtration units and continuously monitored with a digital display, recording and alarm instrument, which must be calibrated on

installation, maintained with periodic calibration and monitored by the contractor.

- 5) Contain construction waste before transport in tightly covered containers.
- 6) Cover transport receptacles or carts. Tape covering unless solid lid.

b. Upon Completion:

- 1) Do not remove barriers from work area until completed project is inspected by the COR and thoroughly cleaned by the VA Environmental Services Department.
- 2) Remove construction barriers and ceiling protection carefully to minimize spreading of dirt and debris associated with construction, outside of normal work hours.
- 3) Vacuum work area with HEPA filtered vacuums.
- 4) Wet mop area with cleaner/disinfectant.
- 5) Upon completion, restore HVAC system where work was performed.
- 6) Return permit to the COR.

4. Class IV requirements:

a. During Construction Work:

- 1) Obtain permit from the COR.
- 2) Isolate HVAC system in area where work is being done to prevent contamination of duct system.
- 3) Complete all critical barriers i.e. sheetrock, plywood, plastic, to seal area from non-work area or implement control cube method (cart with plastic covering and sealed connection to work site with HEPA vacuum for vacuuming prior to exit) before construction begins. Install construction barriers and ceiling protection carefully, outside of normal work hours.
- 4) Maintain negative air pressure, 0.01 inches of water gauge, within work site utilizing HEPA equipped air filtration units and continuously monitored with a digital display, recording and alarm instrument, which must be calibrated on installation, maintained with periodic calibration and monitored by the contractor.
- 5) Seal holes, pipes, conduits, and punctures.

- 6) Construct anteroom and require all personnel to pass through this room so they can be vacuumed using a HEPA vacuum cleaner before leaving work site or they can wear cloth or paper coveralls that are removed each time they leave work site.
- 7) All personnel entering work site are required to wear shoe covers. Shoe covers must be changed each time the worker exits the work area.

b. Upon Completion:

- 1) Do not remove barriers from work area until completed project is inspected by the COR with thorough cleaning by the VA Environmental Services Dept.
- 2) Remove construction barriers and ceiling protection carefully to minimize spreading of dirt and debris associated with construction, outside of normal work hours.
- 3) Contain construction waste before transport in tightly covered containers.
- 4) Cover transport receptacles or carts. Tape covering unless solid lid.
- 5) Vacuum work area with HEPA filtered vacuums.
- 6) Wet mop area with cleaner/disinfectant.
- 7) Upon completion, restore HVAC system where work was performed.
- 8) Return permit to the COR.

C. Barriers shall be erected as required based upon classification (Class III & IV requires barriers) and shall be constructed as follows:

1. Class III and IV - closed door with masking tape applied over the frame and door is acceptable for projects that can be contained in a single room.
2. Construction, demolition or reconstruction not capable of containment within a single room must have the following barriers erected and made presentable on hospital occupied side:
 - a. Class III & IV (where dust control is the only hazard, and an agreement is reached with the Resident Engineer and Medical Center) - Airtight plastic barrier that extends from the floor to ceiling. Seams must be sealed with duct tape to prevent dust and debris from escaping
 - b. Class III & IV - Drywall barrier erected with joints covered or sealed to prevent dust and debris from escaping.

- c. Class III & IV - Seal all penetrations in existing barrier airtight
 - d. Class III & IV - Barriers at penetration of ceiling envelopes, chases and ceiling spaces to stop movement air and debris
 - e. Class IV only - Anteroom or double entrance openings that allow workers to remove protective clothing or vacuum off existing clothing
 - f. Class III & IV - At elevators shafts or stairways within the field of construction, overlapping flap minimum of two ft. wide of polyethylene enclosures for personnel access.
- D. Products and Materials:
- 1. Sheet Plastic: Fire retardant polystyrene, 6-mil thickness meeting local fire codes.
 - 2. Barrier Doors: Self Closing solid core wood in steel frame, painted
 - 3. Dust proof drywall.
 - 4. High Efficiency Particulate Air-Equipped filtration machine rated at 95% capture of 0.3 microns including pollen, mold spores and dust particles. HEPA filters should have ASHRAE 85 or other pre-filter to extend the useful life of the HEPA. Provide both primary and secondary filtrations units. Maintenance of equipment and replacement of the HEPA filters and other filters will be in accordance with manufacturer's instructions.
 - 5. Exhaust Hoses: Heavy duty, flexible steel reinforced; Ventilation Blower Hose.
 - 6. Adhesive Walk-off Mats: Provide minimum size mats of 24 inches x 36 inches.
 - 7. Disinfectant: Hospital-approved disinfectant or equivalent product
 - 8. Portable Ceiling Access Module.
- E. Before any construction on site begins, all contractor personnel involved in the construction or renovation activity shall be educated and trained in infection prevention measures established by the medical center.
- F. A dust control program will be established and maintained as part of the contractor's infection preventive measures in accordance with the

FGI Guidelines for Design and Construction of Healthcare Facilities. Prior to start of work, prepare a plan detailing project-specific dust protection measures with associated product data, including periodic status reports, and submit to COR for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.

- G. Medical center Infection Control personnel will monitor for airborne disease (e.g. aspergillosis) during construction. A baseline of conditions will be established by the medical center prior to the start of work and periodically during the construction stage to determine impact of construction activities on indoor air quality with safe thresholds established.
- H. In general, the following preventive measures shall be adopted during construction to keep down dust and prevent mold.
1. Contractor shall verify that construction exhaust to exterior is not reintroduced to the medical center through intake vents, or building openings. HEPA filtration is required where the exhaust dust may reenter the medical center.
 2. Exhaust hoses shall be exhausted so that dust is not reintroduced to the medical center.
 3. Adhesive Walk-off/Carpet Walk-off Mats shall be used at all interior transitions from the construction area to occupied medical center area. These mats shall be changed as often as required to maintain clean work areas directly outside construction area at all times.
 4. Vacuum and wet mop all transition areas from construction to the occupied medical center at the end of each workday. Vacuum shall utilize HEPA filtration. Maintain surrounding area frequently. Remove debris as it is created. Transport these outside the construction area in containers with tightly fitting lids.
 5. The contractor shall not haul debris through patient-care areas without prior approval of the Resident Engineer and the Medical Center. When, approved, debris shall be hauled in enclosed dust proof containers or wrapped in plastic and sealed with duct tape. No sharp objects should be allowed to cut through the plastic. Wipe down the exterior of the containers with a damp rag to remove dust. All equipment, tools, material, etc. transported through occupied

areas shall be made free from dust and moisture by vacuuming and wipe down.

6. There shall be no standing water during construction. This includes water in equipment drip pans and open containers within the construction areas. All accidental spills must be cleaned up and dried within 12 hours. Remove and dispose of porous materials that remain damp for more than 72 hours.
7. At completion, remove construction barriers and ceiling protection carefully, outside of normal work hours. Vacuum and clean all surfaces free of dust after the removal.
8. All ceiling tiles shall be reinstalled at the end of each day in occupied areas. Damaged ceiling tiles shall be replaced by the end of each work week in occupied areas.

I. Final Cleanup:

1. Upon completion of project, or as work progresses, remove all construction debris from above ceiling, vertical shafts and utility chases that have been part of the construction.
2. Perform HEPA vacuum cleaning of all surfaces in the construction area. This includes walls, ceilings, cabinets, furniture (built-in or free standing), partitions, flooring, etc.
3. All new air ducts shall be cleaned prior to final inspection.

J. Exterior Construction

1. Contractor shall verify that dust will not be introduced into the medical center through intake vents, or building openings. HEPA filtration on intake vents is required where dust may be introduced.
2. Dust created from disturbance of soil such as from vehicle movement will be wetted with use of a water truck as necessary
3. All cutting, drilling, grinding, sanding, or disturbance of materials shall be accomplished with tools equipped with either local exhaust ventilation (i.e. vacuum systems) or wet suppression controls.

1.13 TUBERCULOSIS SCREENING

- A. Contractor shall provide written certification that all contract employees assigned to the work site have had a pre-placement tuberculin

screening within 90 days prior to assignment to the worksite and been found have negative TB screening reactions. Contractors shall be required to show documentation of negative TB screening reactions for any additional workers who are added after the 90-day requirement before they will be allowed to work on the work site. NOTE: This can be the Center for Disease Control (CDC) and Prevention and two-step skin testing or a Food and Drug Administration (FDA)-approved blood test.

1. Contract employees manifesting positive screening reactions to the tuberculin shall be examined according to current CDC guidelines prior to working on VHA property.
2. Subsequently, if the employee is found without evidence of active (infectious) pulmonary TB, a statement documenting examination by a physician shall be on file with the employer (construction contractor), noting that the employee with a positive tuberculin screening test is without evidence of active (infectious) pulmonary TB.
3. If the employee is found with evidence of active (infectious) pulmonary TB, the employee shall require treatment with a subsequent statement to the fact on file with the employer before being allowed to return to work on VHA property.

1.14 FIRE SAFETY

- A. Fire Safety Plan: Establish and maintain a site-specific fire protection program in accordance with 29 CFR 1926. Prior to start of work, prepare a plan detailing project-specific fire safety measures, including periodic status reports, and submit to COR for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES. This plan may be an element of the Accident Prevention Plan.
- B. Site and Building Access: Maintain free and unobstructed access to facility emergency services and for fire, police and other emergency response forces in accordance with NFPA 241.
- C. Separate temporary facilities, such as trailers, storage sheds, and dumpsters, from existing buildings and new construction by distances in

accordance with NFPA 241. For small facilities with less than 6 m (20 ft.) exposing overall length, separate by 3m (10 ft.).

D. Temporary Construction Partitions:

1. Install and maintain temporary construction partitions to provide smoke-tight separations between construction areas and adjoining areas. Construct partitions of gypsum board or treated plywood (flame spread rating of 25 or less in accordance with ASTM E84) on both sides of fire retardant treated wood or metal steel studs. Extend the partitions through suspended ceilings to floor slab deck or roof. Seal joints and penetrations. At door openings, install Class C, $\frac{3}{4}$ hour fire/smoke rated doors with self-closing devices.
2. Install temporary construction partitions as shown on drawings to maintain integrity of existing exit stair enclosures, exit passageways, fire-rated enclosures of hazardous areas, horizontal exits, smoke barriers, vertical shafts and openings enclosures.
3. Close openings in smoke barriers and fire-rated construction to maintain fire ratings. Seal penetrations with listed through-penetration firestop materials in accordance with Section 07 84 00, FIRESTOPPING.

E. Temporary Heating and Electrical: Install, use and maintain installations in accordance with 29 CFR 1926, NFPA 241 and NFPA 70.

F. Means of Egress: Do not block exiting for occupied buildings, including paths from exits to roads. Minimize disruptions and coordinate with COR.

G. Egress Routes for Construction Workers: Maintain free and unobstructed egress. Inspect daily. Report findings and corrective actions weekly to the COR.

H. Fire Extinguishers: Provide and maintain extinguishers in construction areas and temporary storage areas in accordance with 29 CFR 1926, NFPA 241 and NFPA 10.

I. Flammable and Combustible Liquids: Store, dispense and use liquids in accordance with 29 CFR 1926, NFPA 241 and NFPA 30.

L. Testing and results of any tests performed shall be recorded by the medical center and copies provided to the COR.

- M. Smoke Detectors: Prevent accidental operation. Remove temporary covers at end of work operations each day. Coordinate with the COR.
- N. Hot Work: Perform and safeguard hot work operations in accordance with NFPA 241 and NFPA 51B. Coordinate with COR.
- O. Fire Hazard Prevention and Safety Inspections: Inspect entire construction areas weekly. Coordinate with, and report findings and corrective actions weekly to the COR.
- P. Smoking: Smoking is prohibited in and adjacent to construction areas inside existing buildings and additions under construction. In separate and detached buildings under construction, smoking is prohibited except in designated smoking rest areas.
- Q. Dispose of waste and debris in accordance with NFPA 241. Remove from buildings daily.
- R. If required, submit documentation to the COR that personnel have been trained in the fire safety aspects of working in areas with impaired structural or compartmentalization features.

1.15 ELECTRICAL

- A. All electrical work shall comply with NFPA 70 (NEC), NFPA 70B, NFPA 70E, 29 CFR Part 1910 Subpart J - General Environmental Controls, 29 CFR Part 1910 Subpart S - Electrical, and 29 CFR 1926 Subpart K in addition to other references required by contract.
- B. All qualified persons performing electrical work under this contract shall be licensed journeyman or master electricians. All apprentice electricians performing under this contract shall be deemed unqualified persons unless they are working under the immediate supervision of a licensed electrician or master electrician.
- C. All electrical work will be accomplished de-energized and in the Electrically Safe Work Condition (refer to NFPA 70E for Work Involving Electrical Hazards, including Exemptions to Work Permit). Any Contractor, subcontractor or temporary worker who fails to fully comply with this requirement is subject to immediate termination in accordance with FAR clause 52.236-5(c). Only in rare circumstance where achieving an electrically safe work condition prior to beginning work would

increase or cause additional hazards, or is infeasible due to equipment design or operational limitations is energized work permitted. The COR with approval of the Medical Center Director will make the determination if the circumstances would meet the exception outlined above. An AHA and permit specific to energized work activities will be developed, reviewed, and accepted by the VA prior to the start of that activity.

1. Development of a Hazardous Electrical Energy Control Procedure is required prior to de-energization. A single Simple Lockout/Tagout Procedure for multiple work operations can only be used for work involving qualified person(s) de-energizing one set of conductors or circuit part source. Task specific Complex Lockout/Tagout Procedures are required at all other times.
 2. Verification of the absence of voltage after de-energization and lockout/tagout is considered "energized electrical work" (live work) under NFPA 70E, and shall only be performed by qualified persons wearing appropriate shock protective (voltage rated) gloves and arc rate personal protective clothing and equipment, using Underwriters Laboratories (UL) tested and appropriately rated contact electrical testing instruments or equipment appropriate for the environment in which they will be used.
 3. Personal Protective Equipment (PPE) and electrical testing instruments will be readily available for inspection by the COR.
- D. Before beginning any electrical work, an Activity Hazard Analysis (AHA) will be conducted to include Shock Hazard and Arc Flash Hazard analyses (NFPA Tables can be used only as a last alternative and it is strongly suggested a full Arc Flash Hazard Analyses be conducted). Work shall not begin until the AHA for the work activity and permit for energized work has been reviewed and accepted by the COR and discussed with all engaged in the activity, including the Contractor, subcontractor(s), and Government on-site representatives at preparatory and initial control phase meetings.
- E. Ground-fault circuit interrupters. GFCI protection shall be provided where an employee is operating or using cord- and plug-connected tools related to construction activity supplied by 125-volt, 15-, 20-, or 30-ampere circuits. Where employees operate or use equipment supplied by

greater than 125-volt, 15-, 20-, or 30- ampere circuits, GFCI protection or an assured equipment grounding conductor program shall be implemented in accordance with NFPA 70E - 2015, Chapter 1, Article 110.4(C) (2)..

1.16 FALL PROTECTION

- A. The fall protection (FP) threshold height requirement is 6 ft (1.8 m) for ALL WORK, unless specified differently or the OSHA 29 CFR 1926 requirements are more stringent, to include steel erection activities, systems-engineered activities (prefabricated) metal buildings, residential (wood) construction and scaffolding work.
 - 1. The use of a Safety Monitoring System (SMS) as a fall protection method is prohibited.
 - 2. The use of Controlled Access Zone (CAZ) as a fall protection method is prohibited.
 - 3. A Warning Line System (WLS) may ONLY be used on floors or flat or low-sloped roofs (between 0 - 18.4 degrees or 4:12 slope) and shall be erected around all sides of the work area (See 29 CFR 1926.502(f) for construction of WLS requirements). Working within the WLS does not require FP. No worker shall be allowed in the area between the roof or floor edge and the WLS without FP. FP is required when working outside the WLS.
 - 4. Fall protection while using a ladder will be governed by the OSHA requirements.

1.17 SCAFFOLDS AND OTHER WORK PLATFORMS

- A. All scaffolds and other work platforms construction activities shall comply with 29 CFR 1926 Subpart L.
- B. The fall protection (FP) threshold height requirement is 6 ft. (1.8 m) as stated in Section 1.16.
- C. The following hierarchy and prohibitions shall be followed in selecting appropriate work platforms.
 - 1. Scaffolds, platforms, or temporary floors shall be provided for all work except that can be performed safely from the ground or similar footing.
 - 2. Ladders less than 20 ft. may be used as work platforms only when use of small hand tools or handling of light material is involved.

3. Ladder jacks, lean-to, and prop-scaffolds are prohibited.
 4. Emergency descent devices shall not be used as working platforms.
- D. Contractors shall use a scaffold tagging system in which all scaffolds are tagged by the Competent Person. Tags shall be color-coded: green indicates the scaffold has been inspected and is safe to use; red indicates the scaffold is unsafe to use. Tags shall be readily visible, made of materials that will withstand the environment in which they are used, be legible and shall include:
1. The Competent Person's name and signature;
 2. Dates of initial and last inspections.
- E. Mast Climbing work platforms: When access ladders, including masts designed as ladders, exceed 20 ft. (6 m) in height, positive fall protection shall be used.

1.18 EXCAVATION AND TRENCHES

- A. All excavation and trenching work shall comply with 29 CFR 1926 Subpart P. Excavations less than 5 ft. in depth require evaluation by the contractor's "Competent Person" (CP) for determination of the necessity of an excavation protective system where kneeling, laying in, or stooping within the excavation is required.
- B. All excavations and trenches 24 inches in depth or greater shall require a written trenching and excavation permit (NOTE - some States and other local jurisdictions require separate state/jurisdiction-issued excavation permits). The permit shall have two sections, one section will be completed prior to digging or drilling and the other will be completed prior to personnel entering the excavations greater than 5 ft. in depth. Each section of the permit shall be provided to the COR prior to proceeding with digging or drilling and prior to proceeding with entering the excavation. After completion of the work and prior to opening a new section of an excavation, the permit shall be closed out and provided to the COR. The permit shall be maintained onsite and the first section of the permit shall include the following:
1. Estimated start time & stop time
 2. Specific location and nature of the work.

3. Indication of the contractor's "Competent Person" (CP) in excavation safety with qualifications and signature. Formal course in excavation safety is required by the contractor's CP.
4. Indication of whether soil or concrete removal to an offsite location is necessary.
5. Indication of whether soil samples are required to determine soil contamination.
6. Indication of coordination with local authority (i.e. "One Call") or contractor's effort to determine utility location with search and survey equipment.
7. Indication of review of site drawings for proximity of utilities to digging/drilling.

The second section of the permit for excavations greater than 5 ft. in depth shall include the following:

1. Determination of OSHA classification of soil. Soil samples will be from freshly dug soil with samples taken from different soil type layers as necessary and placed at a safe distance from the excavation by the excavating equipment. A pocket penetrometer will be utilized in determination of the unconfined compression strength of the soil for comparison against OSHA table (Less than 0.5 Tons/FT² - Type C, 0.5 Tons/FT² to 1.5 Tons/FT² - Type B, greater than 1.5 Tons/FT² - Type A without condition to reduce to Type B).
2. Indication of selected protective system (sloping/benching, shoring, shielding). When soil classification is identified as "Type A" or "Solid Rock", only shoring or shielding or Professional Engineer designed systems can be used for protection. A Sloping/Benching system may only be used when classifying the soil as Type B or Type C. Refer to Appendix B of 29 CFR 1926, Subpart P for further information on protective systems designs.
3. Indication of the spoil pile being stored at least 2 ft. from the edge of the excavation and safe access being provided within 25 ft. of the workers.
4. Indication of assessment for a potential toxic, explosive, or oxygen deficient atmosphere where oxygen deficiency (atmospheres containing less than 19.5 percent oxygen) or a hazardous atmosphere exists or could reasonably be expected to exist. Internal combustion engine equipment is not allowed in an excavation without providing force

- air ventilation to lower the concentration to below OSHA PELs, providing sufficient oxygen levels, and atmospheric testing as necessary to ensure safe levels are maintained.
- C. As required by OSHA 29 CFR 1926.651(b)(1), the estimated location of utility installations, such as sewer, telephone, fuel, electric, water lines, or any other underground installations that reasonably may be expected to be encountered during excavation work, shall be determined prior to opening an excavation.
1. The planned dig site will be outlined/marked in white prior to locating the utilities.
 2. Used of the American Public Works Association Uniform Color Code is required for the marking of the proposed excavation and located utilities.
 3. 811 will be called two business days before digging on all local or State lands and public Right-of Ways.
 4. Digging will not commence until all known utilities are marked.
 5. Utility markings will be maintained
- D. Excavations will be hand dug or excavated by other similar safe and acceptable means as excavation operations approach within 3 to 5 ft. of identified underground utilities. Exploratory bar or other detection equipment will be utilized as necessary to further identify the location of underground utilities.
- E. Excavations greater than 20 ft. in depth require a Professional Engineer designed excavation protective system.

1.19 CRANES

- A. All crane work shall comply with 29 CFR 1926 Subpart CC.
- B. Prior to operating a crane, the operator must be licensed, qualified or certified to operate the crane. Thus, all the provisions contained with Subpart CC are effective and there is no "Phase In" date.
- C. A detailed lift plan for all lifts shall be submitted to the COR 14 days prior to the scheduled lift complete with route for truck carrying load, crane load analysis, siting of crane and path of swing and all other elements of a critical lift plan where the lift meets the definition of a critical lift. Critical lifts require a more

comprehensive lift plan to minimize the potential of crane failure and/or catastrophic loss. The plan must be reviewed and accepted by the General Contractor before being submitted to the VA for review. The lift will not be allowed to proceed without prior acceptance of this document.

- D. Crane operators shall not carry loads
 - 1. over the general public or VAMC personnel
 - 2. over any occupied building unless
 - a. the top two floors are vacated
 - b. or overhead protection with a design live load of 300 psf. is provided

1.20 CONTROL OF HAZARDOUS ENERGY (LOCKOUT/TAGOUT)

- A. All installation, maintenance, and servicing of equipment or machinery shall comply with 29 CFR 1910.147 except for specifically referenced operations in 29 CFR 1926 such as concrete & masonry equipment [1926.702(j)], heavy machinery & equipment [1926.600(a)(3)(i)], and process safety management of highly hazardous chemicals (1926.64). Control of hazardous electrical energy during the installation, maintenance, or servicing of electrical equipment shall comply with Section 1.15 to include NFPA 70E and other VA specific requirements discussed in the section.

1.21 CONFINED SPACE ENTRY

- A. All confined space entry shall comply with 29 CFR 1926, Subpart AA except for specifically referenced operations in 29 CFR 1926 such as excavations/trenches [1926.651(g)].
- B. A site-specific Confined Space Entry Plan (including permitting process) shall be developed and submitted to the COR.

1.22 WELDING AND CUTTING

As specified in section 1.14, Hot Work: Perform and safeguard hot work operations in accordance with NFPA 241 and NFPA 51B. Coordinate with the COR. Obtain permits from COR at least 2 hours in advance.

1.23 LADDERS

- A. All Ladder use shall comply with 29 CFR 1926 Subpart X.

- B. All portable ladders shall be of sufficient length and shall be placed so that workers will not stretch or assume a hazardous position.
- C. Manufacturer safety labels shall be in place on ladders
- D. Step Ladders shall not be used in the closed position
- E. Top steps or cap of step ladders shall not be used as a step
- F. Portable ladders, used as temporary access, shall extend at least 3 ft. (0.9 m) above the upper landing surface.
 - 1. When a 3 ft. (0.9-m) extension is not possible, a grasping device (such as a grab rail) shall be provided to assist workers in mounting and dismounting the ladder.
 - 2. In no case shall the length of the ladder be such that ladder deflection under a load would, by itself, cause the ladder to slip from its support.
- G. Ladders shall be inspected for visible defects on a daily basis and after any occurrence that could affect their safe use. Broken or damaged ladders shall be immediately tagged "DO NOT USE," or with similar wording, and withdrawn from service until restored to a condition meeting their original design.

1.24 FLOOR & WALL OPENINGS

- A. All floor and wall openings shall comply with 29 CFR 1926 Subpart M.
- B. Floor and roof holes/openings are any that measure over 2 in (51 mm) in any direction of a walking/working surface which persons may trip or fall into or where objects may fall to the level below. Skylights located in floors or roofs are considered floor or roof hole/openings.
- C. All floor, roof openings or hole into which a person can accidentally walk or fall through shall be guarded either by a railing system with toeboards along all exposed sides or a load-bearing cover. When the cover is not in place, the opening or hole shall be protected by a removable guardrail system or shall be attended when the guarding system has been removed, or other fall protection system.

1. Covers shall be capable of supporting, without failure, at least twice the weight of the worker, equipment and material combined.
2. Covers shall be secured when installed, clearly marked with the word "HOLE", "COVER" or "Danger, Roof Opening-Do Not Remove" or color-coded or equivalent methods (e.g., red or orange "X"). Workers must be made aware of the meaning for color coding and equivalent methods.
3. Roofing material, such as roofing membrane, insulation or felts, covering or partly covering openings or holes, shall be immediately cut out. No hole or opening shall be left unattended unless covered.
4. Non-load-bearing skylights shall be guarded by a load-bearing skylight screen, cover, or railing system along all exposed sides.
5. Workers are prohibited from standing/walking on skylights.

- - - E N D - - -

**SECTION 01 42 19
REFERENCE STANDARDS**

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the availability and source of references and standards specified in the project manual under paragraphs APPLICABLE PUBLICATIONS and/or shown on the drawings.

1.2 AVAILABILITY OF SPECIFICATIONS LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS FPMR PART 101-29 (FAR 52.211-1) (AUG 1998)

- A. The GSA Index of Federal Specifications, Standards and Commercial Item Descriptions, FPMR Part 101-29 and copies of specifications, standards, and commercial item descriptions cited in the solicitation may be obtained for a fee by submitting a request to - GSA Federal Supply Service, Specifications Section, Suite 8100, 470 East L'Enfant Plaza, SW, Washington, DC 20407, Telephone (202) 619-8925, Facsimile (202) 619-8978.
- B. If the General Services Administration, Department of Agriculture, or Department of Veterans Affairs issued this solicitation, a single copy of specifications, standards, and commercial item descriptions cited in this solicitation may be obtained free of charge by submitting a request to the addressee in paragraph (a) of this provision. Additional copies will be issued for a fee.

1.3 AVAILABILITY FOR EXAMINATION OF SPECIFICATIONS NOT LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS (FAR 52.211-4) (JUN 1988)

The specifications and standards cited in this solicitation can be examined at the following location:

DEPARTMENT OF VETERANS AFFAIRS
Office of Construction & Facilities Management
Facilities Quality Service (00CFM1A)
425 Eye Street N.W, (sixth floor)
Washington, DC 20001
Telephone Numbers: (202) 632-5249 or (202) 632-5178
Between 9:00 AM - 3:00 PM

1.4 AVAILABILITY OF SPECIFICATIONS NOT LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS (FAR 52.211-3) (JUN 1988)

The specifications cited in this solicitation may be obtained from the associations or organizations listed below.

- AA Aluminum Association Inc.
<http://www.aluminum.org>
- AABC Associated Air Balance Council
<http://www.aabchq.com>
- AAMA American Architectural Manufacturer's Association
<http://www.aamanet.org>
- AAN American Nursery and Landscape Association
<http://www.anla.org>
- AASHTO American Association of State Highway and Transportation
Officials
<http://www.aashto.org>
- AATCC American Association of Textile Chemists and Colorists
<http://www.aatcc.org>
- ACGIH American Conference of Governmental Industrial Hygienists
<http://www.acgih.org>
- ACI American Concrete Institute
<http://www.aci-int.net>
- ACPA American Concrete Pipe Association
<http://www.concrete-pipe.org>
- ACPPA American Concrete Pressure Pipe Association
<http://www.acppa.org>
- ADC Air Diffusion Council
<http://flexibleduct.org>

AGA American Gas Association
<http://www.aga.org>

AGC Associated General Contractors of America
<http://www.agc.org>

AGMA American Gear Manufacturers Association, Inc.
<http://www.agma.org>

AHAM Association of Home Appliance Manufacturers
<http://www.aham.org>

AIA American Institute of Architects
<http://www.aia.org>

AISC American Institute of Steel Construction
<http://www.aisc.org>

AISI American Iron and Steel Institute
<http://www.steel.org>

AITC American Institute of Timber Construction
<http://www.aitc-glulam.org>

AMCA Air Movement and Control Association, Inc.
<http://www.amca.org>

ANLA American Nursery & Landscape Association
<http://www.anla.org>

ANSI American National Standards Institute, Inc.
<http://www.ansi.org>

APA The Engineered Wood Association
<http://www.apawood.org>

ARI Air-Conditioning and Refrigeration Institute
<http://www.ari.org>

ASAE American Society of Agricultural Engineers
<http://www.asae.org>

ASCE American Society of Civil Engineers
<http://www.asce.org>

ASHRAE	American Society of Heating, Refrigerating, and Air-Conditioning Engineers http://www.ashrae.org
ASME	American Society of Mechanical Engineers http://www.asme.org
ASSE	American Society of Sanitary Engineering http://www.asse-plumbing.org
ASTM	American Society for Testing and Materials http://www.astm.org
AWI	Architectural Woodwork Institute http://www.awinet.org
AWS	American Welding Society http://www.aws.org
AWWA	American Water Works Association http://www.awwa.org
BHMA	Builders Hardware Manufacturers Association http://www.buildershardware.com
BIA	Brick Institute of America http://www.bia.org
CAGI	Compressed Air and Gas Institute http://www.cagi.org
CGA	Compressed Gas Association, Inc. http://www.cganet.com
CI	The Chlorine Institute, Inc. http://www.chlorineinstitute.org
CISCA	Ceilings and Interior Systems Construction Association http://www.cisca.org
CISPI	Cast Iron Soil Pipe Institute http://www.cispi.org

CLFMI Chain Link Fence Manufacturers Institute
<http://www.chainlinkinfo.org>

CPMB Concrete Plant Manufacturers Bureau
<http://www.cpm.org>

CRA California Redwood Association
<http://www.calredwood.org>

CRSI Concrete Reinforcing Steel Institute
<http://www.crsi.org>

CTI Cooling Technology Institute
<http://www.cti.org>

DHI Door and Hardware Institute
<http://www.dhi.org>

EGSA Electrical Generating Systems Association
<http://www.egsa.org>

EEI Edison Electric Institute
<http://www.eei.org>

EPA Environmental Protection Agency
<http://www.epa.gov>

ETL ETL Testing Laboratories, Inc.
<http://www.etl.com>

FAA Federal Aviation Administration
<http://www.faa.gov>

FCC Federal Communications Commission
<http://www.fcc.gov>

FPS The Forest Products Society
<http://www.forestprod.org>

GANA Glass Association of North America
<http://www.cssinfo.com/info/gana.html/>

FM Factory Mutual Insurance
<http://www.fmglobal.com>

GA Gypsum Association
<http://www.gypsum.org>

GSA General Services Administration
<http://www.gsa.gov>

HI Hydraulic Institute
<http://www.pumps.org>

HPVA Hardwood Plywood & Veneer Association
<http://www.hpva.org>

ICBO International Conference of Building Officials
<http://www.icbo.org>

ICEA Insulated Cable Engineers Association Inc.
<http://www.icea.net>

\ICAC Institute of Clean Air Companies
<http://www.icac.com>

IEEE Institute of Electrical and Electronics Engineers
<http://www.ieee.org>

IMSA International Municipal Signal Association
<http://www.imsasafety.org>

IPCEA Insulated Power Cable Engineers Association

NBMA Metal Buildings Manufacturers Association
<http://www.mbma.com>

MSS Manufacturers Standardization Society of the Valve and Fittings Industry Inc.
<http://www.mss-hq.com>

NAAMM National Association of Architectural Metal Manufacturers
<http://www.naamm.org>

NAPHCC Plumbing-Heating-Cooling Contractors Association
<http://www.phccweb.org>

NBS National Bureau of Standards
See - NIST

NBBPVI National Board of Boiler and Pressure Vessel Inspectors
<http://www.nationboard.org>

NEC National Electric Code
See - NFPA National Fire Protection Association

NEMA National Electrical Manufacturers Association
<http://www.nema.org>

NFPA National Fire Protection Association
<http://www.nfpa.org>

NHLA National Hardwood Lumber Association
<http://www.natlhardwood.org>

NIH National Institute of Health
<http://www.nih.gov>

NIST National Institute of Standards and Technology
<http://www.nist.gov>

NLMA Northeastern Lumber Manufacturers Association, Inc.
<http://www.nelma.org>

NPA National Particleboard Association
18928 Premiere Court
Gaithersburg, MD 20879
(301) 670-0604

NSF National Sanitation Foundation
<http://www.nsf.org>

NWWDA Window and Door Manufacturers Association
<http://www.nwwda.org>

OSHA Occupational Safety and Health Administration
Department of Labor
<http://www.osha.gov>

PCA Portland Cement Association
<http://www.portcement.org>

PCI Precast Prestressed Concrete Institute
<http://www.pci.org>

PPI The Plastic Pipe Institute
<http://www.plasticpipe.org>

PEI Porcelain Enamel Institute, Inc.
<http://www.porcelainenamel.com>

PTI Post-Tensioning Institute
<http://www.post-tensioning.org>

RFCI The Resilient Floor Covering Institute
<http://www.rfci.com>

RIS Redwood Inspection Service
See - CRA

RMA Rubber Manufacturers Association, Inc.
<http://www.rma.org>

SCMA Southern Cypress Manufacturers Association
<http://www.cypressinfo.org>

SDI Steel Door Institute
<http://www.steeldoor.org>

SOI Secretary of the Interior
http://www.cr.nps.gov/local-law/arch_stnds_8_2.htm

IGMA Insulating Glass Manufacturers Alliance
<http://www.igmaonline.org>

SJI Steel Joist Institute
<http://www.steeljoist.org>

SMACNA Sheet Metal and Air-Conditioning Contractors
National Association, Inc.
<http://www.smacna.org>

SSPC The Society for Protective Coatings
<http://www.sspc.org>

STI Steel Tank Institute
<http://www.steeltank.com>

SWI Steel Window Institute
<http://www.steelwindows.com>

TCA Tile Council of America, Inc.
<http://www.tileusa.com>

TEMA Tubular Exchange Manufacturers Association
<http://www.tema.org>

TPI Truss Plate Institute, Inc.
583 D'Onofrio Drive; Suite 200
Madison, WI 53719
(608) 833-5900

UBC The Uniform Building Code
See ICBO

UL Underwriters' Laboratories Incorporated
<http://www.ul.com>

ULC Underwriters' Laboratories of Canada
<http://www.ulc.ca>

WCLIB West Coast Lumber Inspection Bureau
6980 SW Varns Road, P.O. Box 23145
Portland, OR 97223
(503) 639-0651

WRCLA Western Red Cedar Lumber Association
P.O. Box 120786
New Brighton, MN 55112
(612) 633-4334

WWPA Western Wood Products Association
<http://www.wwpa.org>

- - - E N D - - -

SECTION 01 74 19
CONSTRUCTION WASTE MANAGEMENT

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the requirements for the management of non-hazardous building construction and demolition waste.
- B. Waste disposal in landfills shall be minimized to the greatest extent possible. Of the inevitable waste that is generated, as much of the waste material as economically feasible shall be salvaged, recycled or reused.
- C. Contractor shall use all reasonable means to divert construction and demolition waste from landfills and incinerators, and facilitate their salvage and recycle not limited to the following:
 - 1. Waste Management Plan development and implementation.
 - 2. Techniques to minimize waste generation.
 - 3. Sorting and separating of waste materials.
 - 4. Salvage of existing materials and items for reuse or resale.
 - 5. Recycling of materials that cannot be reused or sold.
- D. At a minimum the following waste categories shall be diverted from landfills:
 - 1. Soil.
 - 2. Inerts (eg, concrete, masonry and asphalt).
 - 3. Clean dimensional wood and palette wood.
 - 4. Green waste (biodegradable landscaping materials).
 - 5. Engineered wood products (plywood, particle board and I-joists, etc).
 - 6. Metal products (eg, steel, wire, beverage containers, copper, etc).
 - 7. Cardboard, paper and packaging.
 - 8. Bitumen roofing materials.
 - 9. Plastics (eg, ABS, PVC).
 - 10. Carpet and/or pad.
 - 11. Gypsum board.
 - 12. Insulation.
 - 13. Paint.
 - 14. Fluorescent lamps.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.

1.3 QUALITY ASSURANCE

- A. Contractor shall practice efficient waste management when sizing, cutting and installing building products. Processes shall be employed to ensure the generation of as little waste as possible. Construction /Demolition waste includes products of the following:
1. Excess or unusable construction materials.
 2. Packaging used for construction products.
 3. Poor planning and/or layout.
 4. Construction error.
 5. Over ordering.
 6. Weather damage.
 7. Contamination.
 8. Mishandling.
 9. Breakage.
- B. Establish and maintain the management of non-hazardous building construction and demolition waste set forth herein. Conduct a site assessment to estimate the types of materials that will be generated by demolition and construction.
- C. Contractor shall develop and implement procedures to recycle construction and demolition waste to a minimum of 50 percent.
- D. Contractor shall be responsible for implementation of any special programs involving rebates or similar incentives related to recycling. Any revenues or savings obtained from salvage or recycling shall accrue to the contractor.
- E. Contractor shall provide all demolition, removal and legal disposal of materials. Contractor shall ensure that facilities used for recycling, reuse and disposal shall be permitted for the intended use to the extent required by local, state, federal regulations. The Whole Building Design Guide website <http://www.wbdg.org/tools/cwm.php> provides a Construction Waste Management Database that contains information on companies that haul, collect, and process recyclable debris from construction projects.
- F. Contractor shall assign a specific area to facilitate separation of materials for reuse, salvage, recycling, and return. Such areas are to be kept neat and clean and clearly marked in order to avoid contamination or mixing of materials.

- G. Contractor shall provide on-site instructions and supervision of separation, handling, salvaging, recycling, reuse and return methods to be used by all parties during waste generating stages.
- H. Record on daily reports any problems in complying with laws, regulations and ordinances with corrective action taken.

1.4 TERMINOLOGY

- A. Class III Landfill: A landfill that accepts non-hazardous resources such as household, commercial and industrial waste resulting from construction, remodeling, repair and demolition operations.
- B. Clean: Untreated and unpainted; uncontaminated with adhesives, oils, solvents, mastics and like products.
- C. Construction and Demolition Waste: Includes all non-hazardous resources resulting from construction, remodeling, alterations, repair and demolition operations.
- D. Dismantle: The process of parting out a building in such a way as to preserve the usefulness of its materials and components.
- E. Disposal: Acceptance of solid wastes at a legally operating facility for the purpose of land filling (includes Class III landfills and inert fills).
- F. Inert Backfill Site: A location, other than inert fill or other disposal facility, to which inert materials are taken for the purpose of filling an excavation, shoring or other soil engineering operation.
- G. Inert Fill: A facility that can legally accept inert waste, such as asphalt and concrete exclusively for the purpose of disposal.
- H. Inert Solids/Inert Waste: Non-liquid solid resources including, but not limited to, soil and concrete that does not contain hazardous waste or soluble pollutants at concentrations in excess of water-quality objectives established by a regional water board, and does not contain significant quantities of decomposable solid resources.
- I. Mixed Debris: Loads that include commingled recyclable and non-recyclable materials generated at the construction site.
- J. Mixed Debris Recycling Facility: A solid resource processing facility that accepts loads of mixed construction and demolition debris for the purpose of recovering re-usable and recyclable materials and disposing non-recyclable materials.

- K. Permitted Waste Hauler: A company that holds a valid permit to collect and transport solid wastes from individuals or businesses for the purpose of recycling or disposal.
- L. Recycling: The process of sorting, cleansing, treating, and reconstituting materials for the purpose of using the altered form in the manufacture of a new product. Recycling does not include burning, incinerating or thermally destroying solid waste.
1. On-site Recycling - Materials that are sorted and processed on site for use in an altered state in the work, i.e. concrete crushed for use as a sub-base in paving.
 2. Off-site Recycling - Materials hauled to a location and used in an altered form in the manufacture of new products.
- M. Recycling Facility: An operation that can legally accept materials for the purpose of processing the materials into an altered form for the manufacture of new products. Depending on the types of materials accepted and operating procedures, a recycling facility may or may not be required to have a solid waste facilities permit or be regulated by the local enforcement agency.
- N. Reuse: Materials that are recovered for use in the same form, on-site or off-site.
- O. Return: To give back reusable items or unused products to vendors for credit.
- P. Salvage: To remove waste materials from the site for resale or re-use by a third party.
- Q. Source-Separated Materials: Materials that are sorted by type at the site for the purpose of reuse and recycling.
- R. Solid Waste: Materials that have been designated as non-recyclable and are discarded for the purposes of disposal.
- S. Transfer Station: A facility that can legally accept solid waste for the purpose of temporarily storing the materials for re-loading onto other trucks and transporting them to a landfill for disposal, or recovering some materials for re-use or recycling.

1.5 SUBMITTALS

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES, furnish the following:

- B. Prepare and submit to the Resident Engineer a written demolition debris management plan. The plan shall include, but not be limited to, the following information:
1. Procedures to be used for debris management.
 2. Techniques to be used to minimize waste generation.
 3. Analysis of the estimated job site waste to be generated:
 - a. List of each material and quantity to be salvaged, reused, recycled.
 - b. List of each material and quantity proposed to be taken to a landfill.
 4. Detailed description of the Means/Methods to be used for material handling.
 - a. On site: Material separation, storage, protection where applicable.
 - b. Off site: Transportation means and destination. Include list of materials.
 - 1) Description of materials to be site-separated and self-hauled to designated facilities.
 - 2) Description of mixed materials to be collected by designated waste haulers and removed from the site.
 - c. The names and locations of mixed debris reuse and recycling facilities or sites.
 - d. The names and locations of trash disposal landfill facilities or sites.
 - e. Documentation that the facilities or sites are approved to receive the materials.
- C. Designated Manager responsible for instructing personnel, supervising, documenting and administer over meetings relevant to the Waste Management Plan.
- D. Monthly summary of construction and demolition debris diversion and disposal, quantifying all materials generated at the work site and disposed of or diverted from disposal through recycling.

1.6 APPLICABLE PUBLICATIONS

- A Publications listed below form a part of this specification to the extent referenced. Publications are referenced by the basic designation only. In the event that criteria requirements conflict, the most stringent requirements shall be met.

B. U.S. Green Building Council (USGBC):

LEED Green Building Rating System for New Construction

1.7 RECORDS

Maintain records to document the quantity of waste generated; the quantity of waste diverted through sale, reuse, or recycling; and the quantity of waste disposed by landfill or incineration. Records shall be kept in accordance with the LEED Reference Guide and LEED Template.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. List of each material and quantity to be salvaged, recycled, reused.
- B. List of each material and quantity proposed to be taken to a landfill.
- C. Material tracking data: Receiving parties, dates removed, transportation costs, weight tickets, tipping fees, manifests, invoices, net total costs or savings.

PART 3 - EXECUTION

3.1 COLLECTION

- A. Provide all necessary containers, bins and storage areas to facilitate effective waste management.
- B. Clearly identify containers, bins and storage areas so that recyclable materials are separated from trash and can be transported to respective recycling facility for processing.
- C. Hazardous wastes shall be separated, stored, disposed of according to local, state, federal regulations.

3.2 DISPOSAL

- A. Contractor shall be responsible for transporting and disposing of materials that cannot be delivered to a source-separated or mixed materials recycling facility to a transfer station or disposal facility that can accept the materials in accordance with state and federal regulations.
- B. Construction or demolition materials with no practical reuse or that cannot be salvaged or recycled shall be disposed of at a landfill or incinerator.

3.3 REPORT

- A. With each application for progress payment, submit a summary of construction and demolition debris diversion and disposal including beginning and ending dates of period covered.

- B. Quantify all materials diverted from landfill disposal through salvage or recycling during the period with the receiving parties, dates removed, transportation costs, weight tickets, manifests, invoices. Include the net total costs or savings for each salvaged or recycled material.
- C. Quantify all materials disposed of during the period with the receiving parties, dates removed, transportation costs, weight tickets, tipping fees, manifests, invoices. Include the net total costs for each disposal.

- - - E N D - - -

SECTION 07 84 00
FIRESTOPPING

PART 1 - GENERAL

1.01 RELATED DOCUMENTS

- A. Drawings and general provisions of Contract, including General and Supplementary Conditions and Division-1 Specification Section, apply to work specified in this section.

1.02 DEFINITIONS

- A. Firestopping: Material or combination of materials used to retain integrity of fire-rated construction by maintaining an effective barrier against the spread of flame, smoke, and hot gases through penetrations in, or construction joints between, fire rated wall and floor assemblies.

1.03 GENERAL DESCRIPTION OF THE WORK OF THIS SECTION

Only tested firestop systems shall be used in specific locations as follows:

- A. Penetrations for the passage of duct, cable, cable tray, conduit, piping, electrical busways and raceways through fire-rated vertical barriers (walls and partitions), horizontal barriers (floor/ceiling assemblies), and vertical service shaft walls and partitions.
- C. Openings between structurally separate sections of wall or floors.
- D. Gaps between the top of walls and ceilings or roof assemblies.
- E. Expansion joints in walls and floors.
- F. Openings and penetrations in fire-rated partitions or walls containing fire doors.
- G. Openings around structural members which penetrate floors or walls.

1.04 RELATED WORK OF OTHER SECTIONS

- A. Coordinate work of this section with work of other sections as required to properly execute the work and as necessary to maintain satisfactory progress of the work of other sections, including:
 - 1. Section 21 00 00 - Fire Suppression
 - 2. Section 26 00 00 - Electrical

1.05 REFERENCES

- A. Test Requirements: ASTM E 814, "Standard Method of Fire Tests of Through Penetration Fire Stops"
- B. Test Requirements: UL 1479, "Fire Tests of Through-Penetration Firestops"

- C. Test Requirements: UL 2079, "Tests for Fire Resistance of Building Joint Systems"
- D. Underwriters Laboratories (UL) of Northbrook, IL publishes tested systems in their "FIRE RESISTANCE DIRECTORY" that is updated annually.
 - 1. UL Fire Resistance Directory:
 - a. Firestop Devices (XHJI)
 - b. Fire Resistance Ratings (BXRH)
 - c. Through-Penetration Firestop Systems (XHEZ)
 - d. Fill, Voids, or Cavity Material (XHHW)
 - e. Forming Materials (XHKU)
 - f. Joint Systems (XHBN)
 - g. Perimeter Fire Containment Systems (XHDG)
 - 2. Alternate Systems: "Omega Point Laboratories Directory" (updated annually).
- E. Test Requirements: ASTM E 1966, "Standard Test Method for Fire Resistive Joint Systems"
- F. Test Requirements: ASTM E 2307, "Standard Test Method for Determining Fire Resistance of Perimeter Fire Barrier Systems Using Intermediate-Scale, Multi-story Test Apparatus"
- G. Inspection Requirements: ASTM E 2174, "Standard Practice for On-site Inspection of Installed Fire Stops"
- H. ASTM E 84, "Standard Test Method for Surface Burning Characteristics of Building Materials"
- I. ASTM D6904, "Standard Practice for Resistance to Wind Driven Rain for Exterior Coatings Applied on Masonry"
- J. ASTM C 679, "Standard Test Method for Tack-Free Time of Elastomeric Sealants"
- K. International Firestop Council Guidelines for Evaluating Firestop Systems Engineering Judgments
- L. International Building Code
- M. NFPA 101 - Life Safety Code
- N. NFPA 70 - National Electric Code

1.06 QUALITY ASSURANCE

- A. Fire-Test-Response Characteristics: Provide through-penetration fire stop systems and fire-resistive joint systems that comply with specified requirements of tested systems.
- B. Firestop System installation must meet requirements of ASTM E 814, UL 1479 or UL 2079 tested assemblies that provide a fire rating equal to that of construction being penetrated.
- C. Proposed fire stop materials and methods shall conform to applicable governing codes having local jurisdiction.

- D. Firestop Systems do not reestablish the structural integrity of load bearing partitions/assemblies, or support live loads and traffic. Installer shall consult the structural engineer prior to penetrating any load bearing assembly.
- E. For those firestop applications that exist for which no qualified tested system is available through a manufacturer, an engineering judgment derived from similar qualified tested system designs or other tests will be submitted to local authorities having jurisdiction for their review and approval prior to installation. Engineering judgment documents must follow requirements set forth by the International Firestop Council.

1.07 SUBMITTALS

- A. Submit Product Data: Manufacturer's specifications and technical data for each material including the composition and limitations, documentation of qualified tested firestop systems to be used and manufacturer's installation instructions to comply with Section 01 30 00.
- B. Manufacturer's engineering judgment identification number and document details when no qualified tested system is available for an application. Engineering judgment must include both project name and contractor's name who will install firestop system as described in document.
- C. Submit safety data sheets provided with product delivered to job-site.

1.08 INSTALLER QUALIFICATIONS

- A. Engage an experienced Installer who is certified, licensed, or otherwise qualified by the firestopping manufacturer as having been provided the necessary training to install manufacturer's products per specified requirements. A supplier's willingness to sell its firestopping products to the Contractor or to an Installer engaged by the Contractor does not in itself confer qualification on the buyer.
- B. The work is to be installed by a contractor with at least one of the following qualifications:

Hilti Accredited Fire Stop Specialty Contractor
- C. The installer must have no less than 3 years of experience with fire stop installation.

1.09 DELIVERY, STORAGE, AND HANDLING

- A. Deliver materials undamaged in manufacturer's clearly labeled, unopened containers, identified with brand, type, and UL label where applicable.

- B. Coordinate delivery of materials with scheduled installation date to allow minimum storage time at job-site.
- C. Store materials under cover and protect from weather and damage in compliance with manufacturer's requirements, including temperature restrictions.
- D. Comply with recommended procedures, precautions or remedies described in material safety data sheets as applicable.
- E. Do not use damaged or expired materials.

1.10 PROJECT CONDITIONS

- A. Do not use materials that contain flammable solvents.
- B. Schedule installation of firestopping after completion of penetrating item installation but prior to covering or concealing of openings.
- C. Verify existing conditions and substrates before starting work. Correct unsatisfactory conditions before proceeding.
- D. Weather conditions: Do not proceed with installation of firestop materials when temperatures exceed the manufacturer's recommended limitations for installation printed on product label and product data sheet.
- E. During installation, provide masking and drop cloths to prevent firestopping materials from contaminating any adjacent surfaces.

PART 2 - PRODUCTS

2.01 PERFORMANCE REQUIREMENTS

- A. Provide firestopping composed of components that are compatible with each other, the substrates forming openings, and the items, if any, penetrating the firestopping under conditions of service and application, as demonstrated by the firestopping manufacturer based on testing and field experience.
- B. Provide components for each firestopping system that are needed to install fill material. Use only components specified by the firestopping manufacturer and approved by the qualified testing agency for the designated fire-resistance-rated systems.
- C. Provide a round fire-rated cable management device whenever cables penetrate fire rated walls, where frequent cable changes and additions may occur. The fire-rated cable management device shall consist of a corrugated steel tube with zinc coating, contain an inner plastic housing, intumescent material rings, and inner fabric smoke seal membrane. The length of the sleeve shall be 12.4 inches. The fire-rated cable management device shall contain integrated intumescent firestop wrap strip materials sufficient to maintain the hourly rating of the barrier being penetrated. The fire-rated cable management device shall contain a smoke seal fabric membrane or intumescent firestop plugs sufficient to achieve the L-Rating requirements of the barrier type. Install device per the manufacturer's published installation instructions.

- D. Penetrations in Fire Resistance Rated Walls: Provide firestopping with ratings determined in accordance with UL 1479 or ASTM E 814.
 - 1. F-Rating: Not less than the fire-resistance rating of the wall construction being penetrated.
- E. Penetrations in Horizontal Assemblies: Provide firestopping with ratings determined in accordance with UL 1479 or ASTM E 814.
 - 1. F-Rating: Minimum of 1-hour rating, but not less than the fire-resistance rating of the floor construction being penetrated.
 - 2. T-Rating: when penetrant is located outside of a wall cavity, minimum of 1-hour rating, but not less than the fire-resistance rating of the floor construction being penetrated.
 - 3. W-Rating: Class 1 rating in accordance with water leakage test per UL 1479.
- F. Penetrations in Smoke Barriers: Provide firestopping with ratings determined in accordance with UL 1479 or ASTM E 814.
 - 1. L-Rating: Not exceeding 5.0 cfm/sq. ft. of penetration opening at both ambient and elevated temperatures.
- G. Mold Resistance: Provide penetration firestopping with mold and mildew resistance rating of one (1) or less as tested per ASTM G21.
- H. Rain and water resistance: provide perimeter joint sealant tested in accordance with ASTM D 6904 with less than 1 hour tack free time as tested in accordance with ASTM C 679.
- I. Firestopping Materials are either "cast-in-place" (integral with concrete placement) or "post installed." Provide cast-in-place firestop devices prior to concrete placement.

2.02 ACCEPTABLE MANUFACTURERS

- A. Subject to compliance with through penetration firestop systems (XHEZ), joint systems (XHBN), and perimeter firestop systems (XH DG) listed in Volume 2 of the UL Fire Resistance Directory; provide products of the following manufacturers as identified below:
 - 1. **Basis of Design:**
Hilti, Inc., Plano, Texas
800-879-8000
www.us.hilti.com
 - 2. Substitution requests shall be considered in accordance with contract provisions.

2.03 MATERIALS

- A. Use only firestop products that have been UL 1479, ASTM E 814 or UL 2079 tested for specific fire-rated construction conditions conforming to construction assembly type, penetrating item type, annular space requirements, and fire-rating involved for each separate instance.

- B. Pre-formed firestop devices for use with noncombustible and combustible pipes (closed and open systems), conduit, and/or cable bundles penetrating concrete floors the following products are acceptable:
1. Hilti Cast-In Place Firestop Device (CP 680-P)
 - a. Add Aerator Adaptor when used in conjunction with aerator system.
 2. Hilti Cast-In Place Firestop Device (CP 680-M) for use with noncombustible penetrants.
 3. Hilti Tub Box Kit (CP 681) for use with tub installations.
 4. Hilti Firestop Speed Sleeve (CP 653) for use with cable penetrations.
 5. Hilti Firestop Drop-In Device (CFS-DID) for use with noncombustible and combustible penetrants.
 6. Hilti Firestop Block (CFS-BL)
 7. Hilti Closet Stub (CFS-CID CS)
- C. Sealants, caulking materials, or foams for use with non-combustible items including steel pipe, copper pipe, rigid steel conduit and electrical metallic tubing (EMT), the following products are acceptable:
1. Hilti Intumescent Firestop Sealant (FS-ONE MAX)
 2. Hilti Fire Foam (CP 620)
 3. Hilti Flexible Firestop Sealant (CP 606)
 4. Hilti Firestop Silicone Sealant Gun Grade (CFS-S SIL GG)
 5. Hilti Firestop Silicone Sealant Self Leveling (CFS-S SIL SL)
- D. Sealants or caulking materials for use with sheet metal ducts, the following products are acceptable:
1. Hilti Silicone Sealant Gun Grade (CFS-S SIL GG)
 2. Hilti Firestop Silicone Sealant Self Leveling (CFS-S SIL SL)
 3. Hilti Flexible Firestop Sealant (CP 606)
 4. Hilti Intumescent Firestop Sealant (FS-ONE MAX)
- E. Sealants, sprays, or pre-formed materials for use with fire-rated construction joints and other gaps, the following products are acceptable:
1. Hilti Firestop Top Track Seal (CFS-TTS)
 2. Hilti Firestop Joint Spray (CFS-SP WB)
 3. Hilti Firestop Silicone Joint Spray (CFS-SP SIL)
 4. Hilti Flexible Firestop Sealant (CP 606)
 5. Hilti Firestop Silicone Sealant Gun Grade (CFS-S SIL GG)
 6. Hilti Firestop Silicone Sealant Self Leveling (CFS-S SIL SL)
 7. Hilti Bottom-of-Wall Sealant (CP 605)
- F. Pre-formed mineral wool designed to fit flutes of metal profile deck and gap between top of wall and metal profile deck; as a backer for spray material.
1. Hilti Speed Plugs (CP 777)
 2. Hilti Speed Strips (CP 767)
- G. Intumescent sealants, caulking materials for use with combustible items (penetrants consumed by high heat and flame) including insulated metal pipe, PVC jacketed, flexible cable or cable bundles and plastic pipe, the following products are acceptable:

1. Hilti Intumescent Firestop Sealant (FS-ONE MAX)
- H. Foams, intumescent sealants, or caulking materials for use with flexible cable or cable bundles, the following products are acceptable:
1. Hilti Intumescent Firestop Sealant (FS-ONE MAX)
 2. Hilti Fire Foam (CP 620)
 3. Hilti Flexible Firestop Sealant (CP 606)
 4. Hilti Firestop Silicone Sealant Gun Grade (CFS-S SIL GG)
 5. Hilti Firestop Silicone Sealant Self Leveling (CFS-S SIL SL)
- I. Non-curing, re-penetrable intumescent putty or foam materials for use with flexible cable or cable bundles, the following products are acceptable:
1. Hilti Firestop Putty Stick (CP 618)
 2. Hilti Firestop Plug (CFS-PL)
- J. Wall opening protective materials for use with U.L. listed metallic and specified nonmetallic outlet boxes, the following products are acceptable:
1. Hilti Firestop Putty Pad (CFS-P PA)
 2. Hilti Firestop Putty Pad (CP 617)
 3. Hilti Firestop Box Insert
- K. Firestop collar or wrap devices attached to assembly around combustible plastic pipe (closed and open piping systems), the following products are acceptable:
1. Hilti Firestop Collar (CP 643N)
 2. Hilti Firestop Collar (CP 644)
 3. Hilti Wrap Strips (CP 648-E/648-S)
- L. Materials used for large openings and complex penetrations made to accommodate cable trays and bundles, multiple steel and copper pipes, electrical busways in raceways, the following products are acceptable:
1. Hilti Firestop Block (CFS-BL)
 2. Hilti Composite Sheet (CFS-COS)
 3. Hilti Firestop Mortar (CP 637)
 4. Hilti Fire Foam (CP 620)
 5. Hilti Firestop Board (CP 675T)
- M. Non curing, re-penetrable materials used for large size/complex penetrations made to accommodate cable trays and bundles, multiple steel and copper pipes, electrical busways in raceways, the following products are acceptable:
1. Hilti Firestop Block (CFS-BL)
 2. Hilti Firestop Board (CP 675T)
- N. Re-penetrable, round cable management devices for use with new or existing cable bundles penetrating gypsum or masonry walls, the following products are acceptable:

1. Hilti Firestop Speed Sleeve (CP 653) with integrated smoke seal fabric membrane.
 2. Hilti Firestop Cable Collar (CFS-CC)
 3. Hilti Firestop Sleeve (CFS-SL SK)
 4. Hilti Retrofit Sleeve (CFS-SL RK) for use with existing cable bundles.
 5. Hilti Gangplate (CFS-SL GP) for use with multiple cable management devices.
 6. Hilti Gangplate Cap (CFS-SL GP CAP) for use at blank openings in gangplate for future penetrations.
- O. Sealants or caulking materials used for openings between structurally separate sections of wall and floors, the following products are acceptable:
1. Hilti Firestop Joint Spray (CFS-SP WB)
 2. Hilti Flexible Firestop Sealant (CP 606)
 3. Hilti Firestop Silicone Sealant Gun Grade (CFS-S SIL GG)
 4. Hilti Firestop Silicone Sealant Self Leveling (CFS-S SIL SL)
- P. For blank openings made in fire-rated wall or floor assemblies, where future penetration of pipes, conduits, or cables is expected, the following products are acceptable:
1. Hilti Firestop Block (CFS-BL)
 2. Hilti Firestop Plug (CFS-PL)
- Q. For single or cable bundles up to one inch diameter penetrating gypsum, masonry, concrete walls or wood floor assemblies the following product is acceptable:
1. Hilti Firestop Cable Disc (CFS-D)

PART 3 - EXECUTION

3.01 PREPARATION

- A. Verification of Conditions: Examine areas and conditions under which work is to be performed and identify conditions detrimental to proper or timely completion.
1. Verify penetrations are properly sized and in suitable condition for application of materials.
 2. Surfaces to which firestop materials will be applied shall be free of dirt, grease, oil, rust, laitance, release agents, water repellents, and any other substances that may affect proper adhesion.
 3. Provide masking and temporary covering to prevent soiling of adjacent surfaces by firestopping materials.
 4. Comply with manufacturer's recommendations for temperature and humidity conditions before, during and after installation of firestopping.
 5. Do not proceed until unsatisfactory conditions have been corrected.

3.02 COORDINATION

- A. Coordinate construction of openings, penetrations and construction joints to ensure that the fire stop systems are installed according to specified requirements.
- B. Coordinate sizing of sleeves, openings, core-drilled holes, or cut openings to accommodate through-penetration fire stop systems. Coordinate construction and sizing of joints to ensure that fire-resistive joint systems are installed according to specified requirements.
- C. Coordinate fire stopping with other trades so that obstructions are not placed in the way prior to the installation of the fire stop systems.
- D. Do not cover up through-penetration fire stop and joint system installations that will become concealed behind other construction until each installation has been examined by the building inspector.

3.03 INSTALLATION

- A. Regulatory Requirements: Install firestop materials in accordance with UL Fire Resistance Directory or Omega Point Laboratories Directory.
- B. Manufacturer's Instructions: Comply with manufacturer's instructions for installation of through-penetration and construction joint materials.
 - 1. Seal all holes or voids made by penetrations to ensure an air and water resistant seal.
 - 2. Consult with mechanical engineer, project manager, and damper manufacturer prior to installation of UL firestop systems that might hamper the performance of fire dampers as it pertains to duct work.
 - 3. Protect materials from damage on surfaces subjected to traffic.

3.04 FIELD QUALITY CONTROL

- A. Examine sealed penetration areas to ensure proper installation before concealing or enclosing areas.
- B. Keep areas of work accessible until inspection by applicable code authorities.
- C. Inspection of through-penetration firestopping shall be performed in accordance with ASTM E 2174, "Standard Practice for On-Site Inspection of Installed Fire Stops" or other recognized standard.
- D. Perform under this section patching and repairing of firestopping caused by cutting or penetrating of existing firestop systems already installed by other trades.
- E. Manufacturer's Field Services: Contractor to ensure a manufacturer's direct representative is on-site during initial installation of firestop systems to train appropriate contractor personnel in proper selection and installation procedures. Training will be done per manufacturer's written recommendations published in their literature and drawing details. During

installation, contractor shall have manufacturer's representative provide periodic visual observations and written documentation of the results. Contact Hilti for support at 800.879.8000.

3.05 IDENTIFICATION & DOCUMENTATION

A. The firestop contractor is to supply documentation for each single application addressed. This documentation is to identify each penetration and joint location on the entire project.

A.1 The Documentation Form for through penetrations is to include:

1. A Sequential Location Number
2. The Project Name
3. Date of Installation
4. Detailed Description of the Penetration's Location
5. Tested System or Engineered Judgment Number
6. Type of Assembly Penetrated
7. A Detailed Description of the Size and Type of Penetrating Item
8. Size of Opening
9. Number of Sides of Assemblies Addressed
10. Hourly Rating to be Achieved
11. Installer's Name

A.2 The Documentation Form for Construction Joints is to include:

1. A Sequential Location Number
2. The Project Name
3. Date of Installation
4. Detailed Description of the Construction Joint's Location
5. Tested System or Engineered Judgment Number
6. Type of Construction Joint
7. The Width of the Joint
8. The Lineal Footage of the Joint
9. Number of Sides Addressed
10. Hourly Rating to be Achieved
11. Installer's Name

B. Copies of these documents are to be provided to the general contractor at the completion of the project.

C. Identify through-penetration firestop systems with pressure-sensitive, self-adhesive, preprinted vinyl labels. Attach labels permanently to surfaces of penetrated construction on both sides of each firestop system installation where labels will be visible to anyone seeking to remove penetrating items or firestop systems. Include the following information on labels:

1. The words: "Warning: Through Penetration Firestop System - Do Not Disturb. Notify Building Management of Any Damage."
2. Contractor's name, address and phone number.
3. Through-penetration firestop system designation of applicable testing and inspecting agency.
4. Date of installation.
5. Through-penetration firestop system manufacturer's name.
6. Installer's name.

D. A firestop documentation manager software shall be used to document, track, and

maintain the passive firestop systems throughout the construction and maintenance phase of the facility. The software solution shall be used to track and document every firestop system installed on the project and each subsequent addition, change, or removal of the firestop system. The firestop documentation shall be managed with a cloud-based software which allows the installer to use a standard smartphone or tablet device (either iOS, Android or Windows capable) to capture the relevant information for the installation. The following data shall be tracked for each penetration within the facility: product installed, system installed, date of installation, location of the penetration including a notation on the 2D plan image, F-rating, name of installer, photo (pre-installation and post-installation), and inspection status. The Owner and/ or Construction Manager may designate additional items to be tracked. The firestop documentation manager software must perform the following basic functions:

1. Create multiple projects/ facilities, add/create/ remove users for each project, upload documents including UL systems, 2D floor plans, product data, engineering judgments, etc.
2. Define data to track using pre-defined input fields or creating custom input fields as desired.
3. Capture multiple photos for each penetration, including a pre-installation and post-installation photo.
4. Scan QR Code on Hilti identification label to link the program data to a specific penetration location.
5. Annotate (mark) location of penetration on 2D floor plan.
6. Create reports by filtering data and utilizing report templates.
7. Online/ offline (for use in areas where data service is unavailable) synchronization of data between mobile device, online application and cloud-based system.
8. Ability to transfer ownership of projects from one customer to another from construction phase to facility maintenance.

Permanently attach Hilti identification labels to surfaces adjacent to and within 6 inches (150 mm) of firestopping edge so labels will be visible to anyone seeking to remove or change penetrating items or firestopping. Labels shall have a unique QR code for each penetration which can be scanned by the firestop documentation software to quickly identify the penetration attributes.

Acceptable Software: Hilti CFS-DM, from Hilti Inc., Plano, TX. Tel (800) 879-8000 or Hilti (Canada) Corporation, Mississauga, Ontario (800) 363-4458 website: www.us.hilti.com or www.hilti.ca.com

1. Substitutions: Not permitted.
2. Single Source: Obtain firestop documentation manager software and firestop systems for each type of penetration

and construction condition indicated only from a single manufacturer.

3.06 ADJUSTING AND CLEANING

- A. Remove equipment, materials and debris, leaving area in undamaged, clean condition.
- B. Clean all surfaces adjacent to sealed holes and joints to be free of excess firestop materials and soiling as work progresses.

3.07 LABOR USE TO INSTALL FIRESTOP SYSTEMS

- A. If firestopping is not assigned to a single-source firestop specialty contractor, the installation of each scope of work is to be performed jurisdictionally correct per existing trade agreements.

3.08 SCHEDULE OF COMMON FIRESTOP SYSTEMS

Schedule of joint firestop systems. Basis of design: Hilti, Inc.

Joint Type	F-Rating (Hr)	Hilti Basis of Design UL System	
		Joint Width Less than or Equal to 2"	Joint Width Greater than 2" Less than or Equal to 6" ⁴
Concrete (Floor to Floor)	1	FF-D-1012, FF-D-1013 ¹	FF-D-1012, FF-D-1013
	2	FF-D-1012, FF-D-1013 ¹	FF-D-1012, FF-D-1013
	3	FF-D-1011, FF-D-1026 ¹	FF-D-1011, FF-D-1026
	4	FF-D-1047	FF-D-1125
Concrete (Edge of Floor Slab to Wall)	1	FW-D-1011, FW-D-1012, FW-D-1013	FW-D-1011, FW-D-1012, FW-D-1013, FW-D-1021
	2	FW-D-1011, FW-D-1012, FW-D-1013	FW-D-1011, FW-D-1012, FW-D-1013, FW-D-1021
	3	FW-D-1011	FW-D-1011, FW-D-1021
	4	FW-D-1047	FW-D-1092
Concrete or Block Wall to Flat Concrete Floor (Top-of-Wall)	1	N/A**	N/A**
	2	HW-D-0097 ¹	HW-D-1009
	3	HW-D-1008 ¹ , HW-D 0268	HW-D-1008
	4	HW-D-1042	HW-D-1103
Concrete or Block Wall to Concrete Over Fluted Metal Deck (Top-of-Wall)	1	HW-D-0098	N/A**
	2	HW-D-0080, HW-D-0081, HW-D-0098	HW-D-1037
	3	N/A**	N/A**
	4	HW-D-0294	N/A**
Gypsum Wall to Flat Concrete Floor (Top-of-Wall)	1	HW-D-0757, HW-D-0082, HW-D-0083, HW-D-0106, HW-D-0119	HW-D-1011, HW-D-1012, HW-1020
	2	HW-D-0757, HW-D-0082, HW-D-0083, HW-D-0106, HW-D-0119	HW-D-1011, HW-D-1012, HW-1020
	3	HW-D-0119	HW-D-1011, HW-D-1012, HW-1020
Gypsum Shaft Wall to (Top-of-Wall)	2	HW-D-0342 (FLAT CONCRETE) HW-D-0541, HW-D-0542 (CONCRETE OVER METAL DECK)	N/A**
Gypsum Shaft Wall to Concrete Floor (Bottom-of-Wall)	1	BW-S-0023	N/A**
	2	BW-S-0023	N/A**
Gypsum Wall to Concrete Floor (Bottom-of-Wall)	1	BW-S-0001, BW-S-0002, BW-S-0039	N/A**
	2	BW-S-0001, BW-S-0002, BW-S-0039	N/A**
Gypsum Wall to Concrete Over Fluted Metal Deck (Top-of-Wall)	1	HW-D-0042*, HW-D-0049*, HW-D-0087*, HW-D-0089*, HW-D-0045, HW-D-0046*, HW-D-0076*, HW-D-0077*, HW-D-0154, HW-D-0184*, HW-D-0292, HW-D-0295, HW-D-538*	HWD-1011, HWD-1012, HW-1020
	2	HW-D-0042*, HW-D-0049*, HW-D-0087*, HW-D-0089*, HW-D-0045, HW-D-0046*, HW-D-0076*, HW-D-0077*, HW-D-0154, HW-D-0184*, HW-D-292, HW-D-0295, HW-D0538*	HW-D-1011, HW-D-1012, HW-D-1020
	3	HW-D-0292, HW-D-0295	HWD-1011, HWD-1012, HW-1020
	4	HW-D-0292, HW-D-0295	N/A**
Concrete (Wall to Wall)	2	WW-D-0017, WW-D-0082	WW-D-1080, WW-D-1084
	3	WW-D-1011 ¹ , WW-D-0032	WW-D-1011
	4	WW-D-1047	WW-D-1128
Gypsum to Concrete (Wall to Wall)	1	WW-D-0040	N/A**
	2	WW-D-0040	N/A**

* SEE NOTE 3 ** CONTACT HILTI FOR CURRENT UL-CLASSIFIED SYSTEM OR ENGINEER JUDGMENT DRAWING: 800-879-8000

NOTES:

1. CLASSIFIED SYSTEMS FOR 2" - 6" WIDE JOINTS MAY BE USED FOR JOINTS 2" WIDE AND LESS.
2. CONFIRM THAT MOVEMENT CAPABILITIES OF THE SELECTED UL SYSTEM MEETS OR EXCEEDS THE SPECIFIED MOVEMENT RANGE OF THE PARTICULAR JOINT.
3. SYSTEMS MARKED WITH ASTERISK (*) ARE SUITABLE FOR TOP-OF-WALL JOINTS WHERE THE FLUTED METAL DECK HAS SPRAY-ON MONOKOTE MK-6/HY FIREPROOFING.
4. VERIFY ALLOWABLE JOINT WIDTH ON SPECIFIC UL SYSTEM DRAWING.

Schedule of through penetration firestop systems. Basis of design: Hilti, Inc.

CONCRETE FLOORS			CONCRETE OR BLOCK WALLS		
TYPE OF PENETRANT	F-RATING (HR)	BASIS OF DESIGN UL SYSTEM	TYPE OF PENETRANT	F-RATING (HR)	BASIS OF DESIGN UL SYSTEM
CIRCULAR BLANK OPENINGS	1	F-A-0006, C-AJ-0055, C-AJ-0090	CIRCULAR BLANK OPENINGS	1	C-AJ-0055, C-AJ-0090
	2	F-A-0006, C-AJ-0055, C-AJ-0090		2	C-AJ-0055, C-AJ-0090
	3	F-A-0006, C-AJ-0055, C-AJ-0086,		3	C-AJ-0055, C-AJ-0086
SINGLE METAL PIPES OR CONDUIT	1	C-AJ-1226, F-A-1028, F-A-1017	SINGLE METAL PIPES OR CONDUIT	1	C-AJ-1226, W-J-1067, W-J-1020
	2	C-AJ-1226, F-A-1028, F-A-1017		2	C-AJ-1226, W-J-1067, W-J-1020, W-J-1248
	3	C-AJ-1226, F-A-1017		3	C-AJ-1226, W-J-1041, W-J-1068
	4	C-BJ -1037, C-BJ-1034		4	C-BJ-1034, C-BJ-1037, W-J-1041, W-J-1042, W-J-1068
SINGLE NON-METALLIC PIPE OR CONDUIT (I.E. PVC, CPVC, ABS, FRP, ENT)	1	F-A-2053, F-A-2025, C-AJ-2109, C-AJ-2098, C-AJ-2271, C-AJ-2167,	SINGLE NON-METALLIC PIPE OR CONDUIT (I.E. PVC, CPVC, ABS, FRP, ENT)	1	C-AJ-2109, C-AJ-2098, C-AJ-2167, C-AJ-2371, C-AJ-2342
	2	C-AJ-2098, C-AJ-2271, C-AJ-2167, C-BJ-2021, C-AJ-2371, C-AJ-2342		2	C-AJ-2109, C-AJ-2098, C-AJ-2167, C-AJ-2371, C-AJ-2342
	3	F-A-2054, C-AJ-2109, C-AJ-2098, C-AJ-2371, C-AJ-2342		3	C-AJ-2109, C-AJ-2098, C-AJ-2371, C-AJ-2342
	4	C-BJ 2016, C-AJ-2017		4	W-J-2057, W-J-2091
SINGLE/CABLE BUNDLES	1	F-A-3007, C-AJ-3095, C-AJ-3180, C-AJ-3283	SINGLE/CABLE BUNDLES	1	W-J-3036, C-AJ-3095, C-AJ-3180, W-J-3060, W-J-3167
	2	F-A-3007, C-AJ-3095, C-AJ-3334, F-A-3060		2	W-J-3036, C-AJ-3095, C-AJ-3180, W-J-3060, W-J-3167, W-J-3189
	3	F-A-3007, C-AJ 3095, C-AJ-3285		3	C-AJ-3095, C-AJ-3180, W-J-3167
				4	W-J-3050
CABLE TRAY	1	C-AJ-4034, C-AJ-4035	CABLE TRAY	1	W-J-4027, C-AJ-4034, C-AJ-4035
	2	C-AJ-4034, C-AJ-4035		2	W-J-4027, C-AJ-4034, C-AJ-4035
	3	C-AJ-4034, C-AJ-4035		3	C-AJ-4034, C-AJ-4035
				4	W-J-8007
SINGLE INSULATED PIPES	1	F-A 5015, F-A 5017, C-AJ-5090, C-AJ-5091, C-AJ-5090, C-AJ-5048	SINGLE INSULATED PIPES	1	C-AJ-5090, C-AJ-5091, C-AJ 5061, W-J-5042
	2	F-A 5015, F-A 5017, C-AJ-5090, C-AJ-5091, C-AJ-5090		2	C-AJ-5090, C-AJ-5091, C-AJ-5061, W-J-5042
	3	F-A 5016, C-AJ-5090, F-A-5018		3	C-AJ-5090, C-AJ-5061
	4	C-BJ-5006		4	C-BJ-5006, W-J-5028
ELECTRICAL BUSWAY	1	C-AJ-6006, C-AJ-6017, F-A-6002, C-AJ-6036	ELECTRICAL BUSWAY	1	C-AJ-6006, C-AJ-6017, C-AJ-6036
	2	C-AJ-6006, C-AJ-6017, F-A 6042, C-AJ-6036		2	C-AJ-6006, C-AJ-6017, C-AJ-6036
	3	C-AJ-6006, C-AJ-6017		3	C-AJ-6006, C-AJ-6017
MECHANICAL DUCTWORK WITHOUT DAMPERS NON-INSULATED	1	C-AJ-7046, C-AJ-7051, C-AJ-7084	MECHANICAL DUCTWORK WITHOUT DAMPERS NON-INSULATED	1	C-AJ-7046, C-AJ-7051, W-J-7021, W-J-7022
	2	C-AJ-7046, C-AJ-7051, C-AJ-7085		2	C-AJ-7046, C-AJ-7051, W-J-7021, W-J-7022
	3	C-AJ-7046, C-AJ-7051		3	C-AJ-7046, C-AJ-7051
MECHANICAL DUCTWORK WITHOUT DAMPERS INSULATED	N/A**	N/A**	MECHANICAL DUCTWORK WITHOUT DAMPERS INSULATED	1	W-J-7029, W-J-7124
MIXED PENETRANTS	1	C-AJ 8099, C-AJ-8056, C-AJ-8143	MIXED PENETRANTS	1	C-AJ 8099, C-AJ 8056, W-J 8007, C-AJ 8143
	2	C-AJ-8099, C-AJ-8056, C-AJ-8143		2	C-AJ 8099, C-AJ 8056, W-J 8007, C-AJ 8143
	3	C-AJ-8099, C-AJ-8056		3	C-AJ 8041, C-AJ 8056, W-J 8007, C-AJ 8099
	4	C-AJ-8095		4	C-AJ 8095, W-J 8007
WOOD FLOORS			GYPSUM WALLS		
TYPE OF PENETRANT	F-RATING (HR)	BASIS OF DESIGN UL SYSTEM	TYPE OF PENETRANT	F-RATING (HR)	BASIS OF DESIGN UL SYSTEM
METAL PIPES OR CONDUIT	1	F-C-1009, F-C-1059, F-C-1168	METAL PIPES OR CONDUIT	1	W-L-1054, W-L-1058, W-L-1164, W-L-1506
	2	F-C-1009, F-C-1059, F-C-1168		2	W-L-1054, W-L-1058, W-L-1164, W-L-1506
				4	W-L-1110, W-L-1111, W-L-1165
NON-METALLIC PIPE OR CONDUIT	1	F-C-2232, F-C-2030, F-C-2160, F-C-2389	NON-METALLIC PIPE OR CONDUIT	1	W-L-2078, W-L-2075, W-L-2128
	2	F-C-2029, F-C-2030, F-C-2128, F-C-2160		2	W-L-2078, W-L-2075, W-L-2128
				4	W-L-2184, W-L-2245
SINGLE OR BUNDLED CABLES	1	F-C-3012, F-C-3110, F-C-3044	SINGLE OR BUNDLED CABLES	1	W-L-3065, W-L-3111, W-L-3112, W-L-3334, W-L-3414, W-L-3396
	2	F-C-3012, F-C-3110		2	W-L-3065, W-L-3111, W-L-3112, W-L-3334, W-L-3414, W-L-3396
				3	W-L-3385, W-L-3277
		4		W-L-3139, W-L-3334	
INSULATED PIPES	1	F-C-5004, F-C-5037, F-C-5036	CABLE TRAY	1	W-L-4011, W-L-4019, W-L-4081
				2	W-L-4011, W-L-4019, W-L-4081
	2	F-C-5004, F-C-5037	INSULATED PIPES	4	W-L 8014
				1	W-L-5028, W-L-5029, W-L-5047
			2	W-L-5028, W-L-5029, W-L-5047	
			4	W-L-5073	
NON-INSULATED MECHANICAL DUCTWORK WITHOUT DAMPERS	1	F-C-7013	NON-INSULATED MECHANICAL DUCTWORK WITHOUT DAMPERS	1	W-L 7017, W-L-7040, W-L-7042, W-L-7155
			2	W-L-7040, W-L-7042, W-L-7155	
INSULATED MECHANICAL DUCTWORK WITHOUT DAMPERS	1	N/A**	INSULATED MECHANICAL DUCTWORK WITHOUT DAMPERS	1	W-L-7059, W-L-7153, W-L-7156, W-L-7151
	2	N/A**		2	W-L-7059, W-L-7153, W-L-7156, W-L-7151
MIXED PENETRANTS	1	F-C-8009, F-C-8014, F-C-826	MIXED PENETRANTS	1	W-L-1095, W-L-8013
				2	W-L-1095, W-L-8013
				4	W-L-8014

END OF SECTION

SECTION 09 91 00
PAINTING

PART 1 - GENERAL

1.1 DESCRIPTION:

- A. Work of this Section includes all labor, materials, equipment, and services necessary to complete the painting and finishing as shown on the construction documents and/or specified herein, including, but not limited to, the following:
1. Prime coats which may be applied in shop under other sections.
 2. Prime painting unprimed surfaces to be painted under this Section.
 3. Painting items furnished with a prime coat of paint, including touching up of or repairing of abraded, damaged or rusted prime coats applied by others.
 4. Painting ferrous metal (except stainless steel) exposed to view.
 5. Painting galvanized ferrous metals exposed to view.
 6. Painting interior concrete block exposed to view.
 7. Painting gypsum drywall exposed to view.
 8. Painting of wood exposed to view, except items which are specified to be painted or finished under other Sections of these specifications. Back painting of all wood in contact with concrete, masonry or other moisture areas.
 9. Painting pipes, pipe coverings, conduit, ducts, insulation, hangers, supports and other mechanical and electrical items and equipment exposed to view.
 10. Painting surfaces above, behind or below grilles, gratings, diffusers, louvers lighting fixtures, and the like, which are exposed to view through these items.
 11. Painting includes shellacs, stains, varnishes, coatings specified, and striping or markers and identity markings.

12. Incidental painting and touching up as required to produce proper finish for painted surfaces, including touching up of factory finished items.
13. Painting of any surface not specifically mentioned to be painted herein or on construction documents, but for which painting is obviously necessary to complete the job, or work which comes within the intent of these specifications, is to be included as though specified.

1.2 RELATED WORK:

- A. Activity Hazard Analysis: Section 01 35 26, SAFETY REQUIREMENTS.
- B. Shop prime painting of steel and ferrous metals; Division 21 - FIRE SUPPRESSION; Division 26 - ELECTRICAL; and Division 28 - ELECTRONIC SAFETY AND SECURITY sections.
- C. Prefinished flush doors with transparent finishes: Section 08 14 00, WOOD DOORS.

1.3 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Painter qualifications.
- D. Manufacturer's Literature and Data:
 1. Before work is started, or sample panels are prepared, submit manufacturer's literature and technical data, the current Master Painters Institute (MPI) "Approved Product List" indicating brand label, product name and product code as of the date of contract award, will be used to determine compliance with the submittal requirements of this specification. The Contractor may choose to use subsequent MPI "Approved Product List", however, only one (1) list may be used for the entire contract and each coating system is to be from a single manufacturer.

All coats on a particular substrate must be from a single manufacturer. No variation from the MPI "Approved Product List" where applicable is acceptable.
- G. Manufacturers' Certificates indicating compliance with specified requirements:

1. Manufacturer's paint substituted for Federal Specification paints meets or exceeds performance of paint specified.

1.4 DELIVERY AND STORAGE:

- A. Deliver materials to site in manufacturer's sealed container marked to show following:
 1. Name of manufacturer.
 2. Product type.
 3. Batch number.
 4. Instructions for use.
 5. Safety precautions.
- B. In addition to manufacturer's label, provide a label legibly printed as following:
 1. Federal Specification Number, where applicable, and name of material.
 2. Surface upon which material is to be applied.
 3. Specify Coat Types: Prime; body; finish; etc.
- C. Maintain space for storage, and handling of painting materials and equipment in a ventilated, neat and orderly condition to prevent spontaneous combustion from occurring or igniting adjacent items.
- D. Store materials at site at least 24 hours before using, at a temperature between 7 and 30 degrees C (45 and 85 degrees F).

1.5 QUALITY ASSURANCE:

- A. Qualification of Painters: Use only qualified journeyman painters for the mixing and application of paint on exposed surfaces. Submit evidence that key personnel have successfully performed surface preparation and application of coating on a minimum of three (3) similar projects within the past three (3) years.
- B. Paint Coordination: Provide finish coats which are compatible with the prime paints used. Review other Sections of these specifications in which prime paints are to be provided to ensure compatibility of the total coatings system for the various substrates. Upon request from other subcontractors, furnish information on the characteristics of the finish materials proposed to be used, to ensure that compatible prime coats are used. Provide barrier

coats over incompatible primers or remove and re-prime as required. Notify the Contracting Officer Representative (COR) in writing of any anticipated problems using the coating systems as specified with substrates primed by others.

1.6 MOCK-UP PANEL (NOT USED)

1.7 REGULATORY REQUIREMENTS:

A. Paint materials are to conform to the restrictions of the local Environmental and Toxic Control jurisdiction.

1. Volatile Organic Compounds (VOC) Emissions Requirements: Field-applied paints and coatings that are inside the waterproofing system to not exceed limits of authorities having jurisdiction.

2. Lead-Base Paint:

a. Comply with Section 410 of the Lead-Based Paint Poisoning Prevention Act, as amended, and with implementing regulations promulgated by Secretary of Housing and Urban Development.

b. Regulations concerning prohibition against use of lead-based paint in federal and federally assisted construction, or rehabilitation of residential structures are set forth in Subpart F, Title 24, Code of Federal Regulations, Department of Housing and Urban Development.

c. Do not use coatings having a lead content over 0.06 percent by weight of non-volatile content.

3. Asbestos: Provide materials that do not contain asbestos.

4. Chromate, Cadmium, Mercury, and Silica: Provide materials that do not contain zinc-chromate, strontium-chromate, Cadmium, mercury or mercury compounds or free crystalline silica.

5. Human Carcinogens: Provide materials that do not contain any of the ACGIH-BKLT and ACGHI-DOC confirmed or suspected human carcinogens.

6. Use high performance acrylic paints in place of alkyd paints.

1.8 SAFETY AND HEALTH

A. Apply paint materials using safety methods and equipment in accordance with the following:

1. Comply with applicable Federal, State, and local laws and regulations, and with the ACCIDENT PREVENTION PLAN, including the Activity Hazard

- Analysis (AHA) as specified in Section 01 35 26, SAFETY REQUIREMENTS. The AHA is to include analyses of the potential impact of painting operations on painting personnel and on others involved in and adjacent to the work zone.
- B. Safety Methods Used During Paint Application: Comply with the requirements of SSPC PA Guide 10.
- C. Toxic Materials: To protect personnel from overexposure to toxic materials, conform to the most stringent guidance of:
1. The applicable manufacturer's Material Safety Data Sheets (MSDS) or local regulation.
 2. 29 CFR 1910.1000.
 3. ACHIH-BKLT and ACGHI-DOC, threshold limit values.

1.9 APPLICABLE PUBLICATIONS:

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by basic designation only.
- B. American Conference of Governmental Industrial Hygienists (ACGIH):
- ACGIH TLV-BKLT-2012.....Threshold Limit Values (TLV) for Chemical Substances and Physical Agents and Biological Exposure Indices (BEIs)
- ACGIH TLV-DOC-2012.....Documentation of Threshold Limit Values and Biological Exposure Indices, (Seventh Edition)
- C. ASME International (ASME):
- A13.1-07(R2013).....Scheme for the Identification of Piping Systems
- D. Code of Federal Regulation (CFR):
- 40 CFR 59.....Determination of Volatile Matter Content, Water Content, Density Volume Solids, and Weight Solids of Surface Coating
- E. Commercial Item Description (CID):
- A-A-1272A.....Plaster Gypsum (Spackling Compound)
- F. Federal Specifications (Fed Spec):

TT-P-1411A.....Paint, Copolymer-Resin, Cementitious (For
Waterproofing Concrete and Masonry Walls) (CEP)

G. Master Painters Institute (MPI):

- 1.....Aluminum Paint
- 4.....Interior/ Exterior Latex Block Filler
- 5.....Exterior Alkyd Wood Primer
- 7.....Exterior Oil Wood Primer
- 8.....Exterior Alkyd, Flat MPI Gloss Level 1
- 9.....Exterior Alkyd Enamel MPI Gloss Level 6
- 10.....Exterior Latex, Flat
- 11.....Exterior Latex, Semi-Gloss
- 18.....Organic Zinc Rich Primer
- 22.....Aluminum Paint, High Heat (up to 590° - 1100F)
- 27.....Exterior / Interior Alkyd Floor Enamel, Gloss
- 31.....Polyurethane, Moisture Cured, Clear Gloss
- 36.....Knot Sealer
- 43.....Interior Satin Latex, MPI Gloss Level 4
- 44.....Interior Low Sheen Latex, MPI Gloss Level 2
- 45.....Interior Primer Sealer
- 46.....Interior Enamel Undercoat
- 47.....Interior Alkyd, Semi-Gloss, MPI Gloss Level 5
- 48.....Interior Alkyd, Gloss, MPI Gloss Level 6
- 50.....Interior Latex Primer Sealer
- 51.....Interior Alkyd, Eggshell, MPI Gloss Level 3
- 52.....Interior Latex, MPI Gloss Level 3
- 53.....Interior Latex, Flat, MPI Gloss Level 1
- 54.....Interior Latex, Semi-Gloss, MPI Gloss Level 5

- 59.....Interior/Exterior Alkyd Porch & Floor Enamel, Low Gloss
- 60.....Interior/Exterior Latex Porch & Floor Paint, Low Gloss
- 66.....Interior Alkyd Fire Retardant, Clear Top-Coat (ULC Approved)
- 67.....Interior Latex Fire Retardant, Top-Coat (ULC Approved)
- 68.....Interior/ Exterior Latex Porch & Floor Paint, Gloss
- 71.....Polyurethane, Moisture Cured, Clear, Flat
- 77.....Epoxy Cold Cured, Gloss
- 79.....Marine Alkyd Metal Primer
- 90.....Interior Wood Stain, Semi-Transparent
- 91.....Wood Filler Paste
- 94.....Exterior Alkyd, Semi-Gloss
- 95.....Fast Drying Metal Primer
- 98.....High Build Epoxy Coating
- 101.....Epoxy Anti-Corrosive Metal Primer
- 108.....High Build Epoxy Coating, Low Gloss
- 114.....Interior Latex, Gloss
- 119.....Exterior Latex, High Gloss (acrylic)
- 134.....Galvanized Water Based Primer
- 135.....Non-Cementitious Galvanized Primer
- 138.....Interior High Performance Latex, MPI Gloss Level 2
- 139.....Interior High Performance Latex, MPI Gloss Level 3
- 140.....Interior High Performance Latex, MPI Gloss Level 4
- 141.....Interior High Performance Latex (SG) MPI Gloss Level 5

163.....Exterior Water Based Semi-Gloss Light Industrial
Coating, MPI Gloss Level 5

G. Society for Protective Coatings (SSPC):

SSPC SP 1-82(R2004).....Solvent Cleaning

SSPC SP 2-82(R2004).....Hand Tool Cleaning

SSPC SP 3-28(R2004).....Power Tool Cleaning

SSPC SP 10/NACE No.2.....Near-White Blast Cleaning

SSPC PA Guide 10.....Guide to Safety and Health Requirements

H. Maple Flooring Manufacturer's Association (MFMA):

I. U.S. National Archives and Records Administration (NARA):

29 CFR 1910.1000.....Air Contaminants

J. Underwriter's Laboratory (UL)

PART 2 - PRODUCTS

2.1 MATERIALS:

A. Conform to the coating specifications and standards referenced in PART 3. Submit manufacturer's technical data sheets for specified coatings and solvents.

2.2 PAINT PROPERTIES:

A. Use ready-mixed (including colors), except two component epoxies, polyurethanes, polyesters, paints having metallic powders packaged separately and paints requiring specified additives.

B. Where no requirements are given in the referenced specifications for primers, use primers with pigment and vehicle, compatible with substrate and finish coats specified.

C. Provide undercoat paint produced by the same manufacturer as the finish coats. Use only thinners approved by the paint manufacturer, and use only to recommended limits.

D. VOC Content: For field applications that are inside the weatherproofing system, paints and coating to comply with VOC content limits of authorities having jurisdiction and the following VOC content limits:

1. Flat Paints and Coatings: 50 g/L.

2. Non-flat Paints and Coatings: 150 g/L.
3. Dry-Fog Coatings: 400 g/L.
4. Primers, Sealers, and Undercoaters: 200 g/L.
5. Anticorrosive and Antirust Paints applied to Ferrous Metals: 250 g/L.
6. Zinc-Rich Industrial Maintenance Primers: 340 g/L.
7. Pretreatment Wash Primers: 420 g/L.
8. Shellacs, Clear: 730 g/L.
9. Shellacs, Pigmented: 550 g/L.

E. VOC test method for paints and coatings is to be in accordance with 40 CFR 59 (EPA Method 24). Part 60, Appendix A with the exempt compounds' content determined by Method 303 (Determination of Exempt Compounds) in the South Coast Air Quality Management District's (SCAQMD) "Laboratory Methods of Analysis for Enforcement Samples" manual.

2.3 PLASTIC TAPE: (NOT USED)

PART 3 - EXECUTION

3.1 JOB CONDITIONS:

- A. Safety: Observe required safety regulations and manufacturer's warning and instructions for storage, handling and application of painting materials.
1. Take necessary precautions to protect personnel and property from hazards due to falls, injuries, toxic fumes, fire, explosion, or other harm.
 2. Deposit soiled cleaning rags and waste materials in metal containers approved for that purpose. Dispose of such items off the site at end of each day's work.
- B. Atmospheric and Surface Conditions:
1. Do not apply coating when air or substrate conditions are:
 - a. Less than 3 degrees C (5 degrees F) above dew point.
 - b. Below 10 degrees C (50 degrees F) or over 35 degrees C (95 degrees F), unless specifically pre-approved by the COR and the product manufacturer. Under no circumstances are application conditions to exceed manufacturer recommendations.

- c. When the relative humidity exceeds 85 percent; or to damp or wet surfaces; unless otherwise permitted by the paint manufacturer's printed instructions.
2. Maintain interior temperatures until paint dries hard.
3. Do no exterior painting when it is windy and dusty.
4. Do not paint in direct sunlight or on surfaces that the sun will warm.
5. Apply only on clean, dry and frost free surfaces except as follows:
 - a. Apply water thinned acrylic and cementitious paints to damp (not wet) surfaces only when allowed by manufacturer's printed instructions.
 - b. Concrete and masonry when permitted by manufacturer's recommendations, dampen surfaces to which water thinned acrylic and cementitious paints are applied with a fine mist of water on hot dry days to prevent excessive suction and to cool surface.
6. Varnishing:
 - a. Apply in clean areas and in still air.
 - b. Before varnishing vacuum and dust area.
 - c. Immediately before varnishing wipe down surfaces with a tack rag.

3.2 INSPECTION:

- A. Examine the areas and conditions where painting and finishing are to be applied and correct any conditions detrimental to the proper and timely completion of the work. Do not proceed with the work until unsatisfactory conditions are corrected to permit proper installation of the work.

3.3 GENERAL WORKMANSHIP REQUIREMENTS:

- A. Application may be by brush or roller. Spray application only upon acceptance from the COR in writing.
- B. Furnish to the COR a painting schedule indicating when the respective coats of paint for the various areas and surfaces will be completed. This schedule is to be kept current as the job progresses.
- C. Protect work at all times. Protect all adjacent work and materials by suitable covering or other method during progress of work. Upon completion of the work, remove all paint and varnish spots from floors, glass and other

surfaces. Remove from the premises all rubbish and accumulated materials of whatever nature not caused by others and leave work in a clean condition.

- D. Remove and protect hardware, accessories, device plates, lighting fixtures, and factory finished work, and similar items, or provide in place protection. Upon completion of each space, carefully replace all removed items by workmen skilled in the trades involved.
- E. When indicated to be painted, remove electrical panel box covers and doors before painting walls. Paint separately and re-install after all paint is dry.
- F. Materials are to be applied under adequate illumination, evenly spread and flowed on smoothly to avoid runs, sags, holidays, brush marks, air bubbles and excessive roller stipple.
- G. Apply materials with a coverage to hide substrate completely. When color, stain, dirt or undercoats show through final coat of paint, the surface is to be covered by additional coats until the paint film is of uniform finish, color, appearance and coverage, at no additional cost to the Government.
- H. All coats are to be dry to manufacturer's recommendations before applying succeeding coats.
- I. All suction spots or "hot spots" in plaster after the application of the first coat are to be touched up before applying the second coat.
- J. Do not apply paint behind frameless mirrors that use mastic for adhering to wall surface.

3.4 SURFACE PREPARATION:

A. General:

1. The Contractor shall be held wholly responsible for the finished appearance and satisfactory completion of painting work. Properly prepare all surfaces to receive paint, which includes cleaning, sanding, and touching-up of all prime coats applied under other Sections of the work. Broom clean all spaces before painting is started. All surfaces to be painted or finished are to be completely dry, clean and smooth.
2. See other sections of specifications for specified surface conditions and prime coat.

3. Perform preparation and cleaning procedures in strict accordance with the paint manufacturer's instructions and as herein specified, for each particular substrate condition.
 4. Clean surfaces before applying paint or surface treatments with materials and methods compatible with substrate and specified finish. Remove any residue remaining from cleaning agents used. Do not use solvents, acid, or steam on concrete and masonry. Schedule the cleaning and painting so that dust and other contaminants from the cleaning process will not fall in wet, newly painted surfaces.
 5. Maximum Moisture Content of Substrates: When measured with an electronic moisture meter as follows:
 - a. Concrete: 12 percent.
 - b. Fiber-Cement Board: 12 percent.
 - c. Masonry (Clay and CMU's): 12 percent.
 - d. Wood: 15 percent.
 - e. Gypsum Board: 12 percent.
 - f. Plaster: 12 percent.
- B. Wood:
1. Sand to a smooth even surface and then dust off.
 2. Sand surfaces showing raised grain smooth between each coat.
 3. Wipe surface with a tack rag prior to applying finish.
 4. Surface painted with an opaque finish:
 - a. Coat knots, sap and pitch streaks with MPI 36 (Knot Sealer) before applying paint.
 - b. Apply two coats of MPI 36 (Knot Sealer) over large knots.
 5. After application of prime or first coat of stain, fill cracks, nail and screw holes, depressions and similar defects with wood filler paste. Sand the surface to make smooth and finish flush with adjacent surface.

6. Before applying finish coat, reapply wood filler paste if required, and sand surface to remove surface blemishes. Finish flush with adjacent surfaces.
7. Fill open grained wood such as oak, walnut, ash and mahogany with MPI 91 (Wood Filler Paste), colored to match wood color.
 - a. Thin filler in accordance with manufacturer's instructions for application.
 - b. Remove excess filler, wipe as clean as possible, dry, and sand as specified.

C. Ferrous Metals:

1. Remove oil, grease, soil, drawing and cutting compounds, flux and other detrimental foreign matter in accordance with SSPC-SP 1 (Solvent Cleaning).
2. Remove loose mill scale, rust, and paint, by hand or power tool cleaning, as defined in SSPC-SP 2 (Hand Tool Cleaning) and SSPC-SP 3 (Power Tool Cleaning). Where high temperature aluminum paint is used, prepare surface in accordance with paint manufacturer's instructions.
3. Fill dents, holes and similar voids and depressions in flat exposed surfaces of hollow steel doors and frames, access panels, roll-up steel doors and similar items specified to have semi-gloss or gloss finish with TT-F-322D (Filler, Two-Component Type, For Dents, Small Holes and Blow-Holes). Finish flush with adjacent surfaces.
 - a. Fill flat head countersunk screws used for permanent anchors.
 - b. Do not fill screws of item intended for removal such as glazing beads.
4. Spot prime abraded and damaged areas in shop prime coat which expose bare metal with same type of paint used for prime coat. Feather edge of spot prime to produce smooth finish coat.
5. Spot prime abraded and damaged areas which expose bare metal of factory finished items with paint as recommended by manufacturer of item.

D. Zinc-Coated (Galvanized) Metal, Aluminum, Copper and Copper Alloys Surfaces Specified Painted:

1. Clean surfaces to remove grease, oil and other deterrents to paint adhesion in accordance with SSPC-SP 1 (Solvent Cleaning).
2. Spot coat abraded and damaged areas of zinc-coating which expose base metal on hot-dip zinc-coated items with MPI 18 (Organic Zinc Rich Coating). Prime or spot prime with MPI 134 (Waterborne Galvanized Primer)

or MPI 135 (Non-Cementitious Galvanized Primer) depending on finish coat compatibility.

E. Masonry, Concrete, Cement Board, Cement Plaster and Stucco:

1. Clean and remove dust, dirt, oil, grease efflorescence, form release agents, laitance, and other deterrents to paint adhesion.
2. Use emulsion type cleaning agents to remove oil, grease, paint and similar products. Use of solvents, acid, or steam is not permitted.
3. Remove loose mortar in masonry work.
4. Replace mortar and fill open joints, holes, cracks and depressions with new mortar. Do not fill weep holes. Finish to match adjacent surfaces.
5. Neutralize Concrete floors to be painted by washing with a solution of 1.4 Kg (3 pounds) of zinc sulfate crystals to 3.8 L (1 gallon) of water, allow to dry three (3) days and brush thoroughly free of crystals.
6. Repair broken and spalled concrete edges with concrete patching compound to match adjacent surfaces. Remove projections to level of adjacent surface by grinding or similar methods.

F. Gypsum Plaster and Gypsum Board:

1. Remove efflorescence, loose and chalking plaster or finishing materials.
2. Remove dust, dirt, and other deterrents to paint adhesion.
3. Fill holes, cracks, and other depressions with CID-A-A-1272A finished flush with adjacent surface, with texture to match texture of adjacent surface. Patch holes over 25 mm (1-inch) in diameter as specified in Section for plaster or gypsum board.

3.5 PAINT PREPARATION:

- A. Thoroughly mix painting materials to ensure uniformity of color, complete dispersion of pigment and uniform composition.
- B. Do not thin unless necessary for application and when finish paint is used for body and prime coats. Use materials and quantities for thinning as specified in manufacturer's printed instructions.
- C. Remove paint skins, then strain paint through commercial paint strainer to remove lumps and other particles.
- D. Mix two (2) component and two (2) part paint and those requiring additives in such a manner as to uniformly blend as specified in manufacturer's printed instructions unless specified otherwise.
- E. For tinting required to produce exact shades specified, use color pigment recommended by the paint manufacturer.

3.6 APPLICATION:

- A. Start of surface preparation or painting will be construed as acceptance of the surface as satisfactory for the application of materials.
- B. Unless otherwise specified, apply paint in three (3) coats; prime, body, and finish. When two (2) coats applied to prime coat are the same, first coat applied over primer is body coat and second coat is finish coat.
- C. Apply each coat evenly and cover substrate completely.
- D. Allow not less than 48 hours between application of succeeding coats, except as allowed by manufacturer's printed instructions, and approved by COR.
- E. Apply by brush or roller. Spray application for new or existing occupied spaces only upon approval by acceptance from COR in writing.
 - 1. Apply painting materials specifically required by manufacturer to be applied by spraying.
 - 2. In new construction and in existing occupied spaces, where paint is applied by spray, mask or enclose with polyethylene, or similar air tight material with edges and seams continuously sealed including items specified in "Building and Structural Work Field Painting"; "Work not Painted"; motors, controls, telephone, and electrical equipment, fronts of sterilizes and other recessed equipment and similar prefinished items.
- F. Do not paint in closed position operable items such as access doors and panels, window sashes, overhead doors, and similar items except overhead roll-up doors and shutters.

3.7 PRIME PAINTING:

- A. After surface preparation, prime surfaces before application of body and finish coats, except as otherwise specified.
- B. Spot prime and apply body coat to damaged and abraded painted surfaces before applying succeeding coats.
- C. Additional field applied prime coats over shop or factory applied prime coats are not required except for exterior exposed steel apply an additional prime coat.
- D. Prime rabbets for stop and face glazing of wood, and for face glazing of steel.
- E. Wood and Wood Particleboard:
 - 1. Use same kind of primer specified for exposed face surface.

- a. Exterior wood: MPI 7 (Exterior Oil Wood Primer) for new construction and MPI 5 (Exterior Alkyd Wood Primer) for repainting bare wood primer except where MPI 90 (Interior Wood Stain, Semi-Transparent) is scheduled.
 - b. Interior wood except for transparent finish: MPI 45 (Interior Primer Sealer) or MPI 46 (Interior Enamel Undercoat), thinned if recommended by manufacturer.
 - c. Transparent finishes as specified under "Transparent Finishes on Wood Except Floors Article".
2. Apply two (2) coats of primer MPI 7 (Exterior Oil Wood Primer) or MPI 5 (Exterior Alkyd Wood Primer) or sealer MPI 45 (Interior Primer Sealer) or MPI 46 (Interior Enamel Undercoat) to surfaces of wood doors, including top and bottom edges, which are cut for fitting or for other reason.
 3. Apply one (1) coat of primer MPI 7 (Exterior Oil Wood Primer) or MPI 5 (Exterior Alkyd Wood Primer) or sealer MPI 45 (Interior Primer Sealer) or MPI 46 (Interior Enamel Undercoat) as soon as delivered to site to surfaces of unfinished woodwork, except concealed surfaces of shop fabricated or assembled millwork and surfaces specified to have varnish, stain or natural finish.
 4. Back prime and seal ends of exterior woodwork, and edges of exterior plywood specified to be finished.
 5. Apply MPI 67 (Interior Latex Fire Retardant, Top-Coat (UL Approved) to wood for fire retardant finish.
- F. Metals except boilers, incinerator stacks, and engine exhaust pipes:
1. Steel and iron: MPI 79 (Marine Alkyd Metal Primer) MPI 95 (Fast Drying Metal Primer). Use MPI 101 (Cold Curing Epoxy Primer) where MPI 77 (Epoxy Cold Cured, Gloss MPI 98 (High Build Epoxy Coating) MPI 108 (High Build Epoxy Marine Coating finish is specified.
 2. Zinc-coated steel and iron: MPI 134 (Waterborne Galvanized Primer)—MPI 135 (Non-Cementitious Galvanized Primer).
 3. Aluminum scheduled to be painted: MPI 95 (Fast Drying Metal Primer).
 4. Terne Metal: MPI 79 (Marine Alkyd Metal Primer) MPI 95 (Fast Drying Metal Primer).
 5. Copper and copper alloys scheduled to be painted: MPI 95 (Fast Drying Metal Primer).
 6. Machinery not factory finished: MPI 9 (Exterior Alkyd Enamel).

7. Asphalt coated metal: MPI 1 (Aluminum Paint).
8. Metal over 94 degrees C (201 degrees F), Boilers, Incinerator Stacks, and Engine Exhaust Pipes: MPI 22 (High Heat Resistant Coating).

G. Gypsum Board and Hardboard:

1. Surfaces scheduled to have MPI 10 (Exterior Latex, Flat) MPI 11 (Exterior Latex, Semi-Gloss) MPI 119 (Exterior Latex, High Gloss (acrylic)) MPI 53 (Interior Latex, Flat), MPI Gloss Level 1 MPI 52 (Interior Latex, MPI Gloss Level 3) MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5) MPI 114 (Interior Latex, Gloss) finish: Use MPI 10 (Exterior Latex, Flat) MPI 11 (Exterior Latex, Semi-Gloss) MPI 119 (Exterior Latex, High Gloss (acrylic)) MPI 53 (Interior Latex, MPI Gloss Level 3) MPI 52 (Interior Latex, MPI Gloss Level 3) MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5) MPI 114 (Interior Latex, Gloss) respectively.
2. Primer: MPI 50 (Interior Latex Primer Sealer) except use MPI 45 (Interior Primer Sealer) MPI 46 (Interior Enamel Undercoat) in shower and bathrooms.
3. Surfaces scheduled to receive vinyl coated fabric wall covering:
Use MPI 45 (Interior Primer Sealer) MPI 46 (Interior Enamel Undercoat).
4. Use MPI 101 (Cold Curing Epoxy Primer) for surfaces scheduled to receive MPI 77 (Epoxy Cold Cured, Gloss) MPI 98 (High Build Epoxy Coating) MPI 108 (High Build Epoxy Marine Coating) finish.

H. Gypsum Plaster and Veneer Plaster:

1. Surfaces scheduled to receive vinyl coated fabric wall covering: Use MPI 45 (Interior Primer Sealer).
2. MPI 45 (Interior Primer Sealer), except use MPI 50 (Interior Latex Primer Sealer) when an alkyd flat finish is specified.
3. Surfaces scheduled to have MPI 10 (Exterior Latex, Flat) MPI 11 (Exterior Latex, Semi-Gloss) MPI 119 (Exterior Latex, High Gloss (acrylic)) MPI 53 (Interior Latex, Flat, MPI Gloss Level 1) MPI 52 (Interior Latex, MPI Gloss Level 3) MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5) MPI 114 (Interior Latex, Gloss) finish: Use MPI 10 (Exterior Latex, Flat) MPI 11 (Exterior Latex, Semi-Gloss) MPI 119 (Exterior Latex, High Gloss (acrylic)) MPI 53 (Interior Latex, Flat, MPI Gloss Level 1) MPI 52 (Interior Latex, MPI Gloss Level 3) MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5) MPI 114 (Interior Latex, Gloss) respectively.

4. Use MPI 101 (Cold Curing Epoxy Primer) for surfaces scheduled to receive MPI 77 (Epoxy Cold Cured, Gloss) MPI 108 (High Build Epoxy Marine Coating) finish.
- I. Concrete Masonry Units except glazed or integrally colored and decorative units:
 1. MPI 4 (Block Filler) on interior surfaces.
 2. Prime exterior surface as specified for exterior finishes.
- J. Cement Plaster or stucco Concrete Masonry, Brick Masonry and Cement board Interior Surfaces of Ceilings and Walls:
 1. MPI 53 (Interior Latex, Flat, MPI Gloss Level 1) MPI 52 (Interior Latex, MPI Gloss Level 3) MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5) MPI 114 (Interior Latex, Gloss) except use two (2) coats where substrate has aged less than six (6) months.
 2. Use MPI 138 (Interior High Performance Latex, MPI Gloss Level 2) MPI 139 (Interior High Performance Latex, MPI Gloss level 3) MPI 140 (Interior High Performance latex, MPI Gloss Level 4) MPI 141 (Interior High Performance Latex, MPI Gloss Level 5) MPI 114 (Interior Latex, Gloss) TT-P-1411A (Paint, Copolymer Resin, Cementitious) Type II MPI 77 (Epoxy Cold Cured, Gloss MPI 98 (High Build Epoxy Coating) MPI 108 (High Build Epoxy Marine Coating) as scheduled.

3.8 EXTERIOR FINISHES:

- A. Apply following finish coats where specified in Section 09 06 00.
- B. Wood:
 1. Do not apply finish coats on surfaces concealed after installation, top and bottom edges of wood doors and sash, or on edges of wood framed insect screens.
 2. Two (2) coats of MPI 10 Exterior Latex, Flat) MPI 11 (Exterior Latex, Semi-Gloss) MPI 119 (Exterior Latex, High Gloss (acrylic) on exposed surfaces, except where transparent finish is specified.
 3. Two (2) coats of MPI 31 (Polyurethane, Moisture Cured, Clear Gloss) MPI 71 (Polyurethane, Moisture Cured, Clear Flat) for transparent finish.
- C. Steel and Ferrous Metal, Including Tern:
 1. Two (2) coats of MPI 8 (Exterior Alkyd, Flat) MPI 9 (Exterior Alkyd Enamel) MPI 94 (Exterior Alkyd, Semi-Gloss) on exposed surfaces, except on surfaces over 94 degrees C (201 degrees F).

2. One (1) coat of MPI 22 (High Heat Resistant Coating) on surfaces over 94 degrees K (290 degrees F) and on surfaces of boiler, incinerator, stacks engine exhaust pipes.
- D. Machinery without factory finish except for primer: One (1) coat MPI 8 (Exterior Alkyd, Flat) MPI 9 (Exterior Alkyd Enamel) MPI 94 (Exterior Alkyd, Semi-Gloss).
- E. Concrete Masonry Units Brick Cement Plaster Concrete:
1. General:
 - a. Where specified in Section 09 06 00, SCHEDULE FOR FINISHES or shown.
 - b. Mix as specified in manufacturer's printed directions.
 - c. Do not mix more paint than can be used within four (4) hours after mixing. Discard paint that has started to set.
 - d. Dampen warm surfaces above 24 degrees C (75 degrees F) with fine mist of water before application of paint. Do not leave free water on surface.
 - e. Cure paint with a fine mist of water as specified in manufacturer's printed instructions.
 2. Use two (2) coats of TT-P-1411 (Paint, Co-polymer-Resin, Cementitious), unless specified otherwise.

3.9 INTERIOR FINISHES:

- A. Apply following finish coats over prime coats in spaces or on surfaces specified in Section 09 06 00, SCHEDULE FOR FINISHES.
- B. Metal Work:
1. Apply to exposed surfaces.
 2. Omit body and finish coats on surfaces concealed after installation except electrical conduit containing conductors over 600 volts.
 3. Ferrous Metal, Galvanized Metal, and Other Metals Scheduled:
 - a. Apply two (2) coats of MPI 47 (Interior Alkyd, Semi-Gloss) unless specified otherwise.
 - b. Two (2) coats of MPI 48 (Interior Alkyd Gloss) MPI 51 (Interior Alkyd, Eggshell).
 - c. One (1) coat of MPI 46 (Interior Enamel Undercoat) plus one coat of MPI 47 (Interior Alkyd, Semi-Gloss) on exposed interior surfaces of alkyd-amine enamel prime finished windows.
 - d. One (1) coat of MPI 101 primer over two (2) coats of waterborne light industrial coating MPI 163 on exposed surfaces in battery rooms -pool

area chlorinator rooms. Steel is to be blast cleaned to SSPC 10/NACE No. 2.

e. Machinery: One (1) coat MPI 9 (Exterior Alkyd Enamel).

f. Asphalt Coated Metal: One (1) coat MPI 1 (Aluminum Paint).

g. Ferrous Metal over 94 degrees K (290 degrees F): Boilers, Incinerator Stacks, and Engine Exhaust Pipes: One (1) coat MPI 22 (High Heat Resistant Coating).

C. Gypsum Board:

1. One (1) coat of MPI 45 (Interior Primer Sealer) MPI 46 (Interior Enamel Undercoat) plus one (1) coat of MPI 139 (Interior High Performance Latex, MPI Gloss level 3).

2. Two (2) coats of MPI 138 (Interior High Performance Latex, MPI Gloss Level 2).

3. One (1) coat of MPI 45 (Interior Primer Sealer)—MPI 46 (Interior Enamel Undercoat) plus one (1) coat of MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5) or MPI 114 (Interior Latex, Gloss).

4. One (1) coat of MPI 45 (Interior Primer Sealer) MPI 46 (Interior Enamel Undercoat) plus one (1) coat of MPI 48 (Interior Alkyd Gloss).

D. Plaster:

1. One (1) coat of MPI 45 (Interior Primer Sealer) MPI 46 (Interior Enamel Undercoat) MPI 50 (Interior Latex Primer Sealer) plus one (1) coat of MPI 139 (Interior High Performance Latex, MPI Gloss level 3).

2. Two (2) coats of MPI 51 (Interior Alkyd, Eggshell).

3. One (1) coat of MPI 45 (Interior Primer Sealer) MPI 46 (Interior Enamel Undercoat) or MPI 50 (Interior Latex Primer Sealer) plus one (1) coat of 139 (Interior High Performance Latex, MPI Gloss level 3).

4. One (1) coat MPI 101 (Cold Curing Epoxy Prime).

E. Masonry and Concrete Walls:

1. Over MPI 4 (Interior/Exterior Latex Block Filler) on CMU surfaces.

2. Two (2) coats of MPI 53 (Interior Latex, Flat, MPI Gloss Level 1)—MPI 52 (Interior Latex, MPI Gloss Level 3) MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5) MPI 114 (Interior Latex, Gloss).

3. Two (2) coats of MPI 138 (Interior High Performance Latex, MPI Gloss Level 2) MPI 139 (Interior High Performance Latex, MPI Gloss Level 3) MPI 140 (Interior High Performance Latex MPI Gloss Level 4) MPI 141 (Interior High Performance Latex MPI Gloss Level 5) MPI 114 (Interior Latex, Gloss).

F. Wood:

1. Sanding:
 - a. Use 220-grit sandpaper.
 - b. Sand sealers and varnish between coats.
 - c. Sand enough to scarify surface to assure good adhesion of subsequent coats, to level roughly applied sealer and varnish, and to knock off "whiskers" of any raised grain as well as dust particles.
2. Sealers:
 - a. MPI 31 (gloss) or MPI 71 (flat) thinned as recommended by manufacturer at rate of one (1) part of thinner to four (4) parts of varnish.
 - b. Apply sealers specified except sealer may be omitted where pigmented, penetrating, or wiping stains containing resins are used.
 - c. Allow manufacturer's recommended drying time before sanding, but not less than 24 hours or 36 hours in damp or muggy weather.
 - d. Sand as specified.
3. Paint Finish:
 - a. One (1) coat of MPI 45 (Interior Primer Sealer) MPI 46 (Interior Enamel plus one (1) coat of MPI 47 (Interior Alkyd, Semi-Gloss).
 - b. One (1) coat MPI 66 (Interior Alkyd Fire retardant, Clear Top-Coat (UL Approved) MPI 67 (Interior Latex Fire Retardant, Top-Coat (UL Approved), intumescent type, on exposed wood in attics with floors used for mechanical equipment and above ceilings where shown.
 - c. One (1) coat of MPI 45 Interior Primer Sealer) MPI 46 (Interior Enamel Undercoat) plus one (1) coat of MPI 48 (Interior Alkyd Gloss).
 - d. Two (2) coats of MPI 51 (Interior Alkyd, Eggshell).
4. Transparent Finishes on Wood Except Floors.
 - a. Natural Finish:
 - 1) One (1) coat of sealer MPI 31 (gloss) MPI 71 (flat) thinned with thinner recommended by manufacturer at rate of one (1) part of thinner to four (4) parts of varnish.
 - 2) Two (2) coats of MPI 71 (Polyurethane, Moisture Cured, Clear Flat MPI 31 (Polyurethane, Moisture Cured, Clear Gloss.
 - b. Stain Finish:
 - 1) One (1) coat of MPI 90 (Interior Wood Stain, Semi-Transparent).
 - 2) Use wood stain of type and color required to achieve finish specified. Do not use varnish type stains.

3) One (1) coat of sealer MPI 31 (gloss) MPI 71 (flat) thinned as recommended by manufacturer at rate of one (1) part of thinner to four (4) parts of varnish.

4) Two (2) coats of MPI 71 (Polyurethane, Moisture Cured, Clear Flat) MPI 31 (Polyurethane Moisture Cured, Clear Gloss).

c. Varnish Finish:

1) One (1) coat of sealer MPI 31 (gloss) MPI 71 (flat) thinned as recommended by manufacturer at rate of one (1) part of thinner to four (4) parts of varnish.

2) Two (2) coats of MPI 71 (Polyurethane, Moisture Cured, Clear Flat) MPI 31 (Polyurethane Moisture Cured, Clear Gloss).

d. Fire Retardant Intumescent Varnish:

1) MPI 66 (Interior Alkyd Fire Retardant, Clear Top-Coat (UL Approved)) Intumescent Type, Fire Retardant Coating where scheduled: Two (2) coats.

I. Miscellaneous:

1. MPI 1 (Aluminum Paint): Two (2) coats of aluminum paint.

2. Interstitial floor markings: One (1) coat MPI 27 (Exterior/ Interior Alkyd Floor Enamel, Gloss) MPI 59 ((Interior/ Exterior Alkyd Porch & Floor Enamel, Low Gloss) MPI 68 (Interior/ Exterior Latex Porch & Floor Paint, Gloss) MPI 60 (interior/ Exterior Latex Porch & Floor Paint, Low Gloss).

3.10 REFINISHING EXISTING PAINTED SURFACES:

A. Clean, patch and repair existing surfaces as specified under "Surface Preparation". No "telegraphing" of lines, ridges, flakes, etc., through new surfacing is permitted. Where this occurs, sand smooth and re-finish until surface meets with COR's approval.

B. Remove and reinstall items as specified under "General Workmanship Requirements".

C. Remove existing finishes or apply separation coats to prevent non compatible coatings from having contact.

D. Patched or Replaced Areas in Surfaces and Components: Apply spot prime and body coats as specified for new work to repaired areas or replaced components.

E. Except where scheduled for complete painting apply finish coat over plane surface to nearest break in plane, such as corner, reveal, or frame.

- F. In existing rooms and areas where alterations occur, clean existing stained and natural finished wood retouch abraded surfaces and then give entire surface one (1) coat of MPI 31 (Polyurethane, Moisture Cured, Clear Gloss) MPI 71 (Polyurethane, Moisture Cured, Clear Flat).
- G. Refinish areas as specified for new work to match adjoining work unless specified or scheduled otherwise.
- H. Coat knots and pitch streaks showing through old finish with MPI 36 (Knot Sealer) before refinishing.
- I. Sand or dull glossy surfaces prior to painting.
- J. Sand existing coatings to a feather edge so that transition between new and existing finish will not show in finished work.

3.11 PAINT COLOR:

- A. Color and gloss of finish coats to match existing.
- B. Coat Colors:
 - 1. Color of priming coat: Lighter than body coat.
 - 2. Color of body coat: Lighter than finish coat.
 - 3. Color prime and body coats to not show through the finish coat and to mask surface imperfections or contrasts.
- C. Painting, Caulking, Closures, and Fillers Adjacent to Casework:
 - 1. Paint to match color of casework where casework has a paint finish.
 - 2. Paint to match color of wall where casework is stainless steel, plastic laminate, or varnished wood.

3.12 MECHANICAL AND ELECTRICAL WORK FIELD PAINTING SCHEDULE:

- A. Field painting of mechanical and electrical consists of cleaning, touching-up abraded shop prime coats, and applying prime, body and finish coats to materials and equipment if not factory finished in space scheduled to be finished.
- B. In spaces not scheduled to be finish painted as specified below.
- C. Paint various systems specified in, Division 21 - FIRE SUPPRESSION, Division 22 - PLUMBING, Division 23 - Division 26 - ELECTRICAL, Division 27 - COMMUNICATIONS, and Division 28 - ELECTRONIC SAFETY AND SECURITY.
- D. Paint after tests have been completed.

- E. Omit prime coat from factory prime-coated items.
- F. Finish painting of mechanical and electrical equipment is not required when located in interstitial spaces, above suspended ceilings, in concealed areas such as pipe and electric closets, pipe basements, pipe tunnels, trenches, attics, roof spaces, shafts and furred spaces except on electrical conduit containing feeders 600 volts or more.
- G. Color:
 - 1. Paint items having no color specified to match surrounding surfaces.
 - 2. Paint colors to match existing except for following:
 - a. White: Exterior unfinished surfaces of enameled plumbing fixtures. Insulation.
 - b. Gray: Heating, ventilating, air conditioning and refrigeration equipment (except as required to match surrounding surfaces), and water and sewage treatment equipment and sewage ejection equipment.
 - c. Aluminum Color: Ferrous metal on outside of boilers and in connection with boiler settings including supporting doors and door frames and fuel oil burning equipment, and steam generation system (bare piping, fittings, hangers, supports, valves, traps and miscellaneous iron work in contact with pipe).
 - d. Federal Safety Red: Exposed fire protection piping hydrants, post indicators, electrical conduits containing fire alarm control wiring, and fire alarm equipment.
 - e. Federal Safety Orange: Entire lengths of electrical conduits containing feeders 600 volts or more.
 - f. Color to match brickwork sheet metal covering on breeching outside of exterior wall of boiler house.
- I. Apply paint systems on properly prepared and primed surface as follows:
 - 1. Exterior Locations:
 - a. Apply two (2) coats of MPI 8 (Exterior Alkyd, Flat) MPI 94 (Exterior Alkyd, Semi-gloss) MPI 9 (Exterior Alkyd Enamel) to the following ferrous metal items: Vent and exhaust pipes with temperatures under 94 degrees C (201 degrees F), roof drains, fire hydrants, post indicators, yard hydrants, exposed piping and similar items.

- b. Apply two (2) coats of MPI 10 (Exterior Latex, Flat) MPI 11 (Exterior Latex, Semi-Gloss) MPI 119 (Exterior Latex, High Gloss (acrylic) to galvanized and zinc-copper alloy metal.
 - c. Apply one (1) coat of MPI 22 (High Heat Resistant Coating), 650 degrees C (1200 degrees F) to incinerator stacks, boiler stacks, and engine generator exhaust.
2. Interior Locations:
- a. Apply two (2) coats of MPI 47 (Interior Alkyd, Semi-Gloss) to following items:
 - 1) Metal under 94 degrees C (201 degrees F) of items such as bare piping, fittings, hangers and supports.
 - 2) Equipment and systems such as hinged covers and frames for control cabinets and boxes, cast-iron radiators, electric conduits and panel boards.
 - 3) Heating, ventilating, air conditioning, plumbing equipment, and machinery having shop prime coat and not factory finished.
 - b. Ferrous metal exposed in hydrotherapy equipment room and chlorinator room of water and sewerage treatment plants: One (1) coat of MPI 101 (Cold Curing Epoxy Primer) and one (1) coat of MPI 77 (Epoxy Cold Cured, Gloss MPI 98 (High Build Epoxy Coating) MPI 108 (High Build Epoxy Marine coating).
 - c. Apply one (1) coat of MPI 50 (Interior Latex Primer Sealer) and one (1) coat of MPI 53 (Interior Latex, Flat, MPI Gloss Level 1) MPI 44 (Interior Low Sheen Latex) MPI 52 (Interior Latex, MPI Gloss Level 3) MPI 43 (Interior Satin Latex) MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5) MPI 114 (Interior Latex, Gloss) on finish of insulation on boiler breeching and uptakes inside boiler house, drums, drumheads, oil heaters, feed water heaters, tanks and piping.

3.13 BUILDING AND STRUCTURAL WORK FIELD PAINTING:

- A. Painting and finishing of interior and exterior work except as specified here-in-after.
 - 1. Painting of disturbed, damaged and repaired or patched surfaces when entire space is not scheduled for complete repainting or refinishing.
 - 2. Painting of ferrous metal and galvanized metal.
 - 3. Painting of wood with fire retardant paint exposed in attics, when used as mechanical equipment space (except shingles).
 - 4. Identity painting and safety painting.

B. Building and Structural Work not Painted:

1. Prefinished items:
 - a. Casework, doors, elevator entrances and cabs, metal panels, wall covering, and similar items specified factory finished under other sections.
 - b. Factory finished equipment and pre-engineered metal building components such as metal roof and wall panels.
2. Finished surfaces:
 - a. Hardware except ferrous metal.
 - b. Anodized aluminum, stainless steel, chromium plating, copper, and brass, except as otherwise specified.
 - c. Signs, fixtures, and other similar items integrally finished.
3. Concealed surfaces:
 - a. Inside dumbwaiter, elevator and duct shafts, interstitial spaces, pipe basements, crawl spaces, pipe tunnels, above ceilings, attics, except as otherwise specified.
 - b. Inside walls or other spaces behind access doors or panels.
 - c. Surfaces concealed behind permanently installed casework and equipment.
4. Moving and operating parts:
 - a. Shafts, chains, gears, mechanical and electrical operators, linkages, and sprinkler heads, and sensing devices.
 - b. Tracks for overhead or coiling doors, shutters, and grilles.
5. Labels:
 - a. Code required label, such as Underwriters Laboratories Inc., Intertek Testing Service or Factory Mutual Research Corporation.
 - b. Identification plates, instruction plates, performance rating, and nomenclature.
6. Galvanized metal:
 - a. Exterior chain link fence and gates, corrugated metal areaways, and gratings.
 - b. Gas Storage Racks.
 - c. Except where specifically specified to be painted.
7. Metal safety treads and nosings.
8. Gaskets.

9. Concrete curbs, gutters, pavements, retaining walls, exterior exposed foundations walls and interior walls in pipe basements.
10. Face brick.
11. Structural steel encased in concrete, masonry, or other enclosure.
12. Structural steel to receive sprayed-on fire proofing.
13. Ceilings, walls, columns in interstitial spaces.
14. Ceilings, walls, and columns in pipe basements.
15. Wood Shingles.

3.14 IDENTITY PAINTING SCHEDULE:

- A. Identify designated service in new buildings or projects with extensive remodeling in accordance with ASME A13.1, unless specified otherwise, on exposed piping, piping above removable ceilings, piping in accessible pipe spaces, interstitial spaces, and piping behind access panels. For existing spaces where work is minor match existing.
 1. Legend may be identified using snap-on coil plastic markers or by paint stencil applications.
 2. Apply legends adjacent to changes in direction, on branches, where pipes pass through walls or floors, adjacent to operating accessories such as valves, regulators, strainers and cleanouts a minimum of 12.2 M (40 feet) apart on straight runs of piping. Identification next to plumbing fixtures is not required.
 3. Locate Legends clearly visible from operating position.
 4. Use arrow to indicate direction of flow using black stencil paint.
 5. Identify pipe contents with sufficient additional details such as temperature, pressure, and contents to identify possible hazard. Insert working pressure shown on construction documents where asterisk appears for High, Medium, and Low Pressure designations as follows:
 - a. High Pressure - 414 kPa (60 psig) and above.
 - b. Medium Pressure - 104 to 413 kPa (15 to 59 psig).
 - c. Low Pressure - 103 kPa (14 psig) and below.
 - d. Add Fuel oil grade numbers.
 6. Legend name in full or in abbreviated form as follows:

PIPING	COLOR OF EXPOSED PIPING	COLOR OF BACKGROUND	COLOR OF LETTERS	LEGEND	ABBREVIATIONS
Drain Line		Green	White	Drain	
Fire Protection Water					
Sprinkler	Red	Red	White	Auto Spr	
Standpipe	Red	Red	White	Stand	
Sprinkler	Red	Red	White	Drain	

B. Fire and Smoke Partitions:

1. Identify partitions above ceilings on both sides of partitions except within shafts in letters not less than 64 mm (2 1/2 inches) high.
2. Stenciled message: "SMOKE BARRIER" or, "FIRE BARRIER" as applicable.
3. Locate not more than 6096 mm (20 feet) on center on corridor sides of partitions, and with a least one (1) message per room on room side of partition.
4. Use semi-gloss paint of color that contrasts with color of substrate.

C. Identify columns in pipe basements and interstitial space:

1. Apply stenciled number and letters to correspond with grid numbering and lettering indicated on construction documents.
2. Paint numbers and letters 101 mm (4 inches) high, locate 45 mm (18 inches) below overhead structural slab.
3. Apply on four (4) sides of interior columns and on inside face only of exterior wall columns.
4. Color:
 - a. Use black on concrete columns.
 - b. Use white or contrasting color on steel columns.

3.15 PROTECTION CLEAN UP, AND TOUCH-UP:

- A. Protect work from paint droppings and spattering by use of masking, drop cloths, removal of items or by other approved methods.
- B. Upon completion, clean paint from hardware, glass and other surfaces and items not required to be painted of paint drops or smears.
- C. Before final inspection, touch-up or refinished in a manner to produce solid even color and finish texture, free from defects in work which was damaged or discolored.

- - - E N D - - -

SECTION 21 08 00
COMMISSIONING OF FIRE SUPPRESSION SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. The requirements of this Section apply to all sections of Division 21.
- B. This project will have selected building systems commissioned. The Architect/Engineer will act as the commissioning Agent.

1.2 RELATED WORK

- A. Section 01 00 00 GENERAL REQUIREMENTS.
- B. Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

1.3 SUMMARY

- A. This Section includes requirements for commissioning the Fire Suppression systems, subsystems and equipment.

1.4 DEFINITIONS (NOT USED)

1.5 COMMISSIONED SYSTEMS

- A. Commissioning of a system or systems specified in Division 21 is part of the construction process. Documentation and testing of these systems, as well as training of the VA's Operation and Maintenance personnel in accordance with the requirements is required in cooperation with the VA and the Commissioning Agent.
- B. The Fire Suppression systems commissioning will include the fire sprinkler systems.

1.6 SUBMITTALS

- A. The commissioning process requires review of selected Submittals. The Commissioning Agent will provide a list of submittals that will be reviewed by the Commissioning Agent. This list will be reviewed and approved by the VA prior to forwarding to the Contractor. Refer to Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, and SAMPLES for further details.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION

3.1 CONSTRUCTION INSPECTIONS

- A. Commissioning of the building fire suppression systems will require inspection of individual elements of the fire suppression construction throughout the construction period. The Contractor shall coordinate

with the Commissioning Agent and the Commissioning plan to schedule inspections as required to support the Commissioning Process.

.2 PRE-FUNCTIONAL CHECKLISTS

- A. The Contractor shall complete Pre-Functional Checklists to verify systems, subsystems, and equipment installation is complete and systems are ready for Systems Functional Performance Testing. The Commissioning Agent will prepare Pre-Functional Checklists to be used to document equipment installation. The Contractor shall complete the checklists. Completed checklists shall be submitted to the VA and to the Commissioning Agent for review. The Commissioning Agent may spot check a sample of completed checklists. If the Commissioning Agent determines that the information provided on the checklist is not accurate, the Commissioning Agent will return the marked-up checklist to the Contractor for correction and resubmission. If the Commissioning Agent determines that a significant number of completed checklists for similar equipment are not accurate, the Commissioning Agent will select a broader sample of checklists for review. If the Commissioning Agent determines that a significant number of the broader sample of checklists is also inaccurate, all the checklists for the type of equipment will be returned to the Contractor for correction and resubmission.

3.3 CONTRACTORS TESTS

- A. Contractor tests as required by other sections of Division 21 shall be scheduled and documented in accordance with Section 01 00 00 GENERAL REQUIREMENTS. All testing shall be incorporated into the project schedule. Contractor shall provide no less than 7 calendar days' notice of testing. The Commissioning Agent will witness selected Contractor tests at the sole discretion of the Commissioning Agent. Contractor tests shall be completed prior to scheduling Systems Functional Performance Testing.

3.4 SYSTEMS FUNCTIONAL PERFORMANCE TESTING

- A. The Commissioning Process includes Systems Functional Performance Testing that is intended to test systems functional performance under steady state conditions, to test system reaction to changes in operating conditions, and system performance under emergency conditions. The Commissioning Agent will prepare detailed Systems Functional Performance Test procedures for review and approval by the COR. The Contractor shall review and comment on the tests prior to

approval. The Contractor shall provide the required labor, materials, and test equipment identified in the test procedure to perform the tests. The Commissioning Agent will witness and document the testing. The Contractor shall sign the test reports to verify tests were performed.

3.5 TRAINING OF VA PERSONNEL

- A. Training of the VA operation and maintenance personnel is required in cooperation with the COR and Commissioning Agent. Provide competent, factory authorized personnel to provide instruction to operation and maintenance personnel concerning the location, operation, and troubleshooting of the installed systems. Contractor shall submit training agendas and trainer resumes. The instruction shall be scheduled in coordination with the COR after submission and approval of formal training plans. Refer to Division 21 Sections for additional Contractor training requirements.

----- END -----

SECTION 21 13 13
WET-PIPE SPRINKLER SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Design, installation and testing shall be in accordance with NFPA 13.
- B. The design and installation of a standpipe system combined with the sprinkler system.
- D. Modification of the existing sprinkler and standpipe systems as indicated on the drawings and as further required by these specifications.
- E. Existing piping to be reused, replaced or removed as indicated on the drawings. Removal of piping to include all valves, flow switches, supervisory devices, hangers, supports, and associated fire alarm system conduit and wire.
- F. Existing fire hose valve outlets interior to the building and accessible piping to be disconnected from their supply, drained, removed, and all remaining inaccessible piping capped.
- G. Replacement of all existing sprinklers in each sprinkler work zone. Work to include all necessary piping modifications, installation of new flex hose sprinkler drop, new sprinklers, new sprinkler escutcheon, and replacement of existing ceiling tile if scratched or damaged.
- H. Installation of new sectional valves and replacement of existing valves in the sprinkler/standpipe system feed mains as indicated on the drawings.
- I. Installation of new sprinkler system zone control valves (2-1/2" minimum) and replacement of all existing zone control valves as indicated on the drawings.
- J. Provide access doors or panels where control or drain valves are located behind plaster or gypsum walls or ceilings as necessary to install piping above suspended plaster or gypsum ceilings.
- K. Painting of exposed piping and supports to follow Section 09 91 00, PAINTING.

1.2 RELATED WORK

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Section 07 84 00, FIRESTOPPING.
- C. Section 09 91 00, PAINTING.
- D. Section 21 08 00, COMMISSIONING OF FIRE SUPPRESSION SYSTEMS.
- E. Section 21 31 00, FIRE DETECTION AND ALARM.

1.3 DESIGN CRITERIA

- A. Design Basis Information: Provide design, materials, equipment, installation, inspection, and testing of the automatic sprinkler system, standpipe system and fire pump shall be in accordance with the requirements of NFPA 13, 14, 20, 25, 75, 82. Exception to NFPA Fire Codes are as follows:
 - 1. Standpipe system shall be sized to meet volume requirements of NFPA 14 but not pressure requirements.

1.4 SUBMITTALS

- A. Submit as one package in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Prepare detailed working drawings that are signed by a NICET Level III or Level IV Sprinkler Technician or stamped by a Registered Professional Engineer licensed in the field of Fire Protection Engineering. As the Government review is for technical adequacy only, the installer remains responsible for correcting any conflicts with other trades and building construction that arise during installation. Material submittals shall be approved prior to the purchase or delivery to the job site. Suitably bind submittals in notebooks or binders and provide an index referencing the appropriate specification section. In addition to the hard copies, provide submittal items in Paragraphs 1.4(A)1 through 1.4(A)5 electronically in pdf format on a compact disc or as directed by the COR. Submittals shall include, but not be limited to, the following:
 - 1. Qualifications:
 - a. Provide a copy of the installing contractors fire sprinkler and state contractor's license.
 - b. Provide a copy of the NICET certification for the NICET Level III or Level IV Sprinkler Technician who prepared and signed the detailed working drawings unless the drawings are stamped by a Registered Professional Engineer licensed in the field of Fire Protection Engineering.

- c. Provide documentation showing that the installer has been actively and successfully engaged in the installation of commercial automatic sprinkler systems for the past ten years.
2. Drawings: Submit detailed 1:100 (1/8 inch) scale (minimum) working drawings conforming to the Plans and Calculations chapter of NFPA 13. Drawings shall include graphical scales that allow the user to determine lengths when the drawings are reduced in size. Include a plan showing the piping to the water supply test location.
3. Manufacturer's Data Sheets: Provide data sheets for all materials and equipment proposed for use on the system. Include listing information and installation instructions in data sheets. Where data sheets describe items in addition to those proposed to be used for the system, clearly identify the proposed items on the sheet.
4. Calculation Sheets:
 - a. Submit hydraulic calculation sheets in tabular form conforming to the requirements and recommendations of the Plans and Calculations chapter of NFPA 13.
 - b. Submit calculations of loads for sizing of sway bracing in accordance with NFPA 13.
5. Valve Charts: Provide a valve chart that identifies the location of each control valve. Coordinate nomenclature and identification of control valves with COR. Where existing nomenclature does not exist, the chart shall include no less than the following: Tag ID No., Valve Size, Service (control valve, main drain, aux. drain, inspectors test valve, etc.), and Location.
6. Final Document Submittals: Provide as-built drawings, testing and maintenance instructions in accordance with the requirements in Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. In addition, submittals shall include, but not be limited to, the following:
 - a. A complete set of as-built drawings showing the installed system with the specific interconnections between the system switches and the fire alarm equipment. Provide a complete set in the formats as follows. Submit items 2 and 3 below on a compact disc or as directed by the COR.
 - 1) One full size (or size as directed by the COR) printed copy.
 - 2) One complete set in electronic pdf format.

- 3) One complete set in AutoCAD format or a format as directed by the COR.
 - b. Material and Testing Certificate: Upon completion of the sprinkler system installation or any partial section of the system, including testing and flushing, provide a copy of a completed Material and Testing Certificate as indicated in NFPA 13. Certificates shall be provided to document all parts of the installation.
 - c. Operations and Maintenance Manuals that include step-by-step procedures required for system startup, operation, shutdown, and routine maintenance and testing. The manuals shall include the manufacturer's name, model number, parts list, and tools that should be kept in stock by the owner for routine maintenance, including the name of a local supplier, simplified wiring and controls diagrams, troubleshooting guide, and recommended service organization, including address and telephone number, for each item of equipment.
 - d. One paper copy of the Material and Testing Certificates and the Operations and Maintenance Manuals above shall be provided in a binder. In addition, these materials shall be provided in pdf format on a compact disc or as directed by the COR.
 - e. Provide one additional copy of the Operations and Maintenance Manual covering the system in a flexible protective cover and mount in an accessible location adjacent to the riser or as directed by the COR.
- B. Manufacturer's Literature and Data:
1. Pipe and fittings.
 2. Valves.
 3. Sprinklers-each type, temperature and model.
 4. Air Compressors.
 5. Inspectors Test Alarm Modules.
 6. Sprinkler Cabinets.
 7. Pressure Gages.
 8. Pressure Switches.
 9. Pipe Hangers and Supports.
 10. Water Flow Switches.
 11. Valve Tamper Switches.

1.5 QUALITY ASSURANCE

- A. **Installer Reliability:** The installer shall possess a valid State of Michigan fire sprinkler contractor's license. The installer shall have been actively and successfully engaged in the installation of commercial automatic sprinkler systems for the past ten years.
- B. **Materials and Equipment:** All equipment and devices shall be of a make and type listed by UL or approved by FM, or other nationally recognized testing laboratory for the specific purpose for which it is used. All materials, devices, and equipment shall be approved by the VA. All materials and equipment shall be free from defect. All materials and equipment shall be new unless specifically indicated otherwise on the contract drawings. All construction materials and components shall be provided in accordance with the Buy American Act.

.6 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. **National Fire Protection Association (NFPA):**
 - 13-2016.....Installation of Sprinkler Systems
 - 14-2016.....Installation of Standpipe and Hose Systems
 - 20-2015.....Installation of Centrifugal Fire Pump
 - 25-2014.....Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems
 - 70-2014.....National Electrical Code
 - 77-2016.....National Fire Alarm Code
 - 82-2015.....Incinerators, Waste and Linen Handling Systems and Equipment
 - 170-2015.....Standards for Fire Safety Symbols
 - 291-2014.....Fire Flow Testing and Marking of Hydrants
- C. **Underwriters Laboratories, Inc. (UL):**
 - Fire Protection Equipment Directory (2015)
- D. **Factory Mutual Engineering Corporation (FM):**
 - Approval Guide (2015)
- E. **American Society of Sanitary Engineering (ASSE):**
 - 1015-2009.....Double Check Backflow Prevention Assembly

PART 2 - PRODUCTS

2.1 PIPING & FITTINGS

- A. Fire Protection water supply within the building up to sprinkler system isolation valves shall be per NFPA, black steel, Schedule 10 Minimum.
- B. New Sprinkler piping downstream of the isolation valve on wet-pipe systems shall be per NFPA 13, black steel, Schedule 40 minimum.
- C. Sprinkler piping of a dry pipe system shall be galvanized, Schedule 40 minimum.
- D. Threaded or flanged fittings shall be ANSIBI 6.3 cast iron, class 125 minimum. Threaded fittings are not permitted on pipe with wall thickness less than schedule 40.
- D. Thread fittings are not permitted on pipe with wall thickness less than schedule 40.
- E. Plain end pipe, fittings with locking lugs or shear bolts are not permitted.
- F. All fittings on galvanized piping shall be galvanized in accordance with ASTM A53.
- G. Slip type or clamp-on type rubber gasketed fittings shall be listed for each piping application.
- H. Use nonferrous piping in MRI Scanning Rooms.
- I. Flexible sprinkler hose shall be FM Approved and limited to hose with threaded end fittings with a minimum inside diameter of 1-inch and a maximum length of 6-feet unless approved by the COR.

2.2 VALVES

- A. General:
 - 1. Valves shall be in accordance with NFPA 13.
 - 2. Do not use quarter turn ball valves for 50 mm (2 inch) or larger drain valves.
- B. The wet system control valve shall be a listed indicating butterfly type valve. Control valve shall be UL Listed and FM Approved for fire protection installations. System control valve shall be rated for normal system pressure but in no case less than 175 PSI.
- C. Check Valve shall be of the swing type with a flanged cast iron body and flanged inspection plate.
- D. Self-contained Test and Drain Valve:
 - 1. Ductile iron body with bronze "Drain" and "Test" bonnets.
Acrylic sight glass for viewing test flow. Various sized orifice

inserts to stimulate flow through the smallest diameter sprinklers utilized.

2. Bronze body, with chrome plates bronze ball, brass steel, steel handle, Teflon seat and sight glasses. Provide valve with three position indicator plate (off, test, and drain), 6 mm (1/4 in.) tapping for pressure gage and various other orifice inserts to stimulate flow through the smallest diameter sprinklers utilized.

E. Auxiliary Drain Valves: Equipped with reducer and 3/4" hose bib.

F. Low Point Drain Valves: Equipped with reducer and 3/4" hose bib or connected to a sanitary drain.

2.3 FIRE DEPARTMENT SIAMESE CONNECTION (NOT USED)

2.4 SPRINKLERS

- A. All sprinklers shall be FM approved quick response except "institutional" type sprinklers shall be permitted to be UL Listed quick response. Provide FM approved quick response sprinklers in all areas, except that standard response sprinklers shall be provided in freezers, refrigerators, elevator hoistways, elevator machine rooms, and generator rooms. The sprinkler shall be installed in the flush position with the element exposed below the ceiling line. At the specified locations, provide the following type of sprinklers:

LOCATION	TYPE
Mechanical Equipment Rooms, Electrical & Electrical Switch Gear Rooms, Telephone closets, Transformer Vaults	Quick Response Type, Upright or Telephone Closets, Transformer Vaults Pendent Brass [93 °C (200 °F)]
Elevator Shafts, Dumbwaiter Shafts, Elevator Machine Rooms, Elevator Pits	Standard Response Type Upright or Sidewall Brass [93°F]
Gravity Type Linen & Trash Chutes	Standard Response Type Upright or Pendent Brass [66-74 °C (150-165 °F)].
Warehouse [Storage under 3600 mm (12 ft.)]	Quick Response Type Pendent or Upright, Brass [77-74 °C (150-165 °F)]
Warehouse [Storage over 3600 mm (12 ft.)]	See NFPA 13
Cold rooms, Freezers, Controlled Temperature Rooms and Unheated Areas	Standard Response Type, Dry Pendent [66-74 °C (150-165 °F)]
Kitchen Hoods, Exhaust Ducts & Duct Collars	Standard Response Type, Dry Pendent or Upright (Extra High Temperature [163-191 °C (325-375 °F)]

Generator Rooms	Standard Response Type Pendant or Upright [141 °C (286°F)]
Mental Health and Behavioral Unit: Nursing Bedroom, Toilets and all areas with plaster/dry wall ceilings within the area.	Institutional Style Quick Response Type, Chrome Plated with 85 lb. breakaway, Pendant Type, Horizontal Sidewall [66-74 °C (150-165 °F)]
Patient Sleeping, Patient Bedrooms, and Corridors within a Patient Ward	Residential Type, Quick Response Type, Recessed Pendant Type, Chrome Plated, [66-74 °C (150-165 °F)]
All Patient Treatment, Elevator Lobbies and Corridors	Quick Response Type, Recessed Pendant Type, Chrome Plated [66-74 °C [150-165 °F)]
Operating Rooms, Radiology Rooms, Nuclear Medicine Rooms	Quick Response Type, Recessed Pendant Type, Chrome Plated, Sidewall [66-74 °C [150-165 °F)]
All Areas Not Listed Above	Quick Response Type, Recessed Pendant Type, Sidewall Chrome Plated [66-74 °C [150-165 °F)]

- B. Temperature Ratings: In accordance with NFPA 13 except that sprinklers in elevator shafts and elevator machine rooms shall be no less than intermediate temperature rated and sprinklers in generator rooms shall be no less than high temperature rated.
- C. Provide sprinkler guards in accordance with NFPA 13 and when the elevation of the sprinkler head is less than 7 feet, 6 inches above finished floor. The sprinkler guard shall be UL listed or FM approved for use with the corresponding sprinkler.

2.5 SPRINKLER CABINET

- A. Provide sprinkler cabinet with the required number of sprinkler heads of all ratings and types installed, and a sprinkler wrench for each type of sprinkler in accordance with NFPA 13. Locate adjacent to the riser.
- B. Provide a list of sprinklers installed in the property in the cabinet. The list shall include the following:
 1. Manufacturer, model, orifice, deflector type, thermal sensitivity, and pressure for each type of sprinkler in the cabinet.
 2. General description of where each sprinkler is used.
 3. Quantity of each type present in the cabinet.
 4. Issue or revision date of list.

2.6 SPRINKLER SYSTEM SIGNAGE

Rigid plastic, steel or aluminum signs with white lettering on a red background with holes for easy attachment. Sprinkler system signage shall be attached to the valve or piping with chain.

2.7 SWITCHES:

- A. OS&Y Valve Supervisory Switches shall be in a weatherproof die cast/red baked enamel, oil resistant, aluminum housing with tamper resistant screws, 13 mm (1/2 inch) conduit entrance and necessary facilities for attachment to the valves. Provide two SPDT switches rated at 2.5 amps at 24 VDC.
- B. Water flow Alarm Switches: Mechanical, non-coded, non-accumulative retard and adjustable from 0 to 60 seconds minimum. Set flow switches at an initial setting between 20 and 30 seconds.
- C. Alarm Pressure Switches: Activation by any flow of water equal to or in excess of the discharge from one sprinkler. The alarm pressure switch shall be UL Listed or Factory Mutual Approved for the application in which it is used. Activation of the alarm pressure switch shall cause an alarm on the fire alarm system control unit.
- D. Valve Supervisory Switches for Ball and Butterfly Valves: May be integral with the valve.
- E. Connect to existing fire alarm system as required in Section 28 31 00, Fire Detection and Alarm.

2.8 GAUGES

Provide gauges as required by NFPA 13. Provide gauges where the normal pressure of the system is at the midrange of the gauge.

2.9 PIPE HANGERS, SUPPORTS AND RESTRAINT OF SYSTEM PIPING

Pipe hangers, supports, and restraint of system piping shall be in accordance with NFPA 13.

2.10 WALL, FLOOR AND CEILING PLATES

- A. Exposed piping passing through walls, floors or ceilings shall be provided with chrome colored escutcheon plates.
- B. Provide chrome plated steel escutcheon plates per NFPA 13.

2.11 ANTIFREEZE SOLUTION

Antifreeze solution shall be in accordance with NFPA 13 and shall be compatible with use in a potable water supply.

2.12 VALVE TAGS

Engraved black filled numbers and letters not less than 15 mm (1/2 inch) high for number designation, and not less than 8 mm (1/4 inch) for service designation on 19 gage, 40 mm (1-1/2 inches) round brass disc, attached with brass "S" hook, brass chain, or nylon twist tie.

2.13 IDENTIFICATION SIGNS

Provide for all new and existing sectional valves, riser control valves, system control valves, drain valves, test and drain connections and alarm devices with securely attached identification signs (enamel on metal) in accordance with NFPA 13.

2.14 PRESSURE GAUGE

Provide a 1280 kPa (200 psi) pressure gauge at each flow alarm switch location, at the top of each sprinkler or standpipe riser, at each main drain connection, and on the suction and discharge of the fire pump.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Installation shall be accomplished by the licensed contractor. Provide a qualified technician, experienced in the installation and operation of the type of system being installed, to supervise the installation and testing of the system.
- B. Installation of Piping: Accurately cut pipe to measurements established by the installer and work into place without springing or forcing. In any situation where bending of the pipe is required, use a standard pipe-bending template. Concealed piping in spaces that have finished ceilings. Where ceiling mounted equipment exists, such as in operating and radiology rooms, install sprinklers so as not to obstruct the movement or operation of the equipment. Sidewall heads may need to be utilized. In stairways, locate piping as near to the ceiling as possible to prevent tampering by unauthorized personnel and to provide a minimum headroom clearance of 2250 mm (seven feet six inches). Piping shall not obstruct the minimum means of egress clearances required by NFPA 101. Pipe hangers, supports, and restraint of system piping, and seismic bracing shall be installed accordance with NFPA 13.
- C. Welding: Conform to the requirements and recommendations of NFPA 13.
- D. Drains: Provide drips and drains, including low point drains, in accordance with NFPA 13. Pipe drains to discharge at safe points outside of the building to readily carry the full flow from each drain under maximum pressure. Do not provide a direct drain connection to

sewer system or discharge into sinks. Install drips and drains where necessary and required by NFPA 13. The drain piping shall not be restricted or reduced and shall be of the same diameter as the drain collector.

- E. Valve Supervisory Switches: For each indicating sprinkler system riser, sprinkler zone, standpipe system riser, main service entrance, fire pump supply and discharge, jockey pump supply, PIV (post indicator valve), control valve, provide a supervisory switch that is connected to the fire alarm system. Standpipe hose valves and test and drain valves shall not be provided with supervisory switches.
- F. Waterflow Alarm Switches: For each sprinkler zone and each standpipe riser and where indicated on drawings, provide a waterflow switch. Install waterflow switch and adjacent valves in easily accessible locations. Set flow switches at an initial setting between 30 and 45 seconds.
- G. Sprinkler Zone: Each sprinkler zone shall coincide with each smoke zone.
- H. Inspector's Test Connection: Install and supply in accordance with NFPA 13, locate in a secured area, and discharge to the exterior of the building.
- I. Affix cutout disks, which are created by cutting holes in the walls of pipe for flow switches and non-threaded pipe connections to the respective waterflow switch or pipe connection near to the pipe from where they were cut.
- J. Provide escutcheon plates for exposed piping passing through walls, floors or ceilings.
- K. Clearances: For systems requiring seismic protection, piping that passes through floors or walls shall have penetrations sized 50 mm (2 inches) nominally larger than the penetrating pipe for pipe sizes 25 mm (1 inch) to 90 mm (3 ½ inches) and 100 mm (4 inches) nominally larger for penetrating pipe sizes 100 mm (4 inches) and larger.
- L. Sleeves: Provide for pipes passing through masonry or concrete. Provide space between the pipe and the sleeve in accordance with NFPA 13. Seal this space with a UL Listed through penetration fire stop material in accordance with Section 07 84 00, FIRESTOPPING. Where core drilling is used in lieu of sleeves, also seal space. Seal penetrations of walls, floors and ceilings of other types of construction, in accordance with Section 07 84 00, FIRESTOPPING.

- M. Where dry pendent sprinklers are used for freezers or similar spaces and they are connected to the wet pipe system, provide an EPDM boot around the dry pendent sprinkler on the heated side and securely seal to the pipe and freezer to prevent condensation from entering the freezer.
- N. Provide pressure gauges at each water flow alarm switch location and at each main drain connection.
- O. Firestopping shall be provided for all penetrations of fire resistance rated construction. Firestopping shall comply with Section 07 84 00, FIRESTOPPING.
- P. Painting of Pipe: In finished areas where walls and ceilings have been painted and inside all stairways, paint primed surfaces with two coats of paint to match adjacent surfaces, except paint valves and operating accessories with two coats of gloss red enamel. Exercise care to avoid painting sprinklers. Painting of sprinkler systems above suspended ceilings and in crawl spaces is not required. Painting shall comply with Section 09 91 00, PAINTING. Any painted sprinkler shall be replaced with a new sprinkler.
- Q. Sprinkler System Signage: Provide rigid sprinkler system signage in accordance with NFPA 13 and NFPA 25. Sprinkler system signage shall include, but not limited to, the following:
 - 1. Identification Signs:
 - a. Provide signage for each control valve, drain valve, sprinkler cabinet, and inspector's test.
 - b. Provide valve tags for each operable valve. Coordinate nomenclature and identification of operable valves with COR. Where existing nomenclature does not exist, the Tag Identification shall include no less than the following: (FP-B-F/SZ-#) Fire Protection, Building Number, Floor Number/Smoke Zone (if applicable), and Valve Number. (E.g., FP-500-1E-001) Fire Protection, Building 500, First Floor East, Number 001.)
 - 2. Instruction/Information Signs:
 - a. Provide signage for each control valve to indicate valve function and to indicate what system is being controlled.
 - b. Provide signage indicating the number and location of low point drains.
 - 3. Hydraulic Placards:

- a. Provide signage indicating hydraulic design information. The placard shall include location of the design area, discharge densities, required flow and residual pressure at the base of riser, occupancy classification, hose stream allowance, flow test information, and installing contractor. Locate hydraulic placard information signs at each alarm check valve.
- R. Repairs: Repair damage to the building or equipment resulting from the installation of the sprinkler system by the installer at no additional expense to the Government.
- S. Interruption of Service: There shall be no interruption of the existing sprinkler protection, water, electric, or fire alarm services without prior permission of the Contracting Officer. Contractor shall develop an interim fire protection program where interruptions involve occupied spaces. Request in writing at least one week prior to the planned interruption.
- T. Piping arrangement shall avoid contact with other piping and equipment and allow clear access to other equipment or devices requiring access or maintenance.

3.2 INSPECTION AND TEST

- A. Preliminary Testing: Flush newly installed systems prior to performing hydrostatic tests in order to remove any debris which may have been left as well as ensuring piping is unobstructed. Hydrostatically test system, including the fire department connections, as specified in NFPA 13, in the presence of the Contracting Officers Representative (COR) or his designated representative. Test and flush underground water line prior to performing these hydrostatic tests.
- B. Final Inspection and Testing: Subject system to tests in accordance with NFPA 13, and when all necessary corrections have been accomplished, advise COR to schedule a final inspection and test. Connection to the fire alarm system shall have been in service for at least ten days prior to the final inspection, with adjustments made to prevent false alarms. Furnish all instruments, labor and materials required for the tests and provide the services of the installation foreman or other competent representative of the installer to perform the tests. Correct deficiencies and retest system as necessary, prior to the final acceptance. Include the operation of all features of the systems under normal operations in test

3.3 INSTRUCTIONS

Furnish the services of a competent instructor for not less than two hours for instructing personnel in the operation and maintenance of the system, on the dates requested by the COR.

- - - E N D - - -

SECTION 21 13 16
DRY-PIPE SPRINKLER SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Design, installation and testing shall be in accordance with NFPA 13.
- B. The design and installation of a hydraulically calculated automatic dry-pipe sprinkler system complete and ready for operation, for those locations as shown on the contract drawings.

1.2 RELATED WORK

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Section 07 84 00, FIRESTOPPING.
- C. Section 09 91 00, PAINTING.
- D. Section 28 31 00, FIRE DETECTION AND ALARM.

1.3 DESIGN CRITERIA

- A. Design Basis Information: Provide design, materials, equipment, installation, inspection, and testing of the automatic sprinkler system in accordance with the requirements of NFPA 13.
 - 1. Perform hydraulic calculations in accordance with NFPA 13 utilizing the Area/Density method, including all applicable design area increases.
 - 2. Sprinkler Protection: Sprinkler hazard classifications shall be in accordance with NFPA 13. The hazard classification examples of uses and conditions identified in the Annex of NFPA 13 shall be mandatory. Request clarification from the Government for any hazard classification not identified.
 - 3. Dry-pipe Sprinkler System Volume:
 - a. Contractor shall indicate the calculated volume of each system on the sprinkler system shop drawings.
 - b. For dry-pipe sprinkler systems with volumes greater than 1893 L (500 gal) up to 2839 L (750 gal), provide a quick opening device unless water delivery time calculations indicate the quick opening devices is not required.
 - c. For dry-pipe sprinkler systems with volumes greater than 2839 L (750 gal), provide calculations for water delivery time. Calculations shall demonstrate compliance with NFPA 13.
 - 4. Nitrogen Generator Plant: Coordinate sizing of nitrogen generator and air compressor with the nitrogen generator manufacturer.

5. Hydraulic Calculations: Calculated demand including hose stream requirements shall fall no less than 10 percent below the available water supply curve.
6. Water Supply: Base water supply on flow test of data provided by COR at start of project.

1.4 SUBMITTALS

- A. Submit as one package in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Prepare detailed working drawings that are signed by a NICET Level III or Level IV Sprinkler Technician or stamped by a Registered Professional Engineer licensed in the field of Fire Protection Engineering. As the Government review is for technical adequacy only, the installer remains responsible for correcting any conflicts with other trades and building construction that arise during installation. Partial submittals will not be accepted. Material submittals shall be approved prior to the purchase or delivery to the job site. Suitably bind submittals in notebooks or binders and provide an index referencing the appropriate specification section. In addition to the hard copies, provide submittal items in Paragraphs 1.4(A)1 through 1.4(A)5 electronically in pdf format on a compact disc or as directed by the COR. Submittals shall include, but not be limited to, the following:
 1. Qualifications:
 - a. Provide a copy of the installing contractors and state contractor's license.
 - b. Provide a copy of the NICET certification for the NICET Level III or Level IV Sprinkler Technician who prepared and signed the detailed working drawings unless the drawings are stamped by a Registered Professional Engineer licensed in the field of Fire Protection Engineering.
 - c. Provide documentation showing that the installer has been actively and successfully engaged in the installation of commercial automatic sprinkler systems for the past ten years.
 2. Drawings: Submit detailed 1:100 (1/8 inch) scale (minimum) working drawings conforming to the Plans and Calculations chapter of NFPA 13. Drawings shall include graphical scales that allow the user to determine lengths when the drawings are reduced in size. Include a plan showing the piping to the water supply test location.

3. **Manufacturer's Data Sheets:** Provide data sheets for all materials and equipment proposed for use on the system. Include listing information and installation instructions in data sheets. Where data sheets describe items in addition to those proposed to be used for the system, clearly identify the proposed items on the sheet.
4. **Calculation Sheets:**
 - a. Submit hydraulic calculation sheets in tabular form conforming to the requirements and recommendations of the Plans and Calculations chapter of NFPA 13.
 - b. For dry-pipe sprinkler systems with volumes more than 2838 L (750 gal), submit calculations for dry-pipe system water delivery time in accordance with NFPA 13.
5. **Valve Charts:** Provide a valve chart that identifies the location of each control valve. Coordinate nomenclature and identification of control valves with COR. Where existing nomenclature does not exist, the chart shall include no less than the following: Tag ID No., Valve Size, Service (control valve, main drain, aux. drain, inspectors test valve, etc.), and Location.
6. **Final Document Submittals:** Provide as-built drawings, testing and maintenance instructions in accordance with the requirements in Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. In addition, submittals shall include, but not be limited to, the following:
 - a. A complete set of as-built drawings showing the installed system with the specific interconnections between the system switches and the fire alarm equipment. Provide a complete set in the formats as follows. Submit items 2 and 3 below on a compact disc or as directed by the COR.
 - 1) One full size (or size as directed by the COR) printed copy.
 - 2) One complete set in electronic pdf format.
 - 3) One complete set in AutoCAD format or a format as directed by the COR.
 - b. **Material and Testing Certificate:** Upon completion of the sprinkler system installation or any partial section of the system, including testing and flushing, provide a copy of a completed Material and Testing Certificate as indicated in NFPA 13. Certificates shall be provided to document all parts of the installation.

- c. Operations and Maintenance Manuals that include step-by-step procedures required for system startup, operation, shutdown, and routine maintenance and testing. The manuals shall include the manufacturer's name, model number, parts list, and tools that should be kept in stock by the owner for routine maintenance, including the name of a local supplier, simplified wiring and controls diagrams, troubleshooting guide, and recommended service organization, including address and telephone number, for each item of equipment.
- d. One paper copy of the Material and Testing Certificates and the Operations and Maintenance Manuals above shall be provided in a binder. In addition, these materials shall be provided in pdf format on a compact disc or as directed by the COR.
- e. Provide one additional copy of the Operations and Maintenance Manual covering the system in a flexible protective cover and mount in an accessible location adjacent to the riser or as directed by the COR.

1.5 QUALITY ASSURANCE

- A. **Installer Reliability:** The installer shall possess a valid State of Michigan fire sprinkler contractor's license. The installer shall have been actively and successfully engaged in the installation of commercial automatic sprinkler systems for the past ten years.
- B. **Materials and Equipment:** All equipment and devices shall be of a make and type listed by UL or approved by FM, or other nationally recognized testing laboratory for the specific purpose for which it is used. All materials, devices, and equipment shall be approved by the VA. All materials and equipment shall be free from defect. All materials and equipment shall be new unless specifically indicated otherwise on the contract drawings.

1.6 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. National Fire Protection Association (NFPA):
 - 13-2016.....Installation of Sprinkler Systems
 - 25-2017Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems
 - 101-2018.....Life Safety Code

- C. Underwriters Laboratories, Inc. (UL):
 - Fire Protection Equipment Directory 2017
- D. Factory Mutual Engineering Corporation (FM):
 - Approval Guide 2017

PART 2 PRODUCTS

2.1 GENERAL

Dry-pipe sprinkler systems shall comply with the requirements of NFPA 13.

2.2 PIPING & FITTINGS

- A. Piping and fittings for private underground water mains shall be in accordance with NFPA 13.
 - 1. Pipe and fittings from inside face of building 300 mm (12 in.) above finished floor to a distance of approximately 1500 mm (5 ft.) outside building: Ductile Iron, flanged fittings and 316 stainless steel bolting.
- B. Piping and fittings for sprinkler systems shall be in accordance with NFPA 13.
 - 1. Plain-end pipe fittings with locking lugs or shear bolts are not permitted.
 - 2. Piping sizes 50 mm (2 inches) and smaller shall be black steel Schedule 40 with threaded end connections.
 - 3. Piping sizes 65 mm (2 ½ inches) and larger shall be black steel Schedule 10 with grooved connections. Grooves in Schedule 10 piping shall be rolled grooved only.

2.3 VALVES

- A. General:
 - 1. Valves shall be in accordance with NFPA 13.
 - 2. Do not use quarter turn ball valves for 50 mm (2 inch) or larger drain valves.
- B. Control Valve:
 - 1. Shall be a manually operated outside stem and yoke (OS&Y) type.
- C. Dry-pipe Valve:
 - 1. Shall be a latching differential type.
 - 2. Shall be complete with trim piping, valves, fittings, pressure gauges, priming water fill cup, velocity drip check, drip cup, and other ancillary components as required for proper operation.

3. For dry-pipe sprinkler systems with volumes more than 1893 L (500 gal), provide a quick opening device unless water delivery time calculations have proven no quick opening device is required.

4. Shall be capable of external reset.

2.4 FIRE DEPARTMENT SIAMESE CONNECTION (NOT USED)

2.5 SPRINKLERS

- A. All sprinklers shall be FM approved. All sprinklers shall be either upright type, dry pendent type, or dry sidewall type. Provide FM Approved quick response sprinklers in all areas, except that standard response sprinklers shall be provided in freezers, refrigerators, elevator hoistways, elevator machine rooms, and generator rooms.
- B. Temperature Ratings: In accordance with NFPA 13 except that sprinklers in elevator shafts and elevator machine rooms shall be no less than intermediate temperature rated and sprinklers in generator rooms shall be no less than high temperature rated.
- C. Provide sprinkler guards in accordance with NFPA 13 and when the elevation of the head is less than 7 feet 6 inches above finished floor. The sprinkler guard shall be listed or approved for use with the corresponding sprinkler.

2.6 SUPERVISORY NITROGEN SYSTEM (NOT USED)

2.7 SUPERVISORY AIR SYSTEM

- A. Provide an air supply system in accordance with NFPA 13 and the manufacturers' requirements. The air supply system shall be sized to pressurize the sprinkler system to 275 kPa (40 psi) within 30 minutes.
- B. Air Compressor: Compressor shall be tank mounted, single stage oil-free type, air-cooled, electric-motor driven, equipped with a check valve, shutoff valve, automatic drain on drip leg, and pressure switch for automatic starting and stopping. Pressure switch settings to start and stop the compressor shall be as required by system conditions. A safety relief valve shall be provided.

2.8 AIR PRESSURE MAINTENANCE DEVICE

Air Pressure Maintenance Device: Air pressure maintenance device shall be UL listed or FM approved and shall automatically reduce supply air pressure to provide the pressure required to be maintained in the piping system. The device shall have a cast bronze body and valve housing complete with diaphragm assembly, spring, filter, ball check to prevent backflow, 1.6 mm (1/16 inch) restriction to prevent rapid pressurization of the system, and adjustment screw. The device shall be

capable of reducing an inlet pressure of up to 680 kPa (100 psig) to a fixed outlet pressure adjustable to 70 kPa (10 psig).

2.9 SPRINKLER CABINET

- A. Provide sprinkler cabinet with the required number of sprinkler heads of all ratings and types installed, and a sprinkler wrench for each type of sprinkler in accordance with NFPA 13.
- B. Provide a list of sprinklers installed in the property in the cabinet. The list shall include the following:
 - 1. Manufacturer, model, orifice, deflector type, thermal sensitivity, and pressure for each type of sprinkler in the cabinet.
 - 2. General description of where each sprinkler is used.
 - 3. Quantity of each type present in the cabinet.
 - 4. Issue or revision date of list.

2.10 SPRINKLER SYSTEM SIGNAGE

Rigid plastic, steel or aluminum signs with white lettering on a red background with holes for easy attachment. Sprinkler system signage shall be attached to the valve or piping with chain.

2.11 SWITCHES

- A. OS&Y Valve Supervisory Switches shall be in a weatherproof die cast/red baked enamel, oil resistant, aluminum housing with tamper resistant screws, 13 mm (1/2 inch) conduit entrance and necessary facilities for attachment to the valves. Provide two SPDT switches rated at 2.5 amps at 24 VDC.
- B. Alarm Pressure Switches: Activation by any flow of water equal to or in excess of the discharge from one sprinkler. The alarm pressure switch shall be UL Listed or Factory Mutual Approved for the application in which it is used. Activation of the alarm pressure switch shall cause an alarm on the fire alarm system control unit.
- C. High/Low Pressure Supervisory Switches: The pressure switch shall be UL Listed or FM Approved and contain two single pole double throw contacts. Each switch shall be adjustable from 70 to 414 kPa (10 to 60 psi). The low pressure switch shall supervise pressure in the system and shall be set to activate at 70 kPa (10 psi) above the dry-pipe valve trip point pressure. The high pressure switch shall supervise pressure in the system and shall be set to activate at 70 kPa (10 psi) above the normal dry-pipe supervisory pressure. Activation of either high or low pressure switch shall cause a supervisory alarm on the fire alarm system control unit.

2.12 GAUGES

Provide gauges as required by NFPA 13. Provide gauges where the normal pressure of the system is at the midrange of the gauge.

2.13 PIPE HANGERS, SUPPORTS AND RESTRAINT OF SYSTEM PIPING

Pipe hangers, supports, and restraint of system piping shall be in accordance with NFPA 13.

2.14 WALL, FLOOR AND CEILING PLATES

Provide chrome plated steel escutcheon plates.

2.15 VALVE TAGS

Engraved black filled numbers and letters not less than 15 mm (1/2 inch) high for number designation, and not less than 8 mm (1/4 inch) for service designation on 19 gage, 40 mm (1-1/2 inches) round brass disc, attached with brass "S" hook, brass chain, or nylon twist tie.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Installation shall be accomplished by the licensed contractor. Provide a qualified technician, experienced in the installation and operation of the type of system being installed, to supervise the installation and testing of the system.
- B. Installation of Piping: Accurately cut pipe to measurements established by the installer and work into place without springing or forcing. In any situation where bending of the pipe is required, use a standard pipe-bending template. Conceal piping in spaces that have finished ceilings. In stairways, locate piping as near to the ceiling as possible to prevent tampering by unauthorized personnel and to provide a minimum headroom clearance of 2250 mm (seven feet six inches). Piping shall not obstruct the minimum means of egress clearances required by NFPA 101. Pipe hangers, supports, and restraint of system piping, shall be installed accordance with NFPA 13.
- C. Welding: Conform to the requirements and recommendations of NFPA 13.
- D. Pitching of Pipe: Conform to the requirements of NFPA 13.
- E. Drains: Provide drips and drains, including low point drains, in accordance with NFPA 13. Pipe drains to discharge at safe points outside of the building. Do not provide a direct drain connection to sewer system or discharge into sinks.

- F. Supervisory Switches: Provide supervisory switches for sprinkler control valves to monitor closure of the valve and for high and low system supervisory air/nitrogen pressure to monitor abnormal system pressures.
- G. Pressure Alarm Switches: Install alarm pressure switches in easily accessible locations.
- H. Inspector's Test Connection: Install and supply in conformance with NFPA 13, and discharge to the exterior of the building. Locate test connection in an area not susceptible to mechanical damage. For dry-pipe sprinkler systems more than 2800 L (750 gal), provide the number of equivalent sprinkler outlets as calculated for water delivery time in accordance with NFPA 13.
- I. Affix cutout disks, which are created by cutting holes in the walls of pipe for non-threaded pipe connections, to the respective pipe connection near to the pipe from where they were cut.
- J. Provide escutcheon plates for exposed piping passing through walls, floors or ceilings.
- K. Clearances: For systems requiring seismic protection, piping that passes through floors or walls shall have penetrations sized 50 mm (2 inches) nominally larger than the penetrating pipe for pipe sizes 25 mm (1 inch) to 90 mm (3 ½ inches) and 100 mm (4 inches) nominally larger for penetrating pipe sizes 100 mm (4 inches) and larger.
- L. Sleeves: Provide for pipes passing through masonry or concrete. Provide space between the pipe and the sleeve in accordance with NFPA 13. Seal this space with a UL Listed through penetration fire stop material in accordance with Section 07 84 00, FIRESTOPPING. Where core drilling is used in lieu of sleeves, also seal space around penetrations. Seal penetrations of walls, floors and ceilings of other types of construction, in accordance with Section 07 84 00, FIRESTOPPING.
- M. Firestopping shall be provided for all penetrations of fire resistance rated construction. Firestopping shall comply with Section 07 84 00, FIRESTOPPING.
- N. Painting of Pipe: In finished areas where walls and ceilings have been painted, paint primed surfaces with two coats of paint to match adjacent surfaces, except paint valves and operating accessories with two coats of gloss red enamel. Exercise care to avoid painting sprinklers. Painting of sprinkler systems above suspended ceilings and in crawl spaces is not required. Painting shall comply with Section 09

90 00, PAINTING. Any painted sprinkler shall be replaced with a new sprinkler.

- O. Locate sprinkler cabinet adjacent to the dry-pipe sprinkler system riser or as directed by COR.
- P. Sprinkler System Signage: Provide rigid sprinkler system signage in accordance with NFPA 13 and NFPA 25. Sprinkler system signage shall include, but not limited to, the following:
 - 1. Identification Signs:
 - a. Provide signage for each control valve, drain valve, sprinkler cabinet, and inspector's test.
 - b. Provide valve tags for each operable valve. Coordinate nomenclature and identification of operable valves with COR. Where existing nomenclature does not exist, the Tag Identification shall include no less than the following: (FP-B-F/SZ-#) Fire Protection, Building Number, Floor Number/Smoke Zone (if applicable), and Valve Number. (E.g., FP-500-1E-001) Fire Protection, Building 500, First Floor East, Number 001.)
 - 2. Instruction/Information Signs:
 - a. Provide signage for each control valve to indicate valve function and to indicate what system is being controlled.
 - b. Provide signage indicating the number and location of low point drains.
 - 3. Hydraulic Placards:
 - a. Provide signage indicating hydraulic design information. The placard shall include location of the design area, discharge densities, required flow and residual pressure at the base of riser, occupancy classification, hose stream allowance, flow test information, and installing contractor. Locate hydraulic placard information signs at each dry-pipe valve.
- Q. Repairs: Repair damage to the building or equipment resulting from the installation of the sprinkler system by the installer at no additional expense to the Government.
- R. Interruption of Service: There shall be no interruption of the existing sprinkler protection, water, electric, or fire alarm services without prior permission of the Contracting Officer Representative. Contractor shall develop an interim fire protection program where interruptions involve in occupied spaces. Request in writing at least one week prior to the planned interruption.

3.2 INSPECTION AND TEST

- A. Preliminary Testing: Flush newly installed systems prior to performing tests in order to remove any debris which may have been left as well as ensuring piping is unobstructed. Hydrostatically test system, including the fire department connections, pneumatically test system, test air compressor fill time to operating pressure within 30 minutes, and trip test system as specified in NFPA 13, in the presence of the Contracting Officers Representative (COR) or their designated representative. For dry-pipe sprinkler systems with a quick-opening device, the system shall be trip tested with the quick-opening device functioning and with the quick-opening device disabled. Record the time to water delivery for each test. Demonstrate pitch of pipe is in compliance with NFPA 13.
- B. Final Inspection and Testing: Subject system to tests in accordance with NFPA 13, and when all necessary corrections have been accomplished, advise COR to schedule a final inspection and test. Connection to the fire alarm system shall have been in service for at least ten days prior to the final inspection, with adjustments made to prevent false alarms. Furnish all instruments, labor and materials required for the tests and provide the services of the installation foreman or other competent representative of the installer to perform the tests. Correct deficiencies and retest system as necessary, prior to the final inspection and testing. Include the operation of all features of the systems under normal operations in test. At the conclusion of final inspection and testing, blow out dry-pipe system piping using compressed air. Verify piping is fully drained, including low point drains.
- C. Post-Final Inspection: One month after final inspection and testing, the contractor shall manually verify that the system piping has a nitrogen concentration of at least 98%. Advise COR to schedule post-final inspection.
- D. Final Contractual Acceptance: Final contractual acceptance will be given after successful completion of the final inspection and testing and post-final inspection. The warranty period shall begin after final contractual acceptance.

3.3 INSTRUCTIONS

Furnish the services of a competent instructor for not less than two hours for instructing personnel in the operation and maintenance of the system on the dates requested by the COR.

- - - E N D - - -

SECTION 21 22 00
CLEAN AGENT FIRE SUPPRESSION SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

A. Design, installation and testing of a calculated automatic and manual fixed total flooding clean agent fire extinguishing system and releasing system in accordance with NFPA 2001, NFPA 72, NFPA 70, and NFPA 75 and manufacturer's written instructions for the Building 1, B-200 Telephone Equipment Room. The installation shall include all mechanical, controls and electrical components necessary for a complete and operating clean agent fire suppression system.

1.2 RELATED WORK

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES
- B. Section 07 84 00, FIRESTOPPING
- C. Section 09 91 00, PAINTING
- D. Section 28 05 13, CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY
- E. Section 28 05 28.33, CONDUIT AND BACKBOXES FOR ELECTRONIC SAFETY AND SECURITY
- F. Section 28 31 00, FIRE DETECTION AND ALARM

1.3 DESIGN CRITERIA

- A. The clean agent fire extinguishing system shall be a fixed total flooding type utilizing clean agent designed to provide a uniform concentration throughout the protected spaces in accordance with NFPA 2001 for a Class C fire.
 - 1. The system shall provide a minimum design concentration by volume, throughout the protected spaces at the minimum anticipated temperature within the protected space.
 - 2. The design concentration within any protected space shall not exceed by volume the no observable adverse effects level (NOAEL). Special means such as mechanical exhaust, shall not be permitted to be used to achieve this criterion.

3. The clean agent shall have a global warming potential (GWP) of less than 4000 and the clean agent shall be readily available throughout the continental United States.
4. Provide the quantity of clean agent as required by NFPA 2001 and manufacturer's written instructions. Such factors as unenclosed openings (if any), "rundown" time of fans, time required for dampers to close, and any other feature of the facility that could affect concentration shall be taken into consideration.

1.4 SUBMITTALS

- A. Submit as one package in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Prepare detailed working drawings that are signed by a NICET Level IV Special Hazards Suppression Systems Technician. As the Government review is for technical adequacy only, the installer remains responsible for correcting any conflicts with other trades and building construction that arise during installation. Partial submittals will not be accepted. Material submittals shall be approved prior to the purchase or delivery to the job site. Suitably bind submittals in notebooks or binders and provide an index referencing the appropriate specification section. In addition to the hard copies, provide submittal items in Paragraphs 1.4 (A) 1 through 1.4 (A) 5 electronically in pdf format on a compact disc or as directed by the Contracting Officers Representative (COR). Submittals shall include, but not be limited to, the following:

1. Qualifications:

- a. Provide a copy of the Special Suppression Systems contractors license.
 - b. Provide a copy of the NICET certification for the NICET Level IV Special Hazards Suppression System Technician who will prepare and sign the detailed working drawings.
 - c. Provide documentation showing that the installer has been actively and successfully engaged in the installation of clean agent fire suppression systems for the past ten years.
2. Drawings: Submit detailed 1:100 (1/8 inch) scale (minimum) working plans and drawings of the clean agent fire extinguishing system conforming to NFPA 2001. Submit detailed 1:100 (1/8 inch) scale (minimum) working plans and drawings of the releasing system conforming to NFPA 72. Drawings shall include graphical scales that

allow the user to determine lengths when the drawings are reduced in size.

3. Manufacturers Data Sheets:

a. Provide for all materials and equipment proposed for use on the clean agent fire extinguishing system, including the releasing system. Include listing information and installation instructions in data sheets. Where data sheet describes items in addition to that item being submitted, clearly identify proposed item on the sheet.

4. Calculation Sheets:

a. Submit flow calculation sheets in tabular form conforming to the requirements of NFPA 2001. Calculations shall include total storage capacity, flooding concentrations, enclosure leakage rates, discharge times, flow through distribution network, pipe sizes, and nozzle orifice sizes.

b. Submit battery calculations sheets in tabular form conforming to the requirements of NFPA 72.

c. Submit voltage drop calculations in tabular form. Calculations shall indicate circuit amperage draw, wire resistance, circuit length, and voltage drop. The voltage drop shall demonstrate that voltage provided at the each appliance is within its operating voltage range. Voltage drop calculations shall assume an initial voltage of 20.4 volts.

5. Clean Agent Recharging Certification: Provide a letter to the COR or his designated representative certifying that the installer maintains or has access to a clean agent recharging station. The installer shall also provide proof of the ability to recharge the largest clean agent fire extinguishing system capacity within 48 hours.

6. Test Plan: Provide a test plan to the COR or his designated representative. The testing plan shall describe the procedures to be used to test the system. The testing plan shall include a step-by-step procedure of all tests to be performed, including indication of which tests will present a disruption to building occupants. No tests shall be conducted until the testing plan is approved by the COR or his designated representative.

7. Final Document Submittals: Provide as-built drawings, testing and maintenance instructions in accordance with the requirements in Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Submittals shall include, but not be limited to, the following:
 - a. A complete set of as-built drawings showing the installed system with the specific interconnections between the system switches and the fire alarm equipment. Provide a complete set in the formats as follows. Submit items 2 and 3 below on a compact disc or as directed by the COR.
 - 1) One full size (or size as directed by the COR) printed copy.
 - 2) One complete set in electronic pdf format.
 - 3) One complete set in AutoCAD format or a format as directed by the COR.
 - b. System Certification: Upon completion of the clean agent fire extinguishing system installation, including testing, the authorized representative of the manufacturer of the major equipment shall certify that the installation complies with all manufacturer's requirements and that satisfactory total system operation has been achieved. Provide a copy of the Record of Completion for the releasing system in accordance with NFPA 72.
 - c. Operating and Maintenance Manuals that include step-by-step procedures required for operation, shutdown, and routine maintenance and testing. The manuals shall include the manufacturer's name, model number, parts list, the name of the local supplier, simplified wiring and controls diagrams, troubleshooting guide, and recommended service organization, including address and telephone number, for each item of equipment.
 - d. One paper copy of the System Certification and Record of Completion and the Operating and Maintenance Manuals listed above shall be provided in a binder. In addition, these materials shall be provided in pdf format on a compact disc or as directed by the COR.
 - e. Provide one additional copy of the Operations and Maintenance Manual for the system in a binder and mount in an accessible location adjacent to the storage cylinder(s).

1.5 QUALITY ASSURANCE

- A. **Installer Reliability:** The installer shall possess a valid State of Michigan contractor's license. The installer shall have been actively and successfully engaged in the installation of clean agent special suppression systems for the past ten years. The installer shall maintain or have access to a clean agent recharging station. The installer shall provide proof of the ability to recharge the largest clean agent fire extinguishing system capacity within 48 hours.
- B. **Materials and Equipment:** All equipment and devices shall be UL listed or approved by FM. All materials, devices, and equipment shall be approved by the VA. All materials and equipment shall be free from defect.

1.6 APPLICABLE PUIBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. **National Fire Protection Association (NFPA):**
 - 70-2017.....National Electric Code
 - 72-2016.....National Fire Alarm Code
 - 75-2017.....Fire Protection of Information Technology
Equipment
 - 2001-2015.....Installation of Clean Agent Fire Extinguishing
Systems
- C. **Underwriters Laboratories, Inc. (UL):**
 - 2015..... Fire Protection Equipment Directory
- D. **Factory Mutual Engineering Corporation (FM):**
 - 2015..... Approval Guide

1.7 WARRANTY

All work performed and all material and equipment furnished under this contract shall be free from defects and shall remain so for a period of one year from the date of acceptance of the entire installation by the COR.

PART 2 PRODUCTS

.1 GENERAL

All equipment and components shall be new and the manufacturer's current model. All equipment and components shall match existing NOVEC 1230 systems at the site and be UL listed or FM approved for its

intended use. The authorized representative of the NOVEC 1230 system shall certify that the installation complies with all manufacturer's requirements and that satisfactory total system operation has been achieved.

2.2 CLEAN AGENT FIRE EXTINGUISHING SYSTEM

A. General:

1. The clean agent fire extinguishing system shall be UL listed and shall be in accordance with NFPA 2001.

B. Piping and fittings:

1. All piping and fittings shall be in compliance with NFPA 2001.
2. Multi-outlet fittings, other than tees, shall not be permitted.
3. All piping shall be reamed, blown clear, and swabbed with appropriate solvent to remove mill varnish and cutting oils before assembly.
4. Ordinary cast iron steel and non-metallic piping and fittings and flexible hoses shall not be used unless specifically required by the manufacturer.

C. Piping Support:

1. All piping shall be supported in accordance with the manufacturer's written instructions.
2. Piping shall be supported within 12 inches (304 mm) of discharge nozzles. The supports shall prevent the upward movement of the nozzle.

D. Storage Cylinders:

1. Provide storage cylinders as required by the manufacturer's written instructions and in accordance with NFPA 2001.
2. Cylinder assemblies shall be of steel construction designed to meet the requirements of the U.S. Department of Transportation.
3. Filling of the storage cylinders shall be by an authorized systems distributor in conjunction with a factory authorized agent filling station. Initial filling and recharge shall be performed in accordance with manufacturer's written instructions and shall not require replacement components for normal service.
4. Cylinders shall be securely attached to the wall. Provide factory- or field-fabricated retaining brackets consisting of steel straps and channels; suitable for container support, maintenance, and tank refilling or replacement.

5. For halocarbon clean agents, storage cylinders shall be provided with a low agent pressure switch.

E. Valve Actuators:

1. Electric valve actuators shall be of brass construction and stackable design with swivel connections to allow removal of actuators for maintenance or testing.
2. Operation of actuators shall not require replacement of components. No electro-explosive devices may be used to actuate the valve assembly. Actuators shall include an indication if they are set or actuated.
3. Electric valve actuators shall be magnetic latch, continuous duty type for 24 VDC operation.
4. Actuation devices shall be UL listed or FM approved for use with the system.
5. Removal of the electric valve actuator shall cause a trouble on the clean agent control panel.

F. Discharge Nozzles:

1. Nozzles shall be permanently marked with the manufacturer's part number. The nozzles shall be threaded directly to the discharge piping without the use of special adaptors.

2.3 RELEASING SYSTEM

A. General

1. The releasing system shall be an analog addressable intelligent reporting, microprocessor controlled system, capable of remote sensitivity testing of the smoke detectors, and be installed in accordance with NFPA 70, NFPA 72, and NFPA 2001.

B. Clean Agent Control Panel:

1. General:
 - a. The clean agent control panel shall be UL listed or FM approved and include a UL listed or FM approved releasing module.
 - b. Each protected space shall be provided with its own clean agent control unit.
 - c. All circuits shall be monitored for integrity.
 - d. Visually and audibly annunciate all alarm, supervisory, and trouble signals including, but not limited to main power failure, open circuit, short circuit, ground faults, and system bypass activation.

- e. The panel or releasing module shall include a 0-60 second programmable timer.
 - f. The clean agent control panel shall be provided with separate contacts to provide common supervisory, alarm, and trouble signals to the main building fire alarm system.
2. Enclosure:
- a. The clean agent control unit shall be housed in a cabinet suitable for both recessed and surface mounting. The cabinet and front panel shall be corrosion protected, given a rust-resistant prime coat, and manufacturer's standard finish.
 - b. The cabinet shall contain all necessary relays, terminals, lamps, and legend plates to provide control for the system.
3. Power Supply:
- a. The clean agent control unit shall derive its normal power from a 120 volt, 60 Hz dedicated supply connected to the emergency power system on the basement floor level as directed by the COR. Standby power shall be provided by a 24 volt DC battery as hereinafter specified. The normal power shall be transformed, rectified, coordinated, and interfaced with the standby battery and charger.
 - b. The power supply for smoke detection systems shall be taken from the clean agent control unit.
4. Circuit Supervision: Each alarm initiating device circuit, signaling line circuit, and notification appliance circuit, shall be supervised against the occurrence of an open, short circuit, or ground fault condition in the field wiring. These conditions shall cause a trouble signal to sound in the control unit until manually silenced by an off switch.
- a. Initiating device circuits (IDC) shall be wired Class B in accordance with NFPA 72.
 - b. Signaling line circuits (SLC) shall be wired Class B in accordance with NFPA 72.
 - c. Notification appliance circuits (NAC) shall be wired Class B in accordance with NFPA 72.
5. Supervisory Alarm Devices: The low agent pressure switch and maintenance lock-out switch shall initiate a supervisory signal.
6. Trouble signals:

- a. Arrange the trouble signals for automatic reset (non-latching).
 - b. System trouble switch off and on lamps shall be visible through the control unit door.
7. Function Switches: Provide the following switches in addition to any other switches required for the system:
- a. Remote Alarm Transmission By-pass Switch: Shall prevent transmission of all signals to the building fire alarm control unit when in the "off" position. A clean agent control unit system trouble signal shall be energized when switch is in the off position.
 - b. Alarm Off Switch: Shall disconnect power to notification appliance circuits on the clean agent control panel. A system trouble signal shall be activated when the switch is in the off position.
 - c. Trouble Silence Switch: Shall silence the trouble signal whenever the trouble silence switch is operated. This switch shall not reset the trouble signal.
 - d. Reset Switch: Shall reset the system after an alarm, provided the initiating device has been reset. The system shall lock in alarm until reset.
 - e. Lamp Test Switch: A test switch or other approved convenient means shall be provided to test the indicator lamps.
 - f. AHU By-Pass: Provide a means to disable air handling units shutdown and dampers from closing upon operation of an initiating device designed to interconnect with these devices. A system trouble signal shall be activated when switch is in the off position.
8. Reset2 Capability: Each clean agent control unit shall be installed and programmed so that each must be reset locally after an alarm, before the main fire alarm control unit can be reset.
- C. Conduit, Boxes, and Wire
1. Conduit shall be in accordance with Section 28 05 33 RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS and as follows:
 - a. All new conduits shall be installed in accordance with NFPA 70.
 - b. Conduit fill shall not exceed 40 percent of interior cross sectional area.
 - c. All new conduits shall be 3/4 inch (19 mm) minimum.

2. Wire:

- a. Wiring shall be installed in conduit.
- b. Wiring shall be in accordance with NEC article 760, Section 26 05 19, LOW VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES, and as recommended by the manufacturer of the fire alarm system. All wires shall be color coded. Number and size of conductors shall be as recommended by the fire alarm system manufacturer, but not less than 18 AWG for initiating device circuits and 14 AWG for notification appliance circuits.
- c. Signaling line circuits shall be twisted and shielded unless other wiring methods are specifically required by the fire alarm equipment manufacturer in writing.

3. Terminal Boxes, Junction Boxes, and Cabinets:

- a. These shall be galvanized steel in accordance with UL requirements.
- b. All boxes shall be sized and installed in accordance with NFPA 70.
- c. Covers shall be repainted red in accordance with Section 09 91 00, PAINTING and shall be identified with white markings as "CA FA" or as directed by the COR for junction boxes and as "CLEAN AGENT FIRE ALARM SYSTEM" for cabinets and terminal boxes. Lettering shall be a minimum of 3/4 inch (19 mm) high.
- d. Terminal boxes and cabinets shall have a volume 50 percent greater than required by NFPA 70. Minimum sized wire shall be considered as 14 AWG for calculation purposes.
- e. Terminal boxes and cabinets shall have identified screw type terminal strips and shall be located in an accessible location. Terminal strips shall be labeled as to what circuit it is or as approved by the COR.

D. Standby Power Supply

1. Batteries:

- a. The batteries shall be of the sealed, maintenance free type, 24-volt nominal.
- b. The batteries shall have sufficient capacity to power the clean agent control panel and its peripherals for not less than 24 hours plus 5 minutes of alarm to an end voltage of 1.14 volts per cell, upon a normal AC power failure.

- c. Battery racks shall be steel with an alkali-resistant finish.
2. Battery Charger:
 - a. The battery charger shall be completely automatic, with constant potential charger maintaining the battery fully charged under all service conditions. Charger shall operate from a 120-volt, 60 hertz emergency power source.
 - b. The battery charger shall be rated for fully charging a completely discharged battery within 48 hours while simultaneously supplying any loads connected to the battery.
 - c. The battery charger shall have protection to prevent discharge through the charger.
 - d. The battery charger shall have protection for overloads and short circuits on both AC and DC sides.
 - e. A trouble condition shall actuate the fire alarm trouble signal.
 - f. The battery charger shall have automatic AC line voltage regulation, automatic current-limiting features, and adjustable voltage controls.
- E. Spot-type Smoke Detectors
 1. Smoke detectors shall be photoelectric plug-in type and UL listed for use with the clean agent control panel being furnished. Each detector shall be monitored individually, via an integral, analog addressable element.
 2. Photoelectric detectors shall be factory calibrated and readily field adjustable. The sensitivity of any photoelectric detector shall be factory set at 3.0 plus or minus 0.25 percent obscuration per foot.
 3. Smoke detectors IN the protected spaces shall be spaced in accordance with NFPA 72 for high air movement areas. Air velocities within the protected spaces shall be suitable for the listed detection air velocity range of the smoke detector.
 4. Each protected space (above and below the suspended ceiling) shall have at least 2 detectors.
 5. Provide red stickers with an "A" on the ceiling below the location of the above ceiling smoke detectors when above ceiling detectors are provided. Each sticker shall also include the address of the detector. The address shall be the same as that address that shows on the fire alarm control unit when the detector is activated.

F. Manual Activation Stations:

1. Shall be non-break glass, address reporting type.
2. Station front shall be constructed of durable material such as cast or extruded metal or high impact plastic. Stations shall be semi-flush type.
3. Shall be of dual action pull down type with suitable operating instructions provided on front in raised or depressed letters, and clearly labeled "AGENT RELEASE."
4. Operating handles shall be constructed of a durable material. On operation, the lever shall lock in alarm position and remain so until physically reset. A key shall be required to gain front access for resetting, or conducting tests and drills.
5. Shall be located to the left of the room door.

G. Notification Appliances:

1. Pre-discharge Bells:
 - a. Shall be 24 VDC and be capable of producing an alarm signal of not less than 85 dBa at 10 feet.
 - b. Shall be at least 6 inches (150 mm) in diameter.
 - c. Locate inside and directly outside Room 1-B200.
2. Pre-discharge Strobes:
 - a. Be listed in accordance with UL 1971.
 - b. Shall be a minimum of 75 candela.
 - c. Shall be provided with an amber lens.
 - d. Shall be synchronized with other pre-discharge strobes in the protected space.
 - e. Locate inside and directly outside Room 1-B200
3. Discharge Strobes:
 - a. Be listed in accordance with UL 1971.
 - b. Shall be a minimum of 75 candela.
 - c. Shall be provided with a red lens.
 - d. Shall be synchronized with other discharge strobes outside the protected space.

H. Addressable Interface Module

1. Addressable interface modules shall be installed in individual boxes in accordance with the manufacturer's product listing. The addressable interface module shall be provided with a protective cover provided by the device manufacturer. The protective cover

shall have the provision for viewing the operational LED of the addressable interface module. Addressable interface modules shall not be installed in a back-box with other devices or relays.

2. The installer shall provide, install, and test addressable interface modules as necessary to comply with the sequence of operations, whether shown on the drawings or not.

I. Graphic Floor Plans:

1. Provide readable scaled graphics of the protected area. The graphics shall show the location and address of each the ceiling smoke detectors, and above ceiling smoke detectors.
2. The graphic shall be framed and shall be located in an area approved by the COR.

J. Abort Switches:

1. The abort switch front shall be constructed of durable material such as cast or extruded metal or high impact plastic. The abort switch shall be semi-flush type.
2. The abort switch shall not be a locking or keyed type.
3. The abort switch shall be of single action dead-man spring loaded type with suitable operating instructions provided on front in raised or depressed letters, and clearly labeled "ABORT."

2.4 SWITCHES

A. Maintenance Lock-out Switch

1. Shall be key-operated only allowing the removal of the key in the "Normal" position. A red indicator lamp shall be included on the switch assembly to be illuminated when in the "Lock-out" position. The clean agent control panel shall indicate a supervisory alarm condition when in the "Lock-out" position.
2. The terminals shall be of the screw type.
3. Shall be provided adjacent to the clean agent control panel.

2.5 SIGNAGE

- A. Signage shall have white lettering on a red plastic background.
- B. The letters shall be 1 inch (25 mm) high with a stroke width of 3/8 inches (9.5 mm).

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Installation shall be accomplished by the licensed contractor. Provide a factory trained qualified technician, experienced in the installation and operation of the type of system being installed, to supervise the installation and testing of the system.
- B. Install clean agent fire extinguishing system piping and fittings level and plumb, according to manufacturer's written instructions.
- C. Where installing piping adjacent to equipment, allow space for service and maintenance.
- D. Identify piping, agent storage cylinders, and control panels with signage in accordance with NFPA 2001.
- E. Provide signage for the pre-discharge bells and strobes. The sign shall say "FIRE. [Agent Surname] RELEASE IMMINENT". The sign shall be permanently affixed to the wall within 12 inches (304 mm) of the pre-discharge strobe.
- F. Provide signage for the discharge strobes. The sign shall say "[Agent Surname] DISCHARGE". The sign shall be permanently affixed to the wall within 12 inches (304 mm) of the discharge strobe.
- G. Provide signage on the exterior of the protected space at each entrance. The sign shall say "THIS SPACE IS PROTECTED BY A CLEAN AGENT FIRE EXTINGUISHING SYSTEM. DO NOT ENTER WITHOUT AUTHORIZATION DURING OR AFTER DISCHARGE. THE RED STROBE INDICATES SYSTEM DISCHARGE." The sign shall be permanently affixed to the wall adjacent to the door.
- H. Provide signage adjacent to each manual activation station. The sign shall say "ACTUATION OF THIS DEVICE WILL CAUSE FIRE SUPPRESSION GAS TO DISCHARGE. BEFORE ACTUATING, ENSURE THAT PERSONNEL ARE CLEAR OF THE AREA." The sign shall be permanently affixed to the wall within 12 inches (304 mm) of the station.
- I. Firestopping shall be provided for all penetrations of fire resistance rated construction. Firestopping shall comply with Section 07 84 00, FIRESTOPPING.
- J. Repairs: Repair damage to the building or equipment resulting from the installation of the clean agent fire extinguishing system by the installer at no additional expense to the Government.

- K. Supervise clean agent control panel for alarm, supervisory, and trouble signals by the building fire alarm system in accordance with Section 28 31 00, FIRE DETECTION AND ALARM.

3.2 SEQUENCE OF OPERATIONS

- A. The clean agent extinguishing fire extinguishing system shall operate as follows:
1. Activation of any single smoke detector shall:
 - a. Energize an alarm LED lamp on the activated detector and clean agent control panel.
 - b. Transmit an alarm signal to the building's fire alarm system.
 2. Activation of a second smoke detector shall:
 - a. Energize an alarm LED lamp on the activator detector.
 - b. Activate pre-discharge bell notification appliance and pre-discharge strobe notification appliance.
 - c. Shut down power to electronic equipment within the protected space, close dampers, release door hold open devices, and shut down air handling units serving the protected space.
 - d. Initiate a programmable 30-second time delay (agent release) sequence.
 3. Activation of a manual activation station shall:
 - a. Energize an alarm LED lamp on the clean agent control panel.
 - b. Activate pre-discharge bell notification appliance and pre-discharge strobe notification appliance.
 - c. Shut down power to electronic equipment within the protected space, close dampers, release door hold open devices, and shut down air handling units serving the protected space.
 - d. Transmit an alarm signal to the building's fire alarm system.
 - e. Initiate a programmable 20-second time delay (agent release) sequence.
 4. Activation of the abort switch shall:
 - a. Cease the time delay. Once the abort switch is released, the time delay countdown shall resume from where it ceased. The time delay shall not reset.
 - b. Transmit a trouble signal to the building's fire alarm system.
 5. Upon completion of the time delay, the system shall:
 - a. De-energize the pre-discharge bell and pre-discharge strobe notification appliance.

- b. Activate a discharge strobe notification appliance inside and outside of the protected area.
- c. Energize valve actuator for agent cylinders releasing gaseous agent into the protected area.
- 6. Activation of the low agent tank pressure switch and maintenance lock-out switch shall:
 - a. Energize a supervisory LED lamp on the clean agent control panel.
 - b. Transmit a supervisory alarm signal to the building's fire alarm system.
- 7. Presence of any fault, bypass function, or removal of the electric valve actuator shall:
 - a. Energize a trouble LED lamp on the clean agent control panel.
 - b. Transmit a trouble signal to the building's fire alarm system.
- 8. Activation of duct detector within a computer room air condition unit shall energize a supervisory signal LED lamp on the clean agent control panel.

3.3 INSPECTION AND TEST

- A. Room Enclosure Test: A room pressurization test shall be conducted for the protected space. The testing shall be done in accordance with NFPA 2001 Annex C. The contractor shall be responsible for sealing the enclosure to ensure the success of the room pressurization test. The test shall be deemed successful if the tested leakage rate is less than or equal to the leakage rate assumed in the calculations.
- B. Pressure Test: Pneumatically pressure test piping in a closed circuit in accordance with NFPA 2001.
- C. Flow Test: Subject system to a flow test utilizing nitrogen to verify that flow is continuous and that the piping and nozzles are unobstructed.
- D. Preliminary Testing: System function operation test system as specified in NFPA 2001 and NFPA 72, in the presence of the COR or his designated representative.
- E. Final Inspection and Testing: Subject system to tests in accordance with NFPA 2001 and NFPA 72, and when all necessary corrections have been accomplished, advise COR to schedule a final inspection and test. Connection to the fire alarm system shall have been in service for at least ten days prior to the final inspection, with adjustments made to prevent false alarms. Furnish all instruments, labor and materials

required for the tests and provide the services of the installation foreman or other competent representative of the installer to perform the tests. Correct deficiencies and retest system as necessary, prior to the final acceptance. Include the operation of all features of the systems under normal operations in test.

3.4 TRAINING

- A. The manufacturer's authorized representative shall provide instruction and training to the VA on the dates requested by the COR as follows:
 - 1. Six 1-hour sessions to employees working in protected area, engineering staff, security police and VA Fire Department personnel where there is a VA Fire Department present on site for simple operation of the system. Two sessions at the start of installation, 2 sessions at the completion of installation and 2 sessions 3 months after the completion of installation.
 - 2. Four 2-hour sessions to engineering staff for detailed operation of the system. Two sessions at the completion of installation and 2 sessions 3 months after the completion of installation.
 - 3. Three 8-hour sessions to electrical technicians for maintaining, programming, modifying, and repairing the system at the completion of installation and one 8-hour refresher session 3 months after the completion of installation.
- B. Each initial training session shall be videotaped.

- - - E N D - - -

SECTION 26 05 11
REQUIREMENTS FOR ELECTRICAL INSTALLATIONS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section applies to all sections of Division 26.
- B. Furnish and install electrical systems, materials, equipment, and accessories in accordance with the specifications and drawings. Capacities and ratings of motors, transformers, conductors and cable, switchboards, switchgear, panelboards, motor control centers, generators, automatic transfer switches, and other items and arrangements for the specified items are shown on the drawings.
- D. Conductor ampacities specified or shown on the drawings are based on copper conductors, with the conduit and raceways sized per NEC. Aluminum conductors are prohibited.

1.2 MINIMUM REQUIREMENTS

- A. The latest International Building Code (IBC), Underwriters Laboratories, Inc. (UL), Institute of Electrical and Electronics Engineers (IEEE), and National Fire Protection Association (NFPA) codes and standards are the minimum requirements for materials and installation.
- B. The drawings and specifications shall govern in those instances where requirements are greater than those stated in the above codes and standards.

1.3 TEST STANDARDS

- A. All materials and equipment shall be listed, labeled, or certified by a Nationally Recognized Testing Laboratory (NRTL) to meet Underwriters Laboratories, Inc. (UL), standards where test standards have been established. Materials and equipment which are not covered by UL standards will be accepted, providing that materials and equipment are listed, labeled, certified or otherwise determined to meet the safety requirements of a NRTL. Materials and equipment which no NRTL accepts, certifies, lists, labels, or determines to be safe, will be considered if inspected or tested in accordance with national industrial standards, such as ANSI, NEMA, and NETA. Evidence of compliance shall include certified test reports and definitive shop drawings.
- B. Definitions:

1. Listed: Materials and equipment included in a list published by an organization that is acceptable to the Authority Having Jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production or listed materials and equipment or periodic evaluation of services, and whose listing states that the materials and equipment either meets appropriate designated standards or has been tested and found suitable for a specified purpose.
2. Labeled: Materials and equipment to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the Authority Having Jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled materials and equipment, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.
3. Certified: Materials and equipment which:
 - a. Have been tested and found by a NRTL to meet nationally recognized standards or to be safe for use in a specified manner.
 - b. Are periodically inspected by a NRTL.
 - c. Bear a label, tag, or other record of certification.
4. Nationally Recognized Testing Laboratory: Testing laboratory which is recognized and approved by the Secretary of Labor in accordance with OSHA regulations.

1.4 QUALIFICATIONS (PRODUCTS AND SERVICES)

- A. Manufacturer's Qualifications: The manufacturer shall regularly and currently produce, as one of the manufacturer's principal products, the materials and equipment specified for this project, and shall have manufactured the materials and equipment for at least three years.
- B. Product Qualification:
 1. Manufacturer's materials and equipment shall have been in satisfactory operation, on three installations of similar size and type as this project, for at least three years.
 2. The Government reserves the right to require the Contractor to submit a list of installations where the materials and equipment have been in operation before approval.

- C. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within eight hours of receipt of notification that service is needed. Submit name and address of service organizations.

1.5 APPLICABLE PUBLICATIONS

- A. Applicable publications listed in all Sections of Division 26 shall be the latest issue, unless otherwise noted.
- B. Products specified in all sections of Division 26 shall comply with the applicable publications listed in each section.

1.6 MANUFACTURED PRODUCTS

- A. Materials and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items, and for which replacement parts shall be available. Materials and equipment furnished shall be new, and shall have superior quality and freshness.
- B. When more than one unit of the same class or type of materials and equipment is required, such units shall be the product of a single manufacturer.
- C. Equipment Assemblies and Components:
1. Components of an assembled unit need not be products of the same manufacturer.
 2. Manufacturers of equipment assemblies, which include components made by others, shall assume complete responsibility for the final assembled unit.
 3. Components shall be compatible with each other and with the total assembly for the intended service.
 4. Constituent parts which are similar shall be the product of a single manufacturer.
- D. Factory wiring and terminals shall be identified on the equipment being furnished and on all wiring diagrams.

1.7 VARIATIONS FROM CONTRACT REQUIREMENTS

- A. Where the Government or the Contractor requests variations from the contract requirements, the connecting work and related components shall include, but not be limited to additions or changes to branch circuits, circuit protective devices, conduits, wire, feeders, controls, panels and installation methods.

1.8 MATERIALS AND EQUIPMENT PROTECTION

- A. Materials and equipment shall be protected during shipment and storage against physical damage, vermin, dirt, corrosive substances, fumes, moisture, cold and rain.
1. Store materials and equipment indoors in clean dry space with uniform temperature to prevent condensation.
 2. During installation, equipment shall be protected against entry of foreign matter, and be vacuum-cleaned both inside and outside before testing and operating. Compressed air shall not be used to clean equipment. Remove loose packing and flammable materials from inside equipment.
 3. Damaged equipment shall be repaired or replaced, as determined by the COR.
 4. Painted surfaces shall be protected with factory installed removable heavy kraft paper, sheet vinyl or equal.
 5. Damaged paint on equipment shall be refinished with the same quality of paint and workmanship as used by the manufacturer so repaired areas are not obvious.

.9 WORK PERFORMANCE

- A. All electrical work shall comply with requirements of the latest NFPA 70 (NEC), NFPA 70B, NFPA 70E, NFPA 99, NFPA 110, OSHA Part 1910 subpart J - General Environmental Controls, OSHA Part 1910 subpart K - Medical and First Aid, and OSHA Part 1910 subpart S - Electrical, in addition to other references required by contract.
- B. Job site safety and worker safety is the responsibility of the Contractor.

C. Electrical work shall be accomplished with all affected circuits or equipment de-energized. However, energized electrical work may be performed only for the non-destructive and non-invasive diagnostic testing(s), or when scheduled outage poses an imminent hazard to patient care, safety, or physical security. In such case, all aspects of energized electrical work, such as the availability of appropriate/correct personal protective equipment (PPE) and the use of PPE, shall comply with the latest NFPA 70E, as well as the following requirements:

1. Only Qualified Person(s) shall perform energized electrical work. Supervisor of Qualified Person(s) shall witness the work of its entirety to ensure compliance with safety requirements and approved work plan.
2. At least two weeks before initiating any energized electrical work, the Contractor and the Qualified Person(s) who is designated to perform the work shall visually inspect, verify and confirm that the work area and electrical equipment can safely accommodate the work involved.
3. At least two weeks before initiating any energized electrical work, the Contractor shall develop and submit a job specific work plan, and energized electrical work request to the COR, and Medical Center's Chief Engineer or his/her designee. At the minimum, the work plan must include relevant information such as proposed work schedule, area of work, description of work, name(s) of Supervisor and Qualified Person(s) performing the work, equipment to be used, procedures to be used on and near the live electrical equipment, barriers to be installed, safety equipment to be used, and exit pathways.
4. Energized electrical work shall begin only after the Contractor has obtained written approval of the work plan, and the energized electrical work request from the COR, and Medical Center's Chief Engineer or his/her designee. The Contractor shall make these approved documents present and available at the time and place of energized electrical work.
5. Energized electrical work shall begin only after the Contractor has invited and received acknowledgment from the COR, and Medical Center's Chief Engineer or his/her designee to witness the work.

- D. For work that affects existing electrical systems, arrange, phase and perform work to assure minimal interference with normal functioning of the facility. Refer to Article OPERATIONS AND STORAGE AREAS under Section 01 00 00, GENERAL REQUIREMENTS.
- E. New work shall be installed and connected to existing work neatly, safely and professionally. Disturbed or damaged work shall be replaced or repaired to its prior conditions, as required by Section 01 00 00, GENERAL REQUIREMENTS.
- F. Coordinate location of equipment and conduit with other trades to minimize interference.

.10 EQUIPMENT INSTALLATION AND REQUIREMENTS

- A. Equipment location shall be as close as practical to locations shown on the drawings.
- B. Working clearances shall not be less than specified in the NEC.
- C. Inaccessible Equipment:
 - 1. Where the Government determines that the Contractor has installed equipment not readily accessible for operation and maintenance, the equipment shall be removed and reinstalled as directed at no additional cost to the Government.
 - 2. "Readily accessible" is defined as being capable of being reached quickly for operation, maintenance, or inspections without the use of ladders, or without climbing or crawling under or over obstacles such as, but not limited to, motors, pumps, belt guards, transformers, piping, ductwork, conduit and raceways.
- D. Electrical service entrance equipment and arrangements for temporary and permanent connections to the electric utility company's system shall conform to the electric utility company's requirements. Coordinate fuses, circuit breakers and relays with the electric utility company's system, and obtain electric utility company approval for sizes and settings of these devices.

.11 EQUIPMENT IDENTIFICATION

- A. In addition to the requirements of the NEC, install an identification sign which clearly indicates information required for use and maintenance of items such as switchboards and switchgear, panelboards, cabinets, motor controllers, fused and non-fused safety switches, generators, automatic transfer switches, separately enclosed circuit breakers, individual breakers and controllers in switchboards,

switchgear and motor control assemblies, control devices and other significant equipment.

- B. Identification signs for Normal Power System equipment shall be laminated black phenolic resin with a white core with engraved lettering. Identification signs for Essential Electrical System (EES) equipment, as defined in the NEC, shall be laminated red phenolic resin with a white core with engraved lettering. Lettering shall be a minimum of 12 mm (1/2 inch) high. Identification signs shall indicate equipment designation, rated bus amperage, voltage, number of phases, number of wires, and type of EES power branch as applicable. Secure nameplates with screws.
- C. Install adhesive arc flash warning labels on all equipment as required by the latest NFPA 70E. Label shall show specific and correct information for specific equipment based on its arc flash calculations. Label shall show the followings:
 - 1. Nominal system voltage.
 - 2. Equipment/bus name, date prepared, and manufacturer name and address.
 - 3. Arc flash boundary.
 - 4. Available arc flash incident energy and the corresponding working distance.
 - 5. Minimum arc rating of clothing.
 - 6. Site-specific level of PPE.

1.12 SUBMITTALS

- A. Submit to the COR in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. The Government's approval shall be obtained for all materials and equipment before delivery to the job site. Delivery, storage or installation of materials and equipment which has not had prior approval will not be permitted.
- C. All submittals shall include six copies of adequate descriptive literature, catalog cuts, shop drawings, test reports, certifications, samples, and other data necessary for the Government to ascertain that the proposed materials and equipment comply with drawing and specification requirements. Catalog cuts submitted for approval shall be legible and clearly identify specific materials and equipment being submitted.

- D. Submittals for individual systems and equipment assemblies which consist of more than one item or component shall be made for the system or assembly as a whole. Partial submittals will not be considered for approval.
1. Mark the submittals, "SUBMITTED UNDER SECTION _____".
 2. Submittals shall be marked to show specification reference including the section and paragraph numbers.
 3. Submit each section separately.
- E. The submittals shall include the following:
1. Information that confirms compliance with contract requirements. Include the manufacturer's name, model or catalog numbers, catalog information, technical data sheets, shop drawings, manuals, pictures, nameplate data, and test reports as required.
 2. Submittals are required for all equipment anchors and supports. Submittals shall include weights, dimensions, center of gravity, standard connections, manufacturer's recommendations and behavior problems (e.g., vibration, thermal expansion, etc.) associated with equipment or piping so that the proposed installation can be properly reviewed. Include sufficient fabrication information so that appropriate mounting and securing provisions may be designed and attached to the equipment.
 3. Elementary and interconnection wiring diagrams for communication and signal systems, control systems, and equipment assemblies. All terminal points and wiring shall be identified on wiring diagrams.
 4. Parts list which shall include information for replacement parts and ordering instructions, as recommended by the equipment manufacturer.
- F. Maintenance and Operation Manuals:
1. Submit as required for systems and equipment specified in the technical sections. Furnish in hardcover binders or an approved equivalent.
 2. Inscribe the following identification on the cover: the words "MAINTENANCE AND OPERATION MANUAL," the name and location of the system, material, equipment, building, name of Contractor, and contract name and number. Include in the manual the names, addresses, and telephone numbers of each subcontractor installing the system or equipment and the local representatives for the material or equipment.

3. Provide a table of contents and assemble the manual to conform to the table of contents, with tab sheets placed before instructions covering the subject. The instructions shall be legible and easily read, with large sheets of drawings folded in.
4. The manuals shall include:
 - a. Internal and interconnecting wiring and control diagrams with data to explain detailed operation and control of the equipment.
 - b. A control sequence describing start-up, operation, and shutdown.
 - c. Description of the function of each principal item of equipment.
 - d. Installation instructions.
 - e. Safety precautions for operation and maintenance.
 - f. Diagrams and illustrations.
 - g. Periodic maintenance and testing procedures and frequencies, including replacement parts numbers.
 - h. Performance data.
 - i. Pictorial "exploded" parts list with part numbers. Emphasis shall be placed on the use of special tools and instruments. The list shall indicate sources of supply, recommended spare and replacement parts, and name of servicing organization.
 - j. List of factory approved or qualified permanent servicing organizations for equipment repair and periodic testing and maintenance, including addresses and factory certification qualifications.
- G. Approvals will be based on complete submission of shop drawings, manuals, test reports, certifications, and samples as applicable.
- H. After approval and prior to installation, furnish the COR with one sample of each of the following:
 1. A minimum 300 mm (12 inches) length of each type and size of wire and cable along with the tag from the coils or reels from which the sample was taken. The length of the sample shall be sufficient to show all markings provided by the manufacturer.
 2. Each type of conduit coupling, bushing, and termination fitting.
 3. Conduit hangers, clamps, and supports.
 4. Duct sealing compound.
 5. Each type of receptacle, toggle switch, lighting control sensor, outlet box, manual motor starter, device wall plate, engraved nameplate, wire and cable splicing and terminating material, and branch circuit single pole molded case circuit breaker.

1.13 SINGULAR NUMBER

- A. Where any device or part of equipment is referred to in these specifications in the singular number (e.g., "the switch"), this reference shall be deemed to apply to as many such devices as are required to complete the installation as shown on the drawings.

1.14 POLYCHLORINATED BIPHENYL (PCB) EQUIPMENT (NOT USED)

1.15 ACCEPTANCE CHECKS AND TESTS

- A. The Contractor shall furnish the instruments, materials, and labor for tests.
- B. Where systems are comprised of components specified in more than one section of Division 26, the Contractor shall coordinate the installation, testing, and adjustment of all components between various manufacturer's representatives and technicians so that a complete, functional, and operational system is delivered to the Government.
- C. When test results indicate any defects, the Contractor shall repair or replace the defective materials or equipment, and repeat the tests for the equipment. Repair, replacement, and re-testing shall be accomplished at no additional cost to the Government.

1.16 WARRANTY

- A. All work performed and all equipment and material furnished under this Division shall be free from defects and shall remain so for a period of one year from the date of acceptance of the entire installation by the Contracting Officer for the Government.

1.17 INSTRUCTION

- A. Instruction to designated Government personnel shall be provided for the particular equipment or system as required in each associated technical specification section.
- B. Furnish the services of competent and factory-trained instructors to give full instruction in the adjustment, operation, and maintenance of the specified equipment and system, including pertinent safety requirements. Instructors shall be thoroughly familiar with all aspects of the installation, and shall be factory-trained in operating theory as well as practical operation and maintenance procedures.
- C. A training schedule shall be developed and submitted by the Contractor and approved by the COR at least 30 days prior to the planned training.

---END---

SECTION 26 05 19
LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the furnishing, installation, connection, and testing of the electrical conductors and cables for use in electrical systems rated 600 V and below, indicated as cable(s), conductor(s), wire, or wiring in this section.

1.2 RELATED WORK

- A. Section 07 84 00, FIRESTOPPING: Sealing around penetrations to maintain the integrity of fire-resistant rated construction.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- C. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits for conductors and cables.

1.3 QUALITY ASSURANCE

- A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:
1. Shop Drawings:
 - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
 - b. Submit the following data for approval:
 - 1) Electrical ratings and insulation type for each conductor and cable.
 - 2) Splicing materials and pulling lubricant.
 2. Certifications: Two weeks prior to final inspection, submit the following.
 - a. Certification by the manufacturer that the conductors and cables conform to the requirements of the drawings and specifications.
 - b. Certification by the Contractor that the conductors and cables have been properly installed, adjusted, and tested.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are reference in the text by designation only.
- B. American Society of Testing Material (ASTM):
 - D2301-10.....Standard Specification for Vinyl Chloride
Plastic Pressure-Sensitive Electrical
Insulating Tape
 - D2304-10.....Test Method for Thermal Endurance of Rigid
Electrical Insulating Materials
 - D3005-10.....Low-Temperature Resistant Vinyl Chloride
Plastic Pressure-Sensitive Electrical
Insulating Tape
- C. National Electrical Manufacturers Association (NEMA):
 - WC 70-09.....Power Cables Rated 2000 Volts or Less for the
Distribution of Electrical Energy
- D. National Fire Protection Association (NFPA):
 - 70-17.....National Electrical Code (NEC)
- E. Underwriters Laboratories, Inc. (UL):
 - 44-14.....Thermoset-Insulated Wires and Cables
 - 83-14.....Thermoplastic-Insulated Wires and Cables
 - 467-13.....Grounding and Bonding Equipment
 - 486A-486B-13.....Wire Connectors
 - 486C-13.....Splicing Wire Connectors

 - 486D-15.....Sealed Wire Connector Systems
 - 486E-15.....Equipment Wiring Terminals for Use with
Aluminum and/or Copper Conductors
 - 493-07.....Thermoplastic-Insulated Underground Feeder and
Branch Circuit Cables
 - 514B-12.....Conduit, Tubing, and Cable Fittings

PART 2 - PRODUCTS

2.1 CONDUCTORS AND CABLES

- A. Conductors and cables shall be in accordance with ASTM, NEMA, NFPA, UL, as specified herein, and as shown on the drawings.
- B. All conductors shall be copper.
- C. Single Conductor and Cable:

1. No. 12 AWG: Minimum size, except where smaller sizes are specified herein or shown on the drawings.
2. No. 14 AWG and larger: Stranded.
3. No. 10 AWG and smaller: Solid; except shall be stranded for final connection to motors, transformers, and vibrating equipment.
4. Insulation: THHN-THWN and XHHW-2. XHHW-2 shall be used for isolated power systems.

D. Color Code:

1. No. 10 AWG and smaller: Solid color insulation or solid color coating.
2. No. 8 AWG and larger: Color-coded using one of the following methods:
 - a. Solid color insulation or solid color coating.
 - b. Stripes, bands, or hash marks of color specified.
 - c. Color using 19 mm (0.75 inches) wide tape.
4. For modifications and additions to existing wiring systems, color coding shall conform to the existing wiring system.
5. Conductors shall be color-coded as follows:

208/120 V	Phase	480/277 V
Black	A	Brown
Red	B	Orange
Blue	C	Yellow
White	Neutral	Gray *
* or white with colored (other than green) tracer.		

6. Lighting circuit "switch legs", and 3-way and 4-way switch "traveling wires," shall have color coding that is unique and distinct (e.g., pink and purple) from the color coding indicated above. The unique color codes shall be solid and in accordance with the NEC. Coordinate color coding in the field with the COR.
7. Color code for isolated power system wiring shall be in accordance with the NEC.

2.2 SPLICES

- A. Splices shall be in accordance with NEC and UL.
- B. Above Ground Splices for No. 10 AWG and Smaller:
 1. Solderless, screw-on, reusable pressure cable type, with integral insulation, approved for copper and aluminum conductors.

2. The integral insulator shall have a skirt to completely cover the stripped conductors.
 3. The number, size, and combination of conductors used with the connector, as listed on the manufacturer's packaging, shall be strictly followed.
- C. Above Ground Splices for No. 8 AWG to No. 4/0 AWG:
1. Compression, hex screw, or bolt clamp-type of high conductivity and corrosion-resistant material, listed for use with copper and aluminum conductors.
 2. Insulate with materials approved for the particular use, location, voltage, and temperature. Insulation level shall be not less than the insulation level of the conductors being joined.
 3. Splice and insulation shall be product of the same manufacturer.
 4. All bolts, nuts, and washers used with splices shall be zinc-plated cadmium-plated steel.
- D. Above Ground Splices for 250 kcmil and Larger:
1. Long barrel "butt-splice" or "sleeve" type compression connectors, with minimum of two compression indents per wire, listed for use with copper and aluminum conductors.
 2. Insulate with materials approved for the particular use, location, voltage, and temperature. Insulation level shall be not less than the insulation level of the conductors being joined.
 3. Splice and insulation shall be product of the same manufacturer.
- E. Underground Splices for No. 10 AWG and Smaller:
1. Solderless, screw-on, reusable pressure cable type, with integral insulation. Listed for wet locations, and approved for copper and aluminum conductors.
 2. The integral insulator shall have a skirt to completely cover the stripped conductors.
 3. The number, size, and combination of conductors used with the connector, as listed on the manufacturer's packaging, shall be strictly followed.
- F. Underground Splices for No. 8 AWG and Larger:
1. Mechanical type, of high conductivity and corrosion-resistant material. Listed for wet locations, and approved for copper and aluminum conductors.

2. Insulate with materials approved for the particular use, location, voltage, and temperature. Insulation level shall be not less than the insulation level of the conductors being joined.
 3. Splice and insulation shall be product of the same manufacturer.
- G. Plastic electrical insulating tape: Per ASTM D2304, flame-retardant, cold and weather resistant.

2.3 CONNECTORS AND TERMINATIONS

- A. Mechanical type of high conductivity and corrosion-resistant material, listed for use with copper and aluminum conductors.
- B. Long barrel compression type of high conductivity and corrosion-resistant material, with minimum of two compression indents per wire, listed for use with copper and aluminum conductors.
- C. All bolts, nuts, and washers used to connect connections and terminations to bus bars or other termination points shall be zinc-plated steel.

2.4 CONTROL WIRING

- A. Unless otherwise specified elsewhere in these specifications, control wiring shall be as specified herein, except that the minimum size shall be not less than No. 14 AWG.
- B. Control wiring shall be sized such that the voltage drop under in-rush conditions does not adversely affect operation of the controls.

2.5 WIRE LUBRICATING COMPOUND

- A. Lubricating compound shall be suitable for the wire insulation and conduit, and shall not harden or become adhesive.
- B. Shall not be used on conductors for isolated power systems.

PART 3 - EXECUTION

3.1 GENERAL

- A. Installation shall be in accordance with the NEC, as shown on the drawings, and manufacturer's instructions.
- B. Install all conductors in raceway systems.
- C. Splice conductors only in outlet boxes, junction boxes, pullboxes, manholes, or handholes.
- D. Conductors of different systems (e.g., 120 V and 277 V) shall not be installed in the same raceway.
- E. Install cable supports for all vertical feeders in accordance with the NEC. Provide split wedge type which firmly clamps each individual cable and tightens due to cable weight.

- F. In panelboards, cabinets, wireways, switches, enclosures, and equipment assemblies, neatly form, train, and tie the conductors with non-metallic ties.
- G. For connections to motors, transformers, and vibrating equipment, stranded conductors shall be used only from the last fixed point of connection to the motors, transformers, or vibrating equipment.
- H. Use expanding foam or non-hardening duct-seal to seal conduits entering a building, after installation of conductors.
- I. Conductor and Cable Pulling:
 - 1. Provide installation equipment that will prevent the cutting or abrasion of insulation during pulling. Use lubricants approved for the cable.
 - 2. Use nonmetallic pull ropes.
 - 3. Attach pull ropes by means of either woven basket grips or pulling eyes attached directly to the conductors.
 - 4. All conductors in a single conduit shall be pulled simultaneously.
 - 5. Do not exceed manufacturer's recommended maximum pulling tensions and sidewall pressure values.
- J. No more than three branch circuits shall be installed in any one conduit.
- K. When stripping stranded conductors, use a tool that does not damage the conductor or remove conductor strands.

3.2 INSTALLATION IN MANHOLES

- A. Train the cables around the manhole walls, but do not bend to a radius less than six times the overall cable diameter.

3.3 SPLICE AND TERMINATION INSTALLATION

- A. Splices and terminations shall be mechanically and electrically secure, and tightened to manufacturer's published torque values using a torque screwdriver or wrench.
- B. Where the Government determines that unsatisfactory splices or terminations have been installed, replace the splices or terminations at no additional cost to the Government.

3.4 CONDUCTOR IDENTIFICATION

- A. When using colored tape to identify phase, neutral, and ground conductors larger than No. 8 AWG, apply tape in half-overlapping turns for a minimum of 75 mm (3 inches) from terminal points, and in junction boxes, pullboxes, and manholes. Apply the last two laps of tape with no

tension to prevent possible unwinding. Where cable markings are covered by tape, apply tags to cable, stating size and insulation type.

3.5 FEEDER CONDUCTOR IDENTIFICATION

- A. In each interior pullbox and each underground manhole and handhole, install brass tags on all feeder conductors to clearly designate their circuit identification and voltage. The tags shall be the embossed type, 40 mm (1-1/2 inches) in diameter and 40 mils thick. Attach tags with plastic ties.

3.6 EXISTING CONDUCTORS

- A. Unless specifically indicated on the plans, existing conductors shall not be reused.

3.7 CONTROL WIRING INSTALLATION

- A. Unless otherwise specified in other sections, install control wiring and connect to equipment to perform the required functions as specified or as shown on the drawings.
- B. Install a separate power supply circuit for each system, except where otherwise shown on the drawings.

3.8 CONTROL WIRING IDENTIFICATION

- A. Install a permanent wire marker on each wire at each termination.
- B. Identifying numbers and letters on the wire markers shall correspond to those on the wiring diagrams used for installing the systems.
- C. Wire markers shall retain their markings after cleaning.
- D. In each manhole and handhole, install embossed brass tags to identify the system served and function.

3.9 DIRECT BURIAL CABLE INSTALLATION (NOT USED)

3.10 ACCEPTANCE CHECKS AND TESTS

- A. Perform in accordance with the manufacturer's recommendations. In addition, include the following:
 - 1. Visual Inspection and Tests: Inspect physical condition.
 - 2. Electrical tests:
 - a. After installation but before connection to utilization devices, such as fixtures, motors, or appliances, test conductors phase-to-phase and phase-to-ground resistance with an insulation resistance tester. Existing conductors to be reused shall also be tested.
 - b. Applied voltage shall be 500 V DC for 300 V rated cable, and 1000 V DC for 600 V rated cable. Apply test for one minute or until reading is constant for 15 seconds, whichever is longer. Minimum

- insulation resistance values shall not be less than 25 megohms
for 300 V rated cable and 100 megohms for 600 V rated cable.
- c. Perform phase rotation test on all three-phase circuits.

---END---

SECTION 26 05 33
RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the furnishing, installation, and connection of conduit, fittings, and boxes, to form complete, coordinated, grounded raceway systems. Raceways are required for all wiring unless shown or specified otherwise.
- B. Definitions: The term conduit, as used in this specification, shall mean any or all of the raceway types specified.

1.2 RELATED WORK

- A. Section 07 84 00, FIRESTOPPING: Sealing around penetrations to maintain the integrity of fire rated construction.
- B. Section 07 92 00, JOINT SEALANTS: Sealing around conduit penetrations through the building envelope to prevent moisture migration into the building.
- C. Section 09 91 00, PAINTING: Identification and painting of conduit and other devices.
- D. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. Submit the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
 - 1. Shop Drawings:
 - a. Size and location of main feeders.
 - b. Size and location of panels and pull-boxes.
 - c. Layout of required conduit penetrations through structural elements.
 - d. Submit the following data for approval:
 - 1) Raceway types and sizes.
 - 2) Conduit bodies, connectors and fittings.
 - 3) Junction and pull boxes, types and sizes.

2. Certifications: Two weeks prior to final inspection, submit the following:
 - a. Certification by the manufacturer that raceways, conduits, conduit bodies, connectors, fittings, junction and pull boxes, and all related equipment conform to the requirements of the drawings and specifications.
 - b. Certification by the Contractor that raceways, conduits, conduit bodies, connectors, fittings, junction and pull boxes, and all related equipment have been properly installed.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American National Standards Institute (ANSI):
 - C80.1-05.....Electrical Rigid Steel Conduit
 - C80.3-05.....Steel Electrical Metal Tubing
 - C80.6-05.....Electrical Intermediate Metal Conduit
- C. National Fire Protection Association (NFPA):
 - 70-11.....National Electrical Code (NEC)
- D. Underwriters Laboratories, Inc. (UL):
 - 1-05.....Flexible Metal Conduit
 - 5-11.....Surface Metal Raceway and Fittings
 - 6-07.....Electrical Rigid Metal Conduit - Steel
 - 50-95.....Enclosures for Electrical Equipment
 - 360-13.....Liquid-Tight Flexible Steel Conduit
 - 467-13.....Grounding and Bonding Equipment
 - 514A-13.....Metallic Outlet Boxes
 - 514B-12.....Conduit, Tubing, and Cable Fittings
 - 514C-07.....Nonmetallic Outlet Boxes, Flush-Device Boxes
and Covers
 - 651-11.....Schedule 40 and 80 Rigid PVC Conduit and
Fittings
 - 651A-11.....Type EB and A Rigid PVC Conduit and HDPE
Conduit
 - 797-07.....Electrical Metallic Tubing
 - 1242-06.....Electrical Intermediate Metal Conduit - Steel
- E. National Electrical Manufacturers Association (NEMA):

- TC-2-13.....Electrical Polyvinyl Chloride (PVC) Tubing and
Conduit
 - TC-3-13.....PVC Fittings for Use with Rigid PVC Conduit and
Tubing
 - FB1-12.....Fittings, Cast Metal Boxes and Conduit Bodies
for Conduit, Electrical Metallic Tubing and
Cable
 - FB2.10-13.....Selection and Installation Guidelines for
Fittings for use with Non-Flexible Conduit or
Tubing (Rigid Metal Conduit, Intermediate
Metallic Conduit, and Electrical Metallic
Tubing)
 - FB2.20-12.....Selection and Installation Guidelines for
Fittings for use with Flexible Electrical
Conduit and Cable
- F. American Iron and Steel Institute (AISI):
- S100-2007.....North American Specification for the Design of
Cold-Formed Steel Structural Members

PART 2 - PRODUCTS

2.1 MATERIAL

- A. Conduit Size: In accordance with the NEC, but not less than 13 mm (0.5-inch) unless otherwise shown. Where permitted by the NEC, 13 mm (0.5-inch) flexible conduit may be used for tap connections to recessed lighting fixtures.
- B. Conduit:
 - 1. Size: In accordance with the NEC, but not less than 13 mm (0.5-inch).
 - 2. Rigid Steel Conduit (RMC): Shall conform to UL 6 and ANSI C80.1.
 - 3. Rigid Intermediate Steel Conduit (IMC): Shall conform to UL 1242 and ANSI C80.6.
 - 4. Electrical Metallic Tubing (EMT): Shall conform to UL 797 and ANSI C80.3. Maximum size not to exceed 105 mm (4 inches) and shall be permitted only with cable rated 600 V or less.
 - 5. Flexible Metal Conduit: Shall conform to UL 1.
 - 6. Liquid-tight Flexible Metal Conduit: Shall conform to UL 360.
 - 7. Direct Burial Plastic Conduit: Shall conform to UL 651 and UL 651A, heavy wall PVC or high-density polyethylene (PE).

8. Surface Metal Raceway (Where permitted by COR): Shall conform to UL 5.

C. Conduit Fittings:

1. Rigid Steel and Intermediate Metallic Conduit Fittings:

- a. Fittings shall meet the requirements of UL 514B and NEMA FB1.
- b. Standard threaded couplings, locknuts, bushings, conduit bodies, and elbows: Only steel or malleable iron materials are acceptable. Integral retractable type IMC couplings are also acceptable.
- c. Locknuts: Bonding type with sharp edges for digging into the metal wall of an enclosure.
- d. Bushings: Metallic insulating type, consisting of an insulating insert, molded or locked into the metallic body of the fitting. Bushings made entirely of metal or nonmetallic material are not permitted.
- e. Erickson (Union-Type) and Set Screw Type Couplings: Approved for use in concrete are permitted for use to complete a conduit run where conduit is installed in concrete. Use set screws of case-hardened steel with hex head and cup point to firmly seat in conduit wall for positive ground. Tightening of set screws with pliers is prohibited.
- f. Sealing Fittings: Threaded cast iron type. Use continuous drain-type sealing fittings to prevent passage of water vapor. In concealed work, install fittings in flush steel boxes with blank cover plates having the same finishes as that of other electrical plates in the room.

D. Rigid Aluminum Conduit Fittings:

- a. Standard threaded couplings, locknuts, bushings, conduit bodies, and elbows: Malleable iron, steel or aluminum alloy materials; Zinc or cadmium plate iron or steel fittings. Aluminum fittings containing more than 0.4% copper are prohibited.
 - b. Locknuts and Bushings: As specified for rigid steel and IMC conduit.
 - c. Set Screw Fittings: Not permitted for use with aluminum conduit.
2. Electrical Metallic Tubing Fittings:
- a. Fittings and conduit bodies shall meet the requirements of UL 514B, ANSI C80.3, and NEMA FB1.
 - b. Only steel or malleable iron materials are acceptable.

- c. Setscrew Couplings and Connectors: Use setscrews of case-hardened steel with hex head and cup point, to firmly seat in wall of conduit for positive grounding.
 - d. Indent-type connectors or couplings are prohibited.
 - e. Die-cast or pressure-cast zinc-alloy fittings or fittings made of "pot metal" are prohibited.
3. Flexible Metal Conduit Fittings:
- a. Conform to UL 514B. Only steel or malleable iron materials are acceptable.
 - b. Clamp-type, with insulated throat.
4. Liquid-tight Flexible Metal Conduit Fittings:
- a. Fittings shall meet the requirements of UL 514B and NEMA FB1.
 - b. Only steel or malleable iron materials are acceptable.
 - c. Fittings must incorporate a threaded grounding cone, a steel or plastic compression ring, and a gland for tightening. Connectors shall have insulated throats.
5. Direct Burial Plastic Conduit Fittings: Fittings shall meet the requirements of UL 514C and NEMA TC3.
6. Surface Metal Raceway Fittings: As recommended by the raceway manufacturer. Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, conduit entry fittings, accessories, and other fittings as required for complete system.
7. Expansion and Deflection Couplings:
- a. Conform to UL 467 and UL 514B.
 - b. Accommodate a 19 mm (0.75-inch) deflection, expansion, or contraction in any direction, and allow 30 degree angular deflections.
 - c. Include internal flexible metal braid, sized to guarantee conduit ground continuity and a low-impedance path for fault currents, in accordance with UL 467 and the NEC tables for equipment grounding conductors.
 - d. Jacket: Flexible, corrosion-resistant, watertight, moisture and heat-resistant molded rubber material with stainless steel jacket clamps.
- E. Conduit Supports:
- 1. Parts and Hardware: Zinc-coat or provide equivalent corrosion protection.

2. Individual Conduit Hangers: Designed for the purpose, having a pre-assembled closure bolt and nut, and provisions for receiving a hanger rod.
3. Multiple Conduit (Trapeze) Hangers: Not less than 38 mm x 38 mm (1.5 x 1.5 inches), 12-gauge steel, cold-formed, lipped channels; with not less than 9 mm (0.375-inch) diameter steel hanger rods.
4. Solid Masonry and Concrete Anchors: Self-drilling expansion shields, or machine bolt expansion.

F. Outlet, Junction, and Pull Boxes:

1. UL-50 and UL-514A.
2. Rustproof cast metal where required by the NEC or shown on drawings.
3. Sheet Metal Boxes: Galvanized steel, except where shown on drawings.

G. Metal Wireways: Equip with hinged covers, except as shown on drawings. Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, and other fittings to match and mate with wireways as required for a complete system.

PART 3 - EXECUTION

3.1 PENETRATIONS

A. Cutting or Holes:

1. Cut holes in advance where they should be placed in the structural elements, such as ribs or beams. Obtain the approval of the COR prior to drilling through structural elements.
2. Cut holes through concrete and masonry in new and existing structures with a diamond core drill or concrete saw. Pneumatic hammers, impact electric, hand, or manual hammer-type drills are not allowed, except when permitted by the COR where working space is limited.

B. Firestop: Where conduits, wireways, and other electrical raceways pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING.

C. Waterproofing: At floor, exterior wall, and roof conduit penetrations, completely seal the gap around conduit to render it watertight, as specified in Section 07 92 00, JOINT SEALANTS.

3.2 INSTALLATION, GENERAL

- A. In accordance with UL, NEC, NEMA, as shown on drawings, and as specified herein.
- B. Raceway systems used for Essential Electrical Systems (EES) shall be entirely independent of other raceway systems.
- C. Install conduit as follows:
 - 1. In complete mechanically and electrically continuous runs before pulling in cables or wires.
 - 2. Unless otherwise indicated on the drawings or specified herein, installation of all conduits shall be concealed within finished walls, floors, and ceilings.
 - 3. Flattened, dented, or deformed conduit is not permitted. Remove and replace the damaged conduits with new conduits.
 - 4. Assure conduit installation does not encroach into the ceiling height head room, walkways, or doorways.
 - 5. Cut conduits square, ream, remove burrs, and draw up tight.
 - 6. Independently support conduit at 2.4 M (8 feet) on centers with specified materials and as shown on drawings.
 - 7. Do not use suspended ceilings, suspended ceiling supporting members, lighting fixtures, other conduits, cable tray, boxes, piping, or ducts to support conduits and conduit runs.
 - 8. Support within 300 mm (12 inches) of changes of direction, and within 300 mm (12 inches) of each enclosure to which connected.
 - 9. Close ends of empty conduits with plugs or caps at the rough-in stage until wires are pulled in, to prevent entry of debris.
 - 10. Conduit installations under fume and vent hoods are prohibited.
 - 11. Secure conduits to cabinets, junction boxes, pull-boxes, and outlet boxes with bonding type locknuts. For rigid steel and IMC conduit installations, provide a locknut on the inside of the enclosure, made up wrench tight. Do not make conduit connections to junction box covers.
 - 12. Flashing of penetrations of the roof membrane is specified in Section 07 60 00, FLASHING AND SHEET METAL.
 - 13. Conduit bodies shall only be used for changes in direction, and shall not contain splices.
- D. Conduit Bends:
 - 1. Make bends with standard conduit bending machines.

2. Conduit hickey may be used for slight offsets and for straightening stubbed out conduits.
3. Bending of conduits with a pipe tee or vise is prohibited.

E. Layout and Homeruns:

1. Install conduit with wiring, including homeruns, as shown on drawings.
2. Deviations: Make only where necessary to avoid interferences and only after drawings showing the proposed deviations have been submitted and approved by the COR.

3.3 CONCEALED WORK INSTALLATION

A. Above Furred or Suspended Ceilings and in Walls:

1. Conduit for Conductors Above 600 V: Rigid steel. Mixing different types of conduits in the same system is prohibited.
2. Conduit for Conductors 600 V and Below: Rigid steel, IMC, or EMT. Mixing different types of conduits in the same system is prohibited.
3. Align and run conduit parallel or perpendicular to the building lines.
4. Connect recessed lighting fixtures to conduit runs with maximum 1.8 M (6 feet) of flexible metal conduit extending from a junction box to the fixture.
5. Tightening set screws with pliers is prohibited.
6. For conduits running through metal studs, limit field cut holes to no more than 70% of web depth. Spacing between holes shall be at least 457 mm (18 inches). Cuts or notches in flanges or return lips shall not be permitted.

3.4 EXPOSED WORK INSTALLATION

- A. Unless otherwise indicated on drawings, exposed conduit is only permitted in mechanical and electrical rooms.
- B. Conduit for Conductors Above 600 V: Rigid. Mixing different types of conduits in the system is prohibited.
- C. Conduit for Conductors 600 V and Below: Rigid steel, IMC, or EMT. Mixing different types of conduits in the system is prohibited.
- D. Align and run conduit parallel or perpendicular to the building lines.
- E. Install horizontal runs close to the ceiling or beams and secure with conduit straps.
- F. Support horizontal or vertical runs at not over 2.4 M (8 feet) intervals.
- G. Surface Metal Raceways: Use only where shown on drawings.

H. Painting:

1. Paint exposed conduit as specified in Section 09 91 00, PAINTING.

3.5 DIRECT BURIAL INSTALLATION (NOT USED)

3.6 HAZARDOUS LOCATIONS

- A. Use rigid steel conduit only.
- B. Install UL approved sealing fittings that prevent passage of explosive vapors in hazardous areas equipped with explosion-proof lighting fixtures, switches, and receptacles, as required by the NEC.

3.7 WET OR DAMP LOCATIONS

- A. Use rigid steel or IMC conduits unless as shown on drawings.
- B. Provide sealing fittings to prevent passage of water vapor where conduits pass from warm to cold locations, i.e., refrigerated spaces, constant-temperature rooms, air-conditioned spaces, building exterior walls, roofs, or similar spaces.
- C. Use rigid steel or IMC conduit within 1.5 M (5 feet) of the exterior and below concrete building slabs in contact with soil, gravel, or vapor barriers, unless as shown on drawings. Conduit shall be half-lapped with 10 mil PVC tape before installation. After installation, completely recoat or retape any damaged areas of coating.
- D. Conduits run on roof shall be supported with integral galvanized lipped steel channel, attached to UV-inhibited polycarbonate or polypropylene blocks every 2.4 M (8 feet) with 9 mm (3/8-inch) galvanized threaded rods, square washer and locknut. Conduits shall be attached to steel channel with conduit clamps.

3.8 MOTORS AND VIBRATING EQUIPMENT (NOT USED)

3.9 EXPANSION JOINTS

- A. Conduits 75 mm (3 inch) and larger that are secured to the building structure on opposite sides of a building expansion joint require expansion and deflection couplings. Install the couplings in accordance with the manufacturer's recommendations.
- B. Provide conduits smaller than 75 mm (3 inch) with junction boxes on both sides of the expansion joint. Connect flexible metal conduits to junction boxes with sufficient slack to produce a 125 mm (5 inch) vertical drop midway between the ends of the flexible metal conduit. Flexible metal conduit shall have a green insulated copper bonding jumper installed. In lieu of this flexible metal conduit, expansion and deflection couplings as specified above are acceptable.
- C. Install expansion and deflection couplings where shown.

- D. Seismic Areas: In seismic areas, provide conduits rigidly secured to the building structure on opposite sides of a building expansion joint with junction boxes on both sides of the joint. Connect conduits to junction boxes with 375 mm (15 inches) of slack flexible conduit. Flexible conduit shall have a copper bonding jumper installed.

3.10 CONDUIT SUPPORTS

- A. Safe working load shall not exceed one-quarter of proof test load of fastening devices.
- B. Use pipe straps or individual conduit hangers for supporting individual conduits.
- C. Support multiple conduit runs with trapeze hangers. Use trapeze hangers that are designed to support a load equal to or greater than the sum of the weights of the conduits, wires, hanger itself, and an additional 90 kg (200 lbs). Attach each conduit with U-bolts or other approved fasteners.
- D. Support conduit independently of junction boxes, pull-boxes, fixtures, suspended ceiling T-bars, angle supports, and similar items.
- E. Fasteners and Supports in Solid Masonry and Concrete:
1. Existing Construction:
 - a. Steel expansion anchors not less than 6 mm (0.25-inch) bolt size and not less than 28 mm (1.125 inch) in embedment.
 - b. Power set fasteners not less than 6 mm (0.25-inch) diameter with depth of penetration not less than 75 mm (3 inch).
 - c. Use vibration and shock-resistant anchors and fasteners for attaching to concrete ceilings.
- F. Hollow Masonry: Toggle bolts.
- G. Bolts supported only by plaster or gypsum wallboard are not acceptable.
- H. Metal Structures: Use machine screw fasteners or other devices specifically designed and approved for the application.
- I. Attachment by wood plugs, rawl plug, plastic, lead or soft metal anchors, or wood blocking and bolts supported only by plaster is prohibited.
- J. Chain, wire, or perforated strap shall not be used to support or fasten conduit.
- K. Spring steel type supports or fasteners are prohibited for all uses except horizontal and vertical supports/fasteners within walls.
- L. Vertical Supports: Vertical conduit runs shall have riser clamps and supports in accordance with the NEC and as shown. Provide supports for

cable and wire with fittings that include internal wedges and retaining collars.

3.11 BOX INSTALLATION

- A. Boxes for Concealed Conduits:
 - 1. Flush-mounted.
 - 2. Provide raised covers for boxes to suit the wall or ceiling, construction, and finish.
- B. In addition to boxes shown, install additional boxes where needed to prevent damage to cables and wires during pulling-in operations or where more than the equivalent of 4-90 degree bends are necessary.
- C. Locate pullboxes so that covers are accessible and easily removed. Coordinate locations with piping and ductwork where installed above ceilings.
- D. Remove only knockouts as required. Plug unused openings. Use threaded plugs for cast metal boxes and snap-in metal covers for sheet metal boxes.
- E. Outlet boxes mounted back-to-back in the same wall are prohibited. A minimum 600 mm (24 inch) center-to-center lateral spacing shall be maintained between boxes.
- F. Flush-mounted wall or ceiling boxes shall be installed with raised covers so that the front face of raised cover is flush with the wall. Surface-mounted wall or ceiling boxes shall be installed with surface-style flat or raised covers.
- G. Minimum size of outlet boxes for ground fault circuit interrupter (GFCI) receptacles is 100 mm (4 inches) square x 55 mm (2.125 inches) deep, with device covers for the wall material and thickness involved.
- H. Stencil or install phenolic nameplates on covers of the boxes identified on riser diagrams; for example "SIG-FA JB No. 1."
- I. On all branch circuit junction box covers, identify the circuits with black marker.

- - - E N D - - -

SECTION 28 31 00
FIRE DETECTION AND ALARM

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section of the specifications includes the replacement of sprinkler system water flow and valve tamper switches. It shall include, but not be limited to, alarm initiating devices, and wiring as shown on the drawings and specified.
- B. Fire alarm systems shall comply with requirements of NFPA 72.

1.2 SCOPE

- A. All existing fire alarm equipment, wiring, devices and sub-systems that are not shown to be reused shall be removed. All existing fire alarm conduit not reused shall be removed.
- B. Replacement of sprinkler system water flow and valve tamper switches. shall be designed and installed in accordance with the specifications and drawings. Device location and wiring runs shown on the drawings are for reference only unless specifically dimensioned. Actual locations shall be in accordance with NFPA 72 and this specification.
- C. Basic Performance:
 - 1. Initiating device circuits (IDC) shall be wired Class B in accordance with NFPA 72. Isolation shall be provided so that no more than 80 devices can be lost due to a short circuit fault.

1.3 RELATED WORK (STANDARD VA MASTER SPECIFICATION SECTION)

- A. Section 01 00 00, GENERAL REQUIREMENTS: Restoration of existing surfaces.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES: Procedures for submittals.
- C. Section 07 84 00, FIRESTOPPING: Fire proofing wall penetrations.
- D. Section 09 91 00, PAINTING: Painting for equipment and existing surfaces.
- E. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements for items which are common to other Division 26 sections.
- F. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits and boxes for cables/wiring.
- G. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Cables/wiring.

1.4 SUBMITTALS

- A. General: Submit 4 copies and 1 reproducible in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES and Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.5 GUARANTY WARRANTY (NOT USED)

1.6 GUARANTY PERIOD SERVICES (NOT USED)

1.7 APPLICABLE PUBLICATIONS

- A. The publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. The publications are referenced in text by the basic designation only.
- B. National Fire Protection Association (NFPA):
 - 70-2017.....National Electrical Code (NEC).
 - 72-2016.....National Fire Alarm Code.
 - 90A-2015.....Installation of Air Conditioning and Ventilating Systems.
 - 101-2015.....Life Safety Code
- C. Underwriters Laboratories, Inc. (UL):
 - 2000-2015.....Fire Protection Equipment Directory
- D. Factory Mutual Research Corp (FM): Approval Guide, 2015 Edition
- E. Acoustical Society of America (ASA):
 - S3.41-1996.....Audible Emergency Evacuation Signal
- F. International Conference of Building Officials, International Building Code (IBC) 2012 Edition.

PART 2 - PRODUCTS

2.1 EQUIPMENT AND MATERIALS, GENERAL (NOT USED)

2.2 CONDUIT, BOXES, AND WIRE

- A. Conduit shall be in accordance with Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS and as follows:
 - 1. All new and reused conduit shall be installed in accordance with NFPA 70.
 - 2. Conduit fill shall not exceed 40 percent of interior cross-sectional area.
 - 3. All new conduit shall be 19 mm (3/4 inch) minimum. (1/2 is allowed where existing conduit is reused).
- B. Wire:
 - 1. All existing wiring shall be removed and new wiring installed in a conduit or raceway.
 - 2. Wiring shall be in accordance with NEC article 760, Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES, and as

recommended by the manufacturer of the fire alarm system. All wires shall be color coded. Number and size of conductors shall be as recommended by the fire alarm system manufacturer, but not less than 18 AWG for initiating device circuits and 14 AWG for notification device circuits.

3. Addressable circuits and wiring used for the multiplex communication loop shall be twisted and shielded unless specifically excepted by the fire alarm equipment manufacturer in writing.
4. Any fire alarm system wiring that extends outside of a building shall have additional power surge protection to protect equipment from physical damage and false signals due to lightning, voltage and current induced transients. Protection devices shall be shown on the submittal drawings and shall be UL listed or in accordance with written manufacturer's requirements.
5. All wire or cable used in underground conduits including those in concrete shall be listed for wet locations.

C. Terminal Boxes, Junction Boxes, and Cabinets:

1. Shall be galvanized steel in accordance with UL requirements.
2. All new and reused boxes shall be sized and installed in accordance with NFPA 70.
3. New and existing covers shall be repainted red in accordance with Section 09 91 00, PAINTING and shall be identified with white markings as "FA" for junction boxes and as "FIRE ALARM SYSTEM" for cabinets and terminal boxes. Lettering shall be a minimum of 19 mm (3/4 inch) high.

2.3 FIRE ALARM CONTROL UNIT (NOT USED)

2.4 NETWORK COMMAND CENTER (NOT USED)

2.5 ANNUNCIATION (NOT USED)

2.7 VOICE COMMUNICATION SYSTEM (VCS) (NOT USED)

2.8 ALARM NOTIFICATION APPLIANCES

2.9 ALARM INITIATING DEVICES

A. Water Flow and Pressure Switches:

1. Wet pipe water flow switches and dry pipe alarm pressure switches for sprinkler systems shall be connected to the fire alarm system by way of an address reporting interface device.
2. All new water flow switches shall be of a single manufacturer and series and non-accumulative retard type.
3. All new switches shall have an alarm transmission delay time that is conveniently adjustable from 0 to 60 seconds. Initial settings shall

be 30-45 seconds. Timing shall be recorded and documented during testing.

2.10 SUPERVISORY DEVICES

A. Sprinkler and Standpipe System Supervisory Switches:

1. Each sprinkler system water supply control valve, riser valve or zone control valve, and each standpipe system riser control valve shall be equipped with a supervisory switch. Standpipe hose valves, and test and drain valves shall not be equipped with supervisory switches.
2. PIV (post indicator valve) or main gate valve shall be equipped with a supervisory switch.
3. Valve supervisory switches shall be connected to the fire alarm system by way of address reporting interface device.
4. The mechanism shall be contained in a weatherproof die-cast aluminum housing that shall provide a 19 mm (3/4 inch) tapped conduit entrance and incorporate the necessary facilities for attachment to the valves.
5. The entire installed assembly shall be tamper-proof and arranged to cause a switch operation if the housing cover is removed or if the unit is removed from its mounting.
6. Where dry-pipe sprinkler systems are installed, high and low air pressure switches shall be provided and monitored by way of an address reporting interface devices.

2.11 ADDRESS REPORTING INTERFACE DEVICE

- A. Shall have unique addresses that reports directly to the building fire alarm panel.
- B. Shall be configurable to monitor normally open or normally closed devices for both alarm and trouble conditions.
- C. Shall have terminal designations clearly differentiating between the circuit to which they are reporting from and the device that they are monitoring.
- D. Shall be UL listed for fire alarm use and compatibility with the panel to which they are connected.
- E. Shall be mounted in weatherproof housings if mounted exterior to a building.

2.12 SMOKE BARRIER DOOR CONTROL (NOT USED)

2.13 ELEVATOR CONTROL (NOT USED)

2.14 FIRE PUMP MONITORING (NOT USED)

2.15 2.12 UTILITY LOCKS AND KEYS (NOT USED)

2.16 SPARE AND REPLACEMENT PARTS (NOT USED)

2.17 INSTRUCTION CHART (NOT USED)

2.18 P-TOUCH LABELING:

- A. All field devices (initiating devices, notification appliances and control relays) shall be identified with P-Touch Labels.
- B. Existing labels identify device type, building number, floor level, circuit and device number.
- C. During retesting of field devices, all labels shall be verified to match as-built drawings. All incorrect, damaged or missing labels shall be replaced.
- D. Labels shall be mounted to the front of or module box cover.

PART 3 - EXECUTION

3.1 INSTALLATION:

- A. Installation shall be in accordance with NFPA 70, 72, 90A, and 101 as shown on the drawings, and as recommended by the major equipment manufacturer. Fire alarm wiring shall be installed in conduit. All conduit and wire shall be installed in accordance with Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS, Section 26 05 19 LOW- VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES, and all penetrations of smoke and fire barriers shall be protected as required by Section 07 84 00, FIRESTOPPING.
- B. All new conduits, junction boxes, conduit supports and hangers shall be concealed in finished areas and may be exposed in unfinished areas. All existing accessible fire alarm conduit not reused shall be removed.
- C. All new or reused exposed conduit shall be painted in accordance with Section 09 91 00, PAINTING to match surrounding finished areas and red in unfinished areas.
- D. Existing devices that are reused shall be properly mounted and installed. Where devices are installed on existing shallow backboxes, extension rings of the same material, color and texture of the new fire alarm devices shall be used. Mounting surfaces shall be cut and patched in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Restoration, and be re-painted in accordance with Section 09 91 00, PAINTING as necessary to match existing.
- E. All fire detection and alarm system devices, shall be flush mounted when located in finished areas and may be surface mounted when located in unfinished areas. Exact locations to be approved by the COR.

- F. Where possible, locate water flow and pressure switches a minimum of 300 mm (12 inches) from a fitting that changes the direction of the flow and a minimum of 900 mm (36 inches) from a valve.
- G. Mount valve tamper switches so as not to interfere with the normal operation of the valve and adjust to operate within two revolutions toward the closed position of the valve control, or when the stem has moved no more than one-fifth of the distance from its normal position.
- H. Connect flow and tamper switches installed under Section 21 13 13, WET-PIPE SPRINKLER SYSTEMS.

3.2 TYPICAL OPERATION

- A. Activation of any sprinkler water flow or alarm pressure switch or gaseous suppression system shall cause the following operations to occur:
 - 1. Operate the emergency voice communication system throughout building.
 - 2. Flash strobes continuously on the floor of alarm.
 - 3. Release only the magnetic door holders on the floor from which alarm was initiated after the alert signal.
 - 4. Transmit a separate alarm signal, via the main fire alarm control unit to the fire department.
 - 5. Unlock the electrically locked exit doors within the zone of alarm.
- B. Operation of any sprinkler or standpipe system valve supervisory switch, high/low air pressure switch, or fire pump alarm switch shall cause a system supervisory condition.
- C. All building alarm, supervisory and trouble conditions shall be transmitted to remote annunciators via the site central annunciation. Information shall include building number, floor, zone, device description and status.

3.3 TESTS

- A. Provide the service of a or technician to technically supervise and participate during all of the adjustments and tests for the system. Make all adjustments and tests in the presence of the COR.
- B. When the systems have been completed and prior to the scheduling of the final inspection, furnish testing equipment and perform the following tests in the presence of the COR. When any defects are detected, make repairs or install replacement components, and repeat the tests until such time that the complete fire alarm systems meets all contract requirements. After the system has passed the initial test and been approved by the COR, the contractor may request a final inspection.

1. Before energizing the cables and wires, check for correct connections and test for short circuits, ground faults, continuity, and insulation.
2. Test the insulation on all installed cable and wiring by standard methods as recommended by the equipment manufacturer.
3. Run water through all flow switches. Check time delay on water flow switches. Submit a report listing all water flow switch operations and their retard time in seconds.
4. Open each alarm initiating and notification circuit to see if trouble signal actuates.
5. Ground each alarm initiation and notification circuit and verify response of trouble signals.

3.4 FINAL INSPECTION AND ACCEPTANCE

- A. Prior to final acceptance a minimum 14 day "burn-in" period shall be provided. The purpose shall be to allow equipment to stabilize and potential installation and software problems and equipment malfunctions to be identified and corrected. During this diagnostic period, all system operations and malfunctions shall be recorded. Final acceptance will be made upon successful completion of the "burn-in" period and where the last 7 days is without a system or equipment malfunction.
- B. At the final inspection a factory trained representative of the manufacturer of the major equipment shall repeat the tests in Article 3.3 TESTS and those required by NFPA 72 as an initial acceptance test of the entire system. In addition the representative shall demonstrate that the systems function properly in every respect. The demonstration shall be made in the presence of a VA representative.
- C. Acceptance test documentation including a certificate of completion in accordance with NFPA 72 shall be submitted within 7 days after the final acceptance test.

3.5 INSTRUCTION (NOT USED)

PART 4 - SCHEDULES

4.1 SMOKE ZONE DESCRIPTIONS (NOT USED)

4.2 DIGITIZED VOICE MESSAGES (NOT USED)

4.3 LOCATION OF VOICE MESSAGES (NOT USED)

- - - E N D - - -