

DEMOLITION NOTES:

1. DEMOLITION OF THE EXISTING SPRINKLER SYSTEMS IS TO BE TAKEN BACK TO THE POINT NOTED ON THIS SHEET. IT SHALL NOT BE RECOVERABLE TO REINSTATE ANY PIPES IN PLACE ABOVE CEILING.
2. SURRENDER ALL DEMOLISHED MATERIALS (PIPES, FITTINGS, HANGERS, ESPECIALLY SPRINKLER HEADS) TO THE OWNER OR FIRST RIGHT OF REUSE.

SPRINKLER HEAD LEGEND

- FM APPROVED, QUICK RESPONSE, STANDARD COVERAGE, PENDENT SPRINKLER WITH SEMI-RECESSED ESOUTCHEON.
- EXISTING SPRINKLER HEAD
- ⊗ CONNECTION POINT FOR NEW POOL AREA PIPING

NOTICE:

THERE ARE NO MORE THAN ONE SPRINKLER SYSTEM PROTECTING THE AREAS OF RENOVATION. THE FIRE SUPPRESSION CONTRACTOR SHALL THOROUGHLY FAMILIARIZE THEMSELVES WITH THE AREA OF WORK AND THE FACILITY FIRE PROTECTION SYSTEMS PRIOR TO ANY WORK BEING DONE. THE CONTRACTOR IS RESPONSIBLE FOR ANY DAMAGES CAUSED AS A RESULT OF THEIR NEGLIGENCE.


THE OWNER'S SPRINKLER SYSTEM SHUTDOWN PROCEDURE SHALL BE LEFT OUT OF SERVICE DURING NON-WORK HOURS. THE FIRE SUPPRESSION CONTRACTOR SHALL RESTORE THE SPRINKLER SYSTEMS TO NORMAL STANDBY TO CHECK FOR LEAKS OR PROBLEMS BEFORE LEAVING FOR THE DAY. THE INSTALLING FIRE SUPPRESSION CONTRACTOR SHALL BE ABLE TO RESPOND TO ANY EMERGENCY SITUATIONS PERTAINING TO THIS WORK WITHIN ONE (1) HOUR.

NOTICE TO CONTRACTORS:

THE FIRE PROTECTION SYSTEMS DESIGNER IS CAUTIONED TO CAREFULLY COORDINATE AND CONSIDER ROUTINES OF ALL TRADES AND SYSTEMS PRIOR TO ANY WORK BEING DONE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING STRUCTURAL ELEMENTS, HVAC DUCTWORK, ALL ABOVE CEILING PIPING SYSTEMS, LIGHTING FIXTURES, PLUMBING, MEDICAL GAS, ETC.), AS THERE WILL BE LIMITED SPACE ABOVE CEILING AND IN CHASES. THE SHORTEST ROUTE / PATH FOR ANY PENETRATIONS SHALL BE MAINTAINED. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING FEATURES OR CONFLICTS WITH OTHER DISCIPLINES. THE FIRE PROTECTION DESIGNER IS CAUTIONED TO PERFORM A VERY DETAILED SURVEY OF THE BUILDING, EXISTING OR PLANNED, AND CAREFULLY REVIEW ALL PROJECT DRAWINGS AND DETAILS DURING DESIGN OF THE FIRE PROTECTION SYSTEMS.

THE INSTALLING FIRE PROTECTION CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING WITH THE GENERAL CONTRACTOR AND OTHER TRADES PRIOR TO ANY PENETRATIONS AND DRILLING INTO STRUCTURAL, GASKET, CORE AND GEOD CONCRETE. ANY PENETRATIONS SHALL BE PROTECTED AND REINFORCED WITH STEEL PLATE AND SHALL BE MAINTAINED TO ANY PART OR FEATURE OF THE BUILDING, EXISTING OR PLANNED. THE INSTALLING CONTRACTOR IS CAUTIONED TO VERIFY ANY AND ALL PENETRATIONS PRIOR TO DRILLING HOLES FOR PIPES, SPRIT, CRACK OR OTHERWISE DAMAGE ANY STRUCTURAL FRAMING MEMBERS OR CONCRETE SLABS. PENETRATIONS OF STRUCTURAL MEMBERS IS STRICTLY PROHIBITED WITHOUT A PROPERLY EXECUTED, WRITTEN APPROVAL FROM THE FIRE PROTECTION DESIGNER. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING FEATURES OR CONFLICTS WITH OTHER DISCIPLINES. THE CONTRACTOR IS CAUTIONED TO COORDINATE WITH ALL OTHER DISCIPLINES.

FIRST FLOOR DEMOLITION PLAN - FIRE PROTECTION

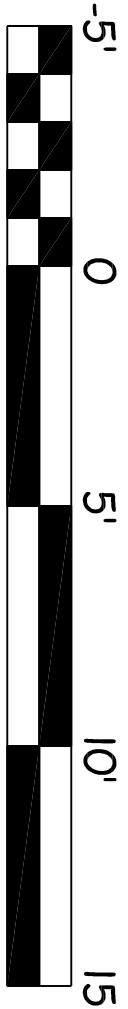


CONSULTANTS:

WITTENBERG, DELONY & DAVIDSON
1100 WEST CAPITOL AVE., LITTLE ROCK, AR 72201
(501) 376-6661

BERNHARD TME ENGINEERS
1 ALLIED DRIVE, SUITE 2000, LITTLE ROCK, AR 72202
(501) 666-6776

ARCHITECT/ENGINEERS:

JOHNSON DANFORTH & ASSOCIATES
2200 N. RODNEY PARKWAY RD., SUITE 210, LITTLE ROCK, AR 72212
(501) 404-4461

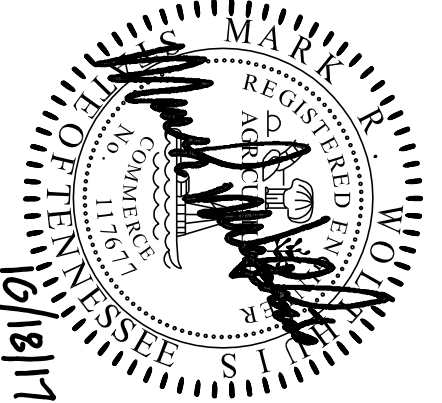

Drawing Title
FIRST FLOOR DEMOLITION PLAN - FIRE PROTECTION

Approved Project Director
VAPACHOS PLANNING AND ENGINEERING

Project Title
RENOVATE PHYSICAL MEDICINE AND REHABILITATION POOL AREA

Location
MEMPHIS

Date
10/18/17

Checked
TN

Drawn
F1.02

Project Number
614-16-112

Building Number
-

Drawing Number
F1.02

Dwg 1 of 1

Office of
Construction
and Facilities
Management

