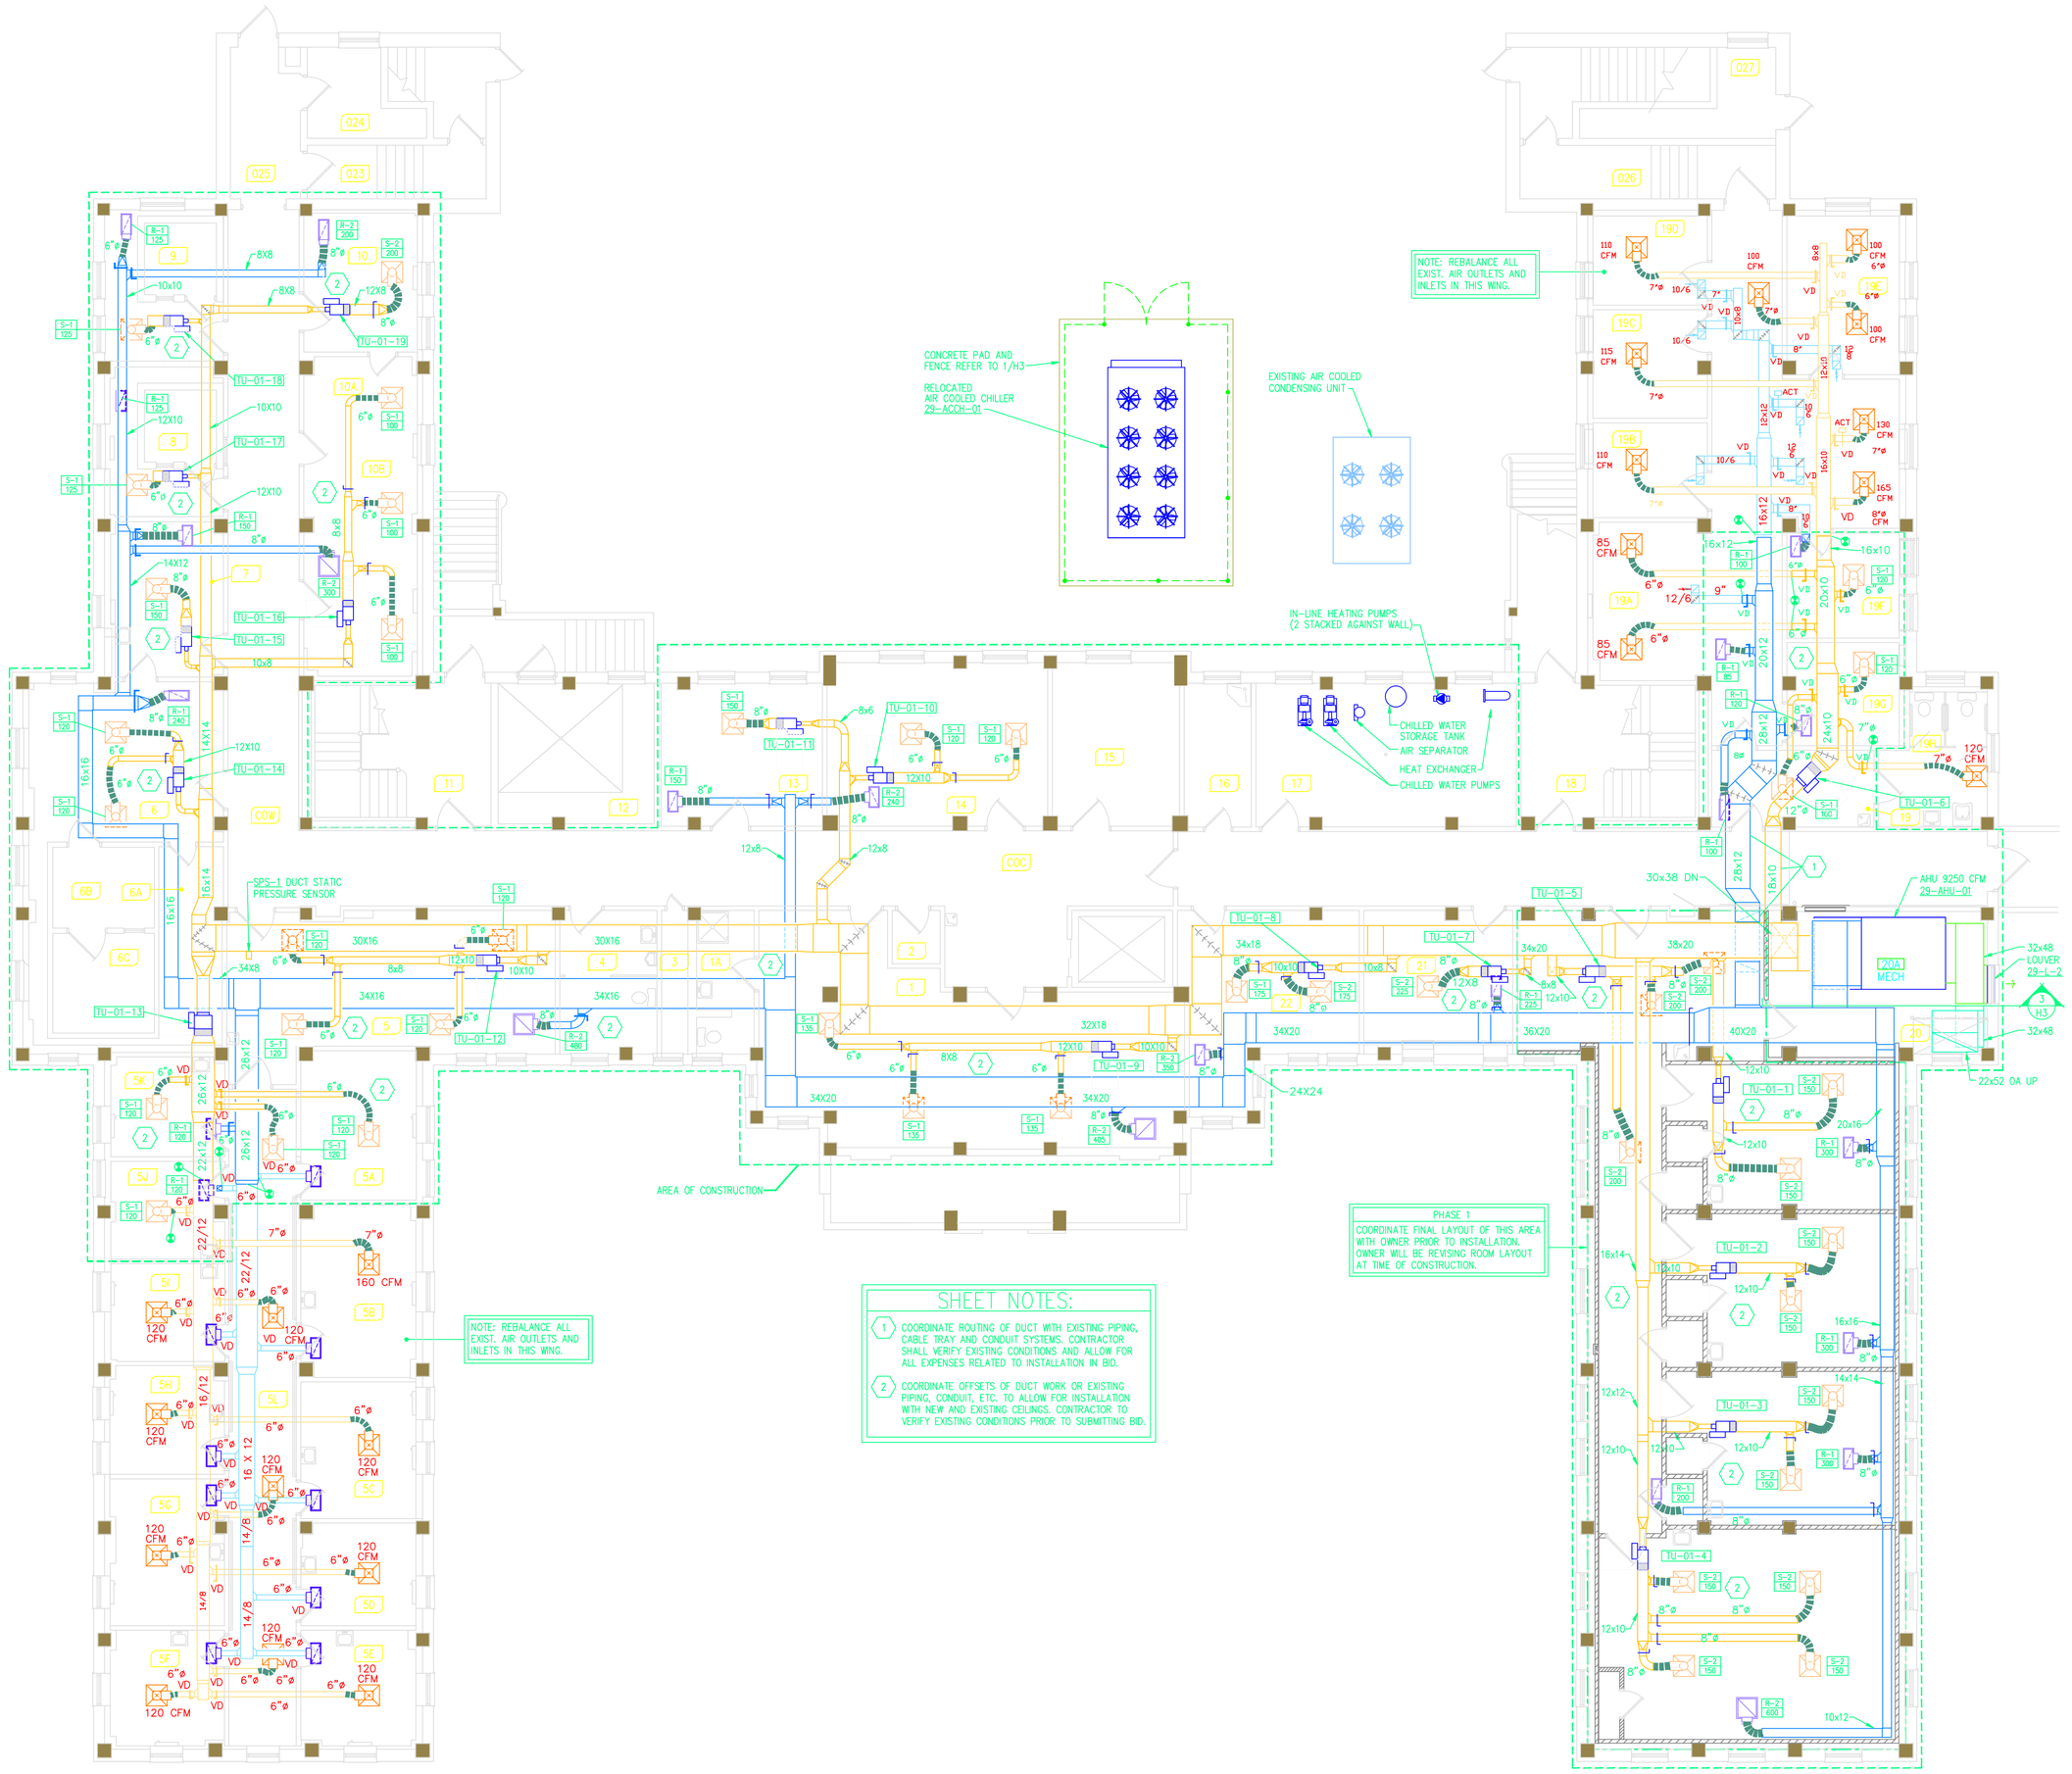

SHEET NOTES:

1. COORDINATE ROUTING OF DUCT WITH EXISTING PIPING, CABLE TRAY AND CONDUIT SYSTEMS. CONTRACTOR SHALL VERIFY EXISTING CONDITIONS AND ALLOW FOR ALL EXPENSES RELATED TO INSTALLATION IN BID.
2. COORDINATE OFFSETS OF DUCT WORK OR EXISTING PIPING, CONDUIT, ETC. TO ALLOW FOR INSTALLATION WITH NEW AND EXISTING CEILINGS. CONTRACTOR TO VERIFY EXISTING CONDITIONS PRIOR TO SUBMITTING BID.

NORTH

1 / H2 BASEMENT FLOOR VENTILATION PLAN

SCALE: 1/8"=1'-0"

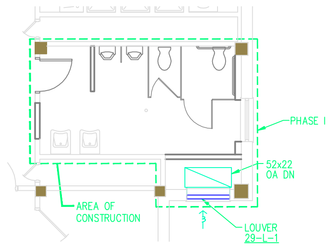

2 / H2 FIRST FLOOR VENTILATION PLAN

SCALE: 1/8"=1'-0"

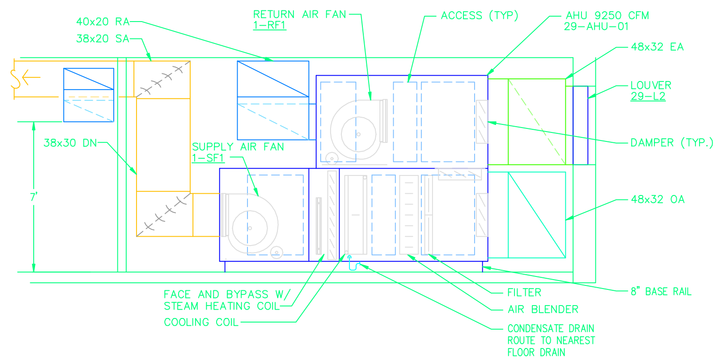

3 / H2 SECTION AT AHU

SCALE: 1/8"=1'-0"

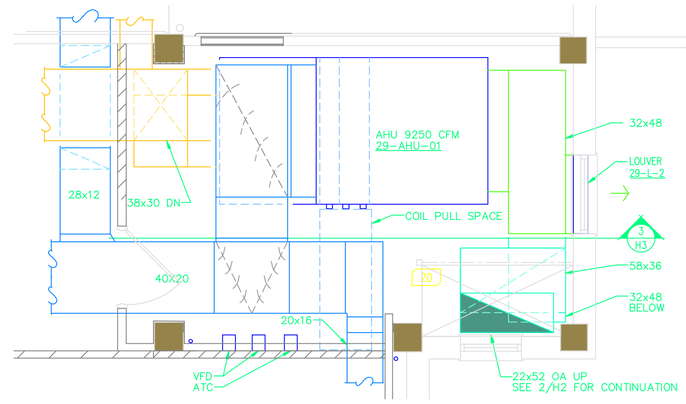

4 / H2 PLAN AT AHU

SCALE: 1/8"=1'-0"

GENERAL NOTE:

1. CONTRACTOR AND ALL SUB-CONTRACTORS SHALL VISIT SITE AND REVIEW ABOVE CEILING CONDITIONS PRIOR TO SUBMITTING A BID. ALL REVISIONS OF EXISTING SERVICES SHALL BE CONSIDERED AND INCLUDED IN BID. REQUESTS FOR ADDITIONAL FEES WILL NOT BE APPROVED DUE TO EXISTING CONDITIONS.
2. CONTRACTOR SHALL MAINTAIN ALL CEILING HEIGHTS AS THEY EXIST. ANY REVISION IN CEILING HEIGHT WILL BE AT THE CONTRACTORS COST AND ONLY IF APPROVED BY THE COTR.

No	REVISION	DATE

IMAGE GROUP
IMAGE GROUP INC., Architecture & Interiors
409 CENTER AVENUE, SUITE 300
MOORHEAD, MN 56560

OBERMILLER·NELSON ENGINEERING
P.O. Box 2725
Fargo, ND 58108
TEL: (701) 280-0500
FAX: (701) 280-0522

Ulteig engineers
Bismarck - Detroit Lakes - Fargo - Minneapolis - Sioux Falls
3350 38th Avenue South
Fargo, North Dakota 58104

I hereby certify that this plan specification, or report was prepared by me or under my direct supervision, and that I am duly Registered Engineer under the laws of the State of Minnesota.

Date_____ Reg. No. 44065

APPROVED: SERVICE LINE DIRECTOR DATE:	APPROVED: INFECTION CONTROL NURSE DATE:
APPROVED: SERVICE LINE DIRECTOR DATE:	APPROVED: PATIENT SAFETY DATE:
APPROVED: PROJECTS SECTION MANAGER DATE:	APPROVED: CHIEF OF POLICE DATE:
APPROVED: DIRECTOR FMS DATE:	APPROVED: SAFETY MANAGER DATE:
APPROVED: CHIEF OF STAFF DATE:	
APPROVED: MEDICAL CENTER DIRECTOR DATE:	

DRAWING TITLE: BASEMENT FLOOR VENTILATION PLAN

PROJECT TITLE: BUILDING 29 BASEMENT HVAC

BUILDING No: 29 | CHECKED BY: JS | DRAWN: JDK

LOCATION: VA MEDICAL CENTER ST.CLOUD, MN 56303

DATE: December 1, 2008
PLOT SCALE: SCALE AS SHOWN
PROJECT NO.: -
CAD FILE: -
DRAWING NO.: H2 DWG. 6 OF 12

VAMC SAINT CLOUD MN