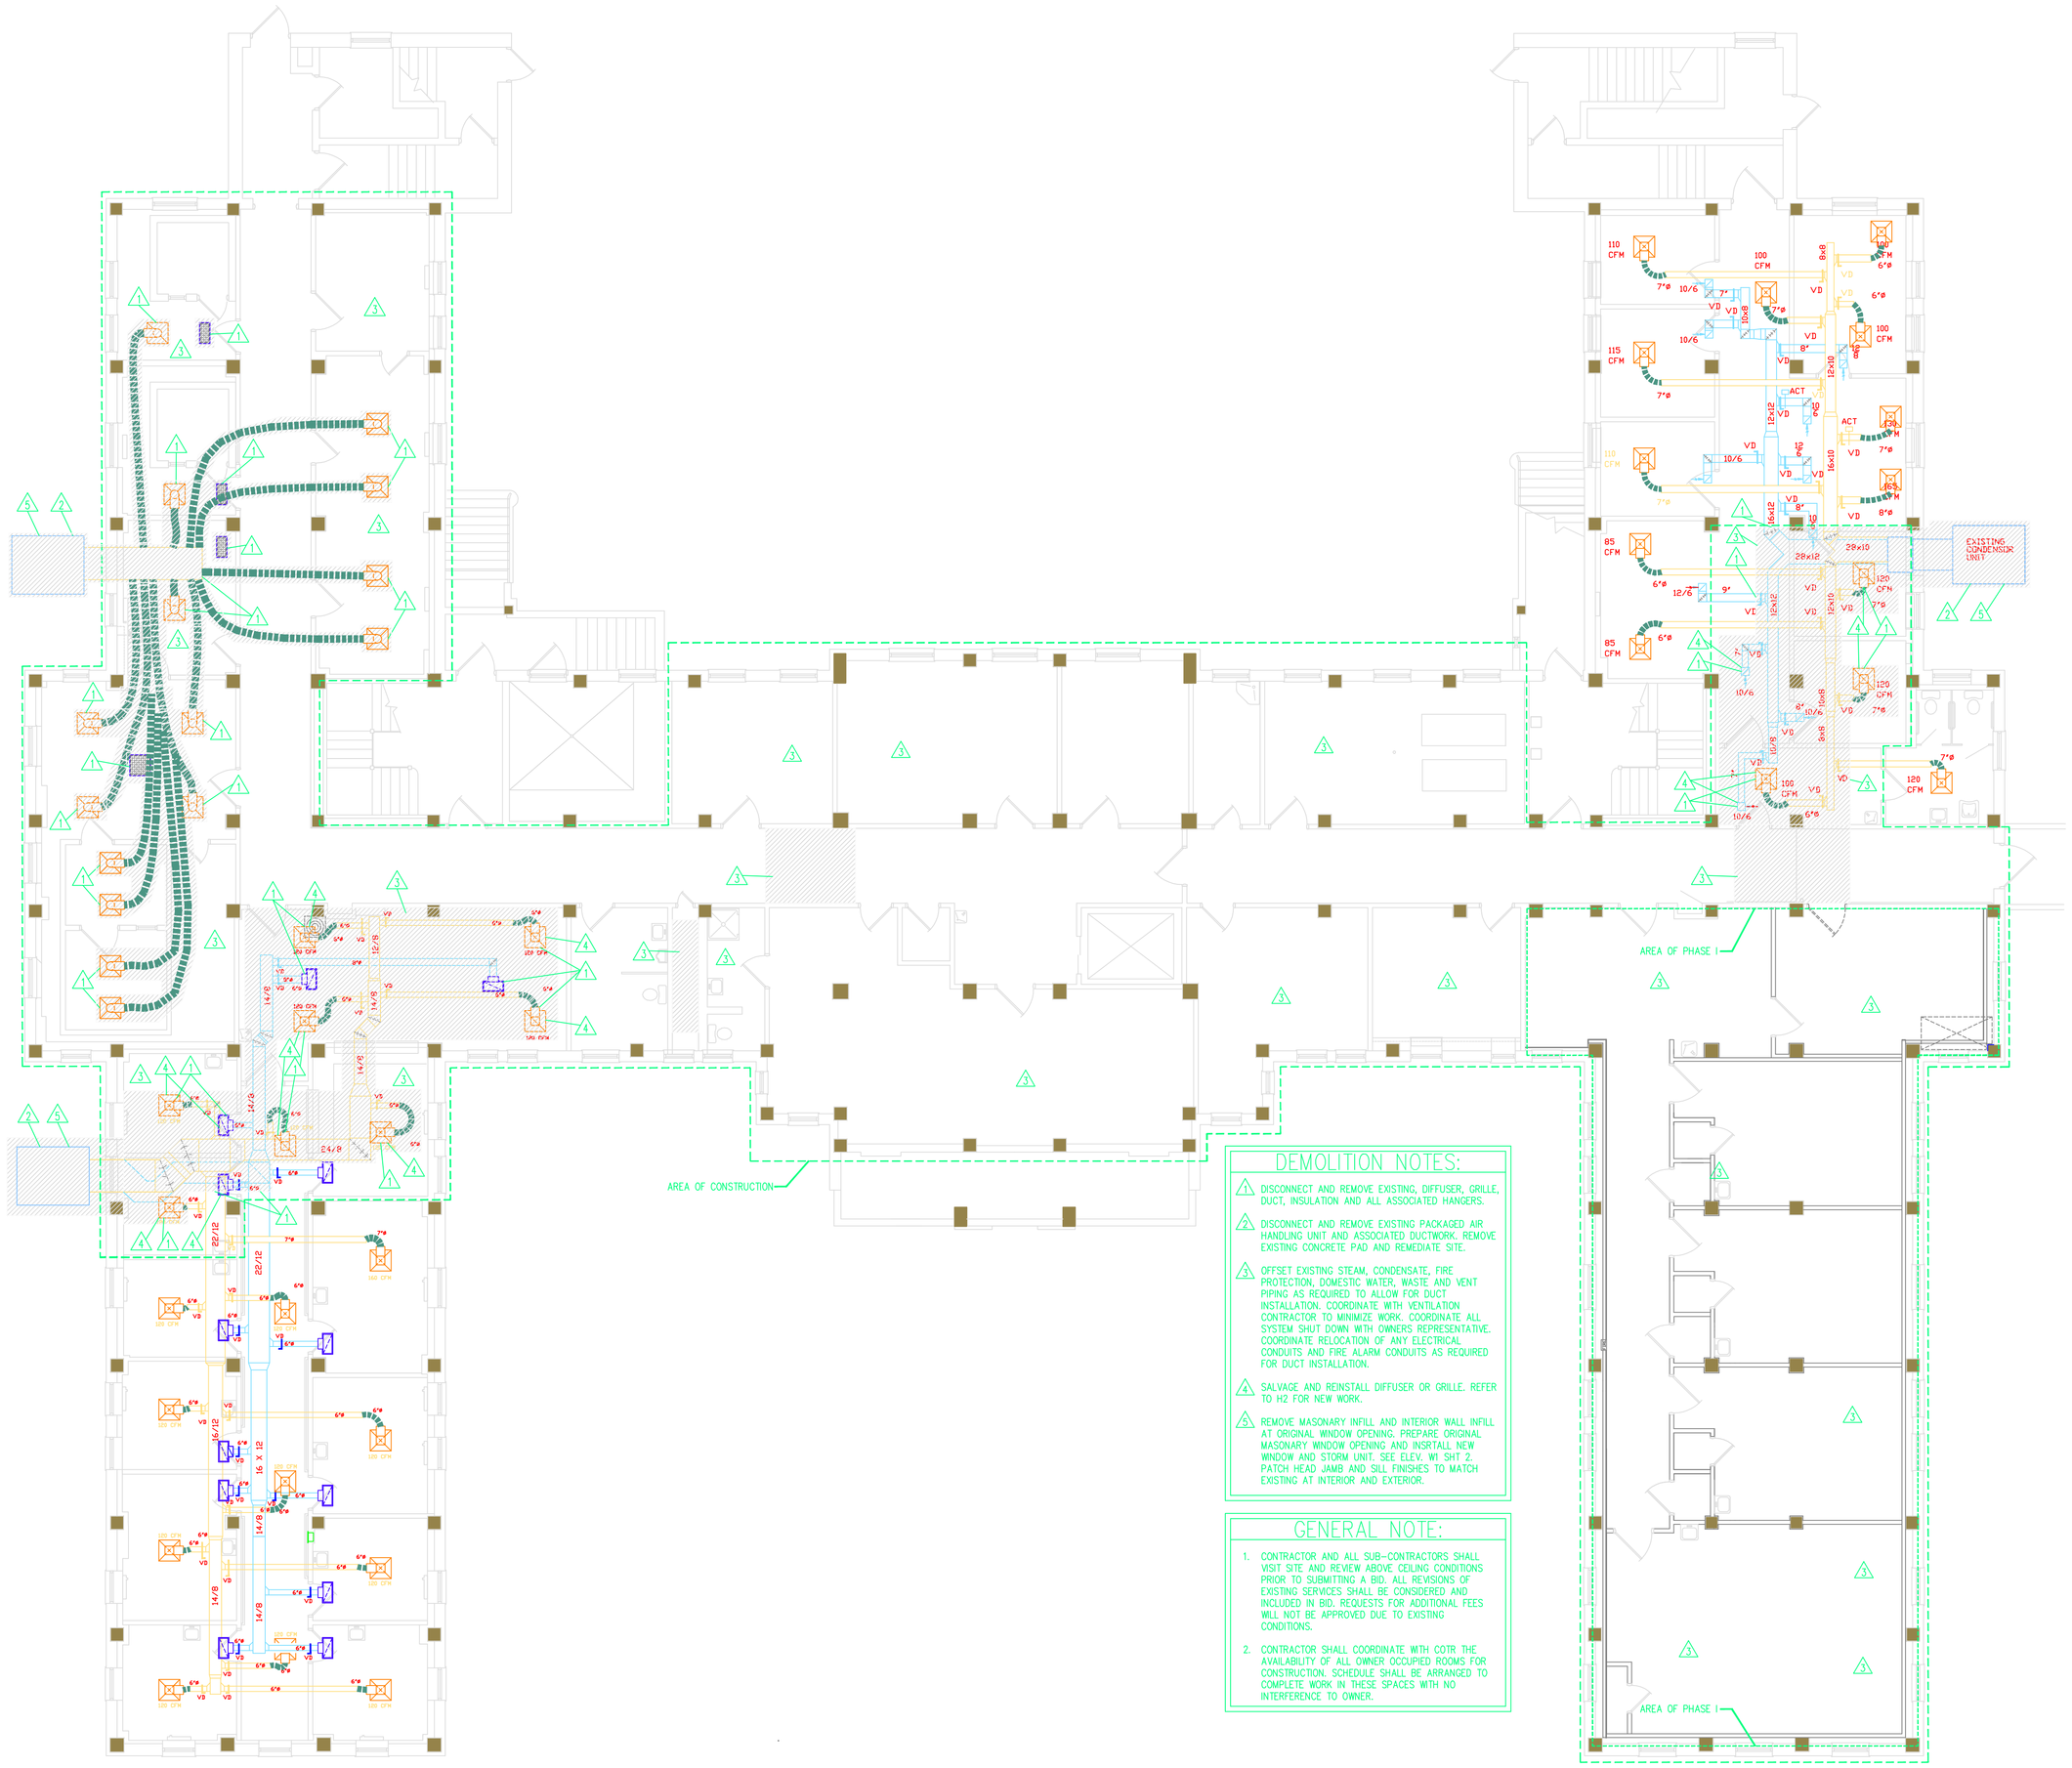

DEMOLITION NOTES:

1. DISCONNECT AND REMOVE EXISTING, DIFFUSER, GRILLE, DUCT, INSULATION AND ALL ASSOCIATED HANGERS.
2. DISCONNECT AND REMOVE EXISTING PACKAGED AIR HANDLING UNIT AND ASSOCIATED DUCTWORK. REMOVE EXISTING CONCRETE PAD AND REMEDIATE SITE.
3. OFFSET EXISTING STEAM, CONDENSATE, FIRE PROTECTION, DOMESTIC WATER, WASTE AND VENT PIPING AS REQUIRED TO ALLOW FOR DUCT INSTALLATION. COORDINATE WITH VENTILATION CONTRACTOR TO MINIMIZE WORK. COORDINATE ALL SYSTEM SHUT DOWN WITH OWNERS REPRESENTATIVE. COORDINATE RELOCATION OF ANY ELECTRICAL CONDUITS AND FIRE ALARM CONDUITS AS REQUIRED FOR DUCT INSTALLATION.
4. SALVAGE AND REINSTALL DIFFUSER OR GRILLE. REFER TO H2 FOR NEW WORK.
5. REMOVE MASONARY INFILL AND INTERIOR WALL INFILL AT ORIGINAL WINDOW OPENING. PREPARE ORIGINAL MASONARY WINDOW OPENING AND INSTALL NEW WINDOW AND STORM UNIT. SEE ELEV. W1 SHT 2. PATCH HEAD JAMB AND SILL FINISHES TO MATCH EXISTING AT INTERIOR AND EXTERIOR.

GENERAL NOTE:

1. CONTRACTOR AND ALL SUB-CONTRACTORS SHALL VISIT SITE AND REVIEW ABOVE CEILING CONDITIONS PRIOR TO SUBMITTING A BID. ALL REVISIONS OF EXISTING SERVICES SHALL BE CONSIDERED AND INCLUDED IN BID. REQUESTS FOR ADDITIONAL FEES WILL NOT BE APPROVED DUE TO EXISTING CONDITIONS.
2. CONTRACTOR SHALL COORDINATE WITH COTR THE AVAILABILITY OF ALL OWNER OCCUPIED ROOMS FOR CONSTRUCTION. SCHEDULE SHALL BE ARRANGED TO COMPLETE WORK IN THESE SPACES WITH NO INTERFERENCE TO OWNER.

NORTH

1
H1

BASEMENT FLOOR HVAC DEMO PLAN

SCALE: 1/8"=1'-0"

No	REVISION	DATE

IMAGE GROUP
IMAGE GROUP INC., Architecture & Interiors
403 CENTER AVENUE, SUITE 300
MOORHEAD, MN 56560

OBERMILLER·NELSON ENGINEERING
Building Systems Consultants
P.O. Box 2725
Fargo, ND 58108
TEL: (701) 280-0500
FAX: (701) 280-0522

Ulteig engineers
Bismarck - Detroit Lakes - Fargo - Minneapolis - Sioux Falls
3350 38th Avenue South
Fargo, North Dakota 58104

I hereby certify that this plan specification, or report was prepared by me or under my direct supervision, and that I am duly Registered Engineer under the laws of the State of Minnesota.

Date_____ Reg. No. 44065

APPROVED: SERVICE LINE DIRECTOR DATE:	APPROVED: INFECTION CONTROL NURSE DATE:
APPROVED: SERVICE LINE DIRECTOR DATE:	APPROVED: PATIENT SAFETY DATE:
APPROVED: PROJECTS SECTION MANAGER DATE:	APPROVED: CHIEF OF POLICE DATE:
APPROVED: DIRECTOR FMS DATE:	APPROVED: SAFETY MANAGER DATE:
APPROVED: CHIEF OF STAFF DATE:	
APPROVED: MEDICAL CENTER DIRECTOR DATE:	

DRAWING TITLE: BASEMENT LEVEL HVAC DEMO PLAN

PROJECT TITLE: BUILDING 29 BASEMENT HVAC

BUILDING No: 29 | CHECKED BY: JS | DRAWN: JDK

LOCATION: VA MEDICAL CENTER ST.CLOUD, MN 56303

DATE: December 1, 2008
PLOT SCALE: SCALE AS SHOWN
PROJECT NO.: -
CAD FILE
DRAWING NO.: H1 DWG. 5 OF 12

VAMC SAINT CLOUD MN