

DRAWING NOTES:

- GAZEBO IS BEING RELOCATED. PROTECT EXISTING LIGHT FIXTURE, PHOTOCELL, CONDUIT AND WIRE INSTALLED IN GAZEBO FOR REUSE. REMOVE ALL ELECTRICAL DEVICES, WIRE AND CONDUIT SERVING EXISTING GAZEBO BACK TO SOURCE.
- REMOVE EXISTING POLE LIGHT AND BASE. RETURN TO VA. FOR USE IN FUTURE PHASE.
- REMOVE EXISTING HANDBOX AND ASSOCIATED UNDERGROUND CONDUIT AND WIRE BACK TO POINT INDICATED.
- DEMOLISH EXISTING UNDERGROUND CONDUIT AND ASSOCIATED WIRE TO THIS POINT.
- PROVIDE 1 POLE 20A, CIRCUIT BREAKER IN EXISTING PANEL "S". BREAKER SHALL BE MANUFACTURED BY SQUARE D TYPE NODD. PROVIDE 2 #10 + 1 #10 GRD. IN 3/4" PVC 40 CONDUIT. EXTEND UP TO THE NEW GAZEBO LOCATION. PROVIDE NEW RECEPTACLE AND RECONNECT LIGHT FIXTURE IN GAZEBO.
- PROVIDE 3" PVC DIRECT BURIED 24" BELOW GRADE. PROVIDE CONDUCTOR SIZE AND QUANTITY. SAME AS EXISTING CIRCUIT THAT WAS DEMOLISHED. SPUDGE TO EXISTING CONDUCTORS IN HANDBOXES.
- ROUTE CONDUIT AS SHOWN TO ALLOW FOR FUTURE EXPANSION OF NEW STORM WATER RETENTION POND.
- MOUNT NEW RECEPTACLE ON GAZEBO PERIMETER COLUMN AT 24" AFG.
- SEE POWER RISER AND DWG 1-B-1-E1 FOR MORE INFORMATION.
- SEE POWER RISER AND DWG 1-B-1-E1 FOR MORE INFORMATION.
- THE CONTRACTOR SHALL COORDINATE EXACT LOCATION OF GAZEBO WITH THE COIR AND FUTURE PARKING LOT PROJECT.
- SEE DWG 1-E2 FOR NEW 15 KV SWITCH DETAILS. NEW CONCRETE PAD SHALL BE AN EXTENSION OF THE EXISTING 15 KV SWITCHES CONCRETE PAD. ADJUST PAD THICKNESS AND/OR MODIFY FINISHED GRADE AS REQUIRED FOR SLIGHT DROP OFF IN TOPOGRAPHY.



ELECTRICAL LEGEND

- UNDERGROUND ELECTRIC LINE
- POLE LIGHT
- ELECTRIC HAND BOX, SEE DETAIL
- GFI RECEPTACLE WITH WATERPROOF COVER

ELECTRICAL ABBREVIATIONS

- | | |
|-------------|-----------------------------------|
| A | AMPERE |
| AFF | ABOVE FINISHED FLOOR |
| AFG | ABOVE FINISHED GRADE |
| AHU | AIR HANDLING UNIT |
| AWG | AMERICAN WIRE GAUGE |
| C | CONDUIT |
| CB, CKT BKR | CIRCUIT BREAKER |
| CKT | CIRCUIT |
| CLG | CEILING |
| CT | CURRENT TRANSFORMER |
| DWG | DRAWING |
| ETR | EXISTING TO REMAIN |
| EWG | ELECTRIC WATER COOLER |
| EF | EXHAUST FAN |
| EX / EXIST | EXISTING |
| FA | FIRE ALARM |
| FOU | FAN COIL UNIT |
| G, GND | GROUND |
| GFCI | GROUND FAULT CIRCUIT INTERRUPTER |
| HP | HORSEPOWER |
| JB | JUNCTION BOX |
| KAIC | KILO AMPERE INTERRUPTING CAPACITY |
| KW | KILO WATT |
| LITG | LIGHTING |
| MLO | MAIN LUGS ONLY |
| NFSS | NON-FUSED SAFETY SWITCH |
| UN | UNLESS OTHERWISE NOTED |

KEY PLAN

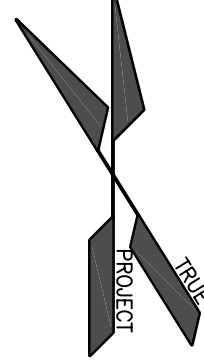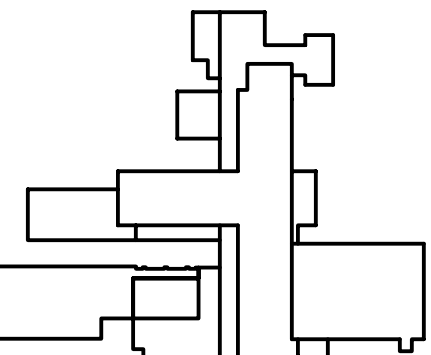

DELLC
JOB NO. 090407

Project Title
SITE PLAN DEMOLITION
AND NEW WORK

Approved: Division Chief	Approved: Service Director
Building Number 01	Checked RAW
Location VAMC Altoona, Pennsylvania	Drawn JGB

Project Title
MOVE AND EXPAND
REHAB

Date 19 JULY 2010	Project No. 503-305
Building Number 01	Checked RAW
Location VAMC Altoona, Pennsylvania	Drawn JGB
DWG 52 of 71	DRAWING NO. 1-E1



Consultants
BURDETTE KOEHLER MURPHY & ASSOCIATES, INC.
1423 CLARKVIEW ROAD, SUITE 500
BALTIMORE, MARYLAND 21209
410.531.2000 - FAX 410.531.2244

DUNLAP ENGINEERING, INC.
STRUCTURAL ENGINEERING
17111 LINDEN LANE, SUITE 100
PHILADELPHIA, PENNSYLVANIA 19151-1827
410.817.2000 - FAX 410.817.2901

THE EADS GROUP, INC.
1725 EIGHTH AVENUE
ALTOONA, PENNSYLVANIA 16602
814.944.5005 - FAX 814.944.6852

BUILDING COST CONSULTANTS, INC.
COST ESTIMATING
1000 MARKET STREET, SUITE 200
PHILADELPHIA, PENNSYLVANIA 19106
410.298.8200 - FAX 410.298.8290

DERBY ENTERPRISES
ARCHITECTURE
ENGINEERING
13201 ELMWOOD COURT, SUITE 103-C1
BELLEVILLE, MISSOURI 63704-1984
410.533.5200
Fax: 410.533.1653

James E. Van Zandt
Veterans Administration
Medical Center