



- MEDICAL GAS (PLUMBING) GENERAL NOTES**
- THE MEDICAL GAS SYSTEM SHALL CONFORM TO THE CURRENT EDITION OF NFPA 99.
 - ALL PIPING CONNECTIONS SHALL BE OFF OF THE TOP OF THE PIPING.
 - MINIMUM PIPING SIZE SHALL BE 1/2" FOR ALL SYSTEMS EXCEPT VACUUM WHICH SHALL BE 3/4".
 - COORDINATE EXACT ELEVATION AND LOCATION OF ALL OUTLETS WITH THE ARCHITECTURAL ELEVATIONS.
 - WHERE ONE PIPE DROP IS SHOWN TO MULTIPLE OUTLETS, PROVIDE BRANCHES IN THE WALL SPACE OF MINIMUM PIPE SIZE FROM DROP TO OUTLET CONNECTION.
 - COORDINATE EXACT LOCATION WITH ALL ABOVE CEILING COMPONENTS PRIOR TO INSTALLING MEDICAL GAS PIPING.
 - CONTRACTOR TO COORDINATE LOCATION OF MEDICAL GAS TERMINALS IN ENDOSCOPY PROCEDURE ROOMS FOR CONNECTION TO SKYTRON SKYBOOM SYSTEM.


- CODED NOTES**
- PROVIDE NEW CONNECTION TO THE EXISTING OXYGEN RISER. PROVIDE A NEW FLOOR ISOLATION VALVE. WORK SHALL BE PERFORMED DURING "OFF-HOURS". COORDINATE OUTAGE WITH VA PROJECT MANAGER.
 - PROVIDE A NEW ZONE VALVE WITH ALARM.
 - EXTEND NEW MEDICAL VACUUM PIPING TO CONNECT TO EXISTING MAN OVER ROOM (MOR). PROVIDE ISOLATION VALVE. WORK SHALL BE PERFORMED DURING "OFF-HOURS". COORDINATE OUTAGE WITH VA PROJECT MANAGER.

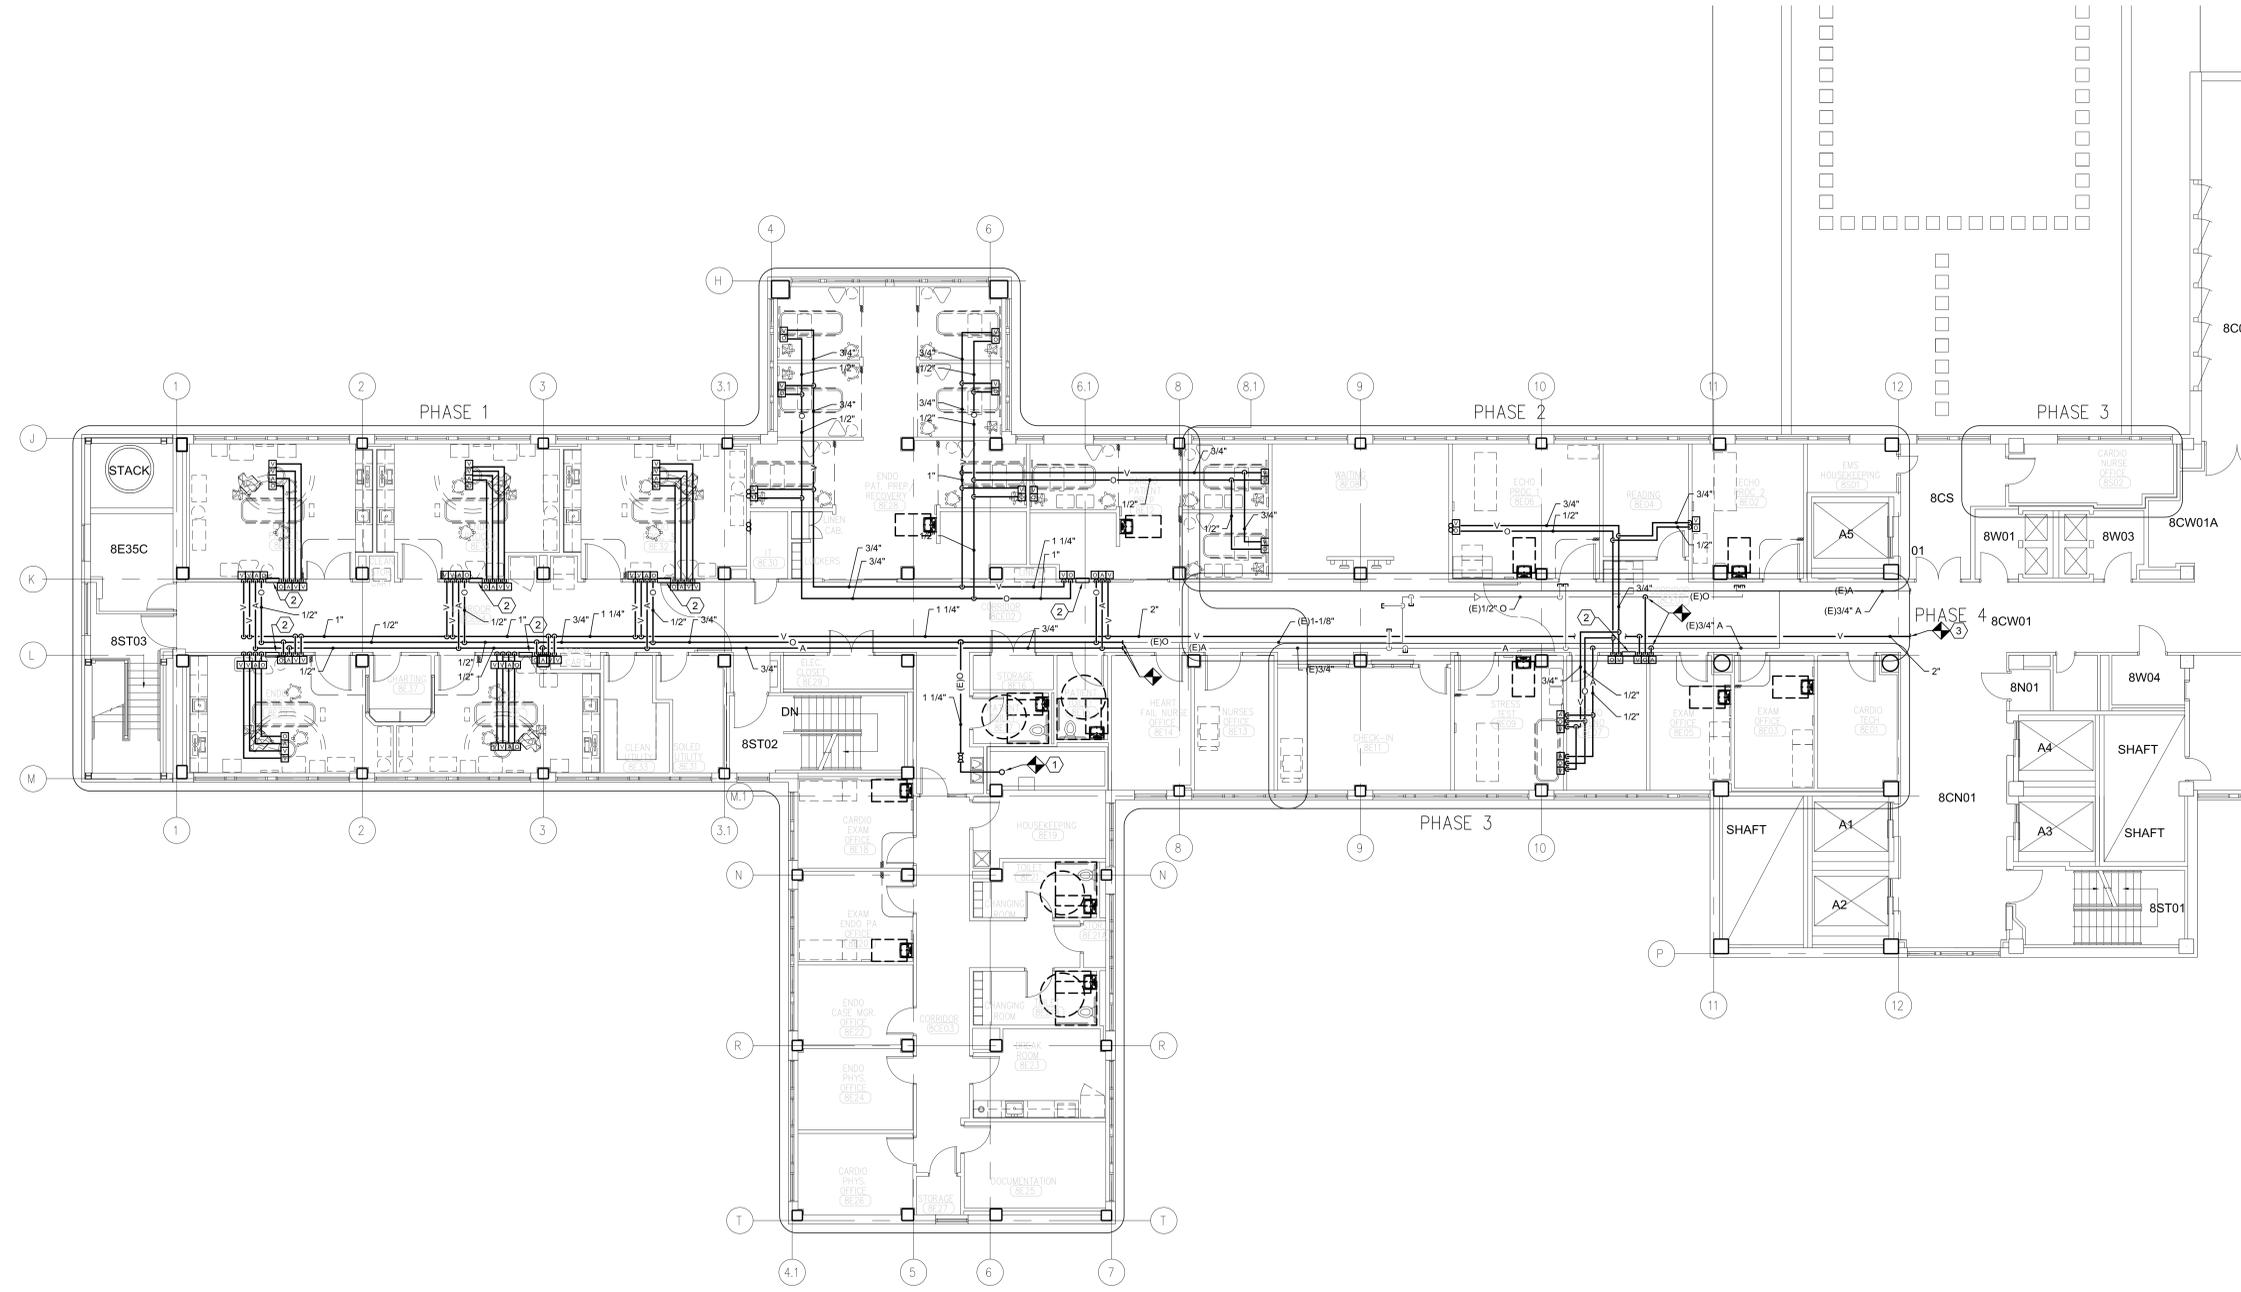

A EIGHTH FLOOR



KEYPLAN

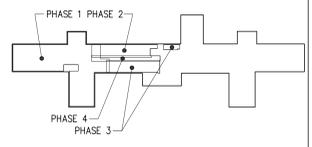

CONSTRUCTION DOCUMENTS

NO. REVISIONS/SUBMISSIONS DATE	Consultant	Seal 	FED/Matrix A Joint Venture 	Drawing Title EIGHT EAST MEDICAL GASES NEW WORK PLAN	Project Title RENOVATE EIGHT EAST FOR ENDOSCOPY & CARDIOLOGY IC VAHCS	Project Number 636A8-12-005	Office of Construction and Facilities Management
	Approved: Project Director	Location IOWA CITY, IOWA	Date 07/27/2012	Checked CAM	Drawn JMS	Building Number 1	