


- MEDICAL GAS (PLUMBING) GENERAL NOTES**
1. THE MEDICAL GAS SYSTEM SHALL CONFORM TO THE CURRENT EDITION OF NFPA 99.
  2. ALL PIPING CONNECTIONS SHALL BE OFF OF THE TOP OF THE PIPING.
  3. MINIMUM PIPING SIZE SHALL BE 1/2" FOR ALL SYSTEMS EXCEPT VACUUM WHICH SHALL BE 3/4".
  4. COORDINATE EXACT ELEVATION AND LOCATION OF ALL OUTLETS WITH THE ARCHITECTURAL ELEVATIONS.
  5. WHERE ONE PIPE DROP IS SHOWN TO MULTIPLE OUTLETS, PROVIDE BRANCHES IN THE WALL SPACE OF MINIMUM PIPE SIZE FROM DROP TO OUTLET CONNECTION.
  6. COORDINATE EXACT LOCATION WITH ALL ABOVE CEILING COMPONENTS PRIOR TO INSTALLING MEDICAL GAS PIPING.
- CODED NOTES**
1. PROVIDE NEW CONNECTION TO THE EXISTING OXYGEN RISER. PROVIDE A NEW FLOOR ISOLATION VALVE. WORK SHALL BE PERFORMED DURING "OFF-HOURS". COORDINATE OUTAGE WITH VA PROJECT MANAGER.
  2. PROVIDE A NEW ZONE VALVE WITH ALARM.
  3. EXTEND NEW MEDICAL VACUUM PIPING TO CONNECT TO EXISTING MAN OVER ROOM 8006. PROVIDE ISOLATION VALVE. WORK SHALL BE PERFORMED DURING "OFF-HOURS." COORDINATE OUTAGE WITH VA PROJECT MANAGER.

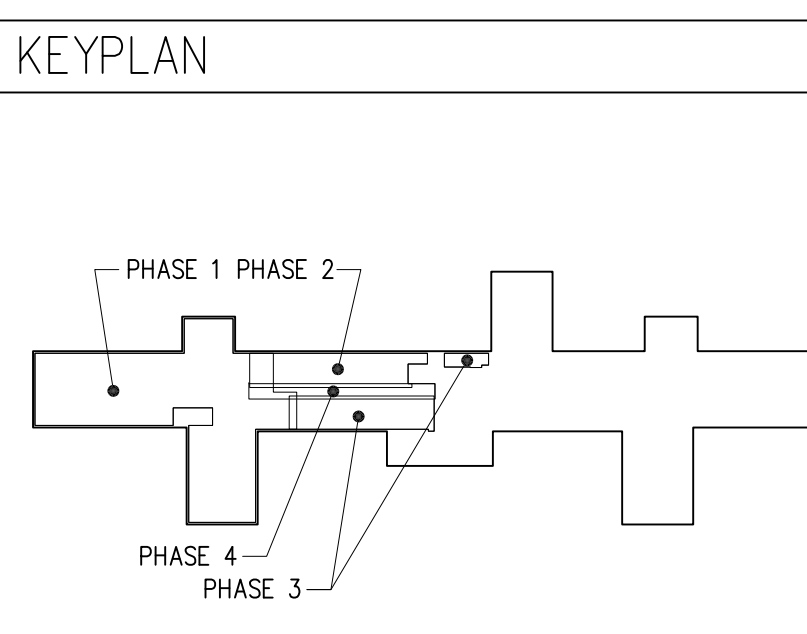

**CONSTRUCTION DOCUMENTS**

Project Number 636A8-12-005	Office of Construction and Facilities Management
Building Number 1	
Drawing Number 1-P6	
26 of 42	

NO.	REVISIONS/SUBMISSIONS	DATE	Consultant	Seal	<b>FED/Matrix</b> A Joint Venture 255 COUNTY ROAD 555 SOUTH, BARTOW, FLORIDA 33830 Telephone: (863) 665-6363 Fax: (863) 667-1773	Drawing Title <b>EIGHT EAST PLUMBING MEDICAL GAS RISER</b>	Project Title <b>RENOVATE EIGHT EAST FOR ENDOSCOPY &amp; CARDIOLOGY IC VAHCS</b>	Location IOWA CITY, IOWA	Date 07/27/2012	Checked CAM	Drawn JMS
-----	-----------------------	------	------------	------	---	---	---	-----------------------------	--------------------	----------------	--------------