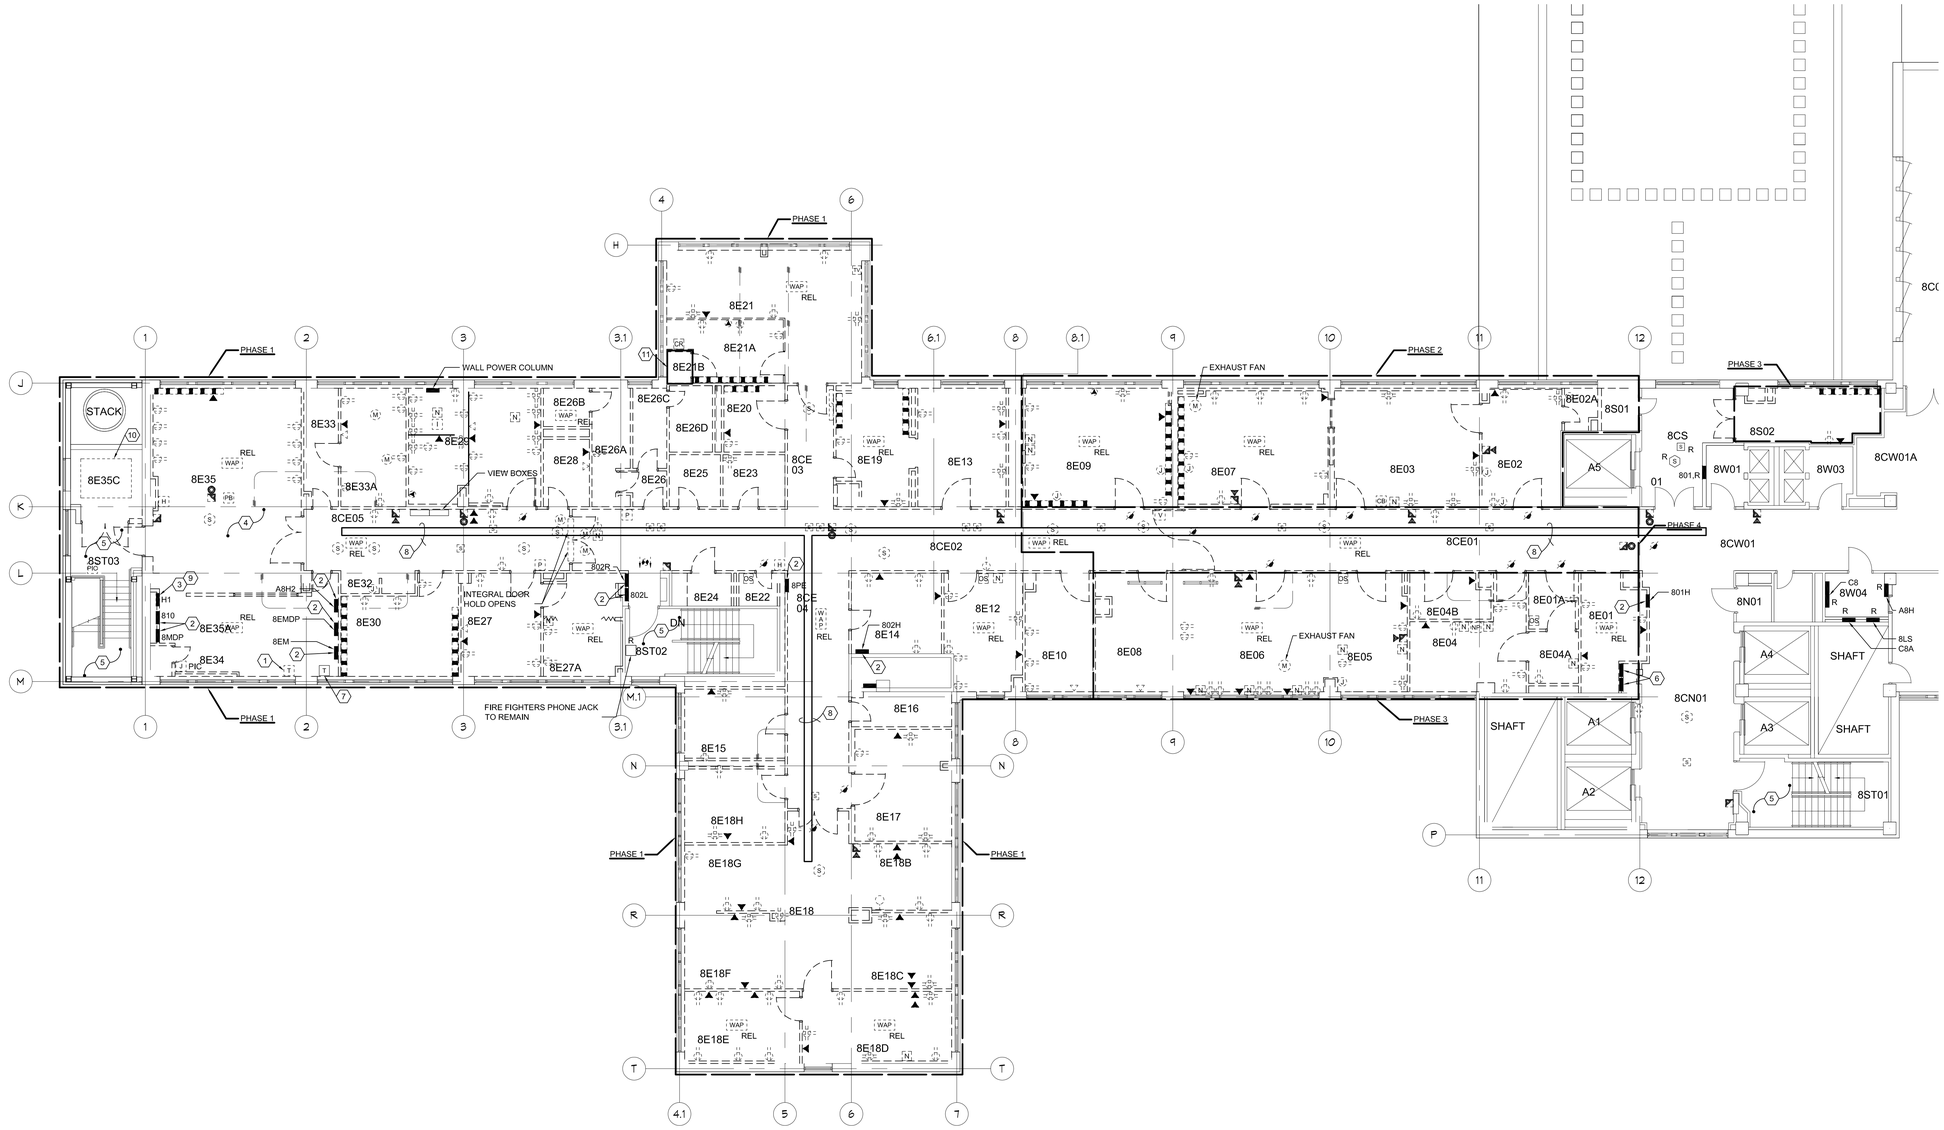

A EIGHT EAST
POWER DEMOLITION PLAN

1/8" = 1'-0"
0' 1'-2" 4' 8'

GENERAL NOTES

1. IT IS THE INTENT THAT ALL LIGHTING FIXTURES, RECEPTACLES, SYSTEMS DEVICES, SYSTEMS WIRING CONDUITS, CIRCUITING, PANELBOARDS, ETC., WITHIN THE DEMOLITION AREAS BE DISCONNECTED AND REMOVED IN ITS ENTIRETY. THESE DRAWINGS WERE CREATED USING EXISTING AS-BUILT DRAWINGS AND FROM FIELD OBSERVATIONS. THE ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR VERIFYING EXACT QUANTITY AND EXISTING CONDUIT ROUTING. ROOMS INDICATED TO BE DEMOLISHED, BUT HAVE NO DEVICES, FIXTURES, ETC. SHOWN SHALL ALSO HAVE THEIR DEVICES DISCONNECTED AND REMOVED. ALL WIRING AND EQUIPMENT THAT IS TO REMAIN (BUT NEEDS RELOCATED TO ACCOMMODATE NEW DUCTWORK ETC.) SHALL BE RELOCATED AS REQUIRED.
2. MAINTAIN EXISTING FIRE ALARM, NURSE CALL, PAGING, DATA COMMUNICATIONS SYSTEM UNTIL NEW SYSTEMS ARE OPERATIONAL 3. REFER TO THE PLUMBING, FIRE PROTECTION AND HVAC FOR ITEMS THAT ARE TO BE DISCONNECTED WHICH HAVE ELECTRICAL CONNECTIONS.
3. REFER TO THE PLUMBING, FIRE PROTECTION AND HVAC DRAWINGS FOR ITEMS THAT ARE TO BE DISCONNECTED AND REMOVED WHICH HAVE ELECTRICAL CONNECTIONS.

CODED NOTES

1. EXISTING TRANSFORMER TO BE DISCONNECTED AND REMOVED.
2. DISCONNECT AND REMOVE EXISTING PANELBOARD. PROVIDE NEW PANELBOARD IN LOCATION SHOWN ON DRAWING 1-E2. SEE DRAWING 1-E5 FOR PANELBOARD SCHEDULES. EXTEND EXISTING FEEDERS AND BRANCH CIRCUITS, THAT ARE TO REMAIN, TO NEW LOCATION AS REQUIRED. COORDINATE OUTAGES WITH OWNER.
3. DISCONNECT AND REMOVE EXISTING PANELBOARD AND ASSOCIATED FEEDERS AND BRANCH CIRCUITS.
4. DISCONNECT AND REMOVE ALL WIRING AND DEVICES WITHIN UNDERFLOOR RACEWAY SYSTEMS. COVER AND PATCH EXISTING FLOOR.
5. NO NEW WORK WITHIN THIS AREA.
6. DISCONNECT AND REMOVE EXISTING NURSE CALL SYSTEM AND ASSOCIATED WIRING.
7. DISCONNECT, REMOVE AND REPLACE EXISTING TRANSFORMER T1. REFER TO DRAWING 1-E2 FOR NEW LOCATION.
8. EXISTING CABLE TRAY ABOVE CEILING TO BE DISCONNECTED, REMOVED AND REPLACED. REMOVE ALL EXISTING WIRING.
9. TURN PANELBOARD OVER TO OWNER.
10. DISCONNECT AND REMOVE EXISTING AIR HANDLING UNIT, FEEDER, OVERCURRENT PROTECTION, DUCT MOUNTED SMOKE DETECTOR ETC.
11. EXISTING VOICE/DATA CLOSET. CONTRACTOR SHALL PROTECT AND MAINTAIN THIS ROOM AND ITS EQUIPMENT UNTIL THE NEW IT/DATA ROOM IS BUILT AND OPERATIONAL. ONCE THE NEW ROOM IS OPERATIONAL, CONTRACTOR SHALL DISCONNECT ALL EQUIPMENT AND TURN OVER TO OWNER. DISCONNECT AND REMOVE ALL REMAINING WIRING. COORDINATE ALL REQUIREMENTS IN FIELD.

KEYPLAN

CONSTRUCTION DOCUMENTS

KORDA/NEMETH ENGINEERING, INC.
1650 WATERMARK DRIVE
COLUMBUS, OHIO 43215
DESIGNED BY Erin R. Corbin
DRAWN BY Cory A. Cameron
CHECKED BY R. Randy Lowe
JOB FILE 2011-0312

NO.	REVISIONS/SUBMISSIONS	DATE

Consultant
KORDA
KORDA/NEMETH ENGINEERING
1650 Watermark Drive, Suite 200 - Columbus, Ohio 43215-7010
614-487-1650 - FAX 614-487-8981 - WEB www.korda.com

FED/Matrix
A Joint Venture
255 COUNTY ROAD 555 SOUTH, BARTOW, FLORIDA 33830
Telephone: (863) 665-6363 Fax: (863) 667-1773

Seal

Drawing Title: EIGHTH EAST POWER DEMOLITION PLAN

Approved: Project Director: Project Director

Project Title: RENOVATE EIGHT EAST FOR ENDOSCOPY & CARDIOLOGY IC VAHCS

Location: IOWA CITY, IOWA

Date: 07/27/2012 | Checked: RRL | Drawn: ERC

Project Number: 636A8-12-005

Building Number: 1

Drawing Number: 1-ED2

36 of 42

Office of Construction and Facilities Management
Department of Veterans Affairs