


- GENERAL NOTES**
- ALL EXIT AND EMERGENCY LUMINAIRES ON THIS SHEET BETWEEN COLUMNS 1 AND 6 SHALL BE CONNECTED TO CIRCUIT 8LS-28. COLUMNS 6 AND 12 SHALL BE CONNECTED TO CIRCUIT 8LS-30 WITH PERIMETER 10/000V CONDUCTORS, AHEAD OF ANY SWITCHING FOR NIGHT LIGHTING.
- REFER TO ARCHITECTURAL REFLECTED CEILING PLANS FOR EXACT LOCATIONS OF LUMINAIRES. COORDINATE WITH OTHER TRADES CONTRACTORS, IN ADVANCE OF INSTALLATION, TO AVOID CONFLICTS OF SUFFICIENT SPACE ABOVE CEILINGS FOR RECESSED LUMINAIRES.
- REFER TO ARCHITECTURAL ELEVATIONS, CASEWORK, AND FINISH SCHEDULES FOR FINISHES, AND LUMINAIRE SCHEDULE FOR LUMINAIRE MOUNTING HEIGHTS AND ADDITIONAL INSTALLATION INFORMATION.
- LOCATIONS OF LUMINAIRES IN ROOMS WITH MECHANICAL EQUIPMENT SHALL BE COORDINATED IN ADVANCE WITH UNLLOOED ROOMS. LUMINAIRES TO BE LOCATED OVER ACCESS PATHWAYS AROUND EQUIPMENT AND NOT OVER TOP OF EQUIPMENT OR DUCTWORK. DO NOT SUSPEND LUMINAIRES FROM PIPES OR DUCTWORK. PROVIDE APPROPRIATE MOUNTING HARDWARE AS REQUIRED TO SUPPORT LUMINAIRES.
- SOME SWITCHED LIGHTING CIRCUITING NOT SHOWN FOR CLARITY. ALL LUMINAIRES WITH A SPACE ARE TO BE CONTROLLED FROM THE SAME SWITCHED LIGHTING SENSORS SHOWN IN THAT SPACE UNLESS NOTED OTHERWISE.
- OCCUPANCY SENSOR POWER PACKS ARE SHOWN FOR CLARITY. POWER PACKS TO BE LOCATED WITHIN EACH ROOM ABOVE CEILING ADJACENT TO ENTRY DOOR. PROVIDE CONSTANT AND WIRING FROM POWER PACK TO SENSOR UNITS.
- LUMINAIRES IN ROOMS SHOWN WITH TWO SWITCHES, OR NOTED AS HAVING MULTILEVEL LIGHTING, SHALL HAVE INNER LAMPS CONTROLLED SEPARATELY FROM PULL DOWN LAMPS. PROVIDE PULL DOWN RELAY PANEL, PROVIDE APPROPRIATE WIRING TO RELAY PANEL.
- PROVIDE STEEL BRIDGING BETWEEN PURLINS/JOISTS/BAYS AS NECESSARY TO SUPPORT THE WEIGHT OF SUSPENDED LUMINAIRES.

CODED NOTES

- EXISTING LUMINAIRE'S WITHIN THIS AREA TO REMAIN
AND BE REUSED.
- AMBIENT PORTION OF R5 LUMINAIRE SHALL BE
CIRCUITED TO H02H-7 AND CONTROLLED VIA WALL
SWITCH.
- SWITCH FOR CONTROL OF AMBIENT PORTION R5
LUMINAIRE.
- SWITCH FOR CONTROL OF EXAM PORTION OF R5
LUMINAIRE.
- EXTEND LIGHTING CIRCUIT TO PANELBOARD 801.
- CONNECT LUMINAIRE AT THIS LANDING TO PANEL 8LS.
- CIRCUIT TO EXISTING LIFE SAFETY CIRCUIT PRESENTLY
SERVING EXISTING EXIT SIGN.
- CIRCUIT U7 LUMINAIRE'S TO LOCAL NORMAL POWER
RECEPTACLE CIRCUIT.

KEYPLAN

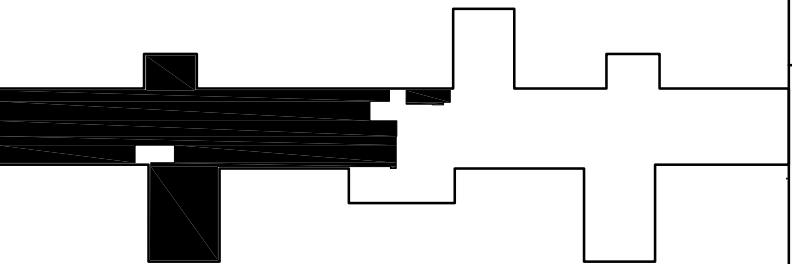

CONSTRUCTION DOCUMENTS


**LORD/NEMETH
ENGINEERING, INC.**
1550 WATERMARK DRIVE
COLUMBUS, OHIO 43215
DESIGNED BY
John R. Corbin
DRAWN BY
Gregory A. Cameron
CHECKED BY
Randy Lowe
DB FILE 2011-0312

Office of
Construction
and Facilities
Management

Department of
Veterans Affairs

EIGHT EAST

LIGHTING PLAN

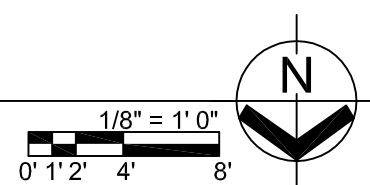

Drawing Title
**EIGHT EAST
LIGHTING PLAN**

Approved: Project Director
Project Director

Project Title

**RENOVATE EIGHT EAST FOR
ENDOSCOPY & CARDIOLOGY
IC VAHCS**

Location
IOWA CITY, IOWA

Checked
RRL

Drawn
ERC

Number
A8-12-005

g. Name:

1-E1

42

Consultant

KORDA
KORDA/NEMETH ENGINEERING
1650 Watermark Drive, Suite 200 - Columbus, Ohio 43215-7010
614-487-1650 - FAX 614-487-8981 - WEB www.korda.com

Seal

FED/Matrix
A Joint Venture



255 COUNTY ROAD 555 SOUTH, BARTOW, FLORIDA 33830
Telephone: (863) 665-6363 Fax: (863) 667-1773

VA FORM 08-6231