

# **REPLACE ELEVATOR CONTROLS (HOSPITAL COMPLEX)**

Project # 552-19-106

For the  
Department of Veterans Affairs  
Dayton Veterans Medical Center  
Dayton, OH 45428

## **PROJECT MANUAL**

100% Construction Documents

12/16/2019

**GUIDON DESIGN INC.  
HEAPY ENGINEERING  
LERCH BATES**

# PROJECT CONTACTS:


OWNER: Dayton VA MEDICAL CENTER  
Attn: Phillip West  
4100 West Third Street  
Dayton, OH 45428  
Phone: 937-268-6511 x2305  
Email: [phillip.west@va.gov](mailto:phillip.west@va.gov)

ARCHITECT: GUIDON DESIGN INC.  
Attn: James Gooden  
1221 N. Pennsylvania St. Suite 200  
Indianapolis, Indiana 46202  
Phone: 317-800-6388 x145  
Email: [jgooden@guidondesign.com](mailto:jgooden@guidondesign.com)

MEP ENGINEERS: HEAPY ENGINEERING  
Attn: Matt Graham  
1400 West Dorothy Lane  
Dayton OH 45409  
Phone: 937-224-0861  
Email: [msgraham@heapy.com](mailto:msgraham@heapy.com)

VERTICAL TRANSPORTATION: LERCH BATES  
Attn: David Borchers  
4995 Bradenton Ave. Suite 200  
Dublin, OH 43017  
Phone: 614-956-9337  
Email: [david.borchers@lerchbates.com](mailto:david.borchers@lerchbates.com)

ISSUE DATE: December 16, 2019

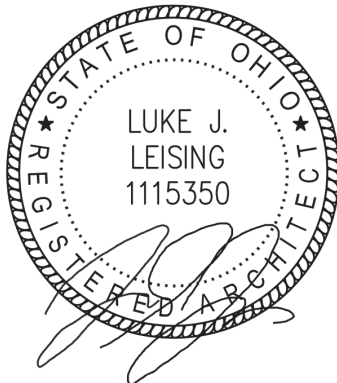

**DEPARTMENT OF VETERANS AFFAIRS  
 VHA MASTER SPECIFICATIONS**

**TABLE OF CONTENTS  
 Section 00 01 10**

	<b>DIVISION 00 - SPECIAL SECTIONS</b>	<b>DATE</b>
00 01 15	List of Drawing Sheets	07-15
	<b>DIVISION 01 - GENERAL REQUIREMENTS</b>	
01 00 00	General Requirements	12-18
01 32 16.15	Project Schedules (Small Projects - Design/Bid/Build	04-13
01 33 23	Shop Drawings, Product Data, and Samples	05-17
01 35 26	Safety Requirements	02-17
01 42 19	Reference Standards	05-16
01 45 00	Quality Control	01-18
01 58 16	Temporary Interior Signage	07-15
01 99 99	Project Closeout	
	<b>DIVISION 02 - EXISTING CONDITIONS</b>	
02 41 00	Demolition	08-17
	<b>DIVISION 03 - CONCRETE</b>	
03 30 53	(Short-Form) Cast-in-Place Concrete	02-16
	<b>DIVISION 04 - MASONRY</b>	
04 05 16	Masonry Grouting	02-16
	<b>DIVISION 05 - METALS</b>	
05 50 00	Metal Fabrications	08-18
	<b>DIVISION 06 - WOOD, PLASTICS AND COMPOSITES - NOT USED</b>	
	<b>DIVISION 07 - THERMAL AND MOISTURE PROTECTION</b>	
07 84 00	Firestopping	02-16
07 92 00	Joint Sealants	10-17
	<b>DIVISION 08 - OPENINGS</b>	
08 11 13	Hollow Metal Doors and Frames	08-16
08 71 00	Door Hardware	01-16
	<b>DIVISION 09 - FINISHES</b>	
09 06 00	Schedule for Finishes	04-15
09 22 16	Non-Structural Metal Framing	06-18
09 29 00	Gypsum Board	06-18
09 65 13	Resilient Base and Accessories	02-16
09 65 16	Resilient Sheet Flooring	05-18
09 65 19	Resilient Tile Flooring	05-18
09 91 00	Painting	01-16

	<b>DIVISION 10 - SPECIALTIES</b>	
10 14 00	Signage	10-15
	<b>DIVISION 11 - EQUIPMENT - NOT USED</b>	
	<b>DIVISION 12 - FURNISHINGS - NOT USED</b>	
	<b>DIVISION 13 - SPECIAL CONSTRUCTION - NOT USED</b>	
	<b>DIVISION 14- CONVEYING EQUIPEMENT</b>	
14 22 00	Electric Traction Elevator Modernization	02-19
	<b>DIVISION 21- FIRE SUPPRESSION</b>	
21 13 13	Wet-Pipe Sprinkler Systems	06-15
	<b>DIVISION 22 - PLUMBING - NOT USED</b>	
	<b>DIVISION 23 - HEATING, VENTILATING, AND AIR CONDITIONING (HVAC)</b>	
23 05 11	Common Work Results for HVAC	08-17
23 05 12	General Motor Requirements for HVAC and Steam Generation Equipment	08-17
23 05 41	Noise and Vibration Control for HVAC Piping and Equipment	02-15
23 07 11	HVAC and Boiler Plant Insulation	02-15
23 21 13	Hydronic Piping	08-17
23 23 00	Refrigerant Piping	02-15
23 81 00	Decentralized Unitary HVAC Equipment	02-11
	<b>DIVISION 25 - INTEGRATED AUTOMATION - NOT USED</b>	
	<b>DIVISION 26 - ELECTRICAL</b>	
26 05 11	Requirements for Electrical Installations	01-16
26 05 19	Low-Voltage Electrical Power Conductors and Cables	01-17
26 05 26	Grounding and Bonding for Electrical Systems	01-17
26 05 33	Raceway and Boxes for Electrical Systems	01-18
26 05 73	Overcurrent Protective Device Coordination Study	01-18
26 24 16	Panelboards	01-18
26 27 26	Wiring Devices	01-18
26 29 21	Enclosed Switches and Circuit Breakers	01-17
26 51 00	Interior Lighting	01-18
	<b>DIVISION 27 - COMMUNICATIONS - NOT USED</b>	
	<b>DIVISION 28 - ELECTRONIC SAFETY AND SECURITY - NOT USED</b>	
	<b>DIVISION 31 - EARTHWORK - NOT USED</b>	
	<b>DIVISION 32 - EXTERIOR IMPROVEMENTS - NOT USED</b>	
	<b>DIVISION 33 - UTILITIES - NOT USED</b>	
	<b>DIVISION 34 - TRANSPORTATION - NOT USED</b>	

Dayton Veterans Medical Center  
Replace Elevator Controls (Hospital Complex)  
552-19-106

02-01-19  
100% Construction Documents  
December 16, 2019

	<b>DIVISION 48 - Electrical Power Generation - NOT USED</b>	

**SECTION 00 01 15  
LIST OF DRAWINGS**

The drawings listed below accompanying this specification form a part of the contract.

Drawing No.	Title
<b>GENERAL</b>	
GI000	Cover Sheet
GI101	Life Safety Plans
GI102	Life Safety Plans
GI103	Life Safety Plans
GI104	Life Safety Plans
GI105	Infection Control/Phasing Plans
<b>ARCHITECTURAL</b>	
AS001	Architectural Symbols and Abbreviations
AS100	Basement Floor Plan
AS111	Elevator Machine Room Floor Plan
AS401	Enlarged Plans
<b>MECHANICAL</b>	
M001	Legend, Abbreviations & Index of Drawings
M002	Schedules and Details
M110	Tenth Floor and Elevator Machine Room Plan
<b>ELECTRICAL</b>	
E001	Legend, Abbreviations & Index of Drawings
E002	Single Line Diagram - Emergency
E003	Luminaire and Motor Schedule
ED110	Tenth Floor and Elevator Machine Room Plan - Demo
EL110	Tenth Floor and Elevator Machine Room Plan - Lighting
EP110	Tenth Floor and Elevator Machine Room Plan - Power
<b>FIRE PROTECTION</b>	
FX001	Legend, Abbreviations & Index of Drawings
FX110	Elevator Machine Room Floor Plan

- - - E N D - - -

**SECTION 01 00 00  
GENERAL REQUIREMENTS**

**TABLE OF CONTENTS**

1.1 SAFETY REQUIREMENTS.....	1
1.2 GENERAL INTENTION.....	1
1.3 STATEMENT OF BID ITEM(S).....	1
1.4 SPECIFICATIONS AND DRAWINGS FOR CONTRACTOR.....	2
1.5 CONSTRUCTION SECURITY REQUIREMENTS.....	2
1.6 OPERATIONS AND STORAGE AREAS.....	4
1.7 ALTERATIONS.....	9
1.8 DISPOSAL AND RETENTION.....	11
1.9 RESTORATION.....	11
1.10 AS-BUILT DRAWINGS.....	12
1.11 TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT.....	12
1.12 TEMPORARY USE OF EXISTING ELEVATORS.....	14
1.13 AVAILABILITY AND USE OF UTILITY SERVICES.....	15
1.14 TESTS.....	16
1.15 INSTRUCTIONS.....	17
1.16 RELOCATED EQUIPMENT.....	18
1.17 SAFETY SIGN.....	19
1.18 PHOTOGRAPHIC DOCUMENTATION.....	19

**SECTION 01 00 00**  
**GENERAL REQUIREMENTS**

**1.1 SAFETY REQUIREMENTS**

Refer to section 01 35 26, SAFETY REQUIREMENTS for safety and infection control requirements.

**1.2 GENERAL INTENTION**

- A. Contractor shall completely prepare site for building operations, including demolition and removal of existing structures, and furnish labor and materials and perform work for replacement of existing outdated elevator controls in Building 330 as required by drawings and specifications.
- B. Visits to the site by Bidders may be made only by appointment with the COR.
- C. Offices of Guidon Design Inc. 1221 N. Pennsylvania St. Suite 200, Indianapolis, IN 46202, as Architect-Engineers, will render certain technical services during construction. Such services shall be considered as advisory to the Government and shall not be construed as expressing or implying a contractual act of the Government without affirmations by Contracting Officer or his duly authorized representative.
- D. Before placement and installation of work subject to tests by testing laboratory retained by Department of Veterans Affairs, the Contractor shall notify the COR in sufficient time to enable testing laboratory personnel to be present at the site in time for proper taking and testing of specimens and field inspection. Such prior notice shall be not less than three work days unless otherwise designated by the COR.
- E. All employees of general contractor and subcontractors shall comply with VA security management program and obtain permission of the VA police, be identified by project and employer, and restricted from unauthorized access.

**1.3 STATEMENT OF BID ITEM(S)**

- A. BID ITEM 1 (BASE BID): Work includes demolition, new construction, and renovation necessary to fully upgrade existing elevator controls and interior elevator cab finishes per the contact documents.



1. Completion time for BID ITEM 1 (BASE BID) is 365 calendar days from receipt of the Notice to Proceed.

- B. BID ITEM 2 (DEDUCT ALTERNATE 1): includes all work in BID ITEM 1 (BASE BID), except DELETE all labor and materials required to replace finishes in existing cab interiors including; flooring, wall panels, handrails, ceiling, and lighting.

1. Completion time for BID ITEM 2 (DEDUCT ALTERNATE 1) is 365 calendar days from receipt of the Notice to Proceed.

- C. BID ITEM 3 (DEDUCT ALTERNATE 2): Includes all work in BID ITEM 2 (DEDUCT ALTERNATE 1), except DELETE all labor and materials required to replace hoist-way door panels.

1. Completion time for BID ITEM 3 (DEDUCT ALTERNATE 2) is 365 calendar days from receipt of the Notice to Proceed.

- D. BID ITEM 4 (DEDUCT ALTERNATE 3): includes all work in BID ITEM 3 (DEDUCT ALTERNATE 2), except DELETE all labor and materials required to provide proprietary elevator controls, and substitute with all labor and materials required to provide non-proprietary approved equal elevator controls.

1. Completion time for BID ITEM 4 (DEDUCT ALTERNATE 3) is 365 calendar days from receipt of the Notice to Proceed.

#### **1.4 SPECIFICATIONS AND DRAWINGS FOR CONTRACTOR**

- A. Drawings and contract documents may be obtained from the website where the solicitation is posted. Additional copies will be at Contractor's expense.

#### **1.5 CONSTRUCTION SECURITY REQUIREMENTS**

- A. Security Plan:

1. The security plan defines both physical and administrative security procedures that will remain effective for the entire duration of the project.

2. The General Contractor is responsible for assuring that all sub-contractors working on the project and their employees also comply with these regulations.

B. Security Procedures:

1. General Contractor's employees shall not enter the project site without appropriate badge. They may also be subject to inspection of their personal effects when entering or leaving the project site.
2. Before starting work the General Contractor shall give one week's notice to the COR so that security arrangements can be provided for the employees. This notice is separate from any notices required for utility shutdown described later in this section.
3. No photography of VA premises is allowed without written permission of the Contracting Officer.
4. VA reserves the right to close down or shut down the project site and order General Contractor's employees off the premises in the event of a national emergency. The General Contractor may return to the site only with the written approval of the Contracting Officer.

c. Key Control:

1. The General Contractor shall provide duplicate keys and lock combinations to the COR for the purpose of security inspections of every area of project including tool boxes and parked machines and take any emergency action.
2. The General Contractor shall turn over all permanent lock cylinders to the VA locksmith for permanent installation. See Section 08 71 00, DOOR HARDWARE and coordinate.

E. Document Control:

1. Before starting any work, the General Contractor/Sub Contractors shall submit an electronic security memorandum describing the approach to following goals and maintaining confidentiality of "sensitive information".
2. The General Contractor is responsible for safekeeping of all drawings, project manual and other project information. This

- information shall be shared only with those with a specific need to accomplish the project.
3. Certain documents, sketches, videos or photographs and drawings may be marked "Law Enforcement Sensitive" or "Sensitive Unclassified". Secure such information in separate containers and limit the access to only those who will need it for the project. Return the information to the Contracting Officer upon request.
  4. These security documents shall not be removed or transmitted from the project site without the written approval of Contracting Officer.
  5. All paper waste or electronic media such as CD's and diskettes shall be shredded and destroyed in a manner acceptable to the VA.
  6. Notify Contracting Officer and Site Security Officer immediately when there is a loss or compromise of "sensitive information".
  7. All electronic information shall be stored in specified location following VA standards and procedures using an Engineering Document Management Software (EDMS).
    - a. Security, access and maintenance of all project drawings, both scanned and electronic shall be performed and tracked through the EDMS system.
    - b. "Sensitive information" including drawings and other documents may be attached to e-mail provided all VA encryption procedures are followed.

F. Motor Vehicle Restrictions

1. Vehicle authorization request shall be required for any vehicle entering the site and such request shall be submitted 24 hours before the date and time of access. Access shall be restricted to picking up and dropping off materials and supplies.
2. A limited number of (2 to 5) permits shall be issued for General Contractor and its employees for parking in designated areas only.

#### **1.6 OPERATIONS AND STORAGE AREAS**

- A. The Contractor shall confine all operations (including storage of materials) on Government premises to areas authorized or approved by the Contracting Officer. The Contractor shall hold and save the Government, its officers and agents, free and harmless from liability of any nature occasioned by the Contractor's performance.
- B. Temporary buildings (e.g., storage sheds, shops, offices) and utilities may be erected by the Contractor only with the approval of the Contracting Officer and shall be built with labor and materials furnished by the Contractor without expense to the Government. The temporary buildings and utilities shall remain the property of the Contractor and shall be removed by the Contractor at its expense upon completion of the work. With the written consent of the Contracting Officer, the buildings and utilities may be abandoned and need not be removed.
- C. The Contractor shall, under regulations prescribed by the Contracting Officer, use only established roadways, or use temporary roadways constructed by the Contractor when and as authorized by the Contracting Officer. When materials are transported in prosecuting the work, vehicles shall not be loaded beyond the loading capacity recommended by the manufacturer of the vehicle or prescribed by any Federal, State, or local law or regulation. When it is necessary to cross curbs or sidewalks, the Contractor shall protect them from damage. The Contractor shall repair or pay for the repair of any damaged curbs, sidewalks, or roads.
- D. Working space and space available for storing materials shall be as determined by the COR.
- E. Workers are subject to rules of Medical Center applicable to their conduct.
- F. Execute work so as to interfere as little as possible with normal functioning of Medical Center as a whole, including operations of utility services, fire protection systems and any existing equipment, and with work being done by others. Use of equipment and tools that transmit vibrations and noises through the building structure, are not permitted in buildings that are occupied, during construction, jointly

by patients or medical personnel, and Contractor's personnel, except as permitted by COR where required by limited working space.

1. Do not store materials and equipment in other than assigned areas.
2. Schedule delivery of materials and equipment to immediate construction working areas within buildings in use by Department of Veterans Affairs in quantities sufficient for not more than two work days. Provide unobstructed access to Medical Center areas required to remain in operation.
3. Where access by Medical Center personnel to vacated portions of buildings is not required, storage of Contractor's materials and equipment will be permitted subject to fire and safety requirements.

G. Utilities Services: Where necessary to cut existing pipes, electrical wires, conduits, cables, etc., of utility services, or of fire protection systems or communications systems (except telephone), they shall be cut and capped at suitable places where shown; or, in absence of such indication, where directed by COR. All such actions shall be coordinated with the COR or Utility Company involved:

H. Phasing:

The Medical Center must maintain its operation 24 hours a day 7 days a week. Therefore, any interruption in service must be scheduled and coordinated with the COR to ensure that no lapses in operation occur. It is the CONTRACTOR'S responsibility to develop a work plan and schedule detailing, at a minimum, the procedures to be employed, the equipment and materials to be used, the interim life safety measure to be used during the work, and a schedule defining the duration of the work with milestone subtasks. The work to be outlined shall include, but not be limited to firestop all open penetrations within the elevator hoistway.

To ensure such executions, Contractor shall furnish the COR with a schedule of approximate phasing dates on which the Contractor intends to accomplish work in each specific area of site, building or portion thereof. In addition, Contractor shall notify the COR two weeks in advance of the proposed date of starting work in each specific area of site, building or portion thereof. Arrange such phasing dates to ensure

accomplishment of this work in successive phases mutually agreeable to COR and Contractor, as follows:

- Phase I: Elevators P-1 & SE-1 will be shut down and worked on - all others will be operational.**
- Phase II: Elevators P-2 & SE-2 will be shut down and worked on - all others will be operational.**
- Phase III: Elevators P-3 & SE-3 will be shut down and worked on - all others will be operational.**
- Phase IV: Elevators P-4 & SE-4 will be shut down and worked on - all others will be operational.**
- Phase V: Elevators P-5 & P-6 will be shut down and worked on - all others will be operational.**

I. Building(s) No.330 will be occupied during performance of work.

Contractor shall take all measures and provide all material necessary for protecting existing equipment and property in affected areas of construction against dust and debris, so that equipment and affected areas to be used in the Medical Centers operations will not be hindered. Contractor shall permit access to Department of Veterans Affairs personnel and patients through other construction areas which serve as routes of access to such affected areas and equipment. These routes whether access or egress shall be isolated from the construction area by temporary partitions and have walking surfaces, lighting etc to facilitate patient and staff access. Coordinate alteration work in areas occupied by Department of Veterans Affairs so that Medical Center operations will continue during the construction period.

J. When a building and/or construction site is turned over to Contractor, Contractor shall accept entire responsibility including upkeep and maintenance therefore:

1. Contractor shall maintain a minimum temperature of 4 degrees C (40 degrees F) at all times, except as otherwise specified.
2. Contractor shall maintain in operating condition existing fire protection and alarm equipment. In connection with fire alarm equipment, Contractor shall make arrangements for pre-inspection of site with Fire Department or Company (Department of Veterans Affairs

or municipal) whichever will be required to respond to an alarm from Contractor's employee or watchman.

K. Utilities Services: Maintain existing utility services for Medical Center at all times. Provide temporary facilities, labor, materials, equipment, connections, and utilities to assure uninterrupted services. Where necessary to cut existing water, steam, gases, sewer or air pipes, or conduits, wires, cables, etc. of utility services or of fire protection systems and communications systems (including telephone), they shall be cut and capped at suitable places where shown; or, in absence of such indication, where directed by COR.

1. No utility service such as water, gas, steam, sewers or electricity, or fire protection systems and communications systems may be interrupted without prior approval of COR. Electrical work shall be accomplished with all affected circuits or equipment de-energized. When an electrical outage cannot be accomplished, work on any energized circuits or equipment shall not commence without a detailed work plan, the Medical Center Director's prior knowledge and written approval. Refer to specification Sections 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
2. Contractor shall submit a request to interrupt any such services to COR, in writing, 7 days in advance of proposed interruption. Request shall state reason, date, exact time of, and approximate duration of such interruption.
3. Contractor will be advised (in writing) of approval of request, or of which other date and/or time such interruption will cause least inconvenience to operations of Medical Center. Interruption time approved by Medical Center may occur at other than Contractor's normal working hours.
4. Major interruptions of any system must be requested, in writing, at least 15 calendar days prior to the desired time and shall be performed as directed by the COR.
5. In case of a contract construction emergency, service will be interrupted on approval of COR. Such approval will be confirmed in writing as soon as practical.

6. Whenever it is required that a connection fee be paid to a public utility provider for new permanent service to the construction project, for such items as water, sewer, electricity, gas or steam, payment of such fee shall be the responsibility of the Government and not the Contractor.
  
- L. Abandoned Lines: All service lines such as wires, cables, conduits, ducts, pipes and the like, and their hangers or supports, which are to be abandoned but are not required to be entirely removed, shall be sealed, capped or plugged at the main, branch or panel they originate from. The lines shall not be capped in finished areas, but shall be removed and sealed, capped or plugged in ceilings, within furred spaces, in unfinished areas, or within walls or partitions; so that they are completely behind the finished surfaces.
  
- M. To minimize interference of construction activities with flow of Medical Center traffic, comply with the following:
  1. Keep roads, walks and entrances to grounds, to parking and to occupied areas of buildings clear of construction materials, debris and standing construction equipment and vehicles.
  
  2. Method and scheduling of required cutting, altering and removal of existing roads, walks and entrances must be approved by the COR.
  
- N. Coordinate the work for this contract with other construction operations as directed by COR. This includes the scheduling of traffic and the use of roadways, as specified in Article, USE OF ROADWAYS.

#### **1.7 ALTERATIONS**

- A. Survey: Before any work is started, the Contractor shall make a thorough survey with the COR areas of buildings in which alterations occur and areas which are anticipated routes of access, and furnish a report, signed by both, to the Contracting Officer. This report shall list by rooms and spaces:
  1. Existing condition and types of resilient flooring, doors, windows, walls and other surfaces not required to be altered throughout affected areas of the building.



2. Existence and conditions of items such as plumbing fixtures and accessories, electrical fixtures, equipment, venetian blinds, shades, etc., required by drawings to be either reused or relocated, or both.
  3. Shall note any discrepancies between drawings and existing conditions at site.
  4. Shall designate areas for working space, materials storage and routes of access to areas within buildings where alterations occur and which have been agreed upon by Contractor and COR.
- B. Any items required by drawings to be either reused or relocated or both, found during this survey to be nonexistent, or in opinion of COR, to be in such condition that their use is impossible or impractical, shall be furnished and/or replaced by Contractor with new items in accordance with specifications which will be furnished by Government. Provided the contract work is changed by reason of this subparagraph B, the contract will be modified accordingly, under provisions of clause entitled "DIFFERING SITE CONDITIONS" (FAR 52.236-2) and "CHANGES" (FAR 52.243-4 and VAAR 852.236-88).
- C. Re-Survey: Thirty days before expected partial or final inspection date, the Contractor and COR together shall make a thorough re-survey of the areas of buildings involved. They shall furnish a report on conditions then existing, of resilient flooring, doors, windows, walls and other surfaces as compared with conditions of same as noted in first condition survey report:
1. Re-survey report shall also list any damage caused by Contractor to such flooring and other surfaces, despite protection measures; and, will form basis for determining extent of repair work required of Contractor to restore damage caused by Contractor's workers in executing work of this contract.
- D. Protection: Provide the following protective measures:
1. Wherever existing roof surfaces are disturbed they shall be protected against water infiltration. In case of leaks, they shall be repaired immediately upon discovery.

2. Temporary protection against damage for portions of existing structures and grounds where work is to be done, materials handled and equipment moved and/or relocated.
3. Protection of interior of existing structures at all times, from damage, dust and weather inclemency. Wherever work is performed, floor surfaces that are to remain in place shall be adequately protected prior to starting work, and this protection shall be maintained intact until all work in the area is completed.

#### **1.8 DISPOSAL AND RETENTION**

- A. Materials and equipment accruing from work removed and from demolition of buildings or structures, or parts thereof, shall be disposed of as follows:
  1. Reserved items which are to remain property of the Government are identified by attached tags or noted on drawings or in specifications as items to be stored. Items that remain property of the Government shall be removed or dislodged from present locations in such a manner as to prevent damage which would be detrimental to re-installation and reuse. Store such items where directed by COR.
  2. Items not reserved shall become property of the Contractor and be removed by Contractor from Medical Center.
  3. Items of portable equipment and furnishings located in rooms and spaces in which work is to be done under this contract shall remain the property of the Government. When rooms and spaces are vacated by the Department of Veterans Affairs during the alteration period, such items which are NOT required by drawings and specifications to be either relocated or reused will be removed by the Government in advance of work to avoid interfering with Contractor's operation.

#### **1.9 RESTORATION**

- A. Remove, cut, alter, replace, patch and repair existing work as necessary to install new work. Except as otherwise shown or specified, do not cut, alter or remove any structural work, and do not disturb any ducts, plumbing, steam, gas, or electric work without approval of the COR. Existing work to be altered or extended and that is found to be defective in any way, shall be reported to the COR before it is

disturbed. Materials and workmanship used in restoring work, shall conform in type and quality to that of original existing construction, except as otherwise shown or specified.

- B. Upon completion of contract, deliver work complete and undamaged. Existing work (walls, ceilings, partitions, floors, mechanical and electrical work, lawns, paving, roads, walks, etc.) disturbed or removed as a result of performing required new work, shall be patched, repaired, reinstalled, or replaced with new work, and refinished and left in as good condition as existed before commencing work.
- C. At Contractor's own expense, Contractor shall immediately restore to service and repair any damage caused by Contractor's workers to existing piping and conduits, wires, cables, etc., of utility services or of fire protection systems and communications systems (including telephone) which are not scheduled for discontinuance or abandonment.
- D. Expense of repairs to such utilities and systems not shown on drawings or locations of which are unknown will be covered by adjustment to contract time and price in accordance with clause entitled "CHANGES" (FAR 52.243-4 and VAAR 852.236-88) and "DIFFERING SITE CONDITIONS" (FAR 52.236-2).

#### **1.10 AS-BUILT DRAWINGS**

- A. The contractor shall maintain two full size sets of as-built drawings which will be kept current during construction of the project, to include all contract changes, modifications and clarifications.
- B. All variations shall be shown in the same general detail as used in the contract drawings. To ensure compliance, as-built drawings shall be made available for the COR review, as often as requested.
- C. Contractor shall deliver two approved completed sets of as-built drawings in the electronic version (scanned PDF) to the COR within 15 calendar days after each completed phase and after the acceptance of the project by the COR.
- D. Paragraphs A, B, & C shall also apply to all shop drawings.

### **1.11 TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT**

- A. Use of new installed mechanical and electrical equipment to provide heat, ventilation, plumbing, light and power will be permitted subject to written approval and compliance with the following provisions:
1. Permission to use each unit or system must be given by COR in writing. If the equipment is not installed and maintained in accordance with the written agreement and following provisions, the COR will withdraw permission for use of the equipment.
  2. Electrical installations used by the equipment shall be completed in accordance with the drawings and specifications to prevent damage to the equipment and the electrical systems, i.e. transformers, relays, circuit breakers, fuses, conductors, motor controllers and their overload elements shall be properly sized, coordinated and adjusted. Installation of temporary electrical equipment or devices shall be in accordance with NFPA 70, National Electrical Code, (2014 Edition), Article 590, *Temporary Installations*. Voltage supplied to each item of equipment shall be verified to be correct and it shall be determined that motors are not overloaded. The electrical equipment shall be thoroughly cleaned before using it and again immediately before final inspection including vacuum cleaning and wiping clean interior and exterior surfaces.
  3. Units shall be properly lubricated, balanced, and aligned. Vibrations must be eliminated.
  4. Automatic temperature control systems for preheat coils shall function properly and all safety controls shall function to prevent coil freeze-up damage.
  5. The air filtering system utilized shall be that which is designed for the system when complete, and all filter elements shall be replaced at completion of construction and prior to testing and balancing of system.
  6. All components of heat production and distribution system, metering equipment, condensate returns, and other auxiliary facilities used in temporary service shall be cleaned prior to use; maintained to prevent corrosion internally and externally during use; and cleaned,

- maintained and inspected prior to acceptance by the Government.  
Boilers, pumps, feedwater heaters and auxiliary equipment must be operated as a complete system and be fully maintained by operating personnel. Boiler water must be given complete and continuous chemical treatment.
- B. Prior to final inspection, the equipment or parts used which show wear and tear beyond normal, shall be replaced with identical replacements, at no additional cost to the Government.
  - C. This paragraph shall not reduce the requirements of the mechanical and electrical specifications sections.
  - D. Any damage to the equipment or excessive wear due to prolonged use will be repaired replaced by the contractor at the contractor's expense.

**1.12 TEMPORARY USE OF EXISTING ELEVATORS**

- A. Use of existing elevators for handling building materials and Contractor's personnel will be permitted subject to following provisions:
  - 1. Contractor makes all arrangements with the COR for use of elevators. The COR will ascertain that elevators are in proper condition. Personnel for operating elevators will not be provided by the Department of Veterans Affairs.
  - 2. Contractor covers and provides maximum protection of following elevator components:
    - a. Entrance jambs, heads soffits and threshold plates.
    - b. Entrance columns, canopy, return panels and inside surfaces of car enclosure walls.
    - c. Finish flooring.
  - 3. Government will accept hoisting ropes of elevator and rope of each speed governor if they are worn under normal operation. However, if these ropes are damaged by action of foreign matter such as sand, lime, grit, stones, etc., during temporary use, they shall be removed and replaced by new hoisting ropes at the contractors expense.

4. If brake lining of elevators are excessively worn or damaged during temporary use, they shall be removed and replaced by new brake lining at the contractors expense.
5. All parts of main controller, starter, relay panel, selector, etc., worn or damaged during temporary use shall be removed and replaced with new parts at the contractors expense, if recommended by elevator inspector after elevator is released by Contractor.
6. Place elevator in condition equal, less normal wear, to that existing at time it was placed in service of Contractor as approved by Contracting Officer.

#### **1.13 AVAILABILITY AND USE OF UTILITY SERVICES**

- A. The Government shall make all reasonably required amounts of utilities available to the Contractor from existing outlets and supplies, as specified in the contract. The amount to be paid by the Contractor for chargeable electrical services shall be the prevailing rates charged to the Government. The Contractor shall carefully conserve any utilities furnished without charge.
- B. The Contractor, at Contractor's expense and in a workmanlike manner, in compliance with code and as satisfactory to the Contracting Officer, shall install and maintain all necessary temporary connections and distribution lines, and all meters required to measure the amount of electricity used for the purpose of determining charges. Before final acceptance of the work by the Government, the Contractor shall remove all the temporary connections, distribution lines, meters, and associated paraphernalia and repair restore the infrastructure as required.
- C. Heat: Furnish temporary heat necessary to prevent injury to work and materials through dampness and cold. Use of open salamanders or any temporary heating devices which may be fire hazards or may smoke and damage finished work, will not be permitted. Maintain minimum temperatures as specified for various materials:
  1. Obtain heat by connecting to Medical Center heating distribution system.

- D. Electricity (for Construction and Testing): Furnish all temporary electric services.
1. Obtain electricity by connecting to the Medical Center electrical distribution system. The Contractor shall meter and pay for electricity required for electric cranes and hoisting devices, electrical welding devices and any electrical heating devices providing temporary heat. Electricity for all other uses is available at no cost to the Contractor.
- E. Water (for Construction and Testing): Furnish temporary water service.
1. Obtain water by connecting to the Medical Center water distribution system. Provide reduced pressure backflow preventer at each connection as per code. Water is available at no cost to the Contractor.
  2. Maintain connections, pipe, fittings and fixtures and conserve water-use so none is wasted. Failure to stop leakage or other wastes will be cause for revocation (at COR discretion) of use of water from Medical Center's system.
- F. Fuel: Natural and LP gas and burner fuel oil required for boiler cleaning, normal initial boiler-burner setup and adjusting, and for performing the specified boiler tests will be furnished by the Government. Fuel required for prolonged boiler-burner setup, adjustments, or modifications due to improper design or operation of boiler, burner, or control devices shall be furnished and paid by the Contractor at Contractor's expense.

#### **1.14 TESTS**

- A. Pre-test mechanical and electrical equipment and systems and make corrections required for proper operation of such systems before requesting final tests. Final test will not be conducted unless pre-tested.
- B. Conduct final tests required in various sections of specifications in presence of an authorized representative of the Contracting Officer. Contractor shall furnish all labor, materials, equipment, instruments, and forms, to conduct and record such tests.

- C. Mechanical and electrical systems shall be balanced, controlled and coordinated. A system is defined as the entire system which must be coordinated to work together during normal operation to produce results for which the system is designed. For example, air conditioning supply air is only one part of entire system which provides comfort conditions for a building. Other related components are return air, exhaust air, steam, chilled water, refrigerant, hot water, controls and electricity, etc. Another example of a system which involves several components of different disciplines is a boiler installation. Efficient and acceptable boiler operation depends upon the coordination and proper operation of fuel, combustion air, controls, steam, feedwater, condensate and other related components.
- D. All related components as defined above shall be functioning when any system component is tested. Tests shall be completed within a reasonable period of time during which operating and environmental conditions remain reasonably constant and are typical of the design conditions.
- E. Individual test result of any component, where required, will only be accepted when submitted with the test results of related components and of the entire system.

#### **1.15 INSTRUCTIONS**

- A. Contractor shall furnish Maintenance and Operating manuals (hard copies and electronic) and verbal instructions when required by the various sections of the specifications and as hereinafter specified.
- B. Manuals: Maintenance and operating manuals and one compact disc (four hard copies and one electronic copy each) for each separate piece of equipment shall be delivered to the COR coincidental with the delivery of the equipment to the job site. Manuals shall be complete, detailed guides for the maintenance and operation of equipment. They shall include complete information necessary for starting, adjusting, maintaining in continuous operation for long periods of time and dismantling and reassembling of the complete units and sub-assembly components. Manuals shall include an index covering all component parts clearly cross-referenced to diagrams and illustrations. Illustrations shall include "exploded" views showing and identifying each separate



item. Emphasis shall be placed on the use of special tools and instruments. The function of each piece of equipment, component, accessory and control shall be clearly and thoroughly explained. All necessary precautions for the operation of the equipment and the reason for each precaution shall be clearly set forth. Manuals must reference the exact model, style and size of the piece of equipment and system being furnished. Manuals referencing equipment similar to but of a different model, style, and size than that furnished will not be accepted.

- C. Instructions: Contractor shall provide qualified, factory-trained manufacturers' representatives to give detailed training to assigned Department of Veterans Affairs personnel in the operation and complete maintenance for each piece of equipment. All such training will be at the job site. These requirements are more specifically detailed in the various technical sections. Instructions for different items of equipment that are component parts of a complete system, shall be given in an integrated, progressive manner. All instructors for every piece of component equipment in a system shall be available until instructions for all items included in the system have been completed. This is to assure proper instruction in the operation of inter-related systems. All instruction periods shall be at such times as scheduled by the COR and shall be considered concluded only when the COR is satisfied in regard to complete and thorough coverage. The contractor shall submit a course outline with associated material to the COR for review and approval prior to scheduling training to ensure the subject matter covers the expectations of the VA and the contractual requirements. The Department of Veterans Affairs reserves the right to request the removal of, and substitution for, any instructor who, in the opinion of the COR, does not demonstrate sufficient qualifications in accordance with requirements for instructors above.

#### **1.16 RELOCATED EQUIPMENT**

- A. Contractor shall disconnect, dismantle as necessary, remove and reinstall in new location, all existing equipment indicated by symbol "R" or otherwise shown to be relocated by the Contractor.
- B. Perform relocation of such equipment or items at such times and in such a manner as directed by the COR.

- C. Suitably cap existing service lines, such as steam, condensate return, water, drain, gas, air, vacuum and/or electrical, at the main whenever such lines are disconnected from equipment to be relocated. Remove abandoned lines in finished areas and cap as specified herein before under paragraph "Abandoned Lines".
- D. Provide all mechanical and electrical service connections, fittings, fastenings and any other materials necessary for assembly and installation of relocated equipment; and leave such equipment in proper operating condition.

#### **1.17 SAFETY SIGN**

- A. Provide a Safety Sign where directed by COR. Face of sign shall be 19 mm (3/4 inch) thick exterior grade plywood. Provide two 100 mm by 100 mm (four by four inch) posts extending full height of sign and 900 mm (three feet) into ground. Set bottom of sign level at 1200 mm (four feet) above ground.
- B. Paint all surfaces of Safety Sign and posts with one prime coat and two coats of white gloss paint. Letters and design shall be painted with gloss paint of colors noted.
- C. Maintain sign and remove it when directed by COR.
- D. Standard Detail Drawing Number SD10000-02(Found on VA TIL) of safety sign showing required legend and other characteristics of sign is shown on the drawings.

#### **1.18 PHOTOGRAPHIC DOCUMENTATION**

- A. During the construction period through completion, provide photographic documentation of construction progress and at selected milestones.
- B. Photographic documentation elements:
  - 1. Each digital image shall be taken with a professional grade camera with minimum size of 6 megapixels (MP) capable of producing 200x250mm (8 x 10 inch) prints with a minimum of 2272 x 1704 pixels and 400x500mm (16 x 20 inch) prints with a minimum 2592 x 1944 pixels.
  - 2. Documentation shall combine indexing and navigation system with inspection-grade digital photography designed to capture actual

conditions throughout construction and at critical milestones.

Documentation shall be accessible on-line through use of an internet connection. Documentation shall allow for secure multiple-user access, simultaneously, on-line.

3. Before construction, the impacted construction areas and site shall be documented before building work commences.
  4. Construction progress for all trades shall be tracked at reasonable intervals.
  5. As-built conditions of mechanical, electrical, plumbing and all other systems shall be documented post-inspection and pre-insulation, sheet rock or dry wall installation. This process shall include all finished systems located in the walls and ceilings of all buildings at the Project. Overlapping photographic techniques shall be used to ensure maximum coverage. Indexing and navigation accomplished through interactive architectural drawings.
  6. As-built finished conditions of the interior of each building including floors, ceilings and walls shall be documented at certificate of occupancy or equivalent, or just prior to occupancy, or both, as directed by the COR. Overlapping photographic techniques shall be used to ensure maximum coverage. Indexing and navigation accomplished through interactive architectural drawings.
- D. Coordination of photo shoots is accomplished through COR. Contractor shall also attend construction team meetings as necessary. Contractor's operations team shall provide regular updates regarding the status of the documentation.

- - - E N D - - -

**SECTION 01 32 16.15**  
**PROJECT SCHEDULES**  
**(SMALL PROJECTS - DESIGN/BID/BUILD)**

**PART 1- GENERAL**

**1.1 DESCRIPTION:**

- A. The Contractor shall develop a Critical Path Method (CPM) plan and schedule demonstrating fulfillment of the contract requirements (Project Schedule), and shall keep the Project Schedule up-to-date in accordance with the requirements of this section and shall utilize the plan for scheduling, coordinating and monitoring work under this contract (including all activities of subcontractors, equipment vendors and suppliers). Conventional Critical Path Method (CPM) technique shall be utilized to satisfy both time and cost applications.

**1.2 CONTRACTOR'S REPRESENTATIVE:**

- A. The Contractor shall designate an authorized representative responsible for the Project Schedule including preparation, review and progress reporting with and to the Contracting Officer's Representative (COTR).
- B. The Contractor's representative shall have direct project control and complete authority to act on behalf of the Contractor in fulfilling the requirements of this specification section.
- C. The Contractor's representative shall have the option of developing the project schedule within their organization or to engage the services of an outside consultant. If an outside scheduling consultant is utilized, Section 1.3 of this specification will apply.

**1.3 CONTRACTOR'S CONSULTANT:**

- A. The Contractor shall submit a qualification proposal to the COR, within 10 days of bid acceptance. The qualification proposal shall include:
1. The name and address of the proposed consultant.
  2. Information to show that the proposed consultant has the qualifications to meet the requirements specified in the preceding paragraph.
  3. A representative sample of prior construction projects, which the proposed consultant has performed complete project scheduling services. These representative samples shall be of similar size and scope.
- B. The Contracting Officer has the right to approve or disapprove the proposed consultant and will notify the Contractor of the VA decision

within seven calendar days from receipt of the qualification proposal. In case of disapproval, the Contractor shall resubmit another consultant within 10 calendar days for renewed consideration. The Contractor shall have their scheduling consultant approved prior to submitting any schedule for approval.

#### **1.4 COMPUTER PRODUCED SCHEDULES**

- A. The contractor shall provide monthly, to the Department of Veterans Affairs (VA), all computer-produced time/cost schedules and reports generated from monthly project updates. This monthly computer service will include: three copies of up to five different reports (inclusive of all pages) available within the user defined reports of the scheduling software approved by the Contracting Officer; a hard copy listing of all project schedule changes, and associated data, made at the update and an electronic file of this data; and the resulting monthly updated schedule in PDF format. These must be submitted with and substantively support the contractor's monthly payment request and the signed look ahead report. The COTR shall identify the five different report formats that the contractor shall provide.
- B. The contractor shall be responsible for the correctness and timeliness of the computer-produced reports. The Contractor shall also responsible for the accurate and timely submittal of the updated project schedule and all CPM data necessary to produce the computer reports and payment request that is specified.
- C. The VA will report errors in computer-produced reports to the Contractor's representative within ten calendar days from receipt of reports. The Contractor shall reprocess the computer-produced reports and associated diskette(s), when requested by the Contracting Officer's representative, to correct errors which affect the payment and schedule for the project.

#### **1.5 THE COMPLETE PROJECT SCHEDULE SUBMITTAL**

- A. Within 45 calendar days after receipt of Notice to Proceed, the Contractor shall submit for the Contracting Officer's review; three blue line copies of the interim schedule on sheets of paper 765 x 1070 mm (30 x 42 inches) and an electronic file in the previously approved CPM schedule program. The submittal shall also include three copies of a computer-produced activity/event ID schedule showing project duration; phase completion dates; and other data, including event cost.

Each activity/event on the computer-produced schedule shall contain as a minimum, but not limited to, activity/event ID, activity/event description, duration, budget amount, early start date, early finish date, late start date, late finish date and total float. Work activity/event relationships shall be restricted to finish-to-start or start-to-start without lead or lag constraints. Activity/event date constraints, not required by the contract, will not be accepted unless submitted to and approved by the Contracting Officer. The contractor shall make a separate written detailed request to the Contracting Officer identifying these date constraints and secure the Contracting Officer's written approval before incorporating them into the network diagram. The Contracting Officer's separate approval of the Project Schedule shall not excuse the contractor of this requirement. Logic events (non-work) will be permitted where necessary to reflect proper logic among work events, but must have zero duration. The complete working schedule shall reflect the Contractor's approach to scheduling the complete project. **The final Project Schedule in its original form shall contain no contract changes or delays which may have been incurred during the final network diagram development period and shall reflect the entire contract duration as defined in the bid documents.** These changes/delays shall be entered at the first update after the final Project Schedule has been approved. The Contractor should provide their requests for time and supporting time extension analysis for contract time as a result of contract changes/delays, after this update, and in accordance with Article, ADJUSTMENT OF CONTRACT COMPLETION.

- D. Within 30 calendar days after receipt of the complete project interim Project Schedule and the complete final Project Schedule, the Contracting Officer or his representative, will do one or both of the following:
1. Notify the Contractor concerning his actions, opinions, and objections.
  2. A meeting with the Contractor at or near the job site for joint review, correction or adjustment of the proposed plan will be scheduled if required. Within 14 calendar days after the joint review, the Contractor shall revise and shall submit three blue line copies of the revised Project Schedule, three copies of the revised

computer-produced activity/event ID schedule and a revised electronic file as specified by the Contracting Officer. The revised submission will be reviewed by the Contracting Officer and, if found to be as previously agreed upon, will be approved.

- E. The approved baseline schedule and the computer-produced schedule(s) generated there from shall constitute the approved baseline schedule until subsequently revised in accordance with the requirements of this section.

#### **1.6 WORK ACTIVITY/EVENT COST DATA**

- A. The Contractor shall cost load all work activities/events except procurement activities. The cumulative amount of all cost loaded work activities/events (including alternates) shall equal the total contract price. Prorate overhead, profit and general conditions on all work activities/events for the entire project length. The contractor shall generate from this information cash flow curves indicating graphically the total percentage of work activity/event dollar value scheduled to be in place on early finish, late finish. These cash flow curves will be used by the Contracting Officer to assist him in determining approval or disapproval of the cost loading. Negative work activity/event cost data will not be acceptable, except on VA issued contract changes.
- B. The Contractor shall cost load work activities/events for guarantee period services, test, balance and adjust various systems in accordance with the provisions in Article, FAR 52.232 - 5 (PAYMENT UNDER FIXED-PRICE CONSTRUCTION CONTRACTS) and VAAR 852.236 - 83 (PAYMENT UNDER FIXED-PRICE CONSTRUCTION CONTRACTS).
- C. In accordance with FAR 52.236 - 1 (PERFORMANCE OF WORK BY THE CONTRACTOR) and VAAR 852.236 - 72 (PERFORMANCE OF WORK BY THE CONTRACTOR), the Contractor shall submit, simultaneously with the cost per work activity/event of the construction schedule required by this Section, a responsibility code for all activities/events of the project for which the Contractor's forces will perform the work.
- D. The Contractor shall cost load work activities/events for all BID ITEMS. The sum of each BID ITEM work shall equal the value of the bid item in the Contractors' bid.

### 1.7 PROJECT SCHEDULE REQUIREMENTS

- A. Show on the project schedule the sequence of work activities/events required for complete performance of all items of work. The Contractor Shall:
1. Show activities/events as:
    - a. Contractor's time required for submittal of shop drawings, templates, fabrication, delivery and similar pre-construction work.
    - b. Contracting Officer's and Architect-Engineer's review and approval of shop drawings, equipment schedules, samples, template, or similar items.
    - c. Interruption of VA Facilities utilities, delivery of Government furnished equipment, and rough-in drawings, project phasing and any other specification requirements.
    - d. Test, balance and adjust various systems and pieces of equipment, maintenance and operation manuals, instructions and preventive maintenance tasks.
    - e. VA inspection and acceptance activity/event with a minimum duration of five work days at the end of each phase and immediately preceding any VA move activity/event required by the contract phasing for that phase.
  2. Show not only the activities/events for actual construction work for each trade category of the project, but also trade relationships to indicate the movement of trades from one area, floor, or building, to another area, floor, or building, for at least five trades who are performing major work under this contract.
  3. Break up the work into activities/events of a duration no longer than 20 work days each or one reporting period, except as to non-construction activities/events (i.e., procurement of materials, delivery of equipment, concrete and asphalt curing) and any other activities/events for which the COR may approve the showing of a longer duration. The duration for VA approval of any required submittal, shop drawing, or other submittals will not be less than 20 work days.
  4. Describe work activities/events clearly, so the work is readily identifiable for assessment of completion. Activities/events labeled



- "start," "continue," or "completion," are not specific and will not be allowed. Lead and lag time activities will not be acceptable.
5. The schedule shall be generally numbered in such a way to reflect either discipline, phase or location of the work.
- B. The Contractor shall submit the following supporting data in addition to the project schedule:
1. The appropriate project calendar including working days and holidays.
  2. The planned number of shifts per day.
  3. The number of hours per shift.
- Failure of the Contractor to include this data shall delay the review of the submittal until the Contracting Officer is in receipt of the missing data.
- C. To the extent that the Project Schedule or any revised Project Schedule shows anything not jointly agreed upon, it shall not be deemed to have been approved by the COR. Failure to include any element of work required for the performance of this contract shall not excuse the Contractor from completing all work required within any applicable completion date of each phase regardless of the COR's approval of the Project Schedule.
- D. Compact Disk Requirements and CPM Activity/Event Record Specifications: Submit to the VA an electronic file(s) containing one file of the data required to produce a schedule, reflecting all the activities/events of the complete project schedule being submitted.

**1.8 PAYMENT TO THE CONTRACTOR:**

- A. Monthly, the contractor shall submit an application and certificate for payment using VA Form 10-6001a or the AIA application and certificate for payment documents G702 & G703 reflecting updated schedule activities and cost data in accordance with the provisions of the following Article, PAYMENT AND PROGRESS REPORTING, as the basis upon which progress payments will be made pursuant to Article, FAR 52.232 - 5 (PAYMENT UNDER FIXED-PRICE CONSTRUCTION CONTRACTS) and VAAR 852.236 - 83 (PAYMENT UNDER FIXED-PRICE CONSTRUCTION CONTRACTS). The Contractor shall be entitled to a monthly progress payment upon approval of estimates as determined from the currently approved updated project schedule. Monthly payment requests shall include: a listing of all

agreed upon project schedule changes and associated data; and an electronic file (s) of the resulting monthly updated schedule.

- B. Approval of the Contractor's monthly Application for Payment shall be contingent, among other factors, on the submittal of a satisfactory monthly update of the project schedule.

#### **1.9 PAYMENT AND PROGRESS REPORTING**

- A. Monthly schedule update meetings will be held on dates mutually agreed to by the COR and the Contractor. Contractor and their CPM consultant (if applicable) shall attend all monthly schedule update meetings. The Contractor shall accurately update the Project Schedule and all other data required and provide this information to the COTR three work days in advance of the schedule update meeting. Job progress will be reviewed to verify:
1. Actual start and/or finish dates for updated/completed activities/events.
  2. Remaining duration for each activity/event started, or scheduled to start, but not completed.
  3. Logic, time and cost data for change orders, and supplemental agreements that are to be incorporated into the Project Schedule.
  4. Changes in activity/event sequence and/or duration which have been made, pursuant to the provisions of following Article, ADJUSTMENT OF CONTRACT COMPLETION.
  5. Completion percentage for all completed and partially completed activities/events.
  6. Logic and duration revisions required by this section of the specifications.
  7. Activity/event duration and percent complete shall be updated independently.
- B. After completion of the joint review, the contractor shall generate an updated computer-produced calendar-dated schedule and supply the Contracting Officer's representative with reports in accordance with the Article, COMPUTER PRODUCED SCHEDULES, specified.
- C. After completing the monthly schedule update, the contractor's representative or scheduling consultant shall rerun all current period contract change(s) against the prior approved monthly project schedule. The analysis shall only include original workday durations and schedule logic agreed upon by the contractor and COR for the contract change(s).

When there is a disagreement on logic and/or durations, the Contractor shall use the schedule logic and/or durations provided and approved by the COR. After each rerun update, the resulting electronic project schedule data file shall be appropriately identified and submitted to the VA in accordance to the requirements listed in articles 1.4 and 1.7. This electronic submission is separate from the regular monthly project schedule update requirements and shall be submitted to the COR within fourteen (14) calendar days of completing the regular schedule update. **Before inserting the contract changes durations, care must be taken to ensure that only the original durations will be used for the analysis, not the reported durations after progress. In addition, once the final network diagram is approved, the contractor must recreate all manual progress payment updates on this approved network diagram and associated reruns for contract changes in each of these update periods as outlined above for regular update periods. This will require detailed record keeping for each of the manual progress payment updates.**

- D. Following approval of the CPM schedule, the VA, the General Contractor, its approved CPM Consultant, COR, and all subcontractors needed, as determined by the SRE, shall meet to discuss the monthly updated schedule. The main emphasis shall be to address work activities to avoid slippage of project schedule and to identify any necessary actions required to maintain project schedule during the reporting period. The Government representatives and the Contractor should conclude the meeting with a clear understanding of those work and administrative actions necessary to maintain project schedule status during the reporting period. This schedule coordination meeting will occur after each monthly project schedule update meeting utilizing the resulting schedule reports from that schedule update. If the project is behind schedule, discussions should include ways to prevent further slippage as well as ways to improve the project schedule status, when appropriate.

#### **1.10 RESPONSIBILITY FOR COMPLETION**

- A. If it becomes apparent from the current revised monthly progress schedule that phasing or contract completion dates will not be met, the Contractor shall execute some or all of the following remedial actions:

1. Increase construction manpower in such quantities and crafts as necessary to eliminate the backlog of work.
  2. Increase the number of working hours per shift, shifts per working day, working days per week, the amount of construction equipment, or any combination of the foregoing to eliminate the backlog of work.
  3. Reschedule the work in conformance with the specification requirements.
- B. Prior to proceeding with any of the above actions, the Contractor shall notify and obtain approval from the COR for the proposed schedule changes. If such actions are approved, the representative schedule revisions shall be incorporated by the Contractor into the Project Schedule before the next update, at no additional cost to the Government.

#### **1.11 CHANGES TO THE SCHEDULE**

- A. Within 30 calendar days after VA acceptance and approval of any updated project schedule, the Contractor shall submit a revised electronic file (s) and a list of any activity/event changes including predecessors and successors for any of the following reasons:
1. Delay in completion of any activity/event or group of activities/events, which may be involved with contract changes, strikes, unusual weather, and other delays will not relieve the Contractor from the requirements specified unless the conditions are shown on the CPM as the direct cause for delaying the project beyond the acceptable limits.
  2. Delays in submittals, or deliveries, or work stoppage are encountered which make rescheduling of the work necessary.
  3. The schedule does not represent the actual prosecution and progress of the project.
  4. When there is, or has been, a substantial revision to the activity/event costs regardless of the cause for these revisions.
- B. CPM revisions made under this paragraph which affect the previously approved computer-produced schedules for Government furnished equipment, vacating of areas by the VA Facility, contract phase(s) and sub phase(s), utilities furnished by the Government to the Contractor, or any other previously contracted item, shall be furnished in writing to the Contracting Officer for approval.

- C. Contracting Officer's approval for the revised project schedule and all relevant data is contingent upon compliance with all other paragraphs of this section and any other previous agreements by the Contracting Officer or the VA representative.
- D. The cost of revisions to the project schedule resulting from contract changes will be included in the proposal for changes in work as specified in FAR 52.243 - 4 (Changes) and VAAR 852.236 - 88 (Changes - Supplemental), and will be based on the complexity of the revision or contract change, man hours expended in analyzing the change, and the total cost of the change.
- E. The cost of revisions to the Project Schedule not resulting from contract changes is the responsibility of the Contractor.

#### **1.12 ADJUSTMENT OF CONTRACT COMPLETION**

- A. The contract completion time will be adjusted only for causes specified in this contract. Request for an extension of the contract completion date by the Contractor shall be supported with a justification, CPM data and supporting evidence as the COTR may deem necessary for determination as to whether or not the Contractor is entitled to an extension of time under the provisions of the contract. Submission of proof based on revised activity/event logic, durations (in work days) and costs is obligatory to any approvals. The schedule must clearly display that the Contractor has used, in full, all the float time available for the work involved in this request. The Contracting Officer's determination as to the total number of days of contract extension will be based upon the current computer-produced calendar-dated schedule for the time period in question and all other relevant information.
- B. Actual delays in activities/events which, according to the computer- produced calendar-dated schedule, do not affect the extended and predicted contract completion dates shown by the critical path in the network, will not be the basis for a change to the contract completion date. The Contracting Officer will within a reasonable time after receipt of such justification and supporting evidence, review the facts and advise the Contractor in writing of the Contracting Officer's decision.
- C. The Contractor shall submit each request for a change in the contract completion date to the Contracting Officer in accordance with the

provisions specified under FAR 52.243 - 4 (Changes) and VAAR 852.236 - 88 (Changes - Supplemental). The Contractor shall include, as a part of each change order proposal, a sketch showing all CPM logic revisions, duration (in work days) changes, and cost changes, for work in question and its relationship to other activities on the approved network diagram.

- D. All delays due to non-work activities/events such as RFI's, WEATHER, STRIKES, and similar non-work activities/events shall be analyzed on a month by month basis.

- - - E N D - - -

**SECTION 01 33 23**

**SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This specification defines the general requirements and procedures for submittals. A submittal is information submitted for VA review to establish compliance with the contract documents.
- B. Detailed submittal requirements are found in the technical sections of the contract specifications. The Contracting Officer may request submittals in addition to those specified when deemed necessary to adequately describe the work covered in the respective technical specifications at no additional cost to the government.
- C. VA approval of a submittal does not relieve the Contractor of the responsibility for any error which may exist. The Contractor is responsible for fully complying with all contract requirements and the satisfactory construction of all work, including the need to check, confirm, and coordinate the work of all subcontractors for the project. Non-compliant material incorporated in the work will be removed and replaced at the Contractor's expense.

**1.2 DEFINITIONS**

- A. Preconstruction Submittals: Submittals which are required prior to issuing contract notice to proceed or starting construction. For example, Certificates of insurance; Surety bonds; Site-specific safety plan; Construction progress schedule; Schedule of values; Submittal register; List of proposed subcontractors.
- B. Shop Drawings: Drawings, diagrams, and schedules specifically prepared to illustrate some portion of the work. Drawings prepared by or for the Contractor to show how multiple systems and interdisciplinary work will be integrated and coordinated.
- C. Product Data: Catalog cuts, illustrations, schedules, diagrams, performance charts, instructions, and brochures, which describe and illustrate size, physical appearance, and other characteristics of materials, systems, or equipment for some portion of the work. Samples of warranty language when the contract requires extended product warranties.

- D. Samples: Physical examples of materials, equipment, or workmanship that illustrate functional and aesthetic characteristics of a material or product and establish standards by which the work can be judged. Color samples from the manufacturer's standard line (or custom color samples if specified) to be used in selecting or approving colors for the project. Field samples and mock-ups constructed to establish standards by which the ensuing work can be judged.
- E. Design Data: Calculations, mix designs, analyses, or other data pertaining to a part of work.
- F. Test Reports: Report which includes findings of a test required to be performed by the Contractor on an actual portion of the work. Report which includes finding of a test made at the job site or on sample taken from the job site, on portion of work during or after installation.
- G. Certificates: Document required of Contractor, or of a manufacturer, supplier, installer, or subcontractor through Contractor. The purpose is to document procedures, acceptability of methods, or personnel qualifications for a portion of the work.
- H. Manufacturer's Instructions: Pre-printed material describing installation of a product, system, or material, including special notices and MSDS concerning impedances, hazards, and safety precautions.
- I. Manufacturer's Field Reports: Documentation of the testing and verification actions taken by manufacturer's representative at the job site on a portion of the work, during or after installation, to confirm compliance with manufacturer's standards or instructions. The documentation must indicate whether the material, product, or system has passed or failed the test.
- J. Operation and Maintenance Data: Manufacturer data that is required to operate, maintain, troubleshoot, and repair equipment, including manufacturer's help, parts list, and product line documentation. This data shall be incorporated in an operations and maintenance manual.
- K. Closeout Submittals: Documentation necessary to properly close out a construction contract. For example, Record Drawings and as-built drawings. Also, submittal requirements necessary to properly close out a phase of construction on a multi-phase contract.



### **1.3 SUBMITTAL REGISTER**

- A. The submittal register will list items of equipment and materials for which submittals are required by the specifications. This list may not be all inclusive and additional submittals may be required by the specifications. The Contractor is not relieved from supplying submittals required by the contract documents but which have been omitted from the submittal register.
- B. The submittal register will serve as a scheduling document for submittals and will be used to control submittal actions throughout the contract period.
- C. The AE will provide the initial submittal register in electronic format. Thereafter, the Contractor shall track all submittals by maintaining a complete list, including completion of all data columns, including dates on which submittals are received and returned by the VA.
- D. The Contractor shall update the submittal register as submittal actions occur and maintain the submittal register at the project site until final acceptance of all work by Contracting Officer.
- E. The Contractor shall submit formal monthly updates to the submittal register in electronic format. Each monthly update shall document actual submission and approval dates for each submittal.

### **1.4 SUBMITTAL SCHEDULING**

- A. Submittals are to be scheduled, submitted, reviewed, and approved prior to the acquisition of the material or equipment.
- B. Coordinate scheduling, sequencing, preparing, and processing of submittals with performance of work so that work will not be delayed by submittal processing. Allow time for potential resubmittal.
- C. No delay costs or time extensions will be allowed for time lost in late submittals or resubmittals.
- D. All submittals are required to be approved prior to the start of the specified work activity.

### **1.5 SUBMITTAL PREPARATION**

- A. Each submittal is to be complete and in sufficient detail to allow ready determination of compliance with contract requirements.
- B. Collect required data for each specific material, product, unit of work, or system into a single submittal. Prominently mark choices, options, and portions applicable to the submittal. Partial submittals will not be

accepted for expedition of construction effort. Submittal will be returned without review if incomplete.

- C. If available product data is incomplete, provide Contractor-prepared documentation to supplement product data and satisfy submittal requirements.
- D. All irrelevant or unnecessary data shall be removed from the submittal to facilitate accuracy and timely processing. Submittals that contain the excessive amount of irrelevant or unnecessary data will be returned without review.
- E. Provide a transmittal form for each submittal with the following information:
  - 1. Project title, location and number.
  - 2. Construction contract number.
  - 3. Date of the drawings and revisions.
  - 4. Name, address, and telephone number of subcontractor, supplier, manufacturer, and any other subcontractor associated with the submittal.
  - 5. List paragraph number of the specification section and sheet number of the contract drawings by which the submittal is required.
  - 6. When a resubmission, add alphabetic suffix on submittal description. For example, submittal 18 would become 18A, to indicate resubmission.
  - 7. Product identification and location in project.
- F. The Contractor is responsible for reviewing and certifying that all submittals are in compliance with contract requirements before submitting for VA review. Proposed deviations from the contract requirements are to be clearly identified. All deviations submitted must include a side by side comparison of item being proposed against item specified. Failure to point out deviations will result in the VA requiring removal and replacement of such work at the Contractor's expense.
- G. Stamp, sign, and date each submittal transmittal form indicating action taken.
- H. Stamp used by the Contractor on the submittal transmittal form to certify that the submittal meets contract requirements is to be similar to the following:

CONTRACTOR
(Firm Name)
_____ Approved
_____ Approved with corrections as noted on submittal data and/or attached sheets(s)
SIGNATURE: _____
TITLE: _____
DATE: _____

**1.6 SUBMITTAL FORMAT AND TRANSMISSION**

- A. Provide submittals in electronic format, with the exception of material samples. Use PDF as the electronic format, unless otherwise specified or directed by the Contracting Officer.
- B. Compile the electronic submittal file as a single, complete document. Name the electronic submittal file specifically according to its contents.
- C. Electronic files must be of sufficient quality that all information is legible. Generate PDF files from original documents so that the text included in the PDF file is both searchable and can be copied. If documents are scanned, Optical Character Resolution (OCR) routines are required.

- D. E-mail electronic submittal documents smaller than 5MB in size to e-mail addresses as directed by the Contracting Officer.
- E. Provide electronic documents over 5MB through an electronic FTP file sharing system. Confirm that the electronic FTP file sharing system can be accessed from the VA computer network. The Contractor is responsible for setting up, providing, and maintaining the electronic FTP file sharing system for the construction contract period of performance.
- F. Provide hard copies of submittals when requested by the Contracting Officer. Up to 3 additional hard copies of any submittal may be requested at the discretion of the Contracting Officer, at no additional cost to the VA.

**1.7 SAMPLES**

- A. Submit two sets of physical samples showing range of variation, for each required item.
- B. Where samples are specified for selection of color, finish, pattern, or texture, submit the full set of available choices for the material or product specified.
- C. When color, texture, or pattern is specified by naming a particular manufacturer and style, include one sample of that manufacturer and style, for comparison.
- D. Before submitting samples, the Contractor is to ensure that the materials or equipment will be available in quantities required in the project. No change or substitution will be permitted after a sample has been approved.
- E. The VA reserves the right to disapprove any material or equipment which previously has proven unsatisfactory in service.
- F. Physical samples supplied maybe requested back for use in the project after reviewed and approved.

**1.8 OPERATION AND MAINTENANCE DATA**

- A. Submit data specified for a given item within 30 calendar days after the item is delivered to the contract site.
- B. In the event the Contractor fails to deliver O&M Data within the time limits specified, the Contracting Officer may withhold from progress payments 50 percent of the price of the item with which such O&M Data are applicable.

### **1.9 TEST REPORTS**

SRE may require specific test after work has been installed or completed which could require contractor to repair test area at no additional cost to contract.

### **1.10 VA REVIEW OF SUBMITTALS AND RFIS**

- A. The VA will review all submittals for compliance with the technical requirements of the contract documents. The Architect-Engineer for this project will assist the VA in reviewing all submittals and determining contractual compliance. Review will be only for conformance with the applicable codes, standards and contract requirements.
- B. Period of review for submittals begins when the VA COR receives submittal from the Contractor.
- C. Period of review for each resubmittal is the same as for initial submittal.
- D. VA review period is 15 working days for submittals.
- E. VA review period is 10 working days for RFIs.
- F. The VA will return submittals to the Contractor with the following notations:
  - 1. "Approved": authorizes the Contractor to proceed with the work covered.
  - 2. "Approved as noted": authorizes the Contractor to proceed with the work covered provided the Contractor incorporates the noted comments and makes the noted corrections.
  - 3. "Disapproved, revise and resubmit": indicates noncompliance with the contract requirements or that submittal is incomplete. Resubmit with appropriate changes and corrections. No work shall proceed for this item until resubmittal is approved.
  - 4. "Not reviewed": indicates submittal does not have evidence of being reviewed and approved by Contractor or is not complete. A submittal marked "not reviewed" will be returned with an explanation of the reason it is not reviewed. Resubmit submittals after taking appropriate action.

### **1.11 APPROVED SUBMITTALS**

- A. The VA approval of submittals is not to be construed as a complete check, and indicates only that the general method of construction, materials, detailing, and other information are satisfactory.

- B. VA approval of a submittal does not relieve the Contractor of the responsibility for any error which may exist. The Contractor is responsible for fully complying with all contract requirements and the satisfactory construction of all work, including the need to check, confirm, and coordinate the work of all subcontractors for the project. Non-compliant material incorporated in the work will be removed and replaced at the Contractor's expense.
- C. After submittals have been approved, no resubmittal for the purpose of substituting materials or equipment will be considered unless accompanied by an explanation of why a substitution is necessary.
- D. Retain a copy of all approved submittals at project site, including approved samples.

**1.12 WITHHOLDING OF PAYMENT**

Payment for materials incorporated in the work will not be made if required approvals have not been obtained.

- - - E N D - - -

**SECTION 01 35 26  
SAFETY REQUIREMENTS**

**TABLE OF CONTENTS**

1.1	APPLICABLE PUBLICATIONS .....	2
1.2	DEFINITIONS .....	3
1.3	REGULATORY REQUIREMENTS .....	5
1.4	ACCIDENT PREVENTION PLAN (APP).....	5
1.5	ACTIVITY HAZARD ANALYSES (AHAs) .....	10
1.6	PRECONSTRUCTION CONFERENCE .....	12
1.7	"SITE SAFETY AND HEALTH OFFICER" (SSHO) and "COMPETENT PERSON" (CP) .....	12
1.8	TRAINING .....	13
1.9	INSPECTIONS .....	14
1.10	ACCIDENTS, OSHA 300 LOGS, AND MAN-HOURS .....	15
1.11	PERSONAL PROTECTIVE EQUIPMENT (PPE).....	16
1.12	INFECTION CONTROL.....	16
1.13	FIRE SAFETY.....	24
1.14	ELECTRICAL.....	23
1.15	FALL PROTECTION.....	25
1.16	SCAFFOLDS AND OTHER WORK PLATFORMS .....	25
1.17	CONTROL OF HAZARDOUS ENERGY (LOCKOUT/TAGOUT) .....	29
1.18	CONFINED SPACE ENTRY.....	29
1.19	WELDING AND CUTTING.....	30
1.20	LADDERS.....	30
1.21	FLOOR & WALL OPENINGS .....	30

**SECTION 01 35 26  
SAFETY REQUIREMENTS**

**1.1 APPLICABLE PUBLICATIONS:**

A. Latest publications listed below form part of this Article to extent referenced. Publications are referenced in text by basic designations only.

B. American Society of Safety Engineers (ASSE):

A10.1-2011.....Pre-Project & Pre-Task Safety and Health  
Planning

A10.34-2012.....Protection of the Public on or Adjacent to  
Construction Sites

A10.38-2013.....Basic Elements of an Employer's Program to  
Provide a Safe and Healthful Work Environment  
American National Standard Construction and  
Demolition Operations

C. American Society for Testing and Materials (ASTM):

E84-2013.....Surface Burning Characteristics of Building  
Materials

D. The Facilities Guidelines Institute (FGI):

FGI Guidelines-2010Guidelines for Design and Construction of  
Healthcare Facilities

E. National Fire Protection Association (NFPA):

10-2013.....Standard for Portable Fire Extinguishers

30-2012.....Flammable and Combustible Liquids Code

51B-2014.....Standard for Fire Prevention During Welding,  
Cutting and Other Hot Work

70-2014.....National Electrical Code

70B-2013.....Recommended Practice for Electrical Equipment  
Maintenance

70E-2015 .....Standard for Electrical Safety in the Workplace



99-2012.....Health Care Facilities Code

241-2013.....Standard for Safeguarding Construction,  
Alteration, and Demolition Operations

F. The Joint Commission (TJC)

TJC Manual .....Comprehensive Accreditation and Certification  
Manual

G. U.S. Nuclear Regulatory Commission

10 CFR 20 .....Standards for Protection Against Radiation

H. U.S. Occupational Safety and Health Administration (OSHA):

29 CFR 1904 .....Reporting and Recording Injuries & Illnesses

29 CFR 1910 .....Safety and Health Regulations for General  
Industry

29 CFR 1926 .....Safety and Health Regulations for Construction  
Industry

CPL 2-0.124.....Multi-Employer Citation Policy

I. VHA Directive 2005-007

**1.2 DEFINITIONS:**

A. Critical Lift. A lift with the hoisted load exceeding 75% of the crane's maximum capacity; lifts made out of the view of the operator (blind picks); lifts involving two or more cranes; personnel being hoisted; and special hazards such as lifts over occupied facilities, loads lifted close to power-lines, and lifts in high winds or where other adverse environmental conditions exist; and any lift which the crane operator believes is critical.

B. OSHA "Competent Person" (CP). One who is capable of identifying existing and predictable hazards in the surroundings and working conditions which are unsanitary, hazardous or dangerous to employees, and who has the authorization to take prompt corrective measures to eliminate them (see 29 CFR 1926.32(f)).

C. "Qualified Person" means one who, by possession of a recognized degree, certificate, or professional standing, or who by extensive knowledge,

training and experience, has successfully demonstrated his ability to solve or resolve problems relating to the subject matter, the work, or the project.

D. High Visibility Accident. Any mishap which may generate publicity or high visibility.

E. Accident/Incident Criticality Categories:

No impact - near miss incidents that should be investigated but are not required to be reported to the VA;

Minor incident/impact - incidents that require first aid or result in minor equipment damage (less than \$5000). These incidents must be investigated but are not required to be reported to the VA;

Moderate incident/impact - Any work-related injury or illness that results in:

1. Days away from work (any time lost after day of injury/illness onset);
2. Restricted work;
3. Transfer to another job;
4. Medical treatment beyond first aid;
5. Loss of consciousness;
6. A significant injury or illness diagnosed by a physician or other licensed health care professional, even if it did not result in (1) through (5) above or,
7. any incident that leads to major equipment damage (greater than \$5000).

These incidents must be investigated and are required to be reported to the VA;

Major incident/impact - Any mishap that leads to fatalities, hospitalizations, amputations, and losses of an eye as a result of contractors' activities. Or any incident which leads to major property damage (greater than \$20,000) and/or may generate publicity or high visibility. These incidents must be investigated and are required to be

reported to the VA as soon as practical, but not later than 2 hours after the incident.

- E. Medical Treatment. Treatment administered by a physician or by registered professional personnel under the standing orders of a physician. Medical treatment does not include first aid treatment even through provided by a physician or registered personnel.

### **1.3 REGULATORY REQUIREMENTS:**

- A. In addition to the detailed requirements included in the provisions of this contract, comply with 29 CFR 1926, comply with 29 CFR 1910 as incorporated by reference within 29 CFR 1926, comply with ASSE A10.34, and all applicable [federal, state, and local] laws, ordinances, criteria, rules and regulations. Submit matters of interpretation of standards for resolution before starting work. Where the requirements of this specification, applicable laws, criteria, ordinances, regulations, and referenced documents vary, the most stringent requirements govern except with specific approval and acceptance by the COR.

### **1.4 ACCIDENT PREVENTION PLAN (APP):**

- A. The APP (aka Construction Safety & Health Plan) shall interface with the Contractor's overall safety and health program. Include any portions of the Contractor's overall safety and health program referenced in the APP in the applicable APP element and ensure it is site-specific. The Government considers the Prime Contractor to be the "controlling authority" for all worksite safety and health of each subcontractor(s). Contractors are responsible for informing their subcontractors of the safety provisions under the terms of the contract and the penalties for noncompliance, coordinating the work to prevent one craft from interfering with or creating hazardous working conditions for other crafts, and inspecting subcontractor operations to ensure that accident prevention responsibilities are being carried out.
- B. The APP shall be prepared as follows:
  - 1. Written in English by a qualified person who is employed by the Prime Contractor articulating the specific work and hazards pertaining to the contract (model language can be found in ASSE

- A10.33). Specifically articulating the safety requirements found within these VA contract safety specifications.
2. Address both the Prime Contractors and the subcontractors work operations.
  3. State measures to be taken to control hazards associated with materials, services, or equipment provided by suppliers.
  4. Address all the elements/sub-elements and in order as follows:
    - a. **SIGNATURE SHEET.** Title, signature, and phone number of the following:
      - 1) Plan preparer (Qualified Person such as corporate safety staff person or contracted Certified Safety Professional with construction safety experience);
      - 2) Plan approver (company/corporate officers authorized to obligate the company);
      - 3) Plan concurrence (e.g., Chief of Operations, Corporate Chief of Safety, Corporate Industrial Hygienist, project manager or superintendent, project safety professional). Provide concurrence of other applicable corporate and project personnel (Contractor).
    - b. **BACKGROUND INFORMATION.** List the following:
      - 1) Contractor;
      - 2) Contract number;
      - 3) Project name;
      - 4) Brief project description, description of work to be performed, and location; phases of work anticipated (these will require an AHA).
    - c. **STATEMENT OF SAFETY AND HEALTH POLICY.** Provide a copy of current corporate/company Safety and Health Policy Statement, detailing commitment to providing a safe and healthful workplace for all employees. The Contractor's written safety program goals,

objectives, and accident experience goals for this contract should be provided.

d. **RESPONSIBILITIES AND LINES OF AUTHORITIES.** Provide the following:

- 1) A statement of the employer's ultimate responsibility for the implementation of his SOH program;
- 2) Identification and accountability of personnel responsible for safety at both corporate and project level. Contracts specifically requiring safety or industrial hygiene personnel shall include a copy of their resumes;
- 3) The names of Competent and/or Qualified Person(s) and proof of competency/qualification to meet specific OSHA Competent/Qualified Person(s) requirements must be attached;
- 4) Requirements that no work shall be performed unless a designated competent person is present on the job site;
- 5) Requirements for pre-task Activity Hazard Analysis (AHAs);
- 6) Lines of authority;
- 7) Policies and procedures regarding noncompliance with safety requirements (to include disciplinary actions for violation of safety requirements) should be identified;

e. **SUBCONTRACTORS AND SUPPLIERS.** If applicable, provide procedures for coordinating SOH activities with other employers on the job site:

- 1) Identification of subcontractors and suppliers (if known);
- 2) Safety responsibilities of subcontractors and suppliers.

f. **TRAINING.**

- 1) Site-specific SOH orientation training at the time of initial hire or assignment to the project for every employee before working on the project site is required.
- 2) Mandatory training and certifications that are applicable to this project (e.g., explosive actuated tools, crane operator, rigger, crane signal person, fall protection, electrical

lockout/NFPA 70E, machine/equipment lockout, confined space, etc....) and any requirements for periodic retraining/recertification are required.

- 3) Procedures for ongoing safety and health training for supervisors and employees shall be established to address changes in site hazards/conditions.
- 4) OSHA 10-hour training is required for all workers on site and the OSHA 30-hour training is required for Trade Competent Persons (CPs)

**g. SAFETY AND HEALTH INSPECTIONS.**

- 1) Specific assignment of responsibilities for a minimum daily job site safety and health inspection during periods of work activity: Who will conduct (e.g., "Site Safety and Health CP"), proof of inspector's training/qualifications, when inspections will be conducted, procedures for documentation, deficiency tracking system, and follow-up procedures.
- 2) Any external inspections/certifications that may be required (e.g., contracted CSP or CSHT)

**h. ACCIDENT/INCIDENT INVESTIGATION & REPORTING.** The Contractor shall conduct mishap investigations of all Moderate and Major as well as all High Visibility Incidents. The APP shall include accident/incident investigation procedure and identify person(s) responsible to provide the following to the COR:

- 1) Exposure data (man-hours worked);
- 2) Accident investigation reports;
- 3) Project site injury and illness logs.

**i. PLANS (PROGRAMS, PROCEDURES) REQUIRED.** Based on a risk assessment of contracted activities and on mandatory OSHA compliance programs, the Contractor shall address all applicable occupational, patient, and public safety risks in site-specific compliance and accident prevention plans. These Plans shall include but are not be limited to procedures for addressing the risks associates with the following:

- 1) Emergency response;
- 2) Contingency for severe weather;
- 3) Fire Prevention;
- 4) Medical Support;
- 5) Posting of emergency telephone numbers;
- 6) Prevention of alcohol and drug abuse;
- 7) Site sanitation(housekeeping, drinking water, toilets);
- 8) Night operations and lighting;
- 9) Hazard communication program;
- 10) Welding/Cutting "Hot" work;
- 11) Electrical Safe Work Practices (Electrical LOTO/NFPA 70E);
- 12) General Electrical Safety;
- 13) Hazardous energy control (Machine LOTO);
- 14) Site-Specific Fall Protection & Prevention;
- 15) Excavation/trenching;
- 16) Asbestos abatement;
- 17) Lead abatement;
- 18) Crane Critical lift;
- 19) Respiratory protection;
- 20) Health hazard control program;
- 21) Radiation Safety Program;
- 22) Abrasive blasting;
- 23) Heat/Cold Stress Monitoring;
- 24) Crystalline Silica Monitoring (Assessment);
- 25) Demolition plan (to include engineering survey);
- 26) Formwork and shoring erection and removal;

27) PreCast Concrete;

28) Public (Mandatory compliance with ANSI/ASSE A10.34-2012).

- C. Submit the APP to the COR for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES 15 calendar days prior to the date of the preconstruction conference for acceptance. Work cannot proceed without an accepted APP.
- D. Once accepted by the COR, the APP and attachments will be enforced as part of the contract. Disregarding the provisions of this contract or the accepted APP will be cause for stopping of work, at the discretion of the Contracting Officer in accordance with FAR Clause 52.236-13, *Accident Prevention*, until the matter has been rectified.
- E. Once work begins, changes to the accepted APP shall be made with the knowledge and concurrence of the COR. Should any severe hazard exposure, i.e. imminent danger, become evident, stop work in the area, secure the area, and develop a plan to remove the exposure and control the hazard. Notify the Contracting Officer within 24 hours of discovery. Eliminate/remove the hazard. In the interim, take all necessary action to restore and maintain safe working conditions in order to safeguard onsite personnel, visitors, the public and the environment.

**1.5 ACTIVITY HAZARD ANALYSES (AHAS):**

- A. AHAs are also known as Job Hazard Analyses, Job Safety Analyses, and Activity Safety Analyses. Before beginning each work activity involving a type of work presenting hazards not experienced in previous project operations or where a new work crew or sub-contractor is to perform the work, the Contractor(s) performing that work activity shall prepare an AHA (Example electronic AHA forms can be found on the US Army Corps of Engineers web site)
- B. AHAs shall define the activities being performed and identify the work sequences, the specific anticipated hazards, site conditions, equipment, materials, and the control measures to be implemented to eliminate or reduce each hazard to an acceptable level of risk.



- C. Work shall not begin until the AHA for the work activity has been accepted by the COR and discussed with all engaged in the activity, including the Contractor, subcontractor(s), and Government on-site representatives at preparatory and initial control phase meetings.
1. The names of the Competent/Qualified Person(s) required for a particular activity (for example, excavations, scaffolding, fall protection, other activities as specified by OSHA and/or other State and Local agencies) shall be identified and included in the AHA. Certification of their competency/qualification shall be submitted to the Government Designated Authority (GDA) for acceptance prior to the start of that work activity.
  2. The AHA shall be reviewed and modified as necessary to address changing site conditions, operations, or change of competent/qualified person(s).
    - a. If more than one Competent/Qualified Person is used on the AHA activity, a list of names shall be submitted as an attachment to the AHA. Those listed must be Competent/Qualified for the type of work involved in the AHA and familiar with current site safety issues.
    - b. If a new Competent/Qualified Person (not on the original list) is added, the list shall be updated (an administrative action not requiring an updated AHA). The new person shall acknowledge in writing that he or she has reviewed the AHA and is familiar with current site safety issues.
  3. Submit AHAs to the COR for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES for review at least 15 calendar days prior to the start of each phase. Subsequent AHAs shall be formatted as amendments to the APP. The analysis should be used during daily inspections to ensure the implementation and effectiveness of the activity's safety and health controls.
  4. The AHA list will be reviewed periodically (at least monthly) at the Contractor supervisory safety meeting and updated as necessary when procedures, scheduling, or hazards change.

5. Develop the activity hazard analyses using the project schedule as the basis for the activities performed. All activities listed on the project schedule will require an AHA. The AHAs will be developed by the contractor, supplier, or subcontractor and provided to the prime contractor for review and approval and then submitted to the COR.

**1.6 PRECONSTRUCTION CONFERENCE:**

- A. Contractor representatives who have a responsibility or significant role in implementation of the accident prevention program, as required by 29 CFR 1926.20(b)(1), on the project shall attend the preconstruction conference to gain a mutual understanding of its implementation. This includes the project superintendent, subcontractor superintendents, and any other assigned safety and health professionals.
- B. Discuss the details of the submitted APP to include incorporated plans, programs, procedures and a listing of anticipated AHAs that will be developed and implemented during the performance of the contract. This list of proposed AHAs will be reviewed at the conference and an agreement will be reached between the Contractor and the Contracting Officer's representative as to which phases will require an analysis. In addition, establish a schedule for the preparation, submittal, review, and acceptance of AHAs to preclude project delays.

**1.7 "SITE SAFETY AND HEALTH OFFICER" (SSHO) AND "COMPETENT PERSON" (CP):**

- A. The Prime Contractor shall designate a minimum of one SSHO at each project site that will be identified as the SSHO to administer the Contractor's safety program and government-accepted Accident Prevention Plan. Each subcontractor shall designate a minimum of one CP in compliance with 29 CFR 1926.20 (b)(2) that will be identified as a CP to administer their individual safety programs.
- B. Further, all specialized Competent Persons for the work crews will be supplied by the respective contractor as required by 29 CFR 1926 (i.e. Asbestos, Electrical, Cranes, & Derricks, Demolition, Fall Protection, Fire Safety/Life Safety, Ladder, Rigging, Scaffolds, and Trenches/Excavations).

- C. These Competent Persons can have collateral duties as the subcontractor's superintendent and/or work crew lead persons as well as fill more than one specialized CP role (i.e. Asbestos, Electrical, Cranes, & Derricks, Demolition, Fall Protection, Fire Safety/Life Safety, Ladder, Rigging, Scaffolds, and Trenches/Excavations).
- D. The SSHO or an equally-qualified Designated Representative/alternate will maintain a presence on the site during construction operations in accordance with FAR Clause 52.236-6: *Superintendence by the Contractor*. CPs will maintain presence during their construction activities in accordance with above mentioned clause. A listing of the designated SSHO and all known CPs shall be submitted prior to the start of work as part of the APP with the training documentation and/or AHA as listed in Section 1.8 below.
- E. The repeated presence of uncontrolled hazards during a contractor's work operations will result in the designated CP as being deemed incompetent and result in the required removal of the employee in accordance with FAR Clause 52.236-5: Material and Workmanship, Paragraph (c).

#### **1.8 TRAINING:**

- A. The designated Prime Contractor SSHO must meet the requirements of all applicable OSHA standards and be capable (through training, experience, and qualifications) of ensuring that the requirements of 29 CFR 1926.16 and other appropriate Federal, State and local requirements are met for the project. As a minimum the SSHO must have completed the OSHA 30-hour Construction Safety class and have five (5) years of construction industry safety experience or three (3) years if he/she possesses a Certified Safety Professional (CSP) or certified Construction Safety and Health Technician (CSHT) certification or have a safety and health degree from an accredited university or college.
- B. All designated CPs shall have completed the OSHA 30-hour Construction Safety course within the past 5 years.
- C. In addition to the OSHA 30 Hour Construction Safety Course, all CPs with high hazard work operations such as operations involving asbestos, electrical, cranes, demolition, work at heights/fall protection, fire safety/life safety, ladder, rigging, scaffolds, and

trenches/excavations shall have a specialized formal course in the hazard recognition & control associated with those high hazard work operations. Documented "repeat" deficiencies in the execution of safety requirements will require retaking the requisite formal course.

- D. All other construction workers shall have the OSHA 10-hour Construction Safety Outreach course and any necessary safety training to be able to identify hazards within their work environment.
- E. Submit training records associated with the above training requirements to the COR for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES 15 calendar days prior to the date of the preconstruction conference for acceptance.
- F. Prior to any worker for the contractor or subcontractors beginning work, they shall undergo a safety briefing provided by the SSHO or his/her designated representative. As a minimum, this briefing shall include information on the site-specific hazards, construction limits, VAMC safety guidelines, means of egress, break areas, work hours, locations of restrooms, use of VAMC equipment, emergency procedures, accident reporting etc... Documentation shall be provided to the COR that individuals have undergone contractor's safety briefing.
- G. Ongoing safety training will be accomplished in the form of weekly documented safety meeting.

#### **1.9 INSPECTIONS:**

- A. The SSHO shall conduct frequent and regular safety inspections (daily) of the site and each of the subcontractors CPs shall conduct frequent and regular safety inspections (daily) of the their work operations as required by 29 CFR 1926.20(b)(2). Each week, the SSHO shall conduct a formal documented inspection of the entire construction areas with the subcontractors' "Trade Safety and Health CPs" present in their work areas. Coordinate with, and report findings and corrective actions weekly to COR.
- B. A Certified Safety Professional (CSP) with specialized knowledge in construction safety or a certified Construction Safety and Health Technician (CSHT) shall randomly conduct a monthly site safety

inspection. The CSP or CSHT can be a corporate safety professional or independently contracted. The CSP or CSHT will provide their certificate number on the required report for verification as necessary.

1. The COR will be notified immediately prior to start of the inspection and invited to accompany the inspection.
2. Identified hazard and controls will be discussed to come to a mutual understanding to ensure abatement and prevent future reoccurrence.
3. A report of the inspection findings with status of abatement will be provided to the COR within one week of the onsite inspection.

**1.10 ACCIDENTS, OSHA 300 LOGS, AND MAN-HOURS:**

- A. The prime contractor shall establish and maintain an accident reporting, recordkeeping, and analysis system to track and analyze all injuries and illnesses, high visibility incidents, and accidental property damage (both government and contractor) that occur on site. Notify the COR as soon as practical, but no more than four hours after any accident meeting the definition of a Moderate or Major incidents, High Visibility Incidents, or any weight handling and hoisting equipment accident. Within notification include contractor name; contract title; type of contract; name of activity, installation or location where accident occurred; date and time of accident; names of personnel injured; extent of property damage, if any; extent of injury, if known, and brief description of accident (to include type of construction equipment used, PPE used, etc.). Preserve the conditions and evidence on the accident site until the COR determine whether a government investigation will be conducted.
- B. Conduct an accident investigation for all Minor, Moderate and Major incidents as defined in paragraph DEFINITIONS, and property damage accidents resulting in at least \$20,000 in damages, to establish the root cause(s) of the accident. Complete the VA Form 2162 (or equivalent), and provide the report to the COR within 5 calendar days of the accident. The COR will provide copies of any required or special forms.

- C. A summation of all man-hours worked by the contractor and associated sub-contractors for each month will be reported to the COR monthly.
- D. A summation of all Minor, Moderate, and Major incidents experienced on site by the contractor and associated sub-contractors for each month will be provided to the COR monthly. The contractor and associated sub-contractors' OSHA 300 logs will be made available to the COR as requested.

**1.11 PERSONAL PROTECTIVE EQUIPMENT (PPE):**

- A. PPE is governed in all areas by the nature of the work the employee is performing. For example, specific PPE required for performing work on electrical equipment is identified in NFPA 70E, Standard for Electrical Safety in the Workplace.
- B. Mandatory PPE includes:
  - 1. Hard Hats - unless written authorization is given by the COR in circumstances of work operations that have limited potential for falling object hazards such as during finishing work or minor remodeling. With authorization to relax the requirement of hard hats, if a worker becomes exposed to an overhead falling object hazard, then hard hats would be required in accordance with the OSHA regulations.
  - 2. Safety glasses - unless written authorization is given by the COR in circumstances of no eye hazards, appropriate safety glasses meeting the ANSI Z.87.1 standard must be worn by each person on site.
  - 3. Appropriate Safety Shoes - based on the hazards present, safety shoes meeting the requirements of ASTM F2413-11 shall be worn by each person on site unless written authorization is given by the COR in circumstances of no foot hazards.
  - 4. Hearing protection - Use personal hearing protection at all times in designated noise hazardous areas or when performing noise hazardous tasks.

**1.12 INFECTION CONTROL**

- A. Infection Control is critical in all medical center facilities. Interior construction activities causing disturbance of existing dust,

or creating new dust, must be conducted within ventilation-controlled areas that minimize the flow of airborne particles into patient areas.

B. An AHA associated with infection control will be performed by VA personnel in accordance with FGI Guidelines (i.e. Infection Control Risk Assessment (ICRA)). The ICRA procedure found on the American Society for Healthcare Engineering (ASHE) website will be utilized. Risk classifications of Class II or lower will require approval by the COR before beginning any construction work. Risk classifications of Class III or higher will require a permit before beginning any construction work. Infection Control permits will be issued by the COR. The Infection Control Permits will be posted outside the appropriate construction area. More than one permit may be issued for a construction project if the work is located in separate areas requiring separate classes. The primary project scope area for this project is: Class IV, however, work outside the primary project scope area may vary. The required infection control precautions with each class are as follows:

1. Class I requirements:

a. During Construction Work:

- 1) Notify the COR
- 2) Execute work by methods to minimize raising dust from construction operations.
- 3) Ceiling tiles: Immediately replace a ceiling tiles displaced for visual inspection.

b. Upon Completion:

- 1) Clean work area upon completion of task
- 2) Notify the COR

2. Class II requirements:

a. During Construction Work:

- 1) Notify the COR

- 2) Provide active means to prevent airborne dust from dispersing into atmosphere such as wet methods or tool mounted dust collectors where possible.
- 3) Water mist work surfaces to control dust while cutting.
- 4) Seal unused doors with duct tape.
- 5) Block off and seal air vents.
- 6) Remove or isolate HVAC system in areas where work is being performed.

b. Upon Completion:

- 1) Wipe work surfaces with cleaner/disinfectant.
- 2) Contain construction waste before transport in tightly covered containers.
- 3) Wet mop and/or vacuum with HEPA filtered vacuum before leaving work area.
- 4) Upon completion, restore HVAC system where work was performed
- 5) Notify the COR

3. Class III requirements:

a. During Construction Work:

- 1) Obtain permit from the COR
- 2) Remove or Isolate HVAC system in area where work is being done to prevent contamination of duct system.
- 3) Complete all critical barriers i.e. sheetrock, plywood, plastic, to seal area from non-work area or implement control cube method (cart with plastic covering and sealed connection to work site with HEPA vacuum for vacuuming prior to exit) before construction begins. Install construction barriers and ceiling protection carefully, outside of normal work hours.
- 4) Maintain negative air pressure, 0.01 inches of water gauge, within work site utilizing HEPA equipped air filtration units and continuously monitored with a digital display, recording



and alarm instrument, which must be calibrated on installation, maintained with periodic calibration and monitored by the contractor.

- 5) Contain construction waste before transport in tightly covered containers.
- 6) Cover transport receptacles or carts. Tape covering unless solid lid.

b. Upon Completion:

- 1) Do not remove barriers from work area until completed project is inspected by the COR and thoroughly cleaned by the VA Environmental Services Department.
- 2) Remove construction barriers and ceiling protection carefully to minimize spreading of dirt and debris associated with construction, outside of normal work hours.
- 3) Vacuum work area with HEPA filtered vacuums.
- 4) Wet mop area with cleaner/disinfectant.
- 5) Upon completion, restore HVAC system where work was performed.
- 6) Return permit to the COR

4. Class IV requirements:

a. During Construction Work:

- 1) Obtain permit from the COR
- 2) Isolate HVAC system in area where work is being done to prevent contamination of duct system.
- 3) Complete all critical barriers i.e. sheetrock, plywood, plastic, to seal area from non work area or implement control cube method (cart with plastic covering and sealed connection to work site with HEPA vacuum for vacuuming prior to exit) before construction begins. Install construction barriers and ceiling protection carefully, outside of normal work hours.

- 4) Maintain negative air pressure, 0.01 inches of water gauge, within work site utilizing HEPA equipped air filtration units and continuously monitored with a digital display, recording and alarm instrument, which must be calibrated on installation, maintained with periodic calibration and monitored by the contractor.
- 5) Seal holes, pipes, conduits, and punctures.
- 6) Construct anteroom and require all personnel to pass through this room so they can be vacuumed using a HEPA vacuum cleaner before leaving work site or they can wear cloth or paper coveralls that are removed each time they leave work site.
- 7) All personnel entering work site are required to wear shoe covers. Shoe covers must be changed each time the worker exits the work area.

b. Upon Completion:

- 1) Do not remove barriers from work area until completed project is inspected by the COR with thorough cleaning by the VA Environmental Services Dept.
- 2) Remove construction barriers and ceiling protection carefully to minimize spreading of dirt and debris associated with construction, outside of normal work hours.
- 3) Contain construction waste before transport in tightly covered containers.
- 4) Cover transport receptacles or carts. Tape covering unless solid lid.
- 5) Vacuum work area with HEPA filtered vacuums.
- 6) Wet mop area with cleaner/disinfectant.
- 7) Upon completion, restore HVAC system where work was performed.
- 8) Return permit to the COR

C. Barriers shall be erected as required based upon classification (Class III & IV requires barriers) and shall be constructed as follows:

1. Class III and IV - closed door with masking tape applied over the frame and door is acceptable for projects that can be contained in a single room.
2. Construction, demolition or reconstruction not capable of containment within a single room must have the following barriers erected and made presentable on hospital occupied side:
  - a. Class III & IV (where dust control is the only hazard, and an agreement is reached with the COR and Medical Center) - Airtight plastic barrier that extends from the floor to ceiling. Seams must be sealed with duct tape to prevent dust and debris from escaping
  - b. Class III & IV - Drywall barrier erected with joints covered or sealed to prevent dust and debris from escaping.
  - c. Class III & IV - Seal all penetrations in existing barrier airtight
  - d. Class III & IV - Barriers at penetration of ceiling envelopes, chases and ceiling spaces to stop movement air and debris
  - e. Class IV only - Anteroom or double entrance openings that allow workers to remove protective clothing or vacuum off existing clothing
  - f. Class III & IV - At elevators shafts or stairways within the field of construction, overlapping flap minimum of two feet wide of polyethylene enclosures for personnel access.

D. Products and Materials:

1. Sheet Plastic: Fire retardant polystyrene, 6-mil thickness meeting local fire codes
2. Barrier Doors: Self Closing One-hour fire-rated solid core wood in steel frame, painted
3. Dust proof one-hour fire-rated drywall
4. High Efficiency Particulate Air-Equipped filtration machine rated at 95% capture of 0.3 microns including pollen, mold spores and dust particles. HEPA filters should have ASHRAE 85 or other prefilter to

- extend the useful life of the HEPA. Provide both primary and secondary filtrations units. Maintenance of equipment and replacement of the HEPA filters and other filters will be in accordance with manufacturer's instructions.
5. Exhaust Hoses: Heavy duty, flexible steel reinforced; Ventilation Blower Hose
  6. Adhesive Walk-off Mats: Provide minimum size mats of 24 inches x 36 inches
  7. Disinfectant: Hospital-approved disinfectant or equivalent product
  8. Portable Ceiling Access Module
- E. Before any construction on site begins, all contractor personnel involved in the construction or renovation activity shall be educated and trained in infection prevention measures established by the medical center.
- F. A dust control program will be establish and maintained as part of the contractor's infection preventive measures in accordance with the FGI Guidelines for Design and Construction of Healthcare Facilities. Prior to start of work, prepare a plan detailing project-specific dust protection measures with associated product data, including periodic status reports, and submit to COR for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.
- G. Medical center Infection Control personnel will monitor for airborne disease (e.g. aspergillosis) during construction. A baseline of conditions will be established by the medical center prior to the start of work and periodically during the construction stage to determine impact of construction activities on indoor air quality with safe thresholds established.
- H. In general, the following preventive measures shall be adopted during construction to keep down dust and prevent mold.
1. Contractor shall verify that construction exhaust to exterior is not reintroduced to the medical center through intake vents, or building

- openings. HEPA filtration is required where the exhaust dust may reenter the medical center.
2. Exhaust hoses shall be exhausted so that dust is not reintroduced to the medical center.
  3. Adhesive Walk-off/Carpet Walk-off Mats shall be used at all interior transitions from the construction area to occupied medical center area. These mats shall be changed as often as required to maintain clean work areas directly outside construction area at all times.
  4. Vacuum and wet mop all transition areas from construction to the occupied medical center at the end of each workday. Vacuum shall utilize HEPA filtration. Maintain surrounding area frequently. Remove debris as it is created. Transport these outside the construction area in containers with tightly fitting lids.
  5. The contractor shall not haul debris through patient-care areas without prior approval of the COR and the Medical Center. When, approved, debris shall be hauled in enclosed dust proof containers or wrapped in plastic and sealed with duct tape. No sharp objects should be allowed to cut through the plastic. Wipe down the exterior of the containers with a damp rag to remove dust. All equipment, tools, material, etc. transported through occupied areas shall be made free from dust and moisture by vacuuming and wipe down.
  6. There shall be no standing water during construction. This includes water in equipment drip pans and open containers within the construction areas. All accidental spills must be cleaned up and dried within 12 hours. Remove and dispose of porous materials that remain damp for more than 72 hours.
  7. At completion, remove construction barriers and ceiling protection carefully, outside of normal work hours. Vacuum and clean all surfaces free of dust after the removal.

I. Final Cleanup:

1. Upon completion of project, or as work progresses, remove all construction debris from above ceiling, vertical shafts and utility chases that have been part of the construction.

2. Perform HEPA vacuum cleaning of all surfaces in the construction area. This includes walls, ceilings, cabinets, furniture (built-in or free standing), partitions, flooring, etc.
3. All new air ducts shall be cleaned prior to final inspection.

### **1.13 FIRE SAFETY**

- A. Fire Safety Plan: Establish and maintain a site-specific fire protection program in accordance with 29 CFR 1926. Prior to start of work, prepare a plan detailing project-specific fire safety measures, including periodic status reports, and submit to COR for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES. This plan may be an element of the Accident Prevention Plan.
- B. Site and Building Access: Maintain free and unobstructed access to facility emergency services and for fire, police and other emergency response forces in accordance with NFPA 241.
- C. Separate temporary facilities, such as trailers, storage sheds, and dumpsters, from existing buildings and new construction by distances in accordance with NFPA 241. For small facilities with less than 6 m (20 feet) exposing overall length, separate by 3m (10 feet).
- D. Temporary Construction Partitions:
  1. Install and maintain temporary construction partitions to provide smoke-tight separations between construction areas and adjoining areas. Construct partitions of gypsum board or treated plywood (flame spread rating of 25 or less in accordance with ASTM E84) on both sides of fire retardant treated wood or metal steel studs. Extend the partitions through suspended ceilings to floor slab deck or roof. Seal joints and penetrations. At door openings, install Class C, ¾ hour fire/smoke rated doors with self-closing devices.
  2. Install one-hour fire-rated temporary construction partitions as shown on drawings to maintain integrity of existing exit stair enclosures, exit passageways, fire-rated enclosures of hazardous areas, horizontal exits, smoke barriers, vertical shafts and openings enclosures.

3. Close openings in smoke barriers and fire-rated construction to maintain fire ratings. Seal penetrations with listed through-penetration firestop materials in accordance with Section 07 84 00, FIRESTOPPING.
- E. Temporary Heating and Electrical: Install, use and maintain installations in accordance with 29 CFR 1926, NFPA 241 and NFPA 70.
- F. Means of Egress: Do not block exiting for occupied buildings, including paths from exits to roads. Minimize disruptions and coordinate with COR.
- G. Egress Routes for Construction Workers: Maintain free and unobstructed egress. Inspect daily. Report findings and corrective actions weekly to COR.
- H. Fire Extinguishers: Provide and maintain extinguishers in construction areas and temporary storage areas in accordance with 29 CFR 1926, NFPA 241 and NFPA 10.
- I. Flammable and Combustible Liquids: Store, dispense and use liquids in accordance with 29 CFR 1926, NFPA 241 and NFPA 30.
- J. Sprinklers: Install, test and activate new automatic sprinklers prior to removing existing sprinklers.
- K. Existing Fire Protection: Do not impair automatic sprinklers, smoke and heat detection, and fire alarm systems, except for portions immediately under construction, and temporarily for connections. Provide fire watch for impairments more than 4 hours in a 24-hour period. Request interruptions in accordance with Article, OPERATIONS AND STORAGE AREAS, and coordinate with COR. All existing or temporary fire protection systems (fire alarms, sprinklers) located in construction areas shall be tested as coordinated with the medical center. Parameters for the testing and results of any tests performed shall be recorded by the medical center and copies provided to the COR.
- L. Smoke Detectors: Prevent accidental operation. Remove temporary covers at end of work operations each day. Coordinate with COR.
- M. Hot Work: Perform and safeguard hot work operations in accordance with NFPA 241 and NFPA 51B. Coordinate with COR. Designate contractor's

responsible project-site fire prevention program manager to permit hot work.

- N. Fire Hazard Prevention and Safety Inspections: Inspect entire construction areas weekly. Coordinate with, and report findings and corrective actions weekly to COR.
- O. Smoking: Smoking is prohibited in and adjacent to construction areas inside existing buildings and additions under construction. In separate and detached buildings under construction, smoking is prohibited except in designated smoking rest areas.
- P. Dispose of waste and debris in accordance with NFPA 241. Remove from buildings daily.
- Q. If required, submit documentation to the COR that personnel have been trained in the fire safety aspects of working in areas with impaired structural or compartmentalization features.

#### **1.14 ELECTRICAL**

- A. All electrical work shall comply with NFPA 70 (NEC), NFPA 70B, NFPA 70E, 29 CFR Part 1910 Subpart J - General Environmental Controls, 29 CFR Part 1910 Subpart S - Electrical, and 29 CFR 1926 Subpart K in addition to other references required by contract.
- B. All qualified persons performing electrical work under this contract shall be licensed journeyman or master electricians. All apprentice electricians performing under this contract shall be deemed unqualified persons unless they are working under the immediate supervision of a licensed electrician or master electrician.
- C. All electrical work will be accomplished de-energized and in the Electrically Safe Work Condition ( refer to NFPA 70E for Work Involving Electrical Hazards, including Exemptions to Work Permit). Any Contractor, subcontractor or temporary worker who fails to fully comply with this requirement is subject to immediate termination in accordance with FAR clause 52.236-5(c). Only in rare circumstance where achieving an electrically safe work condition prior to beginning work would increase or cause additional hazards, or is infeasible due to equipment design or operational limitations is energized work permitted. The COR with approval of the Medical Center Director will make the



determination if the circumstances would meet the exception outlined above. An AHA and permit specific to energized work activities will be developed, reviewed, and accepted by the VA prior to the start of that activity.

1. Development of a Hazardous Electrical Energy Control Procedure is required prior to de-energization. A single Simple Lockout/Tagout Procedure for multiple work operations can only be used for work involving qualified person(s) de-energizing one set of conductors or circuit part source. Task specific Complex Lockout/Tagout Procedures are required at all other times.
  2. Verification of the absence of voltage after de-energization and lockout/tagout is considered "energized electrical work" (live work) under NFPA 70E, and shall only be performed by qualified persons wearing appropriate shock protective (voltage rated) gloves and arc rate personal protective clothing and equipment, using Underwriters Laboratories (UL) tested and appropriately rated contact electrical testing instruments or equipment appropriate for the environment in which they will be used.
  3. Personal Protective Equipment (PPE) and electrical testing instruments will be readily available for inspection by the COR
- D. Before beginning any electrical work, an Activity Hazard Analysis (AHA) will be conducted to include Shock Hazard and Arc Flash Hazard analyses (NFPA Tables can be used only as a last alternative and it is strongly suggested a full Arc Flash Hazard Analyses be conducted). Work shall not begin until the AHA for the work activity and permit for energized work has been reviewed and accepted by the COR and discussed with all engaged in the activity, including the Contractor, subcontractor(s), and Government on-site representatives at preparatory and initial control phase meetings.
- E. Ground-fault circuit interrupters. GFCI protection shall be provided where an employee is operating or using cord- and plug-connected tools related to construction activity supplied by 125-volt, 15-, 20-, or 30-ampere circuits. Where employees operate or use equipment supplied by greater than 125-volt, 15-, 20-, or 30- ampere circuits, GFCI protection or an assured equipment grounding conductor program shall be

implemented in accordance with NFPA 70E - 2015, Chapter 1, Article 110.4(C)(2)

#### **1.15 FALL PROTECTION**

- A. The fall protection (FP) threshold height requirement is 6 ft (1.8 m) for ALL WORK, unless specified differently or the OSHA 29 CFR 1926 requirements are more stringent, to include steel erection activities, systems-engineered activities (prefabricated) metal buildings, residential (wood) construction and scaffolding work.
1. The use of a Safety Monitoring System (SMS) as a fall protection method is prohibited.
  2. The use of Controlled Access Zone (CAZ) as a fall protection method is prohibited.
  3. A Warning Line System (WLS) may ONLY be used on floors or flat or low-sloped roofs (between 0 - 18.4 degrees or 4:12 slope) and shall be erected around all sides of the work area (See 29 CFR 1926.502(f) for construction of WLS requirements). Working within the WLS does not require FP. No worker shall be allowed in the area between the roof or floor edge and the WLS without FP. FP is required when working outside the WLS.
  4. Fall protection while using a ladder will be governed by the OSHA requirements.

#### **1.16 SCAFFOLDS AND OTHER WORK PLATFORMS**

- A. All scaffolds and other work platforms construction activities shall comply with 29 CFR 1926 Subpart L.
- B. The fall protection (FP) threshold height requirement is 6 ft (1.8 m) as stated in Section 1.16.
- C. The following hierarchy and prohibitions shall be followed in selecting appropriate work platforms.
1. Scaffolds, platforms, or temporary floors shall be provided for all work except that can be performed safely from the ground or similar footing.

2. Ladders less than 20 feet may be used as work platforms only when use of small hand tools or handling of light material is involved.
  3. Ladder jacks, lean-to, and prop-scaffolds are prohibited.
  4. Emergency descent devices shall not be used as working platforms.
- D. Contractors shall use a scaffold tagging system in which all scaffolds are tagged by the Competent Person. Tags shall be color-coded: green indicates the scaffold has been inspected and is safe to use; red indicates the scaffold is unsafe to use. Tags shall be readily visible, made of materials that will withstand the environment in which they are used, be legible and shall include:
1. The Competent Person's name and signature;
  2. Dates of initial and last inspections.
- E. Mast Climbing work platforms: When access ladders, including masts designed as ladders, exceed 20 ft (6 m) in height, positive fall protection shall be used.

**1.17 CONTROL OF HAZARDOUS ENERGY (LOCKOUT/TAGOUT)**

- A. All installation, maintenance, and servicing of equipment or machinery shall comply with 29 CFR 1910.147 except for specifically referenced operations in 29 CFR 1926 such as concrete & masonry equipment [1926.702(j)], heavy machinery & equipment [1926.600(a)(3)(i)], and process safety management of highly hazardous chemicals (1926.64). Control of hazardous electrical energy during the installation, maintenance, or servicing of electrical equipment shall comply with Section 1.15 to include NFPA 70E and other VA specific requirements discussed in the section.

**1.18 CONFINED SPACE ENTRY**

- A. All confined space entry shall comply with 29 CFR 1926, Subpart AA except for specifically referenced operations in 29 CFR 1926 such as excavations/trenches [1926.651(g)].
- B. A site-specific Confined Space Entry Plan (including permitting process) shall be developed and submitted to the COR.

### **1.19 WELDING AND CUTTING**

As specified in section 1.14, Hot Work: Perform and safeguard hot work operations in accordance with NFPA 241 and NFPA 51B. Coordinate with COR. Obtain permits from COR at least 10 days in advance.

### **1.20 LADDERS**

- A. All Ladder use shall comply with 29 CFR 1926 Subpart X.
- B. All portable ladders shall be of sufficient length and shall be placed so that workers will not stretch or assume a hazardous position.
- C. Manufacturer safety labels shall be in place on ladders
- D. Step Ladders shall not be used in the closed position
- E. Top steps or cap of step ladders shall not be used as a step
- F. Portable ladders, used as temporary access, shall extend at least 3 ft (0.9 m) above the upper landing surface.
  - 1. When a 3 ft (0.9-m) extension is not possible, a grasping device (such as a grab rail) shall be provided to assist workers in mounting and dismounting the ladder.
  - 2. In no case shall the length of the ladder be such that ladder deflection under a load would, by itself, cause the ladder to slip from its support.
- G. Ladders shall be inspected for visible defects on a daily basis and after any occurrence that could affect their safe use. Broken or damaged ladders shall be immediately tagged "DO NOT USE," or with similar wording, and withdrawn from service until restored to a condition meeting their original design.

### **1.21 FLOOR & WALL OPENINGS**

- A. All floor and wall openings shall comply with 29 CFR 1926 Subpart M.
- B. Floor and roof holes/openings are any that measure over 2 in (51 mm) in any direction of a walking/working surface which persons may trip or fall into or where objects may fall to the level below. Skylights located in floors or roofs are considered floor or roof hole/openings.

- C. All floor, roof openings or hole into which a person can accidentally walk or fall through shall be guarded either by a railing system with toeboards along all exposed sides or a load-bearing cover. When the cover is not in place, the opening or hole shall be protected by a removable guardrail system or shall be attended when the guarding system has been removed, or other fall protection system.
1. Covers shall be capable of supporting, without failure, at least twice the weight of the worker, equipment and material combined.
  2. Covers shall be secured when installed, clearly marked with the word "HOLE", "COVER" or "Danger, Roof Opening-Do Not Remove" or color-coded or equivalent methods (e.g., red or orange "X"). Workers must be made aware of the meaning for color coding and equivalent methods.
  3. Roofing material, such as roofing membrane, insulation or felts, covering or partly covering openings or holes, shall be immediately cut out. No hole or opening shall be left unattended unless covered.
  4. Non-load-bearing skylights shall be guarded by a load-bearing skylight screen, cover, or railing system along all exposed sides.
  5. Workers are prohibited from standing/walking on skylights.

- - - E N D - - -

**SECTION 01 42 19**  
**REFERENCE STANDARDS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

This section specifies the availability and source of references and standards specified in the project manual under paragraphs APPLICABLE PUBLICATIONS and/or shown on the drawings.

**1.2 AVAILABILITY OF SPECIFICATIONS LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS FPMR PART 101-29 (FAR 52.211-1) (AUG 1998)**

- A. The GSA Index of Federal Specifications, Standards and Commercial Item Descriptions, FPMR Part 101-29 and copies of specifications, standards, and commercial item descriptions cited in the solicitation may be obtained for a fee by submitting a request to - GSA Federal Supply Service, Specifications Section, Suite 8100, 470 East L'Enfant Plaza, SW, Washington, DC 20407, Telephone (202) 619-8925, Facsimile (202) 619-8978.
- B. If the General Services Administration, Department of Agriculture, or Department of Veterans Affairs issued this solicitation, a single copy of specifications, standards, and commercial item descriptions cited in this solicitation may be obtained free of charge by submitting a request to the addressee in paragraph (a) of this provision. Additional copies will be issued for a fee.

**1.3 AVAILABILITY FOR EXAMINATION OF SPECIFICATIONS NOT LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS (FAR 52.211-4) (JUN 1988)**

The specifications and standards cited in this solicitation can be examined at the following location:

DEPARTMENT OF VETERANS AFFAIRS  
Office of Construction & Facilities Management  
Facilities Quality Service (00CFM1A)  
425 Eye Street N.W, (sixth floor)  
Washington, DC 20001  
Telephone Numbers: (202) 632-5249 or (202) 632-5178  
Between 9:00 AM - 3:00 PM

**1.4 AVAILABILITY OF SPECIFICATIONS NOT LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS (FAR 52.211-3) (JUN 1988)**

The specifications cited in this solicitation may be obtained from the associations or organizations listed below.

- AA Aluminum Association Inc.  
<http://www.aluminum.org>
- AABC Associated Air Balance Council  
<http://www.aabchq.com>
- AAMA American Architectural Manufacturer's Association  
<http://www.aamanet.org>
- AAN American Nursery and Landscape Association  
<http://www.anla.org>
- AASHTO American Association of State Highway and Transportation Officials  
<http://www.aashto.org>
- AATCC American Association of Textile Chemists and Colorists  
<http://www.aatcc.org>
- ACGIH American Conference of Governmental Industrial Hygienists  
<http://www.acgih.org>
- ACI American Concrete Institute  
<http://www.aci-int.net>
- ACPA American Concrete Pipe Association  
<http://www.concrete-pipe.org>
- ACPPA American Concrete Pressure Pipe Association  
<http://www.acppa.org>
- ADC Air Diffusion Council  
<http://flexibleduct.org>
- AGA American Gas Association  
<http://www.aga.org>
- AGC Associated General Contractors of America  
<http://www.agc.org>

AGMA American Gear Manufacturers Association, Inc.  
<http://www.agma.org>

AHAM Association of Home Appliance Manufacturers  
<http://www.aham.org>

AIA American Institute of Architects  
<http://www.aia.org>

AISC American Institute of Steel Construction  
<http://www.aisc.org>

AISI American Iron and Steel Institute  
<http://www.steel.org>

AITC American Institute of Timber Construction  
<http://www.aitc-glulam.org>

AMCA Air Movement and Control Association, Inc.  
<http://www.amca.org>

ANLA American Nursery & Landscape Association  
<http://www.anla.org>

ANSI American National Standards Institute, Inc.  
<http://www.ansi.org>

APA The Engineered Wood Association  
<http://www.apawood.org>

ARI Air-Conditioning and Refrigeration Institute  
<http://www.ari.org>

ASAE American Society of Agricultural Engineers  
<http://www.asae.org>

ASCE American Society of Civil Engineers  
<http://www.asce.org>

ASHRAE American Society of Heating, Refrigerating, and  
Air-Conditioning Engineers  
<http://www.ashrae.org>



ASME American Society of Mechanical Engineers  
<http://www.asme.org>

ASSE American Society of Sanitary Engineering  
<http://www.asse-plumbing.org>

ASTM American Society for Testing and Materials  
<http://www.astm.org>

AWI Architectural Woodwork Institute  
<http://www.awinet.org>

AWS American Welding Society  
<http://www.aws.org>

AWWA American Water Works Association  
<http://www.awwa.org>

BHMA Builders Hardware Manufacturers Association  
<http://www.buildershardware.com>

BIA Brick Institute of America  
<http://www.bia.org>

CAGI Compressed Air and Gas Institute  
<http://www.cagi.org>

CGA Compressed Gas Association, Inc.  
<http://www.cganet.com>

CI The Chlorine Institute, Inc.  
<http://www.chlorineinstitute.org>

CISCA Ceilings and Interior Systems Construction Association  
<http://www.cisca.org>

CISPI Cast Iron Soil Pipe Institute  
<http://www.cispi.org>

CLFMI Chain Link Fence Manufacturers Institute  
<http://www.chainlinkinfo.org>

CPMB Concrete Plant Manufacturers Bureau  
<http://www.cpmc.org>

CRA California Redwood Association  
<http://www.calredwood.org>

CRSI Concrete Reinforcing Steel Institute  
<http://www.crsi.org>

CTI Cooling Technology Institute  
<http://www.cti.org>

DHI Door and Hardware Institute  
<http://www.dhi.org>

EGSA Electrical Generating Systems Association  
<http://www.egsa.org>

EEI Edison Electric Institute  
<http://www.eei.org>

EPA Environmental Protection Agency  
<http://www.epa.gov>

ETL ETL Testing Laboratories, Inc.  
<http://www.etl.com>

FAA Federal Aviation Administration  
<http://www.faa.gov>

FCC Federal Communications Commission  
<http://www.fcc.gov>

FPS The Forest Products Society  
<http://www.forestprod.org>

GANA Glass Association of North America  
<http://www.cssinfo.com/info/gana.html/>

FM Factory Mutual Insurance  
<http://www.fmglobal.com>

GA Gypsum Association  
<http://www.gypsum.org>

GSA General Services Administration  
<http://www.gsa.gov>

HI Hydraulic Institute  
<http://www.pumps.org>

HPVA Hardwood Plywood & Veneer Association  
<http://www.hpva.org>

ICBO International Conference of Building Officials  
<http://www.icbo.org>

ICEA Insulated Cable Engineers Association Inc.  
<http://www.icea.net>

\ICAC Institute of Clean Air Companies  
<http://www.icac.com>

IEEE Institute of Electrical and Electronics Engineers  
<http://www.ieee.org>

IMSA International Municipal Signal Association  
<http://www.imsasafety.org>

IPCEA Insulated Power Cable Engineers Association

NBMA Metal Buildings Manufacturers Association  
<http://www.mbma.com>

MSS Manufacturers Standardization Society of the Valve and Fittings  
Industry Inc.  
<http://www.mss-hq.com>

NAAMM National Association of Architectural Metal Manufacturers  
<http://www.naamm.org>

NAPHCC Plumbing-Heating-Cooling Contractors Association  
<http://www.phccweb.org.org>

NBS National Bureau of Standards  
See - NIST

NBBPVI National Board of Boiler and Pressure Vessel Inspectors  
<http://www.nationboard.org>

NEC National Electric Code  
See - NFPA National Fire Protection Association

NEMA National Electrical Manufacturers Association  
<http://www.nema.org>

NFPA National Fire Protection Association  
<http://www.nfpa.org>

NHLA National Hardwood Lumber Association  
<http://www.natlhardwood.org>

NIH National Institute of Health  
<http://www.nih.gov>

NIST National Institute of Standards and Technology  
<http://www.nist.gov>

NLMA Northeastern Lumber Manufacturers Association, Inc.  
<http://www.nelma.org>

NPA National Particleboard Association  
18928 Premiere Court  
Gaithersburg, MD 20879  
(301) 670-0604

NSF National Sanitation Foundation  
<http://www.nsf.org>

NWWDA Window and Door Manufacturers Association  
<http://www.nwwda.org>

OSHA Occupational Safety and Health Administration  
Department of Labor  
<http://www.osha.gov>

PCA Portland Cement Association  
<http://www.portcement.org>

PCI Precast Prestressed Concrete Institute  
<http://www.pci.org>

PPI The Plastic Pipe Institute  
<http://www.plasticpipe.org>

PEI Porcelain Enamel Institute, Inc.  
<http://www.porcelainenamel.com>

PTI Post-Tensioning Institute  
<http://www.post-tensioning.org>

RFCI The Resilient Floor Covering Institute  
<http://www.rfci.com>

RIS Redwood Inspection Service  
See - CRA

RMA Rubber Manufacturers Association, Inc.  
<http://www.rma.org>

SCMA Southern Cypress Manufacturers Association  
<http://www.cypressinfo.org>

SDI Steel Door Institute  
<http://www.steeldoor.org>

SOI Secretary of the Interior  
[http://www.cr.nps.gov/local-law/arch\\_stnds\\_8\\_2.htm](http://www.cr.nps.gov/local-law/arch_stnds_8_2.htm)

IGMA Insulating Glass Manufacturers Alliance  
<http://www.igmaonline.org>

SJI Steel Joist Institute  
<http://www.steeljoist.org>

SMACNA Sheet Metal and Air-Conditioning Contractors  
National Association, Inc.  
<http://www.smacna.org>

SSPC The Society for Protective Coatings  
<http://www.sspc.org>

STI Steel Tank Institute  
<http://www.steeltank.com>

SWI Steel Window Institute  
<http://www.steelwindows.com>

TCA Tile Council of America, Inc.  
<http://www.tileusa.com>

TEMA Tubular Exchange Manufacturers Association  
<http://www.tema.org>

TPI Truss Plate Institute, Inc.  
583 D'Onofrio Drive; Suite 200  
Madison, WI 53719  
(608) 833-5900

UBC The Uniform Building Code  
See ICBO

UL Underwriters' Laboratories Incorporated  
<http://www.ul.com>

ULC Underwriters' Laboratories of Canada  
<http://www.ulc.ca>

WCLIB West Coast Lumber Inspection Bureau  
6980 SW Varns Road, P.O. Box 23145  
Portland, OR 97223  
(503) 639-0651

WRCLA Western Red Cedar Lumber Association  
P.O. Box 120786  
New Brighton, MN 55112  
(612) 633-4334

WWPA Western Wood Products Association  
<http://www.wwpa.org>

- - - E N D - - -

**SECTION 01 45 00**  
**QUALITY CONTROL**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

This section specifies requirements for Contractor Quality Control (CQC) for Design-Bid-Build (DBB) construction projects.

**1.2 APPLICABLE PUBLICATIONS**

- A. The publication listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.
- B. ASTM International (ASTM)
  - 1. ASTM D3740 - (2012a) Minimum Requirements for Agencies Engaged in the Testing and/or Inspection of Soil and Rock as Used in Engineering Design and Construction
  - 2. ASTM E29 - (2014a) Standard Specification for Agencies Engaged in the Testing and/or Inspection of Materials Used in Construction

**1.3 SUBMITTALS**

Government approval is required for all submittals. CQC inspection reports shall be submitted under this Specification section and follow the [Applicable Specification section] naming convention.

- 1. Preconstruction Submittals
  - a. Interim CQC Plan
  - b. CQC Plan
  - c. Additional Requirements for Design Quality Control (DQC) Plan
- 2. Design Data
  - a. Discipline-Specific Checklists
  - b. Design Quality Control
- 3. Test Reports
  - a. Verification Statement

**PART 2 PRODUCTS - NOT USED**

**PART 3 - EXECUTION**

**3.1 GENERAL REQUIREMENTS**

Establish and maintain an effective quality control (QC) system that complies with the FAR Clause 52.246.12 titled "Inspection of Construction". QC consists of plans, procedures, and organization

necessary to produce an end product which complies with the Contract requirements. The QC system covers all design and construction operations, both onsite and offsite, and be keyed to the proposed design and construction sequence. The project superintendent will be held responsible for the quality of work and is subject to removal by the Contracting Office or Authorized designee for non-compliance with the quality requirements specified in the Contract. In this context the highest level manager responsible for the overall construction activities at the site, including quality and production is the project superintendent. The project superintendent maintains a physical presence at the site at all times and is responsible for all construction and related activities at the site, except as otherwise acceptable to the Contracting Officer.

### **3.2 CQC PLAN:**

- A. 30 days after receipt of Notice to Proceed (NTP) the CQC Plan proposed to implement the requirements of the FAR Clause 52.246.12 titled "Inspection of Construction". The Government will consider an Interim CQC Plan for the first days of operation, which must be accepted within 10 business days of NTP. Design and/or construction will be permitted to begin only after acceptance of the CQC Plan or acceptance of an Interim plan applicable to the particular feature of work to be started. Work outside of the accepted Interim CQC Plan will not be permitted to begin until acceptance of a CQC Plan or another Interim CQC Plan containing the additional work scope is accepted.
- B. Content of the CQC Plan: Include, as a minimum, the following to cover all design and construction operations, both onsite and offsite, including work by subcontractors, designers of record consultants, architects/engineers (A/E), fabricators, suppliers, and purchasing agents:
  1. A description of the QC organization, including a chart showing lines of authority and acknowledgement that the CQC staff will implement the three phase control system for all aspects of the work specified. Include a CQC System Manager that reports to the project superintendent.
  2. The name, qualifications (in resume format) duties, responsibilities, and authorities of each person assigned a CQC function.



3. A copy of the letter to the CQC System Manager signed by an authorized official of the firm which describes the responsibilities and delegates sufficient authorities to adequately perform the functions of the CQC System Manager, including authority to stop work which is not in compliance with the Contract. Letters of direction to all other various quality control representatives outlining duties, authorities, and responsibilities will to the Contracting Officer or Authorized designee. be issued by the CQC System Manager. Furnish copies of these letters
4. Procedures for scheduling, reviewing, certifying, and managing submittals including those of subcontractors, designers of record, consultants, A/E's offsite fabricators, suppliers and purchasing agents. These procedures must be in accordance with Section 01 33 23 Shop Drawings, Product Data, and Samples.
5. Control, verification, and acceptance of testing procedures for each specific test to include the test name, specification paragraph requiring test, feature of work to be tested, test frequency, and person responsible for each test. (Laboratory facilities approved by the Contracting Officer or Authorized designee are required to be used)
6. Procedures for tracking Preparatory, Initial, and Follow-Up control phases and control, verification, and acceptance tests including documentation.
7. Procedures for tracking design and construction deficiencies from identification through acceptable corrective action. Establish verification procedures that identified deficiencies have been corrected.
8. Reporting procedures, including proposed reporting formats.
9. A list of the definable features of work. A definable feature of work is a task which is separate and distinct from other tasks has separate control requirements, and is identified by different trades or disciplines, or it is work by the same trade in a different environment. Although each section of specifications can generally be considered as a definable feature of work, there are frequently more than one definable feature under a particular section. This list will be agreed upon during the Coordination meeting.

**3.3 COORDINATION MEETING:**

After the Preconstruction Conference Post-award Conference before start of construction, and prior to acceptance by the Government of the CQC Plan, meet with the Contracting Officer or Authorized designee to discuss the Contractor's quality control system. Submit the CQC Plan a minimum of 5 business days prior to the Coordination Meeting. During the meeting, a mutual understanding of the system details must be developed, including the forms for recording the CC operations, design activities (if applicable), control activities, testing, administration of the system for both onsite and offsite work, and the interrelationship of Contractor's Management and control with the Government's Quality Assurance. Minutes of the meeting will be prepared by the Government, signed by both the Contractor and Contracting Officer or Authorized designee and will become a part of the contract file. There can be occasions when subsequent conferences will be called by either party to reconfirm mutual understandings or address deficiencies in the CQC system or procedures which can require corrective action by the Contractor.

**3.4 QUALITY CONTROL ORGANIZATION:**

- A. Personnel Requirements: The requirements for the CQC organization are a Safety and Health Manager, CQC System Manager, a Design Quality Manager (if applicable), and sufficient number of additional qualified personnel to ensure safety and Contract compliance. The Safety and Health Manager shall satisfy the requirements of Specification 01 35 26 Safety Requirements and reports directly to a senior project (or corporate) official independent from the CQC System Manager. The Safety and Health Manager will also serve as a member of the CQC Staff. Personnel identified in the technical provisions as requiring specialized skills to assure the required work is being performed properly will also be included as part of the CQC organization. The Contractor's CQC staff maintains a presence at the site at all times during progress of the work and have complete authority and responsibility to take any action necessary to ensure Contract compliance. The CQC staff will be subject to acceptance by the Contracting Officer or Authorized designee. Provide adequate office space, filing systems, and other resources as necessary to maintain an effective and fully functional CQC organization. Promptly complete and furnish all letters, material submittals, shop drawings submittals, schedules and all other project documentation to the CQC organization.

The CQC organization is responsible to maintain these documents and records at the site at all times, except as otherwise acceptable to the Government.

- B. CQC System Manager: Identify as CQC System Manager an individual within the onsite work organization that is responsible for overall management of CQC and has the authority to act in all CQC matters for the Contractor. The CQC system Manager is required to be a graduate engineer, graduate architect, or a graduate of construction management, with a minimum of PM or SRE to determine qualifications based on project complexity at construction review years construction experience on construction similar to the scope of this Contract. The CQC System Manger is assigned as CQC System Manager but has duties as project superintendent in addition to quality control. Identify in the plan an alternate to serve in the event of the CDQC System Manager's absence. The requirements for the alternate are the same as the CQC System Manager.
- C. CQC Personnel: In addition to CQC personnel specified elsewhere in the contract, provide as part of the CQC organization specialized personnel to assist in the CQC System Manager for the following areas, as applicable: electrical, mechanical, civil, structural, environmental, architectural, materials technician submittals clerk, Commissioning Agent/LEED specialist, and low voltage systems. These individuals or specified technical companies are employees of the prime or subcontractor; be responsible to the CQC System Manager; be physically present at the construction site during work on the specialized personnel's areas of responsibility; have the necessary education or experience in accordance with the Experience Matrix listed herein. These individuals can perform other duties but need to be allowed sufficient time to perform the specialized personnel's assigned quality controls duties as described in the CQC Plan.

### EXPERIENCE MATRIX

Area	Qualifications
Civil	Graduate Civil Engineer or Construction Manager with 2 years experience in the type of work being performed on this project or technician with 5 years related experience.

Area	Qualifications
Mechanical	Graduate Mechanical Engineer with 2 years experience or construction professional with 5 years of experience supervising mechanical features of work in the field with a construction company.
Electrical	Graduate Electrical Engineer with 2 years related experience or construction professional with 5 years of experience supervising electrical features of work in the field with a construction company.
Structural	Graduate Civil Engineer (with Structural Track or Focus), Structural Engineer, or Construction Manager with 2 years experience or construction professional with 5 years experience supervising structural features of work in the field with a construction company.
Architectural	Graduate Architect with 2 years experience or construction professional with 5 years of related experience.
Environmental	Graduate Environmental Engineer with 3 years experience.
Submittals	Submittal Clerk with 1 year experience.
Concrete, Pavement, and Soils	Materials Technician with 2 years experience for the appropriate area.
Testing, Adjusting, and Balancing (TAB)	Specialist must be a member of AABC or an experienced technician of the firm certified by the NEBB.
Design Quality Control Manager	Registered Architect or Professional Engineer

D. Additional Requirements: In addition to the above experience and education requirements, the CQC System Manager and Alternate CQC System Manager are required to have completed the Construction Quality Management (CQM) for Construction course. If the CQC System Manager does not have a current specification, obtain the CQM for Contractors course identification within 90 days of award. This course is periodically offered by the Naval Facilities Engineering Command and the Army Corps of Engineers. Contact the Contracting Officer or Authorized designee for information on the next scheduled class.

E. Organizational Changes: Maintain the CQC staff at full strength at all times. When it is necessary to make changes to the CQC staff, revise the CQC Plan to reflect the changes and submit the changes to the Contracting Officer or Authorized designee for acceptance.

**3.5 SUBMITTALS AND DELIVERABLES:** Submittals have to comply with the requirements in Section 01 33 23 Shop Drawings, Product Data, and Samples. The CQC organization is responsible for certifying that all submittals and deliverables are in compliance with the contract requirements.

**3.6 CONTROL:**

A. CQC is the means by which the Contractor ensures that the construction, to include that of subcontractors and suppliers, complies with the requirements of the contract. At least three phases of control are required to be conducted by the CQC System Manager for each definable feature of the construction work as follows:

1. Preparatory Phase: This phase is performed prior to beginning work on each definable feature of work after all required plans/documents/materials are approved/accepted, and after copies are at the work site. This phase includes:
  - a. A review of each paragraph of applicable specifications, references codes, and standards. Make available during the preparatory inspection a copy of those sections of referenced codes and standards applicable to that portion of the work to be accomplished in the field. Maintain and make available in the field for use by Government personnel until final acceptance of the work.
  - b. Review of the Contract drawings.
  - c. Check to assure that all materials and equipment have been tested, submitted, and approved.
  - d. Review of provisions that have been made to provide required control inspection and testing.
  - e. Examination of the work area to assure that all required preliminary work has been completed and is in compliance with the Contract.
  - f. Examination of required materials, equipment, and sample work to assure that they are on hand conform to approved shop drawings or submitted data, and are properly stored.

- g. Review of the appropriate Activity Hazard Analysis (AHA) to assure safety requirements are met.
  - i. Discussion of procedures for controlling quality of the work including repetitive deficiencies. Document construction tolerances and workmanship standards - contract defined or industry standard if not contract defined - for that feature of work.
  - j. Check to ensure that the portion of the plan for the work to be performed has been accepted by the Contracting Officer.
  - k. Discussion of the initial control phase.
  - l. The Government needs to be notified at least 48 hours or 2 business days in advance of beginning the Preparatory control phase. Include a meeting conducted by the CQC System Manager and attended by the superintendent, other CQC personnel (as applicable), and the foreman responsible for the definable feature. Document the results of the Preparatory phase actions by separate minutes prepared by the CQC System Manager and attach to the daily CQC report. Instruct applicable workers as to the acceptable level of workmanship required in order to meet contract specifications.
- B. Initial Phase: This phase is accomplished at the beginning of a definable feature of work. Accomplish the following:
1. Check work to ensure that it is in full compliance with contract requirements. Review minutes of the Preparatory meeting.
  2. Verify adequacy of controls to ensure full contract compliance. Verify the required control inspection and testing is in compliance with the contract.
  3. Establish level of workmanship and verify that it meets minimum acceptable workmanship standards. Compare with required sample panels as appropriate.
  4. Resolve all differences.
  5. Check safety to include compliance with an upgrading of the safety plan and activity hazard analysis. Review the activity analysis with each worker.
  6. The Government needs to be notified at least 48 hours or 2 business days in advance of beginning the initial phase for definable features of work. Prepare separate minutes of this phase by the CQC System Manager and attach to the daily CQC report. Indicate the

exact location of initial phase for definable feature of work for future reference and comparison with Follow-Up phases.

7. The initial phase for each definable feature of work is repeated for each new crew to work onsite, or any time acceptable specified quality standards are not being met.
- C. Follow-Up Phase: Perform daily checks to assure control activities, including control testing, are providing continued compliance with contract requirements until the completion of the particular feature of work. Record the checks in the CQC documentation. Conduct final Follow-Up checks and correct all deficiencies prior to the start of additional features of work which may be affected by the deficient work. Do not build upon nor conceal non-conforming work.
- D. Additional Preparatory and Initial Phases on the same definable features of work if: the quality ongoing work is unacceptable; if there are changes in the applicable CQC staff, onsite production supervision or work crew; if work on a definable feature is resumed after a substantial period of inactivity, or if other problems develop.

### 3.7 TESTS

- A. Testing Procedure: Perform specified or required tests to verify that control measures are adequate to provide a product which conforms to contract requirements. Upon request, furnish to the Government duplicate samples of test specimens for possible testing by the Government. Testing includes operation and acceptance test when specified. Procure the services of a Department of Veteran Affairs approved testing laboratory or establish an approved testing laboratory at the project site. Perform the following activities and record and provide the following data:
1. Verify that testing procedures comply with contract requirements.
  2. Verify that facilities and testing equipment are available and comply with testing standards.
  3. Check test instrument calibration data against certified standards.
  4. Verify that recording forms and test identification control number system, including all of the test documentation requirements, have been prepared.
  5. Record results of all tests taken, both passing and failing on the CQC report for the date taken. Specification paragraph reference, location where tests were taken, and the unique sequential control number identifying the test. If approved by the Contracting Officer

or Authorized designee, actual test reports are submitted later with a reference to the test number and date taken. Provide an information copy of tests performed by an offsite or commercial test facility directly to the Contracting Officer or Authorized designee. Failure to submit timely test reports as stated results in nonpayment for related work performed and disapproval of the test facility for this Contract.

### **3.8 COMPLETION INSPECTION**

- A. Punch-Out Inspection: Conduct an inspection of the work by the CQC system Manager near the end of the work, or any increment of the work established by a time stated FAR 52.211-10 - Commencement, Prosecution, and Completion of Work, or by the specifications. Prepare and include in the CQC documentation a punch list of items which do not conform to the approved drawings and specifications. Include within the list of deficiencies the estimated date by which the deficiencies will be corrected. Make a second inspection the CQC System Manager or staff to ascertain that all deficiencies have been corrected. Once this is accomplished, notify the Government that the facility is ready for the Government Pre-Final Inspection.
  
- B. Pre-Final Inspection: The Government will perform the Pre-Final Inspection to verify that the facility is complete and ready to be occupied. A Government Pre-Final Punch List may be developed as a result of this inspection. Ensure that all items on this list have been corrected before notifying the Government, so that a Final Acceptance Inspection with the customer can be scheduled. Correct any items noted on the Pre-Final Inspection in a timely manner. These inspections and any deficiency corrections required by this paragraph need to be accomplished within the time slated for completion of the entire work or any particular increment of the work if the project is divided into increments by separate construction completion dates.
  
- C. Final Acceptance Inspection: The Contractor's QC Inspection personnel, plus the superintendent or other primary management person, and the Contracting Officer's Authorized designee is required to be in attendance at the Final Acceptance Inspection. Additional Government personnel can also be in attendance. The Final Acceptance Inspection



will be formally scheduled by the Contracting Officer's or Authorized designee based upon results of the Pre-Final Inspection. Notify the Contracting Officer through the COR office at least 14 days prior to the Final Acceptance Inspection and include the Contractor's assurance that all specific items previously identified to the Contractor as being unacceptable, along with all remaining work performed under the contract, will be complete and acceptable by the date schedule for the Final Acceptance Inspection. Failure of the Contractor to have all contract work acceptably complete for this inspection will be cause for the Contracting Officer to bill the Contractor for the Government's additional inspection cost in accordance with FAR Clause 52.246-12 titled "Inspection of Construction".

### 3.9 DOCUMENTATION

- A. Quality Control Activities: Maintain current records providing factual evidence that required QC activities and tests have been performed. Include in these records the work of subcontractors and suppliers on an acceptable form that includes, as a minimum, the following information:
1. The name and area of responsibility of the Contractor/Subcontractor
  2. Operating plant/equipment with hours worked, idle, or down for repair.
  3. Work performed each day, giving location, description, and by whom. When Network Analysis (NAS) is used, identify each phase of work performed each day by NAS activity number.
  4. Test and control activities performed with results and references to specification/drawing requirements. Identify the Control Phase (Preparatory, Initial, and/or Follow-Up). List deficiencies noted, along with corrective action.
  5. Quantity of materials received at the site with statement as to acceptability, storage, and reference to specification/drawing requirements.
  6. Submittals and deliverables reviewed, with Contract reference, by whom, and action taken.
  7. Offsite surveillance activities, including actions taken.
  8. Job safety evaluations stating what was checked, results, and instructions or corrective actions.
  9. Instructions given/received and conflicts in plans and specifications.

10. Provide documentation of design quality control activities. For independent design reviews, provide, as a minimum, identification of the Independent Technical Reviewer (ITR) team, the ITR review comments, responses, and the record of resolution of the comments.

B. Verification Statement: Indicate a description of trades working on the project; the number of personnel working; weather conditions encountered; and any delays encountered. Cover both conforming and deficient features and include a statement that equipment and materials incorporated in the work and workmanship comply with the Contract. Furnish the original and one copy of these records in report form to the Government daily with 1 week after the date covered by the report, except that reports need not be submitted for day son which no work is performed. As a minimum, prepare and submit on report for every 7 days of no work and on the last day of a no work period. All calendar days need to be accounted for throughout the life of the contract. The first report following a day of no work will be for that day only. Reports need to be signed and dated by the CQC System Manager. Include copies of test reports and copies of reports prepared by all subordinate QC personnel within the CQC System Manager Report.

**3.10 SAMPLE FORMS**

Can be located at [www.cm.va.gov/til/spec.asp](http://www.cm.va.gov/til/spec.asp)

**3.11 NOTIFICATION OF NONCOMPLIANCE:**

The Contracting Officer or Authorized designee will notify the Contractor of any detected noncompliance with the foregoing requirements. The Contractor should take immediate corrective action after receipt of such notice. Such notice, when delivered to the Contractor at the work site will be deemed sufficient for the purpose of notification. If the Contractor fails or refuses to comply promptly, the Contracting Officer can issue an order stopping all or part of the work until satisfactory corrective action has been taken. No part of the time lost due to such stop orders will be made the subject of claim for extension of time or for excess costs or damages by the Contractor.

--- End of Section ---

**SECTION 01 58 16**  
**TEMPORARY INTERIOR SIGNAGE**

**PART 1 GENERAL**

**DESCRIPTION**

This section specifies temporary interior signs.

**PART 2 PRODUCTS**

**2.1 TEMPORARY SIGNS**

- A. Fabricate from 50 Kg (110 pound) mat finish white paper.
- B. Cut to 100 mm (4-inch) wide by 300 mm (12 inch) long size tag.
- C. Punch 3 mm (1/8-inch) diameter hole centered on 100 mm (4-inch) dimension of tag. Edge of Hole spaced approximately 13 mm (1/2-inch) from one end on tag.
- D. Reinforce hole on both sides with gummed cloth washer or other suitable material capable of preventing tie pulling through paper edge.
- E. Ties: Steel wire 0.3 mm (0.0120-inch) thick, attach to tag with twist tie, leaving 150 mm (6-inch) long free ends.

**PART 3 EXECUTION**

**3.1 INSTALLATION**

- A. Install temporary signs attached to room door frame or room door knob, lever, or pull for doors on corridor openings.
- B. Mark on signs with felt tip marker having approximately 3 mm (1/8-inch) wide stroke for clearly legible numbers or letters.
- C. Identify room with numbers as designated on floor plans.

**3.2 LOCATION**

- A. Install on doors that have room, corridor, and space numbers shown.
- B. Doors that do not require signs are as follows:
  - 1. Corridor barrier doors (cross-corridor) in corridor with same number.
  - 2. Folding doors or partitions.
  - 3. Toilet or bathroom doors within and between rooms.
  - 4. Communicating doors in partitions between rooms with corridor entrance doors.
  - 5. Closet doors within rooms.
- C. Replace missing, damaged, or illegible signs.

- - - E N D - - -

**SECTION 01 99 99**

**PROJECT CLOSEOUT**

**PART 1 - GENERAL**

**1.1 DESCRIPTION OF REQUIREMENTS**

- A. Definitions: Closeout is hereby defined to include general requirements near the end of contract duration, in preparation for final acceptance, final payment, normal termination of contract, occupancy and similar actions evidencing completion of the work. Specific requirements for individual units of work are specified in Sections of Division 02 through 34 as applicable.
- B. Time of closeout is directly related to "Substantial Completion", and therefore may be either a single time period for entire work or a series of time periods for individual parts of the work which have been noted as substantially complete at different dates, that time variation (if any) shall be applicable to other provisions of this section.

**1.2 PREREQUISITES TO SUBSTANTIAL COMPLETION**

- A. General: Two weeks prior to requesting inspection of "substantial completion" (for either entire work or portions thereof), complete the following and list exceptions ...
1. List "substantially complete" areas for portion claimed with certifications and supporting documentation in accordance with the contract documents (properly installed and ready for operation), and itemize incomplete items (Contractor issued final "Punch List"), value of incomplete work, and reasons for being incomplete with supporting documentation.
  2. No GWB/SAT ceiling material shall be installed in the project area until "all" work above the ceiling line has been completed, tested, inspected, approved and accepted by specified agents and the VA COR in advance with "all" associated test/inspection reports issued demonstrating compliance with the contract requirements.
  3. Complete start-up testing of systems, and instructions to Government's operating/maintenance personnel. Discontinue (or change over) and remove from project site temporary facilities and services, along with construction tools, equipment, and similar elements.
- B. Inspection: Upon receipt of Contractor's request, the Contracting Officer will either proceed with inspection or advise Contractor that

prerequisites are not fulfilled. Following initial inspection, the Contracting Officer will either approve "substantial completion", or issue a "Deficiency Report" itemizing work which must be performed and repeat inspection when requested and assured that work has been substantially completed. Results of completed inspections ("Deficiency Report") will form the basis of the "Punch List" to be completed for final acceptance.

### **1.3 PREREQUISITES TO FINAL ACCEPTANCE**

- A. General: Prior to requesting final inspection for final acceptance and final payment, as required by General Provisions and Conditions, complete the following and list known exceptions (if any) ...
1. Submit final payment request with final releases and supporting documentation not previously submitted and accepted.
  2. Submit copy of Contractor final Punch List including resolution of Deficiency Reports resulting from earlier inspections stating that each item has been completed, resolved or otherwise delayed for acceptable circumstances with supporting documentation.
  3. Submit specific warranties, workmanship/maintenance bonds, maintenance agreements, final certifications and similar documents.
  4. Submit record documents in the format specified.
  5. Submit final record information (eg, electrical panel schedule, equipment data sheets).
  6. Provide tools, spare parts, extra stocks of materials, and similar physical items.
  7. Make final change-over of locks and transmit keys to the Contracting Officer and advise Government personnel of change-over in security provisions.
  8. Complete final cleaning up requirements, including touch-up painting of marred surfaces.
  9. Touch-up and otherwise repair and restore marred exposed finishes.
- B. Re-inspection: Upon receipt of Contractor's notice that all work has been completed, including resolution of Deficiency Reports resulting from earlier inspections, the Contracting Officer will re-inspect the work. Upon completion of re-inspection, the Contracting Officer will either proceed to final acceptance or issue a Punch List itemizing work not completed and obligations not fulfilled as required for final

acceptance. If necessary, re-inspection will be repeated until work is accepted.

#### 1.4 RECORD DOCUMENTS

- A. General: As work progresses, prepare and maintain record documents as specified herein. Each record shall be certified by the General Contractor. Do not use record documents for construction purposes; protect from deterioration and loss in a secure, fire-resistive location accessible to the Contracting Office for reference during normal working hours. Upon completion, turn record documents over to the Contracting Officer.
- B. Record Drawings: Maintain a white-print set (blue-line or black-line) of contract drawings (including amendment and change order drawings) and shop drawings in clean, undamaged condition, with mark-up of actual installations which vary from the work as originally shown. Mark whichever drawing is most capable of showing "field" condition fully and accurately; however, where shop drawings are used for mark-up, record a cross-reference at corresponding location on working drawings. Mark with red erasable pencil and, where feasible, use other colors to distinguish between variations in separate categories of work. Mark-up new information which is recognized to be of importance, but was for some reason not shown on either contract drawings or shop drawings. Give particular attention to concealed work, which would be difficult to measure and record at a later date. Note related CO (change order) and/or RFI numbers where applicable. Organize record drawing sheets into manageable sets, bind with durable paper cover sheets, and print suitable titles, dates and other identification on cover of each set.
1. Four (4) weeks prior to the final inspection, the Contractor shall provide the VA Project Engineer with 8 complete sets (4 full size, 4 reduced size) of CAD quality drawings on vellum (reproducible, clean & legible).
  2. AutoCAD (verify required version) files in the format consistent with the VA's standards on PC CD disks with all the above information incorporated.
  3. Adobe Acrobat PDF files for each AutoCAD file on PC CD disks with all the above information incorporated.
  4. The draftsmanship and information shall be comparable in all ways to the original documents, and shall be dated and noted "As-Built".

- C. Record Specifications: Maintain one copy of specifications, including amendments, change orders and similar modifications issued in printed form during construction, and mark-up variations in actual work in comparison with text of specifications and modifications as issued. Give particular attention to substitutions, selection of options, and similar information on work where it is concealed or cannot otherwise be readily discerned at a late date by direct observation. Note related record drawing information and product data, where applicable.
- D. Record Product Data, Certifications and Laboratory Test Reports: Maintain one copy of each product data submittal, product certification, and laboratory test report and mark-up significant variations in actual work in comparison with submitted information. Include both variations in product as delivered to site, and variations from manufacturer's instructions and recommendations for installation. Give particular attention to concealed products and portions of the work which cannot otherwise be easily discerned at a later date by direct observation. Note related change orders and mark-up of record drawings and specifications.
- E. Record Samples and Salvaged Items: Immediately prior to date(s) of substantial completion, the Contacting Officer or designated representative will meet with Contractor on site, and will determine which (if any) of submitted samples and salvaged items maintained by Contractor during progress of the work are to be retained by the Government. Comply with the COR's instructions for packaging, identification marking, and delivery.
- F. Miscellaneous Record Submittals: Refer to other Sections of these specifications for requirements of miscellaneous record-keeping and submittals in connection with actual performance of the work. Immediately prior to date(s) of substantial completion, complete miscellaneous records and place in good order, appropriately identified and bound, ready for continued use and reference. Turn over to the Contacting Officer prior to final acceptance.

#### **1.5 OPERATION AND MAINTENANCE MANUALS**

- A. General: Organize manuals into suitable volumes of manageable size, as approved by the Contacting Officer. Provide two hard copies and one electronic copy (CD) for each piece of equipment. Manuals shall have table of contents (TOC), and be assembled to conform to the TOC with

tab sheets covering each subject. The instructions shall be legible and easy to read. Manuals shall be hard bound with sheets consistent in size; where oversize drawings are necessary, they shall be folded. Illustrations shall include "exploded" views showing and identifying each separate item. Emphasis shall be placed on the use of special tools and instruments. The function of each piece of equipment, component, accessory and control shall be clearly and thoroughly explained. All necessary precautions for the operation of the equipment and the reason for each precaution shall be clearly set forth. Manuals must reference the exact model, style and size of the piece of equipment and system being furnished. The organized document shall be labeled "Operation and Maintenance Manual" with the project name, building location, contact and project numbers appearing on the cover.

B. Contents: Manuals shall include, but not belimited to, the following data ...

1. Detailed description of each system and each of its components, including layout showing piping, valves, and controls and other components, and including diagrams and illustrations where applicable.
2. Wiring and control diagrams with data to explain detailed operation and control of each component. Provide installed electrical panel schedules using the VA format.
3. Control sequence describing start-up, operation, and shut-down.
4. Procedure for starting.
5. Procedure for operating.
6. Shut-down instructions.
7. Installation instructions.
8. Maintenance and overhaul instructions.
9. Emergency instructions and safety precautions.
10. Corrected shop drawings.
11. Approved equipment data sheet using the VA format.
12. Approved certifications and laboratory test reports (where applicable).
13. Copies of warranties.
14. Test procedures.
15. Parts list, including source of supply, recommended spare parts, and service organization convenient to building site.



16. Name, address, and telephone number of each subcontractor who installed equipment and systems, and local representative for each type of equipment and each system.

17. Other pertinent data applicable to the operation and maintenance of particular systems or equipment and/or other data specified in technical Sections of the specification.

#### **1.6 APPROVED SUBMITTALS**

Provide Contracting Officer with one copy of each final approved submittal package with all review notations and remarks indicated prior to the time that system or equipment tests are performed, and two additional copies 2 weeks before either the start of operation by the Government or any instruction period specified (whichever comes first).

### **PART 2 - PRODUCTS**

#### **2.1 GENERAL**

A. Keys and Special Tools: Provide Project Engineer with all keys and special tools that might be necessary for access, maintenance, and operation of installed items.

### **PART 3 - EXECUTION**

#### **3.1 INSTRUCTIONS TO GOVERNMENT PERSONNEL**

A. Each applicable trade shall provide qualified, factory-trained representatives to give detailed instructions to assigned Department of Veterans Affairs personnel in the operation and complete maintenance for each system and piece of equipment. Instructions for different items of equipment that are component parts of a complete system shall be given in an integrated, progressive manner. All instructors for every piece of component equipment in a system shall be available until instructions for all items included in the system have been completed. This is to assure proper instruction in the operation of inter-related systems. All instruction periods shall be at such times as scheduled by the COR and shall be considered concluded only when the COR is satisfied in regard to complete and thorough coverage of information.

B. Instructional services of competent instructors shall be provided for a minimum of two blocks of onsite training, 4 hours each, to designated Government employees covering the overall installation, operational

methods, adjustments, care and periodic maintenance requirements for their systems.

- C. Each instructor shall be familiar with all parts of their respective system and shall be trained in operating theory as well as practical operation and maintenance practices. Factory trained instructors shall be employed wherever practical and available. The Department of Veterans affairs reserves the right to request the removal of, and substitution for, any instructor who, in the opinion of the COR, does not demonstrate sufficient qualifications in accordance with requirements for instructors above. The contractor shall submit a course outline with associated material to the COR for review and approval prior to scheduling training to ensure the subject matter covers the expectations of the VA and the contractual requirements. The Department of Veterans Affairs reserves the right to request the removal of, and substitution for, any instructor who, in the opinion of the COR, does not demonstrate sufficient qualifications in accordance with requirements for instructors above.
- D. Utilize the maintenance manual for the system or equipment as a text for instruction. **Instruction shall include a full and extensive review of the maintenance and operation manual.** Failure to execute this task shall require additional training sessions when this information is made available.
- E. Unless otherwise required or approved, the instruction shall be given during the regular work week after the equipment has been accepted and turned over to the Government for regular operation. Where significant changes or modifications in equipment are made under the terms of the guarantee, additional instruction shall be provided as may be necessary to acquaint the operating personnel of the changes or modifications. When more than four man-days (32 hours) of instruction are specified in other Sections, approximately half of the time shall be classroom instruction and the other half at the site of the system or equipment.
- F. Upon completion, submit written acknowledgment with documentation to the Project Engineer demonstrating that the required instructions were successfully completed for each discipline.

### 3.2 FINAL CLEANING

- A. Cleaning shall include dusting, washing, HEPA vacuuming and other required sanitizing of all surfaces within immediate and adjacent affected areas. All affected areas shall be cleaned, polished and hygienically sanitized including but not limited to floors, walls, partitions, ceilings (including above removable ceiling systems ceiling tiles), fixtures, lenses, windows, equipment, furniture (built-in or free standing), shelves counters, cabinets, doors, drawers. Comply with manufacturer's instructions for cleaning operation. Close off access to areas as cleaning is completed. **Project phasing shall require cleaning to be performed in various phases.**
- B. The following minimum requirements shall be performed in addition to special cleaning requirements specified in other Sections:
1. Remove markings that are not required as permanent labels.
  2. Vacuum clean carpeted surfaces and similar soft surfaces.
  3. Clean transparent materials, including mirrors and glass, to a polished clear condition. Replace broken glass and damaged transparent materials.
  4. Clean exposed exterior and interior hard-surface finishes, to a dirt-free condition, free of dust, stains, films and similar noticeable substances. Except as otherwise indicated, avoid disturbance of natural weathering of exterior surfaces. Restore reflective surfaces to original reflective condition.
  5. Remove debris and surface dust from limited-access spaces including roofs, plenums, shafts, and similar spaces.
  6. Wet mop concrete floors in non-occupied spaces.
  7. Strip, wash, wax and polish to a sanitary clean condition all floor surfaces within the construction boundary and outside the boundary throughout areas of construction traffic flow throughout the project.
  8. Clean HVAC systems within the construction area to the requirements specified.
  9. HEPA vacuum the inside/outside sections of the building baseboard perimeter heating fin tube components within the construction area to insure clean and healthy operation.
  10. Wet wipe surfaces of equipment clean. Remove excess lubrication and other substances.

11. Clean and polish plumbing fixtures to a sanitary condition free of stains.
  12. Clean light fixtures and lamps of debris and stains to function with full efficiency.
  13. Clean other items to a condition of sanitation acceptable for intended service use.
- C. Damaged surfaces and items within the contract limits shall be patched, repaired, refinished, painted and/or replaced as necessary with materials comparable to the surrounding material and surface equal to new conditions unless otherwise noted or directed by the VA Project Engineer. Finished surfaces shall be indistinguishable from the surrounding area.
- D. Protection Removal: Except as otherwise indicated or requested by the Contacting Officer, remove temporary protection devices and facilities which were installed during course of the work to protect previously completed work during remainder of construction period.

### **3.3 PARTIAL CHECKLIST PRIOR TO BENEFICIAL OCCUPANCY**

The Contractor is required to ensure that all the following list items are completed:

1. Mechanical Systems -
  - Completion of Mechanical System Inspecting & Testing Checklist as specified in Section 23 05 11, REQUIREMENTS FOR MECHANICAL INSTALLATIONS.
  - Verification of Air Conveyance System Cleanliness as specified in Section 23 31 00, HVAC DUCTS AND CASINGS.
  - Equipment is operating correctly, air/water/steam flow balanced and thermostatic sensors control temperature as designed.
  - All parameters met per specifications (actual measurements) with documentation.
  - Equipment labeled, access doors tagged with belt and filter sizes designated.
  - Balancing Report for all HVAC piping and duct systems.
  - Mechanical/Plumbing System Valve Schedule sheets.
  - As-built plans with pipe/ductwork diagrams.
  - Equipment Data Records - Removed and/or Installed.

2. Electrical Systems -

- Completion of Electrical System Inspecting & Testing Checklist as specified in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- Completion of NEC Compliance Checklist as specified in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- All parameters met per specifications (actual measurements) with documentation.
- All panelboard labeled, circuits traced out, directories updated and panelboard schedule sheets completed (in typed format).
- Each receptacle and switch identified as to circuit & panelboard number.
- Master electrical one-liner updated.
- As-built plans with wiring diagrams.
- Equipment Data Sheets.

3. Facility Communication Systems -

- Computer networks, special system alarms to digitizers, fire alarms.
- Code Blue, Code Green, Emergency Call, intercoms, et al, etc.
- HVAC energy management system.

4. Warranty -

Contractor shall provide name and telephone number of qualified service organization to perform emergency repairs on a 24-hour basis. Each trade shall provide a minimum 1 year (24 hour on call) labor/parts service for equipment troubleshooting and correction. Warranties' starting dates may not be the same for all systems so they must be explicitly stated with supporting documentation.

**3.4 CONTRACT COMPLETION**

- A. Notification: Contractor shall notify the Contracting Officer in writing with supporting documentation, when all work has been completed in accordance with the contract requirements.
- B. Acceptance: Final Inspection shall not be performed until Contractor issued final Punch List work is completed or otherwise resolved for acceptance with supporting documentation. All test and documentation for electrical and mechanical systems must be complete per contract

requirements. Additional final Punch Lists may be developed in collaboration with Project A/E including COR, Contacting Officer, Department Service (customer) and appropriate technical personnel from the Department of Veterans Affairs.

- C. Keys issued to the Contractor by the VA shall be returned to the VA COR at the completion of beneficial occupancy. Project completion is not achieved until all assigned VA keys have been returned.

- - - E N D - - -

ATTACHMENTS FOLLOW

ATTACHMENT A: Equipment Data Record ... 1 Page

**Equipment Data Record**

**Contractor Removed and/or Installed Equipment**

VA Project Name & Number:

General Contractor Name & Address:

Subcontractor Name & Address:

Manufacturer:

Vendor:

Project Device Name:

Mfg's Device Name:

Model #:

Serial #:

VA #:

Bar Code #:

Acquisition Date:

Acquisition Value:

Life Expectancy:

Warranty Expiration Date:

Equipment Location:

Facility Utilities Altered:

Filter Size/Type/Qty:

Belt Size/Type/Qty:

M & O Comments:

**SECTION 02 41 00**  
**DEMOLITION**

**PART 1 - GENERAL**

**1.1 DESCRIPTION:**

This section specifies demolition and removal of buildings, portions of buildings, utilities, other structures and debris from trash dumps shown.

**1.2 RELATED WORK:**

- A. Safety Requirements: Section 01 35 26 Safety Requirements Article, ACCIDENT PREVENTION PLAN (APP).
- B. Disconnecting utility services prior to demolition: Section 01 00 00, GENERAL REQUIREMENTS.
- C. Reserved items that are to remain the property of the Government: Section 01 00 00, GENERAL REQUIREMENTS.
- D. Infectious Control: Section 01 35 26, SAFETY REQUIREMENTS.

**1.3 PROTECTION:**

- A. Perform demolition in such manner as to eliminate hazards to persons and property; to minimize interference with use of adjacent areas, utilities and structures or interruption of use of such utilities; and to provide free passage to and from such adjacent areas of structures.
- B. Provide safeguards, including warning signs, barricades, temporary fences, warning lights, and other similar items that are required for protection of all personnel during demolition and removal operations.
- C. Provide enclosed dust chutes with control gates from each floor to carry debris to truck beds and govern flow of material into truck. Provide overhead bridges of tight board or prefabricated metal construction at dust chutes to protect persons and property from falling debris.
- D. Prevent spread of flying particles and dust. Sprinkle rubbish and debris with water to keep dust to a minimum. Do not use water if it results in hazardous or objectionable condition such as, but not limited to; ice, flooding, or pollution. Vacuum and dust the work area daily.
- E. In addition to previously listed fire and safety rules to be observed in performance of work, include following:
  - 1. No wall or part of wall shall be permitted to fall outwardly from structures.



2. Maintain at least one stairway in each structure in usable condition to highest remaining floor. Keep stairway free of obstructions and debris until that level of structure has been removed.
  3. Wherever a cutting torch or other equipment that might cause a fire is used, provide and maintain fire extinguishers nearby ready for immediate use. Instruct all possible users in use of fire extinguishers.
  4. Keep hydrants clear and accessible at all times. Prohibit debris from accumulating within a radius of 4500 mm (15 feet) of fire hydrants.
- F. Before beginning any demolition work, the Contractor shall survey the site and examine the drawings and specifications to determine the extent of the work. The contractor shall take necessary precautions to avoid damages to existing items to remain in place, to be reused, or to remain the property of the Medical Center; any damaged items shall be repaired or replaced as approved by the COR. The Contractor shall coordinate the work of this section with all other work and shall construct and maintain shoring, bracing, and supports as required. The Contractor shall ensure that structural elements are not overloaded and shall be responsible for increasing structural supports or adding new supports as may be required as a result of any cutting, removal, or demolition work performed under this contract. Do not overload structural elements. Provide new supports and reinforcement for existing construction weakened by demolition or removal works. Repairs, reinforcement, or structural replacement must have COR's approval.
- G. The work shall comply with the requirements of Section 01 00 00, GENERAL REQUIREMENTS and Section 01 35 26, SAFETY REQUIREMENTS.

**PART 2 - PRODUCTS (NOT USED)**

**PART 3 - EXECUTION**

**3.1 DEMOLITION:**

- A. Completely demolish and remove buildings and structures, including all appurtenances related or connected thereto, as noted below:
  1. As required for upgrading elevator controls and cab interior finishes.
- B. Debris, including brick, concrete, stone, metals and similar materials shall become property of Contractor and shall be disposed of by him daily, off the Medical Center to avoid accumulation at the demolition

site. Materials that cannot be removed daily shall be stored in areas specified by the COR. Break up concrete slabs below grade that do not require removal from present location into pieces not exceeding 600 mm (24 inches) square to permit drainage. Contractor shall dispose debris in compliance with applicable federal, state or local permits, rules and/or regulations.

- C. In removing buildings and structures of more than two stories, demolish work story by story starting at highest level and progressing down to third floor level. Demolition of first and second stories may proceed simultaneously.
- D. Remove and legally dispose of all materials, other than earth to remain as part of project work, from any trash dumps shown. Materials removed shall become property of contractor and shall be disposed of in compliance with applicable federal, state or local permits, rules and/or regulations. All materials in the indicated trash dump areas, including above surrounding grade and extending to a depth of 1500mm (5feet) below surrounding grade, shall be included as part of the lump sum compensation for the work of this section. Materials that are located beneath the surface of the surrounding ground more than 1500 mm (5 feet), or materials that are discovered to be hazardous, shall be handled as unforeseen. The removal of hazardous material shall be referred to Hazardous Materials specifications.

**3.2 CLEAN-UP:**

On completion of work of this section and after removal of all debris, leave site in clean condition satisfactory to COR. Clean-up shall include off the Medical Center disposal of all items and materials not required to remain property of the Government as well as all debris and rubbish resulting from demolition operations.

- - - E N D - - -

**SECTION 03 30 53**  
**(SHORT-FORM) CAST-IN-PLACE CONCRETE**

**PART 1 - GENERAL**

**1.1 SUMMARY**

A. Section Includes:

1. Cast-in-place structural concrete.

**1.2 APPLICABLE PUBLICATIONS**

A. Comply with references to extent specified in this Section.

B. American Concrete Institute (ACI):

1. 117-15 - Tolerances for Concrete Construction, Materials and Commentary.
2. 117M-10(R2015) - Tolerances for Concrete Construction, Materials and Commentary.
3. 211.1-91(R2009) - Proportions for Normal, Heavyweight, and Mass Concrete.
4. 211.2-98(R2004) - Selecting Proportions for Structural Lightweight Concrete.
5. 301/310M-10 - Structural Concrete.
6. 305.1-14 - Hot Weather Concreting.
7. 306.1-90(R2002) - Cold Weather Concreting.
8. 318/318M-14 - Building Code Requirements for Structural Concrete and SP-66-04-ACI Detailing Manual.
9. 347-04 - Guide to Formwork for Concrete.

C. ASTM International (ASTM):

1. A615/A615M-15a<sup>1</sup> - Deformed and Plain Carbon-Steel Bars for Concrete Reinforcement.
2. A996/A996M-15 - Rail-Steel and Axle-Steel Deformed Bars for Concrete Reinforcement.
3. A1064/A1064M-15 - Carbon-Steel Wire and Welded Wire Reinforcement, Plain and Deformed, for Concrete.
4. C33/C33M-13 - Concrete Aggregates.
5. C39/C39M-15a - Compressive Strength of Cylindrical Concrete Specimens.
6. C94/C94M-15a - Ready-Mixed Concrete.
7. C143/C143M-15 - Slump of Hydraulic Cement Concrete.
8. C150/C150M-15 - Portland Cement.
9. C171-07 - Sheet Material for Curing Concrete.

10. C192/C192M-15 - Making and Curing Concrete Test Specimens in the Laboratory.
11. C219-14a - Terminology Relating to Hydraulic Cement.
12. C260/C260M-10a - Air-Entraining Admixtures for Concrete.
13. C330/C330M-14 - Lightweight Aggregates for Structural Concrete.
14. C494/C494M-15 - Chemical Admixtures for Concrete.
15. C618-15 - Coal Fly Ash and Raw or Calcined Natural Pozzolan for Use in Concrete.
16. C881/C881M-14 - Epoxy-Resin-Base Bonding Systems for Concrete.
17. C989/C989M-14 - Slag Cement for Use in Concrete and Mortars.
18. C1240-15 - Silica Fume Used in Cementitious Mixtures.
19. D1751-04(2013el) - Preformed Expansion Joint Fillers for Concrete Paving and Structural Construction (Non-extruding and Resilient Bituminous Types).
20. E1155-14 - Determining FF Floor Flatness and FL Floor Levelness Numbers.
21. E1745-11 - Water Vapor Retarders Used in Contact with Soil or Granular Fill under Concrete Slabs.

D. International Concrete Repair Institute:

1. 310.2R-2013 - Selecting and Specifying Concrete Surface Preparation for Sealers, Coatings, Polymer Overlays, and Concrete Repair.

**1.3 SUBMITTALS**

- A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
  1. Concrete Mix Design.
  2. Air-entraining admixture, chemical admixtures, and curing compounds.
  3. Indicate manufacturer's recommendation for each application.
- C. Certificates: Certify products comply with specifications.
  - a. Each ready mix concrete batch delivered to site.

**1.4 DELIVERY**

- A. Deliver each ready-mixed concrete batch with mix certification in duplicate according to ASTM C94/C94M.

**1.5 WARRANTY**

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."

## **PART 2 - PRODUCTS**

### **2.1 MATERIALS**

- A. Portland Cement: ASTM C150/C150M, Type I or II.
- B. Pozzolans:
  - 1. Fly Ash: ASTM C618, Class C or F including supplementary optional physical requirements.
  - 2. Slag: ASTM C989/C989M; Grade 80.
  - 3. Silica Fume: ASTM C1240.
- C. Coarse Aggregate: ASTM C33/C33M.
  - 1. Size 467 for footings and walls over 300 mm (12 inches) thick.
  - 2. Size 7 for coarse aggregate for applied topping and metal pan stair fill.
  - 3. Size 67 for other applications.
- D. Fine Aggregate: ASTM C33/C33M.
- E. Lightweight Aggregate for Structural Concrete: ASTM C330/C330M, Table 1.
- F. Mixing Water: Fresh, clean, and potable.
- G. Air-Entraining Admixture: ASTM C260/C260M.
- H. Chemical Admixtures: ASTM C494/C494M.
- I. Vapor Barrier: ASTM E1745, Class A with a minimum puncture resistance of 2200 g (3000 lbs.); minimum 0.38 mm (15 mil) thick.
- J. Reinforcing Steel: ASTM A615/A615M or ASTM A996/A996M, deformed. See Structural Drawings for grade.
- K. Forms: Wood, plywood, metal, or other materials, approved by Contracting Officer, of grade or type suitable to obtain type of finish specified.
  - 1. Plywood: Exterior grade, free of defects and patches on contact surface.
  - 2. Lumber: Sound, grade-marked, S4S stress graded softwood.
  - 3. Form coating: As recommended by Contractor.
- L. Expansion Joint Filler: ASTM D1751.
- M. Sheet Materials for Curing Concrete: ASTM C171.
- N. Abrasive Aggregates: Aluminum oxide grains or emery grits.
- O. Liquid Densifier/Sealer: 100 percent active colorless aqueous silicate solution.
- P. Grout, Non-Shrinking: Premixed ferrous or non-ferrous. Grout to show no settlement or vertical drying shrinkage at 3 days. Compressive strength

for grout, at least 18 MPa (2500 psi) at 3 days and 35 MPa (5000 psi) at 28 days.

**2.2 ACCESSORIES**

- A. Bonding Agent: ASTM C 1059/C 1059M, Type II.
- B. Structural Adhesive: ASTM C881, 2-component material suitable for use on dry or damp surfaces. Provide material Type, Grade, and Class to suit Project requirements.
- C. Water Stops: Rubber base with self-healing properties. Expanding clay based products not acceptable.
- D. Weeps: Geotextile type as recommended by Contractor and approved by Contracting Officer.

**2.3 CONCRETE MIXES**

- A. Design concrete mixes according to ASTM C94/C94M, Option C.
- B. Compressive strength at 28 days: minimum 30 MPa (4,000 psi).
- C. Submit mix design and results of compression tests to the Contracting Officer for his evaluation. Identify all materials, including admixtures, making-up the concrete.
- D. Maximum Slump for Vibrated Concrete: 100 mm (4 inches) tested according to ASTM C143.
- E. Cement and Water Factor (See Table I):

TABLE I - CEMENT AND WATER FACTORS FOR CONCRETE				
Concrete: Strength	Non-Air-Entrained		Air-Entrained	
Min. 28 Day Comp. Str. MPa (psi)	Min. Cement kg/cu. m (lbs./cu. yd.)	Max. Water Cement Ratio	Min. Cement kg/cu. m (lbs./cu. yd.)	Max. Water Cement Ratio
35 (5000)1,3	375 (630)	0.45	385 (650)	0.40
30 (4000)1,3	325 (550)	0.55	340 (570)	0.50
25 (3000)1,3	280 (470)	0.65	290 (490)	0.55
25 (3000)1,2	300 (500)	*	310 (520)	*

TABLE I - CEMENT AND WATER FACTORS FOR CONCRETE				
Concrete: Strength	Non-Air-Entrained		Air-Entrained	
Min. 28 Day Comp. Str. MPa (psi)	Min. Cement kg/cu. m (lbs./cu. yd.)	Max. Water Cement Ratio	Min. Cement kg/cu. m (lbs./cu. yd.)	Max. Water Cement Ratio
Footnotes:				
1. If trial mixes are used, achieve a compressive strength 8.3 MPa (1 200 psi) in excess of f'c. For concrete strengths greater than 35 MPa (5,000 psi), achieve a compressive strength 9.7 MPa (1,400 psi) in excess of f'c.				
2. Lightweight Structural Concrete: Pump mixes may require higher cement values as specified in ACI 318/318M.				
3. For Concrete Exposed to High Sulfate Content Soils: Maximum water cement ratio is 0.44.				
* Laboratory Determined according to ACI 211.1 for normal weight concrete or ACI 211.2 for lightweight structural concrete.				

F. Air-entrainment as specified, and conform with the following for air content table:

TABLE II - TOTAL AIR CONTENT FOR VARIOUS SIZES OF COARSE AGGREGATES	
Nominal Maximum Size of Coarse Aggregate	Total Air Content, percent
10 mm (3/8 inches)	6 Moderate exposure; 7.5 severe exposure
13 mm (1/2 inches)	5.5 Moderate exposure; 7 severe exposure
19 mm (3/4 inches)	5 Moderate exposure; 6 severe exposure
25 mm (1 inches)	4.5 Moderate exposure; 6 severe exposure
40 mm (1 1/2 inches)	4.5 Moderate exposure; 5.5 severe exposure

#### 2.4 BATCHING AND MIXING

A. Store, batch, and mix materials according to ASTM C94/C94M.

1. Job-Mixed: Batch mix concrete in stationary mixers as specified in ASTM C94/C94M.
2. Ready-Mixed Concrete: Comply with ASTM C94/C94M, except use of non-agitating equipment for transporting concrete to Site is not acceptable.
3. Mixing Structural Lightweight Concrete: Charge mixer with 2/3 of total mixing water and total aggregate for each batch. Mix ingredients minimum 30 seconds in stationary mixer or minimum 10 revolutions at mixing speed in truck mixer. Add remaining mixing water and other ingredients and continue mixing. Above procedure may be modified as recommended by aggregate producer.
4. When aggregate producer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.

### **PART 3 - EXECUTION**

#### **3.1 FORMWORK**

- A. Installation: Conform to ACI 347. Construct forms to obtain concrete of the shapes, dimensions and profiles indicated, with tight joints.
- B. Design and construct forms to prevent bowing-out of forms between supports and to be removable without prying against or otherwise damaging fresh concrete.
- C. When patching formed concrete, seal form edges against existing surface to prevent leakage; set forms so that patch is flush with adjacent surfaces.
- D. Treating and Wetting: Treat or wet concrete contact surfaces:
  1. Coat plywood and lumber forms with non-staining form sealer.
  2. Wet wood forms thoroughly when they are not treated with form release agent.
  3. Prevent water from accumulating and remaining within forms.
  4. Clean and coat removable metal forms with light form oil before reinforcement is placed.
  5. In hot weather, cool metal forms by thoroughly wetting with water just before placing concrete.
  6. Prevent water from accumulating and remaining within forms.
- E. Inserts, Sleeves, and Similar Items: Install flashing reglets, masonry ties, anchors, inserts, wires, hangers, sleeves, boxes for floor



hinges, and other cast-in items specified in other Sections. Place where indicated, square, flush and secured to formwork.

- F. Construction Tolerances - General: Install and maintain concrete formwork to assure completion of work within specified tolerances.
- G. Adjust or replace completed work exceeding specified tolerances before placing concrete.

### **3.2 PLACING CONCRETE**

- A. Remove hardened concrete, debris and other foreign materials from interior of forms, and from inside of mixing and conveying equipment. Obtain approval from Contracting Officer's Representative before placing concrete.
- B. Install screeds at required elevations for concrete slabs.
- C. Roughen and clean free from laitance, foreign matter, and loose particles before placing new concrete on existing concrete.
  - 1. Blow-out areas with compressed air and immediately coat contact areas with adhesive in compliance with manufacturer's instructions.
- D. Place structural concrete according to ACI 301 and ACI 318.
- E. Convey concrete from mixer to final place of deposit by method that will prevent segregation or loss of ingredients. Do not deposit, in Work, concrete that has attained its initial set or has contained its water or cement more than 1 1/2 hours. Do not allow concrete to drop freely more than 1500 mm (5 feet) in unexposed work nor more than 900 mm (3 feet) in exposed work.
- F. Place and consolidate concrete in horizontal layers not exceeding 300 mm (12 inches) in thickness. Consolidate concrete by spading, rodding, and mechanical vibrator. Do not secure vibrator to forms or reinforcement. Continuously vibrate during placement of concrete.
- G. Hot Weather Concrete Placement: As recommended by ACI 305.1 to prevent adversely affecting properties and serviceability of hardened concrete.
- H. Cold Weather Concrete Placement: As recommended by ACI 306.1, to prevent freezing of thin sections less than 300 mm (12 inches) and to permit concrete to gain strength properly.
  - 1. Do not use calcium chloride without written approval from Contracting Officer's Representative.

### **3.3 PROTECTION AND CURING**

- A. Protect exposed surfaces of concrete from premature drying, wash by rain or running water, wind, mechanical damage, and excessive hot or cold temperatures.
- B. Curing Methods: Cure concrete with curing compound using wet method with sheets.
- C. Formed Concrete Curing: Wet the tops and exposed portions of formed concrete and keep moist until forms are removed.
  - 1. If forms are removed before 14 days after concrete is cast, install sheet curing materials as specified above.
- D. Concrete Flatwork Curing:
  - 1. Install sheet materials according to the manufacturer's instructions.
    - a. When manufacturer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.

### **3.4 FORM REMOVAL**

- A. Maintain forms in place until concrete is self-supporting, with construction operation loads.
- B. Remove fins, laitance and loose material from concrete surfaces when forms are removed. Repair honeycombs, rock pockets, sand runs, spalls, or otherwise damaged surfaces by patching with the same mix as concrete minus the coarse aggregates.
- C. Finish to match adjacent surfaces.

### **3.5 FINISHES**

- A. Vertical and Overhead Surface Finishes:
  - 1. Surfaces Concealed in Completed Construction: As-cast; no additional finishing required.
  - 2. Surfaces Exposed in Unfinished Areas: As-cast; no additional finishing required.
    - a. Elevator Shafts.

### **3.6 SURFACE TREATMENTS**

- A. Mix and apply the following surface treatments according to manufacturer's instructions.

1. When manufacturer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.

- - E N D - -

**SECTION 04 05 16**  
**MASONRY GROUTING**

**PART 1 - GENERAL**

**1.1 SUMMARY**

A. Section Includes:

1. Grout for filling open penetration in elevator shafts.

**1.2 RELATED REQUIREMENTS**

A. Grout used in Section:

- B. Section 09 91 00, PAINTING.

**1.3 APPLICABLE PUBLICATIONS**

A. Comply with references to extent specified in this section.

B. American National Standards Institute (ANSI):

1. A118.6-10 - Standard Cement Grouts for Tile Installation.

C. ASTM International (ASTM):

1. C40/C40M-11 - Organic Impurities in Fine Aggregates for Concrete.
2. C150/C150M-15 - Portland Cement.
3. C207-06(2011) - Hydrated Lime for Masonry Purposes.
4. C404-11 - Aggregates for Masonry Grout.
5. C476-11 - Grout for Masonry.
6. C595/C595M-15e1 - Blended Hydraulic Cement.
7. C979/C979M-10 - Pigments for Integrally Colored Concrete.
8. C1019-14 - Sampling and Testing Grout.

**1.4 SUBMITTALS**

A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Manufacturer's Literature and Data:

1. Description of each product.

C. Test Reports: Certify each product complies with specifications.

1. Grout, each type.
2. Cement.
3. Aggregate.

D. Certificates: Certify each product complies with specifications.

1. Blended hydraulic cement.
2. Portland cement.
3. Grout.
4. Hydrated lime.

5. Aggregate.
6. Color admixture.

#### **1.5 QUALITY ASSURANCE**

##### **A. Preconstruction Testing:**

1. Engage independent testing laboratory to perform tests and submit reports.
  - a. Deliver samples to laboratory in number and quantity required for testing.
2. Grout:
  - a. Test compressive strength according to ASTM C1019 standard.
3. Cement:
  - a. Test for water soluble alkali (nonstaining) when nonstaining cement is specified.
  - b. Nonstaining cement containing more than 0.03 percent water soluble alkali.
4. Aggregate:
  - a. Test for deleterious substances, organic impurities, soundness and grading.

#### **1.6 DELIVERY**

- A. Deliver products in manufacturer's original sealed packaging.
- B. Mark packaging, legibly. Indicate manufacturer's name or brand, type, production run number, and manufacture date.

#### **1.7 STORAGE AND HANDLING**

- A. Store masonry materials under waterproof covers on planking clear of ground, and protect damage from handling, dirt, stain, water and wind.
- B. Protect products from damage during handling and construction operations.

#### **1.8 WARRANTY**

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."

### **PART 2 - PRODUCTS**

#### **2.1 MATERIALS**

- A. Grout Components:
  1. Hydrated Lime: ASTM C207, Type S.
  2. Aggregate For Masonry Grout: ASTM C404, Size 8.

3. Blended Hydraulic Cement: ASTM C595, Type IS, IP.
4. Portland Cement: ASTM C150, Type I.
5. Liquid Acrylic Resin:
  - a. A formulation of acrylic polymers and modifiers in liquid form designed for use as an additive for mortar to improve physical properties.
6. Water: Potable, free of substances that are detrimental to grout, masonry, and metal.

## **2.2 PRODUCTS - GENERAL**

- A. Provide each product from one manufacturer.

## **2.3 MIXES**

- A. Grout: ASTM C476; fine grout and coarse grout.
  1. Color Admixture:
    - a. Pigments: ASTM C979, inert, stable to atmospheric conditions, nonfading, alkali resistant, and water insoluble.
    - b. Use mineral pigments only. Organic pigments are not acceptable.
- B. Ready-Mixed Grout: ANSI A118.8.

## **PART 3 - EXECUTION**

### **3.1 PREPARATION**

- A. Examine and verify substrate suitability for product installation.
- B. Protect existing construction and completed work from damage.
- C. Clean mortar from masonry cells protruding more than 13 mm (1/2 inch) to permit grout flow.
- D. Remove debris from grout spaces.
- E. Verify reinforcement is correctly placed before placing grout.

### **3.2 MIXING**

- A. Mix grout in mechanically operated mixer.
  1. Mix grout for five minutes, minimum.
- B. Measure ingredients by volume using container of known capacity.
- C. Mix water with grout dry ingredients.
  1. Slump Range: 200 to 275 mm (8 to 11 inches).

### **3.3 GROUTING**

- A. Use fine grout for filling wall cavities and hollow concrete masonry units where smallest cell dimension is 50 mm (2 inches) or less.

- B. Use either fine grout or coarse grout for filling wall cavities and hollow concrete masonry units where smallest cell dimension is greater than 50 mm (2 inches).

- - E N D - -

**SECTION 05 50 00  
METAL FABRICATIONS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies items and assemblies fabricated from structural steel shapes and other materials as shown and specified.
- B. Items specified.
  - 1. Ladders

**1.2 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:

Pit Ladder
------------

- C. Shop Drawings:
  - 1. Each item specified, showing complete detail, location in the project, material and size of components, method of joining various components and assemblies, finish, and location, size and type of anchors.
  - 2. Mark items requiring field assembly for erection identification and furnish erection drawings and instructions.
  - 3. Provide templates and rough-in measurements as required.
- D. Manufacturer's Certificates:
  - 1. Anodized finish as specified.
  - 2. Live load designs as specified.
- E. Design Calculations for specified live loads including dead loads.
- F. Furnish setting drawings and instructions for installation of anchors to be preset into concrete and masonry work, and for the positioning of items having anchors to be built into concrete or masonry construction.

**1.4 QUALITY ASSURANCE**

- A. Each manufactured product shall meet, as a minimum, the requirements specified, and shall be a standard commercial product of a manufacturer regularly presently manufacturing items of type specified.
- B. Each product type shall be the same and be made by the same manufacturer.
- C. Assembled product to the greatest extent possible before delivery to the site.



- D. Include additional features, which are not specifically prohibited by this specification, but which are a part of the manufacturer's standard commercial product.

**1.5 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):
  - B18.6.1-97.....Wood Screws
  - B18.2.2-87(R2010).....Square and Hex Nuts
- C. American Society for Testing and Materials (ASTM):
  - A36/A36M-14.....Structural Steel
  - A47-99(R2014).....Malleable Iron Castings
  - A48-03(R2012).....Gray Iron Castings
  - A53-12.....Pipe, Steel, Black and Hot-Dipped, Zinc-Coated  
Welded and Seamless
  - A123-15.....Zinc (Hot-Dip Galvanized) Coatings on Iron and  
Steel Products
  - A240/A240M-15.....Standard Specification for Chromium and  
Chromium-Nickel Stainless Steel Plate, Sheet  
and Strip for Pressure Vessels and for General  
Applications.
  - A269-15.....Seamless and Welded Austenitic Stainless Steel  
Tubing for General Service
  - A307-14.....Carbon Steel Bolts and Studs, 60,000 PSI  
Tensile Strength
  - A391/A391M-07(R2015)....Grade 80 Alloy Steel Chain
  - A786/A786M-15.....Rolled Steel Floor Plate
  - B221-14.....Aluminum and Aluminum-Alloy Extruded Bars,  
Rods, Wire, Shapes, and Tubes
  - B456-11.....Electrodeposited Coatings of Copper Plus Nickel  
Plus Chromium and Nickel Plus Chromium
  - B632-08.....Aluminum-Alloy Rolled Tread Plate
  - C1107-13.....Packaged Dry, Hydraulic-Cement Grout  
(Nonshrink)
  - D3656-13.....Insect Screening and Louver Cloth Woven from  
Vinyl-Coated Glass Yarns
  - F436-16.....Hardened Steel Washers

F468-06(R2015).....Nonferrous Bolts, Hex Cap Screws, Socket Head  
Cap Screws and Studs for General Use

F593-13.....Stainless Steel Bolts, Hex Cap Screws, and  
Studs

F1667-15.....Driven Fasteners: Nails, Spikes and Staples

D. American Welding Society (AWS):

D1.1-15.....Structural Welding Code Steel

D1.2-14.....Structural Welding Code Aluminum

D1.3-18.....Structural Welding Code Sheet Steel

E. National Association of Architectural Metal Manufacturers (NAAMM)

AMP 521-01(R2012).....Pipe Railing Manual

AMP 500-06.....Metal Finishes Manual

MBG 531-09(R2017).....Metal Bar Grating Manual

MBG 532-09.....Heavy Duty Metal Bar Grating Manual

F. Structural Steel Painting Council (SSPC)/Society of Protective  
Coatings:

SP 1-15.....No. 1, Solvent Cleaning

SP 2-04.....No. 2, Hand Tool Cleaning

SP 3-04.....No. 3, Power Tool Cleaning

G. Federal Specifications (Fed. Spec):

RR-T-650E.....Treads, Metallic and Nonmetallic, Nonskid

**PART 2 - PRODUCTS**

**2.1 DESIGN CRITERIA**

A. In addition to the dead loads, design fabrications to support the  
following live loads unless otherwise specified.

B. Ladders and Rungs: 120 kg (250 pounds) at any point.

**2.2 MATERIALS**

A. Structural Steel: ASTM A36.

B. Stainless Steel: ASTM A240, Type 302 or 304.

C. Aluminum, Extruded: ASTM B221, Alloy 6063-T5 unless otherwise  
specified. For structural shapes use alloy 6061-T6 and alloy 6061-  
T4511.

D. Steel Pipe (Bollard): ASTM A53.

1. Galvanized for exterior locations.

2. Type S, Grade A unless specified otherwise.

3. NPS (inside diameter) as shown.

E. Cast-Iron: ASTM A48, Class 30, commercial pattern.

F. Malleable Iron Castings: A47.

G. Primer Paint: As specified in Section 09 91 00, PAINTING.

H. Stainless Steel Tubing: ASTM A269, type 302 or 304.

I. Modular Channel Units:

1. Factory fabricated, channel shaped, cold formed sheet steel shapes, complete with fittings bolts and nuts required for assembly.
2. Form channel within turned pyramid shaped clamping ridges on each side.
3. Provide case hardened steel nuts with serrated grooves in the top edges designed to be inserted in the channel at any point and be given a quarter turn so as to engage the channel clamping ridges. Provide each nut with a spring designed to hold the nut in place.
4. Factory finish channels and parts with oven baked primer when exposed to view. Channels fabricated of ASTM A525, G90 galvanized steel may have primer omitted in concealed locations. Finish screws and nuts with zinc coating.
5. Fabricate snap-in closure plates to fit and close exposed channel openings of not more than 0.3 mm (0.0125 inch) thick stainless steel.

J. Grout: ASTM C1107, pourable type.

### **2.3 HARDWARE**

A. Rough Hardware:

1. Furnish rough hardware with a standard plating, applied after punching, forming and assembly of parts; galvanized, cadmium plated, or zinc-coated by electro-galvanizing process. Galvanized G-90 where specified.
2. Use G90 galvanized coating on ferrous metal for exterior work unless non-ferrous metal or stainless is used.

B. Fasteners:

1. Bolts with Nuts:
  - a. ASME B18.2.2.
  - b. ASTM A307 for 415 MPa (60,000 psi) tensile strength bolts.
  - c. ASTM F468 for nonferrous bolts.
  - d. ASTM F593 for stainless steel.
2. Screws: ASME B18.6.1.
3. Washers: ASTM F436, type to suit material and anchorage.
4. Nails: ASTM F1667, Type I, style 6 or 14 for finish work.

### **2.4 FABRICATION GENERAL**

A. Material

1. Use material as specified. Use material of commercial quality and suitable for intended purpose for material that is not named or its standard of quality not specified.
2. Use material free of defects which could affect the appearance or service ability of the finished product.

B. Size:

1. Size and thickness of members as shown.
2. When size and thickness is not specified or shown for an individual part, use size and thickness not less than that used for the same component on similar standard commercial items or in accordance with established shop methods.

C. Connections

1. Except as otherwise specified, connections may be made by welding, riveting or bolting.
2. Field riveting will not be approved.
3. Design size, number and placement of fasteners, to develop a joint strength of not less than the design value.
4. Holes, for rivets and bolts: Accurately punched or drilled and burrs removed.
5. Size and shape welds to develop the full design strength of the parts connected by welds and to transmit imposed stresses without permanent deformation or failure when subject to service loadings.
6. Use Rivets and bolts of material selected to prevent corrosion (electrolysis) at bimetallic contacts. Plated or coated material will not be approved.
7. Use stainless steel connectors for removable members machine screws or bolts.

D. Fasteners and Anchors

1. Use methods for fastening or anchoring metal fabrications to building construction as shown or specified.
2. Where fasteners and anchors are not shown, design the type, size, location and spacing to resist the loads imposed without deformation of the members or causing failure of the anchor or fastener, and suit the sequence of installation.
3. Use material and finish of the fasteners compatible with the kinds of materials which are fastened together and their location in the finished work.

4. Fasteners for securing metal fabrications to new construction only, may be by use of threaded or wedge type inserts or by anchors for welding to the metal fabrication for installation before the concrete is placed or as masonry is laid.
5. Fasteners for securing metal fabrication to existing construction or new construction may be expansion bolts, toggle bolts, power actuated drive pins, welding, self-drilling and tapping screws or bolts.

E. Workmanship

1. General:

- a. Fabricate items to design shown.
- b. Furnish members in longest lengths commercially available within the limits shown and specified.
- c. Fabricate straight, true, free from warp and twist, and where applicable square and in same plane.
- d. Provide holes, sinkages and reinforcement shown and required for fasteners and anchorage items.
- e. Provide openings, cut-outs, and tapped holes for attachment and clearances required for work of other trades.
- f. Prepare members for the installation and fitting of hardware.
- g. Cut openings in gratings and floor plates for the passage of ducts, sumps, pipes, conduits and similar items. Provide reinforcement to support cut edges.
- h. Fabricate surfaces and edges free from sharp edges, burrs and projections which may cause injury.

2. Welding:

- a. Weld in accordance with AWS.
- b. Welds shall show good fusion, be free from cracks and porosity and accomplish secure and rigid joints in proper alignment.
- c. Where exposed in the finished work, continuous weld for the full length of the members joined and have depressed areas filled and protruding welds finished smooth and flush with adjacent surfaces.
- d. Finish welded joints to match finish of adjacent surface.

3. Joining:

- a. Miter or butt members at corners.
- b. Where frames members are butted at corners, cut leg of frame member perpendicular to surface, as required for clearance.

4. Anchors:

- a. Where metal fabrications are shown to be preset in concrete, weld 32 x 3 mm (1-1/4 by 1/8 inch) steel strap anchors, 150 mm (6 inches) long with 25 mm (one inch) hooked end, to back of member at 600 mm (2 feet) on center, unless otherwise shown.
- b. Where metal fabrications are shown to be built into masonry use 32 x 3 mm (1-1/4 by 1/8 inch) steel strap anchors, 250 mm (10 inches) long with 50 mm (2 inch) hooked end, welded to back of member at 600 mm (2 feet) on center, unless otherwise shown.

5. Cutting and Fitting:

- a. Accurately cut, machine and fit joints, corners, copes, and miters.
- b. Fit removable members to be easily removed.
- c. Design and construct field connections in the most practical place for appearance and ease of installation.
- d. Fit pieces together as required.
- e. Fabricate connections for ease of assembly and disassembly without use of special tools.
- f. Joints firm when assembled.
- g. Conceal joining, fitting and welding on exposed work as far as practical.
- h. Do not show rivets and screws prominently on the exposed face.
- i. The fit of components and the alignment of holes shall eliminate the need to modify component or to use exceptional force in the assembly of item and eliminate the need to use other than common tools.

F. Finish:

1. Finish exposed surfaces in accordance with NAAMM AMP 500 Metal Finishes Manual.
2. Aluminum: NAAMM AMP 501.
  - a. Mill finish, AA-M10, as fabricated, use unless specified otherwise.
  - b. Clear anodic coating, AA-C22A41, chemically etched medium matte, with Architectural Class 1, 0.7 mils or thicker.
  - c. Colored anodic coating, AA-C22A42, chemically etched medium matte with Architectural Class 1, 0.7 mils or thicker.
  - d. Painted: AA-C22R10.
3. Steel and Iron: NAAMM AMP 504.

- a. Zinc coated (Galvanized): ASTM A123, G90 unless noted otherwise.
  - b. Surfaces exposed in the finished work:
    - 1) Finish smooth rough surfaces and remove projections.
    - 2) Fill holes, dents and similar voids and depressions with epoxy type patching compound.
  - c. Shop Prime Painting:
    - 1) Surfaces of Ferrous metal:
      - a) Items not specified to have other coatings.
      - b) Galvanized surfaces specified to have prime paint.
      - c) Remove all loose mill scale, rust, and paint, by hand or power tool cleaning as defined in SSPC-SP2 and SP3.
      - d) Clean of oil, grease, soil and other detrimental matter by use of solvents or cleaning compounds as defined in SSPC-SP1.
      - e) After cleaning and finishing apply one coat of primer as specified in Section 09 91 00, PAINTING.
    - 2) Non ferrous metals: Comply with MAAMM-500 series.
  4. Stainless Steel: NAAMM AMP-504 Finish No. 4.
  5. Chromium Plating: ASTM B456, satin or bright as specified, Service Condition No. SC2.
- G. Protection:
1. Insulate aluminum surfaces that will come in contact with concrete, masonry, plaster, or metals other than stainless steel, zinc or white bronze by giving a coat of heavy-bodied alkali resisting bituminous paint or other approved paint in shop.
  2. Spot prime all abraded and damaged areas of zinc coating which expose the bare metal, using zinc rich paint on hot-dip zinc coat items and zinc dust primer on all other zinc coated items.

## 2.5 SUPPORTS

- A. General:
1. Fabricate ASTM A36 structural steel shapes as shown.
  2. Use clip angles or make provisions for welding hangers and braces to overhead construction.
  3. Field connections may be welded or bolted.
- B. For Wall Mounted Items:
1. For items supported by metal stud partitions.
  2. Steel strip or hat channel minimum of 1.5 mm (0.0598 inch) thick.

3. Steel strip minimum of 150 mm (6 inches) wide, length extending one stud space beyond end of item supported.
4. Steel hat channels where shown. Flange cut and flattened for anchorage to stud.
5. Structural steel tube or channel for grab bar at water closets floor to structure above with clip angles or end plates formed for anchors.
6. Use steel angles for thru wall counters. Drill angle for fasteners at ends and not over 100 mm (4 inches) on center between ends.

## **2.6 LADDERS**

### **A. Steel Ladders:**

1. Fixed-rail type with steel rungs shouldered and headed into and welded to rails.
2. Fabricate angle brackets of 50 mm (2 inch) wide by 13 mm (1/2 inch) thick steel; brackets spaced maximum of 1200 mm (4 feet) apart and of length to hold ladder 175 mm (7 inches) from wall to center of rungs. Provide turned ends or clips for anchoring.
3. Provide holes for anchoring with expansion bolts through turned ends and brackets.
4. Where shown, fabricate side rails curved, twisted and formed into a gooseneck.
5. Galvanize exterior ladders after fabrication, ASTM A123, G-90.

### **B. Ladder Rungs:**

1. Fabricate from 25 mm (one inch) diameter steel bars.
2. Fabricate so that rungs will extend at least 100 mm (4 inches) into wall with ends turned 50 mm (2 inches), project out from wall 175 mm (7 inches), be 400 mm (16 inches) wide and be designed so that foot cannot slide off end.
3. Galvanized after fabrication, ASTM A123, G-90 rungs for exterior use and for access to pits.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION, GENERAL**

- A. Set work accurately, in alignment and where shown, plumb, level, free of rack and twist, and set parallel or perpendicular as required to line and plane of surface.
- B. Items set into concrete or masonry.
  1. Provide temporary bracing for such items until concrete or masonry is set.



2. Place in accordance with setting drawings and instructions.
3. Build strap anchors, into masonry as work progresses.
- C. Set frames of gratings, covers, corner guards, trap doors and similar items flush with finish floor or wall surface and, where applicable, flush with side of opening.
- D. Field weld in accordance with AWS.
  1. Design and finish as specified for shop welding.
  2. Use continuous weld unless specified otherwise.
- E. Install anchoring devices and fasteners as shown and as necessary for securing metal fabrications to building construction as specified. Power actuated drive pins may be used except for removable items and where members would be deformed or substrate damaged by their use.
- F. Spot prime all abraded and damaged areas of zinc coating as specified and all abraded and damaged areas of shop prime coat with same kind of paint used for shop priming.
- G. Isolate aluminum from dissimilar metals and from contact with concrete and masonry materials as required to prevent electrolysis and corrosion.
- H. Secure escutcheon plate with set screw.

### **3.2 INSTALLATION OF SUPPORTS**

- A. Anchorage to structure.
  1. Secure angles or channels and clips to overhead structural steel by continuous welding unless bolting is shown.
  2. Secure supports to concrete inserts by bolting or continuous welding as shown.
  3. Secure supports to mid height of concrete beams when inserts do not exist with expansion bolts and to slabs, with expansion bolts. unless shown otherwise.
  4. Secure steel plate or hat channels to studs as detailed.
- B. Supports for Wall Mounted items:
  1. Locate center of support at anchorage point of supported item.
  2. Locate support at top and bottom of wall hung cabinets.
  3. Locate support at top of floor cabinets and shelving installed against walls.
  4. Locate supports where required for items shown.

### **3.3 LADDERS**

- A. Anchor ladders to walls and floors with expansion bolts through turned lugs or angle clips or brackets.

- B. In elevator pits, set ladders to clear all elevator equipment where shown on the drawings.
  - 1. Where ladders are interrupted by division beams, anchor ladders to beams by welding, and to floors with expansion bolts.
  - 2. Where ladders are adjacent to division beams, anchor ladders to beams with bent steel plates, and to floor with expansion bolts.
- C. Ladder Rungs:
  - 1. Set ladder rungs into formwork before concrete is placed.
  - 2. Set step portion of rung 150 mm (6 inches) from wall.
  - 3. Space rungs approximately 300 mm (12 inches) on centers.
  - 4. Where only one rung is required, locate it 400 mm (16 inches) above the floor.

### **3.4 CLEAN AND ADJUSTING**

- A. Adjust movable parts including hardware to operate as designed without binding or deformation of the members centered in the opening or frame and, where applicable, contact surfaces fit tight and even without forcing or warping the components.
- B. Clean after installation exposed prefinished and plated items and items fabricated from stainless steel, aluminum and copper alloys, as recommended by the metal manufacture and protected from damage until completion of the project.

- - - E N D - - -

**SECTION 07 84 00**  
**FIRESTOPPING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION:**

- A. Provide UL or equivalent approved firestopping system for the closures of openings in walls, floors, and roof decks against penetration of flame, heat, and smoke or gases in fire resistant rated construction.
- B. Provide UL or equivalent approved firestopping system for the closure of openings in walls against penetration of gases or smoke in smoke partitions.

**1.2 RELATED WORK:**

- A. Sealants and application: Section 07 92 00, JOINT SEALANTS.

**1.3 SUBMITTALS:**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Installer qualifications.
- C. Inspector qualifications.
- D. Manufacturers literature, data, and installation instructions for types of firestopping and smoke stopping used.
- E. List of FM, UL, or WH classification number of systems installed.
- F. Certified laboratory test reports for ASTM E814 tests for systems not listed by FM, UL, or WH proposed for use.
- G. Submit certificates from manufacturer attesting that firestopping materials comply with the specified requirements.

**1.4 DELIVERY AND STORAGE:**

- A. Deliver materials in their original unopened containers with manufacturer's name and product identification.
- B. Store in a location providing protection from damage and exposure to the elements.

**1.5 QUALITY ASSURANCE:**

- A. FM, UL, or WH or other approved laboratory tested products will be acceptable.
- B. Installer Qualifications: A firm that has been approved by FM Global according to FM Global 4991 or been evaluated by UL and found to comply with UL's "Qualified Firestop Contractor Program Requirements." Submit qualification data.
- C. Inspector Qualifications: Contractor to engage a qualified inspector to perform inspections and final reports. The inspector to meet the

criteria contained in ASTM E699 for agencies involved in quality assurance and to have a minimum of two years' experience in construction field inspections of firestopping systems, products, and assemblies. The inspector to be completely independent of, and divested from, the Contractor, the installer, the manufacturer, and the supplier of material or item being inspected. Submit inspector qualifications.

**1.6 APPLICABLE PUBLICATIONS**

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.
- B. ASTM International (ASTM):
  - E84-14.....Surface Burning Characteristics of Building Materials
  - E699-09.....Standard Practice for Evaluation of Agencies Involved in Testing, Quality Assurance, and Evaluating of Building Components
  - E814-13a.....Fire Tests of Through-Penetration Fire Stops
  - E2174-14.....Standard Practice for On-Site Inspection of Installed Firestops
  - E2393-10a.....Standard Practice for On-Site Inspection of Installed Fire Resistive Joint Systems and Perimeter Fire Barriers
- C. FM Global (FM):
  - Annual Issue Approval Guide Building Materials
  - 4991-13.....Approval of Firestop Contractors
- D. Underwriters Laboratories, Inc. (UL):
  - Annual Issue Building Materials Directory
  - Annual Issue Fire Resistance Directory
  - 723-10(2008).....Standard for Test for Surface Burning Characteristics of Building Materials
  - 1479-04(R2014).....Fire Tests of Through-Penetration Firestops
- E. Intertek Testing Services - Warnock Hersey (ITS-WH):
  - Annual Issue Certification Listings
- F. Environmental Protection Agency (EPA):
  - 40 CFR 59(2014).....National Volatile Organic Compound Emission Standards for Consumer and Commercial Products

**PART 2 - PRODUCTS**

**2.1 FIRESTOP SYSTEMS:**

- A. Provide either factory built (Firestop Devices) or field erected (through-Penetration Firestop Systems) to form a specific building system maintaining required integrity of the fire barrier and stop the passage of gases or smoke. Firestop systems to accommodate building movements without impairing their integrity.
- B. Through-penetration firestop systems and firestop devices tested in accordance with ASTM E814 or UL 1479 using the "F" or "T" rating to maintain the same rating and integrity as the fire barrier being sealed. "T" ratings are not required for penetrations smaller than or equal to 101 mm (4 in.) nominal pipe or 0.01 sq. m (16 sq. in.) in overall cross sectional area.
- C. Firestop sealants used for firestopping or smoke sealing to have the following properties:
  - 1. Contain no flammable or toxic solvents.
  - 2. Release no dangerous or flammable out gassing during the drying or curing of products.
  - 3. Water-resistant after drying or curing and unaffected by high humidity, condensation or transient water exposure.
  - 4. When installed in exposed areas, capable of being sanded and finished with similar surface treatments as used on the surrounding wall or floor surface.
  - 5. VOC Content: Firestopping sealants and sealant primers to comply with the following limits for VOC content when calculated according to 40 CFR 59, (EPA Method 24):
    - a. Sealants: 250 g/L.
    - b. Sealant Primers for Nonporous Substrates: 250 g/L.
    - c. Sealant Primers for Porous Substrates: 775 g/L.
- D. Firestopping system or devices used for penetrations by glass pipe, plastic pipe or conduits, unenclosed cables, or other non-metallic materials to have following properties:
  - 1. Classified for use with the particular type of penetrating material used.
  - 2. Penetrations containing loose electrical cables, computer data cables, and communications cables protected using firestopping systems that allow unrestricted cable changes without damage to the seal.

- E. Maximum flame spread of 25 and smoke development of 50 when tested in accordance with ASTM E84 or UL 723. Material to be an approved firestopping material as listed in UL Fire Resistance Directory or by a nationally recognized testing laboratory.
- F. FM, UL, or WH rated or tested by an approved laboratory in accordance with ASTM E814.
- G. Materials to be nontoxic and noncarcinogen at all stages of application or during fire conditions and to not contain hazardous chemicals. Provide firestop material that is free from Ethylene Glycol, PCB, MEK, and asbestos.
- H. For firestopping exposed to view, traffic, moisture, and physical damage, provide products that do not deteriorate when exposed to these conditions.
  - 1. For piping penetrations for plumbing and wet-pipe sprinkler systems, provide moisture-resistant through-penetration firestop systems.
  - 2. For floor penetrations with annular spaces exceeding 101 mm (4 in.) or more in width and exposed to possible loading and traffic, provide firestop systems capable of supporting the floor loads involved either by installing floor plates or by other means acceptable to the firestop manufacturer.
  - 3. For penetrations involving insulated piping, provide through-penetration firestop systems not requiring removal of insulation.

**2.2 SMOKE STOPPING IN SMOKE PARTITIONS:**

- A. Provide silicone sealant in smoke partitions as specified in Section 07 92 00, JOINT SEALANTS.
- B. Provide mineral fiber filler and bond breaker behind sealant.
- C. Sealants to have a maximum flame spread of 25 and smoke developed of 50 when tested in accordance with ASTM E84.
- D. When used in exposed areas capable of being sanded and finished with similar surface treatments as used on the surrounding wall or floor surface.

**PART 3 - EXECUTION**

**3.1 EXAMINATION:**

- A. Submit product data and installation instructions, as required by article, submittals, after an on-site examination of areas to receive firestopping.
- B. Examine substrates and conditions with installer present for compliance with requirements for opening configuration, penetrating items,

substrates, and other conditions affecting performance of firestopping.

Do not proceed with installation until unsatisfactory conditions have been corrected.

### **3.2 PREPARATION:**

- A. Remove dirt, grease, oil, laitance and form-release agents from concrete, loose materials, or other substances that prevent adherence and bonding or application of the firestopping or smoke stopping materials.
- B. Remove insulation on insulated pipe for a distance of 150 mm (6 inches) on each side of the fire rated assembly prior to applying the firestopping materials unless the firestopping materials are tested and approved for use on insulated pipes.
- C. Prime substrates where required by joint firestopping system manufacturer using that manufacturer's recommended products and methods. Confine primers to areas of bond; do not allow spillage and migration onto exposed surfaces.
- D. Masking Tape: Apply masking tape to prevent firestopping from contacting adjoining surfaces that will remain exposed upon completion of work and that would otherwise be permanently stained or damaged by such contact or by cleaning methods used to remove smears from firestopping materials. Remove tape as soon as it is possible to do so without disturbing seal of firestopping with substrates.

### **3.3 INSTALLATION:**

- A. Do not begin firestopping work until the specified material data and installation instructions of the proposed firestopping systems have been submitted and approved.
- B. Install firestopping systems with smoke stopping in accordance with FM, UL, WH, or other approved system details and installation instructions.
- C. Install smoke stopping seals in smoke partitions.

### **3.4 CLEAN-UP:**

- A. As work on each floor is completed, remove materials, litter, and debris.
- B. Clean up spills of liquid type materials.
- C. Clean off excess fill materials and sealants adjacent to openings and joints as work progresses by methods and with cleaning materials approved by manufacturers of firestopping products and of products in which opening and joints occur.

- D. Protect firestopping during and after curing period from contact with contaminating substances or from damage resulting from construction operations or other causes so that they are without deterioration or damage at time of Substantial Completion. If, despite such protection, damage or deterioration occurs, cut out and remove damaged or deteriorated firestopping immediately and install new materials to provide firestopping complying with specified requirements.

**3.5 INSPECTIONS AND ACCEPTANCE OF WORK:**

- A. Do not conceal or enclose firestop assemblies until inspection is complete and approved by the Contracting Officer Representative (COR).
- B. Furnish service of approved inspector to inspect firestopping in accordance with ASTM E2393 and ASTM E2174 for firestop inspection, and document inspection results. Submit written reports indicating locations of and types of penetrations and type of firestopping used at each location; type is to be recorded by UL listed printed numbers.

- - - E N D - - -



**SECTION 07 92 00**  
**JOINT SEALANTS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION:**

- A. This section covers interior and exterior sealant and their application, wherever required for complete installation of building materials or systems.

**1.2 RELATED WORK (INCLUDING BUT NOT LIMITED TO THE FOLLOWING):**

- A. Firestopping Penetrations: Section 07 84 00, FIRESTOPPING.
- B. Mechanical Work: COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

**1.3 QUALITY ASSURANCE:**

- A. Installer Qualifications: An experienced installer with a minimum of three (3) years' experience and who has specialized in installing joint sealants similar in material, design, and extent to those indicated for this Project and whose work has resulted in joint-sealant installations with a record of successful in-service performance. Submit qualification.
- B. Source Limitations: Obtain each type of joint sealant through one (1) source from a single manufacturer.
- C. Product Testing: Obtain test results from a qualified testing agency based on testing current sealant formulations within a 12-month period.
  - 1. Testing Agency Qualifications: An independent testing agency qualified according to ASTM C1021.
  - 2. Test elastomeric joint sealants for compliance with requirements specified by reference to ASTM C920, and where applicable, to other standard test methods.
  - 3. Test elastomeric joint sealants according to SWRI's Sealant Validation Program for compliance with requirements specified by reference to ASTM C920 for adhesion and cohesion under cyclic movement, adhesion-in peel, and indentation hardness.
  - 4. Test other joint sealants for compliance with requirements indicated by referencing standard specifications and test methods.
- D. Lab Tests: Submit samples of materials that will be in contact or affect joint sealants to joint sealant manufacturers for tests as follows:
  - 1. Adhesion Testing: Before installing elastomeric sealants, test their adhesion to protect joint substrates according to the method in

- ASTM C794 to determine if primer or other specific joint preparation techniques are required.
2. Compatibility Testing: Before installing elastomeric sealants, determine compatibility when in contact with glazing and gasket materials.
  3. Stain Testing: Perform testing per ASTM C1248 on interior and exterior sealants to determine if sealants or primers will stain adjacent surfaces. No sealant work is to start until results of these tests have been submitted to the Contracting Officer Representative (COR) and the COR has given written approval to proceed with the work.

**1.4 CERTIFICATION:**

- A. Contractor is to submit to the COR written certification that joints are of the proper size and design, that the materials supplied are compatible with adjacent materials and backing, that the materials will properly perform to provide permanent watertight, airtight or vapor tight seals (as applicable), and that materials supplied meet specified performance requirements.

**1.5 SUBMITTALS:**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Installer qualifications.
- C. Contractor certification.
- D. Manufacturer's installation instructions for each product used.
- E. Cured samples of exposed sealants for each color.
- F. Manufacturer's Literature and Data:
  1. Primers
  2. Sealing compound, each type, including compatibility when different sealants are in contact with each other.
- G. Manufacturer warranty.

**1.6 PROJECT CONDITIONS:**

- A. Environmental Limitations:
  1. Do not proceed with installation of joint sealants under following conditions:
    - a. When ambient and substrate temperature conditions are outside limits permitted by joint sealant manufacturer or are below 4.4 degrees C (40 degrees F).

- b. When joint substrates are wet.
- B. Joint-Width Conditions:
  - 1. Do not proceed with installation of joint sealants where joint widths are less than those allowed by joint sealant manufacturer for applications indicated.
- C. Joint-Substrate Conditions:
  - 1. Do not proceed with installation of joint sealants until contaminants capable of interfering with adhesion are removed from joint substrates.

**1.7 DELIVERY, HANDLING, AND STORAGE:**

- A. Deliver materials in manufacturers' original unopened containers, with brand names, date of manufacture, shelf life, and material designation clearly marked thereon.
- B. Carefully handle and store to prevent inclusion of foreign materials.
- C. Do not subject to sustained temperatures exceeding 32 degrees C (90 degrees F) or less than 5 degrees C (40 degrees F).

**1.8 DEFINITIONS:**

- A. Definitions of terms in accordance with ASTM C717 and as specified.
- B. Backing Rod: A type of sealant backing.
- C. Bond Breakers: A type of sealant backing.
- D. Filler: A sealant backing used behind a back-up rod.

**1.9 WARRANTY:**

- A. Construction Warranty: Comply with FAR clause 52.246-21 "Warranty of Construction".
- B. Manufacturer Warranty: Manufacturer shall warranty their sealant for a minimum of five (5) years from the date of installation and final acceptance by the Government. Submit manufacturer warranty.

**1.10 APPLICABLE PUBLICATIONS:**

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.
- B. ASTM International (ASTM):
  - C509-06.....Elastomeric Cellular Preformed Gasket and Sealing Material
  - C612-14.....Mineral Fiber Block and Board Thermal Insulation

- C717-14a.....Standard Terminology of Building Seals and Sealants
- C734-06(R2012).....Test Method for Low-Temperature Flexibility of Latex Sealants after Artificial Weathering
- C794-10.....Test Method for Adhesion-in-Peel of Elastomeric Joint Sealants
- C919-12.....Use of Sealants in Acoustical Applications.
- C920-14a.....Elastomeric Joint Sealants.
- C1021-08(R2014).....Laboratories Engaged in Testing of Building Sealants
- C1193-13.....Standard Guide for Use of Joint Sealants.
- C1248-08(R2012).....Test Method for Staining of Porous Substrate by Joint Sealants
- C1330-02(R2013).....Cylindrical Sealant Backing for Use with Cold Liquid Applied Sealants
- C1521-13.....Standard Practice for Evaluating Adhesion of Installed Weatherproofing Sealant Joints
- D217-10.....Test Methods for Cone Penetration of Lubricating Grease
- D1056-14.....Specification for Flexible Cellular Materials—Sponge or Expanded Rubber
- E84-09.....Surface Burning Characteristics of Building Materials
- C. Sealant, Waterproofing and Restoration Institute (SWRI).  
The Professionals' Guide
- D. Environmental Protection Agency (EPA):  
40 CFR 59(2014).....National Volatile Organic Compound Emission Standards for Consumer and Commercial Products

**PART 2 - PRODUCTS**

**2.1 SEALANTS:**

- A. Interior Sealants:
1. VOC Content of Interior Sealants: Sealants and sealant primers used inside the weatherproofing system are to comply with the following limits for VOC content when calculated according to 40 CFR 59, (EPA Method 24):
    - a. Architectural Sealants: 250 g/L.
    - b. Sealant Primers for Nonporous Substrates: 250 g/L.

- c. Sealant Primers for Porous Substrates: 775 g/L.
- 2. S-1 Vertical and Horizontal Surfaces: ASTM C920, Type S or M, Grade NS, Class 25.
- 3. Provide location(s) of interior sealant as follows:
  - a. Typical narrow joint 6 mm, (1/4 inch) or less at walls and adjacent components.
  - b. Perimeter of doors, windows, access panels which adjoin concrete or masonry surfaces.
  - c. Interior surfaces of exterior wall penetrations.
  - d. Joints at masonry walls and columns, piers, concrete walls or exterior walls.
  - e. Exposed isolation joints at top of full height walls.

**2.2 COLOR:**

- A. Sealants used with exposed masonry are to match color of mortar joints.
- B. Sealants used with unpainted concrete are to match color of adjacent concrete.
- C. Color of sealants for other locations to be light gray or aluminum, unless otherwise indicated in construction documents.

**2.3 JOINT SEALANT BACKING:**

- A. General: Provide sealant backings of material and type that are nonstaining; are compatible with joint substrates, sealants, primers, and other joint fillers; and are approved for applications indicated by sealant manufacturer based on field experience and laboratory testing.
- B. Cylindrical Sealant Backings: ASTM C1330, of type indicated below and of size and density to control sealant depth and otherwise contribute to producing optimum sealant performance:
  - 1. Type C: Closed-cell material with a surface skin.
- C. Elastomeric Tubing Sealant Backings: Neoprene, butyl, EPDM, or silicone tubing complying with ASTM D1056 or synthetic rubber (ASTM C509), nonabsorbent to water and gas, and capable of remaining resilient at temperatures down to minus 32 degrees C (minus 26 degrees F). Provide products with low compression set and of size and shape to provide a secondary seal, to control sealant depth, and otherwise contribute to optimum sealant performance.
- D. Bond-Breaker Tape: Polyethylene tape or other plastic tape recommended by sealant manufacturer for preventing sealant from adhering to rigid, inflexible joint-filler materials or joint surfaces at back of joint

where such adhesion would result in sealant failure. Provide self-adhesive tape where applicable.

**2.4 FILLER:**

- A. Mineral fiberboard: ASTM C612, Class 1.
- B. Thickness same as joint width.
- C. Depth to fill void completely behind back-up rod.

**2.5 PRIMER:**

- A. As recommended by manufacturer of caulking or sealant material.
- B. Stain free type.

**2.6 CLEANERS-NON POROUS SURFACES:**

- A. Chemical cleaners compatible with sealant and acceptable to manufacturer of sealants and sealant backing material. Cleaners to be free of oily residues and other substances capable of staining or harming joint substrates and adjacent non-porous surfaces and formulated to promote adhesion of sealant and substrates.

**PART 3 - EXECUTION**

**3.1 INSPECTION:**

- A. Inspect substrate surface for bond breaker contamination and unsound materials at adherent faces of sealant.
- B. Coordinate for repair and resolution of unsound substrate materials.
- C. Inspect for uniform joint widths and that dimensions are within tolerance established by sealant manufacturer.

**3.2 PREPARATIONS:**

- A. Prepare joints in accordance with manufacturer's instructions and SWRI (The Professionals' Guide).
- B. Clean surfaces of joint to receive caulking or sealants leaving joint dry to the touch, free from frost, moisture, grease, oil, wax, lacquer paint, or other foreign matter that would tend to destroy or impair adhesion.
  - 1. Clean porous joint substrate surfaces by brushing, grinding, blast cleaning, mechanical abrading, or a combination of these methods to produce a clean, sound substrate capable of developing optimum bond with joint sealants.
  - 2. Remove loose particles remaining from above cleaning operations by vacuuming or blowing out joints with oil-free compressed air. Porous joint surfaces include but are not limited to the following:
    - a. Concrete.

- b. Masonry.
- 3. Remove laitance and form-release agents from concrete.
- 4. Clean nonporous surfaces with chemical cleaners or other means that do not stain, harm substrates, or leave residues capable of interfering with adhesion of joint sealants. Nonporous surfaces include but are not limited to the following:
  - a. Metal.
- C. Do not cut or damage joint edges.
- D. Apply non-staining masking tape to face of surfaces adjacent to joints before applying primers, caulking, or sealing compounds.
  - 1. Do not leave gaps between ends of sealant backings.
  - 2. Do not stretch, twist, puncture, or tear sealant backings.
  - 3. Remove absorbent sealant backings that have become wet before sealant application and replace them with dry materials.
- E. Apply primer to sides of joints wherever required by compound manufacturer's printed instructions or as indicated by pre-construction joint sealant substrate test.
  - 1. Apply primer prior to installation of back-up rod or bond breaker tape.
  - 2. Use brush or other approved means that will reach all parts of joints. Avoid application to or spillage onto adjacent substrate surfaces.

### **3.3 BACKING INSTALLATION:**

- A. Install backing material, to form joints enclosed on three sides as required for specified depth of sealant.
- B. Where deep joints occur, install filler to fill space behind the backing rod and position the rod at proper depth.
- C. Cut fillers installed by others to proper depth for installation of backing rod and sealants.
- D. Install backing rod, without puncturing the material, to a uniform depth, within plus or minus 3 mm (1/8 inch) for sealant depths specified.
- E. Where space for backing rod does not exist, install bond breaker tape strip at bottom (or back) of joint so sealant bonds only to two opposing surfaces.

### **3.4 SEALANT DEPTHS AND GEOMETRY:**

- A. At widths up to 6 mm (1/4 inch), sealant depth equal to width.

- B. At widths over 6 mm (1/4 inch), sealant depth 1/2 of width up to 13 mm (1/2 inch) maximum depth at center of joint with sealant thickness at center of joint approximately 1/2 of depth at adhesion surface.

**3.5 INSTALLATION:**

A. General:

1. Apply sealants and caulking only when ambient temperature is between 5 degrees C and 38 degrees C (40 degrees and 100 degrees F).
  2. Do not install polysulfide base sealants where sealant may be exposed to fumes from bituminous materials, or where water vapor in continuous contact with cementitious materials may be present.
  3. Do not install sealant type listed by manufacture as not suitable for use in locations specified.
  4. Apply caulking and sealing compound in accordance with manufacturer's printed instructions.
  5. Avoid dropping or smearing compound on adjacent surfaces.
  6. Fill joints solidly with compound and finish compound smooth.
  7. Tool exposed joints to form smooth and uniform beds, with slightly concave surface conforming to joint configuration per Figure 5A in ASTM C1193 unless shown or specified otherwise in construction documents. Remove masking tape immediately after tooling of sealant and before sealant face starts to "skin" over. Remove any excess sealant from adjacent surfaces of joint, leaving the working in a clean finished condition.
  8. Finish paving or floor joints flush unless joint is otherwise detailed.
  9. Apply compounds with nozzle size to fit joint width.
  10. Test sealants for compatibility with each other and substrate. Use only compatible sealant. Submit test reports.
  11. Replace sealant which is damaged during construction process.
- B. For application of sealants, follow requirements of ASTM C1193 unless specified otherwise. Take all necessary steps to prevent three-sided adhesion of sealants.
- C. Interior Sealants: Where gypsum board partitions are of sound rated, fire rated, or smoke barrier construction, follow requirements of ASTM C919 only to seal all cut-outs and intersections with the adjoining construction unless specified otherwise.



1. Apply a 6 mm (1/4 inch) minimum bead of sealant each side of runners (tracks), including those used at partition intersections with dissimilar wall construction.
2. Coordinate with application of gypsum board to install sealant immediately prior to application of gypsum board.
3. Partition intersections: Seal edges of face layer of gypsum board abutting intersecting partitions, before taping and finishing or application of veneer plaster-joint reinforcing.
4. Openings: Apply a 6 mm (1/4 inch) bead of sealant around all cutouts to seal openings of electrical boxes, ducts, pipes and similar penetrations. To seal electrical boxes, seal sides and backs.
5. Control Joints: Before control joints are installed, apply sealant in back of control joint to reduce flanking path for sound through control joint.

**3.6 FIELD QUALITY CONTROL:**

- A. Inspect joints for complete fill, for absence of voids, and for joint configuration complying with specified requirements. Record results in a field adhesion test log.
- B. Inspect tested joints and report on following:
  1. Whether sealants in joints connected to pulled-out portion failed to adhere to joint substrates or tore cohesively. Include data on pull distance used to test each type of product and joint substrate.
  2. Compare these results to determine if adhesion passes sealant manufacturer's field-adhesion hand-pull test criteria.
  3. Whether sealants filled joint cavities and are free from voids.
  4. Whether sealant dimensions and configurations comply with specified requirements.
- C. Repair sealants pulled from test area by applying new sealants following same procedures used to originally seal joints. Ensure that original sealant surfaces are clean and new sealant contacts original sealant.
- D. Evaluation of Field-Test Results: Sealants not evidencing adhesive failure from testing or noncompliance with other indicated requirements, will be considered satisfactory. Remove sealants that fail to adhere to joint substrates during testing or to comply with other requirements. Retest failed applications until test results prove sealants comply with indicated requirements.

**3.7 CLEANING:**

- A. Fresh compound accidentally smeared on adjoining surfaces: Scrape off immediately and rub clean with a solvent as recommended by manufacturer of the adjacent material or if not otherwise indicated by the caulking or sealant manufacturer.
- B. Leave adjacent surfaces in a clean and unstained condition.

- - - E N D - - -

**SECTION 08 11 13  
HOLLOW METAL DOORS AND FRAMES**

**PART 1 - GENERAL**

**1.1 SUMMARY**

A. Section Includes:

1. Hollow metal doors hung in hollow metal frames at locations.

**1.2 RELATED REQUIREMENTS**

- A. Door Hardware: Section 08 71 00, DOOR HARDWARE.

**1.3 APPLICABLE PUBLICATIONS**

- A. Comply with references to extent specified in this section.

B. American National Standard Institute (ANSI):

1. A250.8-2014 - Standard Steel Doors and Frames.

C. ASTM International (ASTM):

1. A240/A240M-15b - Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and for General Applications.
2. A653/A653M-15 - Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip.
3. A1008/A1008M-15 - Steel, Sheet, Cold-Rolled, Carbon, Structural, High Strength Low Alloy and High Strength Low Alloy with Improved Formability, Solution Hardened, and Bake Hardenable.
4. B209-14 - Aluminum and Aluminum-Alloy Sheet and Plate.
5. B209M-14 - Aluminum and Aluminum-Alloy Sheet and Plate (Metric).
6. B221-14 - Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes.
7. B221M-13 - Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes (Metric).
8. D3656/D3656M-13 - Insect Screening and Louver Cloth Woven from Vinyl Coated Glass Yarns.
9. E90-09 - Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions and Elements.

D. Federal Specifications (Fed. Spec.):

1. L-S-125B - Screening, Insect, Nonmetallic.

E. Master Painters Institute (MPI):

1. No. 18 - Primer, Zinc Rich, Organic.

F. National Association of Architectural Metal Manufacturers (NAAMM):

1. AMP 500-06 - Metal Finishes Manual.

G. National Fire Protection Association (NFPA):

1. 80-16 - Fire Doors and Other Opening Protectives.

H. UL LLC (UL):

1. 10C-09 - Positive Pressure Fire Tests of Door Assemblies.
2. 1784-15 - Air Leakage Tests of Door Assemblies and Other Opening Protectives.

**1.4 SUBMITTALS**

A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Submittal Drawings:

1. Show size, configuration, and fabrication and installation details.

C. Manufacturer's Literature and Data:

1. Description of each product.
2. Include schedule showing each door and frame requirements fire label and smoke control label for openings.
3. Installation instructions.

D. Qualifications: Substantiate qualifications comply with specifications.

1. Manufacturer with project experience list.

**1.5 QUALITY ASSURANCE**

A. Manufacturer Qualifications:

1. Regularly manufactures specified products.
2. Manufactured specified products with satisfactory service on five similar installations for minimum five years.
  - a. Project Experience List: Provide contact names and addresses for completed projects.

**1.6 DELIVERY**

A. Fasten temporary steel spreaders across the bottom of each door frame before shipment.

B. Deliver products in manufacturer's original sealed packaging.

C. Mark packaging, legibly. Indicate manufacturer's name or brand, type, production run number, and manufacture date.

D. Before installation, return or dispose of products within distorted, damaged, or opened packaging.

**1.7 STORAGE AND HANDLING**

A. Store products indoors in dry, weathertight facility.

- B. Protect products from damage during handling and construction operations.

**1.8 WARRANTY**

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."

**PART 2 - PRODUCTS**

**2.1 SYSTEM PERFORMANCE**

- A. Design hollow metal doors and frames complying with specified performance:
  - 1. Fire Doors and Frames: UL 10C; NFPA 80 labeled.
    - a. Fire Ratings: See drawings.

**2.2 MATERIALS**

- A. Sheet Steel: ASTM A1008/A1008M, cold-rolled.
- B. Galvanized Sheet Steel: ASTM A653.

**2.3 PRODUCTS - GENERAL**

- A. Basis of Design: Section 09 06 00, SCHEDULE FOR FINISHES.
- B. Provide hollow metal doors and frames from one manufacturer.

**2.4 HOLLOW METAL DOORS**

- A. Hollow Metal Doors: ANSI A250.8; 44 mm (1-3/4 inches) thick.
  - 1. Interior Doors: Level 1 and Physical Performance Level C, standard duty; Model 2, seamless at designated locations.
- B. Door Faces
  - 1. Interior Doors: Sheet steel.
- C. Door Cores:
  - 1. Interior Doors: Kraft paper honeycomb or vertical steel stiffeners .
  - 2. Fire Doors: Manufacturer's standard complying with specified fire rating performance.

**2.5 HOLLOW METAL FRAMES**

- A. Hollow Metal Frames: ANSI A250.8; Knock-down. See drawings for sizes and designs.
  - 1. Interior Frames:
    - a. Level 1 Hollow Metal Doors: 1.0 mm (0.042 inch) thick.
- B. Frame Materials:
  - 1. Interior Frames: Sheet steel.

## 2.6 FABRICATION

- A. Hardware Preparation: ANSI A250.8; for hardware specified in Section 08 71 00, DOOR HARDWARE.
- B. Fire and Smoke Control Doors:
  - 1. Close top and vertical edges flush.
  - 2. Fire and Smoke Control Door Clearances: NFPA 80.
- C. Custom Metal Hollow Doors:
  - 1. Provide custom hollow metal doors where nonstandard steel doors are shown on drawings.
    - a. Provide door sizes, design, materials, construction, gages, and finish as specified for standard steel doors.
- D. Hollow Metal Frame Fabrication:
  - 1. Fasten mortar guards to back of hardware reinforcements.
  - 2. Concealed Closers in Head Frame: Provide 1 mm (0.042 inch) thick steel removable stop sections for access to concealed face plates and control valves, except when cover plates are furnished with closer.  
  
Terminated Stops: ANSI A250.8.: Two-piece frames are not used except for formed openings where frame is not pre-set in concrete, masonry walls, or in existing construction, and where sill sections occur under panel or glazed areas. Verify that details do not conflict.
  - 3. Frame Anchors:
    - a. Floor anchors:
      - 1) Provide extension type floor anchors to compensate for depth of floor fills.
      - 2) Provide 1.3 mm (0.053 inch) thick steel clip angles welded to jamb and drilled to receive floor fasteners.
      - 3) Provide 50 mm by 50 mm by 9 mm (2 inch by 2 inch by 3/8 inch) clip angle for lead lined frames, drilled for floor fasteners.
      - 4) Provide mullion 2.3 mm (0.093 inch) thick steel channel anchors, drilled for two floor fasteners and frame anchor screws.
      - 5) Provide continuous 1 mm (0.042 inch) thick steel rough bucks drilled for floor fasteners and frame anchor screws for sill sections.
        - a) Space floor bolts 50 mm (2 inches) on center.

b. Jamb anchors:

- 1) Place anchors on jambs:
  - a) Near top and bottom of each frame.
  - b) At intermediate points at maximum 600 mm (24 inches) spacing.
- 2) Form jamb anchors from steel minimum 1 mm (0.042 inch) thick.
- 3) Anchors for stud partitions: Provide tabs for securing anchor to sides of studs. Provide one of the following:
  - a) Welded type.
  - b) Lock-in snap-in type.
- 4) Anchors for frames set in prepared openings:
  - a) Steel pipe spacers 6 mm (1/4 inch) inside diameter, welded to plate reinforcing at jamb stops, or hat shaped formed strap spacers 50 mm (2 inches) wide, welded to jamb near stop.
  - b) Drill jamb stop and strap spacers for 6 mm (1/4 inch) flat head bolts to pass through frame and spacers.
  - c) Two piece frames: Subframe or rough buck drilled for 6 mm (1/4 inch) bolts.
- 5) Anchors for observation windows and other continuous frames set in stud partitions.
  - a) Weld clip anchors to sills and heads of continuous frames over 1200 mm (4 feet) long.
  - b) Space maximum 600 mm (24 inches) on centers.
- 6) Modify frame anchors to fit special frame and wall construction.
- 7) Provide special anchors where shown on drawings and where required to suit application.

**2.7 FINISHES**

- A. Steel: ANSI A250.8; shop primed.
- B. Finish exposed surfaces after fabrication.

**2.8 ACCESSORIES**

- A. Primers: ANSI A250.8.
- B. Barrier Coating: ASTM D1187/D1187M.
- C. Welding Materials: AWS D1.1/D1.1M, type to suit application.
- D. Clips Connecting Members and Sleeves: Match door faces.

- E. Fasteners: Galvanized steel.
  - 1. Metal Framing: Steel drill screws.
  - 2. Masonry and Concrete: Expansion bolts and power actuated drive pins.
- F. Anchors: Galvanized steel.
- G. Galvanizing Repair Paint: MPI No. 18.
- H. Insulation: Unfaced mineral wool.

### **PART 3 - EXECUTION**

#### **3.1 PREPARATION**

- A. Examine and verify substrate suitability for product installation.
- B. Protect existing construction and completed work from damage.
- C. Apply barrier coating to metal surfaces in contact with cementitious materials to minimum 0.7 mm (30 mils) dry film thickness.

#### **3.2 INSTALLATION - GENERAL**

- A. Install products according to manufacturer's instructions.
  - 1. When manufacturer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.
  - 2. Install fire doors and frames according to NFPA 80.
  - 3. Install smoke control doors and frames according to NFPA 105.

#### **3.3 FRAME INSTALLATION**

- A. Apply barrier coating to concealed surfaces of frames built into masonry.
- B. Plumb, align, and brace frames until permanent anchors are set.
  - 1. Use triangular bracing near each corner on both sides of frames with temporary wood spreaders at midpoint.
  - 2. Use wood spreaders at bottom of frame when shipping spreader is removed.
  - 3. Where construction permits concealment, leave shipping spreaders in place after installation, otherwise remove spreaders when frames are set and anchored.
  - 4. Remove wood spreaders and braces when walls are built and jamb anchors are secured.
- C. Floor Anchors:
  - 1. Anchor frame jambs to floor with two expansion bolts.
    - a. Other Frames: Use 6 mm (1/4 inch) diameter bolts.



2. Power actuated drive pins are acceptable to secure frame anchors to concrete floors.

D. Jamb Anchors:

1. Metal Framed Walls: Secure anchors to sides of studs with two fasteners through anchor tabs.

E. Touch up damaged factory finishes.

1. Repair galvanized surfaces with galvanized repair paint.
2. Repair painted surfaces with touch up primer.

**3.4 DOOR INSTALLATION**

- A. Install doors plumb and level.

- B. Adjust doors for smooth operation.

- C. Touch up damaged factory finishes.

1. Repair galvanized surfaces with galvanized repair paint.
2. Repair painted surfaces with touch up primer.

**3.5 CLEANING**

- A. Clean exposed door and frame surfaces. Remove contaminants and stains.

**3.6 PROTECTION**

- A. Protect doors and frames from traffic and construction operations.

- B. Remove protective materials immediately before acceptance.

- C. Repair damage.

- - - E N D - - -

**SECTION 08 71 00**  
**DOOR HARDWARE**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Door hardware and related items necessary for complete installation and operation of doors.

**1.2 RELATED WORK**

- A. Caulking: Section 07 92 00 JOINT SEALANTS.
- B. Application of Hardware: Section 08 11 13, HOLLOW METAL DOORS AND FRAMES
- C. Finishes: Section 09 06 00, SCHEDULE FOR FINISHES.
- D. Painting: Section 09 91 00, PAINTING.

**1.3 GENERAL**

- A. All hardware shall comply with UFAS, (Uniform Federal Accessible Standards) unless specified otherwise.
- B. Provide rated door hardware assemblies where required by most current version of the International Building Code (IBC).
- C. Hardware for Labeled Fire Doors and Exit Doors: Conform to requirements of NFPA 80 for labeled fire doors and to NFPA 101 for exit doors, as well as to other requirements specified. Provide hardware listed by UL, except where heavier materials, large size, or better grades are specified herein under paragraph HARDWARE SETS. In lieu of UL labeling and listing, test reports from a nationally recognized testing agency may be submitted showing that hardware has been tested in accordance with UL test methods and that it conforms to NFPA requirements.
- D. Hardware for application on metal and wood doors and frames shall be made to standard templates. Furnish templates to the fabricator of these items in sufficient time so as not to delay the construction.
- E. The following items shall be of the same manufacturer, except as otherwise specified:
  - 1. Mortise locksets.
  - 2. Hinges for hollow metal and wood doors.
  - 3. Surface applied overhead door closers.
  - 4. Exit devices.
  - 5. Floor closers.

**1.4 MAINTENANCE MANUALS**

A. In accordance with Section 01 00 00, GENERAL REQUIREMENTS Article titled "INSTRUCTIONS", furnish maintenance manuals and instructions on all door hardware. Provide installation instructions with the submittal documentation.

**1.5 SUBMITTALS**

A. Submittals shall be in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES. Submit 6 copies of the schedule per Section 01 33 23. Submit 2 final copies of the final approved schedules to VAMC Locksmith as record copies (VISN Locksmith if the VAMC does not have a locksmith).

B. Hardware Schedule: Prepare and submit hardware schedule in the following form:

Hardware Item	Quantity	Size	Reference Publication Type No.	Finish	Mfr. Name and Catalog No.	Key Control Symbols	UL Mark (if fire rated and listed)	ANSI/BHMA Finish Designation

C. Samples and Manufacturers' Literature:

1. Samples: All hardware items (proposed for the project) that have not been previously approved by Builders Hardware Manufacturers Association shall be submitted for approval. Tag and mark all items with manufacturer's name, catalog number and project number.
2. Samples are not required for hardware listed in the specifications by manufacturer's catalog number, if the contractor proposes to use the manufacturer's product specified.

D. Certificate of Compliance and Test Reports: Submit certificates that hardware conforms to the requirements specified herein. Certificates shall be accompanied by copies of reports as referenced. The testing shall have been conducted either in the manufacturer's plant and certified by an independent testing laboratory or conducted in an independent laboratory, within four years of submittal of reports for approval.

#### **1.6 DELIVERY AND MARKING**

- A. Deliver items of hardware to job site in their original containers, complete with necessary appurtenances including screws, keys, and instructions. Tag one of each different item of hardware and deliver to COR for reference purposes. Tag shall identify items by Project Specification number and manufacturer's catalog number. These items shall remain on file in COR's office until all other similar items have been installed in project, at which time the COR will deliver items on file to Contractor for installation in predetermined locations on the project.

#### **1.7 PREINSTALLATION MEETING**

- A. Convene a preinstallation meeting not less than 30 days before start of installation of door hardware. Require attendance of parties directly affecting work of this section, including Contractor and Installer, Architect, Project Engineer and VA Locksmith, Hardware Consultant, and Hardware Manufacturer's Representative. Review the following:
1. Inspection of door hardware.
  2. Job and surface readiness.
  3. Coordination with other work.
  4. Protection of hardware surfaces.
  5. Substrate surface protection.
  6. Installation.
  7. Adjusting.
  8. Repair.
  9. Field quality control.
  10. Cleaning.

#### **1.8 INSTRUCTIONS**

- A. Hardware Set Symbols on Drawings: Except for protective plates, door stops, mutes, thresholds and the like specified herein, hardware requirements for each door are indicated on drawings by symbols. Symbols for hardware sets consist of letters (e.g., "HW") followed by a number. Each number designates a set of hardware items applicable to a door type.
- B. Keying: All cylinders shall be keyed into existing Grand Master Key System. Keying information shall be furnished at a later date by the COR.

**1.9 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. In text, hardware items are referred to by series, types, etc., listed in such specifications and standards, except as otherwise specified.
- B. American Society for Testing and Materials (ASTM):
  - F883-04.....Padlocks
  - E2180-07.....Standard Test Method for Determining the  
Activity of Incorporated Antimicrobial Agent(s)  
In Polymeric or Hydrophobic Materials
- C. American National Standards Institute/Builders Hardware Manufacturers Association (ANSI/BHMA):
  - A156.1-06.....Butts and Hinges
  - A156.2-03.....Bored and Pre-assembled Locks and Latches
  - A156.3-08.....Exit Devices, Coordinators, and Auto Flush  
Bolts
  - A156.4-08.....Door Controls (Closers)
  - A156.5-14.....Cylinders and Input Devices for Locks.
  - A156.6-05.....Architectural Door Trim
  - A156.8-05.....Door Controls-Overhead Stops and Holders
  - A156.11-14.....Cabinet Locks
  - A156.12-05 .....Interconnected Locks and Latches
  - A156.13-05.....Mortise Locks and Latches Series 1000
  - A156.14-07 .....Sliding and Folding Door Hardware
  - A156.15-06.....Release Devices-Closer Holder, Electromagnetic  
and Electromechanical
  - A156.16-08.....Auxiliary Hardware
  - A156.17-04 .....Self-Closing Hinges and Pivots
  - A156.18-06.....Materials and Finishes
  - A156.20-06 .....Strap and Tee Hinges, and Hasps
  - A156.21-09.....Thresholds
  - A156.22-05.....Door Gasketing and Edge Seal Systems
  - A156.23-04.....Electromagnetic Locks
  - A156.24-03.....Delayed Egress Locking Systems
  - A156.25-07 .....Electrified Locking Devices
  - A156.26-06.....Continuous Hinges

- A156.28-07 .....Master Keying Systems
- A156.29-07 .....Exit Locks and Alarms
- A156.30-03 .....High Security Cylinders
- A156.31-07 .....Electric Strikes and Frame Mounted Actuators
- A156.36-10.....Auxiliary Locks
- A250.8-03.....Standard Steel Doors and Frames

D. National Fire Protection Association (NFPA):

- 80-10.....Fire Doors and Other Opening Protectives
- 101-09.....Life Safety Code

E. Underwriters Laboratories, Inc. (UL):

Building Materials Directory (2008)

**PART 2 - PRODUCTS**

**2.1 BUTT HINGES**

A. ANSI A156.1. Provide only three-knuckle hinges, except five-knuckle where the required hinge type is not available in a three-knuckle version (e.g., some types of swing-clear hinges). The following types of butt hinges shall be used for the types of doors listed, except where otherwise specified:

1. Interior Doors: Type A8112/A5112 for doors 900 mm (3 feet) wide or less and Type A8111/A5111 for doors over 900 mm (3 feet) wide. Hinges for doors exposed to high humidity areas (shower rooms, toilet rooms, kitchens, janitor rooms, etc. shall be of stainless steel material.

B. Provide quantity and size of hinges per door leaf as follows:

1. Doors up to 1210 mm (4 feet) high: 2 hinges.
2. Doors 1210 mm (4 feet) to 2260 mm (7 feet 5 inches) high: 3 hinges minimum.
3. Doors greater than 2260 mm (7 feet 5 inches) high: 4 hinges.
4. Doors up to 900 mm (3 feet) wide, standard weight: 114 mm x 114 mm (4-1/2 inches x 4-1/2 inches) hinges.
5. Doors over 900 mm (3 feet) to 1065 mm (3 feet 6 inches) wide, standard weight: 127 mm x 114 mm (5 inches x 4-1/2 inches).
6. Doors over 1065 mm (3 feet 6 inches) to 1210 mm (4 feet), heavy weight: 127 mm x 114 mm (5 inches x 4-1/2 inches).
7. Provide heavy-weight hinges where specified.
8. At doors weighing 330 kg (150 lbs.) or more, furnish 127 mm (5 inch) high hinges.

- C. See Articles "MISCELLANEOUS HARDWARE" and "HARDWARE SETS" for pivots and hinges other than butts specified above and continuous hinges specified below.

## **2.2 DOOR CLOSING DEVICES**

- A. Closing devices shall be products of one manufacturer for each type specified.

## **2.3 DOOR STOPS**

- A. Conform to ANSI A156.16.
- B. Provide door stops wherever an opened door or any item of hardware thereon would strike a wall, column, equipment or other parts of building construction. For concrete, masonry or quarry tile construction, use lead expansion shields for mounting door stops.
- C. Where the specified wall or floor stop cannot be used, provide concealed overhead stops (surface-mounted where concealed cannot be used).

## **2.4 OVERHEAD DOOR STOPS AND HOLDERS**

- A. Conform to ANSI Standard A156.8. Overhead holders shall be of sizes recommended by holder manufacturer for each width of door. Set overhead holders for 110 degree opening, unless limited by building construction or equipment. Provide Grade 1 overhead concealed slide type: stop-only at rated doors and security doors, hold-open type with exposed hold-open on/off control at all other doors requiring overhead door stops.

## **2.5 LOCKS AND LATCHES**

- A. Conform to ANSI A156.2. Locks and latches for doors 45 mm (1-3/4 inch) thick or over shall have beveled fronts. Lock cylinders shall have not less than seven pins. Cylinders for all locksets shall be removable core type. Cylinders shall be furnished with construction removable cores and construction master keys. Cylinder shall be removable by special key or tool. Construct all cores so that they will be interchangeable into the core housings of all mortise locks, rim locks, cylindrical locks, and any other type lock included in the Great Grand Master Key System. Disassembly of lever or lockset shall not be required to remove core from lockset. All locksets or latches on double doors with fire label shall have latch bolt with 19 mm (3/4 inch) throw, unless shorter throw allowed by the door manufacturer's fire label. Provide temporary keying device or construction core to allow

opening and closing during construction and prior to the installation of final cores.

- B. In addition to above requirements, locks and latches shall comply with following requirements:
1. Cylindrical Lock and Latch Sets: levers shall meet ABA requirements. Cylindrical locksets shall be series 4000 Grade I. All locks and latchsets shall be furnished with 122.55 mm (4-7/8-inch) curved lip strike and wrought box. At outswing pairs with overlapping astragals, provide flat lip strip with 21mm (7/8-inch) lip-to-center dimension. Provide lever design to match design selected by Architect or to match existing lever design. Where two turn pieces are specified for lock F76, turn piece on inside knob shall lock and unlock inside knob, and turn piece on outside knob shall unlock outside knob when inside knob is in the locked position. (This function is intended to allow emergency entry into these rooms without an emergency key or any special tool.)
  2. Auxiliary locks shall be as specified under hardware sets and conform to ANSI A156.36.

## 2.6 KEYS

- A. Stamp all keys with change number and key set symbol. Furnish keys in quantities as follows:

Locks/Keys	Quantity
Cylinder locks	2 keys each
Cylinder lock change key blanks	100 each different key way
Master-keyed sets	6 keys each
Grand Master sets	6 keys each
Great Grand Master set	5 keys
Control key	2 keys

## 2.7 MISCELLANEOUS HARDWARE

- A. Mutes: Conform to ANSI A156.16. Provide door mutes or door silencers Type L03011 or L03021, depending on frame material, of white or light gray color, on each steel or wood door frame, except at fire-rated frames, lead-lined frames and frames for sound-resistant, lightproof and electromagnetically shielded doors. Furnish 3 mutes for single doors and 2 mutes for each pair of doors, except double-acting doors.



Provide 4 mutes or silencers for frames for each Dutch type door.  
Provide 2 mutes for each edge of sliding door which would contact door frame.

## 2.8 FINISHES

- A. Exposed surfaces of hardware shall have ANSI A156.18, finishes as specified below. Finishes on all hinges, pivots, closers, thresholds, etc., shall be as specified below under "Miscellaneous Finishes." For field painting (final coat) of ferrous hardware, see Section 09 91 00, PAINTING.
- B. 626 or 630: All surfaces on exterior and interior of buildings, except where other finishes are specified.
- C. Miscellaneous Finishes:
  - 1. Hinges --interior doors: 652 or 630.
  - 2. Door Closers: Factory applied paint finish. Dull or Satin Aluminum color.
  - 7. Other primed steel hardware: 600.
- D. Hardware Finishes for Existing Buildings: U.S. Standard finishes shall match finishes of hardware in (similar) existing spaces except where otherwise specified.

## 2.9 BASE METALS

- A. Apply specified U.S. Standard finishes on different base metals as following:

Finish	Base Metal
652	Steel
626	Brass or bronze
630	Stainless steel

## PART 3 - EXECUTION

### 3.1 HARDWARE HEIGHTS

- A. For existing buildings locate hardware on doors at heights to match existing hardware. The Contractor shall visit the site, verify location of existing hardware and submit locations to VA COR for approval.
- B. Hardware Heights from Finished Floor:
  - 1. Locksets and latch sets centerline of strike 1024 mm (40-5/16 inches).

2. Locate other hardware at standard commercial heights. Locate push and pull plates to prevent conflict with other hardware.

### 3.2 INSTALLATION

- A. Closer devices, including those with hold-open features, shall be equipped and mounted to provide maximum door opening permitted by building construction or equipment. Closers shall be mounted on side of door inside rooms, inside stairs, and away from corridors. Where closers are mounted on doors they shall be mounted with hex nuts and bolts; foot shall be fastened to frame with machine screws.

- B. Hinge Size Requirements:

Door Thickness	Door Width	Hinge Height
45 mm (1-3/4 inch)	900 mm (3 feet) and less	113 mm (4-1/2 inches)
45 mm (1-3/4 inch)	Over 900 mm (3 feet) but not more than 1200 mm (4 feet)	125 mm (5 inches)
35 mm (1-3/8 inch) (hollow core wood doors)	Not over 1200 mm (4 feet)	113 mm (4-1/2 inches)

- C. Hinge leaves shall be sufficiently wide to allow doors to swing clear of door frame trim and surrounding conditions.
- D. Where new hinges are specified for new doors in existing frames or existing doors in new frames, sizes of new hinges shall match sizes of existing hinges; or, contractor may reuse existing hinges provided hinges are restored to satisfactory operating condition as approved by COR. Existing hinges shall not be reused on door openings having new doors and new frames. Coordinate preparation for hinge cut-outs and screw-hole locations on doors and frames.
- E. Hinges Required Per Door:

Doors 1500 mm (5 ft) or less in height	2 butts
Doors over 1500 mm (5 ft) high and not over 2280 mm (7 ft 6 in) high	3 butts
Doors over 2280 mm (7 feet 6 inches) high	4 butts
Dutch type doors	4 butts
Doors with spring hinges 1370 mm (4 feet 6 inches) high or less	2 butts
Doors with spring hinges over 1370 mm (4 feet 6 inches)	3 butts

- F. Fastenings: Suitable size and type and shall harmonize with hardware as to material and finish. Provide machine screws and lead expansion shields to secure hardware to concrete, ceramic or quarry floor tile, or solid masonry. Fiber or rawl plugs and adhesives are not permitted. All fastenings exposed to weather shall be of nonferrous metal.
- G. After locks have been installed; show in presence of COR that keys operate their respective locks in accordance with keying requirements. (All keys, Master Key level and above shall be sent Registered Mail to the Medical Center Director along with the bidding list. Also, a copy of the invoice shall be sent to the COR for his records.) Installation of locks which do not meet specified keying requirements shall be considered sufficient justification for rejection and replacement of all locks installed on project.

### **3.3 FINAL INSPECTION**

- A. Installer to provide letter to VA COR that upon completion, installer has visited the Project and has accomplished the following:
  - 1. Re-adjust hardware.
  - 2. Evaluate maintenance procedures and recommend changes or additions, and instruct VA personnel.
  - 3. Identify items that have deteriorated or failed.
  - 4. Submit written report identifying problems.

### **3.4 DEMONSTRATION**

- A. Demonstrate efficacy of mechanical hardware and electrical, and electronic hardware systems, including adjustment and maintenance procedures, to satisfaction of COR and VA Locksmith.

### **3.5 HARDWARE SETS**

- A. Following sets of hardware correspond to hardware symbols shown on drawings. Only those hardware sets that are shown on drawings will be required. Disregard hardware sets listed in specifications but not shown on drawings.
- B. Hardware Consultant working on a project will be responsible for providing additional information regarding these hardware sets. The numbers shown in the following sets come from BHMA standards.

ELECTRIC HARDWARE ABBREVIATIONS LEGEND:  
ADO = Automatic Door Operator  
EMCH = Electro-Mechanical Closer-Holder  
MHO = Magnetic Hold-Open (wall- or floor-mounted)

**INTERIOR SINGLE DOORS**

HW-1

Each Door to Have:

RATED

Hinges	QUANTITY & TYPE AS REQUIRED
1 Utility Lock	F09
1 Closer	C02011/C02021
1 Set Self-Adhesive Seals	R0Y154

- - - E N D - - -

**SECTION 09 06 00  
SCHEDULE FOR FINISHES**

**PART I - GENERAL**

**1.1 DESCRIPTION**

This section contains a coordinated system in which requirements for materials specified in other sections shown are identified by abbreviated material names and finish codes in the room finish schedule or shown for other locations.

**1.2 MANUFACTURERS**

Manufacturer's trade names and numbers used herein are only to identify colors, finishes, textures and patterns. Products of other manufacturer's equivalent to colors, finishes, textures and patterns of manufacturers listed that meet requirements of technical specifications will be acceptable upon approval in writing by contracting officer for finish requirements.

**1.3 SUBMITALS**

Submit in accordance with SECTION 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES—provide quadruplicate samples for color approval of materials and finishes specified in this section.

1. DIGITAL COLOR PHOTOS-INTERIOR VIEWS:

Room Number and Name	Item/View to be Photographed
1.	
2.	
3.	
4.	

**1.4 APPLICABLE PUBLICATIONS**

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in text by basic designation only.
- B. MASTER PAINTING INSTITUTE: (MPI)  
 2001.....Architectural Painting Specification Manual

**PART 2- PRODUCTS**

**2.1 DIGITAL COLOR PHOTOS**

- A. Size 24 x 35 mm.
- B. Labeled for:
  - 1. Building name and Number.
  - 2. Room Name and Number.

**2.8 DIVISION 08 - OPENINGS**

- A. SECTION 08 11 13, HOLLOW METAL DOORS AND FRAMES

Paint both sides of door and frames same color including ferrous metal louvers, and hardware attached to door	
Component	Color of Paint Type and Gloss
Door	
Frame	

- U. SECTION 08 71 00, BUILDERS HARDWARE

Item	Material	Finish
Hinges	Steel	652
Door Closers	Steel	652
Lock/ Latches	Steel	652

**2.9 DIVISION 09 - FINISHES**

I. SECTION 09 65 19, RESILIENT TILE FLOORING

Finish Code	Size	Material/Component	Manufacturer	Mfg Name/No.
		VCT		
		R		
		RT		

J. SECTION 09 65 16, VINYL SHEET FLOORING (VSF)

Finish Code	Pattern name	Manufacturer	Mfg. Color Name/No.

T. SECTION 09 91 00, PAINT AND COATINGS

1. MPI Gloss and Sheen Standards

		Gloss @60	Sheen @85
Gloss Level 1	a traditional matte finish-flat	max 5 units, and	max 10 units
Gloss Level 2	a high side sheen flat-"a velvet-like" finish	max 10 units, and	10-35 units
Gloss Level 3	a traditional "egg-shell like" finish	10-25 units, and	10-35 units
Gloss Level 4	a "satin-like" finish	20-35 units, and	min. 35 units
Gloss Level 5	a traditional semi-gloss	35-70 units	
Gloss Level 6	a traditional gloss	70-85 units	
Gloss level 7	a high gloss	more than 85 units	

2. Paint code	Gloss	Manufacturer	Mfg. Color Name/No.

P			
P			
P			
P			
P			
P			
P			

J. SECTION 10 14 00, INTERIOR SIGNS

Sign Type	Component	Manufacturer	Mfg. Color Name/No.



**PART III EXECUTION**

**3.1 FINISH SCHEDULES & MISCELLANEOUS ABBREVIATIONS**

FINISH SCHEDULE & MISCELLANEOUS ABBREVIATIONS	
Term	Abbreviation
Access Flooring	AF
Accordion Folding Partition	AFP
Acoustical Ceiling	AT
Acoustical Ceiling, Special Faced	AT (SP)
Acoustical Metal Pan Ceiling	AMP
Acoustical Wall Panel	AWP
Acoustical Wall Treatment	AWT
Acoustical Wallcovering	AWF
Anodized Aluminum Colored	AAC
Anodized Aluminum Natural Finish	AA
Baked On Enamel	BE
Brick Face	BR
Brick Flooring	BF
Brick Paving	BP
Carpet	CP
Carpet Athletic Flooring	CAF
Carpet Module Tile	CPT
Ceramic Glazed Facing Brick	CGFB
Ceramic Mosaic Tile	FTCT
Concrete	C
Concrete Masonry Unit	CMU
Divider Strips Marble	DS MB

Epoxy Coating	EC
Epoxy Resin Flooring	ERF
Existing	E
Exposed Divider Strips	EXP
Exterior	EXT
Exterior Finish System	EFS
Exterior Paint	EXT-P
Exterior Stain	EXT-ST
Fabric Wallcovering	WF
Facing Tile	SCT
Feature Strips	FS
Floor Mats & Frames	FM
Floor Tile, Mosaic	FT
Fluorocarbon	FC
Folding Panel Partition	FP
Foot Grille	FG
Glass Masonry Unit	GUMU
Glazed Face CMU	GCMU
Glazed Structural Facing Tile	SFTU
Granite	GT
Gypsum Wallboard	GWB
High Glazed Coating	SC
Latex Mastic Flooring	LM
Linear Metal Ceiling	LMC
Linear Wood Ceiling	LWC
Marble	MB
Material	MAT
Mortar	M
Multi-Color Coating	MC
Natural Finish	NF
Paint	P
Paver Tile	PVT
Perforated Metal Facing (Tile or Panels)	PMF

Plaster	PL
Plaster High Strength	HSPL
Plaster Keene Cement	KC
Plastic Laminate	HPDL
Polypropylene Fabric Wallcovering	PFW
Porcelain Paver Tile	PPT
Quarry Tile	QT
Radiant Ceiling Panel System	RCP
Resilient Stair Tread	RST
Rubber Base	RB
Rubber Tile Flooring	RT
Spandrel Glass	SLG
Stain	ST
Stone Flooring	SF
Structural Clay	SC
Suspension Decorative Grids	SDG
Grids	

Terrazzo Portland Cement	PCT
Terrazzo Tile	TT
Terrazzo, Thin Set	
Textured Gypsum Ceiling Panel	TGC
Textured Metal Ceiling Panel	TMC
Thin set Terrazzo	TST
Veneer Plaster	VP
Vinyl Base	VB
Vinyl Coated Fabric Wallcovering	W
Vinyl Composition Tile	VCT
Vinyl Sheet Flooring	VSF
Vinyl Sheet Flooring (Welded Seams)	WSF
Wall Border	WB
Wood	WD

**3.2 FINISH SCHEDULE SYMBOLS**

Symbol Definition

- \*\* Same finish as adjoining walls
- No color required
- E Existing
- XX To match existing
- EFTR Existing finish to remain
- RM Remove

**3.3 ROOM FINISH SCHEDULE**

- A. Match adjoining or existing similar surfaces colors, textures or patterns where disturbed or damaged by alterations or new work when not scheduled.
- B. ROOM FINISH SCHEDULE: See room finish schedule on drawings.

--- E N D---

**SECTION 09 22 16**  
**NON-STRUCTURAL METAL FRAMING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

This section specifies steel studs wall systems, shaft wall systems, ceiling or soffit suspended or furred framing, wall furring, fasteners, and accessories for the screw attachment of gypsum board, plaster bases or other building boards.

**1.2 TERMINOLOGY**

- A. Description of terms shall be in accordance with ASTM C754, ASTM C11, ASTM C841 and as specified.
- B. Underside of Structure Overhead: In spaces where steel trusses or bar joists are shown, the underside of structure overhead shall be the underside of the floor or roof construction supported by beams, trusses, or bar joists. In interstitial spaces with walk-on floors the underside of the walk-on floor is the underside of structure overhead.
- C. Thickness of steel specified is the minimum bare (uncoated) steel thickness.

**1.3 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
  - 1. Studs, runners and accessories.
  - 2. Hanger inserts.
  - 3. Channels (Rolled steel).
  - 4. Furring channels.
  - 5. Screws, clips and other fasteners.
- C. Shop Drawings:
  - 1. Typical ceiling suspension system.
  - 2. Typical metal stud and furring construction system including details around openings and corner details.
  - 3. Typical shaft wall assembly
  - 4. Typical fire rated assembly and column fireproofing showing details of construction same as that used in fire rating test.
- D. Test Results: Fire rating test designation, each fire rating required for each assembly.

#### 1.4 DELIVERY, IDENTIFICATION, HANDLING AND STORAGE

In accordance with the requirements of ASTM C754.

#### 1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society For Testing And Materials (ASTM)
- A641-09.....Zinc-Coated (Galvanized) Carbon Steel Wire
  - A653/653M-11.....Specification for Steel Sheet, Zinc Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by Hot-Dip Process.
  - C11-10.....Terminology Relating to Gypsum and Related Building Materials and Systems
  - C635-07.....Manufacture, Performance, and Testing of Metal Suspension System for Acoustical Tile and Lay-in Panel Ceilings
  - C636-08.....Installation of Metal Ceiling Suspension Systems for Acoustical Tile and Lay-in Panels
  - C645-09.....Non-Structural Steel Framing Members
  - C754-11.....Installation of Steel Framing Members to Receive Screw-Attached Gypsum Panel Products
  - C841-03(R2008).....Installation of Interior Lathing and Furring
  - C954-10.....Steel Drill Screws for the Application of Gypsum Panel Products or Metal Plaster Bases to Steel Studs from 0.033 in. (0.84 mm) to 0.112 in. (2.84 mm) in Thickness
  - E580-11.....Application of Ceiling Suspension Systems for Acoustical Tile and Lay-in Panels in Areas Requiring Moderate Seismic Restraint.

### PART 2 - PRODUCTS

#### 2.1 PROTECTIVE COATING

Galvanize steel studs, runners (track), rigid (hat section) furring channels, "Z" shaped furring channels, and resilient furring channels, with coating designation of G40 or equivalent.

#### 2.2 STEEL STUDS AND RUNNERS (TRACK)

- A. ASTM C645, modified for thickness specified and sizes as shown.
1. Use C 645 steel, 0.75 mm (0.0296-inch) minimum base-metal (30 mil).

2. Runners same thickness as studs.
3. Exception: Members that can show certified third party testing with gypsum board in accordance with ICC ES AC86 (Approved May 2012) need not meet the minimum thickness limitation or minimum section properties set forth in ASTM C 645. The submission of an evaluation report is acceptable to show conformance to this requirement. Use C 645 steel, 0.48mm (0.019 inch) minimum base-metal (19 mil).
- B. Provide not less than two cutouts in web of each stud, approximately 300 mm (12 inches) from each end, and intermediate cutouts on approximately 600 mm (24-inch) centers.
- C. Doubled studs for openings and studs for supporting concrete backer-board.
- D. Studs 3600 mm (12 feet) or less in length shall be in one piece.
- E. Shaft Wall Framing:
  1. Conform to rated wall construction.
  2. C-H Studs or C-T Studs.
  3. E Studs.
  4. J Runners.
  5. Steel Jamb-Strut.

### **2.3 FASTENERS, CLIPS, AND OTHER METAL ACCESSORIES**

- A. ASTM C754, except as otherwise specified.
- B. For fire rated construction: Type and size same as used in fire rating test.
- C. Fasteners for steel studs thicker than 0.84 mm (0.033-inch) thick. Use ASTM C954 steel drill screws of size and type recommended by the manufacturer of the material being fastened.
- D. Clips: ASTM C841 (paragraph 6.11), manufacturer's standard items. Clips used in lieu of tie wire shall have holding power equivalent to that provided by the tie wire for the specific application.
- E. Concrete ceiling hanger inserts (anchorage for hanger wire and hanger straps): Steel, zinc-coated (galvanized), manufacturers standard items, designed to support twice the hanger loads imposed and the type of hanger used.
- F. Tie Wire and Hanger Wire:
  1. ASTM A641, soft temper, Class 1 coating.
  2. Gage (diameter) as specified in ASTM C754 or ASTM C841.
- G. Attachments for Wall Furring:

1. Manufacturers standard items fabricated from zinc-coated (galvanized) steel sheet.
  2. For concrete or masonry walls: Metal slots with adjustable inserts or adjustable wall furring brackets. Spacers may be fabricated from 1 mm (0.0396-inch) thick galvanized steel with corrugated edges.
- H. Power Actuated Fasteners: Type and size as recommended by the manufacturer of the material being fastened.

**PART 3 - EXECUTION**

**3.1 INSTALLATION CRITERIA**

- A. Where fire rated construction is required for walls, partitions, columns, beams and floor-ceiling assemblies, the construction shall be same as that used in fire rating test.
- B. Construction requirements for fire rated assemblies and materials shall be as shown and specified, the provisions of the Scope paragraph (1.2) of ASTM C754 and ASTM C841 regarding details of construction shall not apply.

**3.2 INSTALLING STUDS**

- A. Install studs in accordance with ASTM C754, except as otherwise shown or specified.
- B. Space studs not more than 610 mm (24 inches) on center.
- C. Cut studs 6 mm to 9 mm (1/4 to 3/8-inch) less than floor to underside of structure overhead when extended to underside of structure overhead.
- D. Where studs are shown to terminate above suspended ceilings, provide bracing as shown or extend studs to underside of structure overhead.
- E. Extend studs to underside of structure overhead for fire, rated partitions, smoke partitions, shafts, and sound rated partitions.
- G. Openings:
  1. Frame jambs of openings in stud partitions and furring with two studs placed back to back or as shown.
  2. Fasten back to back studs together with 9 mm (3/8-inch) long Type S pan head screws at not less than 600 mm (two feet) on center, staggered along webs.
  3. Studs fastened flange to flange shall have splice plates on both sides approximately 50 X 75 mm (2 by 3 inches) screwed to each stud with two screws in each stud. Locate splice plates at 600 mm (24 inches) on center between runner tracks.

H. Fastening Studs:

1. Fasten studs located adjacent to partition intersections, corners and studs at jambs of openings to flange of runner tracks with two screws through each end of each stud and flange of runner.
2. Do not fasten studs to top runner track when studs extend to underside of structure overhead.

I. Form building seismic or expansion joints with double studs back to back spaced 75 mm (three inches) apart plus the width of the seismic or expansion joint.

J. Form control joint, with double studs spaced 13 mm (1/2-inch) apart.

**3.3 INSTALLING SUPPORTS REQUIRED BY OTHER TRADES**

A. Provide for attachment and support of electrical outlets, plumbing, laboratory or heating fixtures, recessed type plumbing fixture accessories, access panel frames, wall bumpers, wood seats, toilet stall partitions, dressing booth partitions, urinal screens, chalkboards, tackboards, wall-hung casework, handrail brackets, recessed fire extinguisher cabinets and other items like auto door buttons and auto door operators supported by stud construction.

B. Provide additional studs where required. Install metal backing plates, or special metal shapes as required, securely fastened to metal studs.

**3.4 TOLERANCES**

A. Fastening surface for application of subsequent materials shall not vary more than 3 mm (1/8-inch) from the layout line.

B. Plumb and align vertical members within 3 mm (1/8-inch.)

- - - E N D - - -

**SECTION 09 29 00**  
**GYPSUM BOARD**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

This section specifies installation and finishing of gypsum board.

**1.2 RELATED WORK**

- A. Installation of steel framing members for walls, partitions, furring, soffits, and ceilings: Section 09 22 16, NON-STRUCTURAL METAL FRAMING.

**1.3 TERMINOLOGY**

- A. Definitions and description of terms shall be in accordance with ASTM C11, C840, and as specified.
- B. Underside of Structure Overhead: In spaces where steel trusses or bar joists are shown, the underside of structure overhead shall be the underside of the floor or roof construction supported by the trusses or bar joists.
- C. "Yoked": Gypsum board cut out for opening with no joint at the opening (along door jamb or above the door).

**1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
  - 1. Cornerbead and edge trim.
  - 2. Finishing materials.
  - 3. Laminating adhesive.
  - 4. Gypsum board, each type.
- C. Shop Drawings:
  - 1. Typical gypsum board installation, showing corner details, edge trim details and the like.
  - 2. Typical sound rated assembly, showing treatment at perimeter of partitions and penetrations at gypsum board.
  - 3. Typical shaft wall assembly.
  - 4. Typical fire rated assembly and column fireproofing, indicating details of construction same as that used in fire rating test.
- D. Samples:
  - 1. Cornerbead.
  - 2. Edge trim.
  - 3. Control joints.



E. Test Results:

1. Fire rating test, each fire rating required for each assembly.
2. Sound rating test.

F. Certificates: Certify that gypsum board types, gypsum backing board types, cementitious backer units, and joint treating materials do not contain asbestos material.

**1.5 DELIVERY, IDENTIFICATION, HANDLING AND STORAGE**

In accordance with the requirements of ASTM C840.

**1.6 ENVIRONMENTAL CONDITIONS**

In accordance with the requirements of ASTM C840.

**1.7 APPLICABLE PUBLICATIONS**

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. American Society for Testing And Materials (ASTM):

- C11-15.....Terminology Relating to Gypsum and Related Building Materials and Systems
- C475-15.....Joint Compound and Joint Tape for Finishing Gypsum Board
- C840-13.....Application and Finishing of Gypsum Board
- C919-12.....Sealants in Acoustical Applications
- C954-15.....Steel Drill Screws for the Application of Gypsum Board or Metal Plaster Bases to Steel Stud from 0.033 in. (0.84mm) to 0.112 in. (2.84mm) in thickness
- C1002-14.....Steel Self-Piercing Tapping Screws for the Application of Gypsum Panel Products or Metal Plaster Bases to Wood Studs or Steel Studs
- C1047-14.....Accessories for Gypsum Wallboard and Gypsum Veneer Base
- C1177-13.....Glass Mat Gypsum Substrate for Use as Sheathing
- C1658-13.....Glass Mat Gypsum Panels
- C1396-14.....Gypsum Board

C. Underwriters Laboratories Inc. (UL):

Latest Edition.....Fire Resistance Directory

D. Inchcape Testing Services (ITS):

Latest Editions.....Certification Listings

**PART 2 - PRODUCTS**

**2.1 GYPSUM BOARD**

- A. Gypsum Board: ASTM C1396, Type X, 16 mm (5/8 inch) thick unless shown otherwise.
- B. Paper facings shall contain 100 percent post-consumer recycled paper content.

**2.2 GYPSUM SHEATHING BOARD**

- A. ASTM C1396, Type X, water-resistant core, 16 mm (5/8 inch) thick.
- B. ASTM C1177, Type X.

**2.3 ACCESSORIES**

- A. ASTM C1047, except form of 0.39 mm (0.015 inch) thick zinc coated steel sheet or rigid PVC plastic.
- B. Flanges not less than 22 mm (7/8 inch) wide with punchouts or deformations as required to provide compound bond.

**2.4 FASTENERS**

- A. ASTM C1002 and ASTM C840, except as otherwise specified.
- B. ASTM C954, for steel studs thicker than 0.04 mm (0.33 inch).
- C. Select screws of size and type recommended by the manufacturer of the material being fastened.
- D. For fire rated construction, type and size same as used in fire rating test.
- E. Clips: Zinc-coated (galvanized) steel; gypsum board manufacturer's standard items.

**2.5 FINISHING MATERIALS AND LAMINATING ADHESIVE**

ASTM C475 and ASTM C840. Free of antifreeze, vinyl adhesives, preservatives, biocides and other VOC. Adhesive shall contain a maximum VOC content of 50 g/l.

**PART 3 - EXECUTION**

**3.1 GYPSUM BOARD HEIGHTS**

- A. Extend all layers of gypsum board from floor to underside of structure overhead on following partitions and furring:
  - 1. Two sides of partitions:
    - a. Fire rated partitions.
    - b. Smoke partitions.
    - c. Sound rated partitions.
    - d. Full height partitions shown (FHP).
    - e. Corridor partitions.

- B. In locations other than those specified, extend gypsum board from floor to heights as follows:
1. Not less than 100 mm (4 inches) above suspended acoustical ceilings.
  2. At existing ceilings.

### **3.2 INSTALLING GYPSUM BOARD**

- A. Coordinate installation of gypsum board with other trades and related work.
- B. Install gypsum board in accordance with ASTM C840, except as otherwise specified.
- C. Use gypsum boards in maximum practical lengths to minimize number of end joints.
- D. Bring gypsum board into contact, but do not force into place.
- E. Walls (Except Shaft Walls):
1. When gypsum board is installed parallel to framing members, space fasteners 300 mm (12 inches) on center in field of the board, and 200 mm (8 inches) on center along edges.
  2. When gypsum board is installed perpendicular to framing members, space fasteners 300 mm (12 inches) on center in field and along edges.
  3. Stagger screws on abutting edges or ends.
  4. For single-ply construction, apply gypsum board with long dimension either parallel or perpendicular to framing members as required to minimize number of joints except gypsum board shall be applied vertically over "Z" furring channels.
  5. For two-ply gypsum board assemblies, apply base ply of gypsum board to assure minimum number of joints in face layer. Apply face ply of wallboard to base ply so that joints of face ply do not occur at joints of base ply with joints over framing members.
  6. For three-ply gypsum board assemblies, apply plies in same manner as for two-ply assemblies, except that heads of fasteners need only be driven flush with surface for first and second plies. Apply third ply of wallboard in same manner as second ply of two-ply assembly, except use fasteners of sufficient length enough to have the same penetration into framing members as required for two-ply assemblies.
  7. No offset in exposed face of walls and partitions will be permitted because of single-ply and two-ply or three-ply application requirements.

8. Control Joints ASTM C840 and as follows:
  - a. Locate at both side jambs of openings if gypsum board is not "yoked". Use one system throughout.
  - b. Not required for wall lengths less than 9000 mm (30 feet).
  - c. Extend control joints the full height of the wall or length of soffit/ceiling membrane.

F. Accessories:

1. Set accessories plumb, level and true to line, neatly mitered at corners and intersections, and securely attach to supporting surfaces as specified.
2. Install in one piece, without the limits of the longest commercially available lengths.
3. Corner Beads:
  - a. Install at all vertical and horizontal external corners and where shown.
  - b. Use screws only. Do not use crimping tool.
4. Edge Trim (casings Beads):
  - a. At both sides of expansion and control joints unless shown otherwise.
  - b. Where gypsum board terminates against dissimilar materials and at perimeter of openings, except where covered by flanges, casings or permanently built-in equipment.
  - c. Where gypsum board surfaces of non-load bearing assemblies abut load bearing members.
  - d. Where shown.

**3.3 FINISHING OF GYPSUM BOARD**

- A. Finish joints, edges, corners, and fastener heads in accordance with ASTM C840. Use Level 4 finish for all finished areas open to public view.
- B. Before proceeding with installation of finishing materials, assure the following:
  1. Gypsum board is fastened and held close to framing or furring.
  2. Fastening heads in gypsum board are slightly below surface in dimple formed by driving tool.
- C. Finish joints, fasteners, and all openings, including openings around penetrations, on that part of the gypsum board extending above suspended ceilings to seal surface of non-decorated smoke barrier, fire

rated gypsum board construction. After the installation of hanger rods, hanger wires, supports, equipment, conduits, piping and similar work, seal remaining openings and maintain the integrity of the smoke barrier, fire rated construction. Sanding is not required of non-decorated surfaces.

#### **3.4 REPAIRS**

- A. After taping and finishing has been completed, and before decoration, repair all damaged and defective work, including nondecorated surfaces.
- B. Patch holes or openings 13 mm (1/2 inch) or less in diameter, or equivalent size, with a setting type finishing compound or patching plaster.
- C. Repair holes or openings over 13 mm (1/2 inch) diameter, or equivalent size, with 16 mm (5/8 inch) thick gypsum board secured in such a manner as to provide solid substrate equivalent to undamaged surface.
- D. Tape and refinish scratched, abraded or damaged finish surfaces including cracks and joints in non-decorated surface to provide fire protection equivalent to the fire rated construction.

- - - E N D - - -

**SECTION 09 65 13  
RESILIENT BASE AND ACCESSORIES**

**PART 1 - GENERAL**

**1.1 SUMMARY**

A. Section Includes:

1. Resilient base (RB) adhered to interior walls and partitions.

**1.2 RELATED REQUIREMENTS**

- A. Sheet Flooring Integral Base: Section 09 65 16, RESILIENT SHEET FLOORING.
- B. Rubber Tile Flooring at Landings: Section 09 65 19, RESILIENT TILE FLOORING.

**1.3 APPLICABLE PUBLICATIONS**

- A. Comply with references to extent specified in this section.
- B. ASTM International (ASTM):
  1. F1344-15 - Rubber Floor Tile.
  2. F1859-14 - Rubber Sheet Floor Covering without Backing.
  3. F1860-14 - Rubber Sheet Floor Covering with Backing.
  4. F1861-08(2012)e1 - Resilient Wall Base.
  5. D4259-88(2012) - Abrading Concrete.
- C. Federal Specifications (Fed. Spec.):
  1. RR-T-650E - Treads, Metallic and Non-Metallic, Skid-Resistant.
- D. International Concrete Repair Institute (ICRI):
  1. 310.2R-13 - Selecting and Specifying Concrete Surface Preparation for Sealers, Coatings, and Polymer Overlays.

**1.4 SUBMITTALS**

- A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
  1. Description of each product.
  2. Adhesives and primers indicating manufacturer's recommendation for each application.
  3. Installation instructions.
- C. Samples:
  1. Resilient Base: 150 mm (6 inches) long, each type and color.
  2. Resilient Stair Treads: 150 mm (6 inches) long, each type and color.

3. Sheet Rubber Flooring: 300 mm (12 inches) square, each type and color.

D. Operation and Maintenance Data:

1. Care instructions for each exposed finish product.

**1.5 DELIVERY**

- A. Deliver products in manufacturer's original sealed packaging.
- B. Mark packaging, legibly. Indicate manufacturer's name or brand, type, color, production run number, and manufacture date.
- C. Before installation, return or dispose of products within distorted, damaged, or opened packaging.

**1.6 STORAGE AND HANDLING**

- A. Store products indoors in dry, weathertight facility.
- B. Protect products from damage when handling and during construction operations.

**1.7 FIELD CONDITIONS**

- A. Environment:
  - 1. Product Temperature: Minimum 21 degrees C (70 degrees F) for minimum 48 hours before installation.
  - 2. Work Area Ambient Temperature Range: 21 to 27 degrees C (70 to 80 degrees F) continuously, beginning 48 hours before installation.
  - 3. Install products when building is permanently enclosed and when wet construction is completed, dried, and cured.

**1.8 WARRANTY**

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."

**PART 2 - PRODUCTS**

**2.1 PRODUCTS**

- A. Basis of Design: Section 09 06 00, SCHEDULE FOR FINISHES.
- B. Provide each product from one manufacturer and from one production run.

**2.2 RESILIENT BASE**

- A. Resilient Base: 3 mm (1/8 inch) thick, 100 mm (4 inches) high.
  - 1. Type: Rubber or vinyl; use one type throughout.
  - 2. ASTM F1861, Type TP thermoplastic rubber or Type TV thermoplastic vinyl, Group 2 - layered.

B. Applications:

1. Carpet Flooring Locations: Style A - Straight.
2. Other Locations: Style B - Cove.

**2.3 ADHESIVES**

- A. Adhesives: Low pollutant-emitting, water based type recommended by adhered product manufacturer for each application.

**PART 3 - EXECUTION**

**3.1 PREPARATION**

- A. Examine and verify substrate suitability for product installation.
- B. Protect existing construction and completed work from damage.
- C. Remove existing base to permit new installation.
1. Dispose of removed materials.
- D. Correct substrate deficiencies.
1. Fill cracks, pits, and depressions with leveling compound.
  2. Remove protrusions; grind high spots.
  3. Apply leveling compound to achieve 3 mm (1/8 inch) in 3 m (10 feet) maximum surface variation.
- E. Clean substrates. Remove contaminants capable of affecting subsequently installed product's performance.
1. Mechanically clean concrete floor substrate according to ASTM D4259.
  2. Surface Profile: ICRI Guideline No. 310.2R.
- F. Allow substrate to dry and cure.
- G. Perform flooring manufacturer's recommended bond, substrate moisture content, and pH tests.

**3.2 INSTALLATION GENERAL**

- A. Install products according to manufacturer's instructions.
1. When instructions deviate from specifications, submit proposed resolution for Contracting Officer consideration.

**3.3 RESILIENT BASE INSTALLATION**

- A. Applications:
1. Install resilient base in rooms scheduled on Drawings.
- B. Lay out resilient base with minimum number of joints.
1. Length: 600 mm (24 inches) minimum, each piece.
  2. Locate joints 150 mm (6 inches) minimum from corners and intersection of adjacent materials.



C. Installation:

1. Apply adhesive uniformly for full contact between resilient base and substrate.
2. Set resilient base with hairline butted joints aligned along top edge.

D. Factory form corners and end stops.

1. V-groove back of outside corner.
2. V-groove face of inside corner and notch cove for miter joint.

E. Roll resilient base ensuring complete adhesion.

**3.4 CLEANING**

- A. Remove excess adhesive before adhesive sets.
- B. Clean exposed resilient base surfaces. Remove contaminants and stains.
  1. Clean with mild detergent. Leave surfaces free of detergent residue.
- C. Polish exposed resilient base to gloss sheen.

**3.5 PROTECTION**

- A. Prohibit traffic on resilient flooring 72 hours, minimum, after installation.
- B. Protect products from construction traffic and operations.
  1. Cover resilient flooring with reinforced kraft paper, and plywood or hardboard.
  2. Maintain protection until directed by Contracting Officer's Representative.
- C. Replace damaged products and re-clean.
  1. Damaged Products include cut, gouged, scraped, torn, and unbonded products.

- - E N D - -

**SECTION 09 65 16**  
**RESILIENT SHEET FLOORING**

**PART 1 - GENERAL**

**1.1 SUMMARY**

A. Section Includes:

1. Resilient sheet flooring (RSF) with chemically welded seams.
2. Welded seam sheet flooring (WSF) with heat welded seams.

**1.2 RELATED REQUIREMENTS**

- A. Color, Pattern and Texture: Section 09 06 00, SCHEDULE FOR FINISHES.
- B. Resilient Base: Section 09 65 13, RESILIENT BASE AND ACCESSORIES.

**1.3 APPLICABLE PUBLICATIONS**

- A. Comply with references to extent specified in this section.
- B. ASTM International (ASTM):
  1. D4259-88(2012) - Abrading Concrete.
  2. E648-15e1 - Standard Test Method for Critical Radiant Flux of Floor-Covering Systems Using a Radiant Heat Energy Source.
  3. E662-15a - Standard Test Method for Specific Optical Density of Smoke Generated by Solid Materials.
  4. F1303-04(2014) - Sheet Vinyl Floor Covering with Backing.
  5. F1860-14 - Rubber Sheet Floor Covering With Backing.
  6. F1913-04(2014) - Vinyl Sheet Floor Covering Without Backing.
- C. International Concrete Repair Institute (ICRI):
  1. 310.2R-13 - Selecting and Specifying Concrete Surface Preparation for Sealers, Coatings, and Polymer Overlays, and Concrete Repair.
- D. SCS Global Services (SCS):
  1. FloorScore.

**1.4 SUBMITTALS**

- A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
  1. Show size, configuration, and fabrication and installation details.
- B. Manufacturer's Literature and Data:
  1. Description of each product.
  2. Application Installation instructions.
  3. Warranty.
- C. Samples:

1. Sheet material, 300 mm (12 inches) square for each type, pattern and color.
  2. Cap strip and fillet strip, 300 mm (12 inches) for integral base.
  3. Shop Drawings and Certificates: Layout of joints showing patterns where joints are expressed, and type and location of obscure type joints. Indicate orientation of directional patterns.
  4. Certificates: Quality Control Certificate Submittals and lists specified in paragraph, QUALIFICATIONS.
  5. Edge strips: 150 mm (6 inches) long each type.
  6. Primer: Pint container, each type.
- D. Certificates: Certify products comply with specifications.
1. Heat welded seaming is manufacturer's prescribed method of installation.
- E. Qualifications: Substantiate qualifications comply with specifications.
1. Manufacturer with project experience list.
  2. Installer with project experience list.

#### **1.5 QUALITY ASSURANCE**

- A. Installer Qualifications: A company specializing in installation with minimum three (3) years' experience and employs experienced flooring installers who have retained, and currently hold, an INSTALL Certification, or a certification from a comparable certification program.
1. Installers to be certified by INSTALL or a comparable certification program with the following minimum criteria:
    - a. US Department of Labor approved four (4) year apprenticeship program, 160 hours a year.
    - b. Career long training.
    - c. Manufacturer endorsed training.
    - d. Fundamental journeyman skills certification.
- B. Furnish product type materials from the same production run.

#### **1.6 DELIVERY**

- A. Deliver products in manufacturer's original sealed packaging.
- B. Mark packaging, legibly. Indicate manufacturer's name or brand, type, color, production run number, and manufacture date.

- C. Before installation, return or dispose of products within distorted, damaged, or opened packaging.

#### **1.7 STORAGE AND HANDLING**

- A. Store products indoors in dry, weathertight facility.
- B. Protect products from damage during handling and construction operations.

#### **1.8 FIELD CONDITIONS**

- A. Environment:
  - 1. Work Area Ambient Temperature Range: Minimum 18 to 38 degrees C (65 to 100 degrees F) continuously, beginning 48 hours before installation. Maintain room temperature above 18 degrees C (65 degrees F) after installation.
  - 2. Install products when building is permanently enclosed and when wet construction is completed, dried, and cured.

#### **1.9 WARRANTY**

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."
- B. Manufacturer's Warranty: Warrant resilient sheet flooring against material and manufacturing defects.
  - 1. Warranty Period: 2 years.

### **PART 2 - PRODUCTS**

#### **2.1 SYSTEM PERFORMANCE**

- A. Sheet Flooring:
  - 1. Critical Radiant Flux: ASTM E648; 0.45 watts per sq.cm or more, Class I.
  - 2. Smoke Density: ASTM E662; less than 450.

#### **2.2 PRODUCTS - GENERAL**

- A. Basis of Design: Section 09 06 00, SCHEDULE FOR FINISHES.
- B. Provide vinyl sheet color and pattern from one production run.

#### **2.3 RESILIENT SHEET FLOORING**

- A. Resilient Sheet Flooring (RSF): ASTM F1913; Vinyl, without backing.
  - 1. Wear Surface: Smooth.
  - 2. Thickness: 2 mm (0.080 inches).

- B. Resilient Sheet Flooring (RSF): ASTM F1303; Type II, Grade 1, vinyl, with backing.
  - 1. Wear Surface: Smooth.
  - 2. Wear Layer Thickness: Minimum 0.51 mm (0.020 inches).
  - 3. Total Thickness: 2 mm (0.080 inches).
- C. Sheet Size: Provide maximum size sheet produced by manufacturer to minimize joints.
  - 1. Minimum Width: 1200 mm (48 inches).

#### **2.4 WELDED SEAM SHEET FLOORING**

- A. Welded Seam Sheet Flooring (WSF): ASTM F1860; Type I rubber, with backing.
  - 1. Wear Surface: Smooth.
  - 2. Wear Layer Thickness: Minimum 1.0 mm (0.040 inches).
  - 3. Total Thickness: 2 mm (0.080 inches).
- B. Sheet Size: Provide maximum size sheet produced by manufacturer to minimize joints.
  - 1. Minimum Width: 1200 mm (48 inches).

#### **2.5 ACCESSORIES**

- A. Bonding Chemical: Flooring manufacturer's standard seam bonding chemical.
- B. Welding Rod: Flooring manufacturer's standard, in color matching field color of sheet flooring.
- C. Adhesives: Water resistant type recommended by flooring manufacturer to suit application.
- D. Base Accessories:
  - 1. Fillet Strip: 19 mm (3/4 inch) radius fillet strip compatible with flooring material.
  - 2. Cap Strip: J-Shape extruded flanged reducer strip compatible with flooring material approximately 25 mm (1 inch) exposed height with 13 mm (1/2 inch) flange.
- E. Leveling Compound:
  - 1. Provide cementitious type with latex or polyvinyl acetate resins additive.
- F. Primer:
  - 1. Type recommended by adhesive or flooring manufacturer.

G. Edge Strips:

1. Extruded aluminum, mill finish, mechanically cleaned.
2. 28 mm (1-1/8 inch) wide, 6 mm (1/4 inch) thick, bevel one edge to 3 mm (1/8 inch) thick.
3. Drill and counter sink edge strips for flat head screws. Space holes near ends and approximately 225 mm (9 inches) on center.
4. Fasteners: Stainless steel, type to suit application.

H. Sealant:

1. As specified in Section 07 92 00, JOINT SEALANTS.
2. Compatible with flooring.

I. Polish: Type recommended by flooring manufacturer to suit application and anticipated traffic.

**PART 3 - EXECUTION**

**3.1 PREPARATION**

- A. Examine and verify substrate suitability for product installation.
- B. Protect existing construction and completed work from damage.
- C. Remove existing sheet flooring to permit new installation.
  1. Do not use solvents for removing adhesives.
  2. Dispose of removed materials.
- D. Ensure interior finish work such as plastering, drywall finishing, concrete, terrazzo, ceiling work, and painting work is complete and dry before installation.
  1. Complete mechanical, electrical, and other work above ceiling line.
  2. Ensure heating, ventilating, and air conditioning systems are installed and operating in order to maintain temperature and humidity requirements.
- E. Correct substrate deficiencies.
  1. Fill cracks, pits, and dents with leveling compound.
  2. Grind, sand, or cut away protrusions. Grind high spots.
  3. Level flooring substrate to 3 mm (1/8 inch) maximum variation.
- F. Clean substrates. Remove contaminants capable of affecting subsequently installed product's performance.
  1. Mechanically clean concrete floor substrate according to ASTM D4259.
  2. Surface Profile: ICRI 310.2R CSP 3 to CSP 4.

- G. Perform flooring manufacturer's recommended bond, substrate moisture content, and pH tests.
- H. Broom or vacuum clean substrates immediately before flooring installation.
- I. Primer: Apply primer according to manufacturer's instructions.

### **3.2 INSTALLATION - GENERAL**

- A. Install products according to manufacturer's instructions.
  - 1. When manufacturer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.

### **3.3 INSTALLATION OF FLOORING**

- A. Flooring Layout:
  - 1. Arrange pattern in one direction joints pattern matched.
  - 2. Extend flooring wall-to-wall, under cabinets, casework, laboratory and pharmacy furniture, and other equipment for seamless flooring installation.
  - 3. Arrange sheets to minimize seams.
  - 4. Locate seams in inconspicuous and low traffic areas, minimum 150 mm (6 inches) away from parallel joints in flooring substrates.
- B. Match edges of flooring for color shading and pattern at seams.
- C. Install flooring flush with adjacent floor finishes.
- D. Extend flooring into toe spaces, door reveals, closets, and similar openings.
- E. Install flooring fully adhered to substrate.
  - 1. Air pockets or loose edges are not acceptable.
  - 2. Trim sheet materials tight to flooring penetrations; seal joints at pipe with waterproof sealant specified in Section 07 92 00, JOINT SEALANTS.
- F. Butt joints tight, without gaps and bulges.
- G. Installation of Edge Strips:
  - 1. Install edge strips at flooring terminations and transitions to other floor finishes.
  - 2. Locate edge strips under center lines of doors unless otherwise indicated.
  - 3. Set edge strips in adhesive and mechanically fasten to substrate.

#### **3.4 INTEGRAL COVE BASE INSTALLATION**

- A. Set preformed fillet strip at floor intersection with walls and other vertical surfaces.
- B. Extend flooring over fillet strip and 100 mm (4 inches) up wall surface.
- C. Form straight or radius internal and external corners to suit Application.
- D. Adhere base to wall surface.
- E. Terminate base exposed top edge with cap strip. Seal cap strip to wall with sealant.
- F. Weld joints as specified for flooring.

#### **3.5 HEAT WELDING**

- A. Heat weld joints of flooring and base using welding rod.
- B. Rout joint, insert welding rod into routed space, and fuse flooring and welding rods for seamless, watertight installation.
  - 1. Fuse joints for seamless weld.
- C. Finish joints flush, free from voids, and recessed or raised areas.

#### **3.6 CHEMICAL WELDING**

- A. Chemically weld joints of flooring and base using bonding chemical.
  - 1. Avoid excess bonding chemical and damage to flooring surfaces.
- B. Apply bonding chemical to fuse flooring for seamless, watertight installation.
- C. Finish joints flush, free from voids, and recessed or raised areas.

#### **3.7 CLEANING**

- A. Remove excess adhesive before adhesive sets.
- B. Clean and polish materials.
- C. Vacuum floor thoroughly.
- D. Perform initial maintenance according to flooring manufacturer's instructions.
  - 1. Delay washing flooring until adhesive is fully set and welded joints can contain wash water.

#### **3.8 PROTECTION**

- A. Protect flooring from traffic and construction operations.
- B. Keep traffic off sheet flooring for minimum 24 hours after installation.



- C. Cover flooring with reinforced kraft paper, and plywood or hardboard.
- D. Remove protective materials immediately before acceptance.
- E. Repair damage.
- F. Apply polish to vinyl flooring.
- G. Buff flooring to uniform sheen.

- - E N D - -

**SECTION 09 65 19  
RESILIENT TILE FLOORING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION:**

- A. This section specifies the installation of solid vinyl tile flooring, and accessories required for a complete installation.

**1.2 RELATED WORK:**

- A. Resilient Base: Section 09 65 13, RESILIENT BASE AND ACCESSORIES.
- B. Color, Pattern and Texture for Resilient Tile Flooring and Accessories: Section 09 06 00, SCHEDULE FOR FINISHES.

**1.3 SUBMITTALS:**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
  - 1. Description of each product.
  - 2. Resilient material manufacturer's recommendations for adhesives, underlayment, primers, and polish.
  - 3. Application, installation and maintenance instructions.
- C. Samples:
  - 1. Tile: Each type, color, thickness and finish.
  - 2. Edge Strips: Each type, color, thickness and finish.
  - 3. Feature Strips: Each type, color, thickness and finish.
- D. Shop Drawings:
  - 1. Layout of patterns as shown on the construction documents.
  - 2. Edge strip locations showing types and detail cross sections.
- E. Test Reports:
  - 1. Abrasion resistance: Depth of wear for each tile type and color and volume loss of tile, certified by independent laboratory. Tested per ASTM F510/F510M.

**1.4 DELIVERY:**

- A. Deliver materials to the site in original sealed packages or containers, clearly marked with the manufacturer's name or brand, type and color, production run number and date of manufacture.
- B. Materials from containers which have been distorted, damaged or opened prior to installation are not acceptable.

**1.5 STORAGE:**

- A. Store materials in a clean, dry, enclosed space off the ground, protected from harmful weather conditions and at temperature and humidity conditions recommended by the manufacturer. Protect adhesives from freezing. Store flooring, adhesives, and accessories in the spaces where they will be installed for at least 48 hours before beginning installation.

**1.6 QUALITY ASSURANCE:**

- A. Installer Qualifications: A company specializing in installation with minimum three (3) years' experience and employs experienced flooring installers who have retained, and currently hold, an INSTALL Certification, or a certification from a comparable certification program.
  - 1. Installers to be certified by INSTALL or a comparable certification program with the following minimum criteria:
    - a. US Department of Labor approved four (4) year apprenticeship program, 160 hours a year.
    - b. Career long training.
    - c. Manufacturer endorsed training.
    - d. Fundamental journeyman skills certification.
- B. Furnish product type materials from the same production run.

**1.7 WARRANTY:**

- A. Construction Warranty: Comply with FAR clause 52.246-21, "Warranty of Construction".

**1.8 APPLICABLE PUBLICATIONS:**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. ASTM International (ASTM):
  - D2047-11.....Test Method for Static Coefficient of Friction of Polish-Coated Flooring Surfaces as Measured by the James Machine
  - D2240-05(R2010).....Test Method for Rubber Property—Durometer Hardness
  - D4078-02(R2008).....Water Emulsion Floor Finish
  - E648-14c.....Critical Radiant Flux of Floor Covering Systems Using a Radiant Energy Source

- E662-14.....Specific Optical Density of Smoke Generated by Solid Materials
- E1155/E1155M-14.....Determining Floor Flatness and Floor Levelness Numbers
- F510/F510M-14.....Resistance to Abrasion of Resilient Floor Coverings Using an Abrader with a Grit Feed Method
- F710-11.....Preparing Concrete Floors to Receive Resilient Flooring
- F925-13.....Test Method for Resistance to Chemicals of Resilient Flooring
- F1344-12(R2013).....Rubber Floor Tile
- F1700-13a.....Solid Vinyl Floor Tile
- F1869-11.....Test Method for Measuring Moisture Vapor Emission Rate of Concrete Subfloor Using Anhydrous Calcium Chloride
- F2170-11.....Test Method for Determining Relative Humidity in Concrete Floor Slabs Using in Situ Probes
- F2195-13.....Linoleum Floor Tile
- C. Code of Federal Regulation (CFR):
  - 40 CFR 59.....Determination of Volatile Matter Content, Water Content, Density Volume Solids, and Weight Solids of Surface Coating
- D. International Standards and Training Alliance (INSTALL):

**PART 2 - PRODUCTS**

**2.1 PERFORMANCE REQUIREMENTS:**

- A. Provide adhesives, underlayment, primers, and polish recommended by resilient floor material manufacturer.
- B. Critical Radiant Flux: 0.45 watts per sq. cm or more, Class I, per ASTM E648.
- C. Smoke Density: Less than 450 per ASTM E662.
- D. Slip Resistance - Not less than 0.5 when tested with ASTM D2047.

**2.2 SOLID VINYL-TILE:**

- A. Tile Standard: ASTM F1700.
  - 1. Class: Class I, monolithic vinyl tile.
  - 2. Type: A, smooth surface.
- B. Thickness: 3.2 mm (0.125 inch).

C. Size: 305 x 305 mm (12 x 12 inches).

**2.3 ADHESIVES:**

A. Provide water resistant type adhesive for flooring, base and accessories as recommended by the manufacturer to suit substrate conditions. Submit manufacturer's descriptive data, documentation stating physical characteristics, and mildew and germicidal characteristics.

**2.4 POLISH AND CLEANERS:**

A. Cleaners: As recommended in writing by floor tile manufacturer.  
B. Polish: ASTM D4078.

**2.5 MOULDING:**

A. Provide tapered mouldings of vinyl and types as indicated on the construction documents for both edges and transitions of flooring materials specified. Provide vertical lip on moulding of maximum 6 mm (1/4 inch). Provide bevel change in level between 6 and 13 mm (1/4 and 1/2 inch) with a slope no greater than 1:2.  
B. Fasteners for Aluminum Mouldings: Stainless steel of type required for substrate condition.

**PART 3 - EXECUTION**

**3.1 ENVIRONMENTAL REQUIREMENTS:**

A. Maintain flooring materials and areas to receive resilient flooring at a temperature above 20 degrees C (68 degrees F) for three (3) days before application, during application and two (2) days after application, unless otherwise directly by the flooring manufacturer for the flooring being installed. Maintain a minimum temperature of 13 degrees C (55 degrees F) thereafter. Provide adequate ventilation to remove moisture from area and to comply with regulations limiting concentrations of hazardous vapors.  
B. Do not install flooring until building is permanently enclosed and wet construction in or near areas to receive tile materials is complete, dry and cured.

**3.2 SUBFLOOR TESTING AND PREPARATION:**

A. Prepare concrete substrates in accordance with ASTM F710.

**3.3 INSTALLATION:**

A. Install in accordance with manufacturer's instructions for application and installation unless specified otherwise.

- B. Mix tile from at least two containers. An apparent line either of shades or pattern variance is not acceptable.
- C. Tile Layout:
1. If layout is not shown on construction documents, lay tile symmetrically about center of room or space with joints aligned.
  2. Vary edge width as necessary to maintain full size tiles in the field, no edge tile to be less than 1/2 the field tile size, except where irregular shaped rooms make it impossible.
  3. Place tile pattern in the same direction; do not alternate tiles unless specifically indicated in the construction documents to the contrary.
- D. Application:
1. Adhere floor tile to flooring substrates using a full spread of adhesive applied to substrate to produce a completed installation without open cracks, voids, raising and puckering at joints, telegraphing of adhesive spreader marks, and other surface imperfections.
  2. Scribe, cut, and fit floor tiles to butt neatly and tightly to vertical surfaces and permanent fixtures including built-in furniture, cabinets, pipes, outlets, and door frames.
  3. Extend floor tiles into toe spaces, door reveals, closets, and similar openings. Extend floor tiles to center of door openings.
  4. Roll tile floor with a minimum 45 kg (100 pound) roller.
- E. Seal joints at pipes with sealants in accordance with Section 07 92 00, JOINT SEALANTS.
- F. Installation of Edge Strips:
1. Locate edge strips under center line of doors unless otherwise shown on construction documents.
  2. Set resilient edge strips in adhesive. Anchor metal edge strips with anchors and screws.
  3. Where tile edge is exposed, butt edge strip to touch along tile edge.
  4. Where thin set ceramic tile abuts resilient tile, set edge strip against floor file and against the ceramic tile edge.

**3.4 CLEANING AND PROTECTION:**

- A. Clean adhesive marks on exposed surfaces during the application of resilient materials before the adhesive sets. Exposed adhesive is not acceptable.
- B. Keep traffic off resilient material for a minimum 72 hours after installation.
- C. Clean flooring as recommended in accordance with manufacturer's printed maintenance instructions and within the recommended time frame. As required by the manufacturer, apply the recommended number of coats and type of polish and/or finish in accordance with manufacturer's written instructions.
- D. When construction traffic occurs over tile, cover resilient materials with reinforced kraft paper properly secured and maintained until removal is directed by COR. At entrances and where wheeled vehicles or carts are used, cover tile with plywood, hardboard, or particle board over paper, secured and maintained until removal is directed by COR.
- E. When protective materials are removed and immediately prior to acceptance, replace damaged tile and mouldings, re-clean resilient materials.

**3.5 LOCATION:**

- A. Unless otherwise indicated in construction documents, install tile flooring, under areas where casework, laboratory and pharmacy furniture and other equipment occur.
- B. Extend tile flooring for room into adjacent closets and alcoves.

- - - E N D - - -

**SECTION 09 91 00**  
**PAINTING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION:**

- A. Work of this Section includes all labor, materials, equipment, and services necessary to complete the painting and finishing as shown on the construction documents and/or specified herein, including, but not limited to, the following:
1. Prime coats which may be applied in shop under other sections.
  2. Prime painting unprimed surfaces to be painted under this Section.
  3. Painting items furnished with a prime coat of paint, including touching up of or repairing of abraded, damaged or rusted prime coats applied by others.
  4. Painting ferrous metal (except stainless steel) exposed to view.
  5. Painting galvanized ferrous metals exposed to view.
  6. Painting interior concrete block exposed to view.
  7. Painting gypsum drywall exposed to view.
  8. Painting of wood exposed to view, except items which are specified to be painted or finished under other Sections of these specifications. Back painting of all wood in contact with concrete, masonry or other moisture areas.
  9. Painting pipes, pipe coverings, conduit, ducts, insulation, hangers, supports and other mechanical and electrical items and equipment exposed to view.
  10. Painting surfaces above, behind or below grilles, gratings, diffusers, louvers lighting fixtures, and the like, which are exposed to view through these items.
  11. Painting includes shellacs, stains, varnishes, coatings specified, and striping or markers and identity markings.
  12. Incidental painting and touching up as required to produce proper finish for painted surfaces, including touching up of factory finished items.
  13. Painting of any surface not specifically mentioned to be painted herein or on construction documents, but for which painting is obviously necessary to complete the job, or work which comes within the intent of these specifications, is to be included as though specified.



**1.2 RELATED WORK:**

- A. Activity Hazard Analysis: Section 01 35 26, SAFETY REQUIREMENTS.
- B. Masonry Repairs: Section 04 05 16, MASONRY GROUTING.
- C. Shop prime painting of steel and ferrous metals: Division 05 - METALS, Division 08 - OPENINGS; Division 10 - SPECIALTIES; Division 14 - CONVEYING EQUIPMENT; Division 21 - FIRE SUPPRESSION; Division 23 - HEATING; VENTILATION AND AIR-CONDITIONING; Division 26 - ELECTRICAL.
- D. Type of Finish, Color, and Gloss Level of Finish Coat: Section 09 06 00, SCHEDULE FOR FINISHES.

**1.3 SUBMITTALS:**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Painter qualifications.
- C. Manufacturer's Literature and Data:
  - 1. Before work is started, or sample panels are prepared, submit manufacturer's literature and technical data, the current Master Painters Institute (MPI) "Approved Product List" indicating brand label, product name and product code as of the date of contract award, will be used to determine compliance with the submittal requirements of this specification. The Contractor may choose to use subsequent MPI "Approved Product List", however, only one (1) list may be used for the entire contract and each coating system is to be from a single manufacturer. All coats on a particular substrate must be from a single manufacturer. No variation from the MPI "Approved Product List" where applicable is acceptable.
- D. Sample Panels:
  - 1. After painters' materials have been approved and before work is started submit sample panels showing each type of finish and color specified.
  - 2. Panels to Show Color: Composition board, 100 x 250 mm (4 x 10 inch).
  - 3. Panel to Show Transparent Finishes: Wood of same species and grain pattern as wood approved for use, 100 x 250 mm (4 x 10 inch face) minimum, and where both flat and edge grain will be exposed, 250 mm (10 inches) long by sufficient size, 50 x 50 mm (2 x 2 inch) minimum or actual wood member to show complete finish.
  - 4. Attach labels to panel stating the following:
    - a. Federal Specification Number or manufacturers name and product number of paints used.

- b. Specification code number specified in Section 09 06 00, SCHEDULE FOR FINISHES.
- c. Product type and color.
- d. Name of project.
- 5. Strips showing not less than 50 mm (2 inch) wide strips of undercoats and 100 mm (4 inch) wide strip of finish coat.
- E. Sample of identity markers if used.
- F. Manufacturers' Certificates indicating compliance with specified requirements:
  - 1. Manufacturer's paint substituted for Federal Specification paints meets or exceeds performance of paint specified.
  - 2. High temperature aluminum paint.
  - 3. Epoxy coating.
  - 4. Intumescent clear coating or fire retardant paint.
  - 5. Plastic floor coating.

**1.4 DELIVERY AND STORAGE:**

- A. Deliver materials to site in manufacturer's sealed container marked to show following:
  - 1. Name of manufacturer.
  - 2. Product type.
  - 3. Batch number.
  - 4. Instructions for use.
  - 5. Safety precautions.
- B. In addition to manufacturer's label, provide a label legibly printed as following:
  - 1. Federal Specification Number, where applicable, and name of material.
  - 2. Surface upon which material is to be applied.
  - 3. Specify Coat Types: Prime; body; finish; etc.
- C. Maintain space for storage, and handling of painting materials and equipment in a ventilated, neat and orderly condition to prevent spontaneous combustion from occurring or igniting adjacent items.
- D. Store materials at site at least 24 hours before using, at a temperature between 7 and 30 degrees C (45 and 85 degrees F).

**1.5 QUALITY ASSURANCE:**

- A. Qualification of Painters: Use only qualified journeyman painters for the mixing and application of paint on exposed surfaces. Submit evidence that key personnel have successfully performed surface preparation and

application of coating on a minimum of three (3) similar projects within the past three (3) years.

- B. Paint Coordination: Provide finish coats which are compatible with the prime paints used. Review other Sections of these specifications in which prime paints are to be provided to ensure compatibility of the total coatings system for the various substrates. Upon request from other subcontractors, furnish information on the characteristics of the finish materials proposed to be used, to ensure that compatible prime coats are used. Provide barrier coats over incompatible primers or remove and re-prime as required. Notify the Contracting Officer Representative (COR) in writing of any anticipated problems using the coating systems as specified with substrates primed by others.

**1.6 REGULATORY REQUIREMENTS:**

- A. Paint materials are to conform to the restrictions of the local Environmental and Toxic Control jurisdiction.
1. Volatile Organic Compounds (VOC) Emissions Requirements: Field-applied paints and coatings that are inside the waterproofing system to not exceed limits of authorities having jurisdiction.
  2. Chromate, Cadmium, Mercury, and Silica: Provide materials that do not contain zinc-chromate, strontium-chromate, Cadmium, mercury or mercury compounds or free crystalline silica.
  3. Human Carcinogens: Provide materials that do not contain any of the ACGIH-BKLT and ACGHI-DOC confirmed or suspected human carcinogens.
  4. Use high performance acrylic paints in place of alkyd paints.

**1.7 SAFETY AND HEALTH**

- A. Apply paint materials using safety methods and equipment in accordance with the following:
1. Comply with applicable Federal, State, and local laws and regulations, and with the ACCIDENT PREVENTION PLAN, including the Activity Hazard Analysis (AHA) as specified in Section 01 35 26, SAFETY REQUIREMENTS. The AHA is to include analyses of the potential impact of painting operations on painting personnel and on others involved in and adjacent to the work zone.
- B. Safety Methods Used During Paint Application: Comply with the requirements of SSPC PA Guide 10.
- C. Toxic Materials: To protect personnel from overexposure to toxic materials, conform to the most stringent guidance of:

1. The applicable manufacturer's Material Safety Data Sheets (MSDS) or local regulation.
2. 29 CFR 1910.1000.
3. ACHIH-BKLT and ACGHI-DOC, threshold limit values.

**1.8 APPLICABLE PUBLICATIONS:**

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by basic designation only.
- B. American Conference of Governmental Industrial Hygienists (ACGIH):  
ACGIH TLV-BKLT-2012.....Threshold Limit Values (TLV) for Chemical Substances and Physical Agents and Biological Exposure Indices (BEIs)  
ACGIH TLV-DOC-2012.....Documentation of Threshold Limit Values and Biological Exposure Indices, (Seventh Edition)
- C. ASME International (ASME):  
A13.1-07(R2013).....Scheme for the Identification of Piping Systems
- D. Code of Federal Regulation (CFR):  
40 CFR 59.....Determination of Volatile Matter Content, Water Content, Density Volume Solids, and Weight Solids of Surface Coating
- E. Commercial Item Description (CID):  
A-A-1272A.....Plaster Gypsum (Spackling Compound)
- F. Federal Specifications (Fed Spec):  
TT-P-1411A.....Paint, Copolymer-Resin, Cementitious (For Waterproofing Concrete and Masonry Walls) (CEP)
- G. Master Painters Institute (MPI):  
1.....Aluminum Paint  
4.....Interior/ Exterior Latex Block Filler  
5.....Exterior Alkyd Wood Primer  
7.....Exterior Oil Wood Primer  
8.....Exterior Alkyd, Flat MPI Gloss Level 1  
9.....Exterior Alkyd Enamel MPI Gloss Level 6  
10.....Exterior Latex, Flat  
11.....Exterior Latex, Semi-Gloss  
18.....Organic Zinc Rich Primer  
22.....Aluminum Paint, High Heat (up to 590° - 1100F)  
27.....Exterior / Interior Alkyd Floor Enamel, Gloss

- 31.....Polyurethane, Moisture Cured, Clear Gloss
- 36.....Knot Sealer
- 43.....Interior Satin Latex, MPI Gloss Level 4
- 44.....Interior Low Sheen Latex, MPI Gloss Level 2
- 45.....Interior Primer Sealer
- 46.....Interior Enamel Undercoat
- 47.....Interior Alkyd, Semi-Gloss, MPI Gloss Level 5
- 48.....Interior Alkyd, Gloss, MPI Gloss Level 6
- 50.....Interior Latex Primer Sealer
- 51.....Interior Alkyd, Eggshell, MPI Gloss Level 3
- 52.....Interior Latex, MPI Gloss Level 3
- 53.....Interior Latex, Flat, MPI Gloss Level 1
- 54.....Interior Latex, Semi-Gloss, MPI Gloss Level 5
- 59.....Interior/Exterior Alkyd Porch & Floor Enamel, Low  
Gloss
- 60.....Interior/Exterior Latex Porch & Floor Paint, Low  
Gloss
- 66.....Interior Alkyd Fire Retardant, Clear Top-Coat (ULC  
Approved)
- 67.....Interior Latex Fire Retardant, Top-Coat (ULC  
Approved)
- 68.....Interior/ Exterior Latex Porch & Floor Paint,  
Gloss
- 71.....Polyurethane, Moisture Cured, Clear, Flat
- 77.....Epoxy Cold Cured, Gloss
- 79.....Marine Alkyd Metal Primer
- 90.....Interior Wood Stain, Semi-Transparent
- 91.....Wood Filler Paste
- 94.....Exterior Alkyd, Semi-Gloss
- 95.....Fast Drying Metal Primer
- 98.....High Build Epoxy Coating
- 101.....Epoxy Anti-Corrosive Metal Primer
- 108.....High Build Epoxy Coating, Low Gloss
- 114.....Interior Latex, Gloss
- 119.....Exterior Latex, High Gloss (acrylic)
- 134.....Galvanized Water Based Primer
- 135.....Non-Cementitious Galvanized Primer

- 138.....Interior High Performance Latex, MPI Gloss Level 2
- 139.....Interior High Performance Latex, MPI Gloss Level 3
- 140.....Interior High Performance Latex, MPI Gloss Level 4
- 141.....Interior High Performance Latex (SG) MPI Gloss  
Level 5
- 163.....Exterior Water Based Semi-Gloss Light Industrial  
Coating, MPI Gloss Level 5

- G. Society for Protective Coatings (SSPC):
  - SSPC SP 1-82(R2004).....Solvent Cleaning
  - SSPC SP 2-82(R2004).....Hand Tool Cleaning
  - SSPC SP 3-28(R2004).....Power Tool Cleaning
  - SSPC SP 10/NACE No.2.....Near-White Blast Cleaning
  - SSPC PA Guide 10.....Guide to Safety and Health Requirements
- H. Maple Flooring Manufacturer's Association (MFMA):
- I. U.S. National Archives and Records Administration (NARA):
  - 29 CFR 1910.1000.....Air Contaminants
- J. Underwriter's Laboratory (UL)

**PART 2 - PRODUCTS**

**2.1 MATERIALS:**

- A. Conform to the coating specifications and standards referenced in PART 3. Submit manufacturer's technical data sheets for specified coatings and solvents.

**2.2 PAINT PROPERTIES:**

- A. Use ready-mixed (including colors), except two component epoxies, polyurethanes, polyesters, paints having metallic powders packaged separately and paints requiring specified additives.
- B. Where no requirements are given in the referenced specifications for primers, use primers with pigment and vehicle, compatible with substrate and finish coats specified.
- C. Provide undercoat paint produced by the same manufacturer as the finish coats. Use only thinners approved by the paint manufacturer, and use only to recommended limits.
- D. VOC test method for paints and coatings is to be in accordance with 40 CFR 59 (EPA Method 24). Part 60, Appendix A with the exempt compounds' content determined by Method 303 (Determination of Exempt Compounds) in the South Coast Air Quality Management District's (SCAQMD) "Laboratory Methods of Analysis for Enforcement Samples" manual.

**2.3 PLASTIC TAPE:**

- A. Pigmented vinyl plastic film in colors as specified in Section 09 06 00, SCHEDULE FOR FINISHES or specified.
- B. Pressure sensitive adhesive back.
- C. Widths as shown on construction documents.

**2.4 Biobased Content:**

- A. Paint products shall comply with following bio-based standards for biobased materials:

Material Type	Percent by Weight
Interior Paint	20 percent biobased material
Interior Paint- Oil Based and Solvent Alkyd	67 percent biobased material
Exterior Paint	20 percent biobased material
Wood & Concrete Stain	39 percent biobased content
Polyurethane Coatings	25 percent biobased content
Water Tank Coatings	59 percent biobased content
Wood & Concrete Sealer- Membrane Concrete Sealers	11 percent biobased content
Wood & Concrete Sealer- Penetrating Liquid	79 percent biobased content

- B. The minimum-content standards are based on the weight (not the volume) of the material.

**PART 3 - EXECUTION**

**3.1 JOB CONDITIONS:**

- A. Safety: Observe required safety regulations and manufacturer's warning and instructions for storage, handling and application of painting materials.
  - 1. Take necessary precautions to protect personnel and property from hazards due to falls, injuries, toxic fumes, fire, explosion, or other harm.
  - 2. Deposit soiled cleaning rags and waste materials in metal containers approved for that purpose. Dispose of such items off the site at end of each day's work.
- B. Atmospheric and Surface Conditions:
  - 1. Do not apply coating when air or substrate conditions are:
    - a. Less than 3 degrees C (5 degrees F) above dew point.

- b. Below 10 degrees C (50 degrees F) or over 35 degrees C (95 degrees F), unless specifically pre-approved by the COR and the product manufacturer. Under no circumstances are application conditions to exceed manufacturer recommendations.
  - c. When the relative humidity exceeds 85 percent; or to damp or wet surfaces; unless otherwise permitted by the paint manufacturer's printed instructions.
2. Maintain interior temperatures until paint dries hard.
  3. Apply only on clean, dry and frost free surfaces except as follows:
    - a. Apply water thinned acrylic and cementitious paints to damp (not wet) surfaces only when allowed by manufacturer's printed instructions.
    - b. Concrete and masonry when permitted by manufacturer's recommendations, dampen surfaces to which water thinned acrylic and cementitious paints are applied with a fine mist of water on hot dry days to prevent excessive suction and to cool surface.

**3.2 INSPECTION:**

- A. Examine the areas and conditions where painting and finishing are to be applied and correct any conditions detrimental to the proper and timely completion of the work. Do not proceed with the work until unsatisfactory conditions are corrected to permit proper installation of the work.

**3.3 GENERAL WORKMANSHIP REQUIREMENTS:**

- A. Application may be by brush or roller. Spray application only upon acceptance from the COR in writing.
- B. Furnish to the COR a painting schedule indicating when the respective coats of paint for the various areas and surfaces will be completed. This schedule is to be kept current as the job progresses.
- C. Protect work at all times. Protect all adjacent work and materials by suitable covering or other method during progress of work. Upon completion of the work, remove all paint and varnish spots from floors, glass and other surfaces. Remove from the premises all rubbish and accumulated materials of whatever nature not caused by others and leave work in a clean condition.
- D. Remove and protect hardware, accessories, device plates, lighting fixtures, and factory finished work, and similar items, or provide in place protection. Upon completion of each space, carefully replace all removed items by workmen skilled in the trades involved.



- E. When indicated to be painted, remove electrical panel box covers and doors before painting walls. Paint separately and re-install after all paint is dry.
- F. Materials are to be applied under adequate illumination, evenly spread and flowed on smoothly to avoid runs, sags, holidays, brush marks, air bubbles and excessive roller stipple.
- G. Apply materials with a coverage to hide substrate completely. When color, stain, dirt or undercoats show through final coat of paint, the surface is to be covered by additional coats until the paint film is of uniform finish, color, appearance and coverage, at no additional cost to the Government.
- H. All coats are to be dry to manufacturer's recommendations before applying succeeding coats.
- I. All suction spots or "hot spots" in plaster after the application of the first coat are to be touched up before applying the second coat.
- J. Do not apply paint behind frameless mirrors that use mastic for adhering to wall surface.

#### **3.4 SURFACE PREPARATION:**

- A. General:
  - 1. The Contractor shall be held wholly responsible for the finished appearance and satisfactory completion of painting work. Properly prepare all surfaces to receive paint, which includes cleaning, sanding, and touching-up of all prime coats applied under other Sections of the work. Broom clean all spaces before painting is started. All surfaces to be painted or finished are to be completely dry, clean and smooth.
  - 2. See other sections of specifications for specified surface conditions and prime coat.
  - 3. Perform preparation and cleaning procedures in strict accordance with the paint manufacturer's instructions and as herein specified, for each particular substrate condition.
  - 4. Clean surfaces before applying paint or surface treatments with materials and methods compatible with substrate and specified finish. Remove any residue remaining from cleaning agents used. Do not use solvents, acid, or steam on concrete and masonry. Schedule the cleaning and painting so that dust and other contaminants from the cleaning process will not fall in wet, newly painted surfaces.

5. Maximum Moisture Content of Substrates: When measured with an electronic moisture meter as follows:
  - a. Concrete: 12 percent.
  - b. Fiber-Cement Board: 12 percent.
  - c. Masonry (Clay and CMU's): 12 percent.
  - d. Wood: 15 percent.
  - e. Gypsum Board: 12 percent.
  - f. Plaster: 12 percent.
- B. Ferrous Metals:
  1. Remove oil, grease, soil, drawing and cutting compounds, flux and other detrimental foreign matter in accordance with SSPC-SP 1 (Solvent Cleaning).
  2. Remove loose mill scale, rust, and paint, by hand or power tool cleaning, as defined in SSPC-SP 2 (Hand Tool Cleaning) and SSPC-SP 3 (Power Tool Cleaning).
  3. Fill dents, holes and similar voids and depressions in flat exposed surfaces of hollow steel doors and frames, access panels, roll-up steel doors and similar items specified to have semi-gloss or gloss finish with TT-F-322D (Filler, Two-Component Type, For Dents, Small Holes and Blow-Holes). Finish flush with adjacent surfaces.
    - a. Fill flat head countersunk screws used for permanent anchors.
    - b. Do not fill screws of item intended for removal such as glazing beads.
  4. Spot prime abraded and damaged areas in shop prime coat which expose bare metal with same type of paint used for prime coat. Feather edge of spot prime to produce smooth finish coat.
  5. Spot prime abraded and damaged areas which expose bare metal of factory finished items with paint as recommended by manufacturer of item.
- C. Gypsum Plaster and Gypsum Board:
  1. Remove efflorescence, loose and chalking plaster or finishing materials.
  2. Remove dust, dirt, and other deterrents to paint adhesion.
  3. Fill holes, cracks, and other depressions with CID-A-A-1272A finished flush with adjacent surface, with texture to match texture of adjacent surface. Patch holes over 25 mm (1-inch) in diameter as specified in Section for plaster or gypsum board.

**3.5 PAINT PREPARATION:**

- A. Thoroughly mix painting materials to ensure uniformity of color, complete dispersion of pigment and uniform composition.
- B. Do not thin unless necessary for application and when finish paint is used for body and prime coats. Use materials and quantities for thinning as specified in manufacturer's printed instructions.
- C. Remove paint skins, then strain paint through commercial paint strainer to remove lumps and other particles.
- D. Mix two (2) component and two (2) part paint and those requiring additives in such a manner as to uniformly blend as specified in manufacturer's printed instructions unless specified otherwise.
- E. For tinting required to produce exact shades specified, use color pigment recommended by the paint manufacturer.

**3.6 APPLICATION:**

- A. Start of surface preparation or painting will be construed as acceptance of the surface as satisfactory for the application of materials.
- B. Unless otherwise specified, apply paint in three (3) coats; prime, body, and finish. When two (2) coats applied to prime coat are the same, first coat applied over primer is body coat and second coat is finish coat.
- C. Apply each coat evenly and cover substrate completely.
- D. Allow not less than 48 hours between application of succeeding coats, except as allowed by manufacturer's printed instructions, and approved by COR.
- E. Apply by brush or roller. Spray application for new or existing occupied spaces only upon approval by acceptance from COR in writing.
  - 1. Apply painting materials specifically required by manufacturer to be applied by spraying.
  - 2. In new construction and in existing occupied spaces, where paint is applied by spray, mask or enclose with polyethylene, or similar air tight material with edges and seams continuously sealed including items specified in "Building and Structural Work Field Painting"; "Work not Painted"; motors, controls, telephone, and electrical equipment, fronts of sterilizes and other recessed equipment and similar prefinished items.
- F. Do not paint in closed position operable items such as access doors and panels, window sashes, overhead doors, and similar items except overhead roll-up doors and shutters.

### **3.7 PRIME PAINTING:**

- A. After surface preparation, prime surfaces before application of body and finish coats, except as otherwise specified.
- B. Spot prime and apply body coat to damaged and abraded painted surfaces before applying succeeding coats.
- C. Additional field applied prime coats over shop or factory applied prime coats are not required except for exterior exposed steel apply an additional prime coat.
- D. Prime rabbets for stop and face glazing of wood, and for face glazing of steel.
- E. Metals except boilers, incinerator stacks, and engine exhaust pipes:
  - 1. Steel and iron: MPI 79 (Marine Alkyd Metal Primer) finish is specified.
- F. Gypsum Board:
  - 1. Surfaces scheduled to have MPI 53 (Interior Latex, Flat), respectively.
  - 2. Primer: MPI 50 (Interior Latex Primer Sealer).
  - 3. Surfaces scheduled to receive vinyl coated fabric wall covering:

### **3.8 INTERIOR FINISHES:**

- A. Apply following finish coats over prime coats in spaces or on surfaces specified in Section 09 06 00, SCHEDULE FOR FINISHES.
- B. Metal Work:
  - 1. Apply to exposed surfaces.
  - 2. Omit body and finish coats on surfaces concealed after installation except electrical conduit containing conductors over 600 volts.
  - 3. Ferrous Metal, Galvanized Metal, and Other Metals Scheduled:
    - a. Apply two (2) coats of MPI 47 (Interior Alkyd, Semi-Gloss) unless specified otherwise.
    - b. Two (2) coats of MPI 51 (Interior Alkyd, Eggshell).
    - c. One (1) coat of MPI 46 (Interior Enamel Undercoat) plus one coat of MPI 47 (Interior Alkyd, Semi-Gloss) on exposed interior surfaces of alkyd-amine enamel prime finished windows.
- C. Gypsum Board:
  - 1. One (1) coat of MPI 45 (Interior Primer Sealer) plus one (1) coat of MPI 139 (Interior High Performance Latex, MPI Gloss level 3).

### **3.9 REFINISHING EXISTING PAINTED SURFACES:**

- A. Clean, patch and repair existing surfaces as specified under "Surface Preparation". No "telegraphing" of lines, ridges, flakes, etc., through

new surfacing is permitted. Where this occurs, sand smooth and re-finish until surface meets with COR's approval.

- B. Remove and reinstall items as specified under "General Workmanship Requirements".
- C. Remove existing finishes or apply separation coats to prevent non compatible coatings from having contact.
- D. Patched or Replaced Areas in Surfaces and Components: Apply spot prime and body coats as specified for new work to repaired areas or replaced components.
- E. Except where scheduled for complete painting apply finish coat over plane surface to nearest break in plane, such as corner, reveal, or frame.
- F. In existing rooms and areas where alterations occur, clean existing stained and natural finished wood retouch abraded surfaces and then give entire surface one (1) coat of MPI 71 (Polyurethane, Moisture Cured, Clear Flat).
- G. Refinish areas as specified for new work to match adjoining work unless specified or scheduled otherwise.
- H. Coat knots and pitch streaks showing through old finish with MPI 36 (Knot Sealer) before refinishing.
- I. Sand or dull glossy surfaces prior to painting.
- J. Sand existing coatings to a feather edge so that transition between new and existing finish will not show in finished work.

**3.10 PAINT COLOR:**

- A. Color and gloss of finish coats is specified in Section 09 06 00, SCHEDULE FOR FINISHES.
- B. For additional requirements regarding color see Articles, "REFINISHING EXISTING PAINTED SURFACE" and "MECHANICAL AND ELECTRICAL FIELD PAINTING SCHEDULE".
- C. Coat Colors:
  - 1. Color of priming coat: Lighter than body coat.
  - 2. Color of body coat: Lighter than finish coat.
  - 3. Color prime and body coats to not show through the finish coat and to mask surface imperfections or contrasts.
- D. Painting, Caulking, Closures, and Fillers Adjacent to Casework:
  - 1. Paint to match color of casework where casework has a paint finish.
  - 2. Paint to match color of wall where casework is stainless steel, plastic laminate, or varnished wood.

**3.11 MECHANICAL AND ELECTRICAL WORK FIELD PAINTING SCHEDULE:**

- A. Field painting of mechanical and electrical consists of cleaning, touching-up abraded shop prime coats, and applying prime, body and finish coats to materials and equipment if not factory finished in space scheduled to be finished.
- B. In spaces not scheduled to be finish painted in Section 09 06 00, SCHEDULE FOR FINISHES paint as specified below.
- C. Paint various systems specified in Division 02 - EXISTING CONDITIONS, Division 21 - FIRE SUPPRESSION, Division 23 - HEATING, VENTILATION AND AIR-CONDITIONING, Division 26 - ELECTRICAL, Division 27 - COMMUNICATIONS, and Division 28 - ELECTRONIC SAFETY AND SECURITY.
- D. Paint after tests have been completed.
- E. Omit prime coat from factory prime-coated items.
- F. Finish painting of mechanical and electrical equipment is not required when located in interstitial spaces, above suspended ceilings, in concealed areas such as pipe and electric closets, pipe basements, pipe tunnels, trenches, attics, roof spaces, shafts and furred spaces except on electrical conduit containing feeders 600 volts or more.
- G. Omit field painting of items specified in "BUILDING AND STRUCTURAL WORK FIELD PAINTING"; "Building and Structural Work not Painted".
- H. Color:
  - 1. Paint items having no color specified in Section 09 06 00, SCHEDULE FOR FINISHES to match surrounding surfaces.
  - 2. Paint colors as specified in Section 09 06 00, SCHEDULE FOR FINISHES except for following:
    - a. White: Exterior unfinished surfaces of enameled plumbing fixtures. Insulation coverings on breeching and uptake inside boiler house, drums and drum-heads, oil heaters, condensate tanks and condensate piping.
    - b. Gray: Heating, ventilating, air conditioning and refrigeration equipment (except as required to match surrounding surfaces), and water and sewage treatment equipment and sewage ejection equipment.
    - c. Aluminum Color: Ferrous metal on outside of boilers and in connection with boiler settings including supporting doors and door frames and fuel oil burning equipment, and steam generation system (bare piping, fittings, hangers, supports, valves, traps and miscellaneous iron work in contact with pipe).

- d. Federal Safety Red: Exposed fire protection piping hydrants, post indicators, electrical conducts containing fire alarm control wiring, and fire alarm equipment.
- e. Federal Safety Orange: Entire lengths of electrical conduits containing feeders 600 volts or more.
- f. Color to match brickwork sheet metal covering on breeching outside of exterior wall of boiler house.

**3.12 IDENTITY PAINTING SCHEDULE:**

- A. Identify designated service in new buildings or projects with extensive remodeling in accordance with ASME A13.1, unless specified otherwise, on exposed piping, piping above removable ceilings, piping in accessible pipe spaces, interstitial spaces, and piping behind access panels. For existing spaces where work is minor match existing.
  - 1. Legend may be identified using snap-on coil plastic markers or by paint stencil applications.
  - 2. Apply legends adjacent to changes in direction, on branches, where pipes pass through walls or floors, adjacent to operating accessories such as valves, regulators, strainers and cleanouts a minimum of 12.2 M (40 feet) apart on straight runs of piping. Identification next to plumbing fixtures is not required.
  - 3. Locate Legends clearly visible from operating position.
  - 4. Use arrow to indicate direction of flow using black stencil paint.
  - 5. Identify pipe contents with sufficient additional details such as temperature, pressure, and contents to identify possible hazard. Insert working pressure shown on construction documents where asterisk appears for High, Medium, and Low Pressure designations as follows:
    - a. High Pressure - 414 kPa (60 psig) and above.
    - b. Medium Pressure - 104 to 413 kPa (15 to 59 psig).
    - c. Low Pressure - 103 kPa (14 psig) and below.
    - d. Add Fuel oil grade numbers.
  - 6. Legend name in full or in abbreviated form as follows:

PIPING	COLOR OF EXPOSED PIPING	COLOR OF BACKGROUND	COLOR OF LETTERS	LEGEND ABBREVIATIONS
Blow-off		Green	White	Blow-off
Boiler Feedwater		Green	White	Blr Feed
A/C Condenser Water				

Supply	Green	White	A/C Cond Wtr Sup	
A/C Condenser Water				
Return	Green	White	A/C Cond Wtr Ret	
Chilled Water Supply	Green	White	Ch. Wtr Sup	
Chilled Water Return	Green	White	Ch. Wtr Ret	
Shop Compressed Air	Blue	White	Shop Air	
Air-Instrument Controls	Green	White	Air-Inst Cont	
Drain Line	Green	White	Drain	
Emergency Shower	Green	White	Emg Shower	
High Pressure Steam	Green	White	H.P. _____*	
High Pressure Condensate				
Return	Green	White	H.P. Ret _____*	
Medium Pressure Steam	Green	White	M. P. Stm _____*	
Medium Pressure Condensate				
Return	Green	White	M.P. Ret _____*	
Low Pressure Steam	Green	White	L.P. Stm _____*	
Low Pressure Condensate				
Return	Green	White	L.P. Ret _____*	
High Temperature Water				
Supply	Green	White	H. Temp Wtr Sup	
High Temperature Water				
Return	Green	White	H. Temp Wtr Ret	
Hot Water Heating Supply	Green	White	H. W. Htg Sup	
Hot Water Heating Return	Green	White	H. W. Htg Ret	
Gravity Condensate Return	Green	White	Gravity Cond Ret	
Pumped Condensate Return	Green	White	Pumped Cond Ret	
Vacuum Condensate Return	Green	White	Vac Cond Ret	
Fuel Oil - Grade	Brown	White	Fuel Oil-Grade	
(Diesel Fuel included under Fuel Oil)				
Boiler Water Sampling	Green	White	Sample	
Chemical Feed	Green	White	Chem Feed	
Continuous Blow-Down	Green	White	Cont. B D	
Pumped Condensate	Green	White	Pump Cond	
Pump Recirculating	Green	White	Pump-Recirc.	
Vent Line	Green	White	Vent	
Alkali	Orange	Black	Alk	
Bleach	Orange	Black	Bleach	
Detergent	Yellow	Black	Det	
Liquid Supply	Yellow	Black	Liq Sup	
Reuse Water	Yellow	Black	Reuse Wtr	
Cold Water (Domestic)	White	Green	White	C.W. Dom
Hot Water (Domestic)				
Supply	White	Yellow	Black	H.W. Dom
Return	White	Yellow	Black	H.W. Dom Ret



Tempered Water	White	Yellow	Black	Temp. Wtr
Ice Water				
Supply	White	Green	White	Ice Wtr
Return	White	Green	White	Ice Wtr Ret
Reagent Grade Water		Green	White	RG
Reverse Osmosis		Green	White	RO
Sanitary Waste		Green	White	San Waste
Sanitary Vent		Green	White	San Vent
Storm Drainage		Green	White	St Drain
Pump Drainage		Green	White	Pump Disch
Chemical Resistant Pipe				
Waste		Orange	Black	Acid Waste
Vent		Orange	Black	Acid Vent
Atmospheric Vent		Green	White	ATV
Silver Recovery		Green	White	Silver Rec
Oral Evacuation		Green	White	Oral Evac
Fuel Gas		Yellow	Black	Gas
Fire Protection Water				
Sprinkler	Red	Red	White	Auto Spr
Standpipe	Red	Red	White	Stand
Sprinkler	Red	Red	White	Drain

B. Fire and Smoke Partitions:

1. Identify partitions above ceilings on both sides of partitions except within shafts in letters not less than 64 mm (2 1/2 inches) high.
2. Stenciled message: "SMOKE BARRIER" or, "FIRE BARRIER" as applicable.
3. Locate not more than 6096 mm (20 feet) on center on corridor sides of partitions, and with a least one (1) message per room on room side of partition.
4. Use semi-gloss paint of color that contrasts with color of substrate.

C. Identify columns in pipe basements and interstitial space:

1. Apply stenciled number and letters to correspond with grid numbering and lettering indicated on construction documents.
2. Paint numbers and letters 101 mm (4 inches) high, locate 45 mm (18 inches) below overhead structural slab.
3. Apply on four (4) sides of interior columns and on inside face only of exterior wall columns.
4. Color:
  - a. Use black on concrete columns.
  - b. Use white or contrasting color on steel columns.

**3.13 PROTECTION CLEAN UP, AND TOUCH-UP:**

- A. Protect work from paint droppings and spattering by use of masking, drop cloths, removal of items or by other approved methods.
- B. Upon completion, clean paint from hardware, glass and other surfaces and items not required to be painted of paint drops or smears.
- C. Before final inspection, touch-up or refinished in a manner to produce solid even color and finish texture, free from defects in work which was damaged or discolored.

- - - E N D - - -

**SECTION 10 14 00**  
**SIGNAGE**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies interior signage for room numbers, code required signs and temporary signs.
- B. This section specifies exterior signage.

**1.2 RELATED WORK**

- A. Color and Finish of Interior Signs: Section 09 06 00, SCHEDULE FOR FINISHES.

**1.3 QUALITY ASSURANCE**

- A. Manufacturer's Qualifications: Provide signage that is the product of one manufacturer, who has provided signage as specified for a minimum of three (3) years. Submit manufacturer's qualifications.
- B. Installer's Qualifications: Minimum three (3) years' experience in the installation of signage of the type as specified in this Section. Submit installer's qualifications.

**1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 00, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.
- B. Interior Sign Samples: Sign panels and frames, with letters and symbols, for each sign type.
  - 1. Sign Panel, 203 x 254 mm (8 x 10 inches), with letters.
  - 2. Color samples of each color, 152 x 152 mm (6 x 6 inches). Show anticipated range of color and texture.
  - 3. Sample of typeface, arrow and symbols in a typical full size layout.
- C. Manufacturer's Literature:
  - 1. Showing the methods and procedures proposed for the anchorage of the signage system to each surface type.
  - 2. Manufacturer's printed specifications and maintenance instructions.
- D. Sign Location Plan, showing location, type and total number of signs required.
- E. Shop Drawings: Scaled for manufacture and fabrication of sign types. Identify materials, show joints, welds, anchorage, accessory items, mounting and finishes.
- F. Full size layout patterns for dimensional letters.
- G. Manufacturer's qualifications.

H. Installer's qualifications.

**1.5 DELIVERY AND STORAGE**

- A. Deliver materials to job in manufacturer's original sealed containers with brand name marked thereon. Protect materials from damage.
- B. Package to prevent damage or deterioration during shipment, handling, storage and installation. Maintain protective covering in place and in good repair until removal is necessary.
- C. Deliver signs only when the site and mounting services are ready for installation work to proceed.
- D. Store products in dry condition inside enclosed facilities.

**1.6 WARRANTY**

- A. Construction Warranty: Comply with FAR clause 52.246-21, "Warranty of Construction".

**1.7 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Architectural Manufacturers Association (AAMA):
  - 611-14.....Anodized Architectural Aluminum
  - 2603-13.....Voluntary Specification, Performance Requirements and Test Procedures for Pigmented Organic Coatings on Aluminum Extrusions and Panels
- C. American National Standards Institute (ANSI):
  - A117.1-09.....Accessible and Usable Buildings and Facilities
- D. ASTM International (ASTM):
  - A36/A36M-14.....Carbon Structural Steel
  - A240/A240M-15.....Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and for General Applications
  - A666-10.....Annealed or Cold-Worked Austenitic Stainless Steel Sheet, Strip, Plate and Flat Bar
  - A1011/A1011M-14.....Steel, Sheet and Strip, Hot-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, and Ultra-High Strength
  - B36/B36M-13.....Brass Plate, Sheet, Strip, and Rolled Bar

- B152/B152M-13.....Copper Sheet, Strip, Plate, and Rolled Bar
- B209-14.....Aluminum and Aluminum-Alloy Sheet and Plate
- B209M-14.....Aluminum and Aluminum-Alloy Sheet and Plate  
(Metric)
- B221-14.....Aluminum and Aluminum-Alloy Extruded Bars,  
Rods, Wire, Shapes, and Tubes
- B221M-13.....Aluminum and Aluminum-Alloy Extruded Bars,  
Rods, Wire, Shapes, and Tubes (Metric)
- C1036-11(R2012).....Flat Glass
- C1048-12.....Heat-Treated Flat Glass-Kind HS, Kind FT Coated  
and Uncoated Glass
- C1349-10.....Architectural Flat Glass Clad Polycarbonate
- D1003-13.....Test Method for Haze and Luminous Transmittance  
of Transparent Plastics
- D4802-10.....Poly(Methyl Methacrylate) Acrylic Plastic Sheet
- D. Code of Federal Regulation (CFR):
  - 40 CFR 59.....Determination of Volatile Matter Content, Water  
Content, Density Volume Solids, and Weight  
Solids of Surface Coating
- E. Federal Specifications (Fed Spec):
  - MIL-PRF-8184F.....Plastic Sheet, Acrylic, Modified.
  - MIL-P-46144C.....Plastic Sheet, Polycarbonate
- F. National Fire Protection Association (NFPA):
  - 70-14.....National Electrical Code

**PART 2 - PRODUCTS**

**2.1 SIGNAGE GENERAL**

- A. Provide signs of type, size and design shown on the construction documents.
- B. Provide signs complete with lettering, framing and related components for a complete installation.
- C. Provide graphics items as completed units produced by a single manufacturer, including necessary mounting accessories, fittings and fastenings.
- D. Do not scale construction documents for dimensions. Verify dimensions and coordinate with field conditions. Notify Contracting Officer Representative (COR) of discrepancies or changes needed to satisfy the requirements of the construction documents.

## **2.2 INTERIOR SIGN MATERIALS**

- A. Polycarbonate: MIL-P-46144C; Type I, class 1.
- B. Vinyl: Premium grade 0.1 mm (0.004 inch) thick machine cut, having a pressure sensitive adhesive and integral colors.
- C. Adhesives:
  - 1. Adhesives for Field Application: Mildew-resistant, nonstaining adhesive for use with specific type of panels, sheets, or assemblies; and for substrate application; as recommended in writing by signage manufacturer.
  - 2. Adhesives to have VOC content of 50 g/L or less when calculated according to 40 CFR 59, (EPA Method 24).
- D. Typography: Comply with VA Signage Design Guide.
  - 1. Type Style: Helvetica Medium and Helvetica Medium Condensed. Initial caps or all caps, as indicated on drawings
  - 2. Arrow: Comply with graphic standards in construction documents.
  - 3. Letter spacing: Comply with graphic standards in construction documents.
  - 4. Letter spacing: Comply with graphic standards in construction documents.
  - 5. Provide text, arrows, and symbols in size, colors, typefaces and letter spacing shown in construction documents. Text shall be a true, clean, accurate reproduction of typeface(s). Text shown in construction documents is for layout purposes only; final text for signs is listed on drawings.

## **2.3 INTERIOR SIGN TYPES**

- A. Conform to the VA Signage Design Guide.
- B. Provide frame component system.
- C. Component System Signs:
  - 1. Provide interior sign system as follows:
    - a. Interchangeable system that allows for changes of graphic components of the installed sign, without changing sign in its entirety.
    - b. Provide sign system comprised of following primary components:
      - 1) Rail Back: Horizontal rails, spaced to allow for uniform, modular sizing of sign types.

- 2) Rail Insert: Mount to back of Copy Panels to allow for attachment to Rail Back.
  - 3) Copy Panels: Fabricate of ABS materials to allow for different graphic needs.
  - 4) End Caps: Interlock to Rail Back to enclose and secure changeable Copy Panels.
  - 5) Joiners and Accent Joiners: To connect separate Rail Backs together.
  - 6) Top Accent Bars: To provide decorative trim cap that encloses the top of sign.
- c. Provide rail back, rail insert and end caps in anodized extruded aluminum.
  - d. Provide signs in system that are convertible in the field to allow for enlargement from one (1) size to another in height and width through use of joiners or accent joiners, which connect rail back panels together blindly, providing a butt joint between copy panels. Connect accent joiners to rail backs with a visible 3 mm (1/8") horizontal rib, flush to the adjacent copy insert surfaces.
  - e. Provide sign configurations as indicated on construction documents that vary in width from 228 mm (9 inches) to 2032 mm (80 inches), and have height dimensions of 50 mm (2 inches), 76 mm (3 inches), 152 mm (6 inches), 228 mm (9 inches) and 305 mm (12 inches). Height that can be increased beyond 305 mm (12 inches), by repeating height module in full or in part.
2. Provide rail back functions as internal structural member of sign. Fabricate of 6063T5-extruded aluminum, anodized black.
    - a. Fabricate to accept an extruded aluminum or plastic insert on either side, depending upon sign type.
    - b. Provide components that are convertible in field to allow for connection to other rail back panels.
    - c. Provide mounting devices including wall mounting with pressure sensitive tape and other mounting devices as needed.
  3. Provide rail insert functions as mounting device for copy panels on to the rail back. The rail insert mounts to the back of the copy panel with adhesive suitable for attaching particular copy insert material.

- a. Provide copy panels that slide or snap into the horizontal rail back.
4. Provide copy panels that accept various forms of copy and graphics, and attach to the rail back with the rail insert. Provide copy panels fabricated of ABS plastic with integral color or an acrylic lacquer finish.
  - a. Provide copy panels that are interchangeable by sliding horizontally from either side of sign, and to other signs in system of equal or greater width or height.
  - b. Provide materials that are cleanable without use of special chemicals or cleaning solutions.
  - c. Copy Panel Materials.
    - 1) ABS Inserts: 2.3 mm (.090 inches) extruded ABS plastic core with .07 mm (.003 inches) acrylic cap bonded during extrusion/texturing process.
      - a) Pressure bonded to extruded rail insert with adhesive.
      - b) Background Color: Integral or painted in acrylic lacquer.
      - c) Finished: Texture pattern.
    - 2) Photopolymer Inserts: 3.2 mm (.125 inches) phenolic photo polymer with raised copy etched to 2.3 mm (.0937 inches), bonded to an ABS plastic or extruded aluminum insert with adhesive.
      - a) Background Color: Painted, acrylic enamel.
    - 3) Changeable Paper/ Insert Holder: Extruded insert holder with integral rail insert for connection with structural back panel in 6063T5 aluminum with a black anodized finish.
      - a) Inserts into holder are paper with a clear 0.76 mm (.030 inches) textured cover.
      - b) Background Color: Painted, acrylic lacquer.
    - 4) Acrylic - 2 mm (.080 inches) non-glare acrylic.
      - a) Pressure bonded to extruded rail insert using adhesive.
      - b) Background Color: Painted in acrylic lacquer or acrylic enamel.
    - 5) Extruded 6063T5 aluminum with a black anodized finish insert holder with integral rail insert for connection with structural back panel to hold 0.76 mm (.030 inches) textured



polycarbonate insert and a sliding tile which mounts in the inset holder and slides horizontally.

5. End Caps: Extruded using 6063T5 aluminum with a black anodized finish. End caps interlock with rail back with clips to form an integral unit, enclosing and securing the changeable copy panels, without requiring tools for assembly.
  - a. Interchangeable to each end of sign and to other signs in signage system of equal height.
  - b. Provide mechanical fasteners that can be added to the end caps that will secure it to rail back to make sign tamper resistant.
6. Joiners: Extruded using 6063T5 aluminum with a black anodized finish. Rail joiners connect rail backs together blindly, providing a butt joint between copy inserts.
7. Accent Joiners: Extruded using 6063T5 aluminum with a mirror polished finish. Connect joiner and rail backs together with a visible 3 mm (.125 inches) horizontal rib, flush to the adjacent copy panel surfaces.
8. Top Accent Rail: Extruded rail using 6063T5 aluminum with a mirror polished finish that provides a 3.2 mm (.125 inches) high decorative trim cap. Cap butts flush to adjacent copy panel and encloses top of rail back and copy panel.
9. Typography:
  - a. Vinyl First Surface Copy (non-tactile): Applied vinyl copy.
  - b. Subsurface Copy Inserts: Textured 1 mm (.030 inches) clear polycarbonate face with subsurface applied vinyl copy.
    - 1) Spray face back with paint and laminated to extruded aluminum carrier insert.
  - c. Integral Tactile Copy Inserts: Phenolic photopolymer etched with 2.3 mm (.0937 inches) raised copy.
  - d. Silk-screened First Surface Copy (non-tactile): Injection molded or extruded ABS plastic.

D. Tactile Sign:

1. Tactile sign made from a material that provides for letters, numbers and Braille to be integral with sign. Photopolymer etched metal, sandblasted phenolic or embossed material. Do not apply letters, numbers and Braille with adhesive.

2. Numbers, letters and Braille to be raised 0.8 mm (1/32 inches) from the background surface. The draft of the letters, numbers and Braille to be tapered, vertical and clean.
  3. Braille Dots: Conform with ANSI A117.1 for Braille position and layout; (a) Dot base diameter: 1.5 mm (.059 inches) (b) Inter-dot spacing: 2.3 mm (.090 inches) (c) Horizontal separation between cells: 6.0 mm (.241 inches) (d) Vertical separation between cells: 10.0 mm (.395 inches)
  4. Paint assembly specified color. After painting, apply white or other specified color to surface of the numbers and letters. Apply protective clear coat sealant to entire sign.
  5. Finish: Eggshell, 11 to 19 degree on a 60 degree glossmeter.
- E. Provide cork or felt on bottom or mounting bracket when sign is mounted on counter or desk.
- F. For ceiling mounted signs, provide mounting hardware on the sign that allows for sign disconnection, removal, reinstallation, and reconnection.
- G. Temporary Interior Signs:
1. Fabricated from 50 kg (110 pound) matte finished white paper cut to 101 mm (4 inch) wide by 305 mm (12 inch) long.
    - a. Punched 3.2 mm (.125 inch) hole with edge of hole spaced 13 mm (.5 inch) in from edge and centered on 101 mm (4 inch) side.
    - b. Reinforce hole on both sides with suitable material that prevents tie from pulling through hole.
    - c. Ties: Steel wire 0.3 mm (0.120 inch) thick attached to tag with twist leaving 152 mm (6 inch) long free ends.
  2. Mark architectural room number on sign, with broad felt marker in clearly legible numbers or letters that identify room, corridor or space as shown on construction documents.
  3. Install temporary signs to rooms that have a room, corridor or space number. Attach to door frame, door knob or door pull.
    - a. Doors that do not require signs are: corridor doors in corridor with same number, folding doors or partitions, toilet doors, bathroom doors within and between rooms, closet doors within rooms, communicating doors in partitions between rooms with corridor entrance doors.
    - b. Replace and missing, damaged or illegible signs.

finish in Section 09 06 00, SCHEDULE FOR FINISHES.

#### **2.4 FABRICATION**

- A. Design interior signage components to allow for expansion and contraction for a minimum material temperature range of 38 degrees C (100 degrees F), without causing buckling, excessive opening of joints or over stressing of adhesives, welds and fasteners.
- B. Form work to required shapes and sizes, with true curve lines and angles. Provide necessary rebates, lugs and brackets for assembly of units. Provide concealed fasteners wherever possible.
- C. Shop fabricate so far as practicable. Fasten joints flush to conceal reinforcement, or weld joints, where thickness or section permits.
- D. Level and assemble contract surfaces of connected members so joints will be tight and practically unnoticeable, without applying filling compound.
- E. Signs: Fabricate with fine, even texture to be flat and sound.
  - 1. Maintain lines and miters sharp, arises unbroken, profiles accurate and ornament true to pattern.
  - 2. Plane surfaces to be smooth, flat and without oil-canning, free of rack and twist.
  - 3. Maximum variation from plane of surface plus or minus 0.3 mm (0.015 inches). Restore texture to filed or cut areas.
- F. Finish extruded members to be free from extrusion marks. Fabricate square turns, sharp corners, and true curves.
- G. Finish hollow signs with matching material on all faces, tops, bottoms and ends. Mitere edge joints to give appearance of solid material.
- H. Do not manufacture signs until final sign message schedule and location review has been completed by the COR and forwarded to contractor.
- I. Drill holes for bolts and screws. Mill smooth exposed ends and edges with corners slightly rounded.
- J. Form joints exposed to weather to exclude water.
- K. Movable Parts, Including Hardware: Cleaned and adjusted to operate as designed without binding or deformation of members. Center doors and covers in opening or frame.
  - 1. Align contact surfaces fit tight and even without forcing or warping components.
- L. Pre-assemble items in shop to minimize field splicing and assembly. Disassemble units only as necessary for shipping and handling

limitations. Clearly mark units for re-assembly and coordinated installation.

- M. Prime painted surfaces as required. Apply finish coating of paint for complete coverage with no light or thin applications allowing substrate or primer to show.
  - 1. Finish surface smooth, free of scratches, gouges, drips, bubbles, thickness variations, foreign matter and other imperfections.

**PART 3 - EXECUTION**

**3.1 INSTALLATION**

- A. Locate signs as shown on the Sign Location Plans.
- B. Conform to the VA Signage Design Guide for installation requirements.
- C. At each sign location there are no utility lines behind each sign location that will be affected by installation of signs.
  - 1. Correct and repair damage done to utilities during installation of signs at no additional cost to Government.
- D. Provide inserts and anchoring devices which must be set in concrete or other material for installation of signs. Submit setting drawings, templates, instructions and directions for installation of anchorage devices, which may involve other trades.
- E. Refer to Sign Message Schedule for mounting method. Mount signs in proper alignment, level and plumb according to the Sign Location Plan and the dimensions given on elevation and Sign Location Plans. When exact position, angle, height or location is not clear, contact COR for resolution.
- F. When signs are installed on glass, provide blank glass back up to be placed on opposite side of glass exactly behind sign being installed. Provide blank glass back that is the same size as sign being installed.
- G. Touch up exposed fasteners and connecting hardware to match color and finish of surrounding surface.
- H. At completion of sign installation, clean exposed sign surfaces. Clean and repair adjoining or adjacent surfaces that became soiled or damaged as a result of installation of signs.

- - - END - - -

**SECTION 14 22 00**  
**ELECTRIC TRACTION ELEVATOR MODERNIZATION**

**TABLE OF CONTENTS**

PART 1 - GENERAL.....	1
1.1    WORK INCLUDED.....	1
1.2    RELATED WORK.....	1
1.3    DEFINITIONS.....	4
1.4    QUALITY ASSURANCE.....	4
1.5    MAINTENANCE.....	7
1.6    DOCUMENT AND SITE VERIFICATION.....	8
1.7    SUBMITTALS.....	8
1.8    PERMIT, TEST AND INSPECTION.....	10
PART 2 - PRODUCTS.....	11
2.1    SUMMARY.....	11
2.2    MATERIALS.....	13
2.3    CONDUIT AND WIREWAY.....	14
2.4    CONDUCTORS.....	15
2.5    CAR AND GROUP PERFORMANCE.....	15
2.6    OPERATION.....	16
2.7    MACHINE ROOM EQUIPMENT.....	21
2.8    HOISTWAY EQUIPMENT.....	23
2.9    HOISTWAY ENTRANCES.....	24
2.10   CAR EQUIPMENT.....	25
2.11   CAR ENCLOSURE.....	28
2.12   HALL CONTROL STATIONS.....	31
2.13   SIGNALS.....	31
2.14   GROUP DISPLAY AND MONITORING SYSTEMS.....	31
2.15   INTERCOM AND DISTRESS SIGNAL SYSTEM.....	33
2.16   SEISMIC OPERATIONS AND EQUIPMENT.....	34
PART 3 - EXECUTION.....	34
3.1    SITE CONDITION INSPECTION.....	34
3.2    PRODUCT DELIVERY, STORAGE, AND HANDLING.....	34
3.3    INSTALLATION.....	34
3.4    FIELD QUALITY CONTROL.....	35
3.5    ADJUSTMENTS.....	35
3.6    CLEANUP.....	35
3.7    FINAL CLEANING.....	35
3.8    CONSULTANT'S FINAL OBSERVATION AND REVIEW REQUIREMENTS.....	36
3.9    PURCHASER'S INFORMATION.....	37

**SECTION 14 22 00**  
**ELECTRIC TRACTION ELEVATOR MODERNIZATION**

**PART 1 - GENERAL**

**1.1 WORK INCLUDED**

- A. Ten (10) Gearless Traction elevators as follows:
  - 1. Six (6) Passenger Elevators: Cars P1-P6.
  - 2. Four (4) Service Elevators: Cars S1-S4
- B. All engineering, equipment, labor, and permits required to satisfactorily complete elevator modernization required by Contract Documents.
- C. Cartage and Hoisting: All required staging, hoisting, and movement to, on, and from the site including new equipment, reused equipment, or dismantling and removal of existing equipment.
- D. Unless specifically identified as "Reuse," "Retain," or "Refurbish," provide new equipment.
- E. Protective barriers between cars in normal operation and adjacent cars in the modernization process. Full depth and height of hoistway.
- F. Hoistway, pit, and machine room barricades as required.

**1.2 RELATED WORK**

- A. Architectural and Structural, Hoistway and Hallway
  - 1. Wall blockouts and fire rated closure for control and signal fixture boxes which penetrate walls.
  - 2. Cutting and patching walls and floors.
  - 3. Protect open hoistways and entrances during construction per OSHA Regulations.
  - 4. Patch and fire rate all hoistway penetrations.
  - 5. Patch and fire rate existing machine room vents.
  - 6. Protect car enclosure, hoistway entrance assemblies, and special metal finishes from damage.
  - 7. Where existing, return operation to hoistway venting fire dampers.
  - 8. Remove existing finished cab flooring. Install new flooring. Coordinate weight of flooring and sill height with elevator contractor.
  - 9. Hoistway lighting: All Cars: Provide lighting with 3-way switches at the top and bottom of the hoistway accessible from elevator hoistway entrance prior to entering the pit or stepping onto the car top. Lighting shall illuminate top of elevator cab when it is at the top floor and the pit when at the bottom floor, minimum of 5 Foot candles.
- B. Architectural and Structural, Machine Room
  - 1. Enclosure a machine room that meets the requirements of ASME A17.1, NEC, and IBC.

2. Provide stairs and landing for access to the machine room. The landing shall be large enough to accommodate full opening of the door plus 60 cm (24 in.).
  3. Relocate existing IT services from Elevator Equipment room or otherwise isolate from machine room.
  4. Locate the light switch on the lock side of the door inside the machine room.
  5. Self-closing and locking rated access door. Include signage: "ELEVATOR MACHINE ROOM" and "AUTHORIZED PERSONNEL ONLY".
  6. Paint walls and ceiling for improved light reflectivity.
  7. Class "ABC" fire extinguisher in each elevator machine room.
  8. Access for hoisting. Provide access for hoisting to machine room as required and repair same when complete.
- C. Plumbing
1. Pit Sump or Drain: Indirect waste drain or sump with flush grate and pump. Sump pump/drain capacity minimum 3000 gallons per hour, per elevator.
- D. Mechanical:
1. Machine Room or Control Space: Ventilation and heating. Maintain minimum temperature of 55° F, maximum 90° F. Maintain maximum 80% relative humidity, non-condensing.
- E. Electrical Service, Conductors, and Devices:
1. Machine Room or Control Space Lighting: Guarded LED fixtures to provide minimum 19-foot candles average illumination. Provide toggle switch adjacent to strike side of machine room door. Occupancy sensor is not allowed.
  2. Machine Room or Control Space Night Light: Provide always-on 3-5-watt LED luminaire inside entrance to machine room.
  3. Pit Lighting: Guarded LED fixtures to provide minimum 10-foot candles average illumination.
  4. GFCI convenience outlets in pit.
  5. Two stop switches in the pit, 48" above the bottom landing at the top of the pit ladder and 48" above the pit floor adjacent to the pit ladder.
  6. GFCI convenience outlets in machine room or control space.
  7. GFCI convenience outlets in machine space.
  8. Heavy Duty three-phase mainline copper power feeder to terminals of each elevator controller in the machine room with protected lockable "open" disconnecting means.
  9. Single-phase copper power feeder to each elevator with individual protected lockable "open" disconnecting means located in machine room for utilization equipment:
    - a. Car lighting and Blower
    - b. Pit Sump Pump
    - c. Machine Room Monitoring System
    - d. Firefighters' control status panel.
  10. Emergency telephone line to each individual elevator control panel in elevator machine room.
  11. Automatic Fire Recall System
    - a. Fire alarm initiating devices in each elevator lobby, for each group of elevators or single elevator.
    - b. Fire alarm initiating devices in each elevator machine room.
    - c. Fire alarm initiating devices at top of hoistway if sprinklered.

- d. Three Relay Activation Modules for each group of elevators or single elevator. Locate modules within three feet of controller designated by the Elevator Contractor to minimize un-supervised wiring. Program Modules as follows:
    - 1) PRIMARY: Activate when any hallway device, except primary floor, activates.
    - 2) ALTERNATE: Activate when hallway device at primary floor activates.
    - 3) FIRE HAT: Activate when machine room device activates.
  - e. Device in machine room and at top of hoistway to provide signal for general alarm.
  - f. Provide technician from fire alarm contractor for pre-test of system during normal working hours.
  - g. Provide technician from fire alarm contractor for acceptance test of system with during overtime working hours.
12. Temporary power and illumination to install, test, and adjust elevator equipment.
  13. Firefighters' announcement speaker in car with connection to firefighters' control panel.
  14. Conduit from the closest hoistway of each elevator group or single elevator to the firefighters' control panel. Coordinate size, number, and location of conduits with Elevator Contractor.
  15. Means to automatically disconnect power to affected elevator drive unit and controller prior to activation of machine room fire sprinkler system and/or hoistway fire sprinkler system. Provide heat detectors, shunt trip breaker and all necessary equipment.
  16. When sprinklers are provided in the hoistway all electrical equipment, located less than 4'-0" above the pit floor shall be identified for use in wet locations. Exception: Seismic protection devices.
  17. Power for Mechanical Equipment: Provide power for HVAC and/or ventilation equipment where applicable.
  18. Conduit from fire alarm panel to each fire alarm device location at each floor, hoistway, pit and machine room including three relay activation modules in machine room. Provide junction box at each location.
  19. Review power confirmation data, provided by the Elevator Contractor, on behalf of the Owner. Verify electrical supply to the controllers meets the stated requirements. Where applicable, review standby power generator capability to meet stated requirements and absorb regenerated power.
- F. Standby Power Provision:
1. Standby power of normal voltage characteristics via normal electrical feeders to run one elevator at a time in each elevator group and/or single elevator unit at full-rated car speed and capacity.
  2. Conductors from auxiliary form "C" dry contacts, located in the standby power transfer switch to a designated elevator control panel in each elevator group and/or single elevator unit to indicate utility or standby power active.
  3. Conductors from auxiliary form "C" dry contacts, located in the standby power transfer switch to a designated elevator control panel in each elevator group and/or single elevator unit. Provide a time delay of 30 - 45 seconds for pre-transfer signal in either direction.



4. Standby single-phase power to group controller, and each elevator controller for car lighting, exhaust blower, and emergency signaling device.
5. Means for absorbing regenerated power during an overhauling load condition per NEC 620.91. Elevators will employ IGBT drive, presenting a non-linear active load.
6. Standby power to machine room ventilation or air conditioning.
7. Standby power to emergency communications devices.

G. Elevator Contractor Related Work

1. Pit access stationary ladder for each elevator. Retractable ladder if provided shall include an electrical contact conforming to ASME A17.1, Rule 2.2.2.4.2.7.
2. Under Car Access: Provide permanent ladder and platform for access to under car equipment as required by code.

**1.3 DEFINITIONS**

- A. Terms used are defined in the latest edition of the Safety Code for Elevators and Escalators, ASME A17.1.
- B. Reference to a device or a part of the equipment applies to the number of devices or parts required to complete the installation.
- C. Provisions of this specification are applicable to all elevators unless identified otherwise.

**1.4 QUALITY ASSURANCE**

- A. Approved Contractors:
  1. Gearless Elevators: KONE, Otis, Schindler, and ThyssenKrupp.
- B. Approved Cab Vendors
  1. Car Enclosure: Eklund's Inc., Gunderlin, Ltd., Globe Architectural and Metal, KONE, Otis, Schindler, ThyssenKrupp, Tyler.
- C. Approved Components
  1. Hoistway Entrance: Hauenstein & Burmeister, KONE, Otis, Schindler, ThyssenKrupp
  2. Fixtures vandal-resistant
  3. Non-OEM control systems: MCE.
  4. Hoist Machines: KONE, Otis, Schindler, ThyssenKrupp, Hollister Whitney, Torin, Imperial
  5. Rope brakes: Hollister Whitney, Secondary Brake AC Gearless
  6. Elevator Motor control:
    - a. ACVVVF Yaskawa or KEB
- D. Approved Installers:
  1. KONE, Otis, Schindler, ThyssenKrupp. Approval by the Contracting Officer is required for products and services of proposed manufacturers, suppliers and installers and shall be contingent upon submission of certificates by the Contractor stating the following:
  2. Elevator contractor is currently and regularly engaged in the installation of elevator equipment as one of his principal products.

3. Elevator contractor shall have five (5) years of successful experience, trained supervisory personnel, and facilities to install elevator equipment specified herein.
4. Elevator Mechanic (Installer) shall have passed a Mechanic Examination approved by the U.S. Department of Labor and have technical qualifications of at least five years of experience in the elevator industry or 10,000 hours of field experience working in the elevator industry with technical update training. Apprentices shall be actively pursuing Certified Elevator Mechanic status. Certification shall be submitted for all workers employed in this capacity.
- B. Welding at the project site shall be made by welders and welding operators who have previously qualified by test as prescribed in American Welding Society Publications AWS D1.1 to perform the type of work required. Certificates shall be submitted for all workers employed in this capacity. A welding or hot work permit is required for each day and shall be obtained from the VAMC safety department. Request permit one day in advance.
- C. Electrical work shall be performed by a Licensed Master Electrician and Licensed Journeymen Electricians as requirements by NEC. Certificates shall be submitted for all workers employed in this capacity.
- D. Approval will not be given to elevator contractors and manufacturers who have established on prior projects, either government, municipal, or commercial, a record for unsatisfactory elevator installations, have failed to complete awarded contracts within the contract period, and do not have the requisite record of satisfactory performing elevator installations of similar type and magnitude.
- E. Approval of Elevator Contractor's equipment will be contingent upon their providing factory training, engineering and technical support, including all manuals, wiring diagrams, and tools necessary for adjusting, maintenance, repair, and testing of equipment to the VA for use by the VA's designated Elevator Maintenance Service Provider. Identifying an elevator maintenance service provider that shall render services within two hours of receipt of notification, together with certification that the quantity and quality of replacement parts stock is sufficient to warranty continued operation of the elevator installation.
- F. Equipment within a group of electric traction elevators shall be the product of the same manufacturer.
- G. The Contractor shall provide and install safety devices that have been subjected to tests witnessed and certified by an independent professional testing laboratory that is not a subsidiary of the firm that manufactures supplies or installs the equipment.
- H. Compliance with Regulatory Agencies: Comply with most stringent applicable provisions of following Codes, laws, and/or Authorities, including revisions and changes in effect:
  1. Safety Code for Elevators and Escalators, ASME A17.1
  2. Guide for Inspection of Elevators, Escalators, and Moving Walks, ASME A17.2
  3. Elevator and Escalator Electrical Equipment, ASME A17.5
  4. National Electrical Code, NFPA 70
  5. National Fire Alarm and Signaling Code, NFPA 72, 13, 101
  6. Fire Test of Door Assemblies, NFPA 252
  7. American Society of Safety Engineers (ASSE) - Personnel Hoists and Employee Elevators on Construction and Demolition Operations A10.4
  8. Americans with Disabilities Act, ADA A117.1

9. VA Barrier Free Design Standard - PG-18-13
10. VA Seismic Design Handbook - H-18-8
11. Vertical Transportation Handbook, 4<sup>th</sup> Edition
12. Local Fire Authority
13. Requirements of most stringent provision of local applicable building code.
14. International Building Code
15. State of Ohio Code.
16. VA Hospital Code.
17. Life Safety Code, NFPA 101

I. Applicable Publications

1. The publications listed below form a part of this specification. Elevator installation shall meet the requirements of the latest editions published and adopted by the United States Department of Veterans Affairs on the date contract is signed.
2. Federal Specifications (Fed. Spec.):
  - J-C-30B Cable and Wire, Electrical (Power, Fixed Installation)
  - J-C-580 Cord, Flexible, and Wire, Fixture
  - W-S-610 Splice Connectors
  - W-C-596F Connector, Plug, Electrical; Connector, Receptacle, Electrical
  - W-F-406E Fittings for Cable, Power, Electrical and Conduit, Metal, Flexible
  - HH-I-558C Insulation, Blankets, Thermal (Mineral Fiber, Industrial Type)
  - W-F-408E Fittings for Conduit, Metal, Rigid (Thick-Wall and Thin-wall Type)
  - RR-W-410 Wire Rope and Strand
  - TT-E-489J Enamel, Alkyd, Gloss, Low VOC Content
  - QQ-S-766 Steel, Stainless and Heat Resisting, Alloys, Plate, Sheet and Strip
3. American Society for Testing and Materials (ASTM):
  - A1008/A1008M-09...Steel, Sheet, Cold Rolled, Carbon, Structural, High-Strength Low-Alloy and High Strength Low-Alloy with Improved Formability
  - E1042-02.....Acoustically Absorptive Materials Applied by Trowel or Spray
4. Manufacturer's Standardization Society of the Valve and Fittings Industry (MSS):
  - SP-58.....Pipe Hangers and Supports
5. Society of Automotive Engineers, Inc. (SAE):
  - J517-91.....Hydraulic Hose, Standard
6. Gauges:
  - Sheet and Plate: U.S. Standard (USS)
  - Wire: American Wire Gauge (AWG)
7. American Welding Society (AWS):
  - D1.1.....Structured Welding Code Steel
8. National Electrical Manufacturers Association (NEMA):
  - LD-3.....High-Pressure Decorative Laminates
9. Underwriter's Laboratories (UL):
  - 486A.....Safety Wire Connectors for Copper Conductors
  - 797.....Safety Electrical Metallic Tubing
10. Institute of Electrical and Electronic Engineers (IEEE)
11. Regulatory Standards:
  - VA Barrier Free Design Handbook H-18-13
  - VA Seismic Design Manual H-18-8

J. Warranty:

1. Material and workmanship of installation shall comply in every respect with Contract Documents. Correct defective material or workmanship which develops within one (1) year from date of final acceptance of all work to satisfaction of Purchaser and Consultant at no additional cost, unless due to ordinary wear and tear or improper use or care by Purchaser. Perform maintenance in accordance with terms and conditions indicated in the Preventive Maintenance Agreement.
2. Submit all labor and materials furnished regarding elevator system and installation to terms of "Warranty of Construction" articles of FAR clause 52.246-21
3. Defective is defined to include, but not be limited to: Operation or control system failures, car performance below required minimum, excessive wear, unusual deterioration, or aging of materials or finishes, unsafe conditions, the need for excessive maintenance, abnormal noise, or vibration, and similar unsatisfactory conditions.
4. Retained Equipment: All retained components, parts, and materials shall be cleaned, checked, modified, repaired, or replaced in strict accordance with the specification requirements defined herein. Retained equipment must be compatible for integration with new systems.
5. All retained equipment shall be covered under the warranty provisions, of Article 1.4, J., 1 above. No prorations of equipment or parts shall be allowed on preventive maintenance contract between the Contractor and Purchaser.
6. Make modifications, requirements, adjustments, and improvements to meet performance requirements specified herein.

**1.5 MAINTENANCE**

A. Interim Maintenance

1. Furnish preventive maintenance service on elevators described herein for a period from mobilization, verbal or written, until each unit is removed from building service for modernization. In addition, furnish interim preventive maintenance on completed units until the modernization of each group of elevators is complete and one-year warranty maintenance, defined in Item 1.5. H above, is commenced. Cost of interim maintenance shall be included as part of modernization quotation. Perform interim maintenance based upon terms and conditions of Owner's existing maintenance agreement.
2. Prior to the removal of any car from service, the consolidated call back service for all cars in the specific group shall be no more than three (3) calls per month. Contractor will be responsible for providing preventative maintenance to achieve this requirement.
3. If callback activity exceeds 3 callbacks per unit per month at any time when cars are off-line, all maintenance must be completed on OT until callback rate is less than 3/unit/month.
4. Use competent personnel, acceptable to Purchaser, employed and supervised by the Contractor.

B. Warranty Maintenance

1. Provide preventive maintenance and 24-hour emergency callback service for one year commencing on date of final acceptance of all modernized elevators by Purchaser. Warranty maintenance should expire concurrently for all elevators. Bi-weekly, systematically examine, adjust, clean, and lubricate all equipment. Repair or replace defective parts using parts produced by the Contractor of installed equipment. Maintain elevator machine room, hoistway, and pit in clean condition.
2. Equalizing tension, shorten or renew hoisting ropes.
3. Service and emergency personnel shall report to the COR or his authorized representative upon arrival at the hospital and again upon completion of the required work. A copy of the work ticket containing a complete description of the work performed shall be given to the COR or his authorized representative.
4. Use competent personnel, acceptable to the Purchaser, supervised and employed by Contractor.
5. The warranty maintenance period specified in Item 1.5, A. above shall be extended one (1) month for each three (3) month period in which equipment related failures average more than .25 per unit per month.
6. Purchaser retains the option to delete cost of warranty maintenance from modernization equipment contract and remit twelve (12) equal installments directly to Contractor during period in which maintenance is being performed.
7. Warranty maintenance to be performed per the terms of Owner's existing maintenance agreement.

C. Contract Preventive Maintenance

1. Quote monthly cost for five-year Preventive Maintenance Agreement with two, one-year extensions possible, commencing upon completion of the warranty period specified in Item 1.6, A. above. Submit quote based upon terms and conditions of Owner's existing maintenance agreement.
2. Base quotation on present labor and material cost. Price adjustment will be made at Agreement commencement date and thereafter as provided in Agreement.
3. Use competent personnel, acceptable to the Purchaser, employed and supervised by Contractor.

**1.6 DOCUMENT AND SITE VERIFICATION**

- A. In order to discover and resolve conflicts or lack of definition which might create problems, Contractor must review Contract Documents and site conditions for compatibility with its product prior to submittal of quotation. Review existing structural, electrical, and mechanical provisions for compatibility with Contractor's products. Purchaser will not pay for change to structural, mechanical, electrical, or other systems required to accommodate Contractor's equipment.

**1.7 SUBMITTALS**

- A. Within 60 calendar days after award of contract and before beginning equipment fabrication submit shop drawings and required material samples for review. Allow 30 days for response to initial submittal.

1. Scaled or Fully Dimensioned Layout: Plan of machine room indicating equipment arrangement, details of car enclosures, hoistway entrances, and car/hall signal fixtures.
  2. Design Information: Indicate equipment lists, reactions, and design information on layouts.
  3. Power Confirmation Information: Design for existing conditions.
  4. Fixtures: Shop drawings. Provide full cab mock-up to evaluate cab details. Provide full details of ascending car protection means and installation. Provide cut sheets of proposed fixture design.
  5. Finish Material: Submit 3" x 12" samples of actual finished material for review of color, pattern, and texture. Compliance with other requirements is the exclusive responsibility of the Contractor. Include, if requested, signal fixtures, lights, graphics, Braille plates, and detail of mounting provisions.
  6. Design Information: Provide calculations verifying the following:
    - a. Adequacy of existing electrical provisions.
    - b. Adequacy of retained equipment relative to code requirements if car weight increased by more than 5%.
    - c. Machine room heat emissions in B.T.U.
    - d. Adequacy of existing retained elevator machine beams.
    - e. Adequacy of existing car platform structure for intended loading.
  7. Written Maintenance Control Program (MCP) specifically designed for the equipment included under this contract. Include any unique or product specific procedures or methods required to inspect or test the equipment. In addition, identify weekly, bi-weekly, monthly, quarterly, and annual maintenance procedures, including statutory and other required equipment tests.
- B. Submittal review shall not be construed as an indication that submittal is correct or suitable or that the work represented by submittal complies with the Contract Documents. Compliance with Contract Documents, Code requirements, dimensions, fit, and interface with other work is Contractor's responsibility.
- C. Before execution of work, furnish information to evidence full compliance with contract requirements for proposed items. Such information shall include, as required: Manufacturer's Name, Trade Names, Model or Catalog Number, Nameplate Data (size, capacity, and rating) and corresponding specification reference (Federal or project specification number and paragraph). All submitted drawings and related elevator material shall be forwarded to the Contracting Officer.
- D. Acknowledge and/or respond to review comments within 14 calendar days of return. Promptly incorporate required changes due to inaccurate data or incomplete definition so that delivery and installation schedules are not affected. Identify and cloud drawing revisions including Contractor elective revisions on each re-submittal. Contractor's revision response time is not justification for equipment delivery or installation delay.

**1.8 PERMIT, TEST AND INSPECTION**

- A. Pre-test the elevators and related equipment in the presence of the COR or his authorized representative for proper operation before requesting final inspection. Conduct final inspection at other than normal working hours, if required by COR.
1. Contracting Officer shall obtain the services of a third party QEI Certified Elevator Inspector. The QEI must utilize an Elevator Acceptance Inspection Form to record the results of inspection and all testing and to identify safety code and contract deficiencies. Specific values must be provided for all tests required by ASME A17.1, ASME A17.2, and contract documents. Upon completion of inspection and testing, the QEI must sign a copy of the completed form and provide to the Contracting Officer. Within 2 weeks of the inspection, the QEI must also prepare a formal inspection report, including all test results and deficiencies. Upon successful completion of inspection and testing, the QEI will complete, sign, and provide a certificate of compliance with ASME A17.1.
  2. Government shall furnish electric power including necessary current for starting, testing, and operating machinery of each elevator.
  3. Contractor shall furnish the following test instruments and materials on-site and at the designated time of inspection: properly marked certified test weights, voltmeter, amp probe, thermometers, direct reading tachometer, megohm meter, vibration meter, sound meter, light meter, stopwatch, and a means of two-way communication.
- B. Inspect workmanship, equipment furnished, and installation for compliance with specification.
- C. Balance Tests: The percent of counterbalance shall be checked by placing test weights in car until the car and counterweight are equal in weight when located at the mid-point of travel. If the actual percent of counterbalance does not conform to the specification, the amount of counterweight shall be adjusted until conformance is reached.
- D. Full-Load Run Test: Elevator shall be tested for a period of one-hour continuous run with full contract load in the car. The test run shall consist of the elevator stopping at every floor, in either direction of travel, for not less than five or more than ten seconds per floor.
- E. Speed Test: The actual speed of the elevator shall be determined in both directions of travel with full contract load and no load in the elevator. Speed shall be determined by applying a certified tachometer to the car hoisting ropes or governor rope. The actual measured speed of the elevator with all loads in either direction shall be within three (3) percent of specified rated speed. Full speed runs shall be quiet and free from vibration and sway.
- F. Temperature Rise Test: The temperature rise of the hoisting motor shall be determined during the full load test run. Temperatures shall be measured using thermometers. Under these conditions, the temperature rise of the equipment shall not exceed 50 degrees Centigrade above ambient temperature. Test shall start when all machine room equipment is within five (5) degrees Centigrade of the ambient temperature. Other tests for heat runs on motors shall be performed as prescribed by the Institute of Electrical and Electronic Engineers.
- G. Car Leveling Test: Elevator car leveling devices shall be tested for accuracy of leveling at all floors with no load in car and with contract load in car, in both directions of travel. Accuracy of floor level shall be within plus or minus 3 mm (.125 in.) of level with landing floor for which the stop has been initiated regardless of load

- in car or direction of travel. The car leveling device shall automatically correct over travel as well as under travel and shall maintain the car floor within plus or minus 3 mm (.125 in.) of level with the landing floor regardless of change in load.
- H. Brake Test: The action of the brake shall be prompt and a smooth stop shall result in the up and down directions of travel with no load and rated load in the elevator. Down stopping shall be tested with 125 percent of rated load in the elevator.
- I. Insulation Resistance Test: The elevator's complete wiring system shall be free from short circuits and ground faults and the insulation resistance of the system shall be determined by use of megohm meter, at the discretion of the Elevator Inspector conducting the test.
- J. Safety Devices: Car and counterweight safety devices shall be tested.
- K. Overload Devices: Test all overload current protection devices in the system at final inspection.
- L. Limit Stops:
1. The position of the car when stopped by each of the normal limit switches with no load and with contract load in the car shall be accurately measured.
  2. Final position of the elevator relative to the terminal landings shall be determined when the elevator has been stopped by the final limits. The lower limit stop shall be made with contract load in the elevator. Elevator shall be operated at inspection speed for both tests. Normal limit stopping devices shall be inoperative for the tests.
- M. Oil Buffer Tests: These tests shall be conducted with operating device and limit stops inoperative and with contract load in the elevator for the car buffer and with no load in the elevator for the counterweight buffer. Preliminary test shall be made at the lowest (leveling) speed. Final tests shall be conducted at contract speed. Buffers shall compress and return to the fully extended position without oil leakage.
- N. Operating and Signal System: The elevator shall be operated by the operating devices provided and the operation signals and automatic floor leveling shall function in accordance with requirements specified. Starting, stopping and leveling shall be smooth and comfortable without appreciable steps of acceleration or deceleration.
- O. Performance of the Elevator supervisory system shall be witnessed and approved by the elevator inspector and a representative of the COR.
- P. If equipment fails test requirements and a re-inspection is required, the Contractor shall be responsible for the cost of re-inspection; salaries, transportation expenses, and per-diem expenses incurred by the elevator inspector and representative of the COR.
- Q. Supply personnel and equipment for test and final review by Consultant as required in Part 3 of this division.  
Obtain and pay for permit, license, and inspection fee necessary to complete installation.

## **PART 2 - PRODUCTS**

### **2.1 SUMMARY**

- A. Six (6) Gearless Traction Passenger Elevators: Cars P1-P6.
- B. Four (4) Gearless Traction Service Elevators: Cars S1-S4.



C. Unless specifically identified as "retain existing," provide new equipment.

	Existing Equipment	Disposition
Number:	Cars P1-P6 Cars S1-S4	Retain Existing
Capacity:	Cars P1-P6: 4,000 lb. Cars S1-S4: 5,000 lb.	Retain Existing
Class Loading:	Passenger/Service Class A	Retain Existing
Contract Speed:	All Cars: 500 F.P.M.	Retain Existing
Roping:		Retain Existing
Machine:	Gearless	New AC Induction or P.M.S.M.
Machine Location:	Overhead	Retain Existing
Supervisory Control:	Group Automatic Microprocessor-Based System	New Group Automatic Microprocessor-Based System
Operational Control:	Microprocessor-Based System	New Microprocessor-Based System
Motor Control:	DC Variable Voltage	New AC Variable Voltage Variable Frequency Microprocessor Based with Digital Closed-Loop Feedback
Power Characteristics:	480 Volts, 3 Phase, 60 Hertz Field Verify	Design for Existing Conditions
Stops:	All Cars: 10 Front; 0 Rear	Retain Existing
Openings:	All Cars: 10 Front; 0 Rear	Retain Existing
Floors Served:	All Cars: B, 1-9 Front; N/A Rear	Retain Existing
Travel:	Field Verify	Retain Existing
Clear Inside Car:	Cars P1-P6: 90" W X 63" D Cars S1-S4: 74" W X 92" D Field Verify	Retain Existing

	Existing Equipment	Disposition
Entrance Size:	Cars P1-P6: 48" W X 84" H Cars S1-S4: 54" W X 84" H Field Verify	Retain Existing
Entrance Type:	All Cars: Single-Speed, Center Opening	Retain Existing
Door Operation:	Open Loop, Harmonic Drive.	High Speed, Heavy-Duty, Linear Drive Door Operator, Minimum Opening Speed 2-1/2 F.P.S.
Alternates, Cars All:		1. Deduct: Retain existing HW doors  2. Deduct: Retain existing Cab Interiors  3. Deduct: Provide OEM controllers

## 2.2 MATERIALS

- A. Steel:
1. Sheet Steel (Furniture Steel for Exposed Work): Stretcher-leveled, cold-rolled, commercial quality carbon steel, complying with ASTM A366, matte finish.
  2. Sheet Steel (for Unexposed Work): Hot-rolled, commercial quality carbon steel, pickled and oiled, complying with ASTM A568/A568M-03.
  3. Structural Steel Shapes and Plates: ASTM A36.
- B. Stainless Steel: Type 302 or 304 complying with Fed. Spec. QQ-S-766, with standard tempers and hardness required for fabrication, strength and durability. Apply mechanical finish on fabricated work in the locations shown or specified, Federal Standard and NAAMM nomenclature, with texture and reflectivity required to match Architect's sample. Protect with adhesive paper covering.
1. No. 4 Satin: Directional polish finish. Graining directions as shown or, if not shown, in longest dimension.
- C. Aluminum: Extrusions per ASTM B221; sheet and plate per ASTM B209.
- D. Plastic Laminate: ASTM E84 Class A and NEMA LD3.1, Fire-Rated Grade (GP-50), Type 7, 0.050" ± 0.005" thick, color and texture as follows:
1. Exposed Surfaces: Color and texture selected by Architect.
  2. Concealed Surfaces: Contractor's standard color and finish.
- E. Fire-Retardant Treated Particle Board Panels: Minimum 3/4" thick backup for natural finished wood and plastic laminate veneered panels, edged and faced as shown, provided with suitable anti-warp backing; meet ASTM E84 Class "I" rating with a flame-spread rating of 25 or less, registered with Local Authorities for elevator finish materials.

- F. Paint: Clean exposed metal parts and assemblies of oil, grease, scale, and other foreign matter and factory paint one shop coat of standard rust-resistant primer. After erection, provide one finish coat of industrial enamel paint. Galvanized metal need not be painted.
- G. Prime Finish: Clean all metal surfaces receiving a baked enamel paint finish of oil, grease, and scale. Apply one coat of rust-resistant primer followed by a filler coat over uneven surfaces. Sand smooth and apply final coat of primer.
- H. Baked Enamel Finish: Prime finish per above. Unless specified "prime finish" only, apply and bake three (3) additional coats of enamel in the selected solid color.
- I. Entrance Field Paint: Clean all surfaces to remove dirt and grease. Sand and finish surfaces as necessary to remove pits and scratches and prepare surface for painting. Apply filler to ensure smooth surface; sand and apply one coat of electrostatic enamel in the selected solid color.
- J. Refinishing of natural metals: Remove existing protective finish. Buff as necessary to remove scratches. Regrain or finish as specified and protect as indicated for particular metal type.
- K. Entrance Support Equipment within Hoistway: Include strut angles, headers, sill support angles, fascia, hanger covers, etc. Clean, remove, and check for corrosive activity. Replace components which exhibit severe deterioration. Tighten all fastenings. Repaint exposed surfaces with rust preventive primer.

### **2.3 CONDUIT AND WIREWAY**

- A. Install electrical conductors, except traveling cable, in rigid zinc-coated steel or aluminum conduit, electrical metallic tubing or metal wireways. Rigid conduit smaller than 18.75 mm (.75 in.) or electrical metallic tubing smaller than 12.5 mm (.50 in.) electrical trade size shall not be used. All raceways completely embedded in concrete slabs, walls, or floor fill shall be rigid steel conduit. Wireway (duct) shall be installed in the hoistway and to the controller and between similar apparatus in the elevator machine room. Fully protect self-supporting connections, where approved, from abrasion or other mechanical injury. Flexible metal conduit not less than 9.375 mm (.375 in.) electrical trade size may be used, not exceeding 45 cm (18 in.) in length unsupported, for short connections between risers and limit switches, interlocks, and for other applications permitted by NEC.
- B. All conduit terminating in steel cabinets, junction boxes, wireways, switch boxes, outlet boxes and similar locations shall have approved insulation bushings. Install a steel lock nut under the bushings if they are constructed completely of insulating materials. Protect the conductors at ends of conduits not terminating in steel cabinets or boxes by terminal fittings having an insulated opening for the conductors.
- C. Rigid conduit and EMT fittings using set screws or indentations as a means of attachment shall not be used.

- D. Connect motor or other items subject to movement, vibration or removal to the conduit or EMT systems with flexible, steel conduits.

## **2.4 CONDUCTORS**

- A. Conductors shall be stranded or solid coated annealed copper in accordance with Federal Specification J-C-30B for Type RHW or THW. Where 16 and 18 AWG are permitted by NEC, single conductors or multiple conductor cables in accordance with Federal Specification J-C-580 for Type TF may be used provided the insulation of single conductor cable and outer jacket of multiple conductor cable is flame retardant and moisture resistant. Multiple conductor cable shall have color or number coding for each conductor. Conductors for control boards shall be in accordance with NEC. Joints or splices are not permitted in wiring except at outlets. Tap connectors may be used in wireways provided they meet all UL requirements.
- B. Provide all conduit and wiring between machine room, hoistway and fixtures.
- C. All wiring must test free from short circuits or ground faults. Insulation resistance between individual external conductors and between conductors and ground shall be a minimum of one megohm.
- D. Where size of conductor is not given, voltage and amperes shall not exceed limits set by NEC.
- E. Provide equipment grounding. Ground the conduits, supports, controller enclosure, motor, platform and car frame, and all other non-current conducting metal enclosures for electrical equipment in accordance with NEC. The ground wires shall be copper, green insulated and sized as required by NEC. Bond the grounding wires to all junction boxes, cabinets, and wire raceways.
- F. Terminal connections for all conductors used for external wiring between various items of elevator equipment shall be solderless pressure wire connectors in accordance with Federal Specification W-S-610. The Elevator Contractor may, at his option, make these terminal connections on #10 gauge or smaller conductors with approved terminal eyelets set on the conductor with a special setting tool, or with an approved pressure type terminal block. Terminal blocks using pierce-through serrated washers are not acceptable.

## **2.5 CAR AND GROUP PERFORMANCE**

- A. Car Speed:  $\pm 3\%$  of contract speed under any loading condition.
- B. Car Capacity: Safely lower, stop and hold 125% of rated load.
- C. Car Stopping Zone:  $\pm 1/8"$  under any loading condition.
- D. Door Opening Time: Seconds from start of opening to fully open:
  - 1. Cars P1-P6: 1.6 seconds
  - 2. Cars S1-S4: 1.8 seconds
- E. Door Closing Time: Seconds from start of closing to fully closed:
  - 1. Cars P1-P6: 2.7 seconds
  - 2. Cars S1-S4: 3.0 seconds
- F. Car Floor-to-Floor Performance Time: Seconds from start of doors closing until doors are 3/4 open (1/2 open for side opening doors) and

car level and stopped at next successive floor under any loading condition or travel direction (12' typical floor height):

1. Cars P1-P6: 8.5 seconds
2. Cars S1-S4: 9.0 seconds

G. Car Ride Quality:

1. Ride Quality shall be measured and analyzed according to the methods specified in ISO18738.
2. Device to be utilized in procuring field measurements shall be the EVA-625 Elevator Vibration Analysis System as manufactured by Physical Measurement Technologies (PMT).
3. Specified levels apply to horizontal and vertical acceleration measured from within car, from the point at which the car has moved ½ meter from start position to ½ meter from final position, as defined by ISO18738.
4. Maximum peak to peak vibration for the horizontal and vertical axes shall be no greater than 25 mg peak to peak.
5. The A95 peak to peak vibration for the horizontal and vertical axes shall be no greater than 17.5 mg peak to peak.
6. Acceleration and Deceleration: Smooth constant and not less than 3.3 feet/second<sup>2</sup> with an initial ramp between 0.5 and 0.75 second. Sustained Jerk: Not more than 6 feet/second<sup>3</sup>.

H. Noise and Vibration Control

1. Airborne Noise: Measured noise level of elevator equipment and its operation shall not exceed 60 dBA inside car under any condition including door operation and car ventilation exhaust blower on its highest speed. Limit noise level in the machine room relating to elevator equipment and its operation to no more than 80 dBA. All dBA readings to be taken 3'-0" off the floor and 3'-0" from the equipment using the "A" weighted scale.
2. Vibration Control: All elevator equipment provided under this contract, including power unit, controller, and their support shall be mechanically isolated from the building structure and electrically isolated from the building power supply and to each other to minimize the possibility of objectionable noise and vibrations being transmitted to occupied areas of the building.

I. System-Response Time, Passenger and Service Groups: Meet the following criteria during any 60-minute peak period as measured by duration of all hall call registration times:

1. System-Response Time: Not more than 30 seconds
2. Hall Calls Answered within 30 Seconds: Not less than 65%
3. Hall Calls Answered within 60 Seconds: Not less than 90%
4. Hall Calls Answered within 90 Seconds: Not less than 95%
5. Base above performance on not more than 250 hall calls being registered within 60-minute period, all cars in group operation during test period.

## 2.6 OPERATION

A. Collective Microprocessor-Based, Passenger and Service Groups:

1. Operate car without attendant from pushbuttons in car and located at each floor. When car is available, automatically start car and dispatch it to floor corresponding to registered car or hall

- call. Once car starts, respond to registered calls in direction of travel and in the order the floors are reached.
2. Do not reverse car direction until all car calls have been answered, or until all hall calls ahead of car and corresponding to the direction of car travel have been answered.
  3. Slow car and stop automatically at floors corresponding to registered calls, in the order in which they are approached in either direction of travel. As slowdown is initiated for a hall call, automatically cancel hall call. Cancel car calls in the same manner. Hold car at arrival floor an adjustable time interval to allow passenger transfer.
  4. Answer calls corresponding to direction in which car is traveling unless call in the opposite direction is highest (or lowest) call registered.
  5. Illuminate appropriate pushbutton to indicate call registration. Extinguish light when call is answered.
- B. Group Automatic, Passenger and Service Groups:
1. Approved microprocessor-based, group dispatch with artificial intelligence car and motion control systems as follows:  
MCE: iControl
  2. Alternate 3: Provide Original Equipment Manufacturer controller. Approved vendors: Otis, KONE, thyssenkrupp, Schindler.
  3. Include, as a minimum, the following features:
    - a. Operate cars as a group capable of balancing service and providing continuity of group operation with one or more cars removed from the system.
    - b. Register service calls from pushbuttons located at each floor and in each car. Slow cars and stop automatically at floors corresponding to registered calls. Make stops at successive floors for each direction of travel irrespective of order in which calls are registered except when bypassing hall calls to balance and improve overall service; stop only one car in response to a particular hall call. Assign hall calls to specific cars and continually review and modify those assignments to improve service. Simultaneous to initiation of slowdown of a car for a hall call, cancel that call. Render hall pushbutton ineffective until car doors begin to close after passenger transfer. Cancel car calls in the same manner. Give priority to coincidental car and hall calls in car assignment.
    - c. Operate system to meet changing traffic conditions on a service demand basis. Include provisions for handling traffic which may be heavier in either direction, intermittent or very light. As traffic demands change, automatically and continually modify group and individual car assignment to provide the most-effective means to handle current traffic conditions. Hall lantern shall sound again, and illumination shall pulse just prior to car arrival. Give priority to coincidental car and hall calls in hall call assignment. Accomplish car direction reversal without closing and reopening doors.
    - d. Use easily reprogrammable system software. Design basic algorithm to optimize service based on equalizing system response to registered hall calls and equalizing passenger trip time at shortest possible time.

- e. Serve floors below main floor in a manner which logically minimizes delay in passing or stopping at main floor in both directions of travel. Provide manual means to force a stop at the main floor when passing to or from lower levels.
  - f. Required Features:
    - 1) Dispatch Protection: Backup dispatching shall function in the same manner as the primary dispatching.
    - 2) Delayed Car Removal: Automatically remove delayed car from group operation.
    - 3) Position Sensing: Update car position when passing or stopping at each landing.
    - 4) Hall Pushbutton Failure: Provide multiple power sources and separate fusing for pushbutton risers.
    - 5) Communication Link: Provide serial or duplicate communication link for all group and individual car computers.
- C. Other Items:
- 1. Load Weighing: Provide means for weighing car passenger load. Control system to provide dispatching at main floor in advance of normal intervals when car fills to capacity. Provide hall call by-pass when the car is filled to preset percentage of rated capacity and traveling in down direction. Field adjustment range: 10% to 100%.
  - 2. Anti-Nuisance Feature: If car loading relative to weight in car is not commensurate with number of registered car calls, or activation of door protection device is not commensurate with the number of registered car calls, cancel car calls. Systems employing either load weighing or door protective device for activation of this feature are acceptable.
  - 3. Independent Service: Provide controls for operation of each car from its pushbuttons only. Close doors by constant pressure on desired destination floor button or door close button. Open doors automatically upon arrival at selected floor.
- D. Firefighters' Service: Provide Firefighter's Service.
- 1. Main Floor:1
  - 2. Alternate Floor:2
  - 3. Verify main and alternate floors with Contract Officer's Representative.
- E. Automatic Car Stopping Zone: Stop car within 1/8" above or below the landing sill. Maintain stopping zone regardless of load in car, direction of travel, distance between landings, hoist rope slippage, or stretch.
- F. Remote Monitoring and Diagnostics: Equip each controller and the group dispatch logic controller with standard ports, interface boards, and drivers to accept maintenance, data logging, fault finding diagnostic and monitoring computers, keyboards, modems, and programming tools. The system shall be capable of driving remote color LCD monitors that continually scan and display the status of each car and call. Provide each group with a full, interactive elevator monitoring system.

- G. Motion Control: Microprocessor based AC variable-voltage, variable frequency IGBT with digitally encoded closed-loop velocity feedback suitable for operation specified and capable of providing smooth, comfortable car acceleration, retardation, and dynamic braking. Limit the difference in car speed between full load and no load to not more than  $\pm 3\%$  of the contract speed.
- H. MEDICAL EMERGENCY SERVICE
1. Provisions shall be made for calling elevators to any floor served by the elevator on an emergency basis, operating independently from the dispatch signals and landing call signals.
  2. Install key switch in the floor landing push button fixture above the push buttons.
  3. Provide a call registered light indicator adjacent to key switch. The key switch at the landings and in the car, shall only be operable by authorized personnel with a valid VA key.
  4. When key switch is activated at any floor, the call register light indicator shall illuminate at the call floor and inside the elevator only. The elevator control system shall instantly select an elevator to respond to the medical emergency call. Immediately upon selection, all car calls shall be cancelled. If car is traveling away from the medical emergency call, it shall slow down and stop at the nearest floor, maintain closed doors, reverse direction and proceed nonstop to the medical emergency call floor. If the car is traveling toward the medical emergency call floor, it shall proceed to that floor nonstop. If at the time of selection, it is slowing down for a stop, the car shall stop, maintain doors closed, and start immediately toward the medical emergency floor.
  5. Arriving at the medical emergency floor, the car shall remain with doors open for 30 seconds. After this interval has expired and the car has not been placed on medical emergency operation inside the car, the car shall automatically return to normal service.
  6. Provide an LED illuminated indicator light next to the Medical Emergency key switch the same size as the Fire Service indicator.
  7. Locate a "Medical Emergency" key switch above call buttons in the main car operating panel for selecting medical emergency service. Activation of the card reader will allow the car to accept a car call for any floor, close doors, and proceed nonstop to the floor desired.
  8. After medical emergency call has been completed the elevator shall return to normal operation after an adjustable time of 30 to 90 seconds has expired.
  9. In the center of the rear cab panel provide a back lighted "MEDICAL EMERGENCY" LED illuminated display that shall flash on and off continuously when the car is assigned to this operation and until it is restored to normal service. "MEDICAL EMERGENCY" indicator shall be a photographic negative type 1800 mm (72 in.) to center above the floor, 150 mm (6 in.) wide X 75 mm (3 in.) high, with 12.5 mm (.50 in.) high letters legible only when illuminated.
  10. If the car being operated on "Independent Service", the medical emergency service indicator lights in the car operating panel and rear wall shall be illuminated, buzzer shall sound, and the "Audio Voice" system shall direct the attendant to return the car to automatic operation.



11. If the car is out of service and unable to answer medical emergency calls, the call register light shall not illuminate.
  12. Each key switch shall have its identity legible and indelible engraved in faceplates. All lettering shall be 6 mm (.25 in.) high, filled with black paint.
  13. When Phase I firefighter's recall is activated it shall over-ride elevators on medical emergency service and return them to the main or alternate fire service recall floor. When the fire emergency floor has been identified the attendants may complete their medical emergency run on Phase II firefighter's operation if life safety is not affected.
- I. Door Operation: Automatically open doors when car arrives at main floor. At expiration of normal dwell time, close doors. Reopen doors when car is designated for loading.
- J. Standby Lighting and Alarm: Car mounted battery unit with solid-state charger to operate alarm bell and car emergency lighting. Battery to be rechargeable with minimum 5-year life expectancy. Provide constant pressure test button in service compartment of car operating panel. Provide lighting integral with portion of normal car lighting system.
- K. Standby Power Operation: Upon loss of normal power, adequate standby power will be supplied via building electrical feeders to simultaneously start and run one car in each group and single cars at contract car speed and capacity.
1. Automatically return one car at a time in each group and single cars nonstop to designated floor, open doors for approximately 3.0 seconds, close doors, and park car. During return operation, car and hall call pushbuttons shall be rendered inoperative. As each car parks, system shall immediately select the next car until all cars in a group have returned to the designated floor. If a car fails to start or return within 30 seconds, system shall automatically select the next car in the group to automatically return.
  2. When all cars in a group have returned to the designated floor, one car in each group shall be designated for automatic operation. When a service demand exists for 30 seconds and designated car fails to start, next available car in the group shall be automatically selected for operation.
  3. Provide separate group selection switches in firefighters' control panel.
    - a. Switches shall be labeled "ELEVATOR EMERGENCY POWER" with positions marked "AUTO" and appropriate car numbers controlled by each respective switch. Key shall be keyed same as key utilized for firefighters' Phase I and II key switch. Key shall be removable in "AUTO" position only.
    - b. Switch shall override automatic return and automatic selection functions and cause the manually selected car to operate. Manual selection shall cause car to start and proceed to designated floor and open and close its doors before standby power is manually transferred to next selected car.
    - c. Provide "ELEVATOR EMERGENCY POWER" indicator lights, one per car, in firefighters' control panel. Indicator light illuminates when corresponding car is selected, automatically or manually, to operate on standby power.

- d. Provide indication of "Car at Lobby with Doors Open" where panel is not in sight of elevators.
  - e. Provide "EMERGENCY POWER" jewel in hall station at the designated landing.
4. Successive Starting: When normal power is restored or there has been a power interruption, individual cars in each bank shall restart at five second intervals.
- L. Car Light and Fan Timer: Provide necessary logic and power relay to allow car lights and fan to turn off.

## 2.7 MACHINE ROOM EQUIPMENT

- A. Arrange equipment in existing machine room spaces.
- B. New Gearless Traction Hoist Machine:
- 1. AC induction or P.M.S.M. ACV<sup>3</sup>F gearless traction type motor with brake, drive sheave, and deflector sheave mounted in proper alignment on a common, isolated bedplate.
  - 2. Provide hoist machine mounted direct drive, digital, closed-loop velocity encoder.
  - 3. Provide means to prevent ascending car over-speed and unintended car movement per Code.  
Hoist machine installations which require blockouts through machine room floor for other than hoist ropes shall be provided with a 14-gauge galvanized sheet metal enclosure over entire blockout on underside of floor slab.
- C. New Solid-State Power Conversion and Regulation Unit:
- 1. Provide solid state, alternating current, variable voltage, variable frequency (ACV<sup>3</sup>F), I.G.B.T. converter/inverter drives.
  - 2. Design unit to limit current, suppress noise, and prevent transient voltage feedback into building power supply. Provide internal heat sink cooling fans for the power drive portion of the converter panels. Conform to IEEE standards 519-1992 for line harmonics and switching noise.
  - 3. Isolate unit to minimize noise and vibration transmission. Provide isolation transformers, filter networks, and choke inductors.
  - 4. Suppress solid-state converter noises, radio frequency interference, and eliminate regenerative transients induced into the mainline feeders or the building standby power generator.
  - 5. Supplemental direct-current power for the operation of hoist machine brake, door operator, dispatch processor, signal fixtures, etc., from separate static power supply.
  - 6. ACV<sup>3</sup>F Drives for gearless elevators shall be regenerative and utilize IGBT converter/inverter and dynamic braking during overhauling condition.
- D. New Encoder: Direct drive, solid-state, digital type. Update car position at each floor and automatically restore after power loss.
- E. New Controller: MCE iControl. UL/CSA labeled.
- 1. Compartment: Securely mount all assemblies, power supplies, chassis switches, relays, etc., on a substantial, self-supporting

- steel frame. Completely enclose equipment with covers. Provide means to prevent overheating.
2. Relay Design: Magnet operated with contacts of design and material to insure maximum conductivity, long life, and reliable operation without overheating or excessive wear. Provide wiping action and means to prevent sticking due to fusion. Contacts carrying high inductive currents shall be provided with arc deflectors or suppressors.
  3. Microprocessor-Related Hardware:
    - a. Provide built-in noise suppression devices which provide a high level of noise immunity on all solid-state hardware and devices.
    - b. Provide power supplies with noise suppression devices.
    - c. Isolate inputs from external devices (such as pushbuttons) with opto-isolation modules.
    - d. Design control circuits with one leg of power supply grounded.
    - e. Safety circuits shall not be affected by accidental grounding of any part of the system.
    - f. System shall automatically restart when power is restored.
    - g. System memory shall be retained in the event of power failure or disturbance.
    - h. Equipment shall be provided with Electro Magnetic Interference (EMI) shielding within FCC guidelines.
  4. Wiring: CSA labeled copper for factory wiring. Neatly route all wiring. interconnections and securely attach wiring connections to studs or terminals.
  5. Permanently mark components (relays, fuses, PC boards, etc.) with symbols shown on wiring diagrams.
  6. Monitoring System Interface: Provide controller with serial data link through RJ45 Ethernet connection and install all devices necessary to monitor items outlined herein. Elevator contractor responsible to connect monitoring system interface to machine room monitoring compartment and LAN.
  7. Provide controller or machine mounted auxiliary, lockable "open," disconnect if mainline disconnect is not in sight of controller and/or machine.
  8. Alternate 3: Provide Original Equipment Manufacturer controller.  
Approved vendors: Otis, KONE, thyssenkrupp, Schindler.
- F. New Sleeves and Guards: Provide 2" steel angle guards around cable or duct slots through floor slabs or grating. Provide rope and smoke guards for sheaves, cables, and cable slots in machine room.
- G. Machine and Equipment Support Beams: Retain existing in place. Provide all required supplemental supports and attachments. Provide new if required by new equipment. Provide Structural Engineering certification validating size and location of all new support structure provided.
- H. New Governor: Centrifugal-type, car driven machine room mounted with pull-through jaws and bi-directional shutdown switches. Provide required bracketing and supports for attachment to building structure.
- I. New Emergency Brake:

1. Provide means to prevent ascending car over-speed and unintended car movement per Code.
2. Acceptable emergency brake devices:
  - a. Hollister-Whitney Rope Gripper
3. Mount the auxiliary brake on suitable structural steel supports. Provide a drawing showing the supports, stamped by Professional Engineer verifying the adequacy of the support provided.
4. Provide control circuits to enable the device to function as required by Code.
5. Alternately provide redundant machine brake as allowed by code.

## **2.8 HOISTWAY EQUIPMENT**

- A. Guide Rails: Retain main and counterweight guide rails in place.
  1. Clean rails and brackets.
  2. Check all rail and bracket fastenings and tighten.
  3. Realign rails as required to provide smooth car ride.
  4. Provide supplemental rail brackets and/or backing as required by Code or to enhance car ride quality.
- B. Buffers, Car, and Counterweight: Retain existing.
  1. Drain, flush, refill, paint and test.
  2. Retrofit switch to limit elevator speed if buffer is compressed.
- C. Sheaves, Deflector, Secondary & Compensating: Retain existing.
  1. Check all fastenings and tighten.
  2. Replace worn bearings.
- D. Counterweight: Retain existing. Retrofit spring dampening roller guide shoes.
- E. New Counterweight Guide Shoes: Spring dampened roller guide shoes.
- F. New Governor Rope Tensioning Sheave: Mount sheaves and support frame on pit floor or guide rail. Provide frame with guides or pivot point to enable free vertical movement and proper tension of rope and tape.
- G. New Hoist and Governor Ropes:
  1. Traction steel type as required by machine design. Fasten with staggered length, adjustable, spring isolated wedge type shackles.
  2. Governor rope as required by governor manufacturer.
- H. Compensation: Retain existing sheave. New travel limit switch. New compensation ropes.
- I. New Terminal Stopping: Provide normal and final devices.
- J. New Electrical Wiring and Wiring Connections:
  1. Conductors and Connections: Copper throughout with individual wires coded and connections on identified studs or terminal blocks. Use no splices or similar connections in wiring except at terminal blocks, control compartments, or junction boxes. Provide a minimum of 10% spare conductors throughout. A minimum of ten #18 AWG wires shall be provided. Run spare wires from car connection points to individual elevator controllers in the

- machine room. Provide eight pairs of spare shielded communication wires in addition to those required to connect specified items. Tag spares in machine room.
2. Conduit: Provide as detailed in Section 2.3
  3. Traveling Cables: Flame and moisture-resistant outer cover. Prevent traveling cable from rubbing or chafing against hoistway or equipment within hoistway. In addition to wires needed to connect specified items the following shall be provided:
    - a. Four twisted shielded pair for card reader/future use.
    - b. Four pair of shielded wires to car top, plus 3'-0" excess loop at both ends for CCTV/future use.
    - c. One RG6 coax to car top, plus 3'-0" excess loop at both ends for CCTV/future use.
    - d. Three 14-gauge wires for CCTV power/future use.
    - e. One twisted shielded pair for firefighter's speaker.
  4. Auxiliary Wiring: Connect all fire alarm initiating devices, emergency two-way communication system, firefighters' paging speaker, in each car controller in machine room.
- K. New Entrance Equipment:
1. Door Hangers: Two-point hanger roller with neoprene roller surface and suspension with eccentric up thrust roller adjustment.
  2. Door Tracks: Bar or formed, cold-drawn removable steel tracks with smooth roller contact surface.
  3. Door Interlocks: Operable without retiring cam. Paint interlock box flat black.
  4. Door Closers: Spring activated spirator type. Design and adjust to insure smooth, quiet mechanical close of doors.
- L. New Hoistway Door Unlocking Device: Provide unlocking device including new escutcheon at all floors, with finish to match adjacent surface.
- M. New Hoistway Access Switches: Mount in wall at top and bottom floors. Provide switch with faceplate. Locate within easy reach to entrance so entrance can be guarded by one technician.
- N. Floor Numbers: Stencil paint 4" high floor designations in contrasting color on inside face of hoistway doors or hoistway fascia in location visible from within car.

## **2.9 HOISTWAY ENTRANCES**

- A. Frames: Retain existing. Provide Arabic floor designation/Braille plates, centered at 60" above finished floor, on both side jambs of all entrances. Provide plates at main egress landing with "Star" designation. Braille indications shall be below Arabic floor designation. Provide flat stainless floor designation/Braille plates. Provide 3" car identification plates at all landings.
- B. New Door Panels: Fully enclosed 16-gauge steel, sandwich construction without binder angles. Provide leading edges of center-opening doors with rubber astragals. Provide a minimum of two (2) gibs per panel, with integrated safety retainers, one at leading and one at trailing

edge with gibs in the sill groove entire length of door travel.  
Construct door panels with interlocking, stiffening ribs.

1. Alternate 1: Door Panels: Retain existing. Provide new door gibs with fire tabs at all floors. Minimum two gibs per panel, one at leading edge, and one at trailing edge of each panel. Provide code required door panel retainer mechanism on lower edge of door panel to address failure of primary lower edge door guidance.
- C. New Sight Guards: 14-gauge, same material and finish as hoistway entrance door panels. Construct without sharp edges.
  1. Alternate 1: Retain Existing
- D. Sills: Retain existing. Clean. Check and tighten all fastenings.
- E. Sill Supports: Retain existing. Check and tighten all fastenings.
- F. Fascia, Toe Guards, and Hanger Covers: Retain existing. Provide as required where damaged or missing. Check and tighten all fastenings. Paint/Stencil floor number on fascia or hoistway wall all floors visible where car doors are initially opened.
- G. Struts and Headers: Retain existing. Check and tighten all fastenings.
- H. Finish of Frames and Doors:

Cars	Floor	Frames	Door Panels
All	All	Stainless Steel, Satin Finish	Stainless Steel, Satin Finish

## 2.10 CAR EQUIPMENT

- A. Frame: Retain Existing. Check and tighten all fastenings.
- B. Safety Device: Retain existing. Check and tighten all fastenings. Disassemble, clean, and inspect components. Replace all worn or damaged parts. Reassemble and test for proper operation. For wind up safeties inspect tail rope and verify proper type for the application, replace if needed. Perform soft set and full load test in advance of acceptance test.
- C. Platform: Retain existing. Reinforce if required. Check and tighten all fastenings.
- D. New Platform Apron: Provide new extended platform apron to meet Code. Minimum 14-gauge steel reinforced and braced to car platform with Contractor's standard finish.
- E. New Guide Shoes: Roller type, with three or more spring dampened, sound-deadening rollers per shoe.
- F. New Finish Floor Covering:

1. Passenger Cars 1-6: Accommodate a minimum 2" floor thickness. Finish as selected by Purchaser.
  2. Service Elevators, Cars 1-4: Rubber tile 1/8" thick with 1" diameter by 0.025 high, raised circular pattern. Color selected by Purchaser.
  3. Alternate 2: Retain existing
- G. Sills: Retain existing. Clean full width. Check and tighten all fastenings.
- H. New Doors: Fully enclosed 16-gauge steel, sandwich construction without binder angles. Provide leading edges of center-opening doors with rubber astragals. Provide a minimum of two (2) gibs per panel, one at leading and one at trailing edge with gibs in the sill groove entire length of door travel. Construct door panels with interlocking, stiffening ribs.
- I. New Door Hangers: Two-point hanger roller with neoprene roller surface and suspension with eccentric up thrust roller adjustment.
- J. New Door Track: Bar or formed, cold-drawn removable steel track with smooth roller contact surface.
- K. New Door Header: Construct of minimum 12-gauge steel, shape to provide stiffening flanges.
- L. New Door Clutch: Heavy-duty clutch, linkage arms, drive blocks and pickup rollers or cams to provide positive, smooth, quiet door operation. Design clutch so car doors can be closed, while hoistway doors remain open.
- M. New Restricted Opening Device: Restrict opening of car doors outside unlocking zone. Plunger type restrictors not acceptable.
- N. New Door Operator: High speed, linear drive, heavy-duty door operator capable of opening doors at no less than 2.5 f.p.s. Accomplish reversal in no more than 2-1/2" of door movement. Provide solid-state door control with closed loop circuitry to constantly monitor and automatically adjust door operation based upon velocity, position, and motor current. Maintain consistent, smooth, and quiet door operation at all floors, regardless of door weight or varying air pressure. Provide closed loop operation, monitoring door speed, torque and closing force, at all times.
- O. New Door Control Device:
1. Infrared Reopening Device: Black fully enclosed device with full screen infrared matrix or multiple beams extending vertically along leading edge of each door panel to minimum height of 7'-0" above finished floor. Device shall prevent doors from closing and reverse doors at normal opening speed if beams are obstructed while doors are closing, except during nudging operation. In event of device failure, provide for automatic shutdown of car at floor level with doors open.
  2. Nudging Operation: After beams of door control device are obstructed for a predetermined time interval (minimum 20.0 - 25.0 seconds), warning signal shall sound, and doors shall attempt to

close with a maximum of 2.5-foot pounds kinetic energy. Activation of the door open button shall override nudging operation and reopen doors.

3. Interrupted Beam Time: When beams are interrupted during initial door opening, hold door open a minimum of 3.0 seconds. When beams are interrupted after the initial 3.0 second hold open time, reduce time doors remain open to an adjustable time of approximately 1.0 - 1.5 seconds after beams are reestablished.
4. Differential Door Time: Provide separately adjustable timers to vary time that doors remain open after stopping in response to calls.
  - a. Car Call: Hold open time adjustable between 3.0 and 5.0 seconds.
  - b. Hall Call: Hold open time adjustable between 5.0 and 8.0 seconds. Use hall call time when car responds to coincidental calls.

P. New Car Operating Panel:

1. Two car operating panels with faceplates, consisting of a metal box containing vandal resistant operating fixtures, mounted behind the car stationary front return panels. Faceplates shall be hinged and constructed of stainless steel, satin finish.
2. Suitably identify floor buttons, alarm button, door open button, door close button and emergency push-to-call button with flat stainless tactile symbols recessed flush mounted. Configure plates per local building code accessibility standards including Braille. Locate operating controls no higher than 48" above the car floor; no lower than 35" for emergency push-to-call button and alarm button.
3. Provide minimum 3/4" diameter raised or flush round floor pushbuttons which illuminate white LED lights to indicate call registration.
4. Provide alarm button to ring bell located on car, and sound distress signal at emergency power panel. Illuminate button when actuated.
5. Provide keyed stop switch at bottom of car operating panel in locked car service compartment. Arrange switch to sound main control panel distress signal when actuated. Mark device to indicate "run" and "stop" positions.
6. Provide "door open" button to stop and reopen doors or hold doors in open position.
7. Provide "door close" button to activate door close cycle. Cycle shall not begin until normal door dwell time for a car or hall call has expired, except firefighters' operation.
8. Provide a Door Hold Button on the faceplate next to the Independent Service Key Switch. It shall have "DOOR HOLD" indelibly marked on the button. Button shall light when activated. When activated, the door shall stay open for a maximum of one minute. To override hold timer, push a car call button or door close button.
9. Provide firefighters' locked box with code required devices and illuminated fire hat jewel in car operating panel.
  - a. Provide firefighters' Phase II key switch with engraved instructions filled red. Include light jewel, buzzer, and call cancel button.
10. Install firefighters' telephone approved mounting.



11. Provide lockable service compartment with recessed flush door. Door material and finish shall match car return panel or car operating panel faceplate.
  12. Include the following controls in lockable service cabinet with function and operating positions identified by permanent signage or engraved legend:
    - a. Access Enable switch.
    - b. Light switch.
    - c. Three-position exhaust blower switch.
    - d. Independent service switch.
    - e. Constant pressure test button for battery pack emergency lighting.
    - f. 120-volt, AC, GFCI protected electrical convenience outlet.
    - g. Stop key switch.
  13. Provide black paint filled (except as noted), engraved, or approved etched signage as follows with approved size and font:
    - a. Phase II firefighters' operating instructions on main operating panel above corresponding key switch filled red.
    - b. Car number on main and auxiliary car operating panel.
    - c. "Certificate of Inspection on File in Building Office" on main car operating panel.
    - d. "No Smoking" on main car operating panel.
    - e. Car capacity in pounds on main car operating panel.
- Q. New Car Top Control Station: Mount to provide safe access and utilization while standing in an upright position on car top. Locate car top stop switch within easy reach of landing entrance.
- R. New Work Light and Duplex Plug Receptacle: GFCI protected outlet at top and bottom of car. Include on/off switch and lamp guard.
- S. New Communication System:
1. "Push to Call," two-way communication instrument in car with automatic dialing, tracking, and recall features with shielded wiring to car controller in machine room. Provide dialer with automatic rollover capability with minimum two numbers.
    - a. "Push to Call" button or adjacent light jewel shall illuminate and flash when call is acknowledged. Button shall match car operating panel pushbutton design. Provide uppercase "PUSH TO CALL" "HELP ON THE WAY" engraved signage adjacent to button to indicate when call is placed and when call is received. Coordinate signage with communications provider.
    - b. Provide "Push to Call" button tactile symbol, engraved signage, and Braille adjacent to button mounted integral with car front return panel.
  2. Firefighters' telephone in car and firefighters' panel, with four shielded wires to machine room junction box.
  3. Provide on-site two-way communication between car and emergency personnel, located in firefighters' panel.

## 2.11 CAR ENCLOSURE

- A. New Car Enclosure - Passenger Elevators: Retain existing car shell. Car weight to be verified prior to removal of interior cab finishes. Remove existing interior finishes, weigh, and document. Provide

complete as specified herein. New cab weight including all new finishes to be verified following completion of modernization. Post modernization weight not to exceed code allowable limits. Provide the following features.

1. Shell: Retain. Apply sound-deadening mastic to exterior.
  2. Canopy: Retain.
  3. Front Return Panels: Reinforced 14-gauge stainless steel satin finish with cutouts for car operating panels and other equipment.
  4. Entrance Columns: Reinforced 14-gauge stainless steel satin finish.
  5. Transom: Reinforced 14-gauge stainless steel satin finish full width of enclosure.
  6. Car Door Panels: Reinforced minimum 16-gauge stainless steel satin finish. Same construction as hoistway door panels.
  7. Base: Stainless steel satin finish with concealed ventilation cutouts.
  8. Interior Wall Finish: Side and rear walls up to the center line of the top handrail, shall be covered with stainless steel. Side and rear walls to the ceiling shall be covered with removable panels, faced and edged, with premium color core plastic laminate. Color and finish as selected by Purchaser. Submit a method of fastening panels to steel walls.
  9. Ventilation: Two-speed OE exhaust blower mounted to car canopy on isolated rubber grommets. Exhaust blower shall meet requirements of Item 2.03, H. Ventilation shall shut off after adjustable period (60 - 180 seconds) of no elevator demand.
  10. Lighting: Provide 4100 K LED fixtures with wiring and hookup. Coordinate with emergency lighting requirements. Maintain a minimum light level of 50-foot candles at 90 cm (36 in.) above the finished floor. Lighting shall shut off after adjustable period (60 - 180 seconds) of no elevator demand. Provide emergency lighting integral with portion of normal car lighting system. Provide temporary lighting as required.
  11. Suspended Ceiling: Provide aluminum hanging ceiling frame. Construct frame of 3.125 mm (.125 in.) thick x 37.5 mm (1.50 in.) wide x 37.5 mm (1.50 in.) high "T" and "L" sections, divide ceiling into six panels.
  12. Handrails: Provide two sets of handrails with centerlines 75cm and 105cm (30 in. and 42") above the car floor.
    - a. Locate handrails 37.5 mm (1.50 in.) from cab wall. Install handrails on side and rear walls. Conceal all handrail fastenings. Handrails shall be removable from inside the car enclosure.
- B. New Car Enclosure - Service Elevators: Retain existing car shell. Car weight to be verified prior to removal of interior cab finishes. Remove existing interior finishes, weigh, and document. Provide complete as specified herein. New cab weight including all new finishes to be verified following completion of modernization. Post modernization weight not to exceed code allowable limits. Provide the following features.
1. Shell: Retain. Apply sound-deadening mastic to exterior.
  2. Canopy: Retain.
  3. Front Return Panels: Reinforced 14-gauge stainless steel satin finish with cutouts for car operating panels and other equipment.
  4. Entrance Columns: Reinforced 14-gauge stainless steel satin finish.

5. Transom: Reinforced 14-gauge stainless steel satin finish full width of enclosure.
  6. Car Door Panels: Reinforced minimum 16-gauge stainless steel satin finish. Same construction as hoistway door panels.
  7. Base: Stainless steel satin finish with concealed ventilation cutouts.
  8. Interior Wall Finish: Side and rear walls up to the center line of the top handrail, shall be covered with stainless steel. Side and rear walls to the ceiling shall be covered with removable panels, faced and edged, with premium color core plastic laminate. Color and finish as selected by Purchaser. Submit a method of fastening panels to steel walls.
  9. Ventilation: Two-speed type AA exhaust blower mounted to car canopy on isolated rubber grommets. Exhaust blower shall meet requirements of Item 2.03, H. Ventilation shall shut off after adjustable period (60 - 180 seconds) of no elevator demand.
  10. Lighting: Provide LED fixtures with wiring and hookup. Maintain a minimum light level of 50-foot candles at 90 cm (36 in.) above the finished floor. Coordinate with emergency lighting requirements. Lighting shall shut off after adjustable period (60 - 180 seconds) of no elevator demand. Provide emergency lighting integral with portion of normal car lighting system. Provide temporary lighting as required.
  11. Suspended Ceiling: Provide aluminum hanging ceiling frame. Construct frame of 3.125 mm (.125 in.) thick x 37.5 mm (1.50 in.) wide x 37.5 mm (1.50 in.) high "T" and "L" sections, divide ceiling into six panels.
  12. Handrails: Provide two sets of handrails with centerlines 75cm and 105cm (30 in. and 42") above the car floor.
    - a. Locate handrails 37.5 mm (1.50 in.) from cab wall. Install handrails on side and rear walls. Conceal all handrail fastenings. Handrails shall be removable from inside the car enclosure.
    - b. Provide service elevators with flat stock handrails with the ends at the entrance turned back to the wall.
  13. Provide one set of protective pads for service elevator of sufficient length to completely cover two sides, rear walls and front return of cab interior. Pads shall consist of a minimum of 6 mm (.25 in.) thick glass fiber insulation securely sewn between flame resistant vinyl coated coverings. Color of the covering shall be approved by the COR. Provide stainless steel pad buttons or hooks, spaced at intervals of not more than 150 mm (18 in.) to adequately support pads.
- C. Alternate 2: Car Enclosure Passenger and Service Elevators: Retain existing car enclosure and shell. Modify as required for application of new signal and pushbutton fixtures. Overall car weight to be verified and documented, prior to removal of any equipment from the existing car frame or car enclosure. Check and tighten all fasteners.
- D. Top of Car Guardrail: Provide car top railings where fall hazard exceeds 12". Install guardrails, necessary hardware and toe board to meet code requirements.

## **2.12 HALL CONTROL STATIONS**

- A. Pushbuttons: Provide two (2) risers per elevator group with flush mounted faceplates. Include pushbuttons for each direction of travel which illuminate to indicate call registration. Provide White LED illumination. Include approved engraved message and pictorial representation prohibiting use of elevator during fire or other emergency situation as part of faceplate. Pushbutton design shall match car operating panel pushbuttons. Provide vandal resistant pushbutton and light assemblies. Provide enlarged faceplate to cover existing wall blackout and facilitate handicapped access requirements. Provide any cutting and patching required. Provide an illuminated signal marked "Elevator Emergency Power" to indicate emergency or standby power is in effect.

## **2.13 SIGNALS**

- A. New Hall Lantern, All Cars: Provide at each entrance to indicate travel direction of arriving car. Illuminate green LED lights for up travel and Red LED lights for down travel and sound tone once for up and twice for down direction prior to car arrival at floor. Sound level shall be adjustable from 20-80 dBA measured at 5'-0" in front of hall control station and 3'-0" off floor. Illuminate light until the car doors start to close. Provide advanced hall lantern notification to comply with ADA hall call notification time. Car direction lenses shall be arrow shaped with faceplates. Lenses shall be minimum 2-1/2" in their smallest dimension. Provide vandal resistant lantern and light assemblies consisting of series of dots or lines for maximum visibility.
- B. New Car Position Indicator, All Cars: digital indicator containing floor designations and direction arrows a minimum of 2" high to indicate floor served and direction of car travel. Locate fixture in each car operating panel. When a car leaves or passes a floor, illuminate indication representing position of car in hoistway. Illuminate proper direction arrow to indicate direction of travel.
- C. Hall Position Indicator, All Cars: Alpha-numeric digital indicator containing floor designations and direction arrows a minimum of 2" high to indicate floor served and direction of car travel. Mount integral with hall lanterns at all floors. Provide vandal resistant indicator and light assemblies.
- D. Faceplate Material and Finish: Stainless steel Satin finish all fixtures.
- E. Voice Synthesizer: Provide electronic device with easily reprogrammable message and female voice to announce car direction, floor, emergency exiting instructions, etc.

## **2.14 GROUP DISPLAY AND MONITORING SYSTEMS**

- A. Group Display Panel, All Cars: Provide a CPU with battery backup and LCD minimum 17" diagonal flat screen color monitor with capability to activate, display, monitor, and control the following functions shown

below. Locate Group Display Panels in the following locations;  
Elevator Machine Room.

1. On/off means to place car in or out of service. When placed in "off" position return cars nonstop to designated floor and park with doors open for adjustable period of 1-3 minutes. At expiration of time, restore car to service.
  2. Car operating on normal/standby power.
  3. Car position and direction of travel.
  4. Car calls.
  5. Hall calls.
  6. Operating mode.
  7. Door status.
  8. Delayed car.
  9. Load weighing and by-pass.
  10. Car to lobby feature.
  11. Car in/out of service.
  12. Accumulate hall call registration information as part of monitoring capability. Provide memory capacity for at least the preceding five, 24-hour periods, in blocks of 5 or 15-minute segments, running hour to hour (i.e., 2:00 p.m. to 3:00 p.m.) Provide battery backup to prevent loss of accumulated data due to loss of normal power.
  13. Accumulate information for retrieval and use as follows:
    - a. Visual and printed summary of hall call registration events by floor, direction, and duration, totaled in 5- or 15-minute segments during any 60-minute block using an internal clock.
    - b. Visual and printed summary of hall call registration duration averaged for 5 or 15 minute and hourly periods.
    - c. Visual and printed summary of percentage of hall calls answered within 30 and 60 seconds in each 5- or 15-minute and hourly periods.
    - d. Visual and printed summary of time periods during which individual cars are not in group operation (operating separately or out of service).
  14. Accumulate system fault data including nature of fault, time, and day. Store and retrieval capabilities for minimum 30-day period.
  15. Group Display Panel shall be located as directed by Purchaser. Where applicable, identify all indicators and manual switches with appropriate engraving. Provide conduit and wiring to control panel. Coordinate size and location with Building Console Supplier.
- B. Firefighters' Control Panel, All Cars: Locate as directed by Purchaser. Fixture faceplate, stainless steel satin finish, including the following features:
1. Car position and direction indicator (digital-readout or color LCD Flat Panel Display). Identify each position indicator with car number and group identification.
  2. Indicator showing operating status of car.
  3. Manual car standby power selection switches and power status indicators.
  4. Two-position firefighters' emergency return switches and indicators with engraved instructions filled red.
  5. Firefighters' telephone.
  6. Firefighters Control Panel shall be located as directed by Purchaser. Where applicable, identify all indicators and manual switches with appropriate engraving. Provide conduit and wiring

to control panel. Coordinate size and location with Building Console Supplier.

- C. Firefighters' Key Box: Flush-mounted box with lockable hinged cover. Engrave instructions for use on cover per Local Fire Authority requirements.

## 2.15 INTERCOM AND DISTRESS SIGNAL SYSTEM

- A. General: Provide intercommunication system, All Cars. Include all wiring between elevator hoistways and control panels. Include the following stations:

Station Location	Type Station	Selection Buttons to Call
Firefighters' Control Panel	Master	Machine Rooms, All Cars
Machine Rooms, All Cars	Remote	Firefighters' Control Panel

- B. Basic Equipment:
  - 1. Amplifier providing static-free voice transmission with adequate volume and minimum distortion at all stations, with pre-amplifier capable of receiving voice and music inputs from building and emergency building communication system.
  - 2. Activation of emergency building communication system overrides all other conversations and permits one-way conversation to all master stations in system.
  - 3. Master Stations:
    - a. Speaker-microphone combination, and/or handset for two-way communication.
    - b. Selection buttons to enable communication with all master stations. Maintain continual reception of hands-free reply from station when a selected button is depressed.
    - c. Two-Position "Talk/Listen" Button: Press to talk; release to listen.
    - d. Illuminate "in use" light when any master station is being used.
    - e. Reset button to make system available for use by any master station.
    - f. Volume control knob for adjustment of incoming volume.
    - g. Button to establish communications with all stations.
    - h. Distress light in lobby panel which illuminates when "push to call" button or alarm button in car is actuated. Energize distress light and buzzer or chime until intercom selection button for that car has been depressed. Sound buzzer or chime in lobby panel simultaneously with illumination of distress light.
  - 4. Remote Stations:
    - a. Station in car shall be activated by "push to call" two-way communication button. "Push to call" button shall illuminate and flash when call is acknowledged. Button shall match car operating panel pushbutton design. Provide uppercase "PUSH TO CALL," "HELP ON THE WAY" engraved signage adjacent to button. Provide "push to call" button tactile symbol, engraved signage, and Braille adjacent to button.

- b. Locate car microphone and speaker, or transceiver/speaker combination in car canopy behind front return panel with drilled speaker pattern, with shielded wiring to machine room junction box.

C. Station Housings:

1. House master station in machine room in a metal compartment with baked enamel finish. Attach to the group elevator supervisory control panel or wall mount. Provide communication handset with 25'-0" long cord.
2. Provide control center master intercoms with stainless steel satin finish faceplates and engraved operating instructions. Coordinate faceplate size and installation of units with building Console Supplier.

**2.16 SEISMIC OPERATIONS AND EQUIPMENT**

- A. Meet the requirements of VA Seismic Design Manual H-18-8.

**PART 3 - EXECUTION**

**3.1 SITE CONDITION INSPECTION**

- A. Prior to beginning installation of equipment, examine hoistway and machine room areas. Verify no irregularities exist which affect execution of work specified.
- B. Do not proceed with installation until work in place conforms to project requirements.

**3.2 PRODUCT DELIVERY, STORAGE, AND HANDLING**

- A. Deliver material in Contractor's original, unopened protective packaging.
- B. Store material in original protective packaging. Prevent soiling, physical damage, or moisture damage.
- C. Protect equipment and exposed finishes from damage and stains during transportation, erection, and construction.

**3.3 INSTALLATION**

- A. Install all equipment in accordance with Contractor's instructions, referenced codes, specification, and approved submittals.
- B. Install machine room equipment with clearances in accordance with referenced codes, and specification.
- C. Install all equipment so it may be easily removed for maintenance and repair.
- D. Install all equipment for ease of maintenance.
- E. Install all equipment to afford maximum accessibility, safety, and continuity of operation.

- F. Remove oil, grease, scale, and other foreign matter from the following equipment and apply one coat of field-applied machinery enamel.
  - 1. All exposed equipment and metal work installed as part of this work which does not have architectural finish.
  - 2. Machine room equipment, and pit equipment.
  - 3. Neatly touch up damaged factory-painted surfaces with original paint color. Protect machine-finish surfaces against corrosion.
- G. Paint machine room and pit floors.

### **3.4 FIELD QUALITY CONTROL**

- A. Work at jobsite will be checked during course of installation. Full cooperation with reviewing personnel is mandatory. Accomplish corrective work required prior to performing further installation.
- B. Have Code Authority acceptance inspection performed and complete corrective work.

### **3.5 ADJUSTMENTS**

- A. Install rails plumb and align vertically with tolerance of 1/16" in 100'-0". Secure joints without gaps and file any irregularities to a smooth surface.
- B. Static balance car to equalize pressure of guide shoes on guide rails.
- C. Lubricate all equipment in accordance with Contractor's instructions.
- D. Adjust motors, power conversion units, brakes, controllers, leveling switches, limit switches, stopping switches, door operators, interlocks, and safety devices to achieve required performance levels.

### **3.6 CLEANUP**

- A. Keep work areas orderly and free from debris during progress of project. Remove packaging materials on a daily basis.
- B. Remove all loose materials and filings resulting from work.
- C. Clean machine room equipment and floor.
- D. Clean hoistways, car, car enclosure, entrances, operating and signal fixtures.

### **3.7 FINAL CLEANING**

- A. As a minimum:
  - 1. Elevator hoistways and all equipment therein shall be cleaned and left free of rust, filings, welding slag, rubbish, loose plaster, mortar drippings, extraneous construction materials, dirt, and dust. Include walls, building beams, sill ledges, and hoistway divider beams.
  - 2. Care shall be taken by work persons not to mark, soil, or otherwise deface existing or new surfaces. Clean and restore such surfaces to their original condition.



3. Clean down surfaces and areas which require final painting and finishing work. Cleaning includes removal of rubbish, broom cleaning of floors, removal of any loose plaster or mortar, dust and other extraneous materials from finish surfaces, and surfaces which will remain visible after the work is complete.
4. Machine room walls and floors shall be painted.

### **3.8 CONSULTANT'S FINAL OBSERVATION AND REVIEW REQUIREMENTS**

- A. Review procedure shall apply for individual elevators, portions of groups of elevators and completed groups of elevators accepted on an interim basis, or elevators and groups of elevators completed, accepted, and placed in operation.
- B. Contractor shall perform review and evaluation of all aspects of its work prior to requesting Consultant's final review. Work shall be considered ready for Consultant's final contract compliance review when all Contractor's tests are complete and all elements of work or a designated portion thereof are in place and elevator or group of elevators are deemed ready for service as intended.
- C. Furnish labor, materials, and equipment necessary for Consultant's review. Notify Consultant five (5) working days in advance when ready for final review of elevator or group of elevators.
- D. Consultant's written list of observed deficiencies of materials, equipment and operating systems will be submitted to Contractor for corrective action. Consultant's review shall include as a minimum:
  1. Workmanship and equipment compliance with Contract Documents.
  2. Contract speed, capacity, floor-to-floor, and door performance comply with Contract Documents.
  3. Performance of following is satisfactory:
    - a. Starting, accelerating, running
    - b. Decelerating, stopping accuracy
    - c. Door operation and closing force
    - d. Equipment noise levels
    - e. Signal fixture utility
    - f. Overall ride quality
    - g. Performance of door control devices
    - h. Operations of emergency two-way communication device
    - i. Operations of firefighters' service
    - j. Operations of special security features and floor lock-off provisions
    - k. Operations of remote monitoring devices
    - l. Operations of emergency brake device
  4. Test Results:
    - a. In all test conditions, obtain specified contract speed, performance times, stopping accuracy without re-leveling, and ride quality to satisfaction of Purchaser and Consultant. Tests shall be conducted under both no load and full load condition.
    - b. Temperature rise in motor windings limited to 50° Celsius above ambient. A full-capacity one (1) hour running test, stopping at each floor for ten (10) seconds in up and down directions, may be required.

- E. Performance Guarantee: Should Consultant's review identify defects, poor workmanship, variance or noncompliance with requirements of specified codes and/or ordinances, or variance or noncompliance with the requirements of Contract Documents, Contractor shall complete corrective work in an expedient manner to satisfaction of Purchaser and Consultant at no cost as follows:
1. Replace equipment which does not meet code or Contract Document requirements.
  2. Perform work and furnish labor, materials, and equipment necessary to meet specified operation and performance.
  3. Perform retesting required by governing code authority, Purchaser and Consultant.
- F. A follow-up final contract compliance review shall be performed by Consultant after notification by Contractor that all deficiencies have been corrected. Provide Consultant with copies of the initial deficiency report marked to indicate items which Contractor considers complete.

### **3.9 PURCHASER'S INFORMATION**

- A. Provide three (3) sets of neatly bound written information necessary for proper maintenance and adjustment of equipment within 30 days following final acceptance. Final retention will be withheld until data is received by Purchaser and reviewed by Consultant. Include the following as minimums:
1. Straight-line wiring diagrams of "as-installed" elevator circuits with index of location and function of components. Provide one set reproducible master. Mount one set wiring diagrams on panels, racked, or similarly protected, in elevator machine room. Provide remaining set rolled and in a protective drawing tube. Maintain all drawing sets with addition of all subsequent changes. These diagrams are Purchaser's property.
  2. Written Maintenance Control Program (MCP) specifically designed for the equipment included under this contract. Include any unique or product specific procedures or methods required to inspect or test the equipment. In addition, identify weekly, bi-weekly, monthly, quarterly, and annual maintenance procedures, including statutory and other required equipment tests.
  3. Provide any necessary interface cards required for equipment maintenance, code mandated testing, and troubleshooting.
  4. Lubrication instructions including recommended grade of lubricants.
  5. Parts catalogs for all replaceable parts including ordering forms and instructions.
  6. Four sets of keys for all switches and control features properly tagged and marked.
  7. Neatly bound instructions explaining all operating features including all apparatus in the car and lobby control panels.
  8. Neatly bound maintenance and adjustment instructions explaining areas to be addressed, methods and procedures to be used, and specified tolerances to be maintained for all equipment.
  9. Diagnostic equipment complete with access codes, adjusters' manuals and set-up manuals for adjustment, diagnosis and troubleshooting of elevator system, and performance of routine safety tests.

- B. Preventive Maintenance Contract: Furnish properly executed contract for continuing, preventive maintenance.
- C. Acceptance of such records by Purchaser/Consultant shall not be a waiver of any Contractor deviation from Contract Documents or shop drawings or in any way relieve Contractor from his responsibility to perform work in accordance with Contract Documents.

### **3.10 INSTRUCTION OF VA PERSONNEL**

- A. Provide competent instruction to VA personnel regarding the operation of equipment and accessories installed under this contract, for a period equal to one eight-hour day. Instruction shall commence after completion of all work and at the time and place directed by the COR.
- B. Written instructions in triplicate relative to care, adjustments and operation of all equipment and accessories shall be furnished and delivered to the COR in independently bound folders. DVD recordings will also be acceptable. Written instructions shall include correct and legible wiring diagrams, nomenclature sheet of all electrical apparatus including location of each device, complete and comprehensive sequence of operation, complete replacement parts list of with descriptive literature, and identification and diagrams of equipment and parts. Information shall also include electrical operation characteristics of all circuits, relays, timers, electronic devices, and related characteristics for all rotating equipment.
- C. Provide supplementary instruction for any new equipment that may become necessary because of changes, modifications or replacement of equipment or operation under requirements of paragraph entitled "Warranty of Construction".

**END OF SECTION**

**SECTION 21 13 13**  
**WET-PIPE SPRINKLER SYSTEMS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Design, installation and testing shall be in accordance with NFPA 13.
- B. The design and installation of a hydraulically calculated automatic wet-pipe system complete and ready for operation, for all renovated portions of Building 330.
- C. Modification of the existing sprinkler system on the drawings and as further required by these specifications.

**1.2 RELATED WORK**

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Section 07 84 00, FIRESTOPPING.
- C. Section 09 91 00, PAINTING.

**1.3 DESIGN CRITERIA**

- A. Design Basis Information: Provide design, materials, equipment, installation, inspection, and testing of the automatic sprinkler system in accordance with the requirements of NFPA 13.
  - 1. Perform hydraulic calculations in accordance with NFPA 13 utilizing the Area/Density method. Do not restrict design area reductions permitted for using quick response sprinklers throughout by the required use of standard response sprinklers in the areas identified in this section.
  - 2. Sprinkler Protection: Sprinkler hazard classifications shall be in accordance with NFPA 13. The hazard classification examples of uses and conditions identified in the Annex of NFPA 13 shall be mandatory for areas not listed below. Request clarification from the Government for any hazard classification not identified. To determining spacing and sizing, apply the following coverage classifications:
    - a. Light Hazard Occupancies: Patient care, treatment, and customary access areas.
    - b. Ordinary Hazard Group 1 Occupancies: Laboratories, Mechanical Equipment Rooms, Transformer Rooms, Electrical Switchgear Rooms, Electric Closets, and Repair Shops.
    - c. Ordinary Hazard Group 2 Occupancies: Storage rooms, trash rooms, clean and soiled linen rooms, pharmacy and associated storage,

laundry, kitchens, kitchen storage areas, retail stores, retail store storage rooms, storage areas, building management storage, boiler plants, energy centers, warehouse spaces, file storage areas for the entire area of the space up to 140 square meters (1500 square feet) and Supply Processing and Distribution (SPD).

3. Hydraulic Calculations: Calculated demand including hose stream requirements shall fall no less than 10 percent below the available water supply curve.
4. Water Supply: Base water supply on a flow test of:
  - a. Location: Dayton VAMC - Basement
  - b. Static pressure: 1310 kPa (190 psi)
  - c. Residual pressure: 786 kPa (114 psi)
  - d. Flow: 47.32 L/s (750 gpm)
  - e. Date: 8-9-2012

Note: Perform hydraulic calculations utilizing the basis of design flow test data provided to bid the fire suppression sprinkler system. Upon award of the project, a fire pump flow test along with corresponding hydraulic calculations shall be performed to verify adequate pressure and flow.

5. Provide seismic protection in accordance with NFPA 13. Contractor shall submit load calculations for sizing of sway bracing for systems that are required to be protected against damage from earthquakes.

#### **1.4 SUBMITTALS**

- A. Submit as one package in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Prepare detailed working drawings that are signed by a NICET Level III or Level IV Sprinkler Technician or stamped by a Registered Professional Engineer licensed in the field of Fire Protection Engineering. As the Government review is for technical adequacy only, the installer remains responsible for correcting any conflicts with other trades and building construction that arise during installation. Partial submittals shall not be accepted. Material submittals shall be approved prior to the purchase or delivery to the job site. Suitably bind submittals in notebooks or binders and provide an index referencing the appropriate specification section. In addition to the hard copies, provide submittal items in Paragraphs 1.4(A)1 through 1.4(A)5 electronically in pdf format on a

compact disc or as directed by the COR. Submittals shall include, but not be limited to, the following:

1. Qualifications:

- a. Provide a copy of the installing contractors fire sprinkler and state contractor's license.
- b. Provide a copy of the NICET certification for the NICET Level III or Level IV Sprinkler Technician who prepared and signed the detailed working drawings unless the drawings are stamped by a Registered Professional Engineer licensed in the field of Fire Protection Engineering.
- c. Provide documentation showing that the installer has been actively and successfully engaged in the installation of commercial automatic sprinkler systems for the past ten years.

2. Drawings: Submit detailed 1:100 (1/8 inch) scale (minimum) working drawings conforming to the Plans and Calculations chapter of NFPA 13. Drawings shall include graphical scales that allow the user to determine lengths when the drawings are reduced in size. Include a plan showing the piping to the water supply test location.

3. Manufacturer's Data Sheets: Provide data sheets for all materials and equipment proposed for use on the system. Include listing information and installation instructions in data sheets. Where data sheets describe items in addition to those proposed to be used for the system, clearly identify the proposed items on the sheet.

4. Calculation Sheets:

- a. Submit hydraulic calculation sheets in tabular form conforming to the requirements and recommendations of the Plans and Calculations chapter of NFPA 13.
- b. Submit calculations of loads for sizing of sway bracing in accordance with NFPA 13.

5. Final Document Submittals: Provide as-built drawings, testing and maintenance instructions in accordance with the requirements in Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. In addition, submittals shall include, but not be limited to, the following:

- a. A complete set of as-built drawings showing the installed system with the specific interconnections between the system switches and the fire alarm equipment. Provide a complete set in the

formats as follows. Submit items 2 and 3 below on a compact disc or as directed by the COR.

- 1) One full size (or size as directed by the COR) printed copy.
  - 2) One complete set in electronic pdf format.
  - 3) One complete set in AutoCAD format or a format as directed by the COR.
- b. Material and Testing Certificate: Upon completion of the sprinkler system installation or any partial section of the system, including testing and flushing, provide a copy of a completed Material and Testing Certificate in NFPA 13. Certificates shall be provided to document all parts of the installation.
- c. Operations and Maintenance Manuals that include step-by-step procedures required for system startup, operation, shutdown, and routine maintenance and testing. The manuals shall include the manufacturer's name, model number, parts list, and tools that shall be kept in stock by the Government for routine maintenance, including the name of a local supplier, simplified wiring and controls diagrams, troubleshooting guide, and recommended service organization, including address and telephone number, for each item of equipment.
- d. One paper copy of the Material and Testing Certificates and the Operations and Maintenance Manuals above shall be provided in a binder. In addition, these materials shall be provided in pdf format on a compact disc or as directed by the COR.
- e. Provide one additional copy of the Operations and Maintenance Manual covering the system in a flexible protective cover and mount in an accessible location adjacent to the riser or as directed by the COR.

### **1.5 QUALITY ASSURANCE**

- A. Installer Reliability: The installer shall possess a valid State of Ohio fire sprinkler contractor's license. The installer shall have been actively and successfully engaged in the installation of commercial automatic sprinkler systems for the past ten years.
- B. Materials and Equipment: All equipment and devices shall be of a make and type listed by UL or approved by FM, or other nationally recognized testing laboratory for the specific purpose for which it is used. All

materials, devices, and equipment shall be approved by the VA. All materials and equipment shall be free from defect. All materials and equipment shall be new unless specifically indicated otherwise on the contract drawings.

**1.6 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. National Fire Protection Association (NFPA):
  - 13-19.....Installation of Sprinkler Systems
  - 14-13.....Installation of Standpipe and Hose Systems
  - 25-17.....Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems
  - 101-18.....Life Safety Code
  - 170-18.....Fire Safety Symbols
- C. Underwriters Laboratories, Inc. (UL):
  - Fire Protection Equipment Directory (2011)
- D. Factory Mutual Engineering Corporation (FM):
  - Approval Guide

**PART 2 - PRODUCTS**

**2.1 PIPING & FITTINGS**

- A. Piping and fittings for sprinkler systems shall be in accordance with NFPA 13.
  - 1. Plain-end pipe fittings with locking lugs or shear bolts are not permitted.
  - 2. Piping sizes 50 mm (2 inches) and smaller shall be black steel Schedule 40 with threaded end connections.
  - 3. Piping sizes 65 mm (2 ½ inches) and larger shall be black steel Schedule 10 with grooved connections. Grooves in Schedule 10 piping shall be rolled grooved only.
  - 4. Plastic piping shall not be permitted except for drain piping.

**2.2 SPRINKLERS**

- A. All sprinklers shall be FM approved quick response. Provide FM approved quick response sprinklers in all areas.



- B. Temperature Ratings: In accordance with NFPA 13 except that sprinklers in elevator shafts and elevator machine rooms shall be no less than intermediate temperature rated.
- C. Provide sprinkler guards in accordance with NFPA 13 and when the elevation of the sprinkler head is less than 7 feet 6 inches above finished floor. The sprinkler guard shall be UL listed or FM approved for use with the corresponding sprinkler.

### **2.3 SPRINKLER CABINET**

- A. Provide the required number of sprinkler heads of all ratings and types installed, and a sprinkler wrench for each type of sprinkler in accordance with NFPA 13 in existing sprinkler cabinet.
- B. Provide a list of sprinklers installed in the property in the cabinet. The list shall include the following:
  - 1. Manufacturer, model, orifice, deflector type, thermal sensitivity, and pressure for each type of sprinkler in the cabinet.
  - 2. General description of where each sprinkler is used.
  - 3. Quantity of each type present in the cabinet.
  - 4. Issue or revision date of list.

### **2.4 SPRINKLER SYSTEM SIGNAGE**

- A. Rigid plastic, steel or aluminum signs with white lettering on a red background with holes for easy attachment. Sprinkler system signage shall be attached to the valve or piping with chain.

### **2.5 PIPE HANGERS, SUPPORTS AND RESTRAINT OF SYSTEM PIPING**

- A. Pipe hangers, supports, and restraint of system piping shall be in accordance with NFPA 13.

### **2.6 WALL, FLOOR AND CEILING PLATES**

- A. Provide chrome plated steel escutcheon plates.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Installation shall be accomplished by the licensed contractor. Provide a qualified technician, experienced in the installation and operation of the type of system being installed, to supervise the installation and testing of the system.
- B. Installation of Piping: Accurately cut pipe to measurements established by the installer and work into place without springing or forcing. In any situation where bending of the pipe is required, use a standard pipe-bending template. Concealed piping in spaces that have finished

ceilings. Where ceiling mounted equipment exists, such as in operating and radiology rooms, install sprinklers so as not to obstruct the movement or operation of the equipment. Sidewall heads shall need to be utilized. Piping shall not obstruct the minimum means of egress clearances required by NFPA 101. Pipe hangers, supports, and restraint of system piping, and seismic bracing shall be installed accordance with NFPA 13.

- C. Welding: Conform to the requirements and recommendations of NFPA 13.
- D. Drains: Provide drips and drains, including low point drains, in accordance with NFPA 13. Pipe drains to discharge at safe points outside of the building or to sight cones attached to drains of adequate size to readily carry the full flow from each drain under maximum pressure. Do not provide a direct drain connection to sewer system or discharge into sinks. Install drips and drains where necessary and required by NFPA 13. The drain piping shall not be restricted or reduced and shall be of the same diameter as the drain collector.
- E. Affix cutout disks, which are created by cutting holes in the walls of pipe for flow switches and non-threaded pipe connections to the respective waterflow switch or pipe connection near to the pipe from where they were cut.
- F. Provide escutcheon plates for exposed piping passing through walls, floors or ceilings.
- G. Clearances: For systems requiring seismic protection, piping that passes through floors or walls shall have penetrations sized 50 mm (2 inches) nominally larger than the penetrating pipe for pipe sizes 25 mm (1 inch) to 90 mm (3 ½ inches) and 100 mm (4 inches) nominally larger for penetrating pipe sizes 100 mm (4 inches) and larger.
- H. Sleeves: Provide for pipes passing through masonry or concrete. Provide space between the pipe and the sleeve in accordance with NFPA 13 and NFPA 14. Seal this space with a UL Listed through penetration fire stop material in accordance with Section 07 84 00, FIRESTOPPING. Where core drilling is used in lieu of sleeves, also seal space. Seal penetrations of walls, floors and ceilings of other types of construction, in accordance with Section 07 84 00, FIRESTOPPING.

- I. Firestopping shall be provided for all penetrations of fire resistance rated construction. Firestopping shall comply with Section 07 84 00, FIRESTOPPING.
- J. Painting of Pipe: In finished areas where walls and ceilings have been painted, paint primed surfaces with two coats of paint to match adjacent surfaces, except paint valves and operating accessories with two coats of gloss red enamel. Exercise care to avoid painting sprinklers. Painting of sprinkler systems above suspended ceilings and in crawl spaces is not required. Painting shall comply with Section 09 91 00, PAINTING. Any painted sprinkler shall be replaced with a new sprinkler.
- K. Sprinkler System Signage: Provide rigid sprinkler system signage in accordance with NFPA 13 and NFPA 25. Sprinkler system signage shall include, but not limited to, the following:
  - 1. Identification Signs:
    - a. Provide signage for each control valve, drain valve, sprinkler cabinet, and inspector's test.
  - 2. Instruction/Information Signs:
    - a. Provide signage indicating the number and location of low point drains.
  - 3. Hydraulic Placards:
    - a. Provide signage indicating hydraulic design information. The placard shall include location of the design area, discharge densities, required flow and residual pressure at the base of riser, occupancy classification, hose stream allowance, flow test information, and installing contractor. Locate hydraulic placard information signs at each alarm check valve.
- L. Repairs: Repair damage to the building or equipment resulting from the installation of the sprinkler system by the installer at no additional expense to the Government.
- M. Interruption of Service: There shall be no interruption of the existing sprinkler protection, water, electric, or fire alarm services without prior permission of the COR. Contractor shall develop an interim fire protection program where interruptions involve occupied spaces. Request in writing at least one week prior to the planned interruption.

### **3.2 INSPECTION AND TEST**

- A. Preliminary Testing: Flush newly installed systems prior to performing hydrostatic tests in order to remove any debris which shall have been left as well as ensuring piping is unobstructed.
- B. Hydrostatically test system, including the fire department connections, as specified in NFPA 13, in the presence of the Contracting Officers Representative (COR) or his designated representative. Test and flush underground water line prior to performing these hydrostatic tests.
- C. Final Inspection and Testing: Subject system to tests in accordance with NFPA 13, and when all necessary corrections have been accomplished, advise COR to schedule a final inspection and test. Connection to the fire alarm system shall have been in service for at least ten days prior to the final inspection, with adjustments made to prevent false alarms. Furnish all instruments, labor and materials required for the tests and provide the services of the installation foreman or other competent representative of the installer to perform the tests. Correct deficiencies and retest system as necessary, prior to the final acceptance. Include the operation of all features of the systems under normal operations in test

### **3.3 INSTRUCTIONS**

- A. Furnish the services of a competent instructor for not less than two hours for instructing personnel in the operation and maintenance of the system, on the dates requested by the COR.

- - - E N D - - -

**SECTION 23 05 11  
COMMON WORK RESULTS FOR HVAC**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. The requirements of this Section apply to all sections of Division 23.
- B. Definitions:
  - 1. Exposed: Piping, ductwork, and equipment exposed to view in finished rooms.
  - 2. Exterior: Piping, ductwork, and equipment exposed to weather be it temperature, humidity, precipitation, wind, or solar radiation.
- C. Abbreviations/Acronyms:
  - 1. ac: Alternating Current
  - 2. ACR: Air Conditioning and Refrigeration
  - 3. AI: Analog Input
  - 4. AISI: American Iron and Steel Institute
  - 5. AO: Analog Output
  - 6. ASJ: All Service Jacket
  - 7. AWG: American Wire Gauge
  - 8. BACnet: Building Automation and Control Networking Protocol
  - 9. BA<sub>g</sub>: Silver-Copper-Zinc Brazing Alloy
  - 10. BAS: Building Automation System
  - 11. BCuP: Silver-Copper-Phosphorus Brazing Alloy
  - 12. bhp: Brake Horsepower
  - 13. Btu: British Thermal Unit
  - 14. Btu/h: British Thermal Unit Per Hour
  - 15. CDA: Copper Development Association
  - 16. C: Celsius
  - 17. CD: Compact Disk
  - 18. CFM: Cubic Foot Per Minute
  - 19. CH: Chilled Water Supply
  - 20. CHR: Chilled Water Return
  - 21. CLR: Color
  - 22. CO: Carbon Monoxide
  - 23. COR: Contracting Officer's Representative
  - 24. CPD: Condensate Pump Discharge
  - 25. CPM: Cycles Per Minute
  - 26. CPVC: Chlorinated Polyvinyl Chloride
  - 27. CRS: Corrosion Resistant Steel

- 28. CTPD: Condensate Transfer Pump Discharge
- 29. CTPS: Condensate Transfer Pump Suction
- 30. CW: Cold Water
- 31. CWP: Cold Working Pressure
- 32. CxA: Commissioning Agent
- 33. dB: Decibels
- 34. dB(A): Decibels (A weighted)
- 35. DDC: Direct Digital Control
- 36. DI: Digital Input
- 37. DO: Digital Output
- 38. DVD: Digital Video Disc
- 39. DN: Diameter Nominal
- 40. DWV: Drainage, Waste and Vent
- 41. EPDM: Ethylene Propylene Diene Monomer
- 42. EPT: Ethylene Propylene Terpolymer
- 43. ETO: Ethylene Oxide
- 44. F: Fahrenheit
- 45. FAR: Federal Acquisition Regulations
- 46. FD: Floor Drain
- 47. FED: Federal
- 48. FG: Fiberglass
- 49. FGR: Flue Gas Recirculation
- 50. FOS: Fuel Oil Supply
- 51. FOR: Fuel Oil Return
- 52. FSK: Foil-Scrim-Kraft facing
- 53. FWPD: Feedwater Pump Discharge
- 54. FWPS: Feedwater Pump Suction
- 55. GC: Chilled Glycol Water Supply
- 56. GCR: Chilled Glycol Water Return
- 57. GH: Hot Glycol Water Heating Supply
- 58. GHR: Hot Glycol Water Heating Return
- 59. gpm: Gallons Per Minute
- 60. HDPE: High Density Polyethylene
- 61. Hg: Mercury
- 62. HOA: Hands-Off-Automatic
- 63. hp: Horsepower
- 64. HPS: High Pressure Steam (414 kPa (60 psig) and above)

- 65. HPR: High Pressure Steam Condensate Return
- 66. HW: Hot Water
- 67. HWH: Hot Water Heating Supply
- 68. HWHR: Hot Water Heating Return
- 69. Hz: Hertz
- 70. ID: Inside Diameter
- 71. IPS: Iron Pipe Size
- 72. kg: Kilogram
- 73. klb: 1000 lb
- 74. kPa: Kilopascal
- 75. lb: Pound
- 76. lb/hr: Pounds Per Hour
- 77. L/s: Liters Per Second
- 78. L/min: Liters Per Minute
- 79. LPS: Low Pressure Steam (103 kPa (15 psig) and below)
- 80. LPR: Low Pressure Steam Condensate Gravity Return
- 81. MAWP: Maximum Allowable Working Pressure
- 82. MAX: Maximum
- 83. MBtu/h: 1000 Btu/h
- 84. MBtu: 1000 Btu
- 85. MED: Medical
- 86. m: Meter
- 87. MFG: Manufacturer
- 88. mg: Milligram
- 89. mg/L: Milligrams Per Liter
- 90. MIN: Minimum
- 91. MJ: Megajoules
- 92. ml: Milliliter
- 93. mm: Millimeter
- 94. MPS: Medium Pressure Steam (110 kPa (16 psig) through 414 kPa (60 psig))
- 95. MPR: Medium Pressure Steam Condensate Return
- 96. MW: Megawatt
- 97. NC: Normally Closed
- 98. NF: Oil Free Dry (Nitrogen)
- 99. Nm: Newton Meter
- 100. NO: Normally Open

- 101. NOx: Nitrous Oxide
- 102. NPT: National Pipe Thread
- 103. NPS: Nominal Pipe Size
- 104. OD: Outside Diameter
- 105. OSD: Open Sight Drain
- 106. OS&Y: Outside Stem and Yoke
- 107. PC: Pumped Condensate
- 108. PID: Proportional-Integral-Differential
- 109. PLC: Programmable Logic Controllers
- 110. PP: Polypropylene
- 111. PPE: Personal Protection Equipment
- 112. ppb: Parts Per Billion
- 113. ppm: Parts Per Million
- 114. PRV: Pressure Reducing Valve
- 115. PSIA: Pounds Per Square Inch Absolute
- 116. psig: Pounds Per Square Inch Gauge
- 117. PTFE: Polytetrafluoroethylene
- 118. PVC: Polyvinyl Chloride
- 119. PVDC: Polyvinylidene Chloride Vapor Retarder Jacketing, White
- 120. PVDF: Polyvinylidene Fluoride
- 121. rad: Radians
- 122. RH: Relative Humidity
- 123. RO: Reverse Osmosis
- 124. rms: Root Mean Square
- 125. RPM: Revolutions Per Minute
- 126. RS: Refrigerant Suction
- 127. RTD: Resistance Temperature Detectors
- 128. RTRF: Reinforced Thermosetting Resin Fittings
- 129. RTRP: Reinforced Thermosetting Resin Pipe
- 130. SCFM: Standard Cubic Feet Per Minute
- 131. SPEC: Specification
- 132. SPS: Sterile Processing Services
- 133. STD: Standard
- 134. SDR: Standard Dimension Ratio
- 135. SUS: Saybolt Universal Second
- 136. SW: Soft water
- 137. SWP: Steam Working Pressure



- 138. TAB: Testing, Adjusting, and Balancing
- 139. TDH: Total Dynamic Head
- 140. TEFC: Totally Enclosed Fan-Cooled
- 141. TFE: Tetrafluoroethylene
- 142. THERM: 100,000 Btu
- 143. THHN: Thermoplastic High-Heat Resistant Nylon Coated Wire
- 144. THWN: Thermoplastic Heat & Water-Resistant Nylon Coated Wire
- 145. T/P: Temperature and Pressure
- 146. USDA: U.S. Department of Agriculture
- 147. V: Volt
- 148. VAC: Vacuum
- 149. VA: Veterans Administration
- 150. VAC: Voltage in Alternating Current
- 151. VA CFM: VA Construction & Facilities Management
- 152. VA CFM CSS: VA Construction & Facilities Management, Consulting Support Service
- 153. VAMC: Veterans Administration Medical Center
- 154. VHA OCAMES: Veterans Health Administration - Office of Capital Asset Management Engineering and Support
- 155. VR: Vacuum condensate return
- 156. WCB: Wrought Carbon Steel, Grade B
- 157. WG: Water Gauge or Water Column
- 158. WOG: Water, Oil, Gas

## **1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 05 50 00, METAL FABRICATIONS.
- D. Section 07 84 00, FIRESTOPPING.
- E. Section 07 92 00, JOINT SEALANTS.
- F. Section 09 91 00, PAINTING.
- G. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION.
- H. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.
- I. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- J. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES.

**1.3 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. Where conflicts occur these specifications and the VHA standard shall govern.
- B. Air Movement and Control Association (AMCA):  
410-1996.....Recommended Safety Practices for Users and  
Installers of Industrial and Commercial Fans
- C. American Society of Mechanical Engineers (ASME):  
B31.1-2014.....Power Piping  
B31.9-2014.....Building Services Piping  
ASME Boiler and Pressure Vessel Code:  
BPVC Section IX-2015....Welding, Brazing, and Fusing Qualifications
- D. American Society for Testing and Materials (ASTM):  
A36/A36M-2014.....Standard Specification for Carbon Structural  
Steel  
A575-1996 (R2013)e1.....Standard Specification for Steel Bars, Carbon,  
Merchant Quality, M-Grades
- E. Association for Rubber Products Manufacturers (ARPM):  
IP-20-2015.....Specifications for Drives Using Classical  
V-Belts and Sheaves  
IP-21-2009.....Specifications for Drives Using Double-V  
(Hexagonal) Belts  
IP-24-2010.....Specifications for Drives Using Synchronous  
Belts  
IP-27-2015.....Specifications for Drives Using Curvilinear  
Toothed Synchronous Belts
- F. Manufacturers Standardization Society (MSS) of the Valve and Fittings  
Industry, Inc.:  
SP-58-2009.....Pipe Hangers and Supports—Materials, Design,  
Manufacture, Selection, Application, and  
Installation  
SP-127-2014a.....Bracing for Piping Systems: Seismic-Wind-  
Dynamic Design, Selection, and Application
- G. Military Specifications (MIL):  
MIL-P-21035B-2003.....Paint High Zinc Dust Content, Galvanizing  
Repair (Metric)

- H. National Fire Protection Association (NFPA):
  - 70-2014.....National Electrical Code (NEC)
  - 101-2015.....Life Safety Code
- I. Department of Veterans Affairs (VA):
  - PG-18-10-2016.....Physical Security and Resiliency Design Manual

**1.4 SUBMITTALS**

- A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 23 05 11, COMMON WORK RESULTS FOR HVAC", with applicable paragraph identification.
- C. If the project is phased submit complete phasing plan/schedule with manpower levels prior to commencing work. The phasing plan shall be detailed enough to provide milestones in the process that can be verified.
- D. Contractor shall make all necessary field measurements and investigations to assure that the equipment and assemblies will meet contract requirements, and all equipment that requires regular maintenance or calibration are accessible from the floor or permanent work platform. It is the Contractor's responsibility to ensure all submittals meet the VA specifications and requirements and it is assumed by the VA that all submittals do meet the VA specifications unless the Contractor has requested a variance in writing and approved by COR prior to the submittal. If at any time during the project it is found that any item does not meet the VA specifications and there was no variance approval, the Contractor shall correct at no additional cost or time to the Government even if a submittal was approved.
- E. If equipment is submitted which differs in arrangement from that shown, provide documentation proving equivalent performance, design standards and drawings that show the rearrangement of all associated systems. Additionally, any impacts on ancillary equipment or services such as foundations, piping, and electrical shall be the Contractor's responsibility to design, supply, and install at no additional cost or time to the Government. VA approval will be given only if all features of the equipment and associated systems, including accessibility, are equivalent to that required by the contract.

- F. Prior to submitting shop drawings for approval, Contractor shall certify in writing that manufacturers of all major items of equipment have each reviewed contract documents, and have jointly coordinated and properly integrated their equipment and controls to provide a complete and efficient installation.
- G. Submittals and shop drawings for interdependent items, containing applicable descriptive information, shall be furnished together. Coordinate and properly integrate materials and equipment to provide a completely compatible and efficient installation.
- H. Samples: Samples shall not be required, except where materials offered differ from specification requirements. Samples shall be accompanied by full description of characteristics different from specification. The Government, at the Government's expense, will perform evaluation and testing if necessary. The Contractor may submit samples of additional material at the Contractor's option; however, if additional samples of materials are submitted later, pursuant to Government request, adjustment in contract price and time shall be made.
- I. Coordination Drawings/Shop Drawings:
1. Submit complete consolidated and coordinated drawings and shop drawings for all new systems, and for existing systems that are in the same areas. In addition to MEP systems and building structural systems, coordination drawings shall include above ceiling specialty systems such as pneumatic tube systems and patient track lifts along with associated structure.
  2. Each Sub-Contractor is required by their respective specifications to prepare their own electronic coordination drawings using common backgrounds obtained from the Architect and Structural Engineer. The contractor shall be responsible for consolidating (merging) the drawings from all Sub-Contractors into combined coordination drawings, and shall lead the conflict resolution process with all Sub-Contractors working together to obtain finished coordinated drawings/fabrication drawings. No work shall be installed until all Sub-Contractors have approved and signed-off with their approval, and the coordination drawings have been submitted and reviewed by the Engineer and VA. Review by the Engineer and VA is cursory. It is the Contractors responsibilities to ensure that all work is

- coordinated, including fit above ceilings, and that specified ceiling heights are maintained.
3. The coordination drawings/shop drawings shall include plan views, elevations and sections of all systems and shall be on a scale of not less than 1:32 (3/8-inch equal to one foot). Clearly identify and dimension the proposed locations of the principal items of equipment. The drawings shall clearly show locations and adequate clearance for all equipment, ductwork, piping, valves, control panels and other items. Show the access means for all items requiring access for operations and maintenance. Provide detailed coordination drawings /shop drawings of all piping and duct systems. The drawings shall include all lockout/tagout points for all energy/hazard sources for each piece of equipment. Coordinate lockout/tagout procedures and practices with local VA requirements.
  4. Do not install equipment foundations, equipment, ductwork or piping until coordination/shop drawings have been approved.
  5. In addition, for HVAC systems, provide details of the following:
    - a. Mechanical equipment rooms.
    - b. Hangers, inserts, supports, and bracing.
    - c. Pipe sleeves.
    - d. Duct or equipment penetrations of floors, walls, ceilings, or roofs.
- J. Manufacturer's Literature and Data: Include full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity. Submit under the pertinent section rather than under this section.
1. Submit belt drive with the driven equipment.
  2. Submit electric motor data with the driven equipment.
    - a. Variable speed drive data for motors shall be submitted under the appropriate Division 26 Specification Section. Coordinate requirements with EC.
  3. Equipment and materials identification.
  4. Fire-stopping materials.
  5. Hangers, inserts, supports and bracing. Provide complete stress analysis for variable spring and constant support hangers.
  6. Wall, floor, and ceiling plates.

- K. Rigging Plan: Provide documentation of the capacity and weight of the rigging and equipment intended to be used. The plan shall include the path of travel of the load, the staging area and intended access, and qualifications of the operator and signal person.
- L. HVAC Maintenance Data and Operating Instructions:
1. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Article, INSTRUCTIONS, for systems and equipment.
  2. Complete operating and maintenance manuals including wiring diagrams, technical data sheets, information for ordering replacement parts, and troubleshooting guide:
    - a. Include complete list indicating all components of the systems.
    - b. Include complete diagrams of the internal wiring for each item of equipment.
    - c. Diagrams shall have their terminals identified to facilitate installation, operation and maintenance.
  3. Provide a listing of recommended replacement parts for keeping in stock supply, including sources of supply, for equipment. Include in the listing belts for equipment: Belt manufacturer, model number, size and style, and distinguished whether of multiple belt sets.
- M. Provide copies of approved HVAC equipment submittals to the TAB Subcontractors.

### **1.5 QUALITY ASSURANCE**

- A. Mechanical, electrical and associated systems shall be safe, reliable, efficient, durable, easily and safely operable and maintainable, easily and safely accessible, and in compliance with applicable codes as specified. The systems shall be comprised of high quality institutional-class and industrial-class products of manufacturers that are experienced specialists in the required product lines. All construction firms and personnel shall be experienced and qualified specialists in industrial and institutional HVAC.
- B. Products Criteria:
1. Standard Products: Material and equipment shall be the standard products of a manufacturer regularly engaged in the manufacture of the products for at least 3 years (or longer as specified elsewhere). The design, model and size of each item shall have been in satisfactory and efficient operation on at least three

- installations for approximately three years. However, digital electronics devices, software and systems such as controls, instruments, computer work station, shall be the current generation of technology and basic design that has a proven satisfactory service record of at least three years. See other specification sections for any exceptions and/or additional requirements.
2. Refer to all other sections for quality assurance requirements for systems and equipment specified therein.
  3. All items furnished shall be free from defects that would adversely affect the performance, maintainability and appearance of individual components and overall assembly.
  4. The products and execution of work specified in Division 23 shall conform to the referenced codes and standards as required by the specifications. Local codes and amendments shall be enforced, along with requirements of local utility companies. The most stringent requirements of these specifications, local codes, or utility company requirements shall always apply. Any conflicts shall be brought to the attention of the COR.
  5. Multiple Units: When two or more units of materials or equipment of the same type or class are required, these units shall be of the same manufacturer and model number, or if different models are required they shall be of the same manufacturer and identical to the greatest extent possible (i.e., same model series).
  6. Assembled Units: Performance and warranty of all components that make up an assembled unit shall be the responsibility of the manufacturer of the completed assembly.
  7. Nameplates: Nameplate bearing manufacturer's name or identifiable trademark shall be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.
  8. Use of asbestos products or equipment or materials containing asbestos is prohibited.
- C. HVAC Equipment Service Providers: Service providers shall be authorized and trained by the manufacturers of the equipment supplied. These providers shall be capable of responding onsite and provide acceptable service to restore equipment operations within 4 hours of receipt of notification by phone, e-mail or fax in event of an emergency, such as

the shutdown of equipment; or within 24 hours in a non-emergency. Submit names, mail and e-mail addresses and phone numbers of service personnel and companies providing service under these conditions for (as applicable to the project): fans, air handling units, chillers, cooling towers, control systems, pumps, critical instrumentation, computer workstation and programming.

- D. HVAC Mechanical Systems Welding: Before any welding is performed, Contractor shall submit a certificate certifying that welders comply with the following requirements:
1. Qualify welding processes and operators for piping according to ASME BPVC Section IX. Provide proof of current certification.
  2. Comply with provisions of ASME B31 series "Code for Pressure Piping".
  3. Certify that each welder and welding operator has passed American Welding Society (AWS) qualification tests for the welding processes involved, and that certification is current.
  4. All welds shall be stamped according to the provisions of the AWS or ASME as required herein and by the associated code.
- E. Manufacturer's Recommendations: Where installation procedures or any part thereof are required to be in accordance with the recommendations of the manufacturer of the material being installed, printed copies of these recommendations shall be furnished to the COR with submittals. Installation of the item shall not be allowed to proceed until the recommendations are received. Failure to furnish these recommendations can be cause for rejection of the material and removal by the Contractor at no additional cost or time to the Government.
- F. Execution (Installation, Construction) Quality:
1. Apply and install all items in accordance with manufacturer's written instructions. Refer conflicts between the manufacturer's instructions and the contract documents to the COR for resolution. Provide written hard copies and computer files on CD or DVD of manufacturer's installation instructions to the COR with submittals prior to commencing installation of any item. Installation of the item shall not be allowed to proceed until the recommendations are received and approved by the VA. Failure to furnish these recommendations is a cause for rejection of the material.



2. All items that require access, such as for operating, cleaning, servicing, maintenance, and calibration, shall be easily and safely accessible by persons standing at floor level, or standing on portable ladders or permanent platforms. Examples of these items include all types of valves, filters and strainers, transmitters, control devices. Prior to commencing installation work, refer conflicts between this requirement and contract documents to the COR for resolution. Failure of the Contractor to resolve, or point out any issues shall result in the Contractor correcting at no additional cost or time to the Government.
  3. Complete coordination drawings/shop drawings shall be required in accordance with Paragraph, SUBMITTALS. Construction work shall not start on any system until the coordination drawings/shop drawings have been approved by VA.
  4. Workmanship/craftsmanship shall be of the highest quality and standards. The VA reserves the right to reject any work based on poor quality of workmanship this work shall be removed and done again at no additional cost or time to the Government.
- G. Upon request by Government, provide lists of previous installations for selected items of equipment. Include contact persons who shall serve as references, with current telephone numbers and e-mail addresses.
- H. Guaranty: Warranty of Construction, FAR Clause 52.246-21.

#### **1.6 DELIVERY, STORAGE AND HANDLING**

- A. Protection of Equipment:
1. Equipment and material placed on the job site shall remain in the custody of the Contractor until phased acceptance, whether or not the Government has reimbursed the Contractor for the equipment and material. The Contractor is solely responsible for the protection of such equipment and material against any damage or theft.
  2. Large equipment such as boilers, chillers, cooling towers, fans, and air handling units if shipped on open trailer trucks shall be covered with shrink on plastics or water proof tarpaulins that provide protection from exposure to rain, road salts and other transit hazards. Protection shall be kept in place until equipment is moved into a building or installed as designed.
  3. Repair damaged equipment in first class, new operating condition and appearance; or, replace same as determined and directed by the COR.

Such repair or replacement shall be at no additional cost or time to the Government.

4. Protect interiors of new equipment, ductwork and piping systems against entry of foreign matter. Clean both inside and outside before painting or placing in operation.
5. Existing equipment, ductwork and piping being worked on by the Contractor shall be under the custody and responsibility of the Contractor and shall be protected as required for new work.
6. Protect plastic piping and tanks from ultraviolet light (sunlight).

B. Cleanliness of Piping and Equipment Systems:

1. Exercise care in storage and handling of equipment, ductwork and piping material to be incorporated in the work. Remove debris arising from cutting, threading and welding of piping.
2. Piping systems shall be flushed, blown or pigged as necessary to deliver clean systems.
3. Contractor shall be fully responsible for all costs, damage, and delay arising from failure to provide clean systems.

**1.7 AS-BUILT DOCUMENTATION**

- A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.
- B. Submit operation and maintenance data updated to include submittal review comments, VA approved substitutions and construction revisions shall be in electronic version on CD or DVD. All aspects of system operation and maintenance procedures, including applicable piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices shall be included. A List of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.
- C. The installing Contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. Should the installing Contractor engage the testing company to provide as-built or

any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement. Provide record drawings as follows:

1. Red-lined, hand-marked drawings shall be provided, with one paper copy and a scanned PDF version of the hand-marked drawings provided on CD or DVD.
- D. The as-built drawings shall indicate the location and type of all lockout/tagout points for all energy sources for all equipment and pumps to include all relevant information such as breaker location and numbers and valve tag numbers. Coordinate lockout/tagout procedures and practices with local VA requirements.
- E. Certification documentation shall be provided to COR 21 working days prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and provide documentation/certification that all results of tests were within limits specified. Test results shall contain written sequence of test procedure with written test results annotated at each step along with the expected outcome or setpoint. The results shall include all readings, data on device (make, model and performance characteristics), normal pressures, switch ranges, trip points, amp readings, and calibration data to include equipment serial numbers or individual identifications.

#### **1.8 JOB CONDITIONS - WORK IN EXISTING BUILDING**

- A. Building Operation: Government employees will be continuously operating and managing all facilities, including temporary facilities that serve the VAMC.
- B. Maintenance of Service: Schedule all work to permit continuous service as required by the VAMC.
- C. Steam and Condensate Service Interruptions: Limited steam and condensate service interruptions, as required for interconnections of new and existing systems, shall be permitted by the COR during periods when the demands are not critical to the operation of the VAMC. These non-critical periods are limited to between 8 pm and 5 am in the appropriate off-season (if applicable). Provide at least 10 working days advance notice to the COR. The request shall include a detailed plan on the proposed shutdown and the intended work to be done along

with manpower levels. All equipment and materials shall be onsite and verified with plan 5days prior to the shutdown or it will need to be rescheduled.

- D. Phasing of Work: Comply with all requirements shown on contract documents. Contractor shall submit a complete detailed phasing plan/schedule with manpower levels prior to commencing work. The phasing plan shall be detailed enough to provide milestones in the process that can be verified.
- E. Building Working Environment: Maintain the architectural and structural integrity of the building and the working environment at all times. Maintain the interior of building at 18 degrees C (65 degrees F) minimum. Limit the opening of doors, windows or other access openings to brief periods as necessary for rigging purposes. Storm water or ground water leakage is prohibited. Provide daily clean-up of construction and demolition debris on all floor surfaces and on all equipment being operated by VA. Maintain all egress routes and safety systems/devices.
- F. Acceptance of Work for Government Operation: As new equipment, systems and facilities are made available for operation and these items are deemed of beneficial use to the Government, inspections will be made and tests will be performed. Based on the inspections, a list of contract deficiencies will be issued to the Contractor. After correction of deficiencies as necessary for beneficial use, the Contracting Officer will process necessary acceptance and the equipment will then be under the control and operation of Government personnel.

## **PART 2 - PRODUCTS**

### **2.1 FACTORY-ASSEMBLED PRODUCTS**

- A. Provide maximum standardization of components to reduce spare part requirements.
- B. Performance and warranty of all components that make up an assembled unit shall be the responsibility of the manufacturer of the completed assembly.
  - 1. All components of an assembled unit need not be products of same manufacturer.
  - 2. Constituent parts that are alike shall be products of a single manufacturer.

3. Components shall be compatible with each other and with the total assembly for intended service.
  4. Contractor shall guarantee performance of assemblies of components, and shall repair or replace elements of the assemblies as required to deliver specified performance of the complete assembly.
- C. Equipment and components of equipment shall bear manufacturer's name and trademark, model number, serial number and performance data on a nameplate securely affixed in a conspicuous place, or cast integral with, stamped or otherwise permanently marked upon the components of the equipment.
- D. Major items of equipment, which serve the same function, shall be the same make and model. Exceptions must be approved by the VA, but may be permitted if performance requirements cannot be met.

## **2.2 COMPATIBILITY OF RELATED EQUIPMENT**

- A. Equipment and materials installed shall be compatible in all respects with other items being furnished and with existing items so that the result will be a complete and fully operational plant that conforms to contract requirements.

## **2.3 V-BELT DRIVES**

- A. Type: ARPM standard V-belts with proper motor pulley and driven sheave. Belts shall be constructed of reinforced cord and rubber.
- B. Dimensions, rating and selection standards: ARPM IP-20 and ARPM IP-21.
- C. Minimum Horsepower Rating: Motor horsepower plus recommended ARPM service factor (not less than 20 percent) in addition to the ARPM allowances for pitch diameter, center distance, and arc of contact.
- D. Maximum Speed: 25 m/s (5000 feet per minute).
- E. Adjustment Provisions: For alignment and ARPM standard allowances for installation and take-up.
- F. Drives may utilize a single V-Belt (any cross section) when it is the manufacturer's standard.
- G. Multiple Belts: Matched to ARPM specified limits by measurement on a belt measuring fixture. Seal matched sets together to prevent mixing or partial loss of sets. Replacement, when necessary, shall be an entire set of new matched belts.
- H. Sheaves and Pulleys:
1. Material: Pressed steel, or close-grained cast iron.
  2. Bore: Fixed or bushing type for securing to shaft with keys.

3. Balanced: Statically and dynamically.
  4. Groove spacing for driving and driven pulleys shall be the same.
- I. Drive Types, Based on ARI 435:
1. Provide adjustable-pitch drive as follows:
    - a. Fan speeds up to 1800 RPM: 7.5 kW (10 horsepower) and smaller.
    - b. Fan speeds over 1800 RPM: 2.2 kW (3 horsepower) and smaller.
  2. Provide fixed-pitch drives for drives larger than those listed above.
  3. The final fan speeds required to just meet the system CFM and pressure requirements, without throttling the design air flow branch, shall be determined by adjustment of a temporary adjustable-pitch motor sheave or by fan law calculation if a fixed-pitch drive is used initially.
- J. Final Drive Set: If adjustment is required beyond the capabilities of the factory drive set, the final drive set shall be provided as part of this contract at no additional cost or time to the Government.

#### **2.4 SYNCHRONOUS BELT DRIVES**

- A. Type: ARPM synchronous belts with proper motor pulley and driven sheave. Belts shall be constructed of reinforced cord and rubber.
- B. Dimensions, rating and selection standards: ARPM IP-24 and ARPM IP-27.
- C. Minimum Horsepower Rating: Motor horsepower plus recommended ARPM service factor (not less than 20 percent) in addition to the ARPM allowances for pitch diameter, center distance, and arc of contact.
- D. Maximum Speed: 25 m/s (5000 feet per minute).
- E. Adjustment Provisions: For alignment and ARPM standard allowances for installation and take-up.
- F. Drives may utilize a single belt of manufacturer's standard width for the application.
- G. Multiple Belts: Matched to ARPM specified limits by measurement on a belt measuring fixture. Seal matched sets together to prevent mixing or partial loss of sets. Replacement, when necessary, shall be an entire set of new matched belts.
- H. Sheaves and Pulleys:
  1. Material: Pressed steel, or close-grained cast iron.
  2. Bore: Fixed or bushing type for securing to shaft with keys.
  3. Balanced: Statically and dynamically.

- I. Final Drive Set: The final fan speeds required to just meet the system CFM and pressure requirements, without throttling the design air flow branch, shall be determined by fan law calculation. If adjustment is required beyond the capabilities of the factory drive set, the final drive set shall be provided as part of this contract at no additional cost or time to the Government.

## **2.5 DRIVE GUARDS**

- A. For machinery and equipment, provide guards as shown in AMCA 410 for belts, chains, couplings, pulleys, sheaves, shafts, gears and other moving parts regardless of height above the floor to prevent damage to equipment and injury to personnel. Drive guards may be excluded where motors and drives are inside factory-fabricated air handling unit casings.
- B. Pump shafts and couplings shall be fully guarded by a sheet steel guard, covering coupling and shaft but not bearings. Material shall be minimum 16-gauge sheet steel; all edges shall be hemmed and ends shall be bent into flanges and the flanges shall be drilled and attached to pump base with minimum of four 6 mm (1/4 inch) bolts. Reinforce guard as necessary to prevent side play forcing guard onto couplings.
- C. V-belt and sheave assemblies shall be totally enclosed, firmly mounted, non-resonant. Guard shall be an assembly of minimum 22-gauge sheet steel and expanded or perforated metal to permit observation of belts. 25 mm (1 inch) diameter hole shall be provided at each shaft centerline to permit speed measurement.
- D. Materials: Sheet steel, expanded metal or wire mesh rigidly secured so as to be removable without disassembling pipe, duct, or electrical connections to equipment.
- E. Access for Speed Measurement: 25 mm (1 inch) diameter hole at each shaft center.

## **2.6 LIFTING ATTACHMENTS**

- A. Provide equipment with suitable lifting attachments to enable equipment to be lifted in its normal position. Lifting attachments shall withstand any handling conditions that might be encountered, without bending or distortion of shape, such as rapid lowering and braking of load.

## **2.7 ELECTRIC MOTORS**

- A. All material and equipment furnished and installation methods shall conform to the requirements of Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT; and, Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES. Provide all electrical wiring, conduit, and devices necessary for the proper connection, protection and operation of the systems. Provide special energy efficient premium efficiency type motors as scheduled.

## **2.8 EQUIPMENT AND MATERIALS IDENTIFICATION**

- A. Use symbols, nomenclature and equipment numbers specified, shown on the contract documents and shown in the maintenance manuals. Identification for piping and ductwork is specified in Paragraph 3.8 below.
- B. Interior (Indoor) Equipment: Engraved nameplates, with letters not less than 5 mm (3/16 inch) high of brass with black-filled letters, or rigid black plastic with white letters permanently fastened to the equipment. Identify unit components such as coils, filters, or fans.
- C. Exterior (Outdoor) Equipment: Brass nameplates, with engraved black filled letters, not less than 5 mm (3/16 inch) high riveted or bolted to the equipment.
- D. Control Items: Label all instrumentation, temperature and humidity sensors, controllers and control dampers. Identify and label each item as they appear on the control diagrams.
- E. Valve Tags and Lists:
1. HVAC and Mechanical Rooms: Provide for all valves.
  2. Valve tags: Engraved black filled numbers and letters not less than 15 mm (1/2 inch) high for number designation, and not less than 6 mm (1/4 inch) for service designation on 19-gauge 40 mm (1-1/2 inches) round brass disc, attached with brass "S" hook or brass chain.
  3. Valve lists: Typed or printed plastic coated card(s), sized 215 mm (8-1/2 inches) by 275 mm (11 inches) showing tag number, valve function and area of control, for each service or system. Punch sheets for a 3-ring notebook.
  4. Provide detailed plan for each floor of the building indicating the location and valve number for each valve. Identify location of each valve with a color-coded thumb tack in ceiling.
- F. Ceiling Grid Labels:



1. 50 mm (2 inch) long by 15 mm (1/2 inch) wide by 0.025 mm (1 mil) thick UV resistant metalized polyester label with red border color and black custom lettering on white background interior. Peel and stick adhesive backing. Label and adhesive manufactured specifically for use in equipment inventory tagging.
2. Custom print labels with above ceiling HVAC equipment numbers.

## **2.9 FIRESTOPPING**

- A. Section 07 84 00, FIRESTOPPING specifies an effective barrier against the spread of fire, smoke and gases where penetrations occur for piping and ductwork.

## **2.10 GALVANIZED REPAIR COMPOUND**

- A. Mil-P-21035B, paint form.

## **2.11 HVAC PIPE AND EQUIPMENT SUPPORTS AND RESTRAINTS**

- A. Vibration Isolators: Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- B. Supports for Roof Mounted Items:
  1. Equipment: Equipment rails shall be galvanized steel, minimum 1.3 mm (18 gauge), with integral baseplate, continuous welded corner seams, factory installed 50 by 100 mm (2 by 4 inches) treated wood nailer, 1.3 mm (18 gauge) galvanized steel counter flashing cap with screws, built-in cant strip, (except for gypsum or tectum deck), minimum height 275 mm (11 inches). For surface insulated roof deck, provide raised cant strip to start at the upper surface of the insulation.
  2. Pipe/duct pedestals: Provide a galvanized Unistrut channel welded to U-shaped mounting brackets which are secured to side of rail with galvanized lag bolts.
- C. Pipe Supports: Comply with MSS SP-58. Type Numbers specified refer to this standard. For selection and application comply with MSS SP-58. Refer to Section 05 50 00, METAL FABRICATIONS, for miscellaneous metal support materials and prime coat painting requirements.
- D. Attachment to Concrete Building Construction:
  1. Concrete insert: MSS SP-58, Type 18.
  2. Self-drilling expansion shields and machine bolt expansion anchors: Permitted in concrete not less than 100 mm (4 inches) thick when approved by the COR for each job condition.
  3. Power-driven fasteners: Not permitted.
- E. Attachment to Steel Building Construction:

1. Welded attachment: MSS SP-58, Type 22.
  2. Beam clamps: MSS SP-58, Types 20, 21, 28 or 29. Type 23 C-clamp may be used for individual copper tubing up to 23 mm (7/8 inch) outside diameter.
- F. Attachment to existing structure: Support from existing floor/roof frame.
- G. Attachment to Wood Construction: Wood screws or lag bolts.
- H. Hanger Rods: Hot-rolled steel, ASTM A36/A36M or ASTM A575 for allowable load listed in MSS SP-58. For piping, provide adjustment means for controlling level or slope. Types 13 or 15 turn-buckles shall provide 40 mm (1-1/2 inches) minimum of adjustment and incorporate locknuts. All-thread rods are acceptable.
- I. Hangers Supporting Multiple Pipes (Trapeze Hangers): Galvanized, cold formed, lipped steel channel horizontal member, not less than 41 mm by 41 mm (1-5/8 inches by 1-5/8 inches), 2.7 mm (12 gauge), designed to accept special spring held, hardened steel nuts. Trapeze hangers are prohibited for use for steam supply and condensate piping.
1. Allowable hanger load: Manufacturers rating less 91 kg (200 pounds).
  2. Guide individual pipes on the horizontal member of every other trapeze hanger with 6 mm (1/4 inch) U-bolt fabricated from steel rod. Provide Type 40 insulation shield, secured by two 15 mm (1/2 inch) galvanized steel bands, or preinsulated calcium silicate shield for insulated piping at each hanger.
- J. Supports for Piping Systems:
1. Select hangers sized to encircle insulation on insulated piping. Refer to Section 23 07 11, HVAC AND BOILER PLANT INSULATION for insulation thickness. To protect insulation, provide Type 39 saddles for roller type supports or preinsulated calcium silicate shields. Provide Type 40 insulation shield or preinsulated calcium silicate shield at all other types of supports and hangers including those for preinsulated piping.
  2. Piping Systems except High and Medium Pressure Steam Supply and High and Medium Pressure Condensate Return (MSS SP-58):
    - a. Standard clevis hanger: Type 1; provide locknut.
    - b. Riser clamps: Type 8.
    - c. Wall brackets: Types 31, 32 or 33.
    - d. Roller supports: Type 41, 43, 44 and 46.

- e. Saddle support: Type 36, 37 or 38.
  - f. Turnbuckle: Types 13 or 15. Preinsulate.
  - g. U-bolt clamp: Type 24.
  - h. Copper Tube:
    - 1) Hangers, clamps and other support material in contact with tubing shall be painted with copper colored epoxy paint, plastic coated or taped with non-adhesive isolation tape to prevent electrolysis.
    - 2) For vertical runs use epoxy painted or plastic-coated riser clamps.
    - 3) For supporting tube to strut: Provide epoxy painted pipe straps for copper tube or plastic inserted vibration isolation clamps.
    - 4) Insulated Lines: Provide pre-insulated calcium silicate shields sized for copper tube.
  - i. Supports for plastic piping: As recommended by the pipe manufacturer with black rubber tape extending one inch beyond steel support or clamp.
3. High and Medium Pressure Steam Supply and High and Medium Pressure Condensate Return (MSS SP-58):
- a. Provide eye rod or Type 17 eye nut near the upper attachment.
  - b. Piping 50 mm (2 inches) and larger: Type 43 roller hanger. For roller hangers requiring seismic bracing provide a Type 1 clevis hanger with Type 41 roller attached by flat side bars.
  - c. Piping with Vertical Expansion and Contraction:
    - 1) Movement up to 20 mm (3/4 inch): Type 51 or 52 variable spring unit with integral turn buckle and load indicator.
    - 2) Movement more than 20 mm (3/4 inch): Type 54 or 55 constant support unit with integral adjusting nut, turn buckle and travel position indicator.
4. Convertor and Expansion Tank Hangers: Shall be Type 1 sized for the shell diameter. Insulation where required shall cover the hangers.

## **2.12 PIPE PENETRATIONS**

- A. Install sleeves during construction for other than blocked out floor openings for risers in mechanical bays.
- B. To prevent accidental liquid spills from passing to a lower level, provide the following:

1. For sleeves: Extend sleeve 25 mm (1 inch) above finished floor and provide sealant for watertight joint.
  2. For blocked out floor openings: Provide 40 mm (1-1/2 inch) angle set in silicone adhesive around opening.
  3. For drilled penetrations: Provide 40 mm (1-1/2 inch) angle ring or square set in silicone adhesive around penetration.
- C. Penetrations through beams or ribs are prohibited, but may be installed in concrete beam flanges. Any deviation from these requirements must receive prior approval of COR.
- D. Sheet Metal, Plastic, or Moisture-resistant Fiber Sleeves: Provide for pipe passing through floors, interior walls, and partitions, unless brass or steel pipe sleeves are specifically called for below.
- E. Cast Iron or Zinc Coated Pipe Sleeves: Provide for pipe passing through exterior walls below grade. Make space between sleeve and pipe watertight with a modular or link rubber seal. Seal shall be applied at both ends of sleeve.
- F. Galvanized Steel or an alternate Black Iron Pipe with asphalt coating Sleeves: Provide for pipe passing through concrete beam flanges, except where brass pipe sleeves are called for. Provide sleeve for pipe passing through floor of mechanical rooms, laundry work rooms, and animal rooms above basement. Except in mechanical rooms, connect sleeve with floor plate.
- G. Brass Pipe Sleeves: Provide for pipe passing through quarry tile, terrazzo or ceramic tile floors. Connect sleeve with floor plate.
- H. Sleeves are not required for wall hydrants for fire department connections or in drywall construction.
- I. Sleeve Clearance: Sleeve through floors, walls, partitions, and beam flanges shall be one inch greater in diameter than external diameter of pipe. Sleeve for pipe with insulation shall be large enough to accommodate the insulation. Interior openings shall be caulked tight with fire stopping material and sealant to prevent the spread of fire, smoke, and gases.
- J. Sealant and Adhesives: Shall be as specified in Section 07 92 00, JOINT SEALANTS.

## **2.13 DUCT AND PIPE PENETRATIONS**

- A. Provide curbs for roof mounted piping, ductwork and equipment. Curbs shall be 450 mm (18 inches) high with continuously welded seams, built-

in cant strip, interior baffle with acoustic insulation, curb bottom, hinged curb adapter.

- B. Provide firestopping for openings through fire and smoke barriers, maintaining minimum required rating of floor, ceiling or wall assembly. See section 07 84 00, FIRESTOPPING.

#### **2.14 SPECIAL TOOLS AND LUBRICANTS**

- A. Furnish, and turn over to the COR, tools not readily available commercially, that are required for disassembly or adjustment of equipment and machinery furnished.
- B. Grease Guns with Attachments for Applicable Fittings: One for each type of grease required for each motor or other equipment.
- C. Refrigerant Tools: Provide system charging/Evacuation equipment, gauges, fittings, and tools required for maintenance of furnished equipment.
- D. Tool Containers: Hardwood or metal, permanently identified for intended service and mounted, or located, where directed by the COR.
- E. Lubricants: A minimum of 0.95 L (1 quart) of oil, and 0.45 kg (1 pound) of grease, of equipment manufacturer's recommended grade and type, in unopened containers and properly identified as to use for each different application.

#### **2.15 WALL, FLOOR AND CEILING PLATES**

- A. Material and Type: Chrome plated brass or chrome plated steel, one piece or split type with concealed hinge, with set screw for fastening to pipe, or sleeve. Use plates that fit tight around pipes, cover openings around pipes and cover the entire pipe sleeve projection.
- B. Thickness: Not less than 2.4 mm (3/32 inch) for floor plates. For wall and ceiling plates, not less than 0.64 mm (0.025 inch) for up to 80 mm (3-inch pipe), 0.89 mm (0.035 inch) for larger pipe.
- C. Locations: Use where pipe penetrates floors, walls and ceilings in exposed locations, in finished areas only. Provide a watertight joint in spaces where brass or steel pipe sleeves are specified.

#### **2.16 ASBESTOS**

- A. Materials containing asbestos are prohibited.

#### **2.17 ELECTRICAL REQUIREMENTS FOR HVAC EQUIPMENT**

- A. Motors, starters, disconnects, devices, fuses, wiring and other electrical work shall be factory installed or furnished and field installed as specified in the various specification sections and as

shown on the drawings. Refer to the project documents for requirements related to each trade. Coordinate all aspects of electrical components and wiring to complete the systems.

- B. Equipment control panels containing power control components shall be marked with the minimum SCCR rating. The rating shall not be less than the available fault current. Refer to the electrical drawings for the calculated available fault at the distribution panel, MCC or panelboard serving the equipment. Include confirmation of being protected from the fault current in the equipment shop drawing submittal.
- C. Note: Equipment with Electronically Commutated Motors (ECM's) are sometimes factory programmed to limit current draw to the motor, to limit the available brake horsepower to better match specified performance and reduce required power circuiting. This reduced brake horsepower is likely below the motor's nameplate rating. The electrical design documents shall be sized based on the ECM's nameplate motor horsepower. The equipment supplier shall notify the contractor and the Engineer if the maximum overcurrent protection on the design documents differs from their selected equipment's nameplate data. Any required revisions to the electrical circuiting, including maximum over-current protection devices, shall be documented on the shop drawing submittal. The required revisions shall be forwarded to the contractor with enough time to adjust the over-current protection and the electric circuit installation. However, any additional cost associated with increased electrical feeder/breaker sizes or lack of coordination listed above shall be the contractor's responsibility.
- D. Refer to the Electrical drawings and verify adequacy of feeder size, sets of conductors and size, disconnecting means and other electrical requirements. Compare these to the requirements of the equipment to be furnished and report deficiencies and / or discrepancies to the Engineer in the bid period for resolution by addendum. Bear all costs for electrical changes where such issues are not properly resolved.

### **PART 3 - EXECUTION**

#### **3.1 GENERAL**

- A. If an installation is unsatisfactory to the COR, the Contractor shall correct the installation at no additional cost or time to the Government.

### **3.2 ARRANGEMENT AND INSTALLATION OF EQUIPMENT AND PIPING**

- A. Location of piping, sleeves, inserts, hangers, and equipment, access provisions shall be coordinated with the work of all trades. The coordination drawings/shop drawings shall be submitted for review. Locate piping, sleeves, inserts, hangers, ductwork and equipment clear of windows, doors, openings, light outlets, and other services and utilities. Equipment coordination drawings/shop drawings shall be prepared to coordinate proper location and personnel access of all facilities. The drawings shall be submitted for review. Follow manufacturer's published recommendations for installation methods not otherwise specified.
- B. Operating Personnel Access and Observation Provisions: Select and arrange all equipment and systems to provide clear view and easy access for maintenance and operation of all devices including, but not limited to: all equipment items, valves, filters, strainers, transmitters, sensors, control devices. All gauges and indicators shall be clearly visible by personnel standing on the floor or on portable ladders or permanent platforms. Do not reduce or change maintenance and operating space and access provisions that are shown on the contract documents.
- C. Equipment and Piping Support: Coordinate structural systems necessary for pipe and equipment support with pipe and equipment locations to permit proper installation.
- D. Location of pipe sleeves, trenches and chases shall be accurately coordinated with equipment and piping locations.
- E. Cutting Holes:
1. Cut holes through concrete and masonry by rotary core drill. Pneumatic hammer, impact electric, and hand or manual hammer type drill is prohibited, except as permitted by COR where working area space is limited.
  2. Locate holes to avoid interference with structural members such as slabs, columns, ribs, beams or reinforcing. Holes shall be laid out in advance and drilling done only after approval by COR. If the Contractor considers it necessary to drill through structural members, this matter shall be referred to COR for approval.
  3. Do not penetrate membrane waterproofing.

- F. Minor Piping: Generally, small diameter pipe runs from drips and drains, water cooling, and other service are not shown but shall be provided.
- G. Electrical Interconnection of Instrumentation or Controls: This generally not shown but shall be provided. This includes interconnections of sensors, transmitters, transducers, control devices, control and instrumentation panels, instruments and computer workstations. Devices shall be located so they are easily accessible for testing, maintenance, and calibration. The COR has the final determination on what is accessible and what is not. Comply with NFPA 70.
- H. Protection and Cleaning:
1. Equipment and materials shall be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations and as approved by the COR. Damaged or defective items in the opinion of the COR, shall be replaced.
  2. Protect all finished parts of equipment, such as shafts and bearings where accessible, from rust prior to operation by means of protective grease coating and wrapping. Close pipe openings with caps or plugs during installation. Tightly cover and protect fixtures and equipment against dirt, water chemical, or mechanical injury. At completion of all work thoroughly clean fixtures, exposed materials and equipment.
- I. Install gauges, thermometers, valves and other devices with due regard for ease in reading or operating and maintaining said devices. Locate and position thermometers and gauges to be easily read by operator or staff standing on floor or walkway provided. Servicing shall not require dismantling adjacent equipment or pipe work.
- J. Install steam piping expansion joints as per manufacturer's recommendations.
- K. Work in Existing Building:
1. Perform as specified in Article, OPERATIONS AND STORAGE AREAS, Article, ALTERATIONS, and Article, RESTORATION of the Section 01 00 00, GENERAL REQUIREMENTS for relocation of existing equipment, alterations and restoration of existing building(s).



2. As specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, OPERATIONS AND STORAGE AREAS, make alterations to existing service piping at times that will least interfere with normal operation of the facility.
- L. Switchgear/Electrical Equipment Drip Protection: Every effort shall be made to eliminate the installation of pipe above electrical and data/telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints. Installation of piping, ductwork, leak protection apparatus or other installations foreign to the electrical installation shall not be located in the space equal to the width and depth of the equipment and extending from to a height of 1.8 m (6 feet) above the equipment or to ceiling structure, whichever is lower (NFPA 70).
- M. Inaccessible Equipment:
1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance or inspections, equipment shall be removed and reinstalled or remedial action performed as directed at no additional cost or time to the Government.
  2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as, but not limited to motors, fans, pumps, belt guards, transformers, high voltage lines, conduit and raceways, piping, hot surfaces, and ductwork. The COR has final determination on whether an installation meets this requirement or not.

### **3.3 RIGGING**

- A. Design is based on application of available equipment. Openings in building structures are planned to accommodate design scheme.
- B. Alternative methods of equipment delivery may be offered by Contractor and will be considered by Government under specified restrictions of phasing and maintenance of service requirements as well as structural integrity of the building.
- C. Close all openings in the building when not required for rigging operations to maintain proper environment in the facility for Government operation and maintenance of service.

- D. Contractor shall provide all facilities required to deliver specified equipment and place on foundations. Attachments to structures for rigging purposes and support of equipment on structures shall be Contractor's full responsibility. Upon request, the Government will check structure adequacy and advise Contractor of recommended restrictions.
- E. Contractor shall check all clearances, weight limitations and shall offer a rigging plan designed by a Registered Professional Engineer. All modifications to structures, including reinforcement thereof, shall be at Contractor's cost, time and responsibility.
- F. Rigging plan and methods shall be referred to COR for evaluation prior to actual work. Follow approved rigging plan.
- G. Restore building to original condition upon completion of rigging work.

#### **3.4 PIPE AND EQUIPMENT SUPPORTS**

- A. Where hanger spacing does not correspond with joist or rib spacing, use structural steel channels designed by a structural engineer, secured directly to joist and rib structure that shall correspond to the required hanger spacing, and then suspend the equipment and piping from the channels. Drill or burn holes in structural steel only with the prior approval of the COR.
- B. Use of chain pipe supports; wire or strap hangers; wood for blocking, stays and bracing; or, hangers suspended from piping above are prohibited. Replace or thoroughly clean rusty products and paint with zinc primer.
- C. Hanger rods shall be used that are straight and vertical. Turnbuckles for vertical adjustments may be omitted where limited space prevents use. Provide a minimum of 15 mm (1/2 inch) clearance between pipe or piping covering and adjacent work.
- D. HVAC Horizontal Pipe Support Spacing: Refer to MSS SP-58. Provide additional supports at valves, strainers, in-line pumps and other heavy components. Provide a support within one foot of each elbow.
- E. HVAC Vertical Pipe Supports:
  - 1. Up to 150 mm (6-inch pipe), 9 m (30 feet) long, bolt riser clamps to the pipe below couplings, or welded to the pipe and rests supports securely on the building structure.
  - 2. Vertical pipe larger than the foregoing, support on base elbows or tees, or substantial pipe legs extending to the building structure.

F. Overhead Supports:

1. The basic structural system of the building is designed to sustain the loads imposed by equipment and piping to be supported overhead.
2. Provide steel structural members, in addition to those shown, of adequate capability to support the imposed loads, located in accordance with the final approved layout of equipment and piping.
3. Tubing and capillary systems shall be supported in channel troughs.

G. Floor Supports:

1. Provide concrete bases, concrete anchor blocks and pedestals, and structural steel systems for support of equipment and piping. Concrete bases and structural systems shall be anchored and doweled to resist forces under operating and seismic conditions (if applicable) without excessive displacement or structural failure.
2. Bases and supports shall not be located and installed until equipment mounted thereon has been approved. Bases shall be sized to match equipment mounted thereon plus 50 mm (2 inch) excess on all edges. Chiller foundations shall have horizontal dimensions that exceed chiller base frame dimensions by at least 150 mm (6 inches) on all sides. Structural contract documents shall be reviewed for additional requirements. Bases shall be neatly finished and smoothed, shall have chamfered edges at the top, and shall be suitable for painting.
3. All equipment shall be shimmed, leveled, firmly anchored, and grouted with epoxy grout. Anchor bolts shall be placed in sleeves, anchored to the bases. Fill the annular space between sleeves and bolts with a granular material to permit alignment and realignment.

**3.5 MECHANICAL DEMOLITION**

- A. Rigging access, other than indicated on the contract documents, shall be provided by the Contractor after approval for structural integrity by the COR. Such access shall be provided without additional cost or time to the Government. Where work is in an operating plant, provide approved protection from dust and debris at all times for the safety of plant personnel and maintenance of plant operation and environment of the plant.
- B. In an operating facility, maintain the operation, cleanliness and safety. Government personnel will be carrying on their normal duties of operating, cleaning and maintaining equipment and plant operation.

Confine the work to the immediate area concerned; maintain cleanliness and wet down demolished materials to eliminate dust. Debris accumulated in the area to the detriment of plant operation is prohibited. Perform all flame cutting to maintain the fire safety integrity of this plant. Adequate fire extinguishing facilities shall be available at all times. Perform all work in accordance with recognized fire protection standards. Inspection will be made by personnel of the VAMC, and Contractor shall follow all directives of the COR with regard to rigging, safety, fire safety, and maintenance of operations.

- C. All indicated valves including gate, globe, ball, butterfly and check, all pressure gauges and thermometers with wells shall remain Government property and shall be removed and delivered to COR and stored as directed. The Contractor shall remove all other material and equipment, devices and demolition debris under these contract documents. Such material shall be removed from Government property expeditiously and shall not be allowed to accumulate.

### **3.6 CLEANING AND PAINTING**

- A. Prior to final inspection and acceptance of the plant and facilities for beneficial use by the Government, the plant facilities, equipment and systems shall be thoroughly cleaned and painted. Refer to Section 09 91 00, PAINTING.
- B. In addition, the following special conditions apply:
1. Cleaning shall be thorough. Solvents, cleaning materials and methods recommended by the manufacturers shall be used for the specific tasks. All rust shall be removed prior to painting and from surfaces to remain unpainted. Repair scratches, scuffs, and abrasions prior to applying prime and finish coats.
  2. The following material and equipment shall not be painted:
    - a. Motors, controllers, control switches, and safety switches.
    - b. Control and interlock devices.
    - c. Regulators.
    - d. Pressure reducing valves.
    - e. Control valves and thermostatic elements.
    - f. Lubrication devices and grease fittings.
    - g. Copper, brass, aluminum, stainless steel and bronze surfaces.
    - h. Valve stems and rotating shafts.
    - i. Pressure gauges and thermometers.

- j. Glass.
- k. Nameplates.
- 3. Control and instrument panels shall be cleaned, damaged surfaces repaired, and shall be touched-up with matching paint obtained from panel manufacturer.
- 4. Pumps, motors, steel and cast-iron bases, and coupling guards shall be cleaned, and shall be touched-up with the same paint type and color as utilized by the pump manufacturer.
- 5. Temporary Facilities: Apply paint to surfaces that do not have existing finish coats. This may include painting exposed metals where hangers were removed or where equipment was moved or removed.
- 6. Paint shall withstand the following temperatures without peeling or discoloration:
  - a. Condensate: 38 degrees C (100 degrees F) on insulation jacket surface and 121 degrees C (250 degrees F) on metal pipe surface.
  - b. Steam: 52 degrees C (125 degrees F) on insulation jacket surface and 190 degrees C (374 degrees F) on metal pipe surface.
- 7. Final result shall be smooth, even-colored, even-textured factory finish on all items. Completely repaint the entire piece of equipment if necessary to achieve this.
- 8. Lead based paints are prohibited.

### **3.7 IDENTIFICATION SIGNS**

- A. Provide laminated plastic signs, with engraved lettering not less than 5 mm (3/16 inch) high, designating functions, for all equipment, switches, motor controllers, relays, meters, control devices, including automatic control valves. Nomenclature and identification symbols shall correspond to that used in maintenance manual, and in diagrams specified elsewhere. Attach by chain, adhesive, or screws.
- B. Factory Built Equipment: Metal plate, securely attached, with name and address of manufacturer, serial number, model number, size, performance.
- C. Pipe Identification: Pipe marking shall be applied to all pipes after insulation and painting has been completed, and shall be as follows:
  - 1. Plastic semi-rigid snap-on type, manufacturer's standard pre-printed color-coded pipe markers extending fully around the pipe and insulation or pressure sensitive vinyl markers.

2. On piping and insulation 6" and greater diameter, full band as specified above or strip-type markers fastened to the pipe or insulation with laminated or bonded application or by color-coded plastic tape not less than 1.50" wide, full circle at both ends of the marker.
  3. Arrows for direction of flow provided integral with the pipe marker or separate at each marker.
- D. Duct Identification: Duct marking shall be applied to all ducts after insulation and painting has been completed, and shall be as follows:
1. Laminated plastic color-coded pressure sensitive vinyl tape, 2.50" width, 3 mils minimum thickness. Identification shall include service (supply, return, exhaust, outside air) and direction of flow.
  2. Duct access panel markings shall be similar to duct markings to identify the device (fire damper, smoke damper, control damper, or smoke detector).
  3. Arrows for direction of flow provided integral with the duct marker or separate at each marker.
- E. For pipe and duct labeling, coordinate names, abbreviations and other designations used in mechanical identification work with corresponding designations shown, specified or scheduled on drawings. Pipe and duct markings shall be placed:
1. At each piece of equipment.
  2. At 25 ft. centers in mechanical rooms and concealed spaces, but at least once per room.
  3. At 50 ft. centers in other exposed locations.
  4. On mains at each branch take-off.
- F. On duct access panels. Attach ceiling grid label on ceiling grid location directly underneath above-ceiling air terminal, control system component, valve, filter unit, fan, or other equipment that may require maintenance.

### **3.8 MOTOR AND DRIVES**

- A. Use synchronous belt drives only on equipment controlled by soft starters or variable frequency drive motor controllers without a bypass contactor. Use V-belt drives on all other applications.
- B. Alignment of V-Belt Drives: Set driving and driven shafts parallel and align so that the corresponding grooves are in the same plane.

- C. Alignment of Synchronous Belt Drives: Set driving and driven shafts parallel and align so that the corresponding pulley flanges are in the same plane.
- D. Alignment of Direct-Connect Drives: Securely mount motor in accurate alignment so that shafts are per coupling manufacturer's tolerances when both motor and driven machine are operating at normal temperatures.

### **3.9 LUBRICATION**

- A. All equipment and devices requiring lubrication shall be lubricated prior to initial operation. Field-check all devices for proper lubrication.
- B. All devices and equipment shall be equipped with required lubrication fittings or devices. A minimum of 0.95 liter (1 quart) of oil and 0.45 kg (1 pound) of grease of manufacturer's recommended grade and type for each different application shall be provided; also provide 12 grease sticks for lubricated plug valves. Deliver all materials to COR in unopened containers that are properly identified as to application.
- C. All lubrication points shall be accessible without disassembling equipment, except to remove access plates.
- D. All lubrication points shall be extended to one side of the equipment.

### **3.10 STARTUP, TEMPORARY OPERATION AND TESTING**

- A. Perform tests as recommended by product manufacturer and listed standards and under actual or simulated operating conditions and prove full compliance with design and specified requirements. Tests of the various items of equipment shall be performed simultaneously with the system of which each item is an integral part.
- B. When any defects are detected, correct defects and repeat test at no additional cost or time to the Government.
- C. Startup of equipment shall be performed as described in equipment specifications. Vibration within specified tolerance shall be verified prior to extended operation. Temporary use of equipment is specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT.

### **3.11 OPERATING AND PERFORMANCE TESTS**

- A. Prior to the final inspection, perform required tests as specified in Section 01 00 00, GENERAL REQUIREMENTS Article, TESTS, and in

individual Division 23 specification sections and submit the test reports and records to the COR.

- B. Should evidence of malfunction in any tested system, or piece of equipment or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost or time to the Government.
- C. When completion of certain work or system occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then conduct such performance tests and finalize control settings for heating systems and for cooling systems respectively during first actual seasonal use of respective systems following completion of work. Rescheduling of these tests shall be requested in writing to COR for approval.
- D. No adjustments may be made during the acceptance inspection. All adjustments shall have been made by this point.

**3.12 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for 4 hours to instruct each VA personnel responsible in operation and maintenance of the system.

- - - E N D - - -



**SECTION 23 05 12**  
**GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation and connection of motors for HVAC and steam generation equipment.
- B. A complete listing of common acronyms and abbreviations are included in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- D. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.3 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. Where conflicts occur these specifications and the VHA standard shall govern.
- B. American Bearing Manufacturers Association (ABMA):
  - 9-2015.....Load Ratings and Fatigue Life for Ball Bearings
  - 11-2015.....Load Ratings and Fatigue Life for Roller Bearings
- C. American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE):
  - 90.1-2013.....Energy Efficient Design of New Buildings Except Low-Rise Residential Buildings
- D. Institute of Electrical and Electronics Engineers (IEEE):
  - 112-2004.....Standard Test Procedure for Polyphase Induction Motors and Generators
  - 841-2009.....IEEE Standard for Petroleum and Chemical Industry-Premium-Efficiency, Severe-Duty, Totally Enclosed Fan-Cooled (TEFC) Squirrel Cage Induction Motors--Up to and Including 370 kW (500 hp)
- E. National Electrical Manufacturers Association (NEMA):
  - MG 1-2014.....Motors and Generators

- MG 2-2014.....Safety Standard for Construction and Guide for  
Selection, Installation and Use of Electric  
Motors and Generators
- 250-2014.....Enclosures for Electrical Equipment (1000 Volts  
Maximum)
- F. National Fire Protection Association (NFPA):  
70-2014.....National Electrical Code (NEC)

**1.4 SUBMITTALS**

- A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT", with applicable paragraph identification.
- C. Submit motor submittals with driven equipment.
- D. Shop Drawings:
  - 1. Provide documentation to demonstrate compliance with contract documents.
  - 2. Motor nameplate information shall be submitted including electrical ratings, efficiency, bearing data, power factor, frame size, dimensions, mounting details, materials, horsepower, voltage, phase, speed (RPM), enclosure, starting characteristics, torque characteristics, code letter, full load and locked rotor current, service factor, and lubrication method.
- E. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.
- F. Complete operating and maintenance manuals including wiring diagrams, technical data sheets, information for ordering replacement parts, and troubleshooting guide:
  - 1. Include complete list indicating all components of the systems.
  - 2. Include complete diagrams of the internal wiring for each item of equipment.
  - 3. Diagrams shall have their terminals identified to facilitate installation, operation and maintenance.

- G. Certification: Two weeks prior to final inspection, unless otherwise noted, certification shall be submitted to the COR stating that the motors have been properly applied, installed, adjusted, lubricated, and tested.

#### **1.5 AS-BUILT DOCUMENTATION**

- A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.
- B. Submit operation and maintenance data updated to include submittal review comments, VA approved substitutions and construction revisions shall be in electronic version on CD or DVD. All aspects of system operation and maintenance procedures, including applicable piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices shall be included. A List of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner shall be required to employ shall be inserted into the As-Built documentation.
- C. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. Shall the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement. Provide record drawings as follows:
1. Red-lined, hand-marked drawings shall be provided, with one paper copy and a scanned PDF version of the hand-marked drawings provided on CD or DVD.
- D. The as-built drawings shall indicate the location and type of all lockout/tagout points for all energy sources for all equipment and pumps to include breaker location and numbers, and valve tag numbers.. Coordinate lockout/tagout procedures and practices with local VA requirements.

E. Certification documentation shall be provided to COR 21 working days prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and provide documentation/certification that all results of tests were within limits specified. Test results shall contain written sequence of test procedure with written test results annotated at each step along with the expected outcome or setpoint. The results shall include all readings, data on device (make, model and performance characteristics), normal pressures, switch ranges, trip points, amp readings, and calibration data to include equipment serial numbers or individual identifications.

## **PART 2 - PRODUCTS**

### **2.1 MOTORS**

- A. For alternating current, fractional and integral horsepower motors, NEMA MG 1 and NEMA MG 2 shall apply.
- B. For severe duty TEFC motors, IEEE 841 shall apply.
- C. All material and equipment furnished and installation methods shall conform to the requirements of Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES. Provide all electrical wiring, conduit, and devices necessary for the proper connection, protection and operation of the systems. Provide premium efficiency type motors. Unless otherwise specified for a particular application, use electric motors with the following requirements.
- D. Single-phase Motors: Motors for centrifugal fans and pumps shall be Electrically Commutated motor (EC Type): Motor shall be brushless DC type specifically designed for applications with heavy duty ball bearings and electronic commutation. The motor speed shall be speed controllable down to 20% of full speed and 85% efficient at all speeds.
- E. Poly-phase Motors: NEMA Design B, Squirrel cage, induction type.
  - 1. Two Speed Motors: Each two-speed motor shall have two separate windings. Provide a time- delay (20 seconds minimum) relay for switching from high to low speed.
- F. Voltage ratings shall be as follows:
  - 1. Single phase:
    - a. Motors connected to 120-volt systems: 115 volts.
    - b. Motors connected to 208-volt systems: 200 volts.

- c. Motors connected to 240-volt or 480-volt systems: 230/460 volts, dual connection.
  2. Three phase:
    - a. Motors connected to 208-volt systems: 200 volts.
    - b. Motors, less than 74.6 kW (100 hp), connected to 240-volt or 480-volt systems: 208-230/460 volts, dual connection.
- G. Number of phases shall be as follows:
  1. Motors, less than 373 W (1/2 hp): Single phase.
  2. Motors, 373 W (1/2 hp) and larger: 3 phase.
  3. Exceptions:
    - a. Hermetically sealed motors.
    - b. Motors for equipment assemblies, less than 746 W (1 hp), shall be single phase provided the manufacturer of the proposed assemblies cannot supply the assemblies with three phase motors.
- H. Horsepower ratings shall be adequate for operating the connected loads continuously in the prevailing ambient temperatures in areas where the motors are installed, without exceeding the NEMA standard temperature rises for the motor insulation.
- I. Motor designs, as indicated by the NEMA code letters, shall be coordinated with the connected loads to assure adequate starting, acceleration, and running torque without exceeding nameplate ratings or considering service factor.
- J. Motor Enclosures:
  1. Shall be the NEMA types as specified and/or shown in the Contract Documents.
  2. Where the types of motor enclosures are not shown on the drawings, they shall be the NEMA types per NEMA 250, which are most suitable for the environmental conditions where the motors are being installed. Enclosure requirements for certain conditions are as follows:
    - a. Motors located outdoors, indoors in wet or high humidity locations, or in unfiltered airstreams shall be totally enclosed type.
    - b. Where motors are located in an NEC 511 classified area, provide TEFC explosion proof motor enclosures.
    - c. Where motors are located in a corrosive environment, provide TEFC enclosures with corrosion resistant finish.

3. Enclosures shall be primed and finish coated at the factory with manufacturer's prime coat and standard finish.

K. Electrical Design Requirements:

1. Motors shall be continuous duty.
2. The insulation system shall be rated minimum of Class B, 130 degrees C (266 degrees F).
3. The maximum temperature rise by resistance at rated power shall not exceed Class B limits, 80 degrees C (176 degrees F).
4. The speed/torque and speed/current characteristics shall comply with NEMA Design A or B, as specified.
5. Motors shall be suitable for full voltage starting, unless otherwise noted. Coordinate motor features with applicable motor controllers.
6. Motors for variable frequency drive applications shall adhere to NEMA MG 1, Part 30, Application Considerations for Constant Speed Motors Used on a Sinusoidal Bus with Harmonic Content and General-Purpose Motors Used with Adjustable-Voltage or Adjustable-Frequency Controls or Both, or NEMA MG 1, Part 31, Definite-Purpose Inverter-Fed Polyphase Motors.

L. Mechanical Design Requirements:

1. Bearings shall be rated in accordance with ABMA 9 or ABMA 11 for a minimum fatigue life of 26,280 hours for belt-driven loads and 100,000 hours for direct-drive loads based on L10 (Basic Rating Life) at full load direct coupled, except vertical high thrust motors which require a 40,000 hours rating. A minimum fatigue life of 40,000 hours is required for VFD drives.
2. Vertical motors shall be capable of withstanding a momentary up thrust of at least 30 percent of normal down thrust.
3. Grease lubricated bearings shall be designed for electric motor use. Grease shall be capable of the temperatures associated with electric motors and shall be compatible with Polyurea based greases.
4. Grease fittings, if provided, shall be Alemite type or equivalent.
5. Oil lubricated bearings, when specified, shall have an externally visible sight glass to view oil level.
6. Vibration shall not exceed 3.8 mm (0.15 inch) per second, unfiltered peak.
7. Noise level shall meet the requirements of the application.

8. Motors on 180 frames and larger shall have provisions for lifting eyes or lugs capable of a safety factor of 5.
  9. All external fasteners shall be corrosion resistant.
  10. Condensation heaters, when specified, shall keep motor windings at least 5 degrees C (9 degrees F) above ambient temperature.
  11. Winding thermostats, when specified shall be normally closed, connected in series.
  12. Grounding provisions shall be in the main terminal box.
- M. Special Requirements:
1. Where motor power requirements of equipment furnished deviate from power shown on plans, provide electrical service designed under the requirements of NFPA 70 without additional cost or time to the Government.
  2. Assemblies of motors, starters, controls and interlocks on factory assembled and wired devices shall be in accordance with the requirements of this specification.
  3. Wire and cable materials specified in the electrical division of the specifications shall be modified as follows:
    - a. Wiring material located where temperatures can exceed 71 degrees C (160 degrees F) shall be stranded copper with Teflon FEP insulation with jacket. This includes wiring on the boilers.
    - b. Other wiring at boilers and to control panels shall be NFPA 70 designation THWN.
    - c. Provide shielded conductors or wiring in separate conduits for all instrumentation and control systems where recommended by manufacturer of equipment.
  4. Select motor sizes so that the motors do not operate into the service factor at maximum required loads on the driven equipment. Motors on pumps shall be sized for non-overloading at all points on the pump performance curves.
  5. Motors utilized with variable frequency drives shall be rated "inverter-duty" per NEMA MG 1, Part 31, Definite-Purpose Inverter-Fed Polyphase Motors. Provide motor shaft grounding apparatus that shall protect bearings from damage from stray currents.
- N. Additional requirements for specific motors, as indicated in the other sections listed in paragraph, RELATED SECTIONS shall also apply.

O. NEMA Premium Efficiency Electric Motors (Motor Efficiencies): All permanently wired polyphase motors of 746 W (1 hp) or more shall meet the minimum full-load efficiencies as indicated in the following table. Motors of 746 W (1 hp) or more with open, drip-proof, or TEFC enclosures shall be NEMA premium efficiency type, unless otherwise indicated. Motors provided as an integral part of motor driven equipment are excluded from this requirement if a minimum seasonal or overall efficiency requirement is indicated for that equipment by the provisions of another section.

Minimum Premium Efficiencies Open Drip-Proof				Minimum Premium Efficiencies Totally Enclosed Fan-Cooled (TEFC)			
Rating kW (hp)	1200 RPM	1800 RPM	3600 RPM	Rating kW (hp)	1200 RPM	1800 RPM	3600 RPM
0.746 (1)	82.5%	85.5%	77.0%	0.746 (1)	82.5%	85.5%	77.0%
1.12 (1.5)	86.5%	86.5%	84.0%	1.12 (1.5)	87.5%	86.5%	84.0%
1.49 (2)	87.5%	86.5%	85.5%	1.49 (2)	88.5%	86.5%	85.5%
2.24 (3)	88.5%	89.5%	85.5%	2.24 (3)	89.5%	89.5%	86.5%
3.73 (5)	89.5%	89.5%	86.5%	3.73 (5)	89.5%	89.5%	88.5%
5.60 (7.5)	90.2%	91.0%	88.5%	5.60 (7.5)	91.0%	91.7%	89.5%
7.46 (10)	91.7%	91.7%	89.5%	7.46 (10)	91.0%	91.7%	90.2%
11.2 (15)	91.7%	93.0%	90.2%	11.2 (15)	91.7%	92.4%	91.0%
14.9 (20)	92.4%	93.0%	91.0%	14.9 (20)	91.7%	93.0%	91.0%
18.7 (25)	93.0%	93.6%	91.7%	18.7 (25)	93.0%	93.6%	91.7%
22.4 (30)	93.6%	94.1%	91.7%	22.4 (30)	93.0%	93.6%	91.7%
29.8 (40)	94.1%	94.1%	92.4%	29.8 (40)	94.1%	94.1%	92.4%
37.3 (50)	94.1%	94.5%	93.0%	37.3 (50)	94.1%	94.5%	93.0%
44.8 (60)	94.5%	95.0%	93.6%	44.8 (60)	94.5%	95.0%	93.6%
56.9 (75)	94.5%	95.0%	93.6%	56.9 (75)	94.5%	95.4%	93.6%
74.6 (100)	95.0%	95.4%	93.6%	74.6 (100)	95.0%	95.4%	94.1%
93.3 (125)	95.0%	95.4%	94.1%	93.3 (125)	95.0%	95.4%	95.0%
112 (150)	95.4%	95.8%	94.1%	112 (150)	95.8%	95.8%	95.0%
149.2 (200)	95.4%	95.8%	95.0%	149.2 (200)	95.8%	96.2%	95.4%

P. Minimum Power Factor at Full Load and Rated Voltage: 90 percent at 1200 RPM, 1800 RPM, and 3600 RPM. Power factor correction capacitors shall be provided unless the motor meets the 0.90 requirement without it or if the motor is controlled by a variable frequency drive. The power



factor correction capacitors shall be able to withstand high voltage transients and power line variations without breakdown.

- Q. Energy Efficiency of Small Motors (Motor Efficiencies): All motors under 746 W (1 hp) shall meet the requirements of the DOE Small Motor Regulation.

Polyphase Open Motors Average full load efficiency				Capacitor-start capacitor-run and capacitor-start induction run open motors Average full load efficiency			
Rating kW (hp)	6 poles	4 poles	2 poles	Rating kW (hp)	6 poles	4 poles	2 poles
0.18 (0.25)	67.5	69.5	65.6	0.18 (0.25)	62.2	68.5	66.6
0.25 (0.33)	71.4	73.4	69.5	0.25 (0.33)	66.6	72.4	70.5
0.37 (0.5)	75.3	78.2	73.4	0.37 (0.5)	76.2	76.2	72.4
0.55 (0.75)	81.7	81.1	76.8	0.55 (0.75)	80.2	81.8	76.2

**PART 3 - EXECUTION**

**3.1 INSTALLATION**

- A. Install motors in accordance with manufacturer's recommendations, the NEC, NEMA, as shown on the drawings and/or as required by other sections of these specifications.
- B. If an installation is unsatisfactory to the COR, the Contractor shall correct the installation at no additional cost or time to the Government.

**3.2 FIELD TESTS**

- A. All tests shall be witnessed by the or by the COR.
- B. Perform an electric insulation resistance Test using a megohmmeter on all motors after installation, before startup. All shall test free from grounds.
- C. Perform Load test in accordance with IEEE 112, Test Method B, to determine freedom from electrical or mechanical defects and compliance with performance data.
- D. Insulation Resistance: Not less than one-half meg-ohm between stator conductors and frame, to be determined at the time of final inspection.
- E. All test data shall be compiled into a report form for each motor and provided to the contracting officer or their representative.

**3.3 STARTUP AND TESTING**

- A. Perform tests as recommended by product manufacturer and listed standards and under actual or simulated operating conditions and prove full compliance with design and specified requirements. Tests of the various items of equipment shall be performed simultaneously with the system of which each item is an integral part.
- B. When any defects are detected, correct defects and repeat test at no additional cost or time to the Government.

**3.4 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for two hours to instruct each VA personnel responsible in operation and maintenance of the system.

- - - E N D - - -

**SECTION 23 05 41  
NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

A. Noise criteria, vibration tolerance and vibration isolation for HVAC work.

**1.2 RELATED WORK**

A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.

B. Section 23 05 11, COMMON WORK RESULTS FOR HVAC

**1.3 QUALITY ASSURANCE**

A. Refer to article, QUALITY ASSURANCE in specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

B. Noise Criteria:

1. Noise levels in all 8 octave bands due to equipment and duct systems shall not exceed following NC levels:

<b>TYPE OF ROOM</b>	<b>NC LEVEL</b>
Bathrooms and Toilet Rooms	40
Conference Rooms	35
Corridors (Nurse Stations)	40
Corridors(Public)	40
Dining Rooms, Food Services/ Serving	40
Examination Rooms	35
Lobbies, Waiting Areas	40
Locker Rooms	45
Offices, Large Open	40
Offices, Small Private	35
Patient Rooms	35
Recreation Rooms	40-45
Treatment Rooms	35
X-Ray and General Work Rooms	40

2. For equipment which has no sound power ratings scheduled on the plans, the contractor shall select equipment such that the foregoing noise criteria, local ordinance noise levels, and OSHA requirements are not exceeded. Selection procedure shall be in

accordance with 2017 ASHRAE Fundamentals Handbook, Chapter 8, Sound and Vibration.

3. An allowance, not to exceed 5db, shall be added to the measured value to compensate for the variation of the room attenuating effect between room test condition prior to occupancy and design condition after occupancy which shall include the addition of sound absorbing material, such as, furniture. This allowance shall not be taken after occupancy. The room attenuating effect is defined as the difference between sound power level emitted to room and sound pressure level in room.
  4. In absence of specified measurement requirements, measure equipment noise levels three feet from equipment and at an elevation of maximum noise generation.
- C. Allowable Vibration Tolerances for Rotating, Non-reciprocating Equipment: Not to exceed a self-excited vibration maximum velocity of 5 mm per second (0.20 inch per second) RMS, filter in, when measured with a vibration meter on bearing caps of machine in vertical, horizontal and axial directions or measured at equipment mounting feet if bearings are concealed. Measurements for internally isolated fans and motors shall be made at the mounting feet.

#### **1.4 SUBMITTALS**

- A. Submit in accordance with specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
  1. Vibration isolators:
    - a. Floor mountings
    - b. Hangers
  2. Bases.
- C. Isolator manufacturer shall furnish with submittal load calculations for selection of isolators, including supplemental bases, based on lowest operating speed of equipment supported.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc. (ASHRAE):

- 2017 .....Fundamentals Handbook, Chapter 8, Sound and  
Vibration
- 2015..... HVAC Applications, Chapter 48, Noise and  
Vibration Control
- C. American Society for Testing and Materials (ASTM):
  - A123/A123M-09.....Standard Specification for Zinc (Hot-Dip  
Galvanized) Coatings on Iron and Steel Products
  - A307-07b.....Standard Specification for Carbon Steel Bolts  
and Studs, 60,000 PSI Tensile Strength
  - D2240-05(2010).....Standard Test Method for Rubber Property -  
Durometer Hardness
- D. Manufacturers Standardization (MSS):
  - SP-58-2009.....Pipe Hangers and Supports-Materials, Design and  
Manufacture
- E. Occupational Safety and Health Administration (OSHA):
  - 29 CFR 1910.95.....Occupational Noise Exposure
- F. American Society of Civil Engineers (ASCE):
  - ASCE 7-10 .....Minimum Design Loads for Buildings and Other  
Structures.
- G. American National Standards Institute / Sheet Metal and Air  
Conditioning Contractor's National Association (ANSI/SMACNA):
  - 001-2008.....Seismic Restraint Manual: Guidelines for  
Mechanical Systems, 3rd Edition.
- H. International Code Council (ICC):
  - 2009 IBC.....International Building Code.
- I. Department of Veterans Affairs (VA):
  - H-18-8 2010.....Seismic Design Requirements.

**PART 2 - PRODUCTS**

**2.1 GENERAL REQUIREMENTS**

- A. Type of isolator, base, and minimum static deflection shall be as required for each specific equipment application as recommended by isolator or equipment manufacturer but subject to minimum requirements indicated herein and on the drawings.
- B. Elastomeric Isolators shall comply with ASTM D2240 and be oil resistant neoprene with a maximum stiffness of 60 durometer and have a straight-line deflection curve.

- C. Exposure to weather: Isolator housings to be either hot dipped galvanized or powder coated to ASTM B117 salt spray testing standards. Springs to be powder coated or electro galvanized. All hardware to be electro galvanized. In addition provide limit stops to resist wind velocity. Velocity pressure established by wind shall be calculated in accordance with section 1609 of the International Building Code. A minimum wind velocity of 75 mph shall be employed.
- D. Uniform Loading: Select and locate isolators to produce uniform loading and deflection even when equipment weight is not evenly distributed.
- E. Color code isolators by type and size for easy identification of capacity.

## **2.2 VIBRATION ISOLATORS**

- A. Floor Mountings:
  - 1. Double Deflection Neoprene (Type N): Shall include neoprene covered steel support plated (top and bottom), friction pads, and necessary bolt holes.
  - 2. Spring Isolators (Type S): Shall be free-standing, laterally stable and include acoustical friction pads and leveling bolts. Isolators shall have a minimum ratio of spring diameter-to-operating spring height of 1.0 and an additional travel to solid equal to 50 percent of rated deflection.
  - 3. Spring Isolators with Vertical Limit Stops (Type SP): Similar to spring isolators noted above, except include a vertical limit stop to limit upward travel if weight is removed and also to reduce movement and spring extension due to wind loads. Provide clearance around restraining bolts to prevent mechanical short circuiting. Isolators shall have a minimum seismic rating of one G.
  - 4. Pads (Type D), Washers (Type W), and Bushings (Type L): Pads shall be natural rubber or neoprene waffle, neoprene and steel waffle, or reinforced duck and neoprene. Washers and bushings shall be reinforced duck and neoprene. Washers and bushings shall be reinforced duck and neoprene. Size pads for a maximum load of 345 kPa (50 pounds per square inch).
- B. Hangers: Shall be combination neoprene and springs unless otherwise noted and shall allow for expansion of pipe.
  - 1. Combination Neoprene and Spring (Type H): Vibration hanger shall contain a spring and double deflection neoprene element in series.

- Spring shall have a diameter not less than 0.8 of compressed operating spring height. Spring shall have a minimum additional travel of 50 percent between design height and solid height. Spring shall permit a 15 degree angular misalignment without rubbing on hanger box.
2. Spring Position Hanger (Type HP): Similar to combination neoprene and spring hanger except hanger shall hold piping at a fixed elevation during installation and include a secondary adjustment feature to transfer load to spring while maintaining same position.
  3. Neoprene (Type HN): Vibration hanger shall contain a double deflection type neoprene isolation element. Hanger rod shall be separated from contact with hanger bracket by a neoprene grommet.
  4. Spring (Type HS): Vibration hanger shall contain a coiled steel spring in series with a neoprene grommet. Spring shall have a diameter not less than 0.8 of compressed operating spring height. Spring shall have a minimum additional travel of 50 percent between design height and solid height. Spring shall permit a 15 degree angular misalignment without rubbing on hanger box.
  5. Hanger supports for piping 50 mm (2 inches) and larger shall have a pointer and scale deflection indicator.
- D. Thrust Restraints (Type THR): Restraints shall provide a spring element contained in a steel frame with neoprene pads at each end attachment. Restraints shall have factory preset thrust and be field adjustable to allow a maximum movement of 6 mm (1/4 inch) when the fan starts and stops. Restraint assemblies shall include rods, angle brackets and other hardware for field installation.

### **2.3 BASES**

- A. Rails (Type R): Design rails with isolator brackets to reduce mounting height of equipment and cradle machines having legs or bases that do not require a complete supplementary base. To assure adequate stiffness, height of members shall be a minimum of 1/12 of longest base dimension but not less than 100 mm (4 inches). Where rails are used with neoprene mounts for small fans or close coupled pumps, extend rails to compensate overhang of housing.
- B. Integral Structural Steel Base (Type B): Design base with isolator brackets to reduce mounting height of equipment which require a complete supplementary rigid base. To assure adequate stiffness, height

of members shall be a minimum of 1/12 of longest base dimension, but not less than 100 mm (four inches).

- C. Inertia Base (Type I): Base shall be a reinforced concrete inertia base. Pour concrete into a welded steel channel frame, incorporating prelocated equipment anchor bolts and pipe sleeves. Level the concrete to provide a smooth uniform bearing surface for equipment mounting. Provide grout under uneven supports. Channel depth shall be a minimum of 1/12 of longest dimension of base but not less than 150 mm (six inches). Form shall include 13-mm (1/2-inch) reinforcing bars welded in place on minimum of 203 mm (eight inch) centers running both ways in a layer 40 mm (1-1/2 inches) above bottom. Use height saving brackets in all mounting locations. Weight of inertia base shall be equal to or greater than weight of equipment supported to provide a maximum peak-to-peak displacement of 2 mm (1/16 inch).
- D. Curb Mounted Isolation Base (Type CB): Fabricate from aluminum to fit on top of standard curb with overlap to allow water run-off and have wind and water seals which shall not interfere with spring action. Provide resilient snubbers with 6 mm (1/4 inch) clearance for wind resistance. Top and bottom bearing surfaces shall have sponge type weather seals. Integral spring isolators shall comply with Spring Isolator (Type S) requirements.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Vibration Isolation:
1. No metal-to-metal contact shall be permitted between fixed and floating parts.
  2. Connections to Equipment: Allow for deflections equal to or greater than equipment deflections. Electrical, drain, piping connections, and other items made to rotating or reciprocating equipment (like pumps or compressors) which rests on vibration isolators, shall be isolated from building structure for first three hangers or supports with a deflection equal to that used on the corresponding equipment.
  3. Common Foundation: Mount each electric motor on same foundation as driven machine. Hold driving motor and driven machine in positive rigid alignment with provision for adjusting motor alignment and belt tension. Bases shall be level throughout length and width. Provide shims to facilitate pipe connections, leveling, and bolting.



4. Provide heat shields where elastomers are subject to temperatures over 38 degrees C (100 degrees F).
  5. Extend bases for pipe elbow supports at discharge and suction connections at pumps. Pipe elbow supports shall not short circuit pump vibration to structure.
  6. Non-rotating equipment such as heat exchangers and convertors shall be mounted on isolation units having the same static deflection as the isolation hangers or support of the pipe connected to the equipment.
- B. Inspection and Adjustments: Check for vibration and noise transmission through connections, piping, ductwork, foundations, and walls. Adjust, repair, or replace isolators as required to reduce vibration and noise transmissions to specified levels.

### **3.2 ADJUSTING**

- A. Adjust vibration isolators after piping systems are filled and equipment is at operating weight.
- B. Adjust limit stops on restrained spring isolators to mount equipment at normal operating height. After equipment installation is complete, adjust limit stops so they are out of contact during normal operation.
- C. Attach thrust limits at centerline of thrust and adjust to a maximum of 1/4inch (6-mm) movement during start and stop.
- D. Adjust active height of spring isolators.
- E. Adjust snubbers according to manufacturer's recommendations.

### **3.3 SELECTION GUIDE FOR VIBRATION ISOPLATORS**

- A. Select and size vibration isolators in accordance with Table 47, Chapter 48 of 2015 ASHRAE HVAC Applications Handbook on Noise.

- - - E N D - - -

**SECTION 23 07 11**  
**HVAC AND BOILER PLANT INSULATION**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Field applied insulation for thermal efficiency and condensation control for
1. HVAC piping, ductwork and equipment.
  2. Unless noted otherwise below, exhaust and relief air ductwork shall be insulated from 24" upstream of the auto/backdraft damper to the point of exterior wall/roof penetration.
  3. Equipment and devices, accessories and stiffeners in insulated ductwork shall also be insulated. This includes items such as external duct bracing and stiffeners, duct coils, air terminal reheat box coils, air control dampers and valves, fire dampers, smoke dampers, filter housings, and sound attenuators. The backside of supply air diffusers shall also be insulated to prevent condensation, except if the air device is internally lined or factory insulated.
  4. Reinsulate piping, ductwork and equipment where existing insulation has been damaged or removed in the performance of work in this project.
- B. Definitions
1. ASJ: All service jacket, white finish facing or jacket.
  2. Air conditioned space: Space having air temperature and/or humidity controlled by mechanical equipment.
  3. Cold: Equipment, ductwork or piping handling media at design temperature of 16 degrees C (60 degrees F) or below.
  4. Concealed: Ductwork and piping above ceilings and in chases, and pipe spaces.
  5. Exposed: Piping, ductwork, and equipment exposed to view in finished areas including mechanical and electrical equipment rooms or exposed to outdoor weather. Attics and crawl spaces where air handling units are located are considered to be mechanical rooms. Shafts, chases, unfinished attics, crawl spaces and pipe basements are not considered finished areas.
  6. FSK: Foil-scrim-kraft facing.

7. Hot: HVAC Ductwork handling air at design temperature above 16 degrees C (60 degrees F); HVAC equipment or piping handling media above 41 degrees C (105 degrees F).
8. Density: kg/m<sup>3</sup> - kilograms per cubic meter (Pcf - pounds per cubic foot).
9. Runouts: Branch pipe connections up to 25-mm (one-inch) nominal size to fan coil units or reheat coils for terminal units.
10. Thermal conductance: Heat flow rate through materials.
  - a. Flat surface: Watt per square meter (BTU per hour per square foot).
  - b. Pipe or Cylinder: Watt per square meter (BTU per hour per linear foot).
11. Thermal Conductivity (k): Watt per meter, per degree C (BTU per inch thickness, per hour, per square foot, per degree F temperature difference).
12. Vapor Retarder (Vapor Barrier): A material which retards the transmission (migration) of water vapor. Performance of the vapor retarder is rated in terms of permeance (perms). For the purpose of this specification, vapor retarders shall have a maximum published permeance of 0.1 perms and vapor barriers shall have a maximum published permeance of 0.001 perms.
13. HPS: High pressure steam (415 kPa [60 psig] and above).
14. HPR: High pressure steam condensate return.
15. MPS: Medium pressure steam (110 kPa [16 psig] thru 414 kPa [59 psig]).
16. MPR: Medium pressure steam condensate return.
17. LPS: Low pressure steam (103 kPa [15 psig] and below).
18. LPR: Low pressure steam condensate gravity return.
19. PC: Pumped condensate.
20. HWS: Heating hot water supply.
21. HWR: Heating hot water return.
22. CHS: Chilled water supply.
23. CHR: Chilled water return.
24. PVDC: Polyvinylidene chloride vapor retarder jacketing, white.

## **1.2 RELATED WORK**

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Section 07 84 00, FIRESTOPPING.

C. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

D. Section 23 21 13, HYDRONIC PIPING.

### 1.3 QUALITY ASSURANCE

A. Refer to article QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

B. Criteria:

1. Comply with NFPA 90A, particularly paragraphs 4.3.3.1 through 4.3.3.6, 4.3.10.2.6, and 5.4.6.4, parts of which are quoted as follows:

**4.3.3.1** Pipe insulation and coverings, duct coverings, duct linings, vapor retarder facings, adhesives, fasteners, tapes, and supplementary materials added to air ducts, plenums, panels, and duct silencers used in duct systems, unless otherwise provided for in 4.3.3.1.1 or 4.3.3.1.2., shall have, in the form in which they are used, a maximum flame spread index of 25 without evidence of continued progressive combustion and a maximum smoke developed index of 50 when tested in accordance with NFPA 255, Standard Method of Test of Surface Burning Characteristics of Building Materials.

**4.3.3.1.1** Where these products shall applied with adhesives, they shall be tested with such adhesives applied, or the adhesives used shall have a maximum flame spread index of 25 and a maximum smoke developed index of 50 when in the final dry state. (See 4.2.4.2.)

**4.3.3.1.2** The flame spread and smoke developed index requirements of 4.3.3.1.1 shall not apply to air duct weatherproof coverings where they are located entirely outside of a building, do not penetrate a wall or roof, and do not create an exposure hazard.

4.3.3.2 Closure systems for use with rigid and flexible air ducts tested in accordance with UL 181, Standard for Safety Factory-Made Air Ducts and Air Connectors, shall have been tested, listed, and used in accordance with the conditions of their listings, in accordance with one of the following:

(1) UL 181A, Standard for Safety Closure Systems for Use with Rigid Air Ducts and Air Connectors

(2) UL 181B, Standard for Safety Closure Systems for Use with Flexible Air Ducts and Air Connectors

4.3.3.3 Air duct, panel, and plenum coverings and linings, and pipe insulation and coverings shall not flame, glow, smolder, or smoke when tested in accordance with a similar test for pipe covering, ASTM C 411, Standard Test Method for Hot-Surface Performance of High-Temperature Thermal Insulation, at the temperature to which they are exposed in service.

4.3.3.3.1 In no case shall the test temperature be below 121°C (250°F).

4.3.3.4 Air duct coverings shall not extend through walls or floors that are required to be fire stopped or required to have a

fire resistance rating, unless such coverings meet the requirements of 5.4.6.4.

4.3.3.5\* Air duct linings shall be interrupted at fire dampers to prevent interference with the operation of devices.

4.3.3.6 Air duct coverings shall not be installed so as to conceal or prevent the use of any service opening.

4.3.10.2.6 Materials exposed to the airflow shall be noncombustible or limited combustible and have a maximum smoke developed index of 50 or comply with the following.

4.3.10.2.6.1 Electrical wires and cables and optical fiber cables shall be listed as noncombustible or limited combustible and have a maximum smoke developed index of 50 or shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with NFPA 262, Standard Method of Test for Flame Travel and Smoke of Wires and Cables for Use in Air-Handling Spaces.

4.3.10.2.6.4 Optical-fiber and communication raceways shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with UL 2024, Standard for Safety Optical-Fiber Cable Raceway.

4.3.10.2.6.6 Supplementary materials for air distribution systems shall be permitted when complying with the provisions of 4.3.3.

5.4.6.4 Where air ducts pass through walls, floors, or partitions that are required to have a fire resistance rating and where fire dampers are not required, the opening in the construction around the air duct shall be as follows:

(1) Not exceeding a 25.4 mm (1 in.) average clearance on all sides

(2) Filled solid with an approved material capable of preventing the passage of flame and hot gases sufficient to ignite cotton waste when subjected to the time-temperature fire conditions required for fire barrier penetration as specified in NFPA 251, *Standard Methods of Tests of Fire Endurance of Building Construction and Materials*

2. Test methods: ASTM E84, UL 723, or NFPA 255.
3. Specified k factors are at 24 degrees C (75 degrees F) mean temperature unless stated otherwise. Where optional thermal insulation material is used, select thickness to provide thermal conductance no greater than that for the specified material. For pipe, use insulation manufacturer's published heat flow tables. For run out insulation and condensation control insulation, no thickness adjustment need be made.

4. All materials shall be compatible and suitable for service temperature, and shall not contribute to corrosion or otherwise attack surface to which applied in either the wet or dry state.
- C. Every package or standard container of insulation or accessories delivered to the job site for use shall have a manufacturer's stamp or label giving the name of the manufacturer and description of the material.

#### **1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings:
  1. All information, clearly presented, shall be included to determine compliance with drawings and specifications and ASTM, federal and military specifications.
    - a. Insulation materials: Specify each type used and state surface burning characteristics.
    - b. Insulation facings and jackets: Each type used. Make it clear that white finish shall be furnished for exposed ductwork, casings and equipment.
    - c. Insulation accessory materials: Each type used.
    - d. Manufacturer's installation and fitting fabrication instructions for flexible unicellular insulation.
    - e. Make reference to applicable specification paragraph numbers for coordination.

#### **1.5 STORAGE AND HANDLING OF MATERIAL**

- A. Store materials in clean and dry environment, pipe covering jackets shall be clean and unmarred. Place adhesives in original containers. Maintain ambient temperatures and conditions as required by printed instructions of manufacturers of adhesives, mastics and finishing cements.

#### **1.6 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only.
- B. Federal Specifications (Fed. Spec.):

L-P-535E (2)- 99.....Plastic Sheet (Sheeting): Plastic Strip; Poly  
(Vinyl Chloride) and Poly (Vinyl Chloride -  
Vinyl Acetate), Rigid.

C. Military Specifications (Mil. Spec.):

MIL-A-3316C (2)-90.....Adhesives, Fire-Resistant, Thermal Insulation

MIL-A-24179A (1)-87.....Adhesive, Flexible Unicellular-Plastic  
Thermal Insulation

MIL-C-19565C (1)-88.....Coating Compounds, Thermal Insulation, Fire-and  
Water-Resistant, Vapor-Barrier

MIL-C-20079H-87.....Cloth, Glass; Tape, Textile Glass; and Thread,  
Glass and Wire-Reinforced Glass

D. American Society for Testing and Materials (ASTM):

A167-99(2004).....Standard Specification for Stainless and  
Heat-Resisting Chromium-Nickel Steel Plate,  
Sheet, and Strip

B209-07.....Standard Specification for Aluminum and  
Aluminum-Alloy Sheet and Plate

C411-05.....Standard test method for Hot-Surface  
Performance of High-Temperature Thermal  
Insulation

C449-07.....Standard Specification for Mineral Fiber  
Hydraulic-Setting Thermal Insulating and  
Finishing Cement

C533-09.....Standard Specification for Calcium Silicate  
Block and Pipe Thermal Insulation

C534-08.....Standard Specification for Preformed Flexible  
Elastomeric Cellular Thermal Insulation in  
Sheet and Tubular Form

C547-07.....Standard Specification for Mineral Fiber pipe  
Insulation

C552-07.....Standard Specification for Cellular Glass  
Thermal Insulation

C553-08.....Standard Specification for Mineral Fiber  
Blanket Thermal Insulation for Commercial and  
Industrial Applications

- C585-09.....Standard Practice for Inner and Outer Diameters  
of Rigid Thermal Insulation for Nominal Sizes  
of Pipe and Tubing (NPS System) R (1998)
- C612-10.....Standard Specification for Mineral Fiber Block  
and Board Thermal Insulation
- C1126-04.....Standard Specification for Faced or Unfaced  
Rigid Cellular Phenolic Thermal Insulation
- C1136-10.....Standard Specification for Flexible, Low  
Permeance Vapor Retarders for Thermal  
Insulation
- D1668-97a (2006).....Standard Specification for Glass Fabrics (Woven  
and Treated) for Roofing and Waterproofing
- E84-10.....Standard Test Method for Surface Burning  
Characteristics of Building  
Materials
- E119-09c.....Standard Test Method for Fire Tests of Building  
Construction and Materials
- E136-09b.....Standard Test Methods for Behavior of Materials  
in a Vertical Tube Furnace at 750 degrees C  
(1380 F)
- E. National Fire Protection Association (NFPA):
  - 90A-09.....Standard for the Installation of Air  
Conditioning and Ventilating Systems
  - 96-08.....Standards for Ventilation Control and Fire  
Protection of Commercial Cooking Operations
  - 101-09.....Life Safety Code
  - 251-06.....Standard methods of Tests of Fire Endurance of  
Building Construction Materials
  - 255-06.....Standard Method of tests of Surface Burning  
Characteristics of Building Materials
- F. Underwriters Laboratories, Inc (UL):
  - 723.....UL Standard for Safety Test for Surface Burning  
Characteristics of Building Materials with  
Revision of 09/08
- G. Manufacturer's Standardization Society of the Valve and Fitting  
Industry (MSS):



SP58-2009.....Pipe Hangers and Supports Materials, Design,  
and Manufacture

**PART 2 - PRODUCTS**

**2.1 MINERAL FIBER OR FIBER GLASS**

- A. ASTM C612 (Board, Block), Class 1 or 2, density 48 kg/m<sup>3</sup> (3 pcf), k = 0.037 (0.26) at 24 degrees C (75 degrees F), external insulation for temperatures up to 204 degrees C (400 degrees F) with foil scrim (FSK) facing.
- B. ASTM C553 (Blanket, Flexible) Type I, Class B-3, Density 16 kg/m<sup>3</sup> (1 pcf), k = 0.045 (0.31) at 24 degrees C (75 degrees F), for use at temperatures up to 204 degrees C (400 degrees F) with foil scrim (FSK) facing.
- C. ASTM C547 (Pipe Fitting Insulation and Preformed Pipe Insulation), Class 1, k = 0.037 (0.26) at 24 degrees C (75 degrees F), for use at temperatures up to 230 degrees C (450 degrees F) with an all service vapor retarder jacket with polyvinyl chloride premolded fitting covering.

**2.2 RIGID CELLULAR PHENOLIC FOAM**

- A. Preformed (molded) pipe insulation, ASTM C1126, type III, grade 1, k = 0.021(0.15) at 10 degrees C (50 degrees F), for use at temperatures up to 121 degrees C (250 degrees F) with all service vapor retarder jacket with polyvinyl chloride premolded fitting covering.
- B. Equipment and Duct Insulation, ASTM C 1126, type II, grade 1, k = 0.021 (0.15) at 10 degrees C (50 degrees F), for use at temperatures up to 121 degrees C (250 degrees F) with rigid cellular phenolic insulation and covering, and all service vapor retarder jacket.

**2.3 FLEXIBLE ELASTOMERIC CELLULAR THERMAL**

- A. ASTM C177, C518, k = 0.039 (0.27) at 24 degrees C (75 degrees F), flame spread not over 25, smoke developed not over 50, for temperatures from minus 4 degrees C (40 degrees F) to 93 degrees C (200 degrees F). No jacket required.

**2.4 INSULATION FACINGS AND JACKETS**

- A. Vapor Retarder, higher strength with low water permeance  $\leq$  0.02 or less perm rating, Beach puncture 50 units for insulation facing on exposed ductwork, casings and equipment, and for pipe insulation jackets. Facings and jackets shall be all service type (ASJ) or PVDC Vapor Retarder jacketing.

- B. ASJ jacket shall be white kraft bonded to 0.025 mm (1 mil) thick aluminum foil, fiberglass reinforced, with pressure sensitive adhesive closure. Comply with ASTM C1136. Beach puncture 50 units, Suitable for painting without sizing. Jackets shall have minimum 40 mm (1-1/2 inch) lap on longitudinal joints and minimum 75 mm (3 inch) butt strip on end joints. Butt strip material shall be same as the jacket. Lap and butt strips shall be self-sealing type with factory-applied pressure sensitive adhesive.
- C. Vapor Retarder medium strength with low water vapor permeance of 0.02 or less perm rating), Beach puncture 25 units: Foil-Scrim-Kraft (FSK) or PVDC vapor retarder jacketing type for concealed ductwork and equipment.
- D. Glass Cloth Jackets: Presized, minimum 0.18 kg per square meter (7.8 ounces per square yard), 2000 kPa (300 psig) bursting strength with integral vapor retarder where required or specified. Weather proof if utilized for outside service.
- E. Factory composite materials shall be used provided that they have been tested and certified by the manufacturer.
- F. Pipe fitting insulation covering (jackets): Fitting covering shall be premolded to match shape of fitting and shall be polyvinyl chloride (PVC) conforming to Fed Spec L-P-535, composition A, Type II Grade GU, and Type III, minimum thickness 0.7 mm (0.03 inches). Provide color matching vapor retarder pressure sensitive tape.
- G. Aluminum Jacket-Piping systems: ASTM B209, 3003 alloy, H-14 temper, 0.6 mm (0.023 inch) minimum thickness with locking longitudinal joints. Jackets for elbows, tees and other fittings shall be factory-fabricated to match shape of fitting and of 0.6 mm (0.024) inch minimum thickness aluminum. Fittings shall be of same construction as straight run jackets but need not be of the same alloy. Factory-fabricated stainless steel bands shall be installed on all circumferential joints. Bands shall be 13 mm (0.5 inch) wide on 450 mm (18 inch) centers. System shall be weatherproof if utilized for outside service.

## **2.5 REMOVABLE INSULATION JACKETS**

- A. Removable insulation jackets shall be provided for all valves, control valves, condensate tanks, expansion tanks, flash tanks, pressure reducing valves, traps. and other steam, condensate, or chilled water

equipment that is not insulated due to maintenance accessibility concerns.

**B. Insulation and Jacket:**

1. Non-Asbestos Glass mat, type E needled fiber.
2. Temperature maximum of 450°F, Maximum water vapor transmission of 0.00 perm, and maximum moisture absorption of 0.2 percent by volume.
3. Jacket Material: Silicon/impregnated fiberglass composite and LFP 2109 pure PTFE.
4. Core blanket shall meet ASTM C 1086-88.
5. Construction: Insulating blanket with permanent Velcro straps shall be used. The removable jacket shall reduce a 350 degree F pipe down to 93 degrees F (ambient 76 degrees F) and a 180 degree F pipe to 79 degrees F (ambient 72 degrees F), but in no case shall the insulation thickness be less than 3 inches of ET insulation. One-piece jacket body with three-ply braided pure Teflon or Kevlar thread and insulation sewn as part of jacket.
6. For large equipment, no piece shall weigh over 40 lbs. All large tanks shall come in at least two interlocking pieces. The blanket shall be custom designed for the piece of equipment being used.

**2.6 PIPE COVERING PROTECTION SADDLES**

- A. Cold pipe support: Premolded pipe insulation 180 degrees (half-shells) on bottom half of pipe at supports. Material shall be cellular glass insulation of the same thickness as adjacent insulation.

<b>Nominal Pipe Size and Accessories Material (Insert Blocks)</b>	
Nominal Pipe Size mm (inches)	Insert Blocks mm (inches)
Up through 125 (5)	150 (6) long
150 (6)	150 (6) long
200 (8), 250 (10), 300 (12)	225 (9) long
350 (14), 400 (16)	300 (12) long
450 through 600 (18 through 24)	350 (14) long

- B. Warm or hot pipe supports: Premolded pipe insulation (180 degrees half-shells) on bottom half of pipe at supports. Material shall cellular glass or calcium silicate. Insulation at supports shall have same thickness as adjacent insulation.

## **2.7 ADHESIVE, MASTIC, CEMENT**

- A. Mil. Spec. MIL-A-3316, Class 1: Jacket and lap adhesive and protective finish coating for insulation.
- B. Mil. Spec. MIL-A-3316, Class 2: Adhesive for laps and for adhering insulation to metal surfaces.
- C. Mil. Spec. MIL-A-24179, Type II Class 1: Adhesive for installing flexible unicellular insulation and for laps and general use.
- D. Mil. Spec. MIL-C-19565, Type I: Protective finish for outdoor use.
- E. Mil. Spec. MIL-C-19565, Type I or Type II: Vapor barrier compound for indoor use.
- F. ASTM C449: Mineral fiber hydraulic-setting thermal insulating and finishing cement.
- G. Other: Insulation manufacturers' published recommendations.

## **2.8 MECHANICAL FASTENERS**

- A. Pins, anchors: Welded pins, or metal or nylon anchors with galvanized steel-coated or fiber washer, or clips. Pin diameter shall be as recommended by the insulation manufacturer.
- B. Staples: Outward clinching monel or galvanized steel.
- C. Wire: 1.3 mm thick (18 gage) soft annealed galvanized or 1.9 mm (14 gage) copper clad steel or nickel copper alloy.
- D. Bands: 13 mm (0.5 inch) nominal width, brass, galvanized steel, aluminum or stainless steel.

## **2.9 REINFORCEMENT AND FINISHES**

- A. Glass fabric, open weave: ASTM D1668, Type III (resin treated) and Type I (asphalt treated).
- B. Glass fiber fitting tape: Mil. Spec MIL-C-20079, Type II, Class 1.
- C. Tape for Flexible Elastomeric Cellular Insulation: As recommended by the insulation manufacturer.
- D. Hexagonal wire netting: 25 mm (one inch) mesh, 0.85 mm thick (22 gage) galvanized steel.
- E. Corner beads: 50 mm (2 inch) by 50 mm (2 inch), 0.55 mm thick (26 gage) galvanized steel; or, 25 mm (1 inch) by 25 mm (1 inch), 0.47 mm thick (28 gage) aluminum angle adhered to 50 mm (2 inch) by 50 mm (2 inch) Kraft paper.
- F. PVC fitting cover: Fed. Spec L-P-535, Composition A, 11-86 Type II, Grade GU, with Form B Mineral Fiber insert, for media temperature 4 degrees C (40 degrees F) to 121 degrees C (250 degrees F). Below 4

degrees C (40 degrees F) and above 121 degrees C (250 degrees F), provide double layer insert. Provide color matching vapor barrier pressure sensitive tape.

## **2.10 FIRESTOPPING MATERIAL**

- A. Other than pipe and duct insulation, refer to Section 07 84 00 FIRESTOPPING.

## **2.11 FLAME AND SMOKE**

- A. Unless shown otherwise all assembled systems shall meet flame spread 25 and smoke developed 50 rating as developed under ASTM, NFPA and UL standards and specifications. See paragraph 1.3 "QUALITY ASSURANCE".

## **PART 3 - EXECUTION**

### **3.1 GENERAL REQUIREMENTS**

- A. Required pressure tests of duct and piping joints and connections shall be completed and the work approved by the COR prior to application of insulation. Surface shall be clean and dry with all foreign materials, such as dirt, oil, loose scale and rust removed.
- B. Except for specific exceptions, insulate entire specified equipment, piping (pipe, fittings, valves, accessories), and duct systems. Insulate each pipe and duct individually. Do not use scrap pieces of insulation where a full length section shall fit.
- C. Insulation materials shall be installed in a first class manner with smooth and even surfaces, with jackets and facings drawn tight and smoothly cemented down at all laps. Insulation shall be continuous through all sleeves and openings, except at fire dampers and duct heaters (NFPA 90A). Vapor retarders shall be continuous and uninterrupted throughout systems with operating temperature 16 degrees C (60 degrees F) and below. Lap and seal vapor retarder over ends and exposed edges of insulation. Anchors, supports and other metal projections through insulation on cold surfaces shall be insulated and vapor sealed for a minimum length of 150 mm (6 inches).
- D. Install vapor stops at all insulation terminations on either side of valves, pumps and equipment and particularly in straight lengths of pipe insulation.
- E. Construct insulation on parts of equipment such as chilled water pumps and heads of chillers, convertors and heat exchangers that shall be opened periodically for maintenance or repair, so insulation can be removed and replaced without damage. Install insulation with bolted 1

mm thick (20 gage) galvanized steel or aluminum covers as complete units, or in sections, with all necessary supports, and split to coincide with flange/split of the equipment.

- F. Insulation on hot piping and equipment shall be terminated square at items not to be insulated, access openings and nameplates. Cover all exposed raw insulation with white sealer or jacket material.
- G. Protect all insulations outside of buildings with aluminum jacket using lock joint or other approved system for a continuous weather tight system. Access doors and other items requiring maintenance or access shall be removable and sealable.
- H. Insulate PRVs, flow meters, and steam traps with removable jackets as specified in this section.
- I. HVAC work not to be insulated:
  - 1. Internally insulated ductwork and air handling units.
  - 2. Relief air ducts (Economizer cycle exhaust air).
  - 3. Exhaust air ducts and plenums.
- J. Apply insulation materials subject to the manufacturer's recommended temperature limits. Apply adhesives, mastic and coatings at the manufacturer's recommended minimum coverage.
- K. Elbows, flanges and other fittings shall be insulated with the same material as is used on the pipe straights. The elbow/ fitting insulation shall be field-fabricated, mitered or factory prefabricated to the necessary size and shape to fit on the elbow/ fitting. Use of polyurethane spray-foam to fill a PVC elbow jacket is prohibited on cold applications.
- L. Firestop Pipe and Duct insulation:
  - 1. Provide firestopping insulation at fire and smoke barriers through penetrations. Fire stopping insulation shall be UL listed as defined in Section 07 84 00, FIRESTOPPING.
  - 2. Pipe and duct penetrations requiring fire stop insulation including, but not limited to the following:
    - a. Pipe risers through floors
    - b. Pipe or duct chase walls and floors
    - c. Smoke partitions
    - d. Fire partitions
- M. Freeze protection of above grade outdoor piping (over heat tracing tape): Insulation thicknesses shall be as specified at the end of this

section. Provide metal jackets for all pipes. Provide for chilled water piping as described in Section 23 21 13, HYDRONIC PIPING (electrical heat tracing systems).

N. Provide vapor barrier jackets over insulation as follows:

1. All interior piping and ducts exposed to outdoor air (i.e. in attics, ventilated (not air conditioned) spaces) that are conveying fluids below ambient air temperature.

O. Provide metal jackets over insulation as follows:

1. All piping and ducts exposed to outdoor weather.
2. A 50 mm (2 inch) overlap is required at longitudinal and circumferential joints.

### **3.2 INSULATION INSTALLATION**

A. Mineral Fiber Board:

1. Faced board: Apply board on pins spaced not more than 300 mm (12 inches) on center each way, and not less than 75 mm (3 inches) from each edge of board. In addition to pins, apply insulation bonding adhesive to entire underside of horizontal metal surfaces. Butt insulation edges tightly and seal all joints with laps and butt strips. After applying speed clips cut pins off flush and apply vapor seal patches over clips.
2. Plain board:
  - a. Insulation shall be scored, beveled or mitered to provide tight joints and be secured to equipment with bands spaced 225 mm (9 inches) on center for irregular surfaces or with pins and clips on flat surfaces. Use corner beads to protect edges of insulation.
  - b. For hot equipment: Stretch 25 mm (1 inch) mesh wire, with edges wire laced together, over insulation and finish with insulating and finishing cement applied in one coat, 6 mm (1/4 inch) thick, trowel led to a smooth finish.
  - c. For cold equipment: Apply meshed glass fabric in a tack coat 1.5 to 1.7 square meter per liter (60 to 70 square feet per gallon) of vapor mastic and finish with mastic at 0.3 to 0.4 square meter per liter (12 to 15 square feet per gallon) over the entire fabric surface.
  - d. Chilled water pumps: Insulate with removable and replaceable 1 mm thick (20 gage) aluminum or galvanized steel covers lined with

insulation. Seal closure joints/flanges of covers with gasket material. Fill void space in enclosure with flexible mineral fiber insulation.

3. Exposed, unlined ductwork and equipment in unfinished areas, mechanical and electrical equipment rooms and attics:
    - a. 40 mm (1-1/2 inch) thick insulation faced with ASJ (white all service jacket): Supply air duct.
    - b. 40 mm (1-1/2 inch) thick insulation faced with ASJ: Return air duct.
    - c. Outside air intake ducts and exposed, unlined supply and return ductwork exposed to outdoor weather: 50 mm (2 inch) thick insulation faced with a reinforcing membrane and two coats of vapor barrier mastic or multi-layer vapor barrier with a maximum water vapor permeability of 0.001 perms.
  4. Cold equipment: 40 mm (1-1/2inch) thick insulation faced with ASJ.
    - a. Chilled water pumps, water filter, chemical feeder pot or tank.
  5. Hot equipment: 40 mm (1-1/2 inch) thick insulation faced with ASJ.
    - a. Convertors, air separators, steam condensate pump receivers.
- B. Flexible Mineral Fiber Blanket:
1. Adhere insulation to metal with 75 mm (3 inch) wide strips of insulation bonding adhesive at 200 mm (8 inches) on center all around duct. Additionally, secure insulation to bottom of ducts exceeding 600 mm (24 inches) in width with pins welded or adhered on 450 mm (18 inch) centers. Secure washers on pins. Butt insulation edges and seal joints with laps and butt strips. Staples shall be used to assist in securing insulation. Seal all vapor retarder penetrations with mastic. Sagging duct insulation shall not be acceptable. Install firestop duct insulation where required.
  2. Supply air ductwork to be insulated includes main and branch ducts from AHU discharge to room supply outlets, and the bodies of ceiling outlets to prevent condensation. Insulate sound attenuator units, coil casings and damper frames. To prevent condensation, insulate trapeze type supports and angle iron hangers for flat oval ducts that are in direct contact with metal duct.
  3. Concealed supply air ductwork.



- a. Above ceilings at a roof level, in attics, and duct work exposed to outdoor weather: 50 mm (2 inch) thick insulation faced with FSK.
  - b. Above ceilings for other than roof level: 40 mm (1 ½ inch) thick insulation faced with FSK.
4. Concealed return air duct:
- a. In attics and where exposed to outdoor weather: 50mm (2 inch)thick insulation faced with FSK.
  - b. Above ceilings at a roof level, unconditioned areas, and in chases with external wall or containing steam piping; 40 mm (1-1/2 inch) thick, insulation faced with FSK.
  - c. Concealed return air ductwork in other locations need not be insulated.
5. Concealed outside air duct: 40 mm (1-1/2 inch) thick insulation faced with FSK.
- C. Molded Mineral Fiber Pipe and Tubing Covering:
1. Fit insulation to pipe or duct, aligning longitudinal joints. Seal longitudinal joint laps and circumferential butt strips by rubbing hard with a nylon sealing tool to assure a positive seal. Staples shall be used to assist in securing insulation. Seal all vapor retarder penetrations on cold piping with a generous application of vapor barrier mastic.
  2. Contractor's options for fitting, flange and valve insulation:
    - a. Insulating and finishing cement for sizes less than 100 mm (4 inches) operating at surface temperature of 16 degrees C (61 degrees F) or more.
    - b. Factory premolded, one piece PVC covers with mineral fiber, (Form B), inserts. Provide two insert layers for pipe temperatures below 4 degrees C (40 degrees F), or above 121 degrees C (250 degrees F). Secure first layer of insulation with twine. Seal seam edges with vapor barrier mastic and secure with fitting tape.
    - c. Factory molded, ASTM C547 or field mitered sections, joined with adhesive or wired in place. For hot piping finish with a smoothing coat of finishing cement. For cold fittings, 16 degrees C (60 degrees F) or less, vapor seal with a layer of glass

fitting tape imbedded between two 2 mm (1/16 inch) coats of vapor barrier mastic.

- d. Fitting tape shall extend over the adjacent pipe insulation and overlap on itself at least 50 mm (2 inches).
  3. Nominal thickness in millimeters and inches specified in the schedule at the end of this section.
- D. Rigid Cellular Phenolic Foam:
1. Rigid closed cell phenolic insulation shall be provided for piping, ductwork and equipment for temperatures up to 121 degrees C (250 degrees F).
  2. Note the NFPA 90A burning characteristics requirements of 25/50 in paragraph 1.3.B.
  3. Provide secure attachment facilities such as welding pins.
  4. Apply insulation with joints tightly drawn together
  5. Apply adhesives, coverings, neatly finished at fittings, and valves.
  6. Final installation shall be smooth, tight, neatly finished at all edges.
  7. Minimum thickness in millimeters (inches) specified in the schedule at the end of this section.
  8. Exposed, unlined supply and return ductwork exposed to outdoor weather: 50 mm (2 inch) thick insulation faced with a multi-layer vapor barrier with a maximum water vapor permeance of 0.00 perms.
  9. Condensation control insulation: Minimum 25 mm (1.0 inch) thick for all pipe sizes.
    - a. HVAC: Cooling coil condensation piping to waste piping fixture or drain inlet.
- E. Flexible Elastomeric Cellular Thermal Insulation:
1. Apply insulation and fabricate fittings in accordance with the manufacturer's installation instructions and finish with two coats of weather resistant finish as recommended by the insulation manufacturer.
  2. Pipe and tubing insulation:
    - a. Use proper size material. Do not stretch or strain insulation.
    - b. To avoid undue compression of insulation, provide cork stoppers or wood inserts at supports as recommended by the insulation manufacturer. Insulation shields are specified under Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

- c. Where possible, slip insulation over the pipe or tubing prior to connection, and seal the butt joints with adhesive. Where the slip-on technique is not possible, slit the insulation and apply it to the pipe sealing the seam and joints with contact adhesive. Optional tape sealing, as recommended by the manufacturer, shall be employed. Make changes from mineral fiber insulation in a straight run of pipe, not at a fitting. Seal joint with tape.
3. Apply sheet insulation to flat or large curved surfaces with 100 percent adhesive coverage. For fittings and large pipe, apply adhesive to seams only.
  4. Pipe insulation: nominal thickness in millimeters (inches as specified in the schedule at the end of this section.
  5. Use Class S (Sheet), 20 mm (3/4 inch) thick for the following:
    - a. Chilled water pumps
  6. Exposed, unlined supply and return ductwork exposed to outdoor weather: 50 mm (2 inch) thick insulation faced with a multi-layer vapor barrier with a water vapor permeance of 0.001 perms.

**3.3 PIPE INSULATION SCHEDULE**

Provide insulation for piping systems as scheduled below:

<b>Insulation Thickness Millimeters (Inches)</b>					
		Nominal Pipe Size Millimeters (Inches)			
Operating Temperature Range/Service	Insulation Material	Less than 25 (1)	25 - 32 (1 - 1¼)	38 - 75 (1½ - 3)	100 (4) and Above
122-177 degrees C (251-350 degrees F) (HPS, MPS)	Mineral Fiber (Above ground piping only)	75 (3)	100 (4)	113 (4.5)	113 (4.5)
100-121 degrees C (212-250 degrees F) (HPR, MPR, LPS, vent piping from PRV Safety Valves, Condensate receivers and flash tanks)	Mineral Fiber (Above ground piping only)	62 (2.5)	62 (2.5)	75 (3.0)	75 (3.0)
100-121 degrees C (212-250 degrees F) (HPR, MPR, LPS, vent piping from PRV Safety Valves, Condensate receivers and flash tanks)	Rigid Cellular Phenolic Foam	50 (2.0)	50 (2.0)	75 (3.0)	75 (3.0)

38-94 degrees C (100-200 degrees F) (LPR, HWS, HWR)	Mineral Fiber (Above ground piping only)	38 (1.5)	38 (1.5)	50 (2.0)	50 (2.0)
38-99 degrees C (100-211 degrees F) (LPR, HWS, HWR)	Rigid Cellular Phenolic Foam	38 (1.5)	38 (1.5)	50 (2.0)	50 (2.0)
38-94 degrees C (100-200 degrees F) (LPR, HWS, HWR)	Flexible Elastomeric Cellular Thermal (Above ground piping only)	38 (1.5)	38 (1.5)	-----	-----
4-16 degrees C (40-60 degrees F) (CHS, CHR)	Rigid Cellular Phenolic Foam	38 (1.5)	38 (1.5)	38 (1.5)	38 (1.5)
(40-60 degrees F) (CHS, CHR, and RS for DX refrigeration)	Flexible Elastomeric Cellular Thermal (Above ground piping only)	38 (1.5)	38 (1.5)	38 (1.5)	38 (1.5)

- - - E N D - - -

**SECTION 23 21 13  
HYDRONIC PIPING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Water piping to connect HVAC equipment, including the following:
  - 1. Drain piping.
- B. A complete listing of common acronyms and abbreviations are included in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- C. Piping systems shall conform to ANSI and State rules for pressure piping where applicable. Welders and fitters shall be fully certified for work performed.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 23 05 11, COMMON WORK RESULTS FOR HVAC: General mechanical requirements and items, which are common to more than one section of Division 23.
- D. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- E. Section 23 07 11, HVAC AND BOILER PLANT INSULATION: Piping insulation.

**1.3 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. Where conflicts occur these specifications and the VHA standard shall govern.
- B. American Society of Mechanical Engineers (ASME):
  - B1.20.1-2013.....Pipe Threads, General Purpose (Inch)
  - B16.3-2011.....Malleable Iron Threaded Fittings: Classes 150 and 300
  - B16.4-2011.....Gray Iron Threaded Fittings: (Classes 125 and 250)
  - B16.5-2013.....Pipe Flanges and Flanged Fittings: NPS 1/2 through NPS 24 Metric/Inch Standard
  - B16.9-2012.....Factory Made Wrought Buttwelding Fittings
  - B16.11-2011.....Forged Fittings, Socket-Welding and Threaded
  - B16.18-2012.....Cast Copper Alloy Solder Joint Pressure Fittings

- B16.22-2013.....Wrought Copper and Copper Alloy Solder-Joint  
Pressure Fittings
- B16.24-2011.....Cast Copper Alloy Pipe Flanges and Flanged  
Fittings: Classes 150, 300, 600, 900, 1500, and  
2500
- B16.39-2014.....Malleable Iron Threaded Pipe Unions: Classes  
150, 250, and 300
- B16.42-06.....Ductile Iron Pipe Flanges and Flanged Fittings
- B31.9-2014.....Building Services Piping
- B40.100-2013.....Pressure Gauges and Gauge Attachments
- ASME Boiler and Pressure Vessel Code:  
BPVC Section VIII-2015..Rules for Construction of Pressure Vessels
- C. American Society for Testing and Materials (ASTM):  
A47/A47M-1999 (R2014)...Standard Specification for Ferritic Malleable  
Iron Castings
- A53/A53M-2012.....Standard Specification for Pipe, Steel, Black  
and Hot-Dipped, Zinc-Coated, Welded and  
Seamless
- A106/A106M-2015.....Standard Specification for Seamless Carbon  
Steel Pipe for High-Temperature Service
- A126-2004 (R2014).....Standard Specification for Gray Iron Castings  
for Valves, Flanges, and Pipe Fittings
- A183-2014.....Standard Specification for Carbon Steel Track  
Bolts and Nuts
- A216/A216M-2014e1.....Standard Specification for Steel Castings,  
Carbon, Suitable for Fusion Welding, for High-  
Temperature Service
- A307-2014.....Standard Specification for Carbon Steel Bolts,  
Studs, and Threaded Rod 60,000 PSI Tensile  
Strength
- A536-1984 (R2014).....Standard Specification for Ductile Iron  
Castings
- B62-2015.....Standard Specification for Composition Bronze  
or Ounce Metal Castings
- B88-2014.....Standard Specification for Seamless Copper  
Water Tube

- F439-2013.....Standard Specification for Chlorinated Poly  
(Vinyl Chloride) (CPVC) Plastic Pipe Fittings,  
Schedule 80
- F441/F441M-2015.....Standard Specification for Chlorinated Poly  
(Vinyl Chloride) (CPVC) Plastic Pipe, Schedules  
40 and 80
- D. American Welding Society (AWS):
  - B2.1/B2.1M-2014.....Standard for Welding Procedure and Performance  
Specification
- E. Expansion Joint Manufacturer's Association, Inc. (EJMA):
  - EJMA.....Expansion Joint Manufacturer's Association  
Standards, Tenth Edition
- F. Manufacturers Standardization Society (MSS) of the Valve and Fitting  
Industry, Inc.:
  - SP-67-2011.....Butterfly Valves
  - SP-70-2011.....Gray Iron Gate Valves, Flanged and Threaded  
Ends
  - SP-71-2011.....Gray Iron Swing Check Valves, Flanged and  
Threaded Ends
  - SP-80-2013.....Bronze Gate, Globe, Angle, and Check Valves
  - SP-85-2011.....Gray Iron Globe and Angle Valves, Flanged and  
Threaded Ends
  - SP-110-2010.....Ball Valves Threaded, Socket-Welding, Solder  
Joint, Grooved and Flared Ends
  - SP-125-2010.....Gray Iron and Ductile Iron In-line, Spring-  
Loaded, Center-Guided Check Valves
- G. Tubular Exchanger Manufacturers Association (TEMA):
  - TEMA Standards-2007.....9th Edition

**1.4 SUBMITTALS**

- A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 23 21 13, HYDRONIC PIPING", with applicable paragraph identification.
- C. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights,

materials, applications, standard compliance, model numbers, size, and capacity.

1. Pipe and equipment supports.
  2. Pipe and tubing, with specification, class or type, and schedule.
  3. Pipe fittings, including miscellaneous adapters and special fittings.
  4. Flanges, gaskets and bolting.
  5. Couplings and fittings.
  6. Valves of all types.
- D. Manufacturer's certified data report, Form No. U-1, for ASME pressure vessels:
- E. Submit the welder's qualifications in the form of a current (less than one-year old) and formal certificate.
- F. Coordination Drawings: Refer to paragraph, SUBMITTALS of Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- G. Complete operating and maintenance manuals including wiring diagrams, technical data sheets, information for ordering replacement parts, and troubleshooting guide:
1. Include complete list indicating all components of the systems.
  2. Include complete diagrams of the internal wiring for each item of equipment.
  3. Diagrams shall have their terminals identified to facilitate installation, operation and maintenance.

#### **1.5 QUALITY ASSURANCE**

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC, which includes welding qualifications.
- B. Submit prior to welding of steel piping a certificate of Welder's certification. The certificate shall be current and not more than one-year old.
- C. All couplings, fittings, valves, and specialties shall be the products of a single manufacturer.
1. All castings used for coupling housings, fittings, and valve bodies, shall be date stamped for quality assurance and traceability.

#### **1.6 AS-BUILT DOCUMENTATION**

- A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.



- B. Submit operation and maintenance data updated to include submittal review comments, VA approved substitutions and construction revisions shall be in electronic version on CD or DVD. All aspects of system operation and maintenance procedures, including applicable piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices shall be included. A List of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner shall be required to employ shall be inserted into the As-Built documentation.
- C. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. Shall the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement. Provide record drawings as follows:
1. Red-lined, hand-marked drawings shall be provided, with one paper copy and a scanned PDF version of the hand-marked drawings provided on CD or DVD.
- D. The as-built drawings shall indicate the location and type of all lockout/tagout points for all energy sources for all equipment and pumps to include breaker location and numbers, and valve tag numbers. Coordinate lockout/tagout procedures and practices with local VA requirements.
- E. Certification documentation shall be provided to COR 21 working days prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and provide documentation/certification that all results of tests were within limits specified. Test results shall contain written sequence of test procedure with written test results annotated at each step along with the expected outcome or setpoint. The

results shall include all readings, data on device (make, model and performance characteristics), normal pressures, switch ranges, trip points, amp readings, and calibration data to include equipment serial numbers or individual identifications

#### **1.7 SPARE PARTS**

- A. For mechanical pressed sealed fittings provide tools required for each pipe size used at the facility.

### **PART 2 - PRODUCTS**

#### **2.1 PIPE AND EQUIPMENT SUPPORTS, PIPE SLEEVES, AND WALL AND CEILING PLATES**

- A. Provide in accordance with Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

#### **2.2 PIPE AND TUBING**

- A. Cooling Coil Condensate Drain Piping:
  - 1. From fan coil or other terminal units: Copper water tube, ASTM B88, Type M for runouts and Type L for mains.
- B. Pipe supports, including insulation shields, for above ground piping: Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

#### **2.3 FITTINGS FOR COPPER TUBING**

- A. Joints:
  - 1. Solder Joints: Joints shall be made up in accordance with recommended practices of the materials applied. Apply 95/5 tin and antimony on all copper piping.
  - 2. Mechanically formed tee connection in water and drain piping: Form mechanically extracted collars in a continuous operation by drilling pilot hole and drawing out tube surface to form collar, having a height of not less than three times the thickness of tube wall. Adjustable collaring device shall ensure proper tolerance and complete uniformity of the joint. Notch and dimple joining branch tube in a single process to provide free flow where the branch tube penetrates the fitting.
- B. Bronze Flanges and Flanged Fittings: ASME B16.24.
- C. Fittings: ASME B16.18 cast copper or ASME B16.22 solder wrought copper.

#### **2.4 DIELECTRIC FITTINGS**

- A. Provide where copper tubing and ferrous metal pipe are joined.
- B. 50 mm (2 inches) and Smaller: Threaded dielectric union, ASME B16.39.

- C. 65 mm (2-1/2 inches) and Larger: Flange union with dielectric gasket and bolt sleeves, ASME B16.42. Dielectric gasket material shall be compatible with hydronic medium.
- D. Temperature Rating, 99 degrees C (210 degrees F).
- E. Contractor's option: On pipe sizes 50 mm (2 inch) and smaller, screwed end brass ball valves shall be used in lieu of dielectric unions.

## **2.5 SCREWED JOINTS**

- A. Pipe Thread: ASME B1.20.1.
- B. Lubricant or Sealant: Oil and graphite or other compound approved for the intended service.

## **2.6 VALVES**

- A. Asbestos packing is not acceptable.
- B. All valves of the same type shall be products of a single manufacturer.
- C. Provide chain operators for valves 150 mm (6 inches) and larger when the centerline is located 2.4 m (8 feet) or more above the floor or operating platform.
- D. Shut-Off Valves:
  - 1. Ball Valves (Pipe sizes 50 mm (2 inch) and smaller):
    - a. MSS SP-110, screwed or solder connections, brass or bronze body with chrome-plated ball with full port and Teflon seat at 2758 kPa (400 psig) working pressure rating. Provide stem extension to allow operation without interfering with pipe insulation.

## **2.7 FIRESTOPPING MATERIAL**

- A. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

## **PART 3 - EXECUTION**

### **3.1 GENERAL**

- A. If an installation is unsatisfactory to the COR, the Contractor shall correct the installation at no additional cost or time to the Government.
- B. The drawings show the general arrangement of pipe and equipment but do not show all required fittings and offsets that shall be necessary to connect pipes to equipment, fan-coils, coils, radiators, and to coordinate with other trades. Provide all necessary fittings, offsets and pipe runs based on field measurements and at no additional cost or time to the Government. Coordinate with other trades for space available and relative location of HVAC equipment and accessories to be connected on ceiling grid. Pipe location on the drawings shall be

altered by contractor where necessary to avoid interferences and clearance difficulties.

- C. Store materials to avoid excessive exposure to weather or foreign materials. Keep inside of piping relatively clean during installation and protect open ends when work is not in progress.
- D. Support piping securely. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
  - 1. Install heat exchangers at height sufficient to provide for installation of traps and to allow gravity flow of condensate to the flash tank and condensate pump.
  - 2. Install cooling coils at a height sufficient to provide for installation of condensate drain trap to allow for gravity flow of condensate drain piping.
- E. Install piping generally parallel to walls and column center lines, unless shown otherwise on the drawings. Space piping, including insulation, to provide 25 mm (1 inch) minimum clearance between adjacent piping or other surface. Unless shown otherwise, slope drain piping down in the direction of flow not less than 25 mm (1 inch) in 12 m (40 feet). Provide eccentric reducers to keep bottom of sloped piping flat.
- F. Locate and orient valves to permit proper operation and access for maintenance of packing, seat and disc. Generally, locate valve stems in overhead piping in horizontal position. Provide a union adjacent to one end of all threaded end valves. Control valves usually require reducers to connect to pipe sizes shown on the drawing. Install butterfly valves with the valve open as recommended by the manufacturer to prevent binding of the disc in the seat.
- G. Offset equipment connections to allow valving off for maintenance and repair with minimal removal of piping. Provide flexibility in equipment connections and branch line take-offs with 3-elbow swing joints where appropriate.
- H. Tee water piping runouts or branches into the side of mains or other branches. Avoid bull-head tees, which are two return lines entering opposite ends of a tee and exiting out the common side.
- I. Provide manual or automatic air vent at all piping system high points and drain valves at all low points. Install piping to floor drains from all automatic air vents.

- J. Connect piping to equipment as shown on the drawings. Install components furnished by others such as:
  - 1. Flow elements (orifice unions), control valve bodies, flow switches, pressure taps with valve, and wells for sensors.
- K. Thermometer Wells: In pipes 65 mm (2-1/2 inches) and smaller increase the pipe size to provide free area equal to the upstream pipe area.
- L. Firestopping: Fill openings around uninsulated piping penetrating floors or fire walls, with firestop material. For firestopping insulated piping refer to Section 23 07 11, HVAC AND BOILER PLANT INSULATION.
- M. Where copper piping is connected to steel piping, provide dielectric connections.
- N. Install piping in a first-class manner (plumb and neat).

### **3.2 PIPE JOINTS**

- A. Welded: Beveling, spacing and other details shall conform to ASME B31.9 and AWS B2.1/B2.1M. See Welder's qualification requirements under "Quality Assurance" in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Screwed: Threads shall conform to ASME B1.20.1; joint compound shall be applied to male threads only and joints made up so no more than three threads show. Coat exposed threads on steel pipe with joint compound, or red lead paint for corrosion protection.
- C. 125 Pound Cast Iron Flange (Plain Face): Mating flange shall have raised face, if any, removed to avoid overstressing the cast iron flange.
- D. Solvent Welded Joints: As recommended by the manufacturer.

### **3.3 STARTUP AND TESTING**

- A. Perform tests as recommended by product manufacturer and listed standards and under actual or simulated operating conditions and prove full compliance with design and specified requirements. Tests of the various items of equipment shall be performed simultaneously with the system of which each item is an integral part.
- B. When any defects are detected, correct defects and repeat test at no additional cost or time to the Government.

### **3.4 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for 4 hours to instruct each VA personnel responsible in operation and maintenance of the system.

Dayton Veterans Medical Center  
Replace Elevator Controls (Hospital Complex)  
552-19-106

07-01-15  
100% Construction Documents  
December 16, 2019

- - - E N D - - -

**SECTION 23 23 00**  
**REFRIGERANT PIPING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Factory or field refrigerant piping for direct expansion HVAC systems, including required pipe insulation.
- B. Pipe arrangement, devices and sizing information shown on the drawings is limited due to variations in equipment manufacturers' requirements. The equipment supplier shall prepare project-specific drawings of each piping system showing numbers and sizes of piping, devices and accessories, coil circuitry, traps, double suction risers and other such detail required for the application shown on the drawings and as specified herein. Drawings shall be submitted for review with the equipment shop drawings.
- C. Refrigerant piping shall be sized, selected, and designed either by the equipment manufacturer or in strict accordance with the manufacturer's published instructions. The refrigerant piping drawings shall show all accessories such as, stop valves, level indicators, liquid receivers, oil separator, gauges, thermostatic expansion valves, solenoid valves, moisture separators and driers to make a complete installation.
- D. The equipment supplier shall provide piping installation instructions to the Installing Contractor and supervision as needed to ensure that the piping system is installed in accordance with the equipment manufacturer's recommendations.
- E. Definitions:
  - 1. Refrigerating system: Combination of interconnected refrigerant-containing parts constituting one closed refrigeration circuit in which a refrigerant is circulated for the purpose of extracting heat.
    - a. Low side means the parts of a refrigerating system subjected to evaporator pressure.
    - b. High side means the parts of a refrigerating system subjected to condenser pressure.
  - 2. Brazed joint: A gas-tight joint obtained by the joining of metal parts with alloys which melt at temperatures higher than 449 degrees C (840 degrees F) but less than the melting temperatures of the joined parts.

## **1.2 RELATED WORK**

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Section 23 07 11, HVAC, AND BOILER PLANT INSULATION.
- C. Section 23 21 13, HYDRONIC PIPING.
- D. Section 23 81 00, DECENTRALIZED UNITARY HVAC EQUIPMENT.

## **1.3 QUALITY ASSURANCE**

- A. Refer to specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Comply with ASHRAE Standard 15, Safety Code for Mechanical Refrigeration. The application of this Code is intended to assure the safe design, construction, installation, operation, and inspection of every refrigerating system employing a fluid which normally is vaporized and liquefied in its refrigerating cycle.
- C. Comply with ASME B31.5: Refrigerant Piping and Heat Transfer Components.
- D. Products shall comply with UL 207 "Refrigerant-Containing Components and Accessories, "Nonelectrical"; or UL 429 "Electrical Operated Valves."

## **1.4 SUBMITTALS**

- A. Submit in accordance with specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings:
  - 1. Complete information for components noted, including valves and refrigerant piping accessories, clearly presented, shall be included to determine compliance with drawings and specifications for components noted below:
    - a. Tubing and fittings
    - b. Valves
    - c. Strainers
    - d. Moisture-liquid indicators
    - e. Filter-driers
    - f. Flexible metal hose
    - g. Liquid-suction interchanges
    - h. Oil separators (when specified)
    - i. Gages
    - j. Pipe and equipment supports
    - k. Refrigerant and oil
    - l. Pipe/conduit roof penetration cover



- m. Soldering and brazing materials
- 2. Layout of refrigerant piping and accessories, including flow capacities, valves locations, and oil traps slopes of horizontal runs, floor/wall penetrations, and equipment connection details.
- C. Certification: Copies of certificates for welding procedure, performance qualification record and list of welders' names and symbols.
- D. Design Manual: Furnish two copies of design manual of refrigerant valves and accessories.

**1.5 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Conditioning, Heating, and Refrigeration Institute (ARI/AHRI):
  - 495-1999 (R2002).....Standard for Refrigerant Liquid Receivers
  - 730-2005.....Flow Capacity Rating of Suction-Line Filters and Suction-Line Filter-Driers
  - 750-2007.....Thermostatic Refrigerant Expansion Valves
  - 760-2007.....Performance Rating of Solenoid Valves for Use with Volatile Refrigerants
- C. American Society of Heating Refrigerating and Air Conditioning Engineers (ASHRAE):
  - ANSI/ASHRAE 15-2007.....Safety Standard for Refrigeration Systems (ANSI)
  - ANSI/ASHRAE 17-2008.....Method of Testing Capacity of Thermostatic Refrigerant Expansion Valves (ANSI)
  - 63.1-95 (RA 01).....Method of Testing Liquid Line Refrigerant Driers (ANSI)
- D. American National Standards Institute (ANSI):
  - ASME (ANSI)A13.1-2007...Scheme for Identification of Piping Systems
  - Z535.1-2006.....Safety Color Code
- E. American Society of Mechanical Engineers (ASME):
  - ANSI/ASME B16.22-2001 (R2005)  
Wrought Copper and Copper Alloy Solder-Joint Pressure Fittings (ANSI)
  - ANSI/ASME B16.24-2006...Cast Copper Alloy Pipe Flanges and Flanged Fittings, Class 150, 300, 400, 600, 900, 1500 and 2500 (ANSI)ANSI/ASME B31.5-2006

Refrigeration Piping and Heat Transfer

Components (ANSI)

ANSI/ASME B40.100-2005..Pressure Gauges and Gauge Attachments

ANSI/ASME B40.200-2008..Thermometers, Direct Reading and Remote Reading

F. American Society for Testing and Materials (ASTM)

A126-04.....Standard Specification for Gray Iron Castings  
for Valves, Flanges, and Pipe FittingsB32-08

Standard Specification for Solder Metal

B88-03.....Standard Specification for Seamless Copper  
Water Tube

B88M-05.....Standard Specification for Seamless Copper  
Water Tube (Metric)

B280-08.....Standard Specification for Seamless Copper Tube  
for Air Conditioning and Refrigeration Field  
Service

G. American Welding Society, Inc. (AWS):

Brazing Handbook

A5.8/A5.8M-04.....Standard Specification for Filler Metals for  
Brazing and Braze Welding

H. Federal Specifications (Fed. Spec.)

Fed. Spec. GG

I. Underwriters Laboratories (U.L.):

U.L.207-2009.....Standard for Refrigerant-Containing Components  
and Accessories, Nonelectrical

U.L.429-99 (Rev.2006)...Standard for Electrically Operated Valves

**PART 2 - PRODUCTS**

**2.1 PIPING AND FITTINGS**

A. Refrigerant Piping: For piping up to 100 mm (4 inch) use Copper refrigerant tube, ASTM B280, cleaned, dehydrated and sealed, marked ACR on hard temper straight lengths. Coils shall be tagged ASTM B280 by the manufacturer. For piping over 100 mm (4 inch) use A53 Black SML steel.

B. Water and Drain Piping: Copper water tube, ASTM B88M, Type B or C (ASTM B88, Type M or L).

C. Fittings, Valves and Accessories:

1. Copper fittings: Wrought copper fittings, ASME B16.22.

a. Brazed Joints, refrigerant tubing: Cadmium free, AWS A5.8/A5.8M, 45 percent silver brazing alloy, Class BAg-5.

- b. Solder Joints, water and drain: 95-5 tin-antimony, ASTM B32 (95TA).
- 2. Steel fittings: ASTM wrought steel fittings.
  - a. Refrigerant piping - Welded Joints.
- 3. Flanges and flanged fittings: ASME B16.24.
- 4. Refrigeration Valves:
  - a. Stop Valves: Brass or bronze alloy, packless, or packed type with gas tight cap, frost proof, back seating.
  - b. Pressure Relief Valves: Comply with ASME Boiler and Pressure Vessel Code; UL listed. Forged brass with nonferrous, corrosion resistant internal working parts of high strength, cast iron bodies conforming to ASTM A126, Grade B. Set valves in accordance with ASHRAE Standard 15.
  - c. Solenoid Valves: Comply with ARI 760 and UL 429, UL-listed, two-position, direct acting or pilot-operated, moisture and vapor-proof type of corrosion resisting materials, designed for intended service, and solder-end connections. Fitted with suitable NEMA 250 enclosure of type required by location and normally open or closed holding coil as appropriate for the application.
  - d. Thermostatic Expansion Valves: Comply with ARI 750. Brass body with stainless-steel or non-corrosive non ferrous internal parts, diaphragm and spring-loaded (direct-operated) type with sensing bulb and distributor having side connection for hot-gas bypass and external equalizer. Size and operating characteristics as recommended by manufacturer of evaporator and factory set for superheat requirements. Solder-end connections. Testing and rating in accordance with ASHRAE Standard 17.
  - e. Check Valves: Brass or bronze alloy with swing or lift type, with tight closing resilient seals for silent operation; designed for low pressure drop, and with solder-end connections. Direction of flow shall be legibly and permanently indicated on the valve body.
- 5. Strainers: Designed to permit removing screen without removing strainer from piping system, and provided with screens 80 to 100 mesh in liquid lines DN 25 (NPS 1) and smaller, 60 mesh in liquid lines larger than DN 25 (NPS 1), and 40 mesh in suction lines.

- Provide strainers in liquid line serving each thermostatic expansion valve, and in suction line serving each refrigerant compressor not equipped with integral strainer.
6. Refrigerant Moisture/Liquid Indicators: Double-ported type having heavy sight glasses sealed into forged bronze body and incorporating means of indicating refrigerant charge and moisture indication. Provide screwed brass seal caps.
  7. Refrigerant Filter-Dryers: UL listed, angle or in-line type, as shown on drawings. Conform to ARI Standard 730 and ASHRAE Standard 63.1. Heavy gage steel shell protected with corrosion-resistant paint; perforated baffle plates to prevent desiccant bypass. Size as recommended by manufacturer for service and capacity of system with connection not less than the line size in which installed. Filter driers with replaceable filters shall be furnished with one spare element of each type and size.
  8. Flexible Metal Hose: Seamless bronze corrugated hose, covered with bronze wire braid, with standard copper tube ends. Provide in suction and discharge piping of each compressor.
  9. Water Piping Valves and Accessories: Refer to specification Section 23 21 13, HYDRONIC PIPING.
  10. Receivers (where required by equipment manufacturer): Conform to AHRI 495, steel construction, equipped with tappings for liquid inlet and outlet valves, pressure relief valve and liquid level indicator.

## **2.2 GAGES**

- A. Temperature Gages: Comply with ASME B40.200. Industrial-duty type and in required temperature range for service in which installed. Gages shall have Celsius scale in 1-degree (Fahrenheit scale in 2-degree) graduations and with black number on a white face. The pointer shall be adjustable. Rigid stem type temperature gages shall be provided in thermal wells located within 1525 mm (5 feet) of the finished floor. Universal adjustable angle type or remote element type temperature gages shall be provided in thermal wells located 1525 to 2135 mm (5 to 7 feet) above the finished floor. Remote element type temperature gages shall be provided in thermal wells located 2135 mm (7 feet) above the finished floor.

B. Vacuum and Pressure Gages: Comply with ASME B40.100 and provide with throttling type needle valve or a pulsation dampener and shut-off valve. Gage shall be a minimum of 90 mm (3-1/2 inches) in diameter with a range from 0 kPa (0 psig) to approximately 1.5 times the maximum system working pressure. Each gage range shall be selected so that at normal operating pressure, the needle is within the middle-third of the range.

1. Suction: 101 kPa (30 inches Hg) vacuum to 1723 kPa (gage) (250 psig).
2. Discharge: 0 to 3445 kPa (gage) (0 to 500 psig).

### **2.3 PIPE SUPPORTS**

A. Refer to specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

### **2.4 REFRIGERANTS AND OIL**

A. Provide EPA approved refrigerant and oil for proper system operation.

### **2.5 PIPE/CONDUIT ROOF PENETRATION COVER**

- A. Prefabricated Roof Curb: Galvanized steel or extruded aluminum, minimum 450 mm (18 inches) height above roof deck/300 mm (12 inches) above finished roof surface, continuous welded corner seams, treated wood nailer, 38 mm (1-1/2 inch) thick, 48 kg/cu.m (3 lb/cu.ft.) density rigid mineral fiberboard insulation with metal liner, built-in cant strip (except for gypsum or tectum decks). For surface insulated roof deck, provide raised cant strip (recessed mounting flange) to start at the upper surface of the insulation. Curbs shall be constructed for pitched roof or ridge mounting as required to keep top of curb level.
- B. Penetration Cover: Galvanized sheet metal with flanged removable top. Provide 38 mm (1-1/2 inch) thick mineral fiber board insulation.
- C. Flashing Sleeves: Provide sheet metal sleeves for conduit and pipe penetrations of the penetration cover. Seal watertight penetrations.

### **2.6 PIPE INSULATION FOR DX HVAC SYSTEMS**

A. Refer to specification Section 23 07 11, HVAC, AND BOILER PLANT INSULATION.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Install refrigerant piping and refrigerant containing parts in accordance with ASHRAE Standard 15 and ASME B31.5
1. Install piping as short as possible, with a minimum number of joints, elbows and fittings.

2. Install piping with adequate clearance between pipe and adjacent walls and hangers to allow for service and inspection. Space piping, including insulation, to provide 25 mm (1 inch) minimum clearance between adjacent piping or other surface. Use pipe sleeves through walls, floors, and ceilings, sized to permit installation of pipes with full thickness insulation.
  3. Locate and orient valves to permit proper operation and access for maintenance of packing, seat and disc. Generally locate valve stems in overhead piping in horizontal position. Provide a union adjacent to one end of all threaded end valves. Control valves usually require reducers to connect to pipe sizes shown on the drawing.
  4. Use copper tubing in protective conduit when installed below ground.
  5. Install hangers and supports per ASME B31.5 and the refrigerant piping manufacturer's recommendations.
- B. Joint Construction:
1. Brazed Joints: Comply with AWS "Brazing Handbook" and with filler materials complying with AWS A5.8/A5.8M.
    - a. Use Type BcuP, copper-phosphorus alloy for joining copper socket fittings with copper tubing.
    - b. Use Type BAg, cadmium-free silver alloy for joining copper with bronze or steel.
    - c. Swab fittings and valves with manufacturer's recommended cleaning fluid to remove oil and other compounds prior to installation.
    - d. Pass nitrogen gas through the pipe or tubing to prevent oxidation as each joint is brazed. Cap the system with a reusable plug after each brazing operation to retain the nitrogen and prevent entrance of air and moisture.
- C. Protect refrigerant system during construction against entrance of foreign matter, dirt and moisture; have open ends of piping and connections to compressors, condensers, evaporators and other equipment tightly capped until assembly.
- D. Pipe relief valve discharge to outdoors for systems containing more than 45 kg (100 lbs) of refrigerant.
- E. Firestopping: Fill openings around uninsulated piping penetrating floors or fire walls, with firestop material. For firestopping insulated piping refer to Section 23 07 11, HVAC, AND BOILER PLANT INSULATION.

### **3.2 PIPE AND TUBING INSULATION**

- A. Refer to specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Apply two coats of weather-resistant finish as recommended by the manufacturer to insulation exposed to outdoor weather.

### **3.3 SIGNS AND IDENTIFICATION**

- A. Each refrigerating system erected on the premises shall be provided with an easily legible permanent sign securely attached and easily accessible, indicating thereon the name and address of the installer, the kind and total number of pounds of refrigerant required in the system for normal operations, and the field test pressure applied.
- B. Systems containing more than 50 kg (110 lb) of refrigerant shall be provided with durable signs, in accordance with ANSI A13.1 and ANSI Z535.1, having letters not less than 13 mm (1/2 inch) in height designating:
  - 1. Valves and switches for controlling refrigerant flow, the ventilation and the refrigerant compressor(s).
  - 2. Signs on all exposed high pressure and low pressure piping installed outside the machinery room, with name of the refrigerant and the letters "HP" or "LP."

### **3.4 FIELD QUALITY CONTROL**

- A. Prior to initial operation examine and inspect piping system for conformance to plans and specifications and ASME B31.5. Correct equipment, material, or work rejected because of defects or nonconformance with plans and specifications, and ANSI codes for pressure piping.
- B. After completion of piping installation and prior to initial operation, conduct test on piping system according to ASME B31.5. Furnish materials and equipment required for tests. Perform tests in the presence of the COR. If the test fails, correct defects and perform the test again until it is satisfactorily done and all joints are proved tight.
  - 1. Every refrigerant-containing parts of the system that is erected on the premises, except compressors, condensers, evaporators, safety devices, pressure gages, control mechanisms and systems that are factory tested, shall be tested and proved tight after complete installation, and before operation.

2. The high and low side of each system shall be tested and proved tight at not less than the lower of the design pressure or the setting of the pressure-relief device protecting the high or low side of the system, respectively, except systems erected on the premises using non-toxic and non-flammable Group A1 refrigerants with copper tubing not exceeding DN 18 (NPS 5/8). This shall be tested by means of the refrigerant charged into the system at the saturated vapor pressure of the refrigerant at 20 degrees C (68 degrees F) minimum.
- C. Test Medium: A suitable dry gas such as nitrogen or shall be used for pressure testing. The means used to build up test pressure shall have either a pressure-limiting device or pressure-reducing device with a pressure-relief device and a gage on the outlet side. The pressure relief device shall be set above the test pressure but low enough to prevent permanent deformation of the system components.

### **3.5 SYSTEM TEST AND CHARGING**

- A. System Test and Charging: As recommended by the equipment manufacturer or as follows:
1. Connect a drum of refrigerant to charging connection and introduce enough refrigerant into system to raise the pressure to 70 kPa (10 psi) gage. Close valves and disconnect refrigerant drum. Test system for leaks with halide test torch or other approved method suitable for the test gas used. Repair all leaking joints and retest.
  2. Connect a drum of dry nitrogen to charging valve and bring test pressure to design pressure for low side and for high side. Test entire system again for leaks.
  3. Evacuate the entire refrigerant system by the triplicate evacuation method with a vacuum pump equipped with an electronic gage reading in mPa (microns). Pull the system down to 665 mPa (500 microns) 665 mPa (2245.6 inches of mercury at 60 degrees F) and hold for four hours then break the vacuum with dry nitrogen (or refrigerant). Repeat the evacuation two more times breaking the third vacuum with the refrigeration to be charged and charge with the proper volume of refrigerant.

- - - E N D - - -



**SECTION 23 81 00**  
**DECENTRALIZED UNITARY HVAC EQUIPMENT**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies split-systems, room-type, air conditioners.
- B. Definitions:
  - 1. Energy Efficiency Ratio (EER): The ratio of net cooling capacity is Btu/h to total rate of electricity input in watts under designated operating conditions (Btu hour/Watt).
  - 2. Seasonal Energy Efficiency Ratio (EER): The ratio of the total cooling output of an air conditioner during its normal annual usage period for cooling in Btu/h divided by total electric energy input in watts during the same period (Btu hour/Watt).
  - 3. Unitary: A Unitary Air Conditioner consists of one or more factory-made assemblies which normally include an evaporator or cooling coil, a compressor and condenser combination, and shall include a heating function as well.
  - 4. Where such equipment is provided in more than one assembly the separated assemblies shall be designed to be used together and the requirements of rating are based upon use of matched assemblies.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS: Requirements for pre-test of equipment.
- B. Section 23 05 11, COMMON WORK RESULTS FOR HVAC: General mechanical requirements and items, which are common to more than one section of Division 23.
- C. Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT: Requirements for different types of vibration isolators and noise ratings in the occupied areas.
- D. Section 23 07 11, HVAC AND BOILER PLANT INSULATION: Requirements for piping insulation.
- F. Section 23 23 00, REFRIGERANT PIPING: Requirements for refrigerant pipes and fittings.

**1.3 QUALITY ASSURANCE**

- A. Refer to specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Safety Standards: ASHRAE Standard 15, Safety Code for Mechanical Refrigeration.

**1.4 SUBMITTALS**

- A. Submit in accordance with specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES
- B. Manufacturer's literature and data:
  - 1. Sufficient information, including capacities, pressure drops and piping connections clearly presented, shall be included to determine compliance with drawings and specifications for units noted below:
    - a. Unitary air conditioners:
      - 1) Split systems
  - 2. Unit Dimensions required clearances, operating weights accessories and start-up instructions.
  - 3. Electrical requirements, wiring diagrams, interlocking and control wiring showing factory installed and portions to be field installed.
  - 4. Mounting and flashing of the roof curb to the roofing structure with coordinating requirements for the roof membrane system.
- C. Certification: Submit proof of specified ARI Certification.
- D. Performance Rating: Submit catalog selection data showing equipment ratings and compliance with required sensible-to-heat-ratio, energy efficiency ratio (EER), and coefficient of performance (COP).
- E. Operating and Maintenance Manual: Submit three copies of Operating and Maintenance manual to COR three weeks prior to final inspection.

**1.5 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Federal Specifications (Fed. Spec.):
  - A-A-50502-90..... Air conditioner (Unitary Heat Pump) Air to Air  
(3000-300,000 Btu)
- C. Military Specifications (Mil. Specs.):
  - MIL-PRF-26915D-06.....Primer Coating, for Steel Surfaces
- D. Air-Conditioning, Heating, and Refrigeration Institute (AHRI):
  - 210/240-08.....Performance Rating of Unitary Air-Conditioning  
and Air-Source Heat Pump Equipment
  - 270-08.....Sound Rating of Outdoor Unitary Equipment
  - 310/380-04.....Standard for Packaged Terminal Air-Conditioners  
and Heat Pumps (CSA-C744-04)

- 340/360-07.....Performance Rating of Commercial and Industrial Unitary Air-Conditioning and Heat Pump Equipment
- 520-04.....Performance Rating of Positive Displacement Condensing Units
- E. Air Movement and Control Association (AMCA):
  - 210-07.....Laboratory Methods of Testing Fans for Aerodynamic Performance Rating (ANSI)
  - 410-96.....Recommended Safety Practices for Users and Installers of Industrial and Commercial Fans
- F. American National Standards Institute (ANSI):
  - S12.51-02(R2007).....Acoustics - Determination of Sound Power Levels of Noise Sources Using Sound Pressure - Precision Method for Reverberation Rooms (same as ISO 3741:1999)
- G. American Society of Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE):
  - 2008 Handbook.....HVAC Systems and Equipment
  - 15-10.....Safety Standard for Refrigeration Systems (ANSI)
- H. American Society of Testing and Materials (ASTM):
  - B117-09.....Standard Practice for Operating Salt Spray (Fog) Apparatus
- I. American Society of Civil Engineers (ASCE)
  - ASCE 7-10.....Minimum Design Loads for Buildings and Other Structures
- J. National Electrical Manufacturer's Association (NEMA):
  - MG 1-09 (R2010).....Motors and Generators (ANSI)
  - ICS 1-00 (R2005, R2008).Industrial Controls and Systems: General Requirements
- K. National Fire Protection Association (NFPA) Publications:
  - 90A-09.....Standard for the Installation of Air-Conditioning and Ventilating Systems

**PART 2 - PRODUCTS**

**2.1 UNITARY AIR CONDITIONERS - GENERAL**

- A. Applicable ARI Standards:
  - 1. Cooling Capacity 39.6 kW (135,000 Btu/h) and More: AHRI 340/ 360.

2. Cooling Capacity Less Than 39.6 kW (135,000 Btu/h): AHRI 210/240.

Units shall be listed in the ARI Directory of Certified Unitary Air-Conditioners.

- B. Performance Rating: Cooling capacity of units shall meet the sensible heat and total heat requirements shown in the contract documents. In selecting unit size, make true allowance for "sensible to total heat ratio" to satisfy required sensible cooling capacity.
- C. Machinery Guards: Provide guards as shown in AMCA 410 for belts, chains, couplings, pulleys, sheaves, shafts, gears and other moving parts regardless of height above the floor. Drive guards shall be excluded where motors and drives are inside factory fabricated casings.
- D. Corrosion Prevention: Unless specified otherwise, equipment fabricated from ferrous metals that do not have a zinc coating or a duplex coating of zinc and paint shall be treated for prevention of rust with a factory coating or paint system that shall withstand 125 hours in a salt-spray fog test, except that equipment located outdoors shall be tested for 500 hours. The salt-spray fog test shall be in accordance with ASTM B117 using a 20 percent sodium chloride solution. Immediately after completion of the test, the coating shall show no signs of blistering, wrinkling or cracking, no loss of adhesion, and the specimen shall show no signs of rust beyond 3 mm (1/8-inch) on both sides from the scratch mark.

### **2.3 SPLIT-SYSTEM AIR CONDITIONERS**

- A. Description: Factory assembled and tested, wall-mounted unit, as indicated on the drawings, with an air-cooled remote condensing unit, and field-installed refrigeration piping.
- B. Wall-Mounting, Evaporator-Fan Components:
  - 1. Cabinet: Enameled steel with removable panels on front and ends in color selected by Architect, and discharge drain pans with drain connection.
  - 2. Airstream Surfaces: Surfaces in contact with the airstream shall comply with requirements in ASHRAE 62.1, latest edition.
  - 3. Drain Pan and Drain Connection: Comply with ASHRAE 62.1, latest edition.
  - 4. Refrigerant Coil: Copper tube, with mechanically bonded aluminum fins, complying with AHRI 210/240, and with thermal-expansion valve.

5. Electric-Resistance Heating Coil: Helical, nickel-chrome, resistance-wire heating elements with refractory ceramic support bushings; automatic-reset thermal cutout; built-in magnetic contactors; manual-reset thermal cutout; airflow proving device; and one-time fuses in terminal box for overcurrent protection.
6. Fan: Direct drive, centrifugal fan.
7. Fan Motors: Comply with requirements in Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT for multi-tapped, multi-speed motors with internal thermal protection and permanent lubrication.
8. Filters: Disposable, with MERV rating of 7 or higher according to ASHRAE 52.2.

F. Air-Cooled, Compressor-Condenser Components:

1. Casing: Steel, finished with baked enamel in color selected by Architect, with removable panels for access to controls, weep holes for water drainage, and mounting holes in base. Service valves, fittings, and gage ports shall be brass and located outside of the casing.
2. Compressor: Hermetically sealed scroll with crankcase heater and mounted on vibration isolation. Compressor motor shall have thermal- and current-sensitive overload devices, start capacitor, relay, and contactor.
3. Compressor motor with manual-reset, high-pressure switch and automatic-reset, low-pressure switch.
4. Refrigerant: R-410A unless otherwise indicated.
5. Refrigerant Coil: Copper tube, with mechanically bonded aluminum fins, complying with AHRI 210/240, and with liquid subcooler.
6. Fan: Aluminum, propeller type, directly connected to motor.
7. Motor: Permanently lubricated, with integral thermal-overload protection.
8. Low Ambient Kit: Permit operation down to minus 18 deg C (0 deg F).
9. Mounting Base: Polyethylene.
10. Minimum Energy Efficiency: Comply with ASHRAE/IESNA 90.1, latest edition, "Energy Standard for Buildings except Low-Rise Residential Buildings."

**PART 3 EXECUTION**

**3.1 INSTALLATION**

- A. Install wind restraints according to manufacturer's written instructions. Wind and seismically restrained vibration isolation roof-curb rails are specified in Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.]
- B. Install units level and plumb maintaining manufacturer's recommended clearances and tolerances.
- C. Install roof-mounting compressor-condenser components on equipment supports. Anchor units to supports with removable, cadmium-plated fasteners.
- D. Install compressor-condenser components on restrained, spring isolators with a minimum static deflection of 25 mm (1 inch) unless otherwise indicated. Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- E. Install and connect precharged refrigerant tubing to component's quick-connect fittings. Install tubing to allow access to unit.
- F. Install wall sleeves in finished wall assembly and weatherproof. Install and anchor wall sleeves to withstand, without damage seismic forces as required by code.

### **3.2 CONNECTIONS**

- A. Verify condensate drainage requirements.
- B. Install condensate drain, minimum connection size, with trap and indirect connection to nearest roof drain or area drain.
- C. Install piping adjacent to units to allow service and maintenance.
- E. Install ducts to termination at top of roof curb. Cut roof decking only as required for passage of ducts. Do not cut out decking under entire roof curb.
- G. Install return-air duct continuously through roof structure.
- H. Install normal-weight, 20.7-MPa (3000-psi), compressive strength (28-day) concrete mix inside roof curb, 100 mm (4 inches) thick.
- I. Ground equipment and install power wiring, switches, and controls for self contained and split systems.
- J. Connect refrigerant piping to coils with shutoff valves on the suction and liquid lines at the coil and a union or flange at each connection at the coil and condenser.
- K. Install ducts to the units with flexible duct connections.

- L. Connect piping with shutoff duty valves on the supply and return side of the coil and unions at all connections and with a throttling valve on the return piping near the coil.
- M. Connect piping with shutoff duty valves and unions on the steam supply and condensate side of the steam coil. On the condensate line near the coil provide a strainer, trap and shutoff valve.

### **3.3 FIELD QUALITY CONTROL**

- A. Perform tests and inspections and prepare test reports.
- B. Tests and Inspections: After installing units and after electrical circuitry has been energized, test units for compliance with requirements. Inspect for and remove shipping bolts, blocks, and tie-down straps. After electrical circuitry has been energized, start units to confirm proper motor rotation and unit operation. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment. Remove and replace malfunctioning units and retest as specified above.

### **3.4 INSTRUCTIONS**

Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.

### **3.5 STARTUP AND TESTING**

The Commissioning Agent shall observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with the COR and Commissioning Agent. Provide a minimum of 7 days prior notice.

### **3.6 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.

---END---

**SECTION 26 05 11**  
**REQUIREMENTS FOR ELECTRICAL INSTALLATIONS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section applies to all sections of Division 26.
- B. Furnish and install electrical systems, materials, equipment, and accessories in accordance with the specifications and drawings. Capacities and ratings of motors, conductors and cable, panelboards, and other items and arrangements for the specified items are shown on the drawings.
- C. Conductor ampacities specified or shown on the drawings are based on copper conductors, with the conduit and raceways sized per NEC. Aluminum conductors are prohibited.

**1.2 MINIMUM REQUIREMENTS**

- A. The latest International Building Code (IBC), Underwriters Laboratories, Inc. (UL), Institute of Electrical and Electronics Engineers (IEEE), and National Fire Protection Association (NFPA) codes and standards are the minimum requirements for materials and installation.
- B. The drawings and specifications shall govern in those instances where requirements are greater than those stated in the above codes and standards.

**1.3 TEST STANDARDS**

- A. All materials and equipment shall be listed, labeled, or certified by a Nationally Recognized Testing Laboratory (NRTL) to meet Underwriters Laboratories, Inc. (UL), standards where test standards have been established. Materials and equipment which are not covered by UL standards shall be accepted, providing that materials and equipment are listed, labeled, certified or otherwise determined to meet the safety requirements of a NRTL. Materials and equipment which no NRTL accepts, certifies, lists, labels, or determines to be safe, shall be considered if inspected or tested in accordance with national industrial standards, such as ANSI, NEMA, and NETA. Evidence of compliance shall include certified test reports and definitive shop drawings.
- B. Definitions:
  - 1. Listed: Materials and equipment included in a list published by an organization that is acceptable to the Authority Having Jurisdiction



- and concerned with evaluation of products or services, that maintains periodic inspection of production or listed materials and equipment or periodic evaluation of services, and whose listing states that the materials and equipment either meets appropriate designated standards or has been tested and found suitable for a specified purpose.
2. **Labeled:** Materials and equipment to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the Authority Having Jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled materials and equipment, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.
  3. **Certified:** Materials and equipment which:
    - a. Have been tested and found by a NRTL to meet nationally recognized standards or to be safe for use in a specified manner.
    - b. Are periodically inspected by a NRTL.
    - c. Bear a label, tag, or other record of certification.
  4. **Nationally Recognized Testing Laboratory:** Testing laboratory which is recognized and approved by the Secretary of Labor in accordance with OSHA regulations.

#### **1.4 QUALIFICATIONS (PRODUCTS AND SERVICES)**

- A. **Manufacturer's Qualifications:** The manufacturer shall regularly and currently produce, as one of the manufacturer's principal products, the materials and equipment specified for this project, and shall have manufactured the materials and equipment for at least three years.
- B. **Product Qualification:**
  1. Manufacturer's materials and equipment shall have been in satisfactory operation, on three installations of similar size and type as this project, for at least three years.
  2. The Government reserves the right to require the Contractor to submit a list of installations where the materials and equipment have been in operation before approval.
- C. **Service Qualifications:** There shall be a permanent service organization maintained or trained by the manufacturer which shall render satisfactory service to this installation within eight hours of receipt

of notification that service is needed. Submit name and address of service organizations.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. Applicable publications listed in all Sections of Division 26 shall be the latest issue, unless otherwise noted.
- B. Products specified in all sections of Division 26 shall comply with the applicable publications listed in each section.

#### **1.6 MANUFACTURED PRODUCTS**

- A. Materials and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items, and for which replacement parts shall be available. Materials and equipment furnished shall be new, and shall have superior quality and freshness.
- B. When more than one unit of the same class or type of materials and equipment is required, such units shall be the product of a single manufacturer.
- C. Equipment Assemblies and Components:
  - 1. Components of an assembled unit need not be products of the same manufacturer.
  - 2. Manufacturers of equipment assemblies, which include components made by others, shall assume complete responsibility for the final assembled unit.
  - 3. Components shall be compatible with each other and with the total assembly for the intended service.
  - 4. Constituent parts which are similar shall be the product of a single manufacturer.
- D. Factory wiring and terminals shall be identified on the equipment being furnished and on all wiring diagrams.
- E. When Factory Tests are specified, Factory Tests shall be performed in the factory by the equipment manufacturer, and witnessed by the contractor. In addition, the following requirements shall be complied with:
  - 1. The Government shall have the option of witnessing factory tests. The Contractor shall notify the Government through the COR a minimum of thirty (30) days prior to the manufacturer's performing of the factory tests.

2. When factory tests are successful, contractor shall furnish four (4) copies of the equipment manufacturer's certified test reports to the COR fourteen (14) days prior to shipment of the equipment, and not more than ninety (90) days after completion of the factory tests.
3. When factory tests are not successful, factory tests shall be repeated in the factory by the equipment manufacturer, and witnessed by the Contractor. The Contractor shall be liable for all additional expenses for the Government to witness factory re-testing.

#### **1.7 VARIATIONS FROM CONTRACT REQUIREMENTS**

- A. Where the Government or the Contractor requests variations from the contract requirements, the connecting work and related components shall include, but not be limited to additions or changes to branch circuits, circuit protective devices, conduits, wire, feeders, controls, panels and installation methods.

#### **1.8 MATERIALS AND EQUIPMENT PROTECTION**

- A. Materials and equipment shall be protected during shipment and storage against physical damage, vermin, dirt, corrosive substances, fumes, moisture, cold and rain.
  1. Store materials and equipment indoors in clean dry space with uniform temperature to prevent condensation.
  2. During installation, equipment shall be protected against entry of foreign matter, and be vacuum-cleaned both inside and outside before testing and operating. Compressed air shall not be used to clean equipment. Remove loose packing and flammable materials from inside equipment.
  3. Damaged equipment shall be repaired or replaced, as determined by the COR.
  4. Painted surfaces shall be protected with factory installed removable heavy kraft paper, sheet vinyl or equal.
  5. Damaged paint on equipment shall be refinished with the same quality of paint and workmanship as used by the manufacturer so repaired areas are not obvious.

#### **1.9 WORK PERFORMANCE**

- A. All electrical work shall comply with requirements of the latest NFPA 70 (NEC), NFPA 70B, NFPA 70E, NFPA 99, NFPA 110, OSHA Part 1910 subpart J - General Environmental Controls, OSHA Part 1910 subpart K - Medical

and First Aid, and OSHA Part 1910 subpart S - Electrical, in addition to other references required by contract.

- B. Job site safety and worker safety is the responsibility of the Contractor.
- C. Electrical work shall be accomplished with all affected circuits or equipment de-energized. However, energized electrical work shall be performed only for the non-destructive and non-invasive diagnostic testing(s), or when scheduled outage poses an imminent hazard to patient care, safety, or physical security. In such case, all aspects of energized electrical work, such as the availability of appropriate/correct personal protective equipment (PPE) and the use of PPE, shall comply with the latest NFPA 70E, as well as the following requirements:
  - 1. Only Qualified Person(s) shall perform energized electrical work. Supervisor of Qualified Person(s) shall witness the work of its entirety to ensure compliance with safety requirements and approved work plan.
  - 2. At least two weeks before initiating any energized electrical work, the Contractor and the Qualified Person(s) who is designated to perform the work shall visually inspect, verify and confirm that the work area and electrical equipment can safely accommodate the work involved.
  - 3. At least two weeks before initiating any energized electrical work, the Contractor shall develop and submit a job specific work plan, and energized electrical work request to the COR, and Medical Center's Chief Engineer or his/her designee. At the minimum, the work plan shall include relevant information such as proposed work schedule, area of work, description of work, name(s) of Supervisor and Qualified Person(s) performing the work, equipment to be used, procedures to be used on and near the live electrical equipment, barriers to be installed, safety equipment to be used, and exit pathways.
  - 4. Energized electrical work shall begin only after the Contractor has obtained written approval of the work plan, and the energized electrical work request from the COR, and Medical Center's Chief Engineer or his/her designee. The Contractor shall make these

- approved documents present and available at the time and place of energized electrical work.
5. Energized electrical work shall begin only after the Contractor has invited and received acknowledgment from the COR, and Medical Center's Chief Engineer or his/her designee to witness the work.
- D. For work that affects existing electrical systems, arrange, phase and perform work to assure minimal interference with normal functioning of the facility. Refer to Article OPERATIONS AND STORAGE AREAS under Section 01 00 00, GENERAL REQUIREMENTS.
- E. New work shall be installed and connected to existing work neatly, safely and professionally. Disturbed or damaged work shall be replaced or repaired to its prior conditions, as required by Section 01 00 00, GENERAL REQUIREMENTS.
- F. Coordinate location of equipment and conduit with other trades to minimize interference.

#### **1.10 EQUIPMENT INSTALLATION AND REQUIREMENTS**

- A. Equipment location shall be as close as practical to locations shown on the drawings.
- B. Working clearances shall not be less than specified in the NEC.
- C. Inaccessible Equipment:
1. Where the Government determines that the Contractor has installed equipment not readily accessible for operation and maintenance, the equipment shall be removed and reinstalled as directed at no additional cost to the Government.
  2. "Readily accessible" is defined as being capable of being reached quickly for operation, maintenance, or inspections without the use of ladders, or without climbing or crawling under or over obstacles such as, motors, pumps, belt guards, transformers, piping, ductwork, conduit and raceways.
- D. Electrical service entrance equipment and arrangements for temporary and permanent connections to the electric utility company's system shall conform to the electric utility company's requirements. Coordinate fuses, circuit breakers and relays with the electric utility company's system, and obtain electric utility company approval for sizes and settings of these devices.

### **1.11 EQUIPMENT IDENTIFICATION**

- A. In addition to the requirements of the NEC, install an identification sign which clearly indicates information required for use and maintenance of items such as switchboards and switchgear, panelboards, cabinets, motor controllers, fused and non-fused safety switches, generators, automatic transfer switches, separately enclosed circuit breakers, individual breakers and controllers in switchboards, switchgear and motor control assemblies, control devices and other significant equipment.
- B. Identification signs for Normal Power System equipment shall be laminated black phenolic resin with a white core with engraved lettering. Identification signs for Essential Electrical System (EES) equipment, as defined in the NEC, shall be laminated red phenolic resin with a white core with engraved lettering. Lettering shall be a minimum of 12 mm (1/2 inch) high. Identification signs shall indicate equipment designation, rated bus amperage, voltage, number of phases, number of wires, and type of EES power branch as applicable. Secure nameplates with screws.
- C. Install adhesive arc flash warning labels on all equipment as required by the latest NFPA 70E. Label shall show specific and correct information for specific equipment based on its arc flash calculations. Label shall show the followings:
  - 1. Nominal system voltage.
  - 2. Equipment/bus name, date prepared, and manufacturer name and address.
  - 3. Arc flash boundary.
  - 4. Available arc flash incident energy and the corresponding working distance.
  - 5. Minimum arc rating of clothing.
  - 6. Site-specific level of PPE.

### **1.12 SUBMITTALS**

- A. Submit to the COR in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. The Government's approval shall be obtained for all materials and equipment before delivery to the job site. Delivery, storage or installation of materials and equipment which has not had prior approval shall not be permitted.

- C. All submittals shall include electronic copies of adequate descriptive literature, catalog cuts, shop drawings, test reports, certifications, samples, and other data necessary for the Government to ascertain that the proposed materials and equipment comply with drawing and specification requirements. Catalog cuts submitted for approval shall be legible and clearly identify specific materials and equipment being submitted.
- D. Submittals for individual systems and equipment assemblies which consist of more than one item or component shall be made for the system or assembly as a whole. Partial submittals shall not be considered for approval.
1. Mark the submittals, "SUBMITTED UNDER SECTION\_\_\_\_\_".
  2. Submittals shall be marked to show specification reference including the section and paragraph numbers.
  3. Submit each section separately.
- E. The submittals shall include the following:
1. Information that confirms compliance with contract requirements. Include the manufacturer's name, model or catalog numbers, catalog information, technical data sheets, shop drawings, manuals, pictures, nameplate data, and test reports as required.
  2. Submittals are required for all equipment anchors and supports. Submittals shall include weights, dimensions, center of gravity, standard connections, manufacturer's recommendations and behavior problems (e.g., vibration and thermal expansion) associated with equipment or piping so that the proposed installation can be properly reviewed. Include sufficient fabrication information so that appropriate mounting and securing provisions shall be designed and attached to the equipment.
  3. Elementary and interconnection wiring diagrams for communication and signal systems, control systems, and equipment assemblies. All terminal points and wiring shall be identified on wiring diagrams.
  4. Parts list which shall include information for replacement parts and ordering instructions, as recommended by the equipment manufacturer.
- F. Maintenance and Operation Manuals:
1. Submit as required for systems and equipment specified in the technical sections. Furnish in hardcover binders or an approved equivalent.

2. Inscribe the following identification on the cover: the words "MAINTENANCE AND OPERATION MANUAL," the name and location of the system, material, equipment, building, name of Contractor, and contract name and number. Include in the manual the names, addresses, and telephone numbers of each subcontractor installing the system or equipment and the local representatives for the material or equipment.
3. Provide a table of contents and assemble the manual to conform to the table of contents, with tab sheets placed before instructions covering the subject. The instructions shall be legible and easily read, with large sheets of drawings folded in.
4. The manuals shall include:
  - a. Internal and interconnecting wiring and control diagrams with data to explain detailed operation and control of the equipment.
  - b. A control sequence describing start-up, operation, and shutdown.
  - c. Description of the function of each principal item of equipment.
  - d. Installation instructions.
  - e. Safety precautions for operation and maintenance.
  - f. Diagrams and illustrations.
  - g. Periodic maintenance and testing procedures and frequencies, including replacement parts numbers.
  - h. Performance data.
  - i. Pictorial "exploded" parts list with part numbers. Emphasis shall be placed on the use of special tools and instruments. The list shall indicate sources of supply, recommended spare and replacement parts, and name of servicing organization.
  - j. List of factory approved or qualified permanent servicing organizations for equipment repair and periodic testing and maintenance, including addresses and factory certification qualifications.
- G. Approvals shall be based on complete submission of shop drawings, manuals, test reports, certifications, and samples as applicable.
- H. After approval and prior to installation, furnish the COR with one sample of each of the following:
  1. A minimum 300 mm (12 inches) length of each type and size of wire and cable along with the tag from the coils or reels from which the



sample was taken. The length of the sample shall be sufficient to show all markings provided by the manufacturer.

2. Each type of conduit coupling, bushing, and termination fitting.
3. Conduit hangers, clamps, and supports.
4. Duct sealing compound.
5. Each type of receptacle, toggle switch, lighting control sensor, outlet box, manual motor starter, device wall plate, engraved nameplate, wire and cable splicing and terminating material, and branch circuit single pole molded case circuit breaker.

#### **1.13 SINGULAR NUMBER**

- A. Where any device or part of equipment is referred to in these specifications in the singular number (e.g., "the switch"), this reference shall be deemed to apply to as many such devices as are required to complete the installation as shown on the drawings.

#### **1.14 ACCEPTANCE CHECKS AND TESTS**

- A. The Contractor shall furnish the instruments, materials, and labor for tests.
- B. Where systems are comprised of components specified in more than one section of Division 26, the Contractor shall coordinate the installation, testing, and adjustment of all components between various manufacturer's representatives and technicians so that a complete, functional, and operational system is delivered to the Government.
- C. When test results indicate any defects, the Contractor shall repair or replace the defective materials or equipment, and repeat the tests for the equipment. Repair, replacement, and re-testing shall be accomplished at no additional cost to the Government.

#### **1.15 WARRANTY**

- A. All work performed and all equipment and material furnished under this Division shall be free from defects and shall remain so for a period of one year from the date of acceptance of the entire installation by the Contracting Officer for the Government.

#### **1.16 INSTRUCTION**

- A. Instruction to designated Government personnel shall be provided for the particular equipment or system as required in each associated technical specification section.
- B. Furnish the services of competent and factory-trained instructors to give full instruction in the adjustment, operation, and maintenance of

the specified equipment and system, including pertinent safety requirements. Instructors shall be thoroughly familiar with all aspects of the installation, and shall be factory-trained in operating theory as well as practical operation and maintenance procedures.

- C. A training schedule shall be developed and submitted by the Contractor and approved by the COR at least 30 days prior to the planned training.

#### **1.17 DRAWINGS AND SPECIFICATIONS**

- A. The drawings indicate the general arrangement of the work and shall be followed insofar as possible. The word "provide", as used, shall mean "furnish and install". If significant deviations from the layout are necessitated by field conditions, detailed layouts of the proposed departures shall be submitted to the COR for approval before proceeding with the work.
- B. Make all necessary field measurements to ensure correct fitting. Coordinate work with all other trades in such a manner as to cause a minimum of conflict or delay.
- C. The drawings and specifications shall be carefully studied during the course of bidding and construction. Any errors, omissions or discrepancies encountered shall be referred immediately to the COR for interpretation or correction, so that misunderstandings at a later date shall be avoided. The contract drawings are not intended to show every vertical or horizontal offset which shall be necessary to complete the systems. Having bus duct, wireways and fittings fabricated and delivered in advance of making actual measurements shall not be sufficient cause to avoid making offsets and minor changes as shall be necessary to install bus duct, wireways, fittings and equipment.
- D. The COR shall reserve the right to make minor adjustment in locations of system runs and components where he considers such adjustments desirable in the interest of protecting and concealing work or presenting a better appearance where exposed. Any such changes shall be anticipated and requested sufficiently in advance as to not cause extra work, or unduly delay the work. Coordinate work in advance with all other trades and report immediately any difficulties which can be anticipated.
- E. Equipment, ductwork and piping shall not be installed in the dedicated electrical space above or in the working space required around electrical switchgear, motor control centers or panelboards as

identified by NEC 110.26 Spaces About Electrical Equipment - 600 Volts Nominal or Less. For equipment rated over 600 volts nominal - 110.32 Work Space About Equipment - 110.33 Entrance and Access to Work Space - 110.34 Work Space and Guarding. The Electrical Contractor shall caution other trades to comply with this stipulation.

- F. Where any system runs and components are so placed as to cause or contribute to a conflict, it shall be readjusted at the expense of the contractor causing such conflict. The COR's decision shall be final in regard to the arrangement of bus duct and conduit, where conflict arises.
- G. Provide offsets in system runs, additional fittings, necessary conduit, pull boxes, conductors, switches and devices required to complete the installation, or for the proper operation of the system. Each Contractor shall exercise due and particular caution to determine that all parts of the work are made quickly and easily accessible.
- H. Shall overlap of work among the trades become evident, this shall be called to the attention of the COR. In such event, none of the trades or their suppliers shall assume that he is relieved of the work which is specified under his branch until instructions in writing are received from the COR.

#### **1.18 RECORD DRAWINGS**

- A. The Electrical Contractor shall maintain a separate set of prints of the contract documents and shall show all changes or variations, in a manner to be clearly discernible, which are made during construction. Upon completion of the work, these drawings shall be turned over to the Architect. This shall apply particularly to underground and concealed work, and to other systems where the installation varies to a degree which would justify recording the change.

#### **1.19 FINAL INSPECTION AND PUNCH LIST**

- A. As the time of work completion approaches, the Contractor shall survey and inspect his work and develop his own punch list to confirm that it is complete and finished. He shall then notify the COR and request that a final inspection be made. It shall not be considered the COR's obligation to perform a final inspection until the Contractor has inspected the work and so states at the time of the request for the final inspection.

- B. Requests to the COR for final inspection shall be accompanied by a limited list of known deficiencies in completion, with appropriate explanation and schedule for completing these; this is in the interest of expediting acceptance for beneficial occupancy.
- C. The Architect and/or Engineer shall inspect the work and prepare a punch list of items requiring correction, completion or verification. Corrective action shall be taken by the Contractor to the satisfaction of Architect and Engineer within 30 days of receipt of the Architect/Engineer's punch list.

**1.20 REMOVALS**

- A. Remove ALL existing work which shall be superfluous when the new system is installed and made operational. Not all items that need to be removed are necessarily shown on the drawings. Void unused conduit behind walls or below floors as necessary or as directed. No wire or conduit shall be removed which shall impair the functioning of the remaining work unless first replaced with a rerouted section of wire or conduit to ensure continuity. Remove inactive wiring back to the last active junction box, panelboard or piece of equipment.
- B. Upon completion, no unused conduit or stub shall extend thru floors, walls or ceilings in finished areas. Abandoned conduit where remaining in place shall have any unused wiring removed. All accessible unused conduit shall be removed.
- C. When it is necessary to reroute a section of an active circuit, the rerouted section shall be installed before removing the existing in order to minimize system down time. Rerouted sections shall be installed as required for new work.
- D. Remove all existing backboxes not maintained for new work. Patch and repair all existing drywall associated with removal work to match existing conditions.

**PART 2 - PRODUCTS (NOT USED)**

**PART 3 - EXECUTION (NOT USED)**

---END---

**SECTION 26 05 19**  
**LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, connection, and testing of the electrical conductors and cables for use in electrical systems rated 600 V and below, indicated as cable(s), conductor(s), wire, or wiring in this section.

**1.2 RELATED WORK**

- A. Section 07 84 00, FIRESTOPPING: Sealing around penetrations to maintain the integrity of fire-resistant rated construction.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits for conductors and cables.

**1.3 QUALITY ASSURANCE**

- A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:
1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Submit the following data for approval:
      - 1) Electrical ratings and insulation type for each conductor and cable.
      - 2) Splicing materials and pulling lubricant.
  2. Certifications: Two weeks prior to final inspection, submit the following.
    - a. Certification by the manufacturer that the conductors and cables conform to the requirements of the drawings and specifications.

- b. Certification by the Contractor that the conductors and cables have been properly installed, adjusted, and tested.

**1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are reference in the text by designation only.
- B. American Society of Testing Material (ASTM):
  - D2301-10.....Standard Specification for Vinyl Chloride Plastic Pressure-Sensitive Electrical Insulating Tape
  - D2304-10.....Test Method for Thermal Endurance of Rigid Electrical Insulating Materials
  - D3005-10.....Low-Temperature Resistant Vinyl Chloride Plastic Pressure-Sensitive Electrical Insulating Tape
- C. National Electrical Manufacturers Association (NEMA):
  - WC 70-09.....Power Cables Rated 2000 Volts or Less for the Distribution of Electrical Energy
- D. National Fire Protection Association (NFPA):
  - 70-17.....National Electrical Code (NEC)
- E. Underwriters Laboratories, Inc. (UL):
  - 44-14.....Thermoset-Insulated Wires and Cables
  - 83-14.....Thermoplastic-Insulated Wires and Cables
  - 467-13.....Grounding and Bonding Equipment
  - 486A-486B-13.....Wire Connectors
  - 486C-13.....Splicing Wire Connectors
  - 486D-15.....Sealed Wire Connector Systems
  - 486E-15.....Equipment Wiring Terminals for Use with Aluminum and/or Copper Conductors
  - 493-07.....Thermoplastic-Insulated Underground Feeder and Branch Circuit Cables
  - 514B-12.....Conduit, Tubing, and Cable Fittings

**PART 2 - PRODUCTS**

**2.1 CONDUCTORS AND CABLES**

- A. Conductors and cables shall be in accordance with ASTM, NEMA, NFPA, UL, as specified herein, and as shown on the drawings.
- B. All conductors shall be copper.

C. Single Conductor and Cable:

1. No. 12 AWG: Minimum size, except where smaller sizes are specified herein or shown on the drawings.
2. No. 8 AWG and larger: Stranded.
3. No. 10 AWG and smaller: Solid; except shall be stranded for final connection to motors, transformers, and vibrating equipment.
4. Insulation: THHN-THWN and XHHW-2. XHHW-2 shall be used for isolated power systems.

D. Color Code:

1. No. 10 AWG and smaller: Solid color insulation or solid color coating.
2. No. 8 AWG and larger: Color-coded using one of the following methods:
  - a. Solid color insulation or solid color coating.
  - b. Stripes, bands, or hash marks of color specified.
  - c. Color using 19 mm (0.75 inches) wide tape.
3. For modifications and additions to existing wiring systems, color coding shall conform to the existing wiring system.
4. Conductors shall be color-coded as follows:

208/120 V	Phase	480/277 V
Black	A	Brown
Red	B	Orange
Blue	C	Yellow
White	Neutral	Gray *
* or white with colored (other than green) tracer.		

5. Lighting circuit "switch legs", and 3-way and 4-way switch "traveling wires," shall have color coding that is unique and distinct (e.g., pink and purple) from the color coding indicated above. The unique color codes shall be solid and in accordance with the NEC. Coordinate color coding in the field with the COR.
6. Color code for isolated power system wiring shall be in accordance with the NEC.

**2.2 SPLICES**

- A. Splices shall be in accordance with NEC and UL.
- B. Above Ground Splices for No. 10 AWG and Smaller:

1. Solderless, screw-on, reusable pressure cable type, with integral insulation, approved for copper and aluminum conductors.
  2. The integral insulator shall have a skirt to completely cover the stripped conductors.
  3. The number, size, and combination of conductors used with the connector, as listed on the manufacturer's packaging, shall be strictly followed.
- C. Above Ground Splices for No. 8 AWG to No. 4/0 AWG:
1. Compression, hex screw, or bolt clamp-type of high conductivity and corrosion-resistant material, listed for use with copper and aluminum conductors.
  2. Insulate with materials approved for the particular use, location, voltage, and temperature. Insulation level shall be not less than the insulation level of the conductors being joined.
  3. Splice and insulation shall be product of the same manufacturer.
  4. All bolts, nuts, and washers used with splices shall be zinc-plated steel.
- D. Above Ground Splices for 250 kcmil and Larger:
1. Long barrel "butt-splice" or "sleeve" type compression connectors, with minimum of two compression indents per wire, listed for use with copper and aluminum conductors.
  2. Insulate with materials approved for the particular use, location, voltage, and temperature. Insulation level shall be not less than the insulation level of the conductors being joined.
  3. Splice and insulation shall be product of the same manufacturer.
- E. Plastic electrical insulating tape: Per ASTM D2304, flame-retardant, cold and weather resistant.

### **2.3 CONNECTORS AND TERMINATIONS**

- A. Mechanical type of high conductivity and corrosion-resistant material, listed for use with copper and aluminum conductors.
- B. Long barrel compression type of high conductivity and corrosion-resistant material, with minimum of two compression indents per wire, listed for use with copper and aluminum conductors.
- C. All bolts, nuts, and washers used to connect connections and terminations to bus bars or other termination points shall be zinc-plated steel.



## **2.4 CONTROL WIRING**

- A. Unless otherwise specified elsewhere in these specifications, control wiring shall be as specified herein, except that the minimum size shall be not less than No. 14 AWG.
- B. Control wiring shall be sized such that the voltage drop under in-rush conditions does not adversely affect operation of the controls.

## **2.5 WIRE LUBRICATING COMPOUND**

- A. Lubricating compound shall be suitable for the wire insulation and conduit, and shall not harden or become adhesive.
- B. Shall not be used on conductors for isolated power systems.

## **PART 3 - EXECUTION**

### **3.1 GENERAL**

- A. Installation shall be in accordance with the NEC, as shown on the drawings, and manufacturer's instructions.
- B. Install all conductors in raceway systems.
- C. Splice conductors only in outlet boxes, junction boxes, pullboxes, manholes, or handholes.
- D. Conductors of different systems (e.g., 120 V and 277 V) shall not be installed in the same raceway.
- E. Install cable supports for all vertical feeders in accordance with the NEC. Provide split wedge type which firmly clamps each individual cable and tightens due to cable weight.
- F. In panelboards, cabinets, wireways, switches, enclosures, and equipment assemblies, neatly form, train, and tie the conductors with non-metallic ties.
- G. For connections to motors, transformers, and vibrating equipment, stranded conductors shall be used only from the last fixed point of connection to the motors, transformers, or vibrating equipment.
- H. Use expanding foam or non-hardening duct-seal to seal conduits entering a building, after installation of conductors.
- I. Conductor and Cable Pulling:
  - 1. Provide installation equipment that shall prevent the cutting or abrasion of insulation during pulling. Use lubricants approved for the cable.
  - 2. Use nonmetallic pull ropes.
  - 3. Attach pull ropes by means of either woven basket grips or pulling eyes attached directly to the conductors.

- 4. All conductors in a single conduit shall be pulled simultaneously.
- 5. Do not exceed manufacturer's recommended maximum pulling tensions and sidewall pressure values.
- J. No more than three branch circuits shall be installed in any one conduit.
- K. When stripping stranded conductors, use a tool that does not damage the conductor or remove conductor strands.

### **3.2 SPLICE AND TERMINATION INSTALLATION**

- A. Splices and terminations shall be mechanically and electrically secure, and tightened to manufacturer's published torque values using a torque screwdriver or wrench.
- B. Where the Government determines that unsatisfactory splices or terminations have been installed, replace the splices or terminations at no additional cost to the Government.

### **3.3 CONDUCTOR IDENTIFICATION**

- A. When using colored tape to identify phase, neutral, and ground conductors larger than No. 8 AWG, apply tape in half-overlapping turns for a minimum of 75 mm (3 inches) from terminal points, and in junction boxes, pullboxes, and manholes. Apply the last two laps of tape with no tension to prevent possible unwinding. Where cable markings are covered by tape, apply tags to cable, stating size and insulation type.

### **3.4 FEEDER CONDUCTOR IDENTIFICATION**

- A. In each interior pullbox and each underground manhole and handhole, install brass tags on all feeder conductors to clearly designate their circuit identification and voltage. The tags shall be the embossed type, 40 mm (1-1/2 inches) in diameter and 40 mils thick. Attach tags with plastic ties.

### **3.5 EXISTING CONDUCTORS**

- A. Unless specifically indicated on the plans, existing conductors shall not be reused.

### **3.6 CONTROL WIRING INSTALLATION**

- A. Unless otherwise specified in other sections, install control wiring and connect to equipment to perform the required functions as specified or as shown on the drawings.
- B. Install a separate power supply circuit for each system, except where otherwise shown on the drawings.

### **3.7 CONTROL WIRING IDENTIFICATION**

- A. Install a permanent wire marker on each wire at each termination.
- B. Identifying numbers and letters on the wire markers shall correspond to those on the wiring diagrams used for installing the systems.
- C. Wire markers shall retain their markings after cleaning.
- D. In each manhole and handhole, install embossed brass tags to identify the system served and function.

### **3.8 ACCEPTANCE CHECKS AND TESTS**

- A. Perform in accordance with the manufacturer's recommendations. In addition, include the following:
  - 1. Visual Inspection and Tests: Inspect physical condition.
  - 2. Electrical tests:
    - a. After installation but before connection to utilization devices, such as fixtures, motors, or appliances, test conductors phase-to-phase and phase-to-ground resistance with an insulation resistance tester. Existing conductors to be reused shall also be tested.
    - b. Applied voltage shall be 500 V DC for 300 V rated cable, and 1000 V DC for 600 V rated cable. Apply test for one minute or until reading is constant for 15 seconds, whichever is longer. Minimum insulation resistance values shall not be less than 25 megohms for 300 V rated cable and 100 megohms for 600 V rated cable.
    - c. Perform phase rotation test on all three-phase circuits.

---END---

**SECTION 26 05 26**  
**GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, connection, and testing of grounding and bonding equipment, indicated as grounding equipment in this section.
- B. "Grounding electrode system" refers to grounding electrode conductors and all electrodes required or allowed by NEC, as well as made, supplementary, and lightning protection system grounding electrodes.
- C. The terms "connect" and "bond" are used interchangeably in this section and have the same meaning.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS:  
Requirements that apply to all sections of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES:  
Low-voltage conductors.
- C. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduit and boxes.
- D. Section 26 24 16, PANELBOARDS: Low-voltage panelboards.

**1.3 QUALITY ASSURANCE**

- A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:
  - 1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Submit plans showing the location of system grounding electrodes and connections, and the routing of aboveground and underground grounding electrode conductors.
  - 2. Test Reports:
    - a. Two weeks prior to the final inspection, submit ground resistance field test reports to the COR.

3. Certifications:

- a. Certification by the Contractor that the grounding equipment has been properly installed and tested.

**1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American Society for Testing and Materials (ASTM):
  - B1-13.....Standard Specification for Hard-Drawn Copper Wire
  - B3-13.....Standard Specification for Soft or Annealed Copper Wire
  - B8-11.....Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft
- C. Institute of Electrical and Electronics Engineers, Inc. (IEEE):
  - 81-12.....IEEE Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Ground System Part 1: Normal Measurements
- D. National Fire Protection Association (NFPA):
  - 70-17.....National Electrical Code (NEC)
  - 70E-15.....National Electrical Safety Code
  - 99-15.....Health Care Facilities
- E. Underwriters Laboratories, Inc. (UL):
  - 44-14 .....Thermoset-Insulated Wires and Cables
  - 83-14 .....Thermoplastic-Insulated Wires and Cables
  - 467-13 .....Grounding and Bonding Equipment

**PART 2 - PRODUCTS**

**2.1 GROUNDING AND BONDING CONDUCTORS**

- A. Equipment grounding conductors shall be insulated stranded copper, except that sizes No. 10 AWG and smaller shall be solid copper. Insulation color shall be continuous green for all equipment grounding conductors, except that wire sizes No. 4 AWG and larger shall be identified per NEC.
- B. Bonding conductors shall be bare stranded copper, except that sizes No. 10 AWG and smaller shall be bare solid copper. Bonding conductors

shall be stranded for final connection to motors, transformers, and vibrating equipment.

- C. Conductor sizes shall not be less than shown on the drawings, or not less than required by the NEC, whichever is greater.
- D. Insulation: THHN-THWN and XHHW-2. XHHW-2 shall be used for isolated power systems.

## **2.2 GROUND RODS**

- A. Copper clad steel, 19 mm (0.75 inch) diameter by 3 M (10 feet) long.
- B. Quantity of rods shall be as shown on the drawings, and as required to obtain the specified ground resistance.

## **2.3 CONCRETE ENCASED ELECTRODE**

- A. Concrete encased electrode shall be No. 4 AWG bare copper wire, installed per NEC.

## **2.4 GROUND CONNECTIONS**

- A. Below Grade and Inaccessible Locations: Exothermic-welded type connectors.
- B. Above Grade:
  - 1. Bonding Jumpers: Listed for use with aluminum and copper conductors. For wire sizes No. 8 AWG and larger, use compression-type connectors. For wire sizes smaller than No. 8 AWG, use mechanical type lugs. Connectors or lugs shall use zinc-plated steel bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.
  - 2. Connection to Building Steel: Exothermic-welded type connectors.
  - 3. Connection to Grounding Bus Bars: Listed for use with aluminum and copper conductors. Use mechanical type lugs, with zinc-plated steel bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.
  - 4. Connection to Equipment Rack and Cabinet Ground Bars: Listed for use with aluminum and copper conductors. Use mechanical type lugs, with zinc-plated steel bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.

## **2.5 EQUIPMENT RACK AND CABINET GROUND BARS**

- A. Provide solid copper ground bars designed for mounting on the framework of open or cabinet-enclosed equipment racks. Ground bars shall have minimum dimensions of 6.3 mm (0.25 inch) thick x 19 mm (0.75 inch)

wide, with length as required or as shown on the drawings. Provide insulators and mounting brackets.

## **2.6 GROUND TERMINAL BLOCKS**

- A. At any equipment mounting location (e.g., backboards and hinged cover enclosures) where rack-type ground bars cannot be mounted, provide mechanical type lugs, with zinc-plated steel bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.

## **2.7 GROUNDING BUS BAR**

- A. Pre-drilled rectangular copper bar with stand-off insulators, minimum 6.3 mm (0.25 inch) thick x 100 mm (4 inches) high in cross-section, length as shown on the drawings, with hole size, quantity, and spacing per detail shown on the drawings. Provide insulators and mounting brackets.

## **PART 3 - EXECUTION**

### **3.1 GENERAL**

- A. Installation shall be in accordance with the NEC, as shown on the drawings, and manufacturer's instructions.
- B. System Grounding:
  - 1. Secondary service neutrals: Ground at the supply side of the secondary disconnecting means and at the related transformer.
  - 2. Separately derived systems (transformers downstream from the service entrance): Ground the secondary neutral.
- C. Equipment Grounding: Metallic piping, building structural steel, electrical enclosures, raceways, junction boxes, outlet boxes, cabinets, machine frames, and other conductive items in close proximity with electrical circuits, shall be bonded and grounded.

### **3.2 INACCESSIBLE GROUNDING CONNECTIONS**

- A. Make grounding connections, which are normally buried or otherwise inaccessible, by exothermic weld.

### **3.3 SECONDARY VOLTAGE EQUIPMENT AND CIRCUITS**

- A. Main Bonding Jumper: Bond the secondary service neutral to the ground bus in the service equipment.
- B. Metallic Piping, Building Structural Steel, and Supplemental Electrode(s):
  - 1. Provide a grounding electrode conductor sized per NEC between the service equipment ground bus and all metallic water pipe systems,

- building structural steel, and supplemental or made electrodes.  
Provide jumpers across insulating joints in the metallic piping.
2. Provide a supplemental ground electrode as shown on the drawings and bond to the grounding electrode system.
- C. Switchgear, Switchboards, Unit Substations, Panelboards, Motor Control Centers, Engine-Generators, Automatic Transfer Switches, and other electrical equipment:
1. Connect the equipment grounding conductors to the ground bus.
  2. Connect metallic conduits by grounding bushings and equipment grounding conductor to the equipment ground bus.

### **3.4 RACEWAY**

- A. Conduit Systems:
1. Ground all metallic conduit systems. All metallic conduit systems shall contain an equipment grounding conductor.
  2. Non-metallic conduit systems, except non-metallic feeder conduits that carry a grounded conductor from exterior transformers to interior or building-mounted service entrance equipment, shall contain an equipment grounding conductor.
  3. Metallic conduit that only contains a grounding conductor, and is provided for its mechanical protection, shall be bonded to that conductor at the entrance and exit from the conduit.
  4. Metallic conduits which terminate without mechanical connection to an electrical equipment housing by means of locknut and bushings or adapters, shall be provided with grounding bushings. Connect bushings with an equipment grounding conductor to the equipment ground bus.
- B. Feeders and Branch Circuits: Install equipment grounding conductors with all feeders, and power and lighting branch circuits.
- C. Boxes, Cabinets, Enclosures, and Panelboards:
1. Bond the equipment grounding conductor to each pullbox, junction box, outlet box, device box, cabinets, and other enclosures through which the conductor passes (except for special grounding systems for intensive care units and other critical units shown).
  2. Provide lugs in each box and enclosure for equipment grounding conductor termination.
- D. Wireway Systems:



1. Bond the metallic structures of wireway to provide electrical continuity throughout the wireway system, by connecting a No. 6 AWG bonding jumper at all intermediate metallic enclosures and across all section junctions.
  2. Install insulated No. 6 AWG bonding jumpers between the wireway system, bonded as required above, and the closest building ground at each end and approximately every 16 M (50 feet).
  3. Use insulated No. 6 AWG bonding jumpers to ground or bond metallic wireway at each end for all intermediate metallic enclosures and across all section junctions.
  4. Use insulated No. 6 AWG bonding jumpers to ground cable tray to column-mounted building ground plates (pads) at each end and approximately every 15 M (49 feet).
- E. Receptacles shall not be grounded through their mounting screws. Ground receptacles with a jumper from the receptacle green ground terminal to the device box ground screw and a jumper to the branch circuit equipment grounding conductor.
- F. Ground lighting fixtures to the equipment grounding conductor of the wiring system. Fixtures connected with flexible conduit shall have a green ground wire included with the power wires from the fixture through the flexible conduit to the first outlet box.
- G. Fixed electrical appliances and equipment shall be provided with a ground lug for termination of the equipment grounding conductor.

### **3.5 CORROSION INHIBITORS**

- A. When making grounding and bonding connections, apply a corrosion inhibitor to all contact surfaces. Use corrosion inhibitor appropriate for protecting a connection between the metals used.

### **3.6 CONDUCTIVE PIPING**

- A. Bond all conductive piping systems, interior and exterior, to the grounding electrode system. Bonding connections shall be made as close as practical to the equipment ground bus.
- B. In operating rooms and at intensive care and coronary care type beds, bond the medical gas piping and medical vacuum piping at the outlets directly to the patient ground bus.

### **3.7 MAIN ELECTRICAL ROOM GROUNDING**

- A. Provide ground bus bar and mounting hardware at each main electrical room where incoming feeders are terminated, as shown on the drawings.

Connect to pigtail extensions of the building grounding ring, as shown on the drawings.

### **3.8 GROUND RESISTANCE**

- A. Grounding system resistance to ground shall not exceed 5 ohms. Make any modifications or additions to the grounding electrode system necessary for compliance without additional cost to the Government. Final tests shall ensure that this requirement is met.
- B. Grounding system resistance shall comply with the electric utility company ground resistance requirements.

### **3.9 GROUND ROD INSTALLATION**

- A. For outdoor installations, drive each rod vertically in the earth, until top of rod is 610 mm (24 inches) below final grade.
- B. For indoor installations, leave 100 mm (4 inches) of each rod exposed.
- C. Where buried or permanently concealed ground connections are required, make the connections by the exothermic process, to form solid metal joints. Make accessible ground connections with mechanical pressure-type ground connectors.
- D. Where rock or impenetrable soil prevents the driving of vertical ground rods, install angled ground rods or grounding electrodes in horizontal trenches to achieve the specified ground resistance.

### **3.10 ACCEPTANCE CHECKS AND TESTS**

- A. Resistance of the grounding electrode system shall be measured using a four-terminal fall-of-potential method as defined in IEEE 81. Ground resistance measurements shall be made before the electrical distribution system is energized or connected to the electric utility company ground system, and shall be made in normally dry conditions not fewer than 48 hours after the last rainfall.
- B. Resistance measurements of separate grounding electrode systems shall be made before the systems are bonded together. The combined resistance of separate systems shall be used to meet the required resistance, but the specified number of electrodes shall still be provided.
- C. Below-grade connections shall be visually inspected by the COR prior to backfilling. The Contractor shall notify the COR 24 hours before the connections are ready for inspection.

---END---

**SECTION 26 05 33**  
**RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, and connection of conduit, fittings, and boxes, to form complete, coordinated, grounded raceway systems. Raceways are required for all wiring unless shown or specified otherwise.
- B. Definitions: The term conduit, as used in this specification, shall mean any or all of the raceway types specified.

**1.2 RELATED WORK**

- A. Section 07 84 00, FIRESTOPPING: Sealing around penetrations to maintain the integrity of fire rated construction.
- B. Section 07 92 00, JOINT SEALANTS: Sealing around conduit penetrations through the building envelope to prevent moisture migration into the building.
- C. Section 09 91 00, PAINTING: Identification and painting of conduit and other devices.
- D. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- E. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.

**1.3 QUALITY ASSURANCE**

- A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:
  - 1. Shop Drawings:
    - a. Size and location of main feeders.
    - b. Size and location of panels and pull-boxes.
    - c. Layout of required conduit penetrations through structural elements.

- d. Submit the following data for approval:
  - 1) Raceway types and sizes.
  - 2) Conduit bodies, connectors and fittings.
  - 3) Junction and pull boxes, types and sizes.
- 2. Certifications: Two weeks prior to final inspection, submit the following:
  - a. Certification by the manufacturer that raceways, conduits, conduit bodies, connectors, fittings, junction and pull boxes, and all related equipment conform to the requirements of the drawings and specifications.
  - b. Certification by the Contractor that raceways, conduits, conduit bodies, connectors, fittings, junction and pull boxes, and all related equipment have been properly installed.

**1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American Iron and Steel Institute (AISI):
  - S100-12.....North American Specification for the Design of  
Cold-Formed Steel Structural Members
- C. National Electrical Manufacturers Association (NEMA):
  - C80.1-15.....Electrical Rigid Steel Conduit
  - C80.3-15.....Steel Electrical Metal Tubing
  - C80.6-05.....Electrical Intermediate Metal Conduit
  - FB1-14.....Fittings, Cast Metal Boxes and Conduit Bodies  
for Conduit, Electrical Metallic Tubing and  
Cable
  - FB2.10-13.....Selection and Installation Guidelines for  
Fittings for use with Non-Flexible Conduit or  
Tubing (Rigid Metal Conduit, Intermediate  
Metallic Conduit, and Electrical Metallic  
Tubing)
  - FB2.20-14.....Selection and Installation Guidelines for  
Fittings for use with Flexible Electrical  
Conduit and Cable

TC-2-13.....Electrical Polyvinyl Chloride (PVC) Tubing and  
Conduit

TC-3-13.....PVC Fittings for Use with Rigid PVC Conduit and  
Tubing

D. National Fire Protection Association (NFPA):

70-17.....National Electrical Code (NEC)

E. Underwriters Laboratories, Inc. (UL):

1-05.....Flexible Metal Conduit

5-16.....Surface Metal Raceway and Fittings

6-07.....Electrical Rigid Metal Conduit - Steel

50-15.....Enclosures for Electrical Equipment

360-13.....Liquid-Tight Flexible Steel Conduit

467-13.....Grounding and Bonding Equipment

514A-13.....Metallic Outlet Boxes

514B-12.....Conduit, Tubing, and Cable Fittings

514C-14.....Nonmetallic Outlet Boxes, Flush-Device Boxes  
and Covers

651-11.....Schedule 40 and 80 Rigid PVC Conduit and  
Fittings

651A-11.....Type EB and A Rigid PVC Conduit and HDPE  
Conduit

797-07.....Electrical Metallic Tubing

1242-14.....Electrical Intermediate Metal Conduit - Steel

**PART 2 - PRODUCTS**

**2.1 MATERIAL**

A. Conduit Size: In accordance with the NEC, but not less than 0.75-inch unless otherwise shown. Where permitted by the NEC, 0.75-inch flexible conduit shall be used for tap connections to recessed lighting fixtures.

B. Conduit:

1. Size: In accordance with the NEC, but not less than 0.75-inch.

2. Rigid Steel Conduit (RMC): Shall conform to UL 6 and NEMA C80.1.

3. Rigid Intermediate Steel Conduit (IMC): Shall conform to UL 1242 and NEMA C80.6.

4. Electrical Metallic Tubing (EMT): Shall conform to UL 797 and NEMA C80.3. Maximum size not to exceed 105 mm (4 inches) and shall be permitted only with cable rated 600 V or less.

5. Flexible Metal Conduit: Shall conform to UL 1.
6. Liquid-tight Flexible Metal Conduit: Shall conform to UL 360.
7. Direct Burial Plastic Conduit: Shall conform to UL 651 and UL 651A, heavy wall PVC or high density polyethylene (PE).
8. Surface Metal Raceway: Shall conform to UL 5.

C. Conduit Fittings:

1. Rigid Steel and Intermediate Metallic Conduit Fittings:
  - a. Fittings shall meet the requirements of UL 514B and NEMA FB1.
  - b. Standard threaded couplings, locknuts, bushings, conduit bodies, and elbows: Only steel or malleable iron materials are acceptable. Integral retractable type IMC couplings are also acceptable.
  - c. Locknuts: Bonding type with sharp edges for digging into the metal wall of an enclosure.
  - d. Bushings: Metallic insulating type, consisting of an insulating insert, molded or locked into the metallic body of the fitting. Bushings made entirely of metal or nonmetallic material are not permitted.
  - e. Erickson (Union-Type) and Set Screw Type Couplings: Approved for use in concrete are permitted for use to complete a conduit run where conduit is installed in concrete. Use set screws of case-hardened steel with hex head and cup point to firmly seat in conduit wall for positive ground. Tightening of set screws with pliers is prohibited.
  - f. Sealing Fittings: Threaded cast iron type. Use continuous drain-type sealing fittings to prevent passage of water vapor. In concealed work, install fittings in flush steel boxes with blank cover plates having the same finishes as that of other electrical plates in the room.
2. Electrical Metallic Tubing Fittings:
  - a. Fittings and conduit bodies shall meet the requirements of UL 514B, NEMA C80.3, and NEMA FB1.
  - b. Only steel or malleable iron materials are acceptable.
  - c. Setscrew Couplings and Connectors: Use setscrews of case-hardened steel with hex head and cup point, to firmly seat in wall of conduit for positive grounding.
  - d. Indent-type connectors or couplings are prohibited.

- e. Die-cast or pressure-cast zinc-alloy fittings or fittings made of "pot metal" are prohibited.
- 3. Flexible Metal Conduit Fittings:
  - a. Conform to UL 514B. Only steel or malleable iron materials are acceptable.
  - b. Clamp-type, with insulated throat.
- 4. Liquid-tight Flexible Metal Conduit Fittings:
  - a. Fittings shall meet the requirements of UL 514B and NEMA FB1.
  - b. Only steel or malleable iron materials are acceptable.
  - c. Fittings shall incorporate a threaded grounding cone, a steel or plastic compression ring, and a gland for tightening. Connectors shall have insulated throats.
- 5. Direct Burial Plastic Conduit Fittings: Fittings shall meet the requirements of UL 514C and NEMA TC3.
- 6. Surface Metal Raceway Fittings: As recommended by the raceway manufacturer. Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, conduit entry fittings, accessories, and other fittings as required for complete system.
- 7. Expansion and Deflection Couplings:
  - a. Conform to UL 467 and UL 514B.
  - b. Accommodate a 19 mm (0.75-inch) deflection, expansion, or contraction in any direction, and allow 30 degree angular deflections.
  - c. Include internal flexible metal braid, sized to guarantee conduit ground continuity and a low-impedance path for fault currents, in accordance with UL 467 and the NEC tables for equipment grounding conductors.
  - d. Jacket: Flexible, corrosion-resistant, watertight, moisture and heat-resistant molded rubber material with stainless steel jacket clamps.
- D. Conduit Supports:
  - 1. Parts and Hardware: Zinc-coat or provide equivalent corrosion protection.
  - 2. Individual Conduit Hangers: Designed for the purpose, having a pre-assembled closure bolt and nut, and provisions for receiving a hanger rod.

3. Multiple Conduit (Trapeze) Hangers: Not less than 38 mm x 38 mm (1.5 x 1.5 inches), 12-gauge steel, cold-formed, lipped channels; with not less than 9 mm (0.375-inch) diameter steel hanger rods.
  4. Solid Masonry and Concrete Anchors: Self-drilling expansion shields, or machine bolt expansion.
- E. Outlet, Junction, and Pull Boxes:
1. Comply with UL-50 and UL-514A.
  2. Rustproof cast metal where required by the NEC or shown on drawings.
  3. Sheet Metal Boxes: Galvanized steel, except where shown on drawings.
- F. Metal Wireways: Equip with hinged covers, except as shown on drawings. Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, and other fittings to match and mate with wireways as required for a complete system.

### **PART 3 - EXECUTION**

#### **3.1 PENETRATIONS**

- A. Cutting or Holes:
1. Cut holes in advance where they shall be placed in the structural elements, such as ribs or beams. Obtain the approval of the COR prior to drilling through structural elements.
  2. Cut holes through concrete and masonry in new and existing structures with a diamond core drill or concrete saw. Pneumatic hammers, impact electric, hand, or manual hammer-type drills are not allowed, except when permitted by the COR where working space is limited.
- B. Firestop: Where conduits, wireways, and other electrical raceways pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING.
- C. Waterproofing: At floor, exterior wall, and roof conduit penetrations, completely seal the gap around conduit to render it watertight, as specified in Section 07 92 00, JOINT SEALANTS.

#### **3.2 INSTALLATION, GENERAL**

- A. In accordance with NEC, NEMA, UL, as shown on drawings, and as specified herein.



B. Raceway systems used for Essential Electrical Systems (EES) shall be entirely independent of other raceway systems.

C. Install conduit as follows:

1. In complete mechanically and electrically continuous runs before pulling in cables or wires.
2. Unless otherwise indicated on the drawings or specified herein, installation of all conduits shall be concealed within finished walls, floors, and ceilings.
3. Flattened, dented, or deformed conduit is not permitted. Remove and replace the damaged conduits with new conduits.
4. Assure conduit installation does not encroach into the ceiling height head room, walkways, or doorways.
5. Cut conduits square, ream, remove burrs, and draw up tight.
6. Independently support conduit at 2.4 M (8 feet) on centers with specified materials and as shown on drawings.
7. Do not use suspended ceilings, suspended ceiling supporting members, lighting fixtures, other conduits, cable tray, boxes, piping, or ducts to support conduits and conduit runs.
8. Support within 300 mm (12 inches) of changes of direction, and within 300 mm (12 inches) of each enclosure to which connected.
9. Close ends of empty conduits with plugs or caps at the rough-in stage until wires are pulled in, to prevent entry of debris.
10. Conduit installations under fume and vent hoods are prohibited.
11. Secure conduits to cabinets, junction boxes, pull-boxes, and outlet boxes with bonding type locknuts. For rigid steel and IMC conduit installations, provide a locknut on the inside of the enclosure, made up wrench tight. Do not make conduit connections to junction box covers.
12. Conduit bodies shall only be used for changes in direction, and shall not contain splices.

D. Conduit Bends:

1. Make bends with standard conduit bending machines.
2. Conduit hickey shall be used for slight offsets and for straightening stubbed out conduits.
3. Bending of conduits with a pipe tee or vise is prohibited.

E. Layout and Homeruns:

1. Install conduit with wiring, including homeruns, as shown on drawings.
  2. Deviations: Make only where necessary to avoid interferences and only after drawings showing the proposed deviations have been submitted and approved by the COR.
- F. Conduit shall be run concealed in all finished areas of new construction and elsewhere unless specifically indicated or upon specific permission by the COR. All conduit shall parallel building lines.
- G. Conduit shall be run overhead and shall not be run below concrete slabs unless specifically indicated on the drawings and in the legend on the drawings.
- H. Contractor shall record carefully on a set of "as built" prints the exact location of all feeder conduits.
- I. Unless noted otherwise on the drawings, a maximum of 8 conductors shall be installed in a branch circuit conduit. This maximum is a count of all phase and neutral conductors only - ground conductors are not counted when determining maximum fill for this purpose.

### **3.3 CONCEALED WORK INSTALLATION**

- A. In Concrete:
1. Conduit: Rigid steel, IMC, or EMT. Do not install EMT in concrete slabs that are in contact with soil, gravel, or vapor barriers.
  2. Align and run conduit in direct lines.
  3. Install conduit through concrete beams only:
    - a. Where shown on the structural drawings.
    - b. As approved by the COR prior to construction, and after submittal of drawing showing location, size, and position of each penetration.
  4. Installation of conduit in concrete that is less than 75 mm (3 inches) thick is prohibited.
    - a. Conduit outside diameter larger than one-third of the slab thickness is prohibited.
    - b. Space between conduits in slabs: Approximately six conduit diameters apart, and one conduit diameter at conduit crossings.
    - c. Install conduits approximately in the center of the slab so that there shall be a minimum of 19 mm (0.75-inch) of concrete around the conduits.

5. Make couplings and connections watertight. Use thread compounds that are UL approved conductive type to ensure low resistance ground continuity through the conduits. Tightening setscrews with pliers is prohibited.

B. Above Furred or Suspended Ceilings and in Walls:

1. Conduit for Conductors Above 600 V: Rigid steel. Mixing different types of conduits in the same system is prohibited.
2. Conduit for Conductors 600 V and Below: Rigid steel, IMC, or EMT. Mixing different types of conduits in the same system is prohibited.
3. Align and run conduit parallel or perpendicular to the building lines.
4. Connect recessed lighting fixtures to conduit runs with maximum 1.8 M (6 feet) of flexible metal conduit extending from a junction box to the fixture.
5. Tightening set screws with pliers is prohibited.
6. For conduits running through metal studs, limit field cut holes to no more than 70% of web depth. Spacing between holes shall be at least 457 mm (18 inches). Cuts or notches in flanges or return lips shall not be permitted.

**3.4 EXPOSED WORK INSTALLATION**

- A. Unless otherwise indicated on drawings, exposed conduit is only permitted in mechanical and electrical rooms.
- B. Conduit for Conductors Above 600 V: Rigid steel. Mixing different types of conduits in the system is prohibited.
- C. Conduit for Conductors 600 V and Below: Rigid steel, IMC, or EMT. Mixing different types of conduits in the system is prohibited.
- D. Align and run conduit parallel or perpendicular to the building lines.
- E. Install horizontal runs close to the ceiling or beams and secure with conduit straps.
- F. Support horizontal or vertical runs at not over 2.4 M (8 feet) intervals.
- G. Surface Metal Raceways: Use only where shown on drawings.
- H. Painting:
  1. Paint exposed conduit as specified in Section 09 91 00, PAINTING.
  2. Paint all conduits containing cables rated over 600 V safety orange. Refer to Section 09 91 00, PAINTING for preparation, paint type, and exact color. In addition, paint legends, using 50 mm (2 inch) high

black numerals and letters, showing the cable voltage rating.

Provide legends where conduits pass through walls and floors and at maximum 6 M (20 feet) intervals in between.

### **3.5 HAZARDOUS LOCATIONS**

- A. Use rigid steel conduit only.
- B. Install UL approved sealing fittings that prevent passage of explosive vapors in hazardous areas equipped with explosion-proof lighting fixtures, switches, and receptacles, as required by the NEC.

### **3.6 WET OR DAMP LOCATIONS**

- A. Use rigid steel or IMC conduits unless as shown on drawings.
- B. Provide sealing fittings to prevent passage of water vapor where conduits pass from warm to cold locations, i.e., refrigerated spaces, constant-temperature rooms, air-conditioned spaces, building exterior walls, roofs, or similar spaces.
- C. Use rigid steel or IMC conduit within 1.5 M (5 feet) of the exterior and below concrete building slabs in contact with soil, gravel, or vapor barriers, unless as shown on drawings. Conduit shall be half-lapped with 10 mil PVC tape before installation. After installation, completely recoat or retape any damaged areas of coating.
- D. Conduits run on roof shall be supported with integral galvanized lipped steel channel, attached to UV-inhibited polycarbonate or polypropylene blocks every 2.4 M (8 feet) with 9 mm (3/8-inch) galvanized threaded rods, square washer and locknut. Conduits shall be attached to steel channel with conduit clamps.

### **3.7 MOTORS AND VIBRATING EQUIPMENT**

- A. Use flexible metal conduit for connections to motors and other electrical equipment subject to movement, vibration, misalignment, cramped quarters, or noise transmission.
- B. Use liquid-tight flexible metal conduit for installation in exterior locations, moisture or humidity laden atmosphere, corrosive atmosphere, water or spray wash-down operations, inside airstream of HVAC units, and locations subject to seepage or dripping of oil, grease, or water.
- C. Provide a green equipment grounding conductor with flexible and liquid-tight flexible metal conduit.

### **3.8 EXPANSION JOINTS**

- A. Conduits 75 mm (3 inch) and larger that are secured to the building structure on opposite sides of a building expansion joint require

expansion and deflection couplings. Install the couplings in accordance with the manufacturer's recommendations.

- B. Provide conduits smaller than 75 mm (3 inch) with junction boxes on both sides of the expansion joint. Connect flexible metal conduits to junction boxes with sufficient slack to produce a 125 mm (5 inch) vertical drop midway between the ends of the flexible metal conduit. Flexible metal conduit shall have a green insulated copper bonding jumper installed. In lieu of this flexible metal conduit, expansion and deflection couplings as specified above are acceptable.
- C. Install expansion and deflection couplings where shown.
- D. Seismic Areas: In seismic areas, provide conduits rigidly secured to the building structure on opposite sides of a building expansion joint with junction boxes on both sides of the joint. Connect conduits to junction boxes with 375 mm (15 inches) of slack flexible conduit. Flexible conduit shall have a copper bonding jumper installed.

### **3.9 CONDUIT SUPPORTS**

- A. Safe working load shall not exceed one-quarter of proof test load of fastening devices.
- B. Use pipe straps or individual conduit hangers for supporting individual conduits.
- C. Support multiple conduit runs with trapeze hangers. Use trapeze hangers that are designed to support a load equal to or greater than the sum of the weights of the conduits, wires, hanger itself, and an additional 90 kg (200 lbs.). Attach each conduit with U-bolts or other approved fasteners.
- D. Support conduit independently of junction boxes, pull-boxes, fixtures, suspended ceiling T-bars, angle supports, and similar items.
- E. Fasteners and Supports in Solid Masonry and Concrete:
  - 1. New Construction: Use steel or malleable iron concrete inserts set in place prior to placing the concrete.
  - 2. Existing Construction:
    - a. Steel expansion anchors not less than 6 mm (0.25-inch) bolt size and not less than 28 mm (1.125 inch) in embedment.
    - b. Power set fasteners not less than 6 mm (0.25-inch) diameter with depth of penetration not less than 75 mm (3 inch).
    - c. Use vibration and shock-resistant anchors and fasteners for attaching to concrete ceilings.

- F. Hollow Masonry: Toggle bolts.
- G. Bolts supported only by plaster or gypsum wallboard are not acceptable.
- H. Metal Structures: Use machine screw fasteners or other devices specifically designed and approved for the application.
- I. Attachment by wood plugs, rawl plug, plastic, lead or soft metal anchors, or wood blocking and bolts supported only by plaster is prohibited.
- J. Chain, wire, or perforated strap shall not be used to support or fasten conduit.
- K. Spring steel type supports or fasteners are prohibited for all uses except horizontal and vertical supports/fasteners within walls.
- L. Vertical Supports: Vertical conduit runs shall have riser clamps and supports in accordance with the NEC and as shown. Provide supports for cable and wire with fittings that include internal wedges and retaining collars.

### **3.10 BOX INSTALLATION**

- A. Boxes for Concealed Conduits:
  - 1. Flush-mounted.
  - 2. Provide raised covers for boxes to suit the wall or ceiling, construction, and finish.
- B. In addition to boxes shown, install additional boxes where needed to prevent damage to cables and wires during pulling-in operations or where more than the equivalent of 4-90 degree bends are necessary.
- C. Locate pullboxes so that covers are accessible and easily removed. Coordinate locations with piping and ductwork where installed above ceilings.
- D. Remove only knockouts as required. Plug unused openings. Use threaded plugs for cast metal boxes and snap-in metal covers for sheet metal boxes.
- E. Outlet boxes mounted back-to-back in the same wall are prohibited. A minimum 600 mm (24 inch) center-to-center lateral spacing shall be maintained between boxes.
- F. Flush-mounted wall or ceiling boxes shall be installed with raised covers so that the front face of raised cover is flush with the wall. Surface-mounted wall or ceiling boxes shall be installed with surface-style flat or raised covers.

- G. Minimum size of outlet boxes for ground fault circuit interrupter (GFCI) receptacles is 100 mm (4 inches) square x 55 mm (2.125 inches) deep, with device covers for the wall material and thickness involved.
- H. Stencil or install phenolic nameplates on covers of the boxes identified on riser diagrams; for example "SIG-FA JB No. 1."
- I. On all branch circuit junction box covers, identify the circuits with black marker.

- - - E N D - - -

**SECTION 26 05 73  
OVERCURRENT PROTECTIVE DEVICE COORDINATION STUDY**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the overcurrent protective device coordination study, related calculations and analysis, indicated as the study in this section.
- B. A short-circuit and selective coordination study, and arc flash calculations and analysis shall be prepared for the electrical overcurrent devices to be installed under this project.
- C. The study shall present a well-coordinated time-current analysis of each overcurrent protective device from the individual device up to the utility source.
- D. Turn SKM file over to VA after completion of study.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements that are common to more than one section of Division 26.
- B. Section 26 24 16, PANELBOARDS: Low-voltage panelboards.

**1.3 QUALITY ASSURANCE**

- A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. The study shall be prepared by the equipment manufacturer, and performed by the equipment manufacturer's licensed electrical engineer.

**1.4 SUBMITTALS**

- A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:
  - 1. Product data on the software program to be used for the study. Software shall be in mainstream use in the industry, shall provide device settings and ratings, and shall show selective coordination by time-current drawings.
  - 2. Complete study as described in paragraph 1.6. Submittal of the study shall be well-coordinated with submittals of the shop drawings for equipment in related specification sections.



3. Certifications: Two weeks prior to final inspection, submit the following.
  - a. Certification by the Contractor that the overcurrent protective devices have been set in accordance with the approved study.

**1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. Institute of Electrical and Electronics Engineers (IEEE):
  - 241-90.....Recommended Practice Electrical Systems in Commercial Buildings
  - 242-03.....Recommended Practice for Protection and Coordination of Industrial and Commercial Power Systems
  - 399-97.....Recommended Practice for Industrial and Commercial Power Systems Analysis
  - 1584-02.....Performing Arc-Flash Hazards Calculations
  - 1584A-04.....Performing Arc-Flash Hazards Calculations - Amendment 1
  - 1584B-11.....Performing Arc-Flash Hazards Calculations - Amendment 2
- C. National Fire Protection Association (NFPA):
  - 70-17.....National Electrical Code (NEC)
  - 70E-18.....Standard for Electrical Safety in the Workplace
  - 99-18.....Health Care Facilities Code

**1.6 STUDY REQUIREMENTS**

- A. The study shall be in accordance with IEEE and NFPA standards.
- B. The study shall include one line diagram, short-circuit and ground fault analysis, protective coordination plots for all overcurrent protective devices, and arc flash calculations and analysis.
- C. One Line Diagram:
  1. Show all electrical equipment and wiring to be protected by the overcurrent devices.
  2. Show the following specific information:
    - a. Calculated fault impedance, X/R ratios, and short-circuit values at each feeder and branch circuit bus.

- b. Relay, circuit breaker, and fuse ratings.
  - c. Generator kW/kVA and transformer kVA and voltage ratings, percent impedance, X/R ratios, and wiring connections.
  - d. Voltage at each bus.
  - e. Identification of each bus, matching the identification on the drawings.
  - f. Conduit, conductor, and busway material, size, length, and X/R ratios.
- D. Short-Circuit Study:
- 1. The study shall be performed using computer software designed for this purpose. Pertinent data and the rationale employed in developing the calculations shall be described in the introductory remarks of the study.
  - 2. Calculate the fault impedance to determine the available short-circuit and ground fault currents at each bus. Incorporate applicable motor and/or generator contribution in determining the momentary and interrupting ratings of the overcurrent protective devices.
  - 3. Present the results of the short-circuit study in a table. Include the following:
    - a. Device identification.
    - b. Operating voltage.
    - c. Overcurrent protective device type and rating.
    - d. Calculated short-circuit current.
- E. Coordination Study:
- 1. Prepare the coordination curves to determine the required settings of overcurrent protective devices to demonstrate selective coordination. Graphically illustrate on log-log paper that adequate time separation exists between devices, including the utility company upstream device if applicable. Plot the specific time-current characteristics of each overcurrent protective device in such a manner that all devices are clearly depicted.
  - 2. The following specific information shall also be shown on the coordination curves:
    - a. Device identification.
    - b. Potential transformer and current transformer ratios.

- c. Three-phase and single-phase ANSI damage points or curves for each cable, transformer, or generator.
  - d. Applicable circuit breaker or protective relay characteristic curves.
  - e. No-damage, melting, and clearing curves for fuses.
  - f. Transformer in-rush points.
3. Develop a table to summarize the settings selected for the overcurrent protective devices. Include the following in the table:
- a. Device identification.
  - b. Protective relay or circuit breaker potential and current transformer ratios, sensor rating, and available and suggested pickup and delay settings for each available trip characteristic.
  - c. Fuse rating and type.
- F. Arc Flash Calculations and Analysis:
1. Arc flash warning labels shall comply with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
  2. Arc flash calculations shall be based on actual over-current protective device clearing time. Maximum clearing time shall be in accordance with IEEE 1584.
  3. Arc flash analysis shall be based on the lowest clearing time setting of the over-current protective device to minimize the incident energy level without compromising selective coordination.
  4. Arc flash boundary and available arc flash incident energy at the corresponding working distance shall be calculated for all electrical power distribution equipment specified in the project, and as shown on the drawings.
  5. Required arc-rated clothing and other PPE shall be selected and specified in accordance with NFPA 70E.
- G. Coordination study calculations to be done using SKM power tools.

#### **1.7 ANALYSIS**

- A. Analyze the short-circuit calculations, and highlight any equipment determined to be underrated as specified. Propose solutions to effectively protect the underrated equipment.

#### **1.8 ADJUSTMENTS, SETTINGS, AND MODIFICATIONS**

- A. Final field settings and minor modifications of the overcurrent protective devices shall be made to conform with the study, without additional cost to the Government.

Dayton Veterans Medical Center  
Replace Elevator Controls (Hospital Complex)  
552-19-106

01-01-18  
100% Construction Documents  
December 16, 2019

**PART 2 - PRODUCTS (NOT USED)**

**PART 3 - EXECUTION (NOT USED)**

---END---

**SECTION 26 24 16**  
**PANELBOARDS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, and connection of panelboards.

**1.2 RELATED WORK**

- A. Section 09 91 00, PAINTING: Painting of panelboards.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS:  
Requirements that apply to all sections of Division 26.
- C. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES:  
Low-voltage conductors.
- D. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS:  
Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- E. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits.
- F. Section 26 05 73, OVERCURRENT PROTECTIVE DEVICE COORDINATION STUDY:  
Short circuit and coordination study, and requirements for a coordinated electrical system.

**1.3 QUALITY ASSURANCE**

- A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:
1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Include electrical ratings, dimensions, mounting details, materials, required clearances, terminations, weight, circuit breakers, wiring and connection diagrams, accessories, and nameplate data.
    - c. Certification from the manufacturer that a representative panelboard has been seismically tested to International Building Code requirements. Certification shall be based upon simulated

seismic forces on a shake table or by analytical methods, but not by experience data or other methods.

2. Manuals:

a. Submit, simultaneously with the shop drawings, complete maintenance and operating manuals including technical data sheets, wiring diagrams, and information for ordering circuit breakers and replacement parts.

1) Include schematic diagrams, with all terminals identified, matching terminal identification in the panelboards.

2) Include information for testing, repair, troubleshooting, assembly, and disassembly.

b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.

3. Certifications: Two weeks prior to final inspection, submit the following.

a. Certification by the manufacturer that the panelboards conform to the requirements of the drawings and specifications.

b. Certification by the Contractor that the panelboards have been properly installed, adjusted, and tested.

**1.5 APPLICABLE PUBLICATIONS**

A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.

B. International Code Council (ICC):

IBC-15.....International Building Code

C. National Electrical Manufacturers Association (NEMA):

PB 1-11.....Panelboards

250-14.....Enclosures for Electrical Equipment (1,000V  
Maximum)

D. National Fire Protection Association (NFPA):

70-17.....National Electrical Code (NEC)

70E-18.....Standard for Electrical Safety in the Workplace

E. Underwriters Laboratories, Inc. (UL):

50-15.....Enclosures for Electrical Equipment

67-09.....Panelboards

489-16.....Molded Case Circuit Breakers and Circuit  
Breaker Enclosures

**PART 2 - PRODUCTS**

**2.1 GENERAL REQUIREMENTS**

- A. Panelboards shall be in accordance with NEC, NEMA, UL, as specified, and as shown on the drawings.
- B. Panelboards shall have main breaker or main lugs, bus size, voltage, phases, number of circuit breaker mounting spaces, top or bottom feed, flush or surface mounting, branch circuit breakers, and accessories as shown on the drawings.
- C. Panelboards shall be completely factory-assembled with molded case circuit breakers and integral accessories as shown on the drawings or specified herein.
- D. Non-reduced size copper bus bars, rigidly supported on molded insulators, and fabricated for bolt-on type circuit breakers.
- E. Bus bar connections to the branch circuit breakers shall be the "distributed phase" or "phase sequence" type.
- F. Mechanical lugs furnished with panelboards shall be cast, stamped, or machined metal alloys listed for use with the conductors to which they shall be connected.
- G. Neutral bus shall be 100% rated, mounted on insulated supports.
- H. Grounding bus bar shall be equipped with screws or lugs for the connection of equipment grounding conductors.
- I. Bus bars shall be braced for the available short-circuit current as shown on the drawings, but not be less than 10,000 A symmetrical for 120/208 V and 120/240 V panelboards, and 14,000 A symmetrical for 277/480 V panelboards.
- J. In two-section panelboards, the main bus in each section shall be full size. The first section shall be furnished with subfeed lugs on the line side of main lugs only, or through-feed lugs for main breaker type panelboards, and have field-installed cable connections to the second section as shown on the drawings. Panelboard sections with tapped bus or crossover bus are not acceptable.
- K. Series-rated panelboards are not permitted.

**2.2 ENCLOSURES AND TRIMS**

- A. Enclosures:

1. Provide galvanized steel enclosures, with NEMA rating as shown on the drawings or as required for the environmental conditions in which installed.
2. Enclosures shall not have ventilating openings.
3. Enclosures shall be of one-piece formed steel or of formed sheet steel with end and side panels welded, riveted, or bolted as required.
4. Provide manufacturer's standard option for prepunched knockouts on top and bottom endwalls.
5. Include removable inner dead front cover, independent of the panelboard cover.

B. Trims:

1. Hinged "door-in-door" type.
2. Interior hinged door with hand-operated latch or latches, as required to provide access only to circuit breaker operating handles, not to energized parts.
3. Outer hinged door shall be securely mounted to the panelboard enclosure with factory bolts, screws, clips, or other fasteners, requiring a key or tool for entry. Hand-operated latches are not acceptable.
4. Inner and outer doors shall open left to right.
5. Trims shall be flush or surface type as shown on the drawings.

**2.3 MOLDED CASE CIRCUIT BREAKERS**

- A. Circuit breakers shall be per UL, NEC, as shown on the drawings, and as specified.
- B. Circuit breakers shall be bolt-on type.
- C. Circuit breakers shall have minimum interrupting rating as required to withstand the available fault current, but not less than:
  1. 120/208 V Panelboard: 10,000 A symmetrical.
  2. 120/240 V Panelboard: 10,000 A symmetrical.
  3. 277/480 V Panelboard: 14,000 A symmetrical.
- D. Circuit breakers shall have automatic, trip free, non-adjustable, inverse time, and instantaneous magnetic trips for less than 400 A frame. Circuit breakers with 400 A frames and above shall have magnetic trip, adjustable from 5x to 10x. Breaker trip setting shall be set in the field, based on the approved protective device study as specified in Section 26 05 73, OVERCURRENT PROTECTIVE DEVICE COORDINATION STUDY.



- E. Circuit breaker features shall be as follows:
1. A rugged, integral housing of molded insulating material.
  2. Silver alloy contacts.
  3. Arc quenchers and phase barriers for each pole.
  4. Quick-make, quick-break, operating mechanisms.
  5. A trip element for each pole, thermal magnetic type with long time delay and instantaneous characteristics, a common trip bar for all poles and a single operator.
  6. Electrically and mechanically trip free.
  7. An operating handle which indicates closed, tripped, and open positions.
  8. An overload on one pole of a multi-pole breaker shall automatically cause all the poles of the breaker to open.
  9. Ground fault current interrupting breakers, shunt trip breakers, lighting control breakers (including accessories to switch line currents), or other accessory devices or functions shall be provided where shown on the drawings.
  10. For circuit breakers being added to existing panelboards, coordinate the breaker type with existing panelboards. Modify the panel directory accordingly.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Installation shall be in accordance with the manufacturer's instructions, the NEC, as shown on the drawings, and as specified.
- B. Locate panelboards so that the present and future conduits can be conveniently connected.
- C. In seismic areas, panelboards shall be adequately anchored and braced per details on structural contract drawings to withstand the seismic forces at the location where installed.
- D. Install a printed schedule of circuits in each panelboard after approval by the COR. Schedules shall reflect final load descriptions, room numbers, and room names connected to each circuit breaker. Schedules shall be printed on the panelboard directory cards and be installed in the appropriate panelboards
- E. Mount panelboards such that the maximum height of the top circuit breaker above the finished floor shall not exceed 1980 mm (78 inches).
- F. Provide blank cover for each unused circuit breaker mounting space.

- G. Panelboard enclosures shall not be used for conductors feeding through, spliced, or tapping off to other enclosures or devices.

### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Perform in accordance with the manufacturer's recommendations. In addition, include the following:
1. Visual Inspection and Tests:
    - a. Compare equipment nameplate data with specifications and approved shop drawings.
    - b. Inspect physical, electrical, and mechanical condition.
    - c. Verify appropriate anchorage and required area clearances.
    - d. Verify that circuit breaker sizes and types correspond to approved shop drawings.
    - e. To verify tightness of accessible bolted electrical connections, use the calibrated torque-wrench method or perform thermographic survey after energization.
    - f. Vacuum-clean enclosure interior. Clean enclosure exterior.

### **3.3 FOLLOW-UP VERIFICATION**

- A. Upon completion of acceptance checks, settings, and tests, the Contractor shall demonstrate that the panelboards are in good operating condition and properly performing the intended function.

---END---

**SECTION 26 27 26**  
**WIRING DEVICES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, connection, and testing of wiring devices.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements that are common to more than one section of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Cables and wiring.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduit and boxes.
- E. Section 26 51 00, INTERIOR LIGHTING: Fluorescent ballasts and LED drivers for use with manual dimming controls.

**1.3 QUALITY ASSURANCE**

- A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:
1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Include electrical ratings, dimensions, mounting details, construction materials, grade, and termination information.
  2. Manuals:
    - a. Submit, simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals, including technical data sheets and information for ordering replacement parts.

- b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
- 3. Certifications: Two weeks prior to final inspection, submit the following.
  - a. Certification by the manufacturer that the wiring devices conform to the requirements of the drawings and specifications.
  - b. Certification by the Contractor that the wiring devices have been properly installed and adjusted.

**1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by basic designation only.
- B. National Electrical Manufacturers Association (NEMA):
  - WD 1-99(R2015).....General Color Requirements for Wiring Devices
  - WD 6-16 .....Wiring Devices - Dimensional Specifications
- C. National Fire Protection Association (NFPA):
  - 70-17.....National Electrical Code (NEC)
  - 99-18.....Health Care Facilities
- D. Underwriter's Laboratories, Inc. (UL):
  - 5-16.....Surface Metal Raceways and Fittings
  - 20-10.....General-Use Snap Switches
  - 231-16.....Power Outlets
  - 467-13.....Grounding and Bonding Equipment
  - 498-17.....Attachment Plugs and Receptacles
  - 943-16.....Ground-Fault Circuit-Interrupters
  - 1449-14.....Surge Protective Devices
  - 1472-15.....Solid State Dimming Controls

**PART 2 - PRODUCTS**

**2.1 RECEPTACLES**

- A. General: All receptacles shall comply with NEMA, NFPA, UL, and as shown on the drawings.
  - 1. Mounting straps shall be nickel plated brass, brass, nickel plated steel or galvanize steel with break-off plaster ears, and shall include a self-grounding feature. Terminal screws shall be brass, brass plated or a copper alloy metal.

2. Receptacles shall have provisions for back wiring with separate metal clamp type terminals (four minimum) and side wiring from four captively held binding screws.
- B. Duplex Receptacles - Hospital-grade: shall be listed for hospital grade, single phase, 20 ampere, 120 volts, 2-pole, 3-wire, NEMA 5-20R, with break-off feature for two-circuit operation.
1. Bodies shall be ivory in color.
  2. Switched duplex receptacles shall be wired so that only the top receptacle is switched. The lower receptacle shall be unswitched.
  3. Duplex Receptacles on Emergency Circuit:
    - a. In rooms without emergency powered general lighting, the emergency receptacles shall be of the self-illuminated type.
  4. Ground Fault Current Interrupter (GFCI) Duplex Receptacles: Shall be an integral unit, hospital-grade, suitable for mounting in a standard outlet box, with end-of-life indication and provisions to isolate the face due to improper wiring. GFCI receptacles shall be self-test receptacles in accordance with UL 943.
    - a. Ground fault interrupter shall consist of a differential current transformer, self-test, solid state sensing circuitry and a circuit interrupter switch. Device shall have nominal sensitivity to ground leakage current of 4-6 milliamperes and shall function to interrupt the current supply for any value of ground leakage current above five milliamperes (+ or - 1 milliampere) on the load side of the device. Device shall have a minimum nominal tripping time of 0.025 second.
    - b. Self-test function shall be automatically initiated within 5 seconds after power is activated to the receptacles. Self-test function shall be periodically and automatically performed every 3 hours or less.
    - c. End-of-life indicator light shall be a persistent flashing or blinking light to indicate that the GFCI receptacle is no longer in service.
- C. Receptacles - 20, 30, and 50 ampere, 250 Volts: Shall be complete with appropriate cord grip plug.
- D. Weatherproof Receptacles: Shall consist of a duplex receptacle, mounted in box with a gasketed, weatherproof, cast metal cover plate and cap over each receptacle opening. The cap shall be permanently attached to

the cover plate by a spring-hinged flap. The weatherproof integrity shall not be affected when heavy duty specification or hospital grade attachment plug caps are inserted. Cover plates on outlet boxes mounted flush in the wall shall be gasketed to the wall in a watertight manner.

E. Surge Protective (TVSS) Receptacles shall have integral surge suppression in line to ground, line to neutral, and neutral to ground modes.

1. TVSS Components: Multiple metal-oxide varistors; with a nominal clamp-level rating of 400 Volts, and minimum single transient pulse energy dissipation of 210 Joules.
2. Active TVSS Indication: LED, visible in face of device to indicate device is active or no longer in service.

## **2.2 TOGGLE SWITCHES**

A. Toggle switches shall be totally enclosed tumbler type with nylon bodies. Handles shall be ivory in color unless otherwise specified or shown on the drawings.

1. Switches installed in hazardous areas shall be explosion-proof type in accordance with the NEC and as shown on the drawings.
2. Shall be single unit toggle, butt contact, quiet AC type, heavy-duty general-purpose use with an integral self grounding mounting strap with break-off plaster ears and provisions for back wiring with separate metal wiring clamps and side wiring with captively held binding screws.
3. Switches shall be rated 20 amperes at 120-277 Volts AC.

## **2.3 WALL PLATES**

- A. Wall plates for switches and receptacles shall be type 302 stainless steel. Oversize plates are not acceptable.
- B. For receptacles or switches mounted adjacent to each other, wall plates shall be common for each group of receptacles or switches.
- C. In areas requiring tamperproof wiring devices, wall plates shall be type 302 stainless steel, and shall have tamperproof screws and beveled edges.
- D. Duplex Receptacles on Emergency Circuit: Wall plates shall be type 302 stainless steel, with the word "EMERGENCY" engraved in 6 mm (1/4 inch) red letters.

## **2.4 SURFACE MULTIPLE-OUTLET ASSEMBLIES**

A. Shall have the following features:

1. Enclosures:
  - a. Thickness of steel shall be not less than 1 mm (0.040 inch) for base and cover. Nominal dimensions shall be 40 mm x 70 mm (1-1/2 inches by 2-3/4 inches) with inside cross sectional area not less than 2250 square mm (3-1/2 square inches). The enclosures shall be thoroughly cleaned, phosphatized, and painted at the factory with primer and the manufacturer's standard baked enamel finish.
2. Receptacles shall be duplex, hospital grade. See paragraph 'RECEPTACLES' in this Section. Device cover plates shall be the manufacturer's standard corrosion resistant finish and shall not exceed the dimensions of the enclosure.
3. Unless otherwise shown on drawings, receptacle spacing shall be 600 mm (24 inches) on centers.
4. Conductors shall be as specified in Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES.
5. Installation fittings shall be the manufacturer's standard bends, offsets, device brackets, inside couplings, wire clips, elbows, and other components as required for a complete system.
6. Bond the assemblies to the branch circuit conduit system.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Installation shall be in accordance with the NEC and as shown as on the drawings.
- B. Install wiring devices after wall construction and painting is complete.
- C. The ground terminal of each wiring device shall be bonded to the outlet box with an approved green bonding jumper, and also connected to the branch circuit equipment grounding conductor.
- D. Outlet boxes for toggle switches and manual dimming controls shall be mounted on the strike side of doors.
- E. Provide barriers in multi-gang outlet boxes to comply with the NEC.
- F. Coordinate the electrical work with the work of other trades to ensure that wiring device flush outlets are positioned with box openings aligned with the face of the surrounding finish material. Pay special attention to installations in cabinet work, and in connection with laboratory equipment.

- G. Exact field locations of floors, walls, partitions, doors, windows, and equipment shall vary from locations shown on the drawings. Prior to locating sleeves, boxes and chases for roughing-in of conduit and equipment, the Contractor shall coordinate exact field location of the above items with other trades.
- H. Install wall switches 1.2 M (48 inches) above floor, with the toggle OFF position down.
- I. Install wall dimmers 1.2 M (48 inches) above floor.
- J. Install receptacles 450 mm (18 inches) above floor, and 152 mm (6 inches) above counter backsplash or workbenches. Install specific-use receptacles at heights shown on the drawings.
- K. Install horizontally mounted receptacles with the ground pin to the right.
- L. When required or recommended by the manufacturer, use a torque screwdriver. Tighten unused terminal screws.
- M. Label device plates with a permanent adhesive label listing panel and circuit feeding the wiring device.

### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Perform manufacturer's required field checks in accordance with the manufacturer's recommendations, and the latest NFPA 99. In addition, include the following:
  - 1. Visual Inspection and Tests:
    - a. Inspect physical and electrical conditions.
    - b. Vacuum-clean surface metal raceway interior. Clean metal raceway exterior.
    - c. Test wiring devices for damaged conductors, high circuit resistance, poor connections, inadequate fault current path, defective devices, or similar problems using a portable receptacle tester. Correct circuit conditions, remove malfunctioning units and replace with new, and retest as specified above.
    - d. Test GFCI receptacles.

---END---



**SECTION 26 29 21**  
**ENCLOSED SWITCHES AND CIRCUIT BREAKERS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, and connection of fused and unfused disconnect switches (indicated as switches in this section), and separately-enclosed circuit breakers for use in electrical systems rated 600 V and below.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS:  
Requirements that apply to all sections of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES:  
Low-voltage conductors.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS:  
Requirements for personnel safety and to provide a low impedance path for possible ground faults.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits.
- E. Section 26 24 16, PANELBOARDS: Molded-case circuit breakers.

**1.3 QUALITY ASSURANCE**

- A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:
1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Submit the following data for approval:
      - 1) Electrical ratings, dimensions, mounting details, materials, required clearances, terminations, weight, fuses, circuit breakers, wiring and connection diagrams, accessories, and device nameplate data.
    - c. Certification from the manufacturer that representative enclosed switches and circuit breakers have been seismically tested to International Building Code requirements. Certification shall be

based upon simulated seismic forces on a shake table or by analytical methods, but not by experience data or other methods.

2. Manuals:

a. Submit complete maintenance and operating manuals including technical data sheets, wiring diagrams, and information for ordering fuses, circuit breakers, and replacement parts.

1) Include schematic diagrams, with all terminals identified, matching terminal identification in the enclosed switches and circuit breakers.

2) Include information for testing, repair, troubleshooting, assembly, and disassembly.

b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.

3. Certifications: Two weeks prior to final inspection, submit the following.

a. Certification by the manufacturer that the enclosed switches and circuit breakers conform to the requirements of the drawings and specifications.

b. Certification by the Contractor that the enclosed switches and circuit breakers have been properly installed, adjusted, and tested.

**1.5 APPLICABLE PUBLICATIONS**

A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.

B. International Code Council (ICC):

IBC-15.....International Building Code

C. National Electrical Manufacturers Association (NEMA):

FU 1-12.....Low Voltage Cartridge Fuses

KS 1-13.....Heavy Duty Enclosed and Dead-Front Switches  
(600 Volts Maximum)

D. National Fire Protection Association (NFPA):

70-17.....National Electrical Code (NEC)

E. Underwriters Laboratories, Inc. (UL):

98-16.....Enclosed and Dead-Front Switches

- 248 1-11.....Low Voltage Fuses
- 489-13.....Molded Case Circuit Breakers and Circuit  
Breaker Enclosures

**PART 2 - PRODUCTS**

**2.1 SEPARATELY-ENCLOSED CIRCUIT BREAKERS**

- A. Provide circuit breakers in accordance with the applicable requirements in Section 26 24 16, PANELBOARDS.
- B. Enclosures shall be the NEMA types shown on the drawings. Where the types are not shown, they shall be the NEMA type most suitable for the ambient environmental conditions.

**PART 3 - EXECUTION**

**3.1 INSTALLATION**

- A. Installation shall be in accordance with the NEC, as shown on the drawings, and manufacturer's instructions.
- B. In seismic areas, enclosed switches and circuit breakers shall be adequately anchored and braced per details on structural contract drawings to withstand the seismic forces at the location where installed.
- C. Fused switches shall be furnished complete with fuses. Arrange fuses such that rating information is readable without removing the fuses.

**3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Perform in accordance with the manufacturer's recommendations. In addition, include the following:
  - 1. Visual Inspection and Tests:
    - a. Compare equipment nameplate data with specifications and approved shop drawings.
    - b. Inspect physical, electrical, and mechanical condition.
    - c. Verify tightness of accessible bolted electrical connections by calibrated torque-wrench method.
    - d. Vacuum-clean enclosure interior. Clean enclosure exterior.

**3.3 SPARE PARTS**

- A. Two weeks prior to the final inspection, furnish one complete set of spare fuses for each fused disconnect switch installed on the project. Deliver the spare fuses to the COR.

---END---

**SECTION 26 51 00  
INTERIOR LIGHTING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION:**

- A. This section specifies the furnishing, installation, and connection of the interior lighting systems. The terms "lighting fixture," "fixture," and "luminaire" are used interchangeably.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS:  
Requirements that apply to all sections of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES:  
Low-voltage conductors.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS:  
Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.
- D. Section 26 27 26, WIRING DEVICES: Wiring devices used for control of the lighting systems.

**1.3 QUALITY ASSURANCE**

- A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:
1. Shop Drawings:
    - a. Submit the following information for each type of lighting fixture designated on the LIGHTING FIXTURE SCHEDULE, arranged in order of lighting fixture designation.
    - b. Material and construction details, include information on housing and optics system.
    - c. Physical dimensions and description.
    - d. Wiring schematic and connection diagram.
    - e. Installation details.
    - f. Energy efficiency data.
    - g. Photometric data based on laboratory tests complying with IES Lighting Measurements testing and calculation guides.

- h. Lamp data including lumen output (initial and mean), color rendition index (CRI), rated life (hours), and color temperature (degrees Kelvin).
  - i. Ballast data including ballast type, starting method, ambient temperature, ballast factor, sound rating, system watts, and total harmonic distortion (THD).
  - j. For LED lighting fixtures, submit US DOE LED Lighting Facts label, and IES L70 rated life.
2. Manuals:
- a. Submit, simultaneously with the shop drawings, complete maintenance and operating manuals, including technical data sheets, wiring diagrams, and information for ordering replacement parts.
  - b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
3. Certifications: Two weeks prior to final inspection, submit the following.
- a. Certification by the Contractor that the interior lighting systems have been properly installed and tested.

**1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American Society for Testing and Materials (ASTM):  
C635/C635M REV A-13.....Manufacture, Performance, and Testing of Metal Suspension Systems for Acoustical Tile and Lay-in Panel Ceilings
- C. Environmental Protection Agency (EPA):  
40 CFR 261.....Identification and Listing of Hazardous Waste
- D. Federal Communications Commission (FCC):  
CFR Title 47, Part 15...Radio Frequency Devices  
CFR Title 47, Part 18...Industrial, Scientific, and Medical Equipment
- E. Illuminating Engineering Society of North America (IESNA):  
LM-79-08.....Electrical and Photometric Measurements of Solid-State Lighting Products

- LM-80-15.....Measuring Lumen Maintenance of LED Light Sources
- LM-82-12.....Characterization of LED Light Engines and LED Lamps for Electrical and Photometric Properties as a Function of Temperature
- F. Institute of Electrical and Electronic Engineers (IEEE):
  - C62.41-91(R1995).....Surge Voltages in Low Voltage AC Power Circuits
- G. International Code Council (ICC):
  - IBC-15.....International Building Code
- H. National Electrical Manufacturer's Association (NEMA):
  - C78.376-14.....Chromaticity of Fluorescent Lamps
  - C82.1-04(R2015).....Lamp Ballasts - Line Frequency Fluorescent Lamp Ballasts
  - C82.2-02(R2016).....Method of Measurement of Fluorescent Lamp Ballasts
  - C82.4-17.....Lamp Ballasts - Ballasts for High-Intensity Discharge and Low-Pressure Sodium (LPS) Lamps (Multiple-Supply Type)
  - C82.11-17.....Lamp Ballasts - High Frequency Fluorescent Lamp Ballasts
  - LL 9-11.....Dimming of T8 Fluorescent Lighting Systems
  - SSL 1-16.....Electronic Drivers for LED Devices, Arrays, or Systems
- I. National Fire Protection Association (NFPA):
  - 70-17.....National Electrical Code (NEC)
  - 101-18.....Life Safety Code
- J. Underwriters Laboratories, Inc. (UL):
  - 496-17.....Lampholders
  - 542-05.....Fluorescent Lamp Starters
  - 844-12.....Luminaires for Use in Hazardous (Classified) Locations
  - 924-16.....Emergency Lighting and Power Equipment
  - 935-01.....Fluorescent-Lamp Ballasts
  - 1029-94.....High-Intensity-Discharge Lamp Ballasts
  - 1029A-06.....Ignitors and Related Auxiliaries for HID Lamp Ballasts
  - 1598-08.....Luminaires

- 1574-04.....Track Lighting Systems
- 2108-15.....Low-Voltage Lighting Systems
- 8750-15.....Light Emitting Diode (LED) Light Sources for  
Use in Lighting Products

**PART 2 - PRODUCTS**

**2.1 LIGHTING FIXTURES**

- A. Shall be in accordance with NFPA, UL, as shown on drawings, and as specified.
- B. Sheet Metal:
  - 1. Shall be formed to prevent warping and sagging. Housing, trim and lens frame shall be true, straight (unless intentionally curved), and parallel to each other as designed.
  - 2. Wireways and fittings shall be free of burrs and sharp edges, and shall accommodate internal and branch circuit wiring without damage to the wiring.
  - 3. When installed, any exposed fixture housing surface, trim frame, door frame, and lens frame shall be free of light leaks.
  - 4. Hinged door frames shall operate smoothly without binding. Latches shall function easily by finger action without the use of tools.
- C. Recessed fixtures mounted in an insulated ceiling shall be listed for use in insulated ceilings.
- D. Mechanical Safety: Lighting fixture closures (lens doors, trim frame, and hinged housings) shall be retained in a secure manner by captive screws, chains, aircraft cable, captive hinges, or fasteners such that they cannot be accidentally dislodged during normal operation or routine maintenance.
- E. Metal Finishes:
  - 1. The manufacturer shall apply standard finish (unless otherwise specified) over a corrosion-resistant primer, after cleaning to free the metal surfaces of rust, grease, dirt and other deposits. Edges of pre-finished sheet metal exposed during forming, stamping or shearing processes shall be finished in a similar corrosion resistant manner to match the adjacent surface(s). Fixture finish shall be free of stains or evidence of rusting, blistering, or flaking, and shall be applied after fabrication.

2. Interior light reflecting finishes shall be white with not less than 85 percent reflectances, except where otherwise shown on the drawing.
  3. Exterior finishes shall be as shown on the drawings.
- F. Lighting fixtures shall have a specific means for grounding metallic wireways and housings to an equipment grounding conductor.
- G. Light Transmitting Components for Fluorescent Fixtures:
1. Shall be 100 percent virgin acrylic.
  2. Flat lens panels shall have not less than 3 mm (1/8 inch) of average thickness.
  3. Unless otherwise specified, lenses, reflectors, diffusers, and louvers shall be retained firmly in a metal frame by clips or clamping ring in such a manner as to allow expansion and contraction without distortion or cracking.
- H. Lighting fixtures in hazardous areas shall be suitable for installation in Class and Division areas as defined in NFPA 70.

## **2.2 EMERGENCY LIGHTING UNIT**

- A. Complete, self-contained unit with batteries, battery charger, one or more local or remote lamp heads with lamps, under-voltage relay, and test switch.
1. Enclosure: Shall be impact-resistant thermoplastic. Enclosure shall be suitable for the environmental conditions in which installed.
  2. Lamp Heads: Horizontally and vertically adjustable, mounted on the face of the unit, except where otherwise indicated.
  3. Battery: Shall be maintenance-free nickel-cadmium. Minimum normal life shall be minimum of 10 years.
  4. Battery Charger: Dry-type full-wave rectifier with charging rates to maintain the battery in fully-charged condition during normal operation, and to automatically recharge the battery within 12 hours following a 1-1/2 hour continuous discharge.
  5. Integral Self-Test: Automatically initiates test of unit emergency operation at required intervals. Test failure is annunciated by an integral audible alarm and a flashing LED.

## **2.3 LED LIGHT FIXTURES**

- A. General:
1. LED light fixtures shall be in accordance with IES, NFPA, UL, as shown on the drawings, and as specified.



2. LED light fixtures shall be Reduction of Hazardous Substances (RoHS)-compliant.
  3. LED drivers shall include the following features unless otherwise indicated:
    - a. Minimum efficiency: 85% at full load.
    - b. Minimum Operating Ambient Temperature: -20° C. (-4° F.)
    - c. Input Voltage: 120 - 277V (±10%) at 60 Hz.
    - d. Integral short circuit, open circuit, and overload protection.
    - e. Power Factor: ≥ 0.95.
    - f. Total Harmonic Distortion: ≤ 20%.
    - g. Comply with FCC 47 CFR Part 15.
  4. LED modules shall include the following features unless otherwise indicated:
    - a. Comply with IES LM-79 and LM-80 requirements.
    - b. Minimum CRI 80 and color temperature 4000° K unless otherwise specified in LIGHTING FIXTURE SCHEDULE.
    - c. Minimum Rated Life: 50,000 hours per IES L70.
    - d. Light output lumens as indicated in the LIGHTING FIXTURE SCHEDULE.
  5. LED light fixtures shall have at least a 5 year limited manufacturer's warranty covering drivers, modules, and integral control devices from defects in material and workmanship.
- B. LED Downlights:
1. Housing, LED driver, and LED module shall be products of the same manufacturer.
- C. LED Troffers:
1. LED drivers, modules, and reflector shall be accessible, serviceable, and replaceable from below the ceiling.
  2. Housing, LED driver, and LED module shall be products of the same manufacturer.
  3. LED light fixtures shall be DesignLights Consortium (DLC) qualified.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Installation shall be in accordance with the NEC, manufacturer's instructions, and as shown on the drawings or specified.
- B. Align, mount, and level the lighting fixtures uniformly.

- C. Wall-mounted fixtures shall be attached to the studs in the walls, or to a 20 gauge metal backing plate that is attached to the studs in the walls. Lighting fixtures shall not be attached directly to gypsum board.
- D. Lighting Fixture Supports:
1. Shall provide support for all of the fixtures. Supports shall be anchored to channels of the ceiling construction, to the structural slab or to structural members within a partition, or above a suspended ceiling.
  2. Shall maintain the fixture positions after cleaning and relamping.
  3. Shall support the lighting fixtures without causing the ceiling or partition to deflect.
  4. Hardware for recessed lighting fixtures:
    - a. All fixture mounting devices connecting fixtures to the ceiling system or building structure shall have a capacity for a horizontal force of 100 percent of the fixture weight and a vertical force of 400 percent of the fixture weight.
    - b. Mounting devices shall clamp the fixture to the ceiling system structure (main grid runners or fixture framing cross runners) at four points in such a manner as to resist spreading of these supporting members. Each support point device shall utilize a screw or approved hardware to "lock" the fixture housing to the ceiling system, restraining the fixture from movement in any direction relative to the ceiling. The screw (size No. 10 minimum) or approved hardware shall pass through the ceiling member (T-bar, channel or spline), or it shall extend over the inside of the flange of the channel (or spline) that faces away from the fixture, in a manner that prevents any fixture movement.
    - c. In addition to the above, the following is required for fixtures exceeding 9 kg (20 pounds) in weight.
      - 1) Where fixtures mounted in ASTM Standard C635 "Intermediate Duty" and "Heavy Duty" ceilings and weigh between 9 kg and 25 kg (20 pounds and 56 pounds), provide two 12 gauge safety hangers hung slack between diagonal corners of the fixture and the building structure.
      - 2) Where fixtures weigh over 25 kg (56 pounds), they shall be independently supported from the building structure by

approved hangers. Two-way angular bracing of hangers shall be provided to prevent lateral motion.

- d. Where ceiling cross runners are installed for support of lighting fixtures, they shall have a carrying capacity equal to that of the main ceiling runners and be rigidly secured to the main runners.
5. Surface mounted lighting fixtures:
- a. Fixtures shall be bolted against the ceiling independent of the outlet box at four points spaced near the corners of each unit. The bolts (or stud-clips) shall be minimum 6 mm (1/4 inch) bolt, secured to main ceiling runners and/or secured to cross runners. Non-turning studs shall be attached to the main ceiling runners and cross runners with special non-friction clip devices designed for the purpose, provided they bolt through the runner, or are also secured to the building structure by 12 gauge safety hangers. Studs or bolts securing fixtures weighing in excess of 25 kg (56 pounds) shall be supported directly from the building structure.
  - b. Where ceiling cross runners are installed for support of lighting fixtures, they shall have a carrying capacity equal to that of the main ceiling runners and be rigidly secured to the main runners.
  - c. Fixtures less than 6.8 kg (15 pounds) in weight and occupying less than 3715 sq cm (two square feet) of ceiling area shall, when designed for the purpose, be supported directly from the outlet box when all the following conditions are met.
    - 1) Screws attaching the fixture to the outlet box pass through round holes (not key-hole slots) in the fixture body.
    - 2) The outlet box is attached to a main ceiling runner (or cross runner) with approved hardware.
    - 3) The outlet box is supported vertically from the building structure.
  - d. Fixtures mounted in open construction shall be secured directly to the building structure with approved bolting and clamping devices.
6. Single or double pendant-mounted lighting fixtures:

- a. Each stem shall be supported by an approved outlet box mounted swivel joint and canopy which holds the stem captive and provides spring load (or approved equivalent) dampening of fixture oscillations. Outlet box shall be supported vertically from the building structure.
7. Outlet boxes for support of lighting fixtures (where permitted) shall be secured directly to the building structure with approved devices or supported vertically in a hung ceiling from the building structure with a nine gauge wire hanger, and be secured by an approved device to a main ceiling runner or cross runner to prevent any horizontal movement relative to the ceiling.
- E. Furnish and install the new lamps as specified for all lighting fixtures installed under this project, and for all existing lighting fixtures reused under this project.
  - F. The electrical and ceiling trades shall coordinate to ascertain that approved lighting fixtures are furnished in the proper sizes and installed with the proper devices (hangers, clips, trim frames, and flanges), to match the ceiling system being installed.
  - G. Bond lighting fixtures to the grounding system as specified in Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
  - H. At completion of project, replace all defective components of the lighting fixtures at no cost to the Government.

### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Perform the following:
  1. Visual Inspection:
    - a. Verify proper operation by operating the lighting controls.
    - b. Visually inspect for damage to fixtures, lenses, reflectors, diffusers, and louvers. Clean fixtures, lenses, reflectors, diffusers, and louvers that have accumulated dust, dirt, or fingerprints during construction.
  2. Electrical tests:
    - a. Exercise dimming components of the lighting fixtures over full range of dimming capability by operating the control devices(s) in the presence of the COR. Observe for visually detectable flicker over full dimming range, and replace defective components at no cost to the Government.

- b. Burn-in all lamps that require specific aging period to operate properly, prior to occupancy by Government. Burn-in period to be 40 hours minimum, unless specifically recommended otherwise by the lamp manufacturer. Burn-in dimmed fluorescent and compact fluorescent lamps for at least 100 hours at full voltage, unless specifically recommended otherwise by the lamp manufacturer.  
Replace any lamps and ballasts which fail during burn-in.

### **3.3 FOLLOW-UP VERIFICATION**

- A. Upon completion of acceptance checks and tests, the Contractor shall show by demonstration in service that the lighting systems are in good operating condition and properly performing the intended function.

---END---