


TYPICAL NURSE CALL DEVICE CONDUIT DETAIL  
SCALE: NONE

Diagram illustrating the correct method for securing cable supports to a structure:

- SECURE SUPPORTS TO STRUCTURE
- APPROVED CABLE SUPPORT
- SECURE CABLES TO SUPPORT IN AREAS WHERE CABLES CHANGE DIRECTION
- PROVIDE SADDLE TYPE CABLE HANGERS DESIGNED AND APPROVED FOR ALL SYSTEM CABLEING. SECURE CABLE HANGERS TO STRUCTURE
- TIE CABLE BUNDLES WITH HOOK AND LOOP STRAPS TO SECURE CABLES ONLY. DO NOT OVER TIGHTEN OR DEFORM CABLE JACKETS
- 5' MAXIMUM SPACING
- MIN. 6"
- FINISHED CEILING

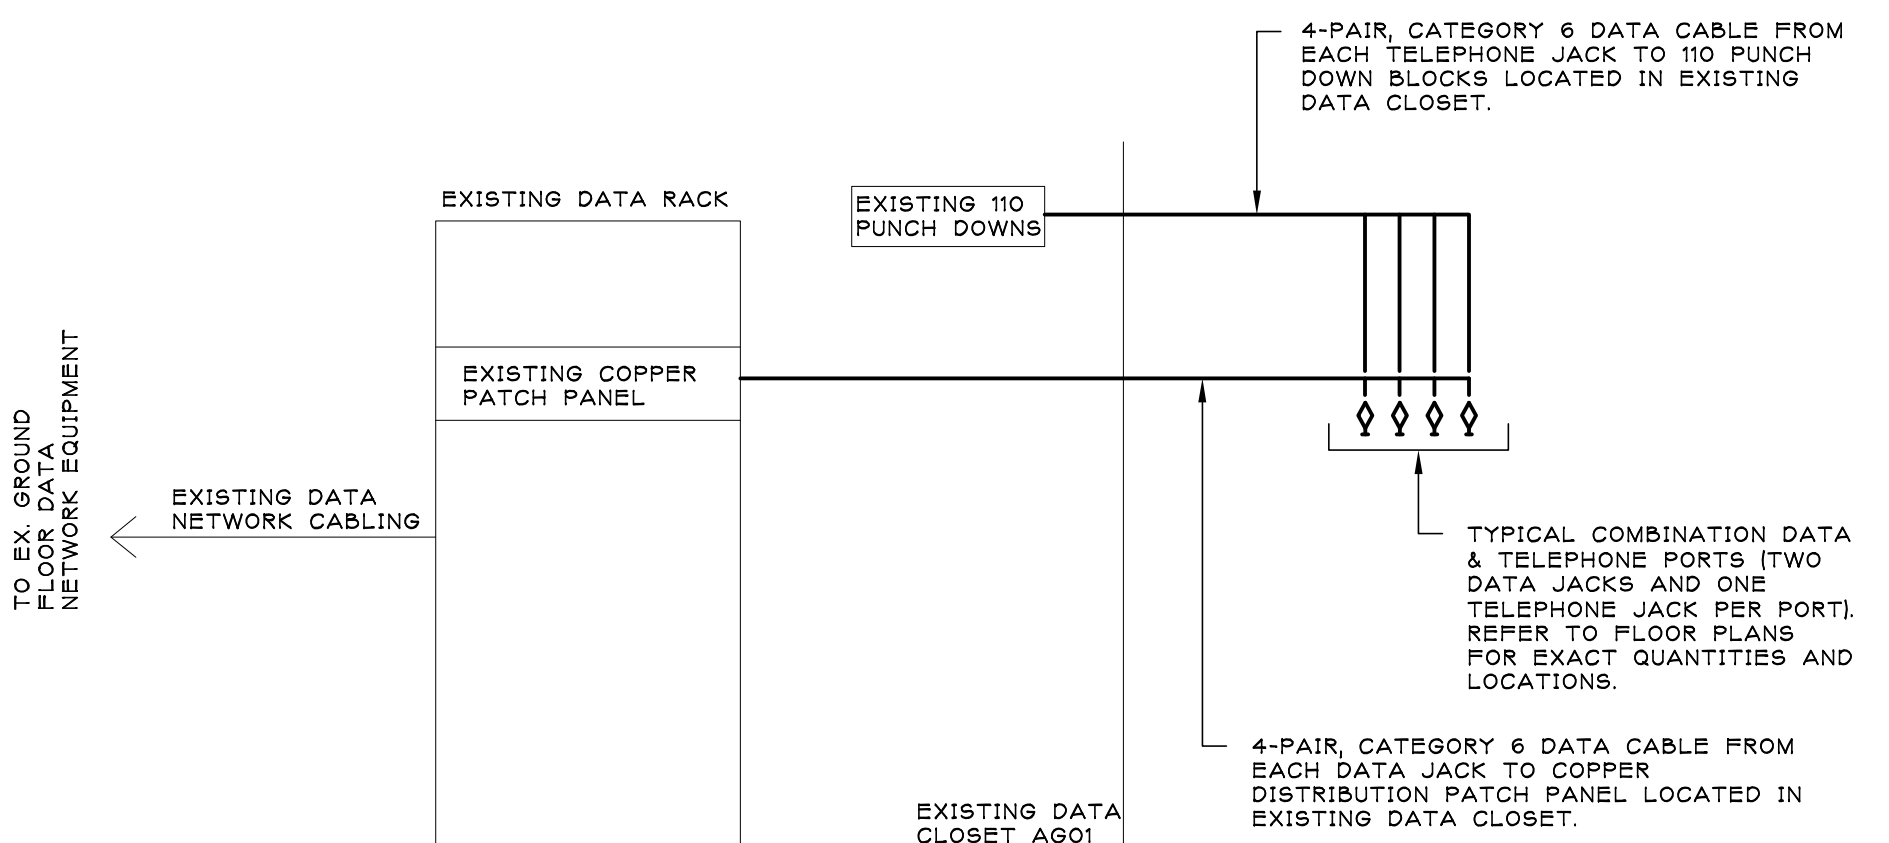

TYPICAL CABLE TRAY INSTALLATION DETAIL  
SCALE: NONE

TO NEXT EXTENDER PANEL

FIRE ALARM RISER CIRCUIT

FIRE ALARM AREA EXTENDER PANEL

CLASS 'A' WIRING TO NEXT DEVICE (TYPICAL)

CLASS 'A' WIRING TO NEXT DEVICE (TYPICAL)

CLASS 'A' WIRING TO NEXT DEVICE (TYPICAL)

CLOSET AG03

FIRE ALARM RISER CIRCUIT


FROM FIRE ALARM CONTROL PANEL

**FIRE ALARM SYSTEM SCOPE OF WORK**

1. RISER DIAGRAM IS INFORMATIONAL ONLY. REFER TO FLOOR PLANS FOR ACTUAL DEVICE COUNTS AND LOCATIONS. CIRCUIT RUN LENGTHS AND ADDITIONAL

FIRE ALARM RISER DIAGRAM  
SCALE: NONE

CONSULTANTS:	

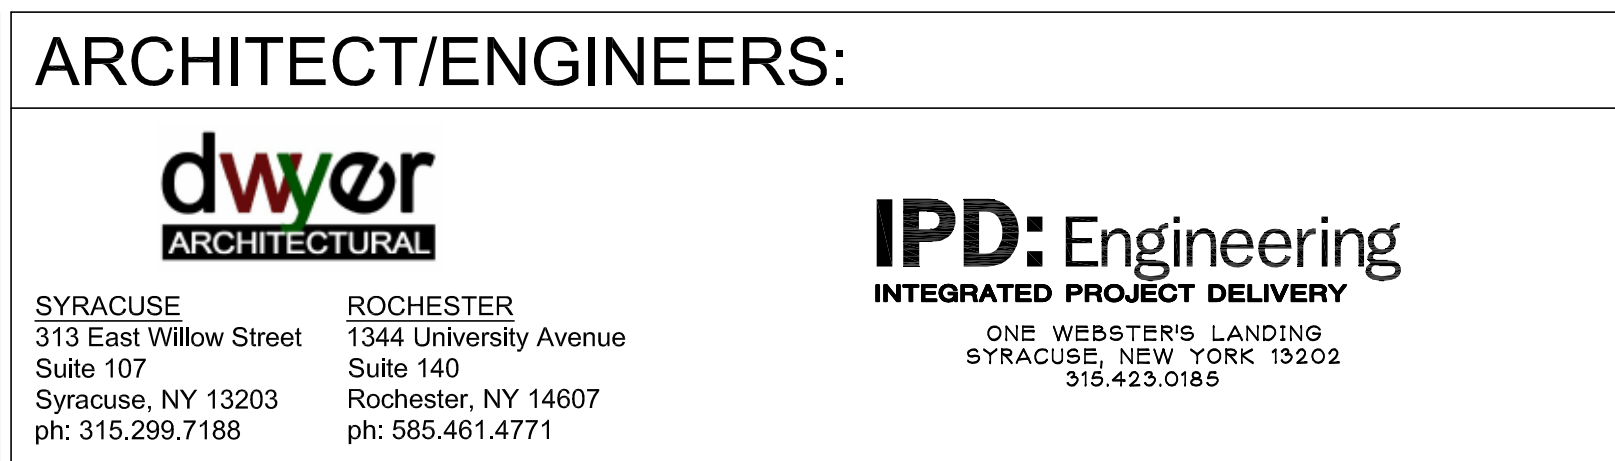

Project Title			Project Number 528A7-13-702	
RENOVATE FOR COMPENSATION AND PENSION CLINIC			Building Number	
Location 800 IRVING AVENUE, SYRACUSE NY 13210			Drawing Number	
Date 12.18.2012	Checked XXX	Drawn DMS	E-501 Dwg. 32 of 33	

