


TYPICAL MULTIPLE RADIANT  
CEILING PANEL DETAIL  
NTS


TYPICAL SINGLE RADIANT  
CEILING PANEL DETAIL  
NTS

9TH FLOOR PARTIAL PLAN - HVAC PIPING PLAN

SCALE: 1/4" = 1'-0"



- GENERAL NOTES:
1. ALL VAV BOXES AND RADIANT PANELS INDICATED AS NEW ON THIS PLAN ARE RELOCATED AND RE-INSTALLED EXISTING EQUIPMENT. BALANCE RE-INSTALLED EQUIPMENT TO MATCH NEW AIRFLOW AND HOT WATER GPM TO VALUES INDICATED ON THE PLANS AND SCHEDULES.
  2. ALL NEW HWS AND HWR BRANCH PIPING SHALL BE 3/4" UNLESS INDICATED OTHERWISE.

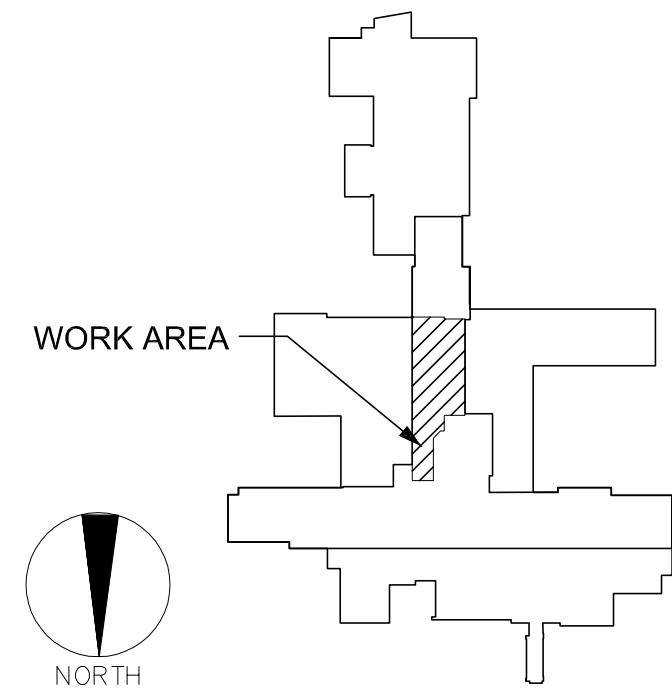

KEY PLAN

Scale: As Noted

CONSULTANTS:

ARCHITECT/ENGINEERS:

**dwyer**  
ARCHITECTURAL

SYRACUSE  
313 East Willow Street  
Suite 107  
Syracuse, NY 13203  
ph: 315.299.7188

ROCHESTER  
1344 University Avenue  
Suite 140  
Rochester, NY 14607  
ph: 585.461.4771

**IPD: Engineering**  
INTEGRATED PROJECT DELIVERY

ONE WEBSTER'S LANDING  
SYRACUSE, NEW YORK 13202  
315-453-0185

Drawing Title  
**9th FLOOR HVAC  
PIPING PLAN**

Approved: Project Director

Project Title  
RENOVATE FOR WOMEN'S CLINIC

Location  
800 IRVING AVENUE, SYRACUSE NY 13210

Date  
12.18.2012

Checked  
SBG

Drawn  
NCB

Project Number  
VA# 528A7-13-701  
IPD# 11-7230

Building Number  
1

Drawing Number  
**M-102**

Dwg. 30 of 41

