



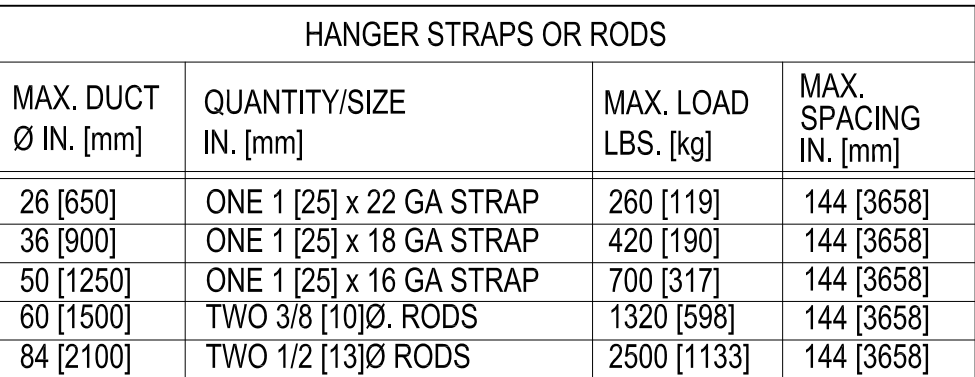


- 1 VOLUME DAMPER DETAIL  
H002 SCALE: N.T.S.

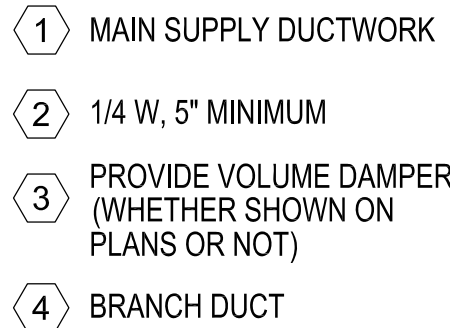

NOTE:

# 3 ROUND DUCTWORK SUPPORT



MAXIMUM PIPE/TUBING SUPPORT SPACING									
NOM. SIZE	IN. (MM)	THRU 3/4 THRU (20)	1 (25)	1 1/4 (32)	1 1/2 (40)	2 (50)	2 1/2 (65)	3 (75)	4 (100)
PIPE	FT. (M)	7 (2.1)	7 (2.1)	7 (2.1)	9 (2.7)	10 (3.0)	11 (3.4)	12 (3.7)	14 (4.1)
TUBING	FT. (M)	5 FT (1.5)	6 (1.8)	7 (2.1)	8 (2.4)	8 (2.4)	9 (2.7)	10 (3.0)	12 (3.7)

# 4 PIPE HANGER DETAIL H002 SCALE: N.T.S.




- ## 5 DUCTWORK RADIUS ELBOW DETAILS



- 7 DUCTWORK SQUARE VANED ELBOW  
H002 SCALE: N.T.S.



9 DUCT LEAKAGE TABLE  
H002 SCALE: N.T.S.

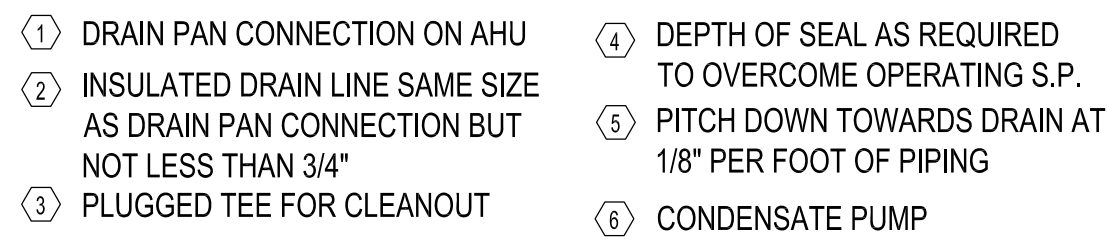

NOTE:

- 11 AHU COOLING COIL CONDENSATE TRAP DETAIL  
H002 SCALE: N.T.S.



100% SUBMISSION	05/13/11
95% SUBMISSION - REISSUED	06/04/10
95% SUBMISSION	02/12/10
60% SUBMISSION	07/17/09
Revisions:	Date


CONSULTANTS:

ARCHITECT/ENGINEERS:

**SAGE ENGINEERING  
ASSOCIATES, LLP**

1211 WESTERN AVENUE  
ALBANY, NY 12203

(518)453-6091 FAX(518)453-6092

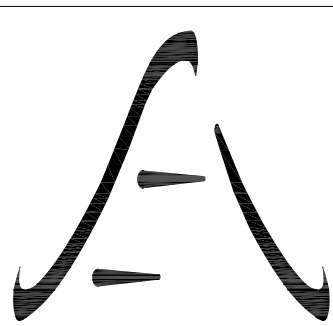

SEA PROJECT NO. 2217

Drawing Title

## HVAC DETAILS

Approved: Project Director

Project Title

## VISION CLINIC RENOVATIONS

[illegible]

Date  
MAY 13, 2011

Checked  
JV

Drawn
JC

Project Number

Building Number

1

Drawing Number

H002

100% DESIGN SUBMISSION

STRATTON  
VA  
MEDICAL CENTER

