


1 HVAC DUCTWORK PLAN
H100 SCALE: 1/4" = 1'-0"

GENERAL NOTES:

- ALL RECTANGULAR ELBOWS SHALL BE INSTALLED WITH TURNING VANES.

KEYED NOTES:

- CONNECT TO OUTDOOR AIR LOUVER AT LOCATION SHOWN AND PROVIDE 12" DEEP OA PLENUM COVERING THE ENTIRE LOUVER OPENING. PROVIDE A 50"x14" OA CONNECTION DOWN TO REAR INLET OF AC-2 AS REQUIRED. REFER TO ARCHITECTURAL DRAWINGS FOR LOUVER DETAILS.
- CONNECT TO RELIEF AIR LOUVER AT LOCATION SHOWN AND PROVIDE 16" DEEP RELIEF AIR PLENUM COVERING THE ENTIRE LOUVER OPENING. PROVIDE A TRANSITION FROM THE 34"x8" RELIEF AIR DUCT TO THE RELIEF AIR PLENUM AS REQUIRED. REFER TO ARCHITECTURAL DRAWINGS FOR LOUVER DETAILS.
- FOR EXISTING EXHAUST DUCTWORK LOCATED IN C-504/505 RELOCATE REGISTERS AS REQUIRED FOR CEILING INSTALLATION LAYOUT.
- PROVIDE A 36"x8" ACCESS DOOR MOUNTED TO THE BOTTOM OF THE OUTSIDE AIR INTAKE DUCTWORK TO ALLOW FOR CLEANING OF THE AIR INTAKE LOUVER.

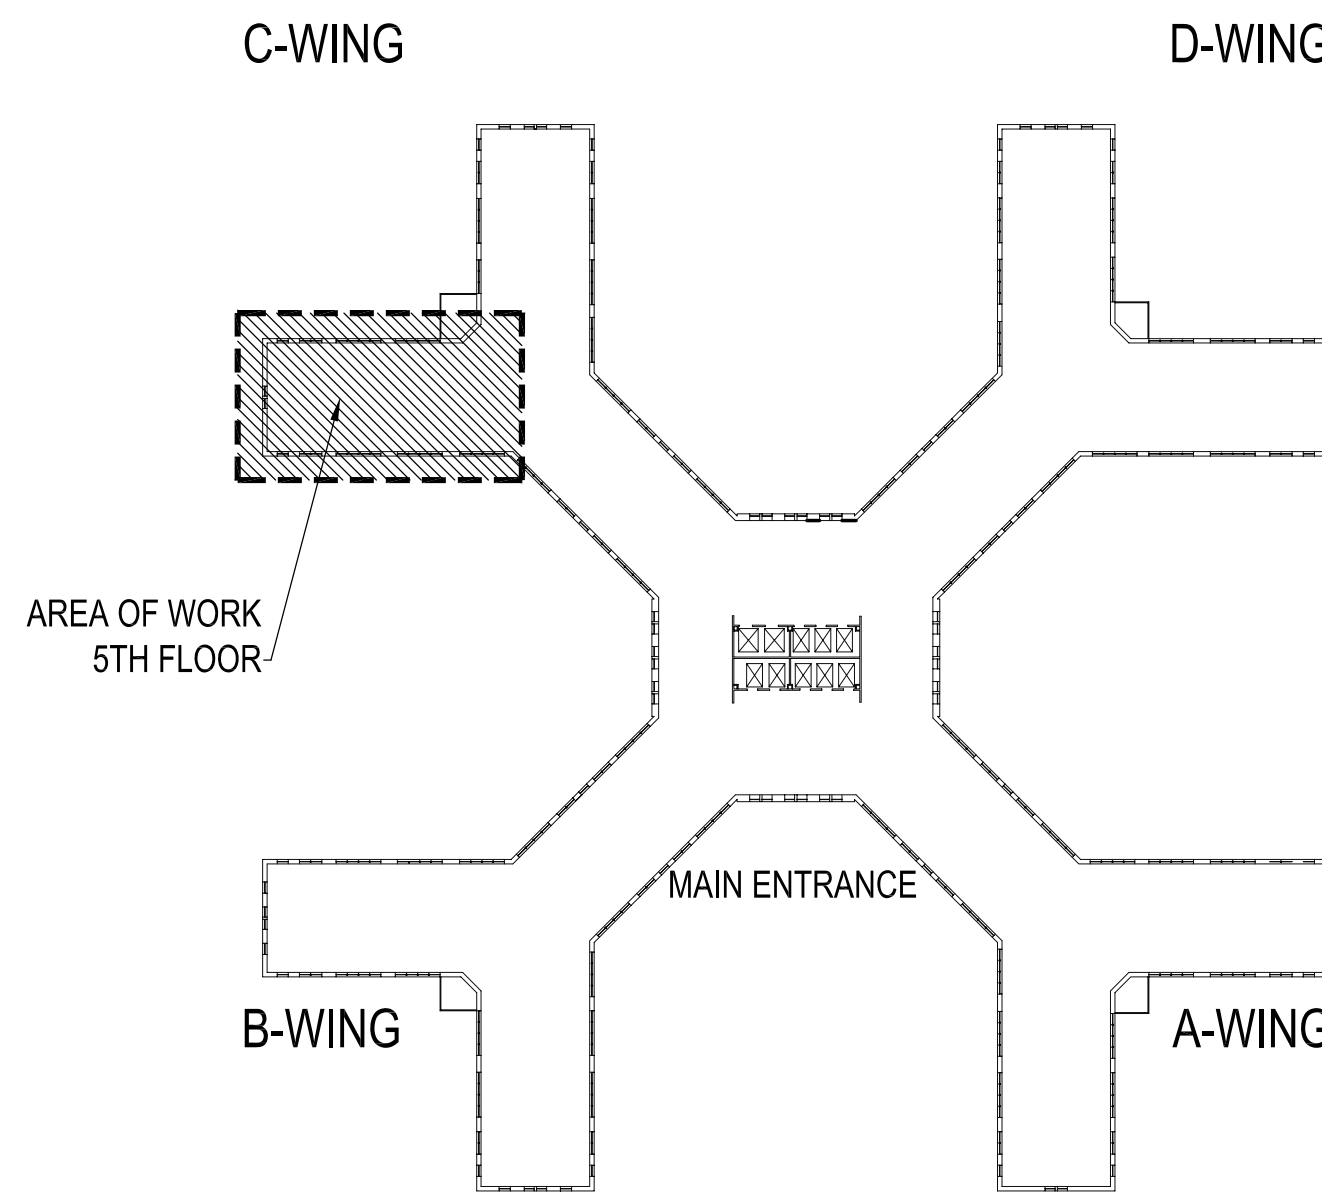

3 WORK KEY PLAN
H100 SCALE: N.T.S. 100% DESIGN SUBMISSION

				ARCHITECT/ENGINEERS:		Drawing Title		Project Title		Project Number		STRATTON VA MEDICAL CENTER	
				<div><div>SAGE ENGINEERING ASSOCIATES, LLP</div><div>1211 WESTERN AVENUE ALBANY, NY 12203</div><div>(518)453-6091 FAX(518)453-6092</div></div> <div>SEA PROJECT NO. 2217</div>		ENLARGED FLOOR PLAN		VISION CLINIC RENOVATIONS		Building Number			
						Approved: Project Director		Location		1			
								ALBANY, NEW YORK		Drawing Number			
100% SUBMISSION	05/13/11							Date		Checked		H100	
95% SUBMISSION - REISSUED	06/04/10							MAY 13, 2011		LM		JWP	
95% SUBMISSION	02/12/10												
60% SUBMISSION	07/17/09												
Revisions:	Date											Department of Veterans Affairs	