NOTES ELSEWHERE

1. DISCONNECT AND REMOVE EXISTING MEDICAL GAS OXYGEN OUTLET AND REPLACE WITH NEW AT SAME LOCATION.
2. 3/4" OXYGEN DOWN TO MEDICAL GAS ZONE VALVE BOX.
3. MEDICAL GAS ZONE VALVE BOX- 3/4" OXYGEN.
4. 3/4" OXYGEN UP FROM MEDICAL GAS ZONE VALVE BOX.
5. RELOCATED EXISTING ZONE VALVE BOX.

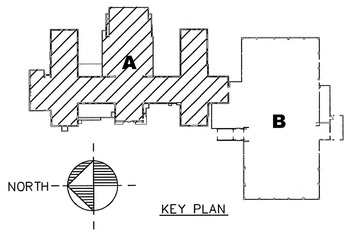

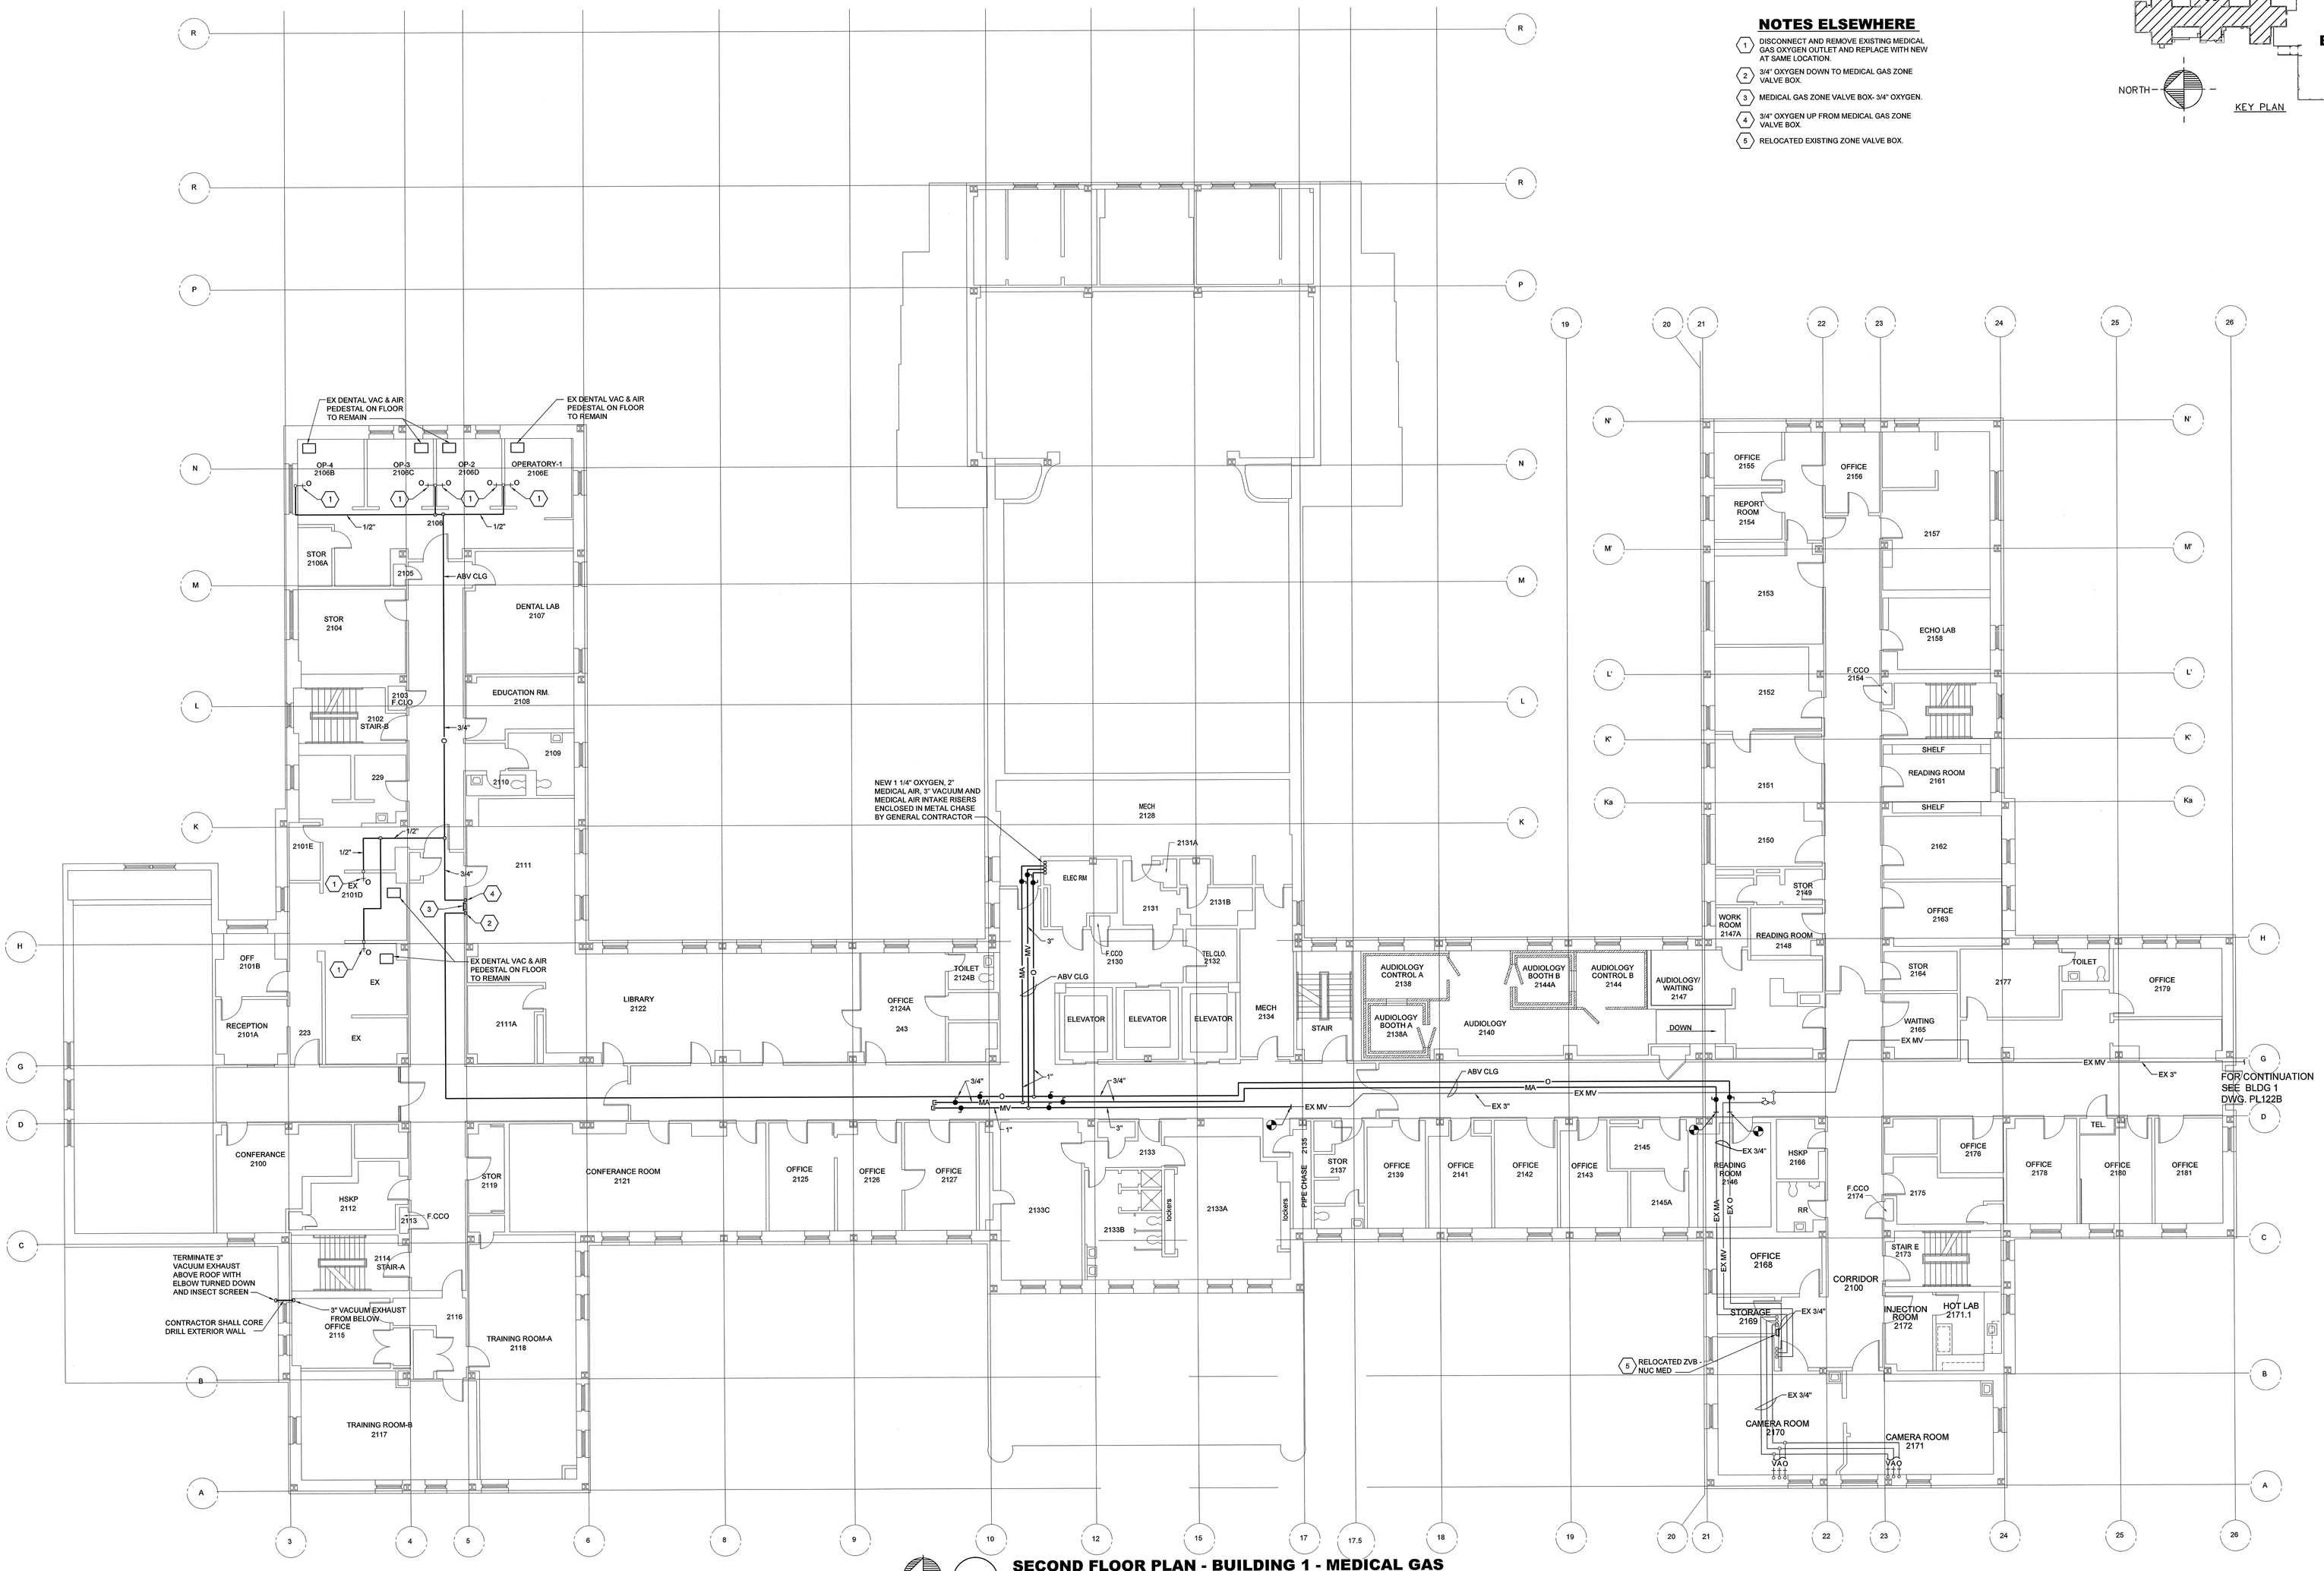

NORTH

A1 **SECOND FLOOR PLAN - BUILDING 1 - MEDICAL GAS**

Scale: 1/8" = 1'-0"

100% CONSTRUCTION DOCUMENTS

CONSULTANTS:

FIE Engineers Planners Surveyors Energy Consultants
H.F. LENZ COMPANY
1407 Scalp Avenue Johnstown, PA 15904
Phone: 814-269-9300 FAX: 814-269-9301
cadd@hflenz.com www.hflenz.com

TIMOTHY M. EARHART REGISTERED PROFESSIONAL ENGINEER 14788 STATE OF VIRGINIA

ARCHITECT:

ARRAY healthcare facilities solutions
2520 Renaissance Boulevard, Suite 110
King of Prussia, PA 19406
t: 610.270.0599
f: 610.270.0995
www.arrayhfs.com

Project Number	Scale

Drawing Title: SECOND FLOOR PLAN - BUILDING 1 - MEDICAL GAS

Approved: Project Director

Project Title: MEDICAL GAS SYSTEM REPLACEMENT PROJECT

Location: VAMC, CLARKSBURG

Date	Checked	Drawn
7/20/2012	TME	JLJ

VA Project Number: VA244-P-1491

Building Number: 01

Drawing Number: PL122A

Dwg. 30 of 44

Office of Facilities Management

Department of Veterans Affairs