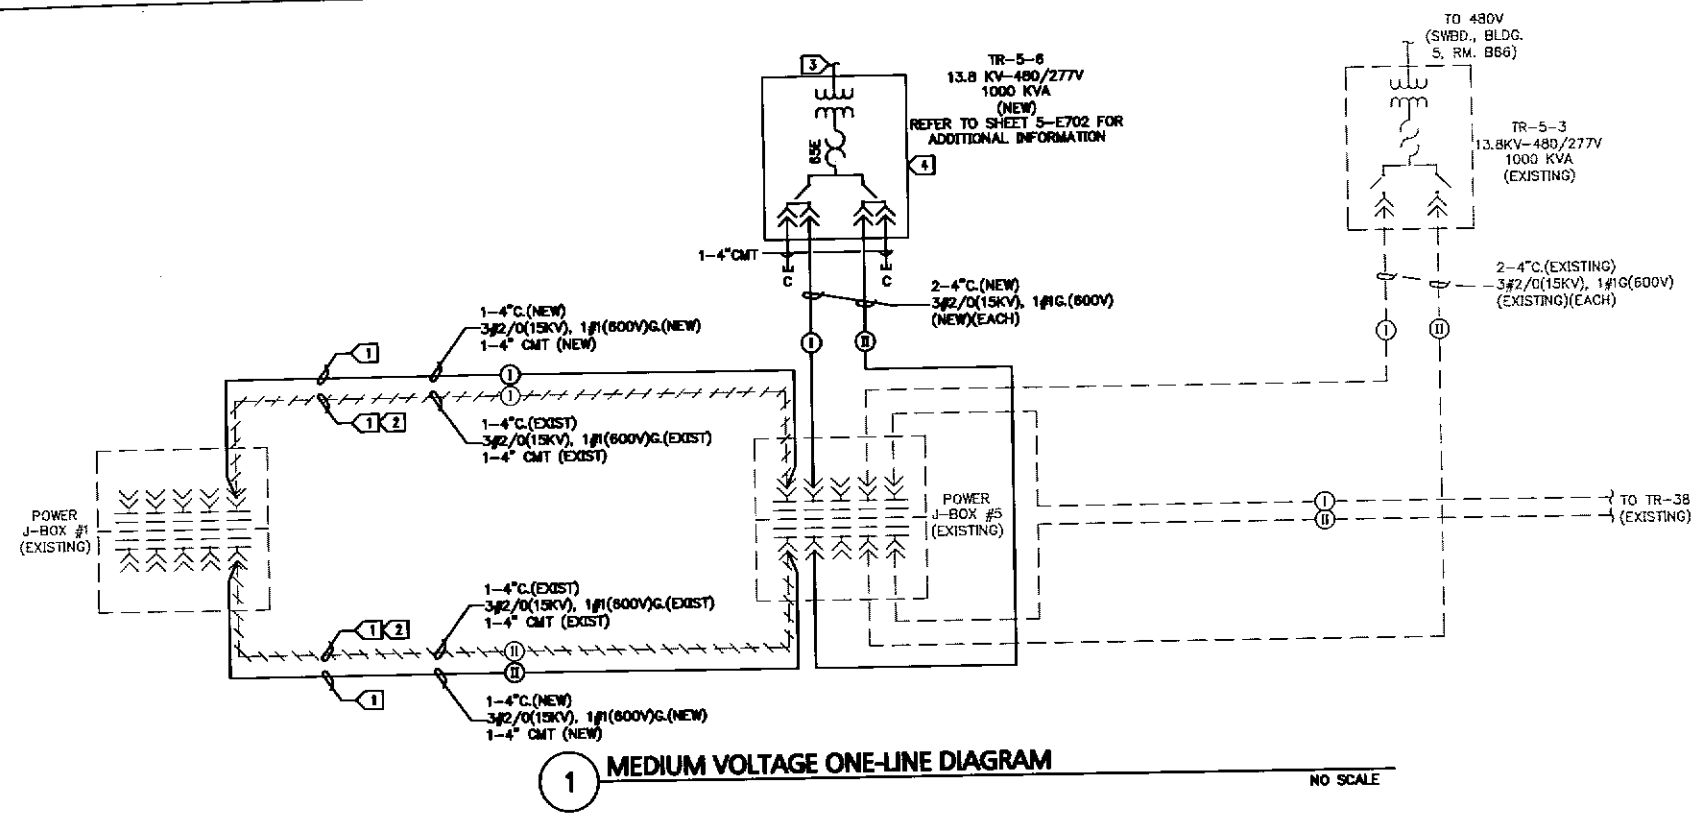

1 MEDIUM VOLTAGE ONE-LINE DIAGRAM

NO SCALE

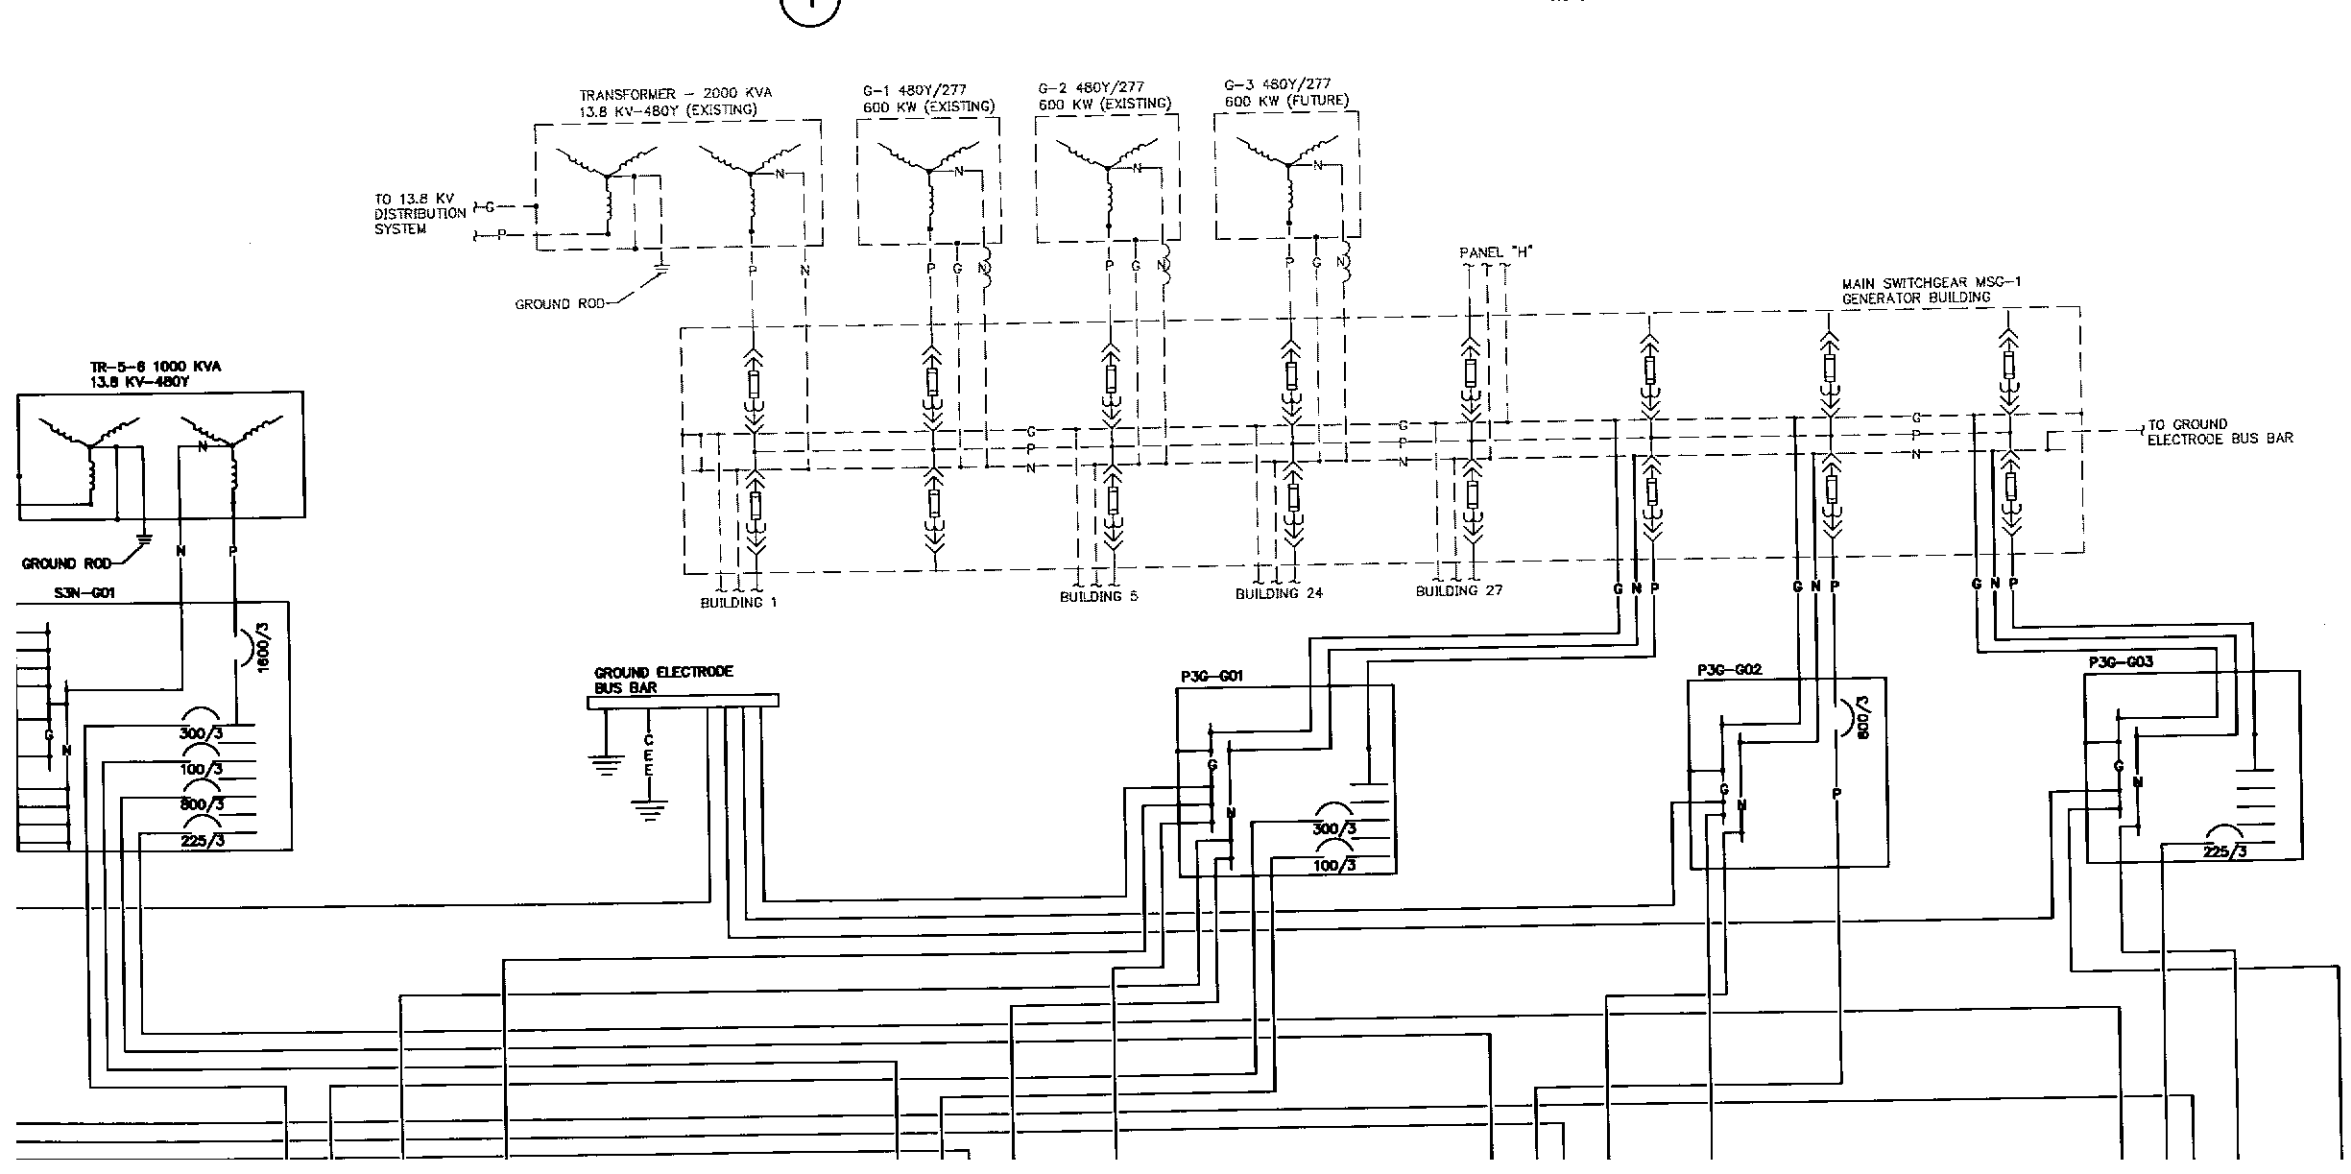

GENERAL NOTES:

A. ELECTRICAL EQUIPMENT AND FEEDERS THAT ARE INDICATED BY A DASHED LINE ARE EXISTING OR FUTURE.

B. UNLESS NOTED OTHERWISE 120/208V PANELBOARDS TO HAVE AN AIC RATING OF 10K AND 277/480V PANELBOARDS TO HAVE AN AIC RATING OF 14K.

ELECTRICAL NOTES:

1. THIS WORK TO BE EXCLUDED AS BID ALTERNATE #4, REFER TO SPECIFICATION SECTION 01.DO.00, GENERAL REQUIREMENTS FOR DESCRIPTION OF THIS BID ITEM.
2. DISCONNECT AND REMOVE EXISTING CABLES AND ABANDON EXISTING DUCT BANK.
3. REFER TO ONE-LINE DIAGRAM ON SHEET 5-702 FOR CONTINUATION OF CIRCUITING.
4. FIELD VERIFY THE EXISTING 13.8 KV SERVICE CONFIGURATION IS DELTA OR GROUNDED WYE.