


GENERAL DEMOLITION NOTES

1. DURING DEMOLITION, COORDINATE WORK WITH ALL TRADES THAT MAY BE REQUIRED.
2. CONTRACTOR SHALL PARTICIPATE IN PRE-CONSTRUCTION SURVEY WITH OWNER.
3. ALL LOCATIONS / DIMENSIONS ARE APPROXIMATE. CONTRACTOR SHALL BE RESPONSIBLE TO VERIFY LOCATIONS / DIMENSIONS AND EXISTING CONDITIONS IN THE FIELD.
4. DO NOT SCALE THIS DRAWING. FIELD VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS AT THE JOB SITE PRIOR TO SUBMITTING BID FOR CONSTRUCTION.
5. PRIOR TO DEMOLISHING THE STRUCTURES THE CONTRACTOR SHALL REMOVE ALL ACM CONTAINING MATERIALS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING AN ABATEMENT CONTRACTOR AND REMOVAL OF EXISTING ACMs SHALL ADHERE TO ALL EXISTING APPLICABLE STATE, COUNTY AND LOCAL REGULATIONS CONCERNING THE DISPOSAL OF DEMOLITION, CONSTRUCTION AND HAZARDOUS MATERIAL.
6. CONTRACTOR SHALL DEMOLISH THE EXISTING STRUCTURES, FOUNDATIONS TO A MINIMUM OF 24" BELOW THE GRADE LEVEL.
7. ALL UNDER SLAB PIPING AND CONDUITS SHALL BE CUT TO 2 TO 3 FEET BELOW GRADE LEVEL.
8. THE CONTRACTOR SHALL EXERCISE PRECAUTIONARY MEASURES TO MINIMIZE DUST EMISSIONS AS NECESSARY, WHICH MAY INCLUDE BUT SHALL NOT BE LIMITED TO, PERIODIC SPRINKLING OR WETTING OF THE SITE.
9. ANY ACCUMULATED STORM WATER IN ANY EXISTING TANKS OR STRUCTURES MAY BE PUMPED OUT AND DISCHARGED AT THE PROJECT SITE.
10. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PERFORMING ANY AND ALL STRUCTURAL DISMANTLING REQUIRED TO FACILITATE THE REMOVAL OF THE STRUCTURE.
11. CONTRACTOR SHALL LEVEL AND GRADE THE SITE AFTER DEMOLITION IS COMPLETE. PROVIDE APPROVED OFFSITE FILL MATERIAL AS REQUIRED.
12. CONTRACTOR TO REMOVE ALL TRASH AND DEBRIS FROM STATION DAILY. THE CONSTRUCTION SITE SHALL BE SECURE AT THE END OF EACH WORK DAY.

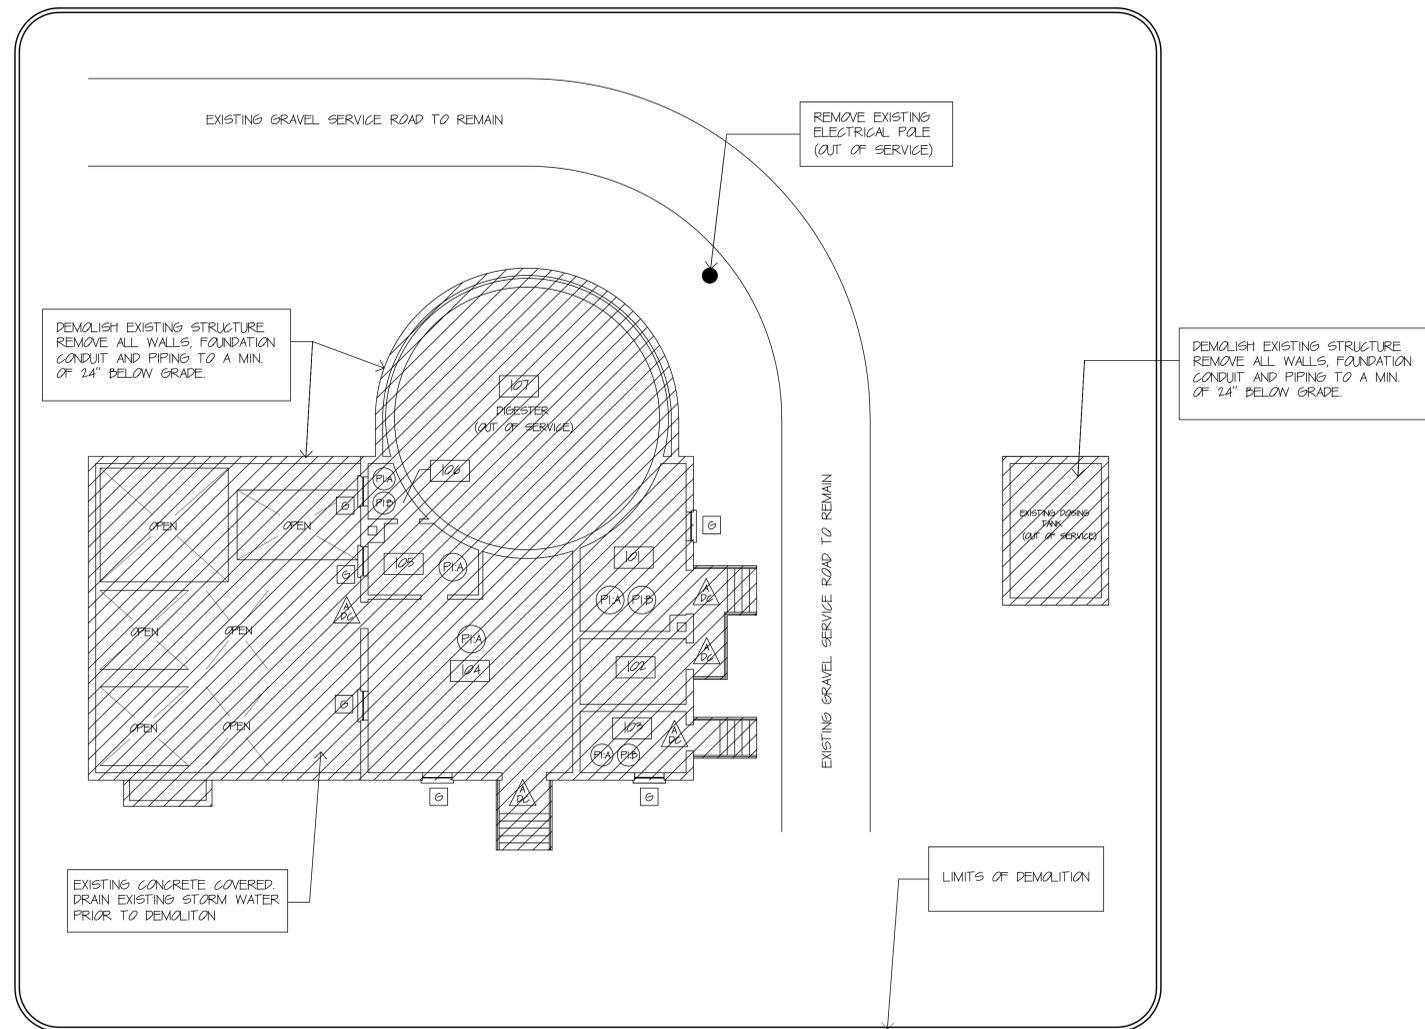

SEWER PLANT BUILDING  
(OUT OF SERVICE)  
EXISTING FLOOR PLAN  
SCALE: 1/8" = 1'-0" APPRX.

EXISTING UTILITY NOTES.

1. UTILITIES ARE BUT NOT LIMITED TO, ELECTRIC, WATER, STEAM & SEWER.
2. THERE ARE NO PHONE OR DATA UTILITIES TO THIS BUILDING.
3. ALL UTILITIES TO THIS BUILDING ARE ASSUMED TO BE PROPERLY TERMINATED AND DISCONNECTED. IF AT ANY TIME, THE CONTRACTOR ENCOUNTERS ACTIVE UTILITIES, IMMEDIATELY STOP WORK AND CONTACT THE PROJECT G.O.R.

LEGEND OF ACM MATERIALS TO BE ABATED

- G ACM WINDOW GLAZING COMPOUND: APPROX. 190 L.F.
- A/D ACM DOOR CAULKING: APPROX. 90 L.F.
- ACM PIPE INSULATION. APPROXIMATE LOCATIONS
- P1A - ROOMS 101, 103, 104, 105, 106: MILLBOARD PIPE INSULATION APPROX. 75 L.F.
- P1B - ROOMS 101, 103, 106: PIPE INSULATION DEBRIS APPROX. 250 L.F.

Revisions	Date

Drawing Title <b>BLDG. 86 - PLANS, DETAILS &amp; GENERAL NOTES</b>		Project Title <b>DEMOLISH BUILDING 86 &amp; 85</b>		Date <b>11/09/2012</b>
Approved: Engineering Project Manager		Building No. <b>86</b>	Checked <b>JAY</b>	Drawn <b>JHH</b>
Approved: Medical Center Director		Location <b>BATH, NEW YORK</b>		Project No. <b>528A6-13-610</b>
		DRAWING NO. VAMC-528A6-1748		<b>A-1</b>
		Dwg. 2 Of 3		

