GENERAL NOTES:

① DEEP 4 SQUARE ELECTRICAL JUNCTION BOX, LOCATIONS APPROXIMATE.

CONTRACTOR TO VERIFY ALL LENGTHS ON DRAWINGS.

EXACT LOCATIONS OF CONDUIT, AND BOXES TO BE VERIFIED WITH VA ELECTRICAL STAFF BEFORE PLACEMENT.

THERE WILL BE 17, 1½ TO 2" DIA. RISERS APPROXIMATELY 20' LONG TO BE INSTALLED BETWEEN FLOORS. NOT ALL LOCATIONS ARE SHOWN ON THE PLANS. VERIFY LOCATIONS WITH VA ELECTRICAL STAFF BEFORE PLACEMENT.

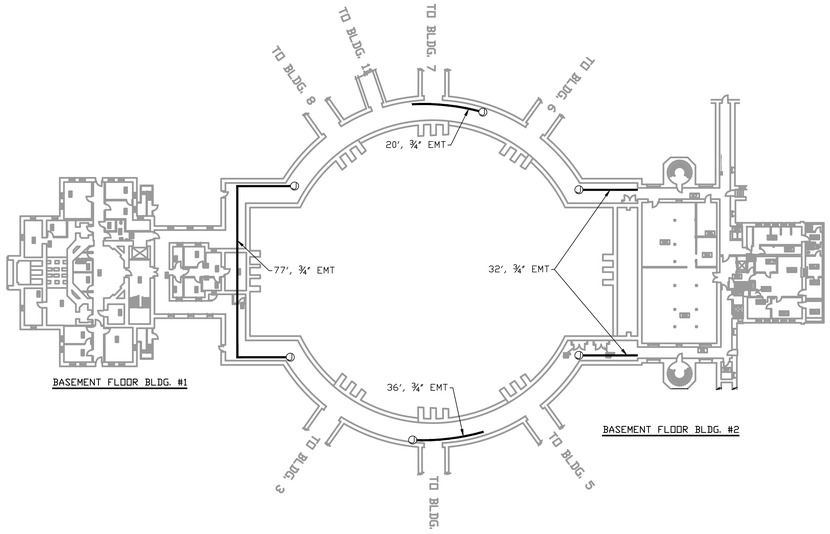

BASEMENT FLOOR BLDG. #1

BASEMENT FLOOR BLDG. #2

INNER ARCADE LOWER



FIRST FLOOR BLDG. #8

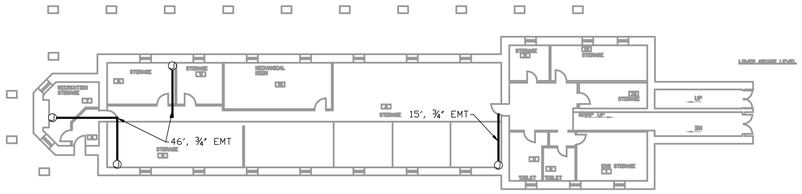

BASEMENT FLOOR BLDG. #8

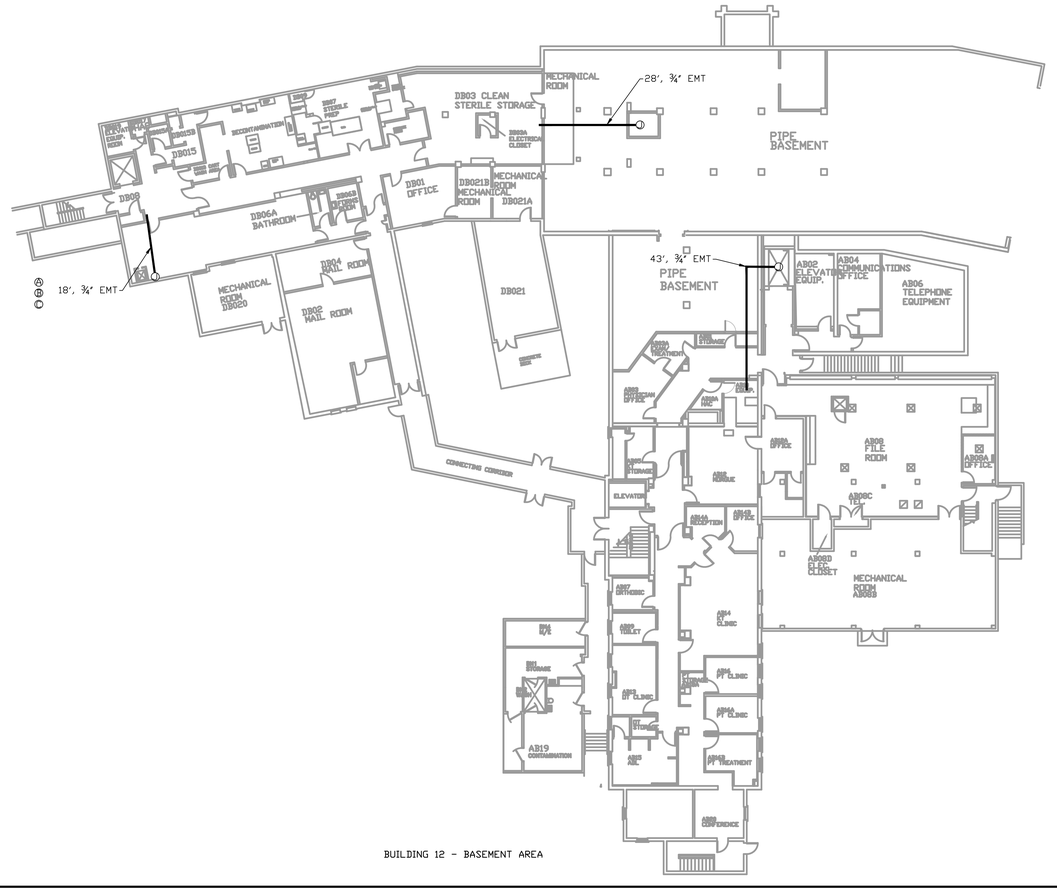

BUILDING 12 - BASEMENT AREA

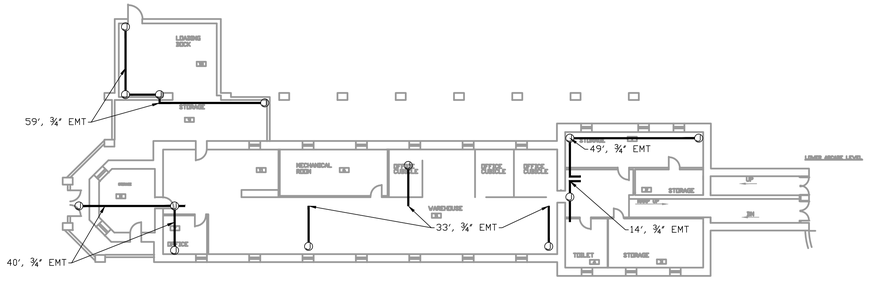

BASEMENT FLOOR BLDG. #6

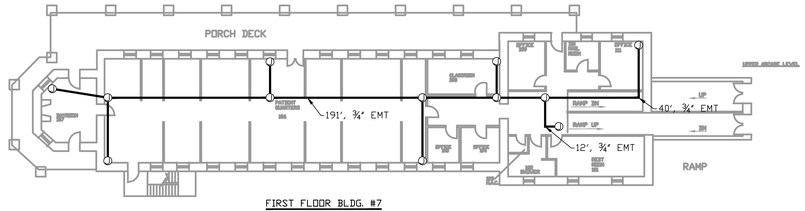

FIRST FLOOR BLDG. #7

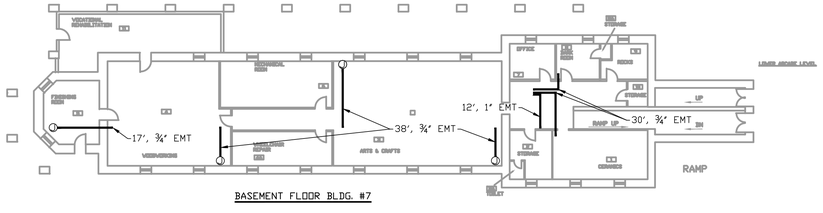

BASEMENT FLOOR BLDG. #7

Revisions:	Date

CONSULTANTS:

ARCHITECT/ENGINEERS:

Drawing Title: WIRELESS CONDUIT LAYOUT

Approved: Project Director

Scale: 1"=200'

Project Title: WIRELESS PROJECT

Location: VA HOT_SPRINGS SD

Date: 11-30-12 | Checked | Drawn: WAL

Project Number

Building Number

Drawing Number: SHT#26-2

Dwg. 2 of 2

Office of Construction and Facilities Management

Department of Veterans Affairs

VA FORM 08-6231