



KBJ Architects, Inc.  
AAC00001  
510 North Julia Street  
Jacksonville, Florida 32202




6767 North Wickham Road  
Suite 214  
Melbourne, Florida 32940

-  CONCRETE PAVING


  1. 6" THICK W/A MIN. 28-DAY COMPRESSIVE STRENGTH OF 4000 PSI PER ASTM C-39.
  2. 6" STABILIZED SUBGRADE COMPACTED TO 95% MODIFIED PROCTOR MAX. DRY DENSITY PER ASTM D1557, MIN. FBV 50.


 HEAVY DUTY ASPHALT PAVING


  1. 1.5" TYPE S-1 ASPHALTIC CONCRETE (1500 LB. MIN. MARSHALL STABILITY) WITH RC-70 PRIME COAT
  2. 8" LIMEROCK OR CEMENTED COQUINA BASE COMPACTED TO 95% MODIFIED PROCTOR MAX. DRY DENSITY PER ASTM D1557, MIN. FBV 100
  3. 8" STABILIZED SUBGRADE COMPACTED TO 95% MODIFIED PROCTOR MAX. DRY DENSITY PER ASTM D1557, MIN. FBV 50.

 STANDARD DUTY ASPHALT PAVING

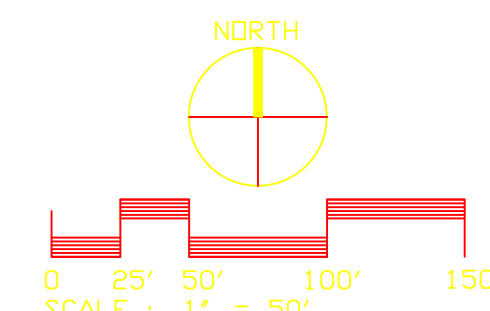
  1. 1.25" TYPE S-3 ASPHALTIC CONCRETE (1500 LB. MIN. MARSHALL STABILITY) WITH RC-70 PRIME COAT
  2. 6" LIMEROCK OR CEMENTED COQUINA BASE COMPACTED TO 95% MODIFIED PROCTOR MAX. DRY DENSITY PER ASTM D1557, MIN. FBV 100
  3. 6" STABILIZED SUBGRADE COMPACTED TO 95% MODIFIED PROCTOR MAX. DRY DENSITY PER ASTM D1557, MIN. FBV 50.

 CONCRETE SIDEWALK

 CURB AND GUTTER

 24" STOP BAR AND 24" "STOP" SIGN

- ① R1-1 24" STOP SIGN
- ② R6-2 18"x24" ONE WAY SIGN
- ③ R5-1 30"x30" DO NOT ENTER SIGN
- ④ R3-2 24"x24" NO LEFT TURN SIGN

Office of  
Facilities  
Management

Department of  
Veterans Affairs

5  
FINAL SUBMITTAL

F:\CIVIL\PROJECTS\15\_442\CADD\_DWG\C101-960.DWG 7-29-98 9:27:57 a.m. EST