


three inches = one foot  
 one and one half inches = one foot  
 one inch = one foot  
 three quarters inch = one foot  
 one half inch = one foot  
 one quarter inch = one foot  
 one eighth inch = one foot  
 one eighth inch = one foot

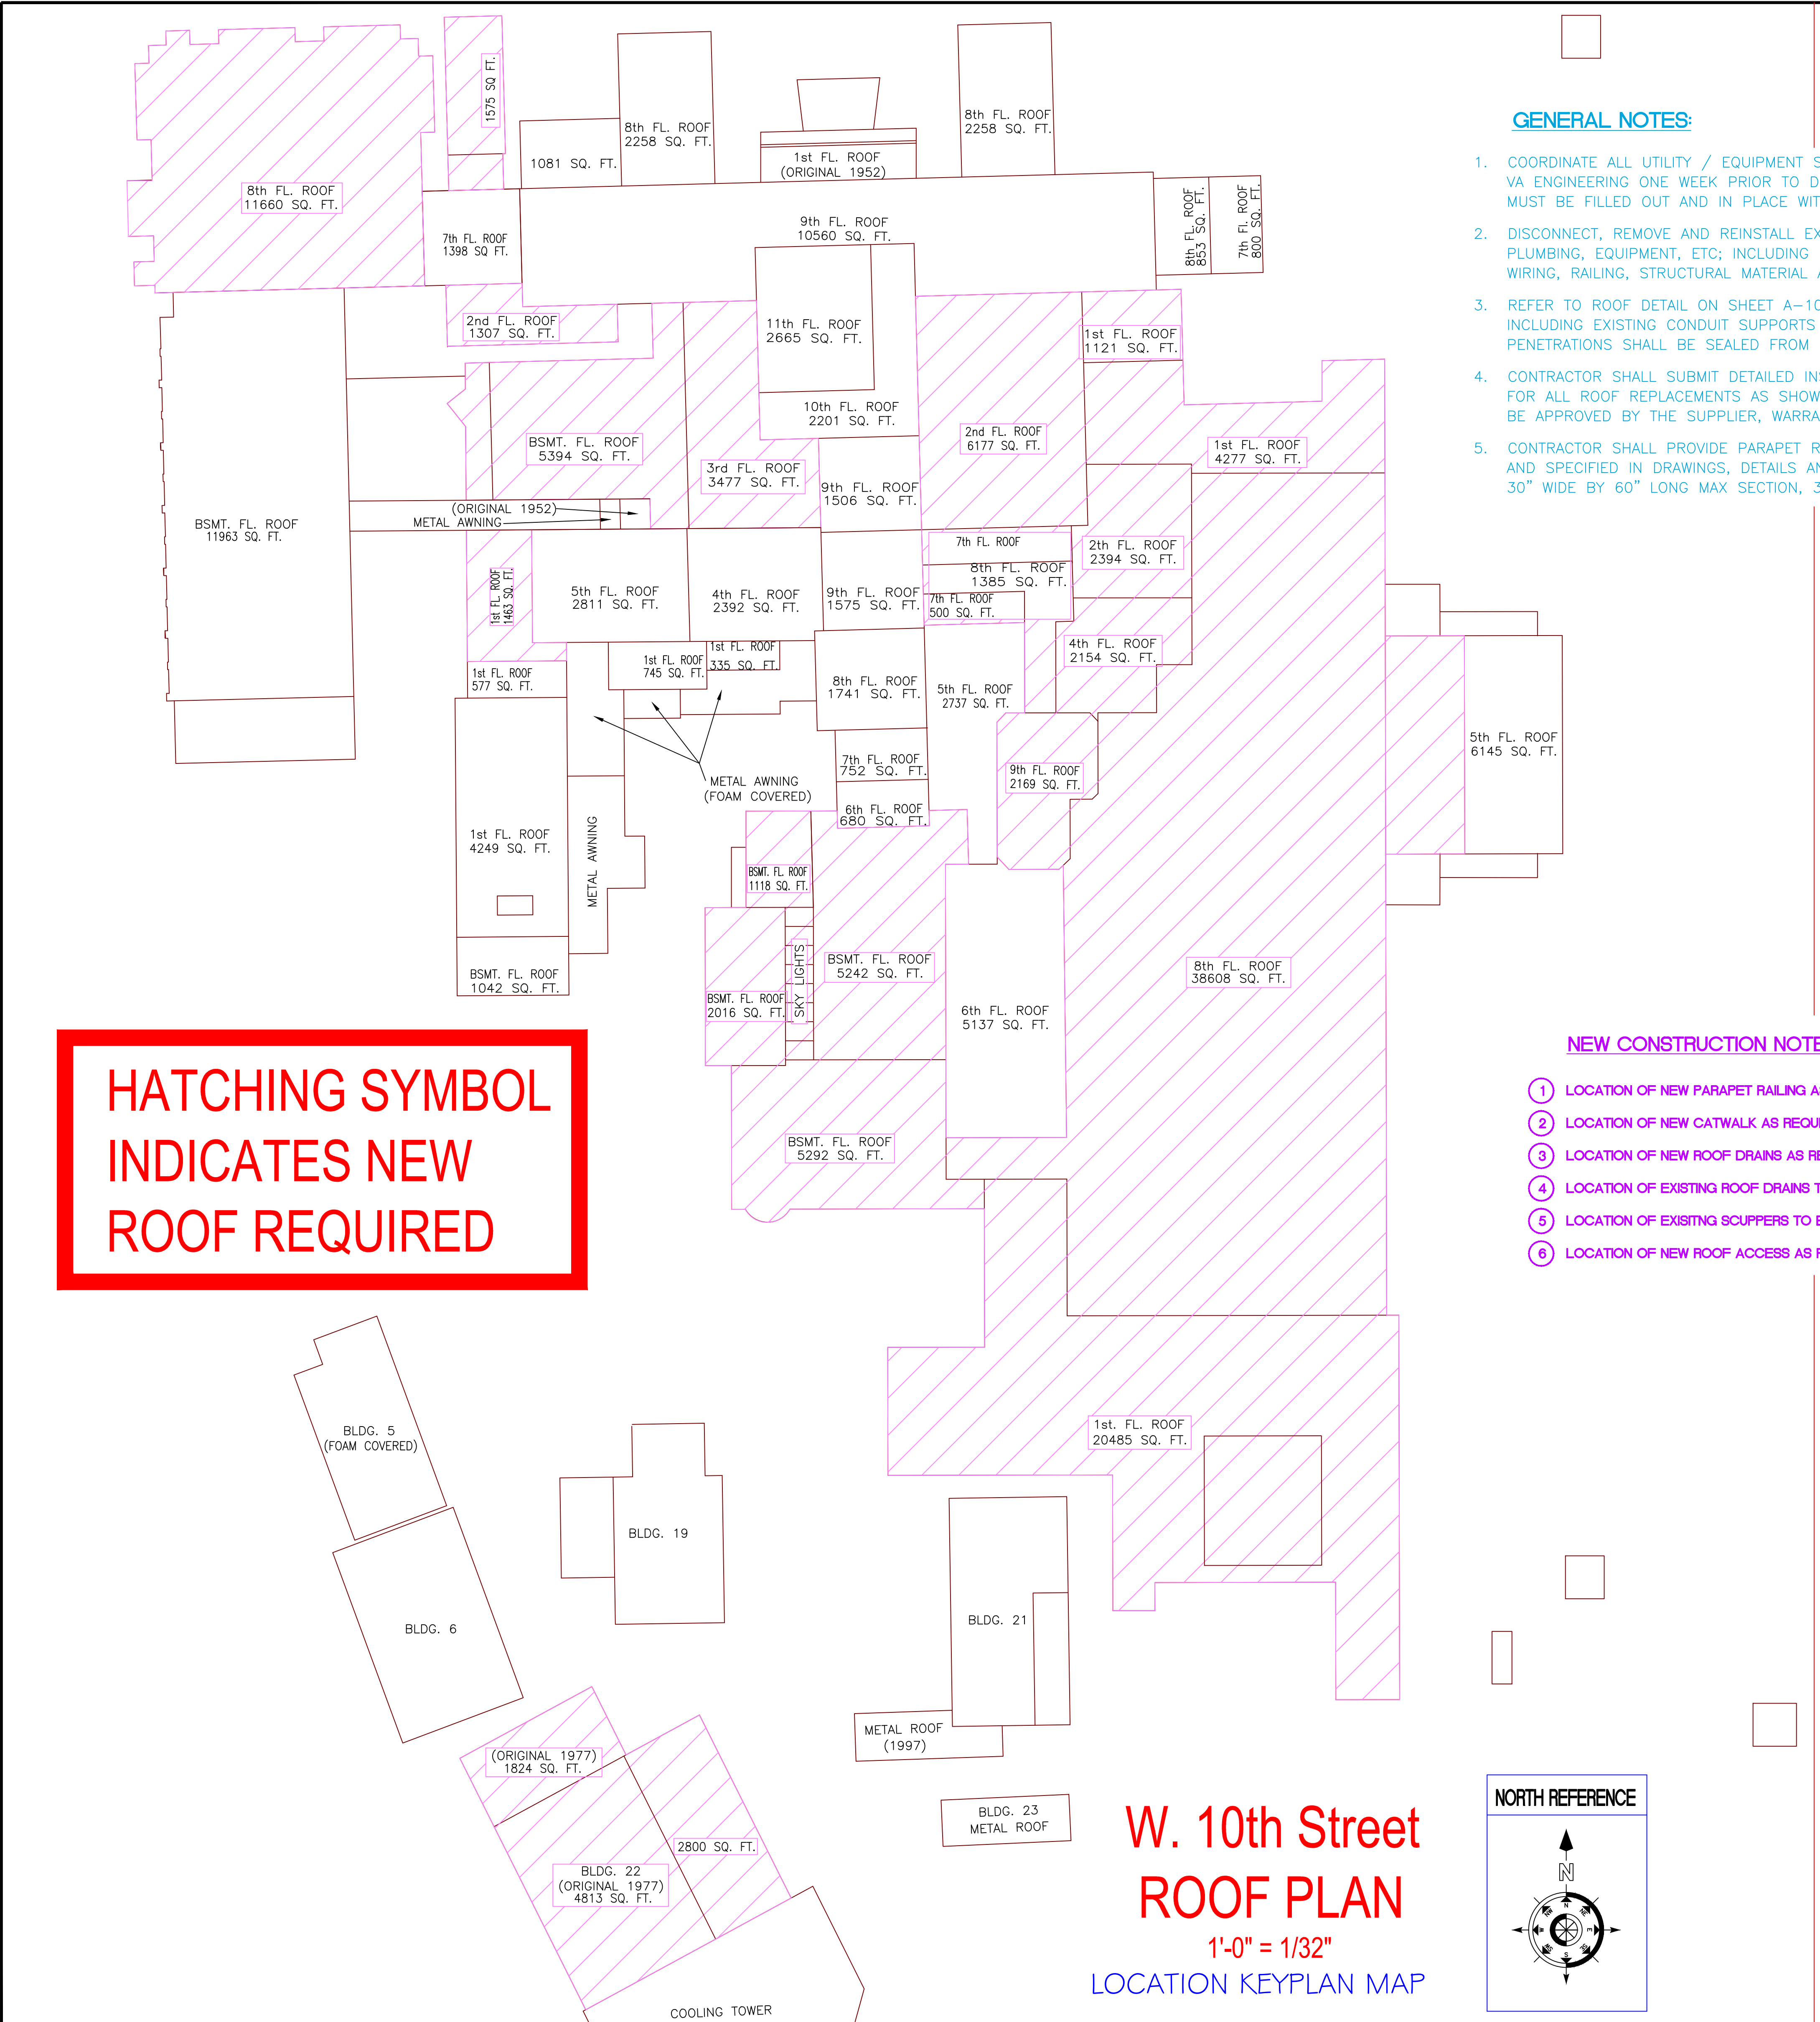

**HATCHING SYMBOL INDICATES NEW ROOF REQUIRED**

**HATCHING SYMBOL INDICATES NEW ROOF REQUIRED**

**SOLID DOTS INDICATES ROOF DRAINS**

**GENERAL NOTES:**



- COORDINATE ALL UTILITY / EQUIPMENT SHUTDOWNS WITH COR AND VA ENGINEERING ONE WEEK PRIOR TO DISCONNECTION. FORMS MUST BE FILLED OUT AND IN PLACE WITH VA ENGINEERING.
- DISCONNECT, REMOVE AND REINSTALL EXISTING ELECTRICAL, HVAC, PLUMBING, EQUIPMENT, ETC; INCLUDING BUT NOT LIMITED TO CONDUITS, WIRING, RAILING, STRUCTURAL MATERIAL AND LIGHTING PROTECTION.
- REFER TO ROOF DETAIL ON SHEET A-103 FOR ADDITIONAL INFORMATION; INCLUDING EXISTING CONDUIT SUPPORTS AND PENETRATIONS. ALL ROOF PENETRATIONS SHALL BE SEALED FROM PEST / INSECT / WATER.
- CONTRACTOR SHALL SUBMIT DETAILED INSTALLATION DRAWINGS AND AS-BUILT FOR ALL ROOF REPLACEMENTS AS SHOWN AND SPECIFIED. DRAWINGS SHALL BE APPROVED BY THE SUPPLIER, WARRANTY UNDERWRITER AND CONTRACTOR.
- CONTRACTOR SHALL PROVIDE PARAPET RAILING, CATWALKS, & WALKWAYS AS SHOWN, AND SPECIFIED IN DRAWINGS, DETAILS AND PHOTOS. WALKWAYS SHALL BE 30" WIDE BY 60" LONG MAX SECTION, 3mm THICK, INSTALLED PER MANUF. SPEC.

**GENERAL DEMOLITION NOTES:**

- HATCHED AREA INDICATES PROJECT AREA (ROOF SYSTEM TO BE REMOVED AND REPLACED) WITH NEW R40 ROOF FOAM SYSTEM. ALL MATERIALS TO BE REMOVED BY CONTRACTOR FROM SITE. REFER TO DETAIL ON SHEET A-103 FOR EXISTING ROOF SYSTEM.
- ONLY REMOVE PORTIONS OF ROOF AREA SUCH THAT NEW ROOF CAN BE REINSTALLED BY THE END OF THE DAY. WORK AFTER HOURS WILL NEED TO BE APPROVED BY COR AND COORDINATED WITH VA POLICE AND VA CHILLER PLANT OPERATORS.
- SEAL ALL WALL MASONRY WHICH ARE PERPENDICULAR TO ROOF (TO AVOID PEST/INSECT/WATER FROM PENETRATING DOWN THE WALL. IF APPLICABLE, WHEN ROOF IS DEMOLISHED, CONCRETE DECK SHALL BE SEAL COATED AND EPOXY COATED TO SEAL ALL CRACKS IN DECK.
- REMOVE AND REINSTALL NEW ROOF DRAINS IN PROJECT HATCHED AREA. REPLACEMENT OF DRAINS SHALL BE COORDINATED WITH COR AND VA ENGINEERING, TO ACCESS FLOOR BELOW DIRECTLY BELOW WHICH DRAIN ENTERS IN THE HOSPITAL.
- SCUPPERS SHALL BE REPLACED WITH NEW SCUPPERS PER DETAIL AND SPECIFICATIONS, IF APPLICABLE TO EITHER WEST 10TH STREET OR CSR SITE.

**NEW CONSTRUCTION NOTES:**

- LOCATION OF NEW PARAPET RAILING AS REQUIRED. COORDINATE EXACT LOCATION.
- LOCATION OF NEW CATWALK AS REQUIRED. COORDINATE EXACT LOCATION.
- LOCATION OF NEW ROOF DRAINS AS REQUIRED.
- LOCATION OF EXISTING ROOF DRAINS TO BE REPLACED WITH NEW.
- LOCATION OF EXISTING SCUPPERS TO BE REPLACED WITH NEW.
- LOCATION OF NEW ROOF ACCESS AS REQUIRED.

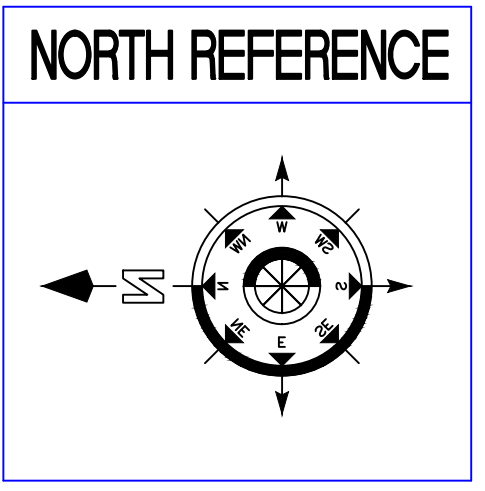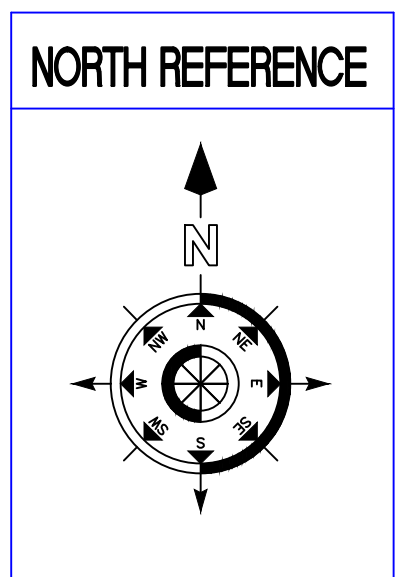

**W. 10th Street ROOF PLAN**  
 1'-0" = 1/32"  
 LOCATION KEYPLAN MAP

**CSR ROOF PLAN**  
 1'-0" = 1/32"  
 LOCATION KEYPLAN MAP

Revisions:	Date

<b>PLOT DATE:</b> PLOT DATE: 10-01-2012 CAD DRAWING FILE LOCATION:	<b>PROFESSIONAL CONSULTANTS:</b> N/A	<b>PROJECT ENGINEERS:</b> PEDRO P. MARISTELA	<b>DRAWN BY:</b> G. MOORE	<b>ROOF PLAN -1 SHEET</b> REPLACE ROOF - BUILDING 1, 22, CSR 7, 9 PROJECT PROJECT # 583-12-112	SHEET 2 OF 6 DRAWING NO. A-102
--	---	---	------------------------------	--	--------------------------------------

