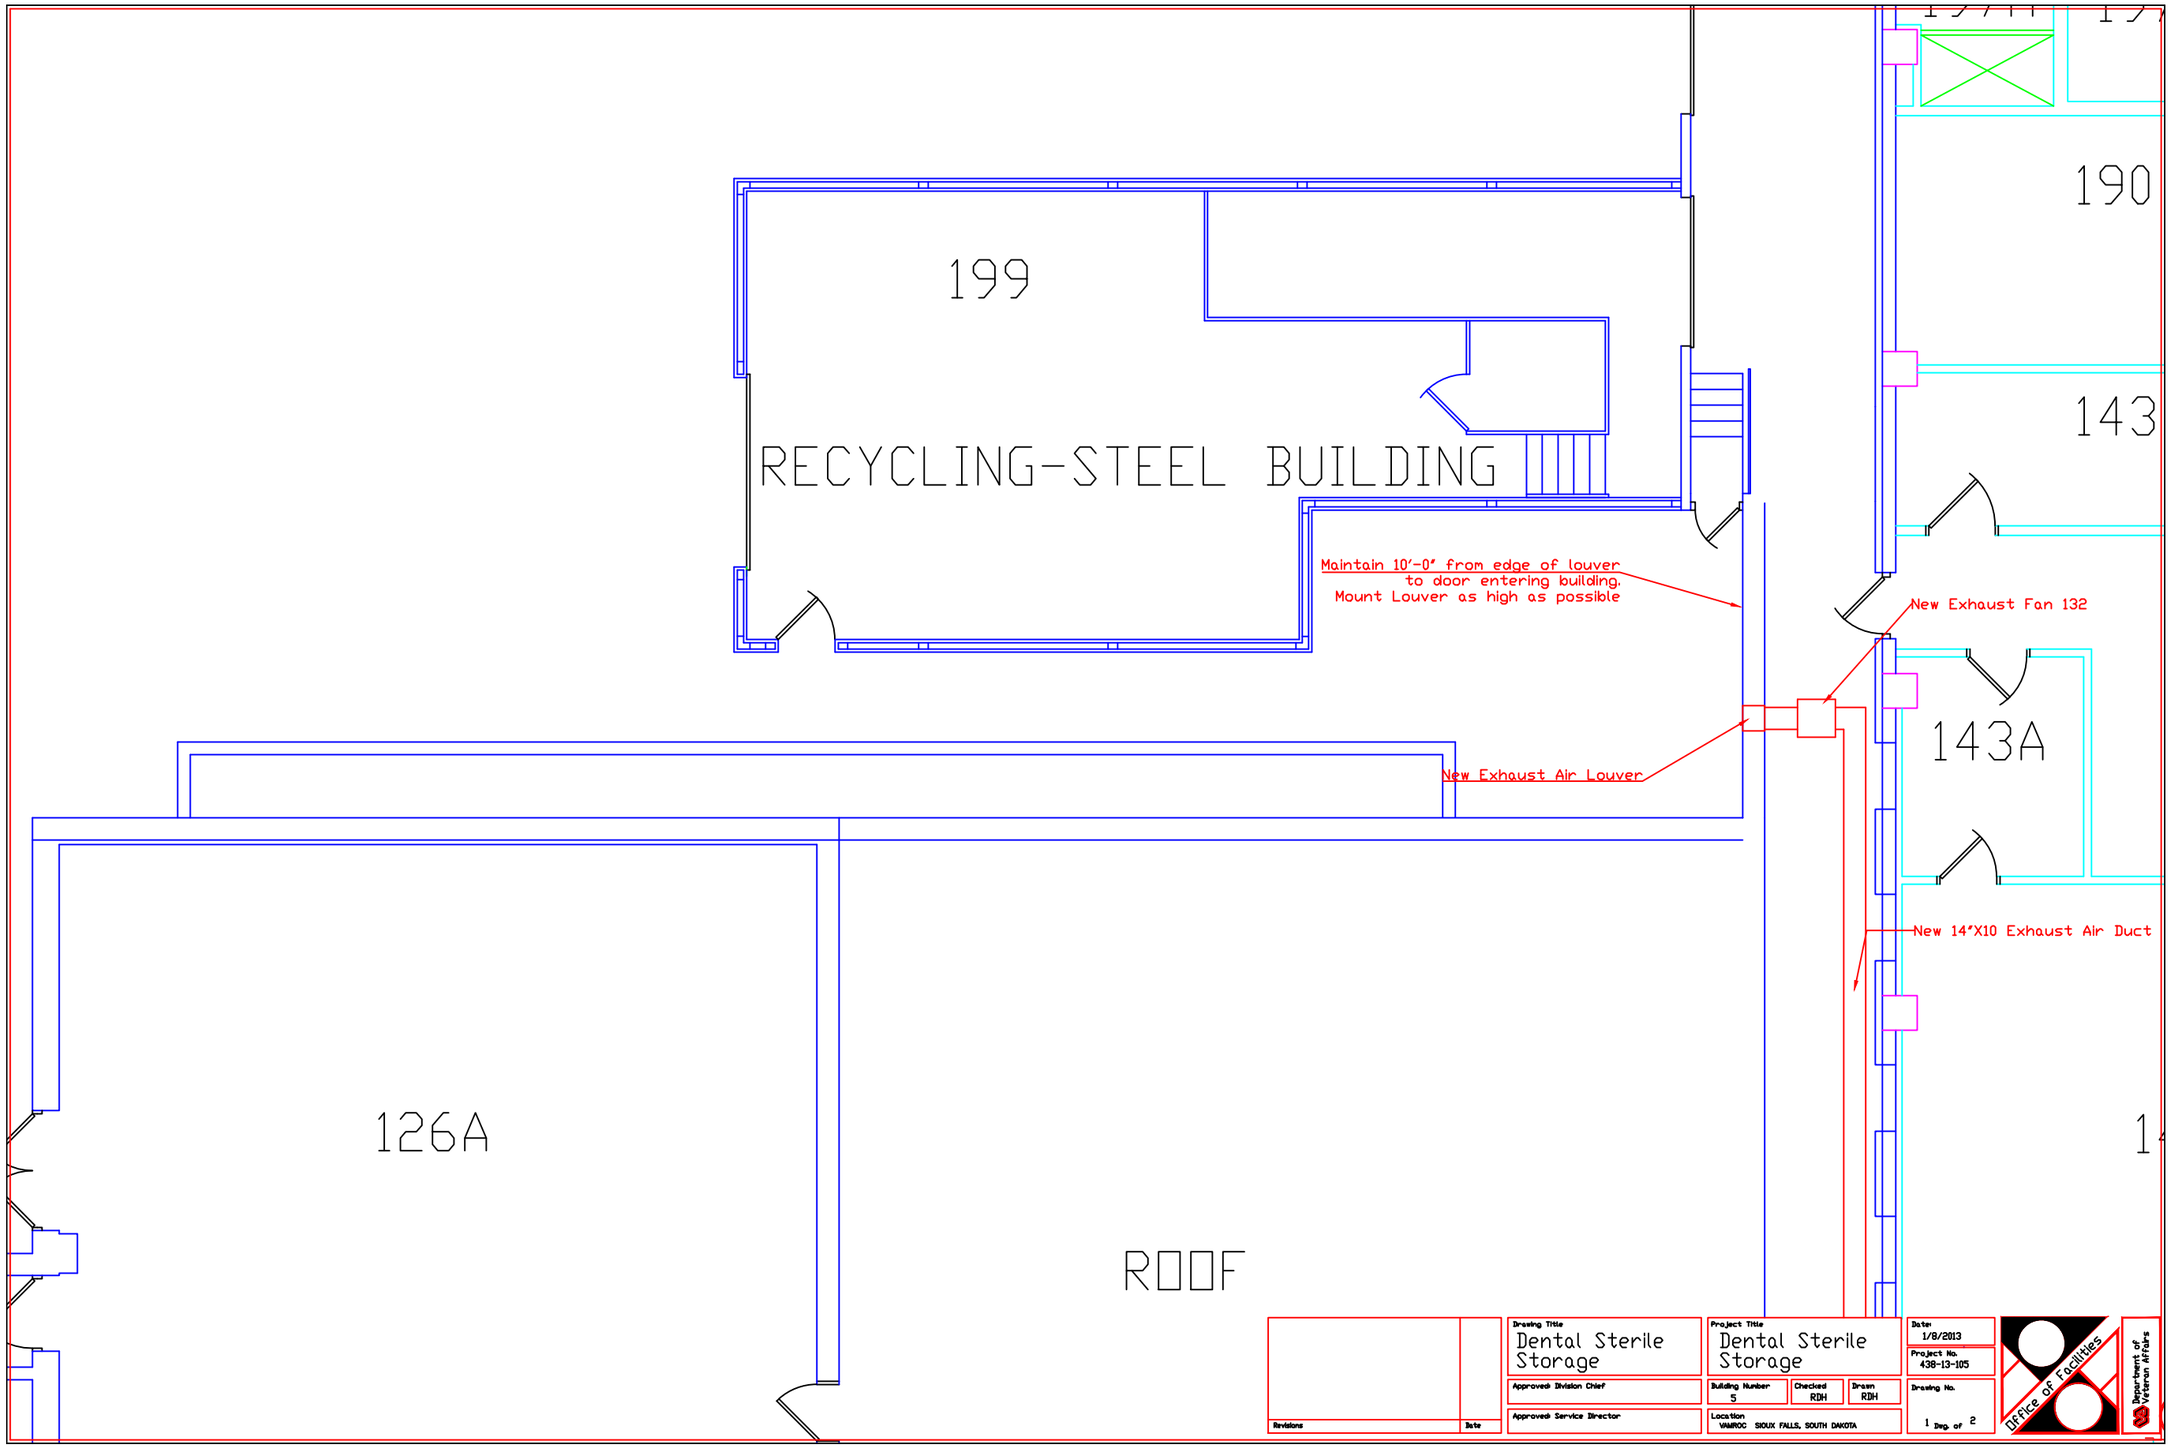
199
RECYCLING-STEEL BUILDING
190
143
143A
126A
ROOF
Maintain 10'-0" from edge of louver
to door entering building.
Mount Louver as high as possible
New Exhaust Fan 132
New Exhaust Air Louver
New 14"X10 Exhaust Air Duct
Revisions
Date
Drawing Title
Dental Sterile Storage
Approved: Division Chief
Approved: Service Director
Project Title
Dental Sterile Storage
Building Number
5
Checked
RDH
Drawn
RDH
Location:
VAMROC SIOUX FALLS, SOUTH DAKOTA
Date:
1/8/2013
Project No.
438-13-105
Drawing No.
1 Dwg. of 2
Office of Facilities
Department of Veterans Affairs