



- GENERAL NOTES
1. REFER TO 1-E7 FOR ELECTRICAL NOTES AND SCHEDULES.
- KEYNOTES
1. EXISTING FLUSH MOUNTED PANEL TO BE REPLACED IN SAME LOCATION UTILIZING SAME BACKBOX. PROVIDE NEW PANEL INTERIOR AND COVER CUSTOM SIZED TO FIT IN EXISTING FLUSH BACKBOX. PROVIDE ALL NEW BRANCH BREAKERS IN QUANTITIES AND SIZES TO MATCH EXISTING. DISCONNECT ALL EXISTING CIRCUITS AND RECONNECT TO NEW BREAKERS ALL DOWNTIME AND SWITCHOVERS TO BE COMPLETED ON OFF HOURS WITH LIMITED AND COORDINATED OUTAGES. OUTAGES IN AFTER HOURS SHALL NOT EXCEED 8 HOURS PER SCHEDULED OUTAGE.


2. EXTEND FIRE PROTECTION INTO NEW ELECTRICAL CLOSET SPACE TO BE ORDINARY, GROUP 1 HAZARD WITH UPRIGHT QUICK RESPONSE HEADS. E.C. TO ENGAGE A PROFESSIONAL FIRE SUPPRESSION COMPANY FOR THIS SCOPE OF WORK.

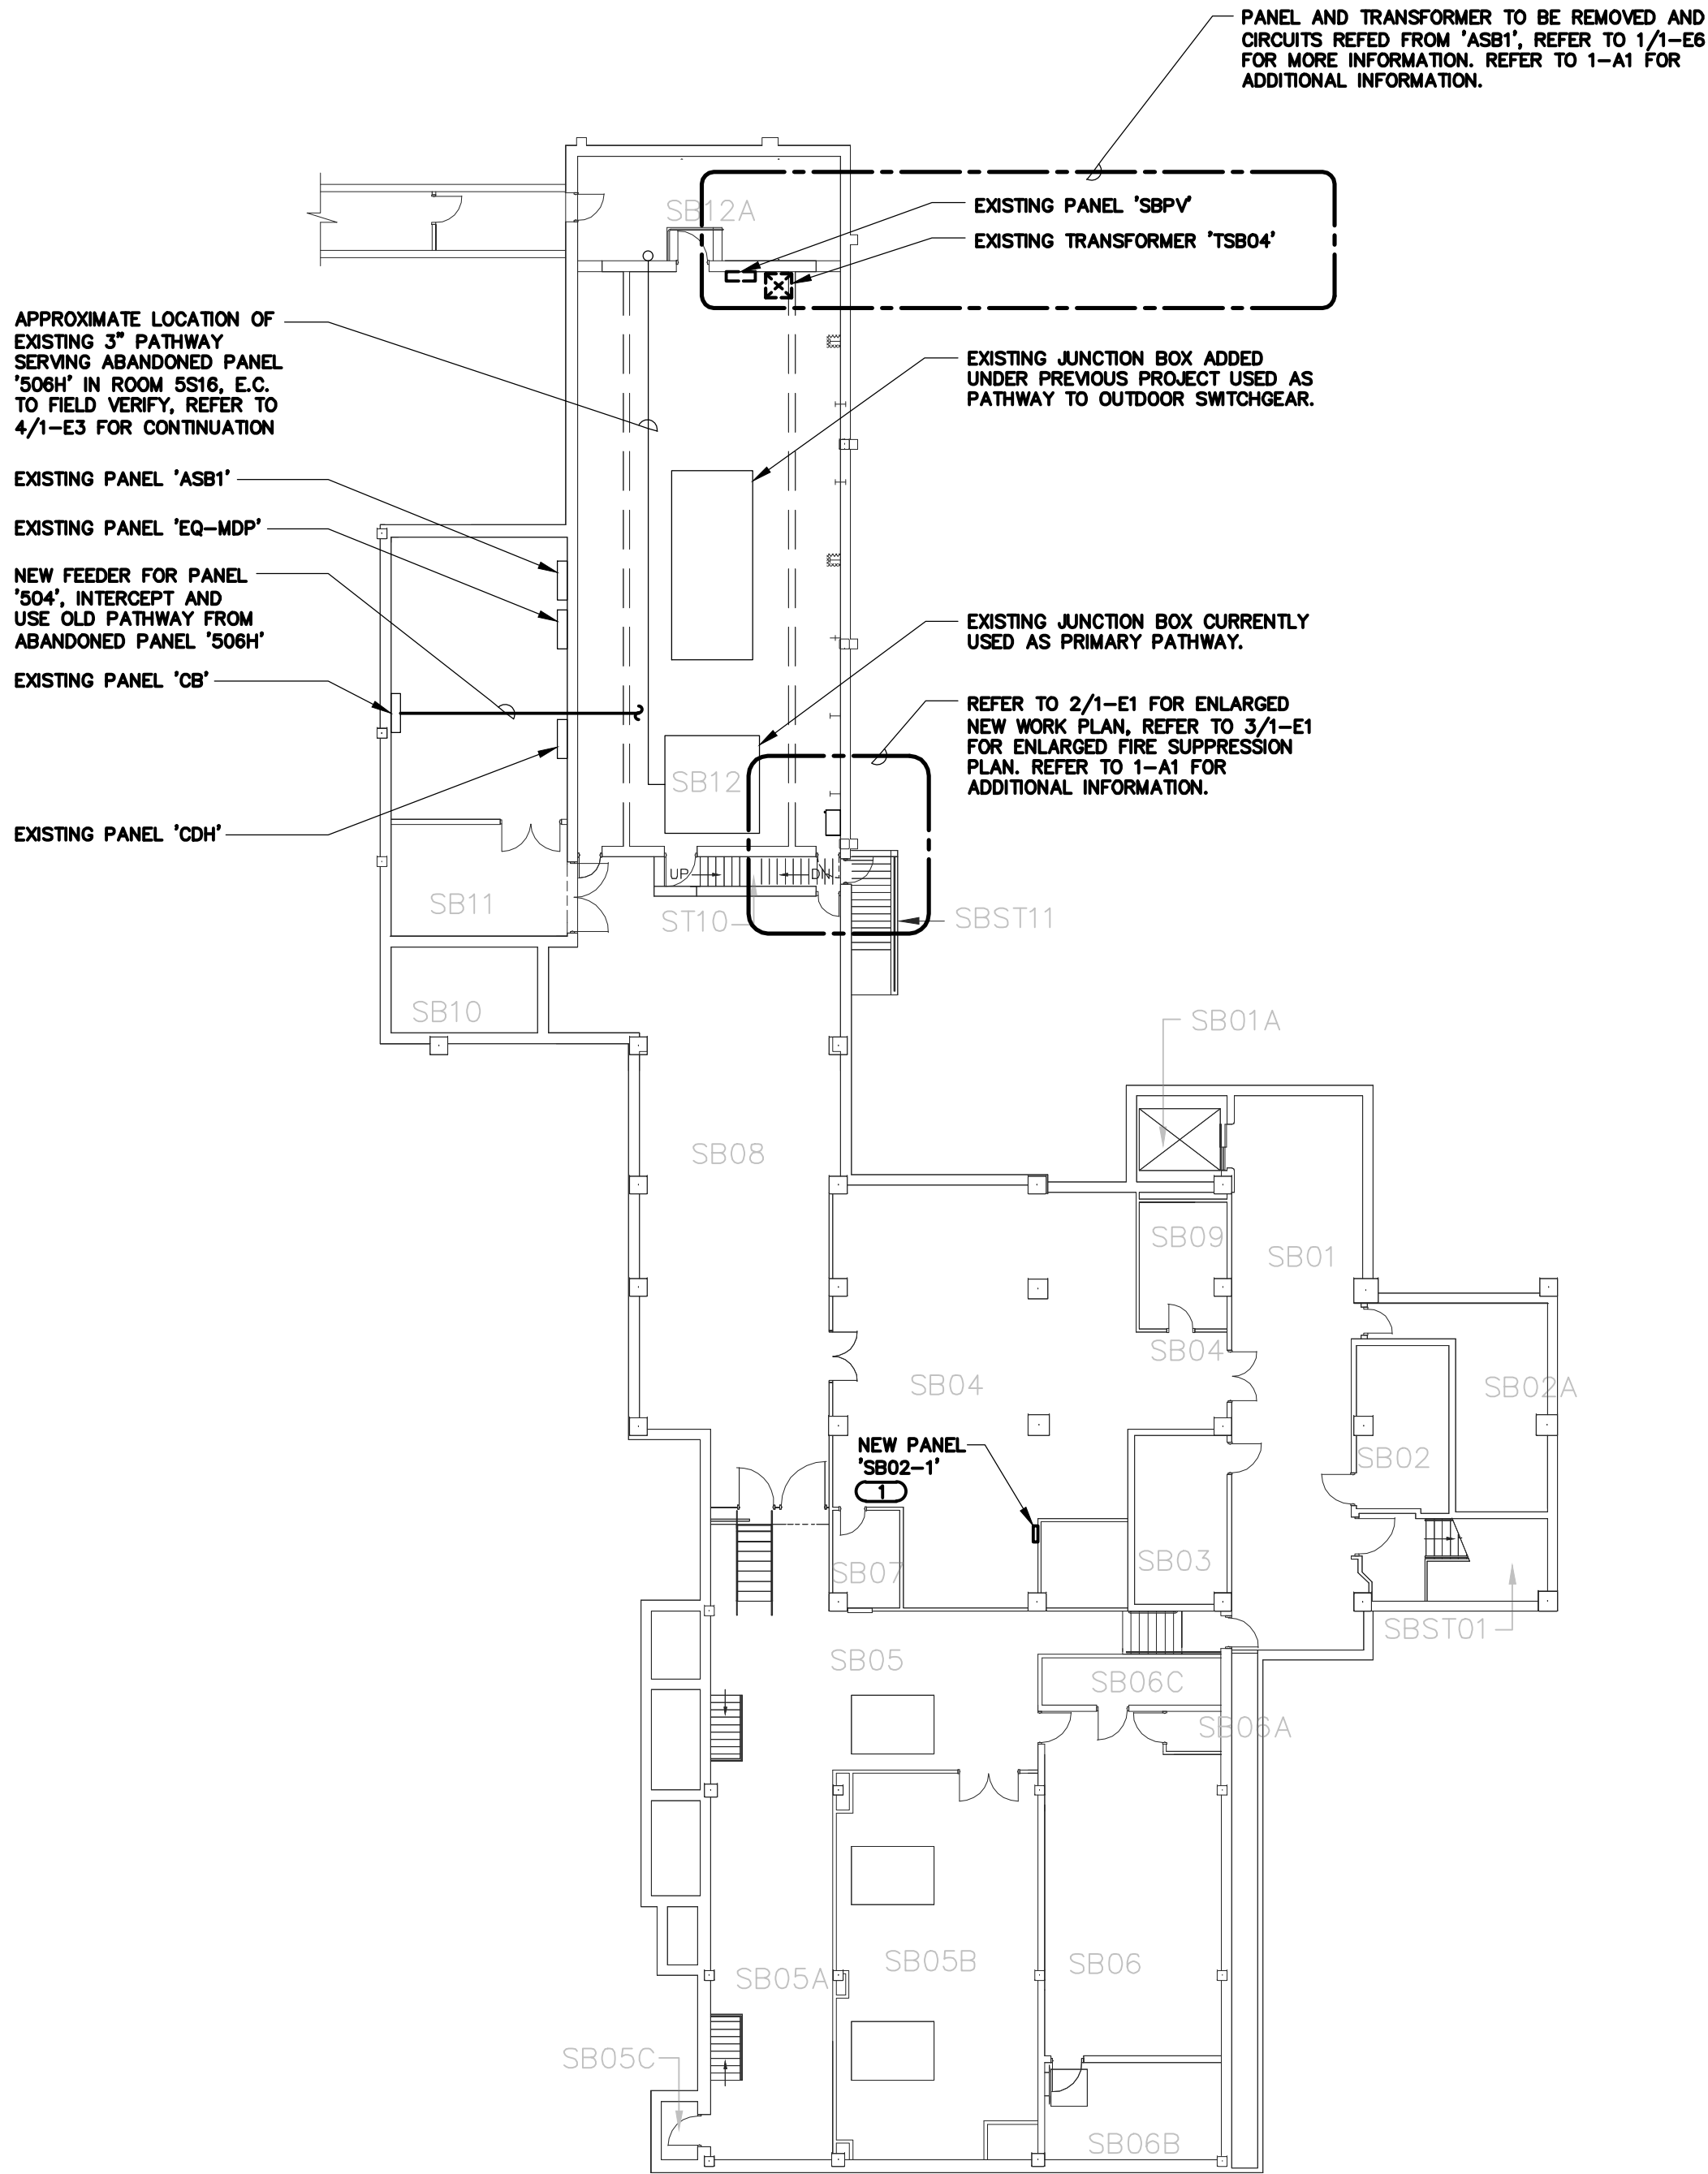

1 SUB-BASEMENT FLOOR PLAN - ELECTRICAL
SCALE: 1/16"=1'-0"

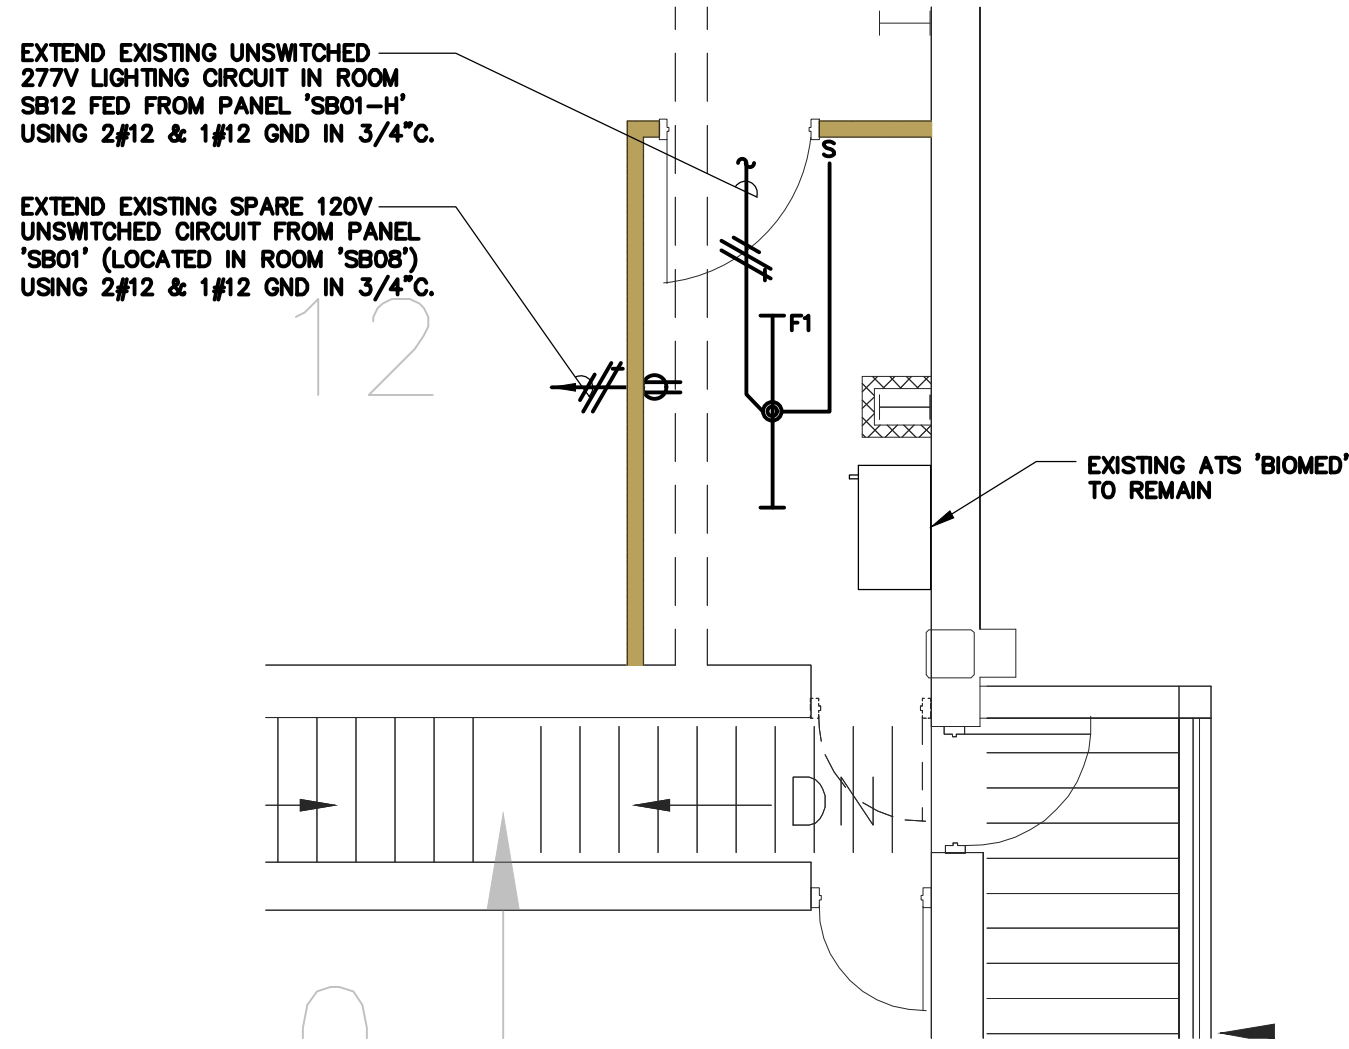

2 ENLARGED NEW WORK PLAN
SCALE: 1/4"=1'-0"

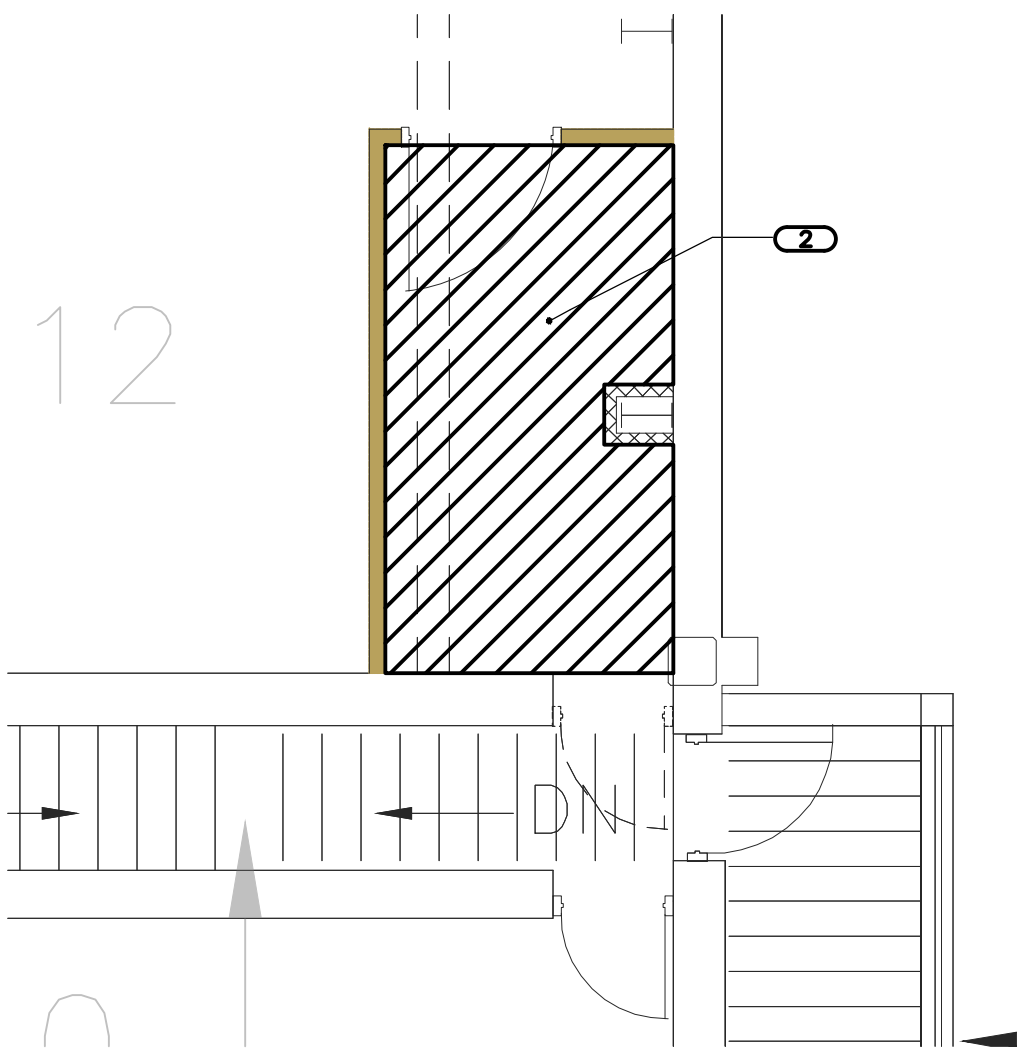

3 ENLARGED FIRE SUPPRESSION PLAN
SCALE: 1/4"=1'-0"

Revisions	Date	Approved Supervisor Facility Manager	Stamp	Key Plan	Architect/Engineer	Drawing Title	Project Title	Project Number	Office of Facilities Management Department of Veterans Affairs
		Approved Associate Director Patient Care			 Calvin L. Hinz Architects, P.C. CLH 2010-18 3705 North 200th Street Omaha, Nebraska 68132 Phone: 402.391.6911 Fax: 402.391.9193	SUB-BASEMENT FLOOR PLAN - ELECTRICAL	ELECTRICAL PANELS, FEEDERS, SWITCH UPGRADES	636A8-12-009	
		Approved Associate Director				Approved Project Director	IOWA CITY, IOWA	Building Number 1	
		Approved Chief of Staff					Location	Drawing Number	
		Approved Director					Date 12-14-12	1-E1	
							Drawn REEWIN	Dwg. 3 of 11	
							Checked LEEVAN		
							Approved MATSNY		