




- NOTES:**
1. WIRE FENCE SHALL BE A MINIMUM OF 32 INCHES IN HEIGHT AND SHALL HAVE A MINIMUM OF 6 WIRES WITH 12" STAY SPACING.
 2. FILTER FABRIC SHALL BE A MINIMUM OF 36" IN WIDTH AND SHALL BE FASTENED ADEQUATELY TO THE WIRE WITH #9 WIRE STAPLES 1-1/2" LONG. FABRIC THAT DETERIORATES TO SUCH EXTENT THAT IT'S EFFECTIVENESS IS REDUCED SHALL BE REPLACED BY CONTRACTOR AT CONTRACTOR'S EXPENSE.
 3. STEEL POSTS SHALL BE A MIN. OF 5' HEIGHT AND SHALL BE THE SELF FASTENER ANGLE STEEL TYPE.
 4. WOOD POSTS SHALL BE A MIN. OF 6' IN HEIGHT AND 3" OR MORE IN DIAMETER. WIRE FABRIC SHALL BE FASTENED TO WOODEN POST WITH NOT LESS THAN #9 WIRE STAPLES 1-1/2 INCHES LONG.
 5. CONTRACTOR SHALL REVIEW SILT FENCE WEEKLY AND AFTER EACH RAINFALL OCCURRENCE. ANY NECESSARY REPAIRS OR CLEAN-UP TO MAINTAIN THE EFFECTIVENESS OF THE DEVICE SHALL BE MADE IMMEDIATELY.
 6. TEMPORARY MEASURE SHALL BE REMOVED BY THE CONTRACTOR ONCE STABILIZATION OR SUFFICIENT GROUND COVER IS ACHIEVED AS DIRECTED BY THE COTR.

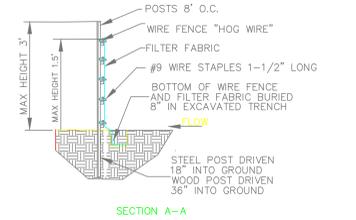


SILT FENCE
SCALE 1/8" = 1'-0"
C-101

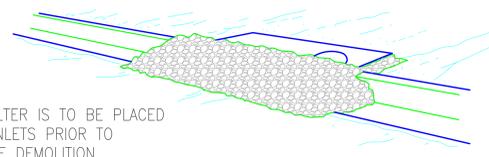

AGGREGATE FILTER IS TO BE PLACED AT EXISTING INLETS PRIOR TO BEGINNING SITE DEMOLITION.

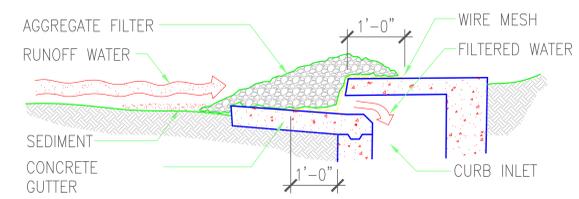


GRAVEL INLET PROTECTION
NTS 2/8" = 1'-0"
C-101

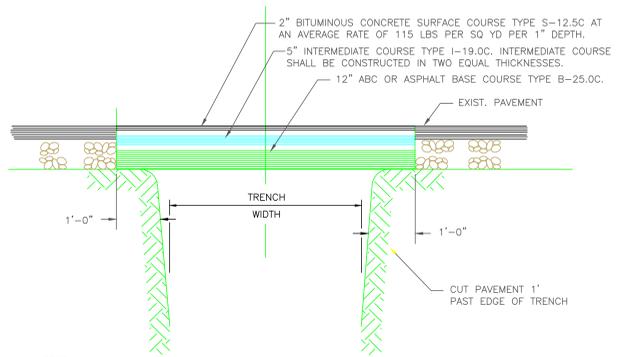



- NOTES:**
1. PAVEMENT REPLACEMENT PER NORTH CAROLINA DOT STD. SPECS.
 2. EXISTING ASPHALT SHALL BE REMOVED FOR A DISTANCE OF 1 FOOT TO BOTH SIDES OF THE TRENCH OPENING.

PAVEMENT REPLACEMENT DETAIL
NTS 3/8" = 1'-0"
C-101

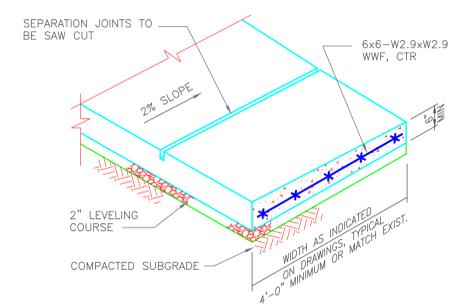


- NOTES:**
1. PROVIDE FULL DEPTH 3/8" PREMOLDED EXPANSION JOINT FILLER ALL AROUND AT ALL UTILITY POLES, METER BOXES, ETC.
 2. PLACE FULL DEPTH THRU JOINTS W/1/2"x6" PREMOLDED EJF AT POINT OF TANGENCY AND AT MIN 25' INTERVALS.


CONCRETE SIDEWALK
NOT TO SCALE 8/8" = 1'-0"
C-101

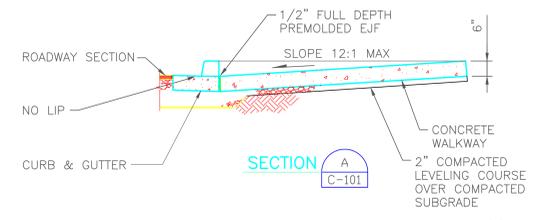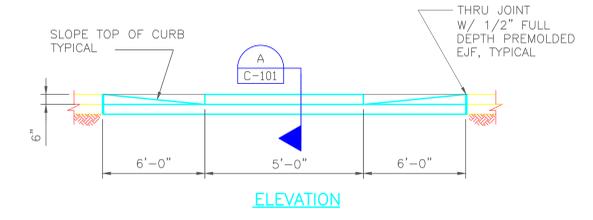

WHEELCHAIR RAMP
NTS 9/8" = 1'-0"
C-101

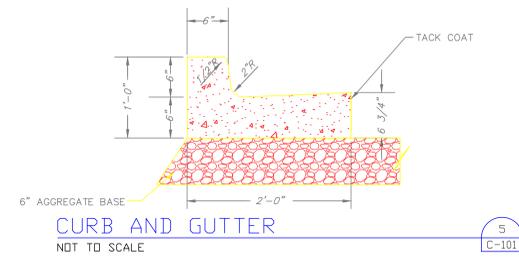


CURB AND GUTTER
NOT TO SCALE 5/8" = 1'-0"
C-101

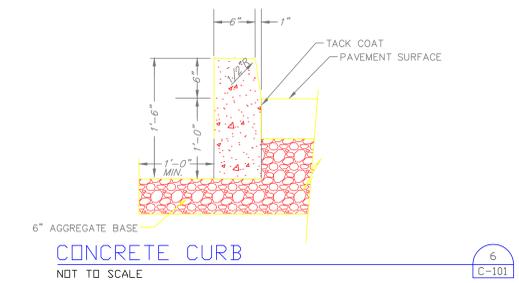

CONCRETE CURB
NOT TO SCALE 6/8" = 1'-0"
C-101

APPROXIMATELY 50 LINEAR FEET OF CURBING TO BE REPLACE BETWEEN BLDG 2 & BLDG 3 IN ADDITION TO OTHER AREAS THAT ARE REQUIRED DUE TO INSTALLATION OF NEW DOMESTIC WATER LINES

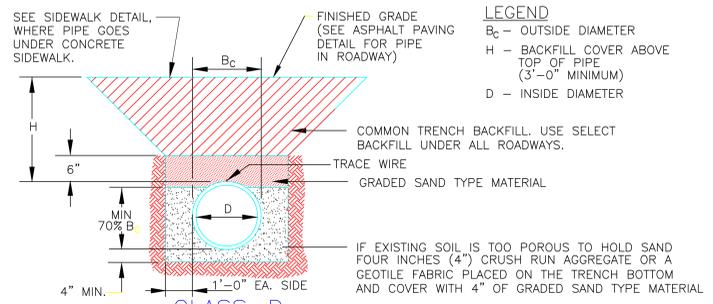

CLASS-D PIPE BEDDING DETAIL
NTS 7/8" = 1'-0"
C-101

Revision	Date

RECOMMEND APPROVAL			
REQUESTER	Date		
CHIEF OF SERVICE	Date	CHIEF OF STAFF	Date
ASSOC. DIR. PATIENT CARE SVC.	Date	ASSOC. DIR. for OPERATIONS	Date
APPROVAL BY:	Date		
MEDICAL CENTER DIRECTOR			

Drawing Title	STANDARD DETAILS
Project Title	BOILER PLANT MODIFICATIONS
Approved: Safety Manager/M&O Supervisor	
Approved: Chief of Facilities Management Svr.	

Date	15 JAN 2013
Project No.	659-13-210
Building Number	BUILDING #18
Checked	
Drawn	BLF
Location	W.G.(Bill) Hefner Medical Center 1601 Brenner Ave. Salisbury, NC 28144

DRAWING NO.	C-101
DWG.	9 OF 10



Department of Veterans Affairs