
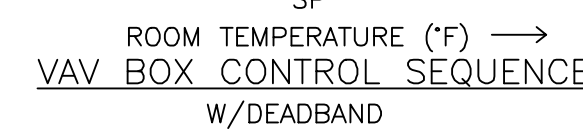




one eighth inch = one foot



F




- A. SET POINTS SHALL BE SET AS FOLLOWS:  
 COOLING 75°F (ADJ)  
 HEATING 70°F (ADJ)
- B. DEAD BAND BETWEEN HEATING AND COOLING SET POINTS WILL BE MAINTAINED.
- C. UPON FALL IN SPACE TEMPERATURE THE VAP DAMPER WILL MODULATE TO MINIMUM POSITION.
- D. UPON FURTHER DROP IN SPACE TEMPERATURE VAP - I WILL MODULATE TO MAXIMUM SET POINT.
- E. THE ADJUSTABLE TOLERANCE OF  $\pm .5^\circ\text{F}$  HAS BEEN SELECTED TO PREVENT VAP HURDLES.
- F. THE REVERSE SHALL OCCUR ON THE RISE IN SPACE TEMPERATURE.
- G. WHEN IN HEATING MODE, THE SUPPLY AIR DAMPER SENSING SHALL MODULATE THE HOT WATER VALVE SO THAT THE DISCHARGE AIR TEMPERATURE IS COMPARABLE WITH THAT OF THE HOT WATER HEATING COIL SCHEDULE.

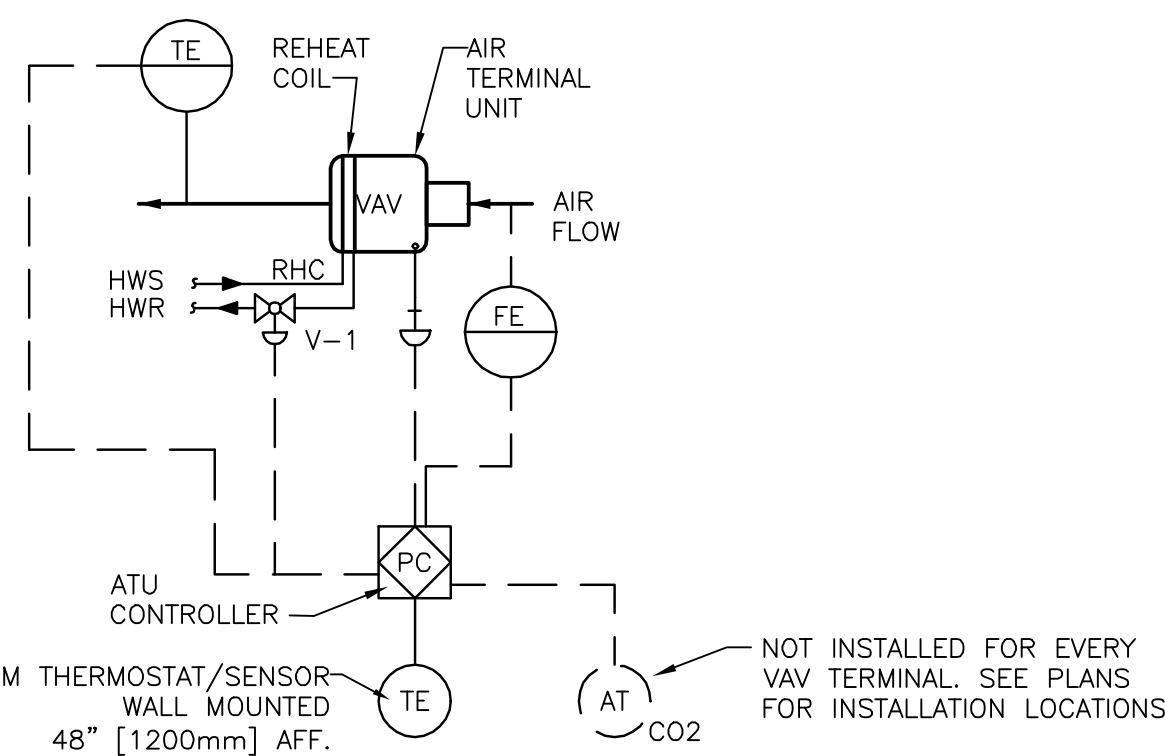

NO SUPPLEMENTAL HEATING

1 UNIT  
N.T.S.

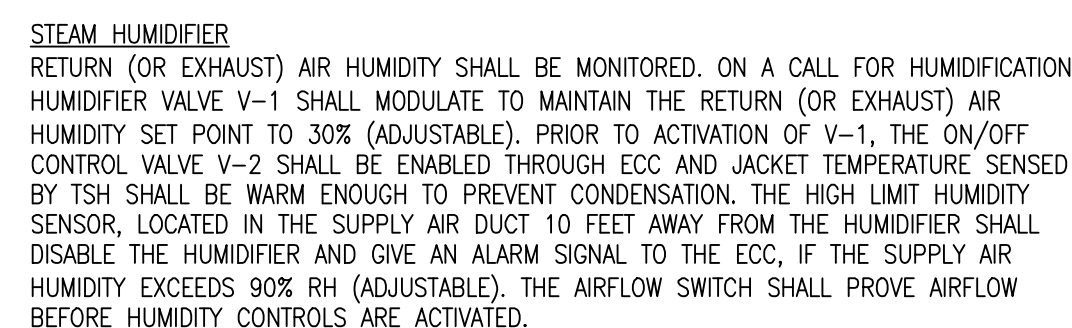

3)  $\frac{SIL}{N.T.S.}$

CONSULTANTS:

3 EXECUTIVE COURT, UNIT 4  
SOUTH BARRINGTON, IL 60010

Drawing Title

## MECHANICAL CONTROL DETAILS & SEQUENCE OF OPERATIONS

Approved Project Director

Project Title

RENOVATE ED + PRIMARY CARE

© 2006 The Authors  
Journal compilation © 2006 Blackwell Publishing Ltd

Location	SHREVEPORT VAMC 510 EAST STONER AVE
----------	--

Date	01/09/13
------	----------

Checked
RM

Drawn	SL
-------	----

Project Number

667-10-10C

Building Number  
1N, 1E

Drawing Number

Mr. [REDACTED]  
Page 75 of 75

Office of  
Construction  
and Facilities  
Management



Scale: AS NOTED