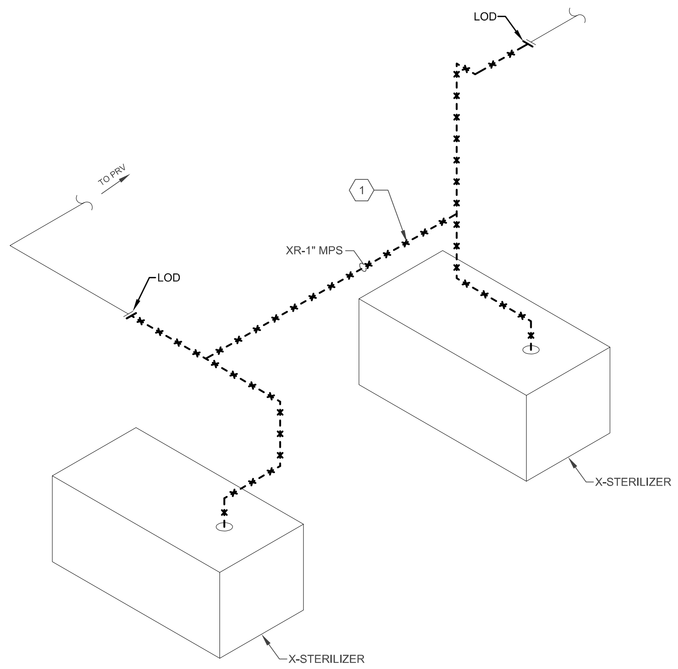

BASEMENT DETAIL 1 - DEMOLITION PLAN AREA 1 (1)
NOT TO SCALE ROOM KO5

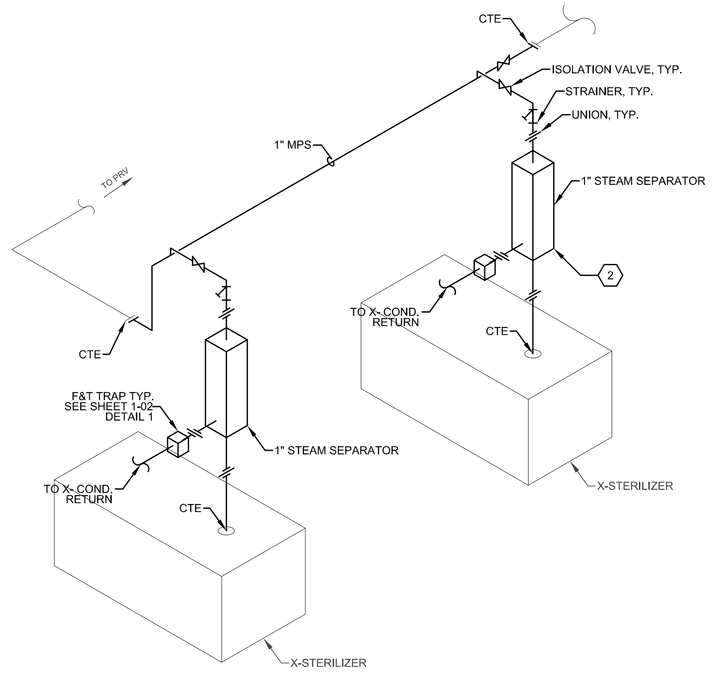

BASEMENT DETAIL 2 - NEW WORK PLAN AREA 1 (2)
NOT TO SCALE ROOM KO5

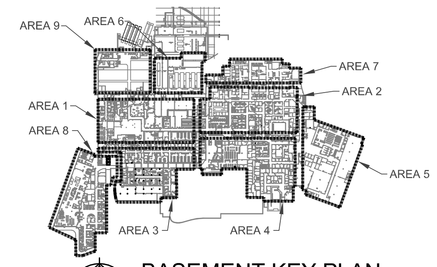

BASEMENT KEY PLAN
SCALE: N.T.S.

CODED NOTES:

1. REMOVE STEAM LINE AS SHOWN.
2. INSTALL VERTICAL STEAM SEPARATOR ASSEMBLY TO STERILIZER.
3. REMOVE CONDENSATE RETURN LINE AS INDICATED.
4. NEW CONDENSATE RETURN LINE TO BE INSTALLED UNDER EXISTING FCU.

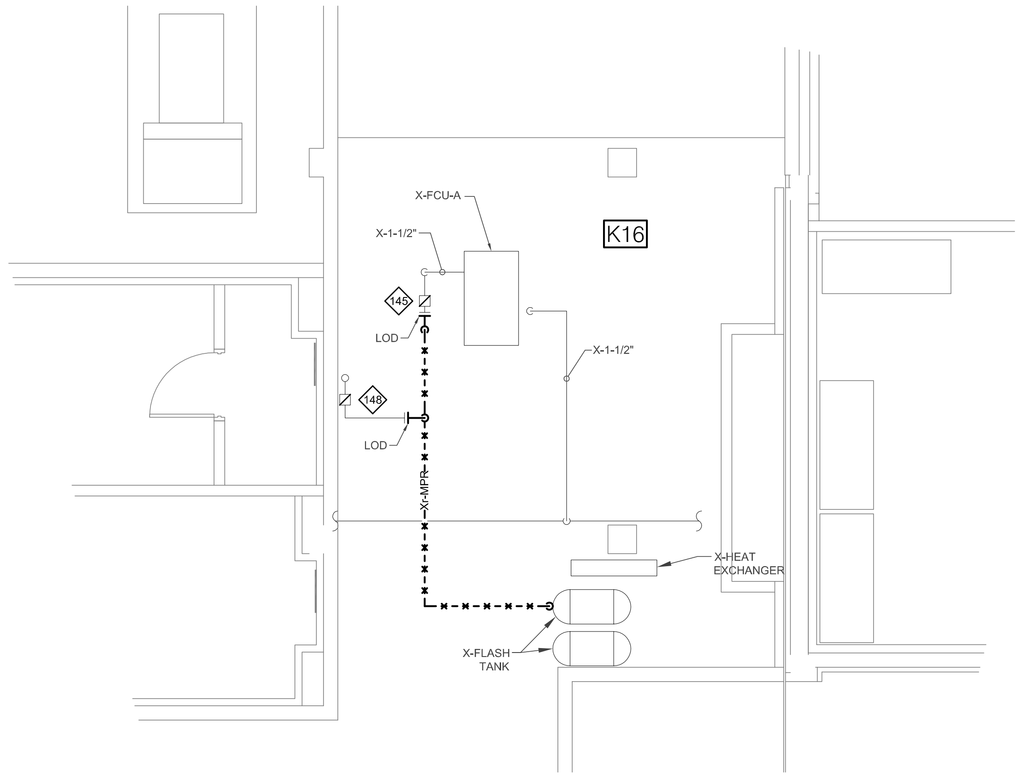

BASEMENT DETAIL 3 - DEMOLITION PLAN AREA 1 (3)
NOT TO SCALE

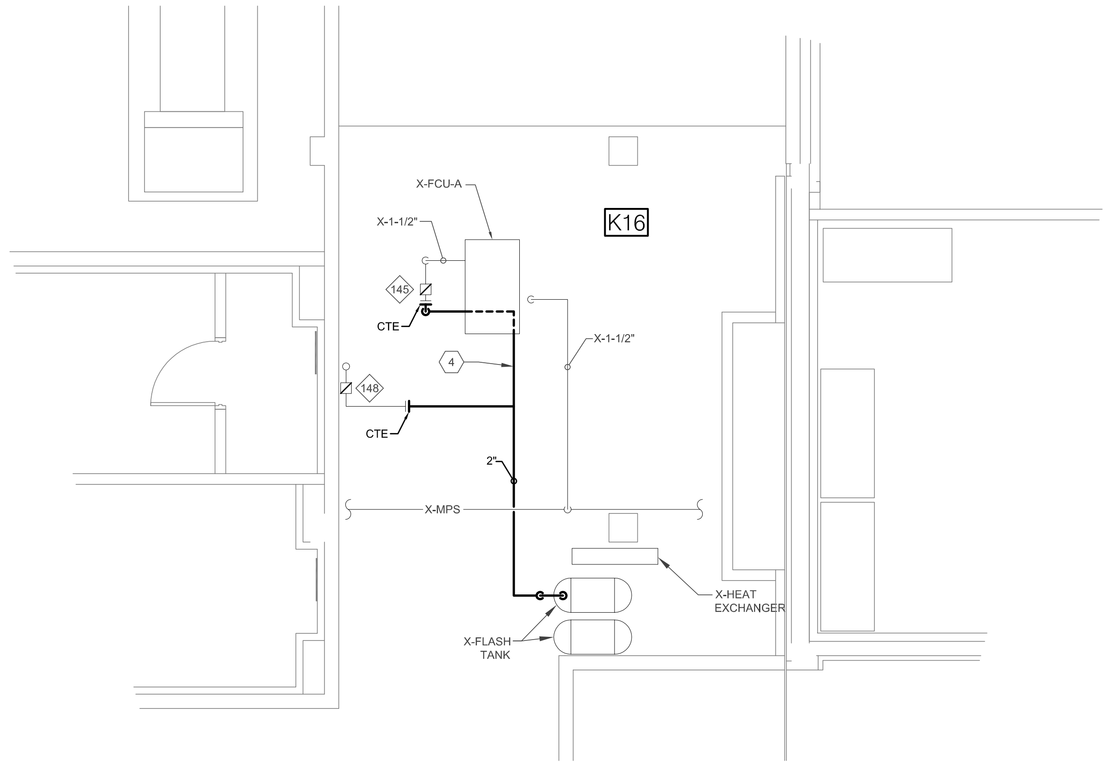

BASEMENT DETAIL 4 - NEW WORK PLAN AREA 1 (4)
NOT TO SCALE

Revisions:	Date
FINAL CD-SUBMISSION	12-21-12
95% SUBMISSION	11-30-12
65% SUBMISSION	11-16-12

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
672 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL. (440) 546-9696
FAX: (440) 546-9699

STATE OF OHIO — BRIAN M. WIDOWSKI 66625 — REGISTERED PROFESSIONAL ENGINEER

ARCHITECT:

Drawing Title: BASEMENT STEAM/CONDENSATE PIPING DETAILS

Approved: Project Director

Project Title: **STEAM TRAP MONITORING, INSULATION AND PIPING UPGRADES**

Location: **VAMC - WADE PARK**

Date: 12-21-12 | Checked: WFW | Drawn: JWF

Project Number: 541-12-115

Building Number: 1

Drawing Number: 4-01

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978