









BASEMENT DETAIL 1 - DEMOLITION PLAN AREA 1

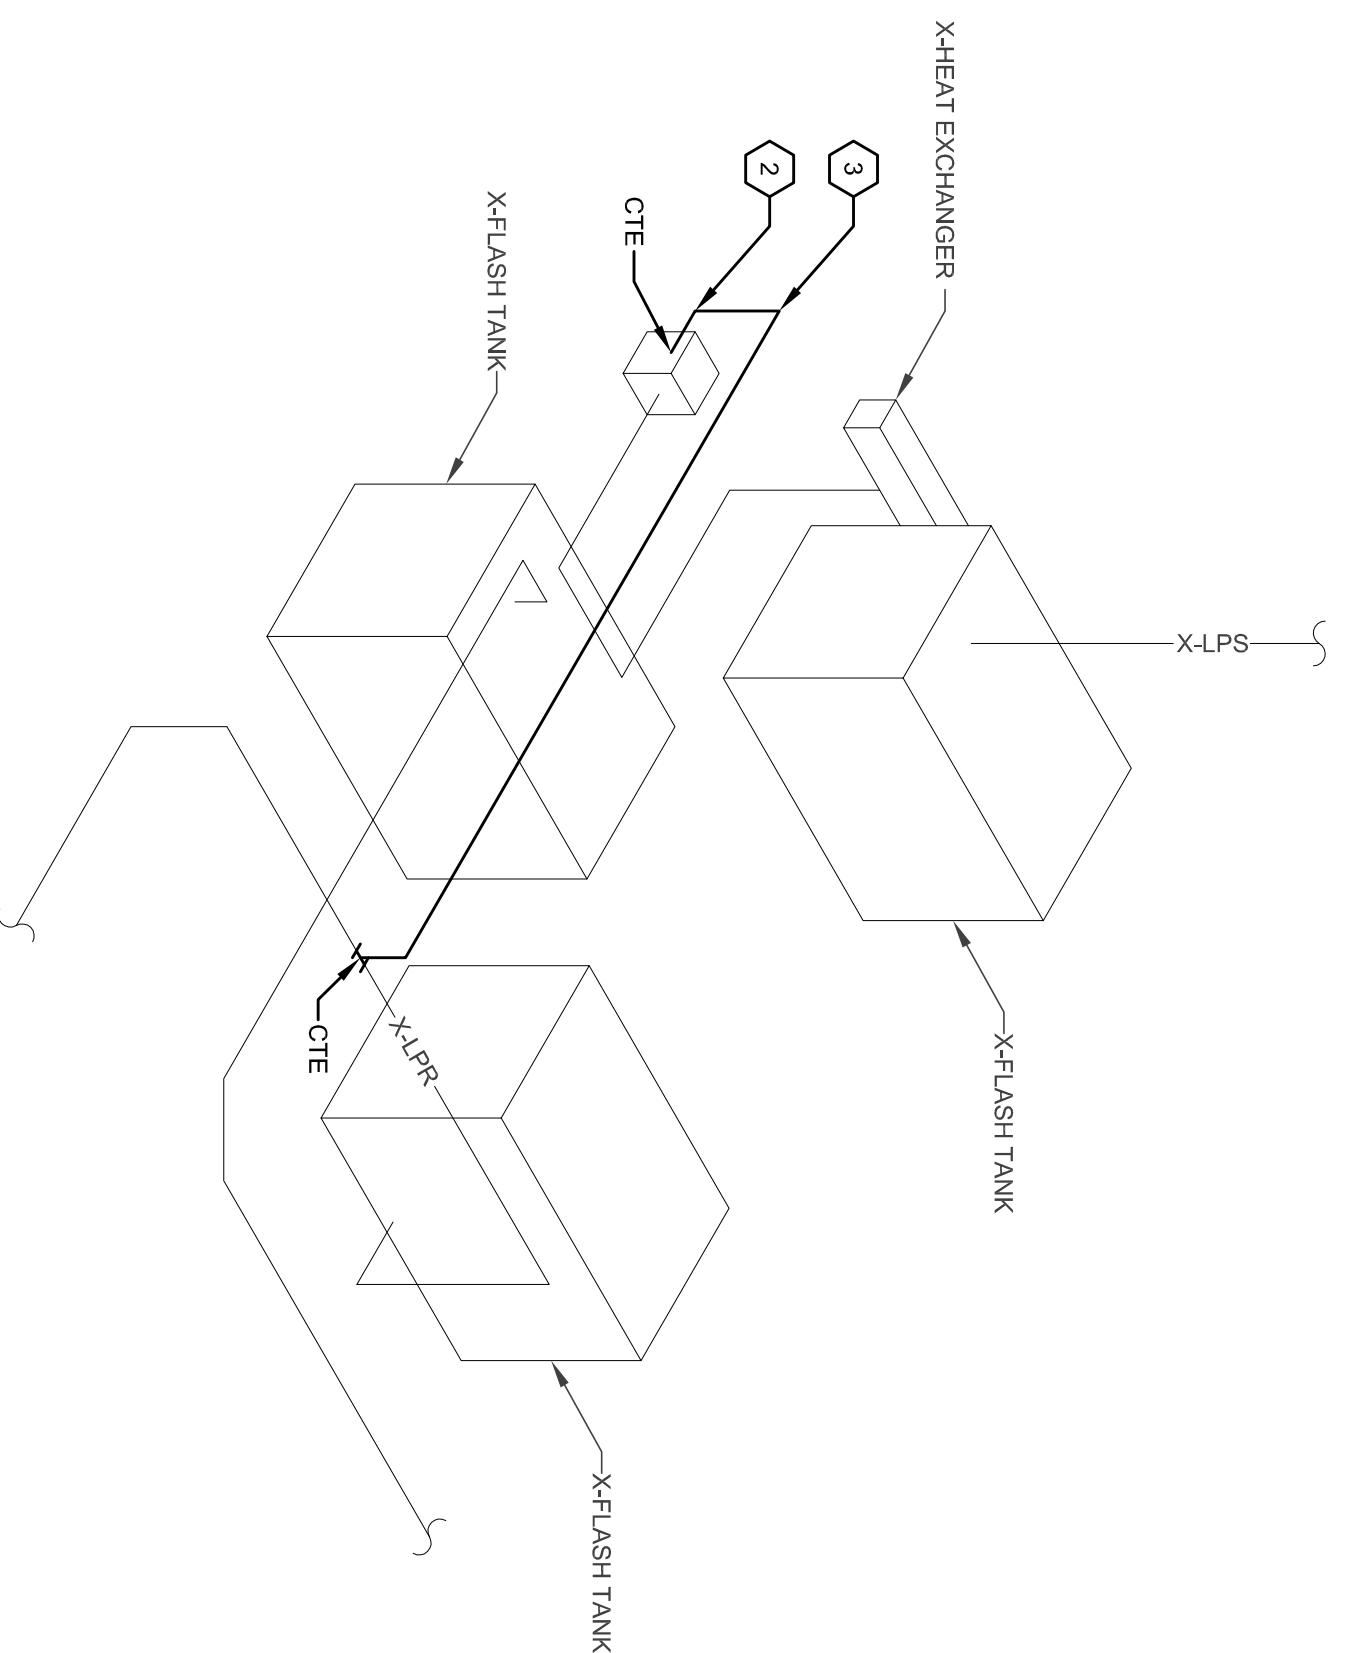


BASEMENT DETAIL 2 - NEW WORK PLAN AREA 1


CODED NOTES:

1. REMOVE CONDENSATE LINE BACK FROM TRAP TO EXISTING MAIN.
2. INSTALL NEW CONDENSATE PIPING TO EXISTING CONDENSATE RETURN LINE.
3. NEW CONDENSATE RETURN LINE TO BE INSTALLED UNDER EXISTING HEAT EXCHANGER.

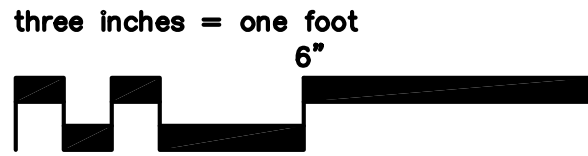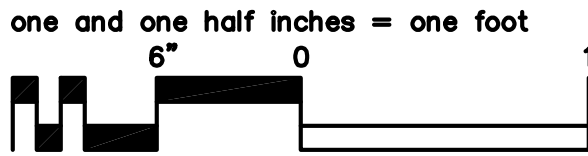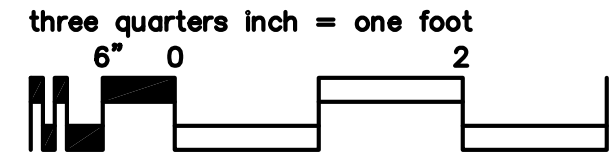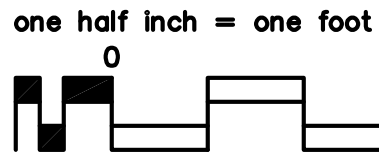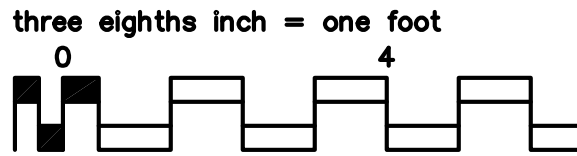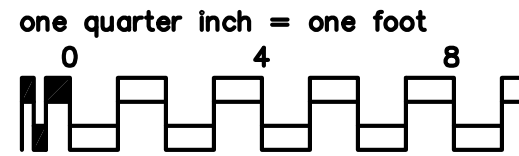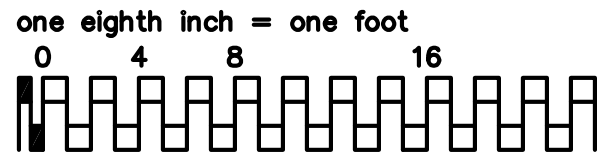

CONSULTANTS:	
	FREDRICK, FREDRICK & HELLER ARCHITECTS 672 EAST NOVALEEN ROAD BROADVIEW HTS., OHIO 44147 P.O. BOX 100 P.O. (440) 486-9890
FINAL CD SUBMISSION	12-21-12
85% SUBMISSION	11-30-12
CD SUBMISSION	11-05-12
REVISIONS	DWG

[illegible]

Drawing Title BASEMENT STEAM/CONDENSATE PIPING DETAILS		Project Title STEAM TRAP MONITORING, INSULATION AND PIPING UPGRADES		Project Number 54-12-2-15
Approved: Project Director		Location VAMC - WADE PARK		Drawing Number 4-02
Date 12-21-12	Checked WFW	Drawn JMF	Building Number 1	
<div>  Department of Veterans Affairs </div>				