



PENTHOUSE KEY PLAN
SCALE: N.T.S.

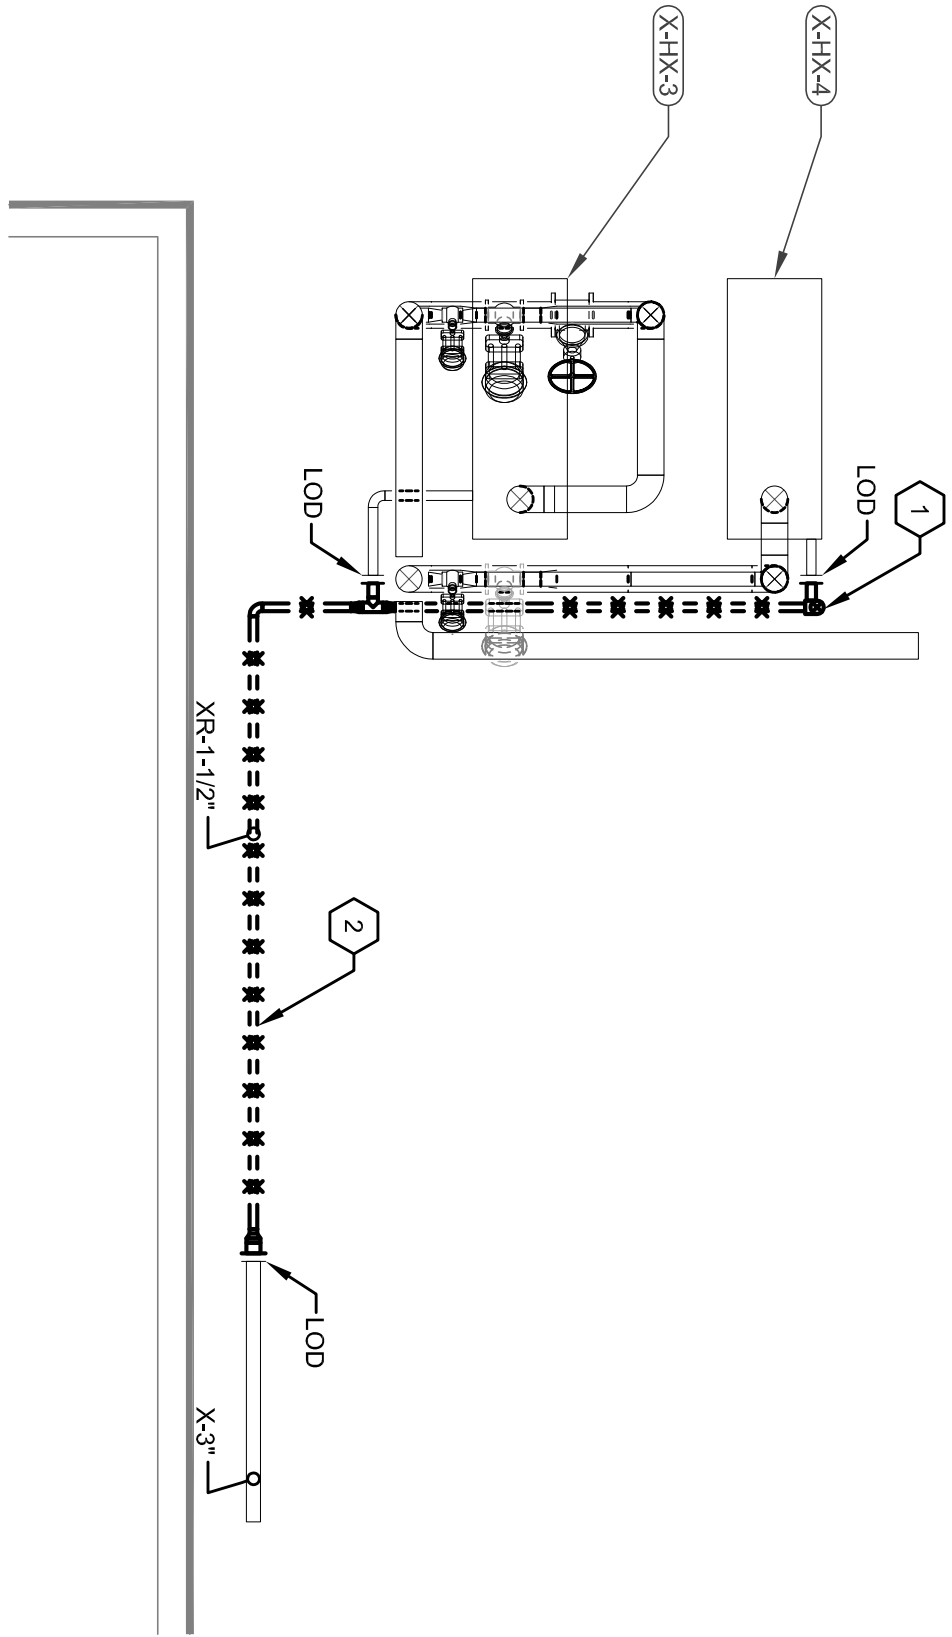

PENTHOUSE DETAIL 1 - DEMOLITION PLAN - AREA 4
SCALE: 1/4" = 1'-0"
MECHANICAL PENTHOUSE PF-104
1

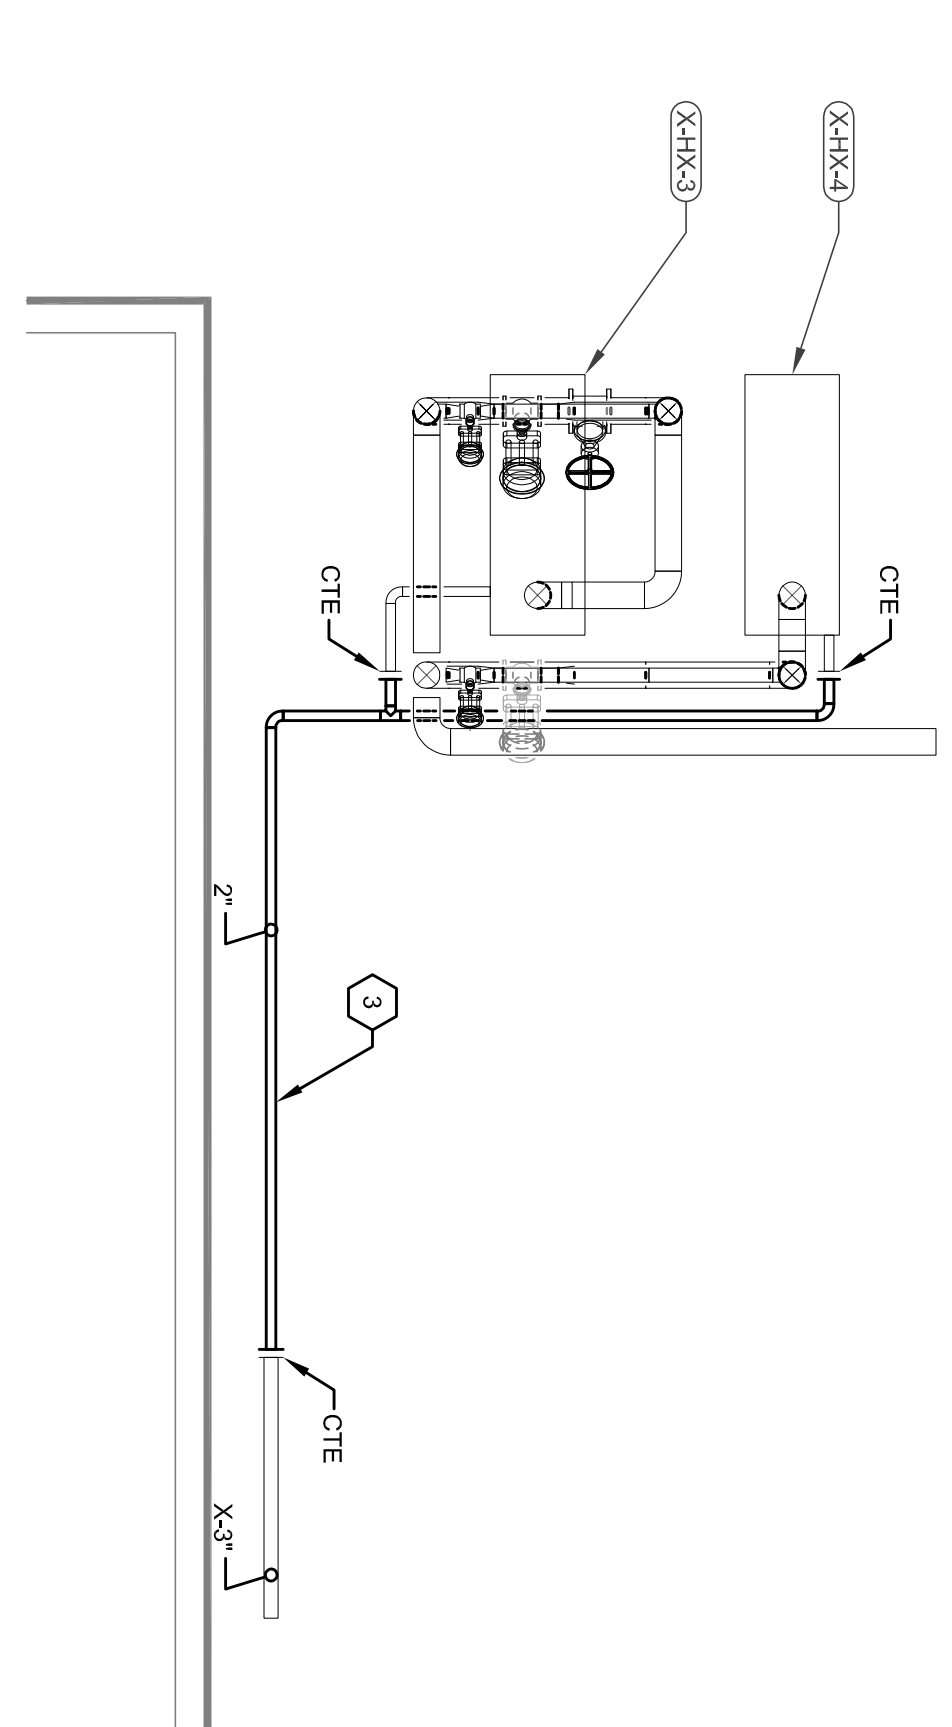









PENTHOUSE DETAIL 2 - NEW WORK PLAN - AREA 4
SCALE: 1/4" = 1'-0"
MECHANICAL PENTHOUSE PF-104
2

CODED NOTES:

- 1 REMOVE EXISTING MEDIUM PRESSURE CONDENSATE RETURN RISER BACK TO MAIN AND CAP.
- 2 REMOVE EXISTING LOW PRESSURE CONDENSATE RETURN LINE BACK TO FLASH TANK.
- 3 INSTALL NEW 2" LOW PRESSURE CONDENSATE RETURN TO FLASH TANK.


NOTES:

1. REFER TO DRAWING 3-PH-4 FOR OVERALL PLAN VIEW.

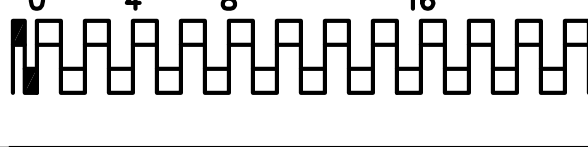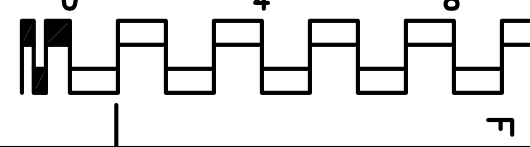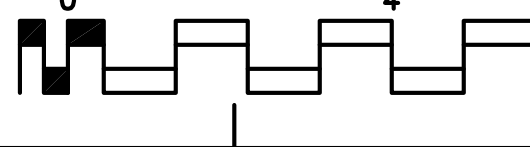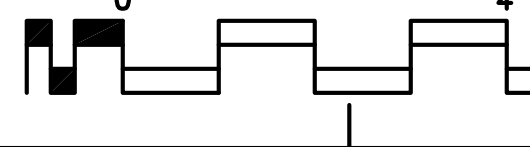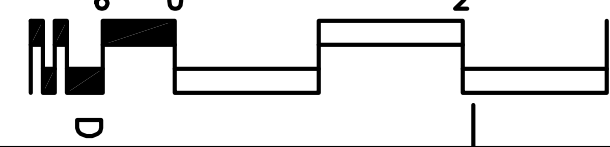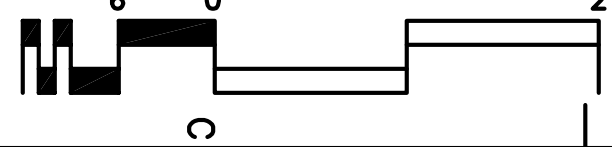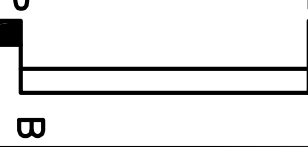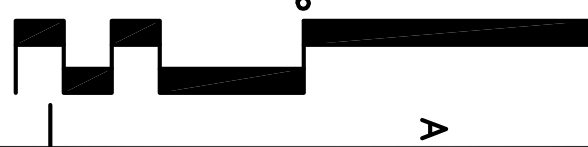

CONSULTANTS:

FREDRICK, FREDRICK & HELLER
ARCHITECTS
672 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL (440) 546-2888
FAX (440) 546-2888

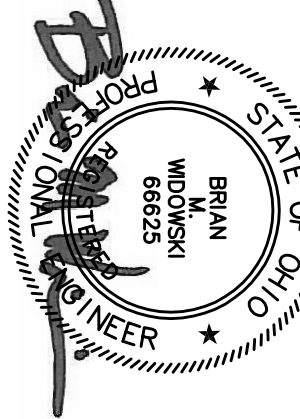

ARCHITECT:

Drawing Title
STEAM/CONDENSATE PIPING
DETAILS

Approved: Project Director

Project Title
STEAM TRAP MONITORING,
INSULATION AND PIPING
UPGRADES

Location
VAMC - WADE PARK

Date
12-21-12

Checked
WFM

Drawn
JMF

Project Number
541-12-115

Building Number
1

Drawing Number
4-07

Office of
Facilities
Management

