



BASEMENT DETAIL 1 - DEMOLITION PLAN AREA 5
NOT TO SCALE ROOM BA109 **1**

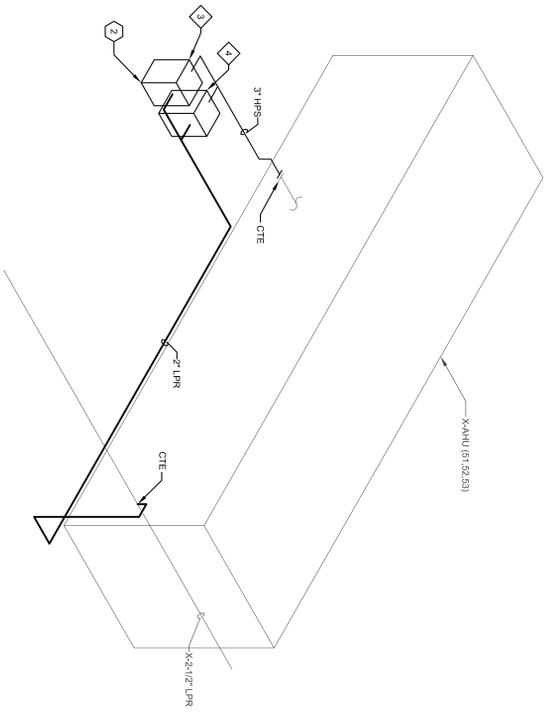


BASEMENT DETAIL 2 - NEW WORK PLAN AREA 5
NOT TO SCALE ROOM BA109 **2**

- CODED NOTES:**
- ① REMOVE EXISTING STEAM TRAPS COMPLETE.
 - ② INSTALL NEW STEAM TRAP/PUMP AND ASSOCIATED PIPING. CONNECT PIPING TO EXISTING CONDENSATE RISER. SEE DETAIL 3 ON SHEET 100.
 - ③ REMOVE EXISTING CONDENSATE PIPING AS SHOWN.

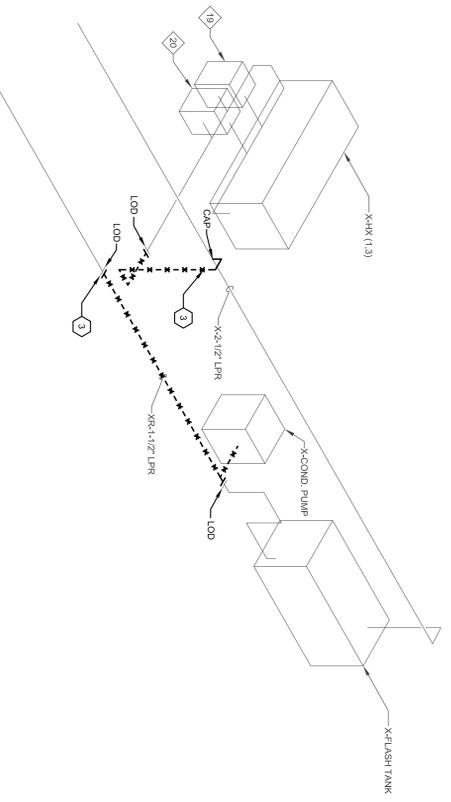

BASEMENT DETAIL 3 - DEMOLITION PLAN AREA 5
NOT TO SCALE ROOM BA109 **3**

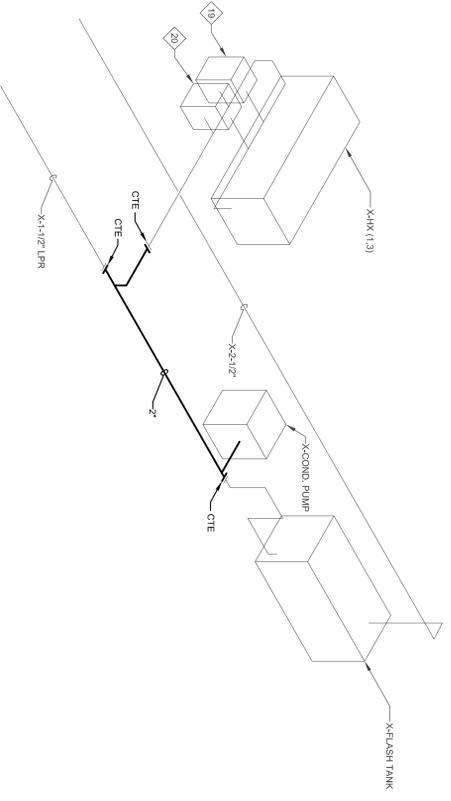

BASEMENT DETAIL 4 - NEW WORK PLAN AREA 5
NOT TO SCALE ROOM BA109 **4**

Revisions:

Date	Description
11-16-12	65% SUBMISSION
11-30-12	95% SUBMISSION
12-21-12	FINAL CD-SUBMISSION

CONSULTANTS:

FREDRICK, FREDRICK & HELLER
 672 EAST ROUALTON ROAD
 BROADVIEW HTS., OHIO 44147
 Tel: (440) 546-2666
 Fax: (440) 546-2666

ARCHITECT:

STEAM TRAP MONITORING, INSULATION AND PIPING UPGRADES
VAMC - WADE PARK

Drawing Title
BASEMENT STEAM/CONDENSATE PIPING DETAILS

Approved: Project Director

Project Title
STEAM TRAP MONITORING, INSULATION AND PIPING UPGRADES

Location: **VAMC - WADE PARK**

Date: 12-21-12

Checked: WPM
 Drawn: JMF

Project Number
 541-12-115

Building Number
 1

Drawing Number
 4-05

Office of Facilities Management
 Department of Veterans Affairs