

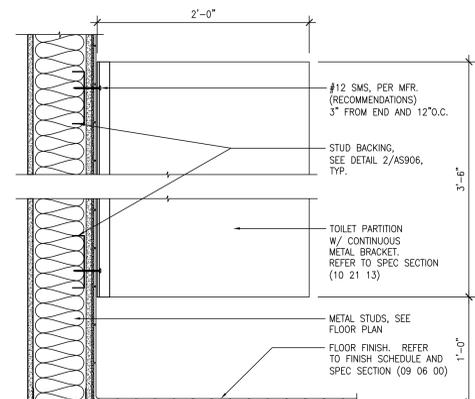
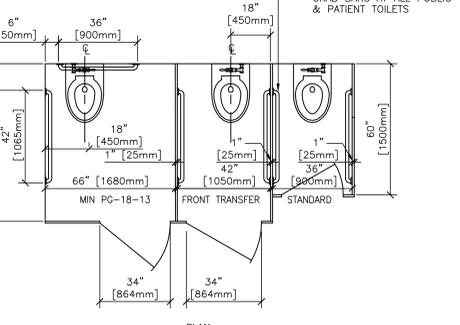



three inches = one foot  
 one and one half inches = one foot  
 one inch = one foot  
 three quarters inch = one foot  
 one half inch = one foot  
 three eighths inch = one foot  
 one quarter inch = one foot  
 one eighth inch = one foot

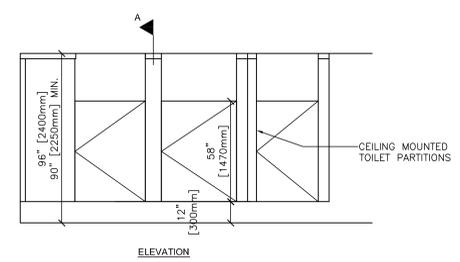


18 TOILET PARTITION AT URINAL  
 1 1/2" = 1'-0"

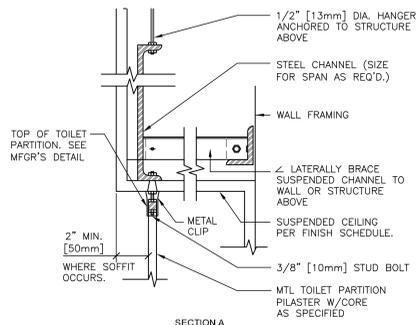


17 TOILET STALL DETAIL  
 N.T.S.

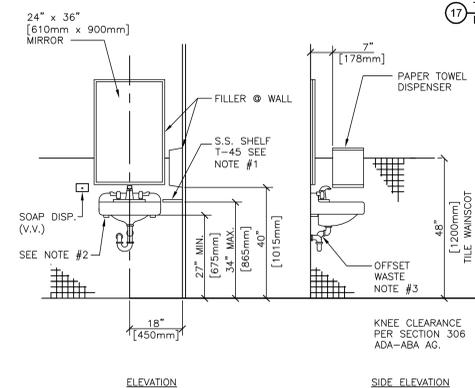


15 ACCESSIBLE LAVATORY  
 N.T.S.

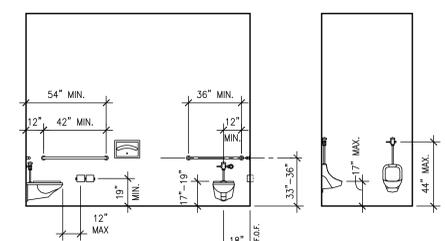


16 TYPICAL MOUNTING DETAILS  
 N.T.S.

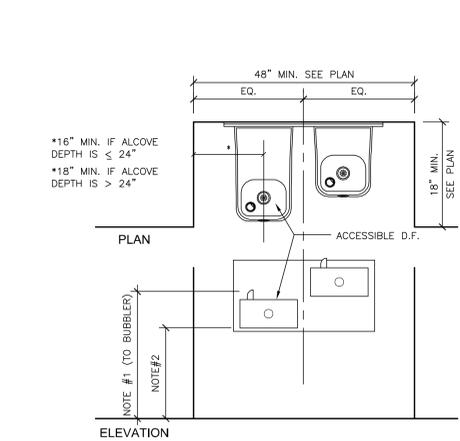


13 ACCESSIBLE DRINKING FOUNTAIN DETAIL  
 N.T.S.

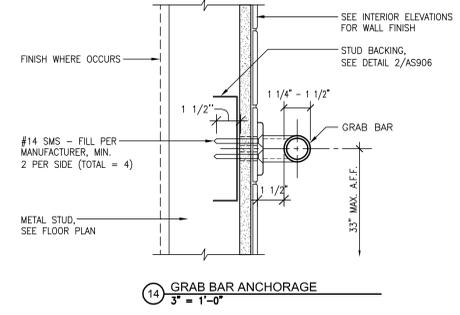


14 GRAB BAR ANCHORAGE  
 3\"/>

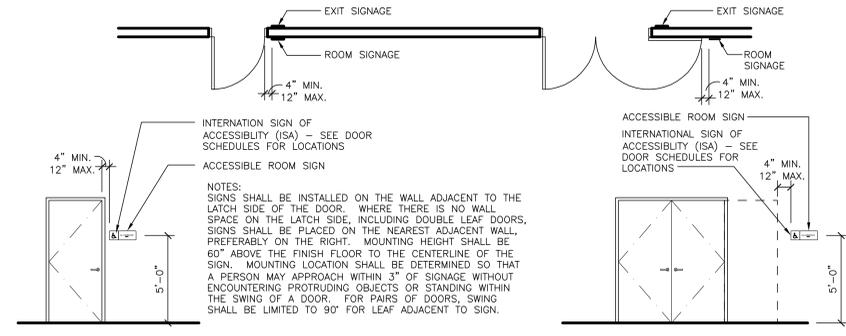


12 WALL MOUNTED DOOR SIGNAGE LOCATIONS  
 N.T.S.

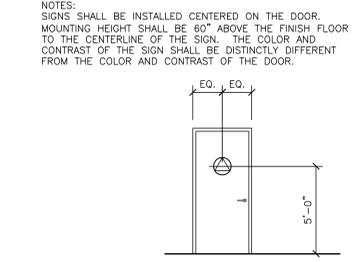


11 DOOR SIGNAGE LOCATION  
 N.T.S.

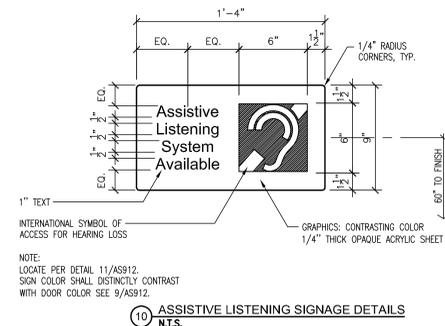

10 ASSISTIVE LISTENING SIGNAGE DETAILS  
 N.T.S.

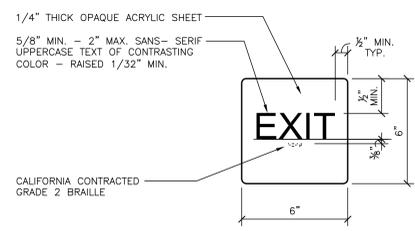

8 EXIT SIGNAGE  
 3\"/>

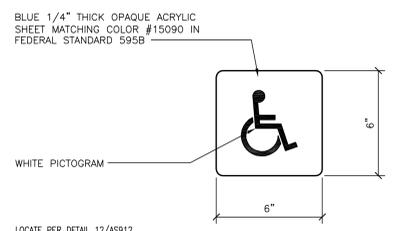

3 ACCESSIBLE ENTRANCE SIGNAGE  
 3\"/>

1. SHELF IF IN EQUIPMENT LIST 7610; SEE DETAIL 10 28 00-4
2. LAVATORY, WITH WRIST OR SENSOR CONTROL FAUCET
3. INSULATE HOT SUPPLY AND WASTE.

- ACCESSIBLE MOUNTING HEIGHTS:  
 NOTE #1: 36" MAX.  
 NOTE #2: 27" MIN. CLR.  
 ONE ACCESSIBLE FOUNTAIN AND ONE STANDARD FOUNTAIN AT ALL DOUBLE DRINKING FOUNTAIN LOCATIONS. REFER TO PLUMBING DRAWINGS FOR TYPE.

- FINISH:  
 CHARACTERS, SYMBOLS, PICTOGRAMS AND THEIR BACKGROUNDS SHALL HAVE A NON-GLARE FINISH, SUCH AS MATTE, SATIN OR EGGSHELL.
- CONTRAST:  
 CHARACTERS, SYMBOLS AND PICTOGRAMS SHALL CONTRAST WITH THEIR BACKGROUND, EITHER LIGHT CHARACTERS, SYMBOLS AND PICTOGRAMS ON A DARK BACKGROUND OR DARK CHARACTERS, SYMBOLS AND PICTOGRAMS ON A LIGHT BACKGROUND. A CONTRAST BETWEEN THE COLOR OF THE BACKGROUND AND THE COLOR OF THE CHARACTERS, SYMBOLS AND PICTOGRAMS OF AT LEAST 70% BASED ON THE LIGHT REFLECTANCE VALUE IS RECOMMENDED. A CONTRAST BETWEEN THE BACKGROUND COLOR OF THE DOOR MOUNTED TOILET ROOM SIGN AND THE COLOR OF THE DOOR OF AT LEAST 70% BASED ON THE LIGHT REFLECTANCE VALUE IS RECOMMENDED.
- TEXT:  
 LETTERS AND NUMBERS SHALL HAVE A WIDTH TO HEIGHT RATIO BETWEEN 3:5 AND 1:1 AND A STROKE WIDTH TO HEIGHT RATIO BETWEEN 1:5 AND 1:10. LETTERS AND NUMBERS ON SIGNS SHALL BE RAISED 1/32" MINIMUM AND SHALL BE SANS-SERIF UPPERCASE CHARACTERS ACCOMPANIED BY GRADE 2 BRAILLE. RAISED CHARACTERS OR SYMBOLS SHALL BE A MINIMUM OF 5/8" HIGH AND A MAXIMUM OF 2" HIGH. THE MINIMUM AND MAXIMUM HEIGHT IS MEASURED USING AN UPPERCASE X. VERIFY TEXT WITH DOOR SCHEDULE.
- BRAILLE SYMBOLS:  
 CALIFORNIA CONTRACTED GRADE 2 BRAILLE SHALL BE USED WHEREVER BRAILLE SYMBOLS ARE REQUIRED BY EITHER THE CALIFORNIA BUILDING CODE OR THE AMERICANS WITH DISABILITIES ACT ACCESSIBILITY GUIDELINES. BRAILLE SHALL BE LOCATED A MIN. OF 3/8" AND 1/2" MAX. FROM TACTILE CHARACTERS. BRAILLE DOTS SHALL BE 1/10" ON CENTERS IN EACH CELL WITH 2/10" SPACE BETWEEN CELLS. BRAILLE DOTS SHALL BE RAISED 1/40" MINIMUM ABOVE THE BACKGROUND. BRAILLE DOTS TO HAVE DOMED TOPS.


9 SIGN COLORS, FINISH, TEXT, AND BRAILLE NOTES  
 N.T.S.

LOCATE PER DETAIL 12/AS912. PROVIDE SIGN AT INTERIOR OF EXIT DOORS PER SCHEDULE. REFER TO SPEC. SECTION 10 14 00 FOR ADDITIONAL INFORMATION FOR ADDITIONAL TEXT, BRAILLE & COLOR NOTES SEE 9/AS912.

LOCATE PER DETAIL 12/AS912. REFER TO SPEC. SECTION 10 14 00 FOR ADDITIONAL INFORMATION PROVIDE SIGN AT ALL ACCESSIBLE ENTRANCE DOORS U.N.O. FOR PICTOGRAM STANDARDS SEE DETAIL 4/AS912. FOR ADDITIONAL TEXT, BRAILLE & COLOR NOTES SEE 9/AS912.

Revisions	Date

CONSULTANTS:



**ARCHITECT/ENGINEERS:**

**HMC Architects**

1827 E. Fir Avenue, Studio 103 / Fresno, CA 93720  
 T 559 322 2444 / www.hmcarchitects.com

Drawing Title <b>SPECIALTY DETAILS</b>
Approved Project Director

Project Title <b>BUILDING 24 SEISMIC CORRECTION AND ADDITION</b>	Project Number <b>570-215</b>
Location <b>VAMC FRESNO, CA</b>	Building Number <b>24</b>
Date <b>March 12, 2013</b>	Drawn <b>CLO</b>
Checked <b>BB</b>	Dwg. 97 of 180

Office of  
 Construction  
 and Facilities  
 Management

Department of  
 Veterans Affairs