



- (1) (E) AH-6 TO REMAIN. REMOVE INDIVIDUAL SUPPLY FAN MOTOR. RETURN FAN MOTOR WITH ALL ASSOCIATED BELTS AND SHEAVES. ALL PNEUMATIC CONTROLS SHALL ALSO BE REMOVED.
- (2) REMOVE (E) VAV BOX WITH REHEAT COIL.
- (3) REMOVE (E) VAV BOX.
- (4) REMOVE (E) CEILING GRILLE.
- (5) REMOVE (E) DUCT SHOWN HATCHED. ALL DUCTWORK TO REMAIN SHALL BE CLEANED PER SPEC. SECT. 23 31 00.
- (6) (E) AH-1 TO REMAIN. REMOVE INDIVIDUAL SUPPLY FAN MOTOR. RETURN FAN MOTOR WITH ALL ASSOCIATED BELTS AND SHEAVES. ALL PNEUMATIC CONTROLS SHALL ALSO BE REMOVED. ADD SEISMIC BRACING TO MAIN DUCTWORK.
- (7) (E) EXHAUST FAN ON ROOF TO REMAIN.
- (8) REMOVE (E) SIDEWALL GRILLE. PATCH WALL WHERE (E) DUCTWORK IS BEING REMOVED AND GAP DUCT AT BRANCH TAKE-OFF.

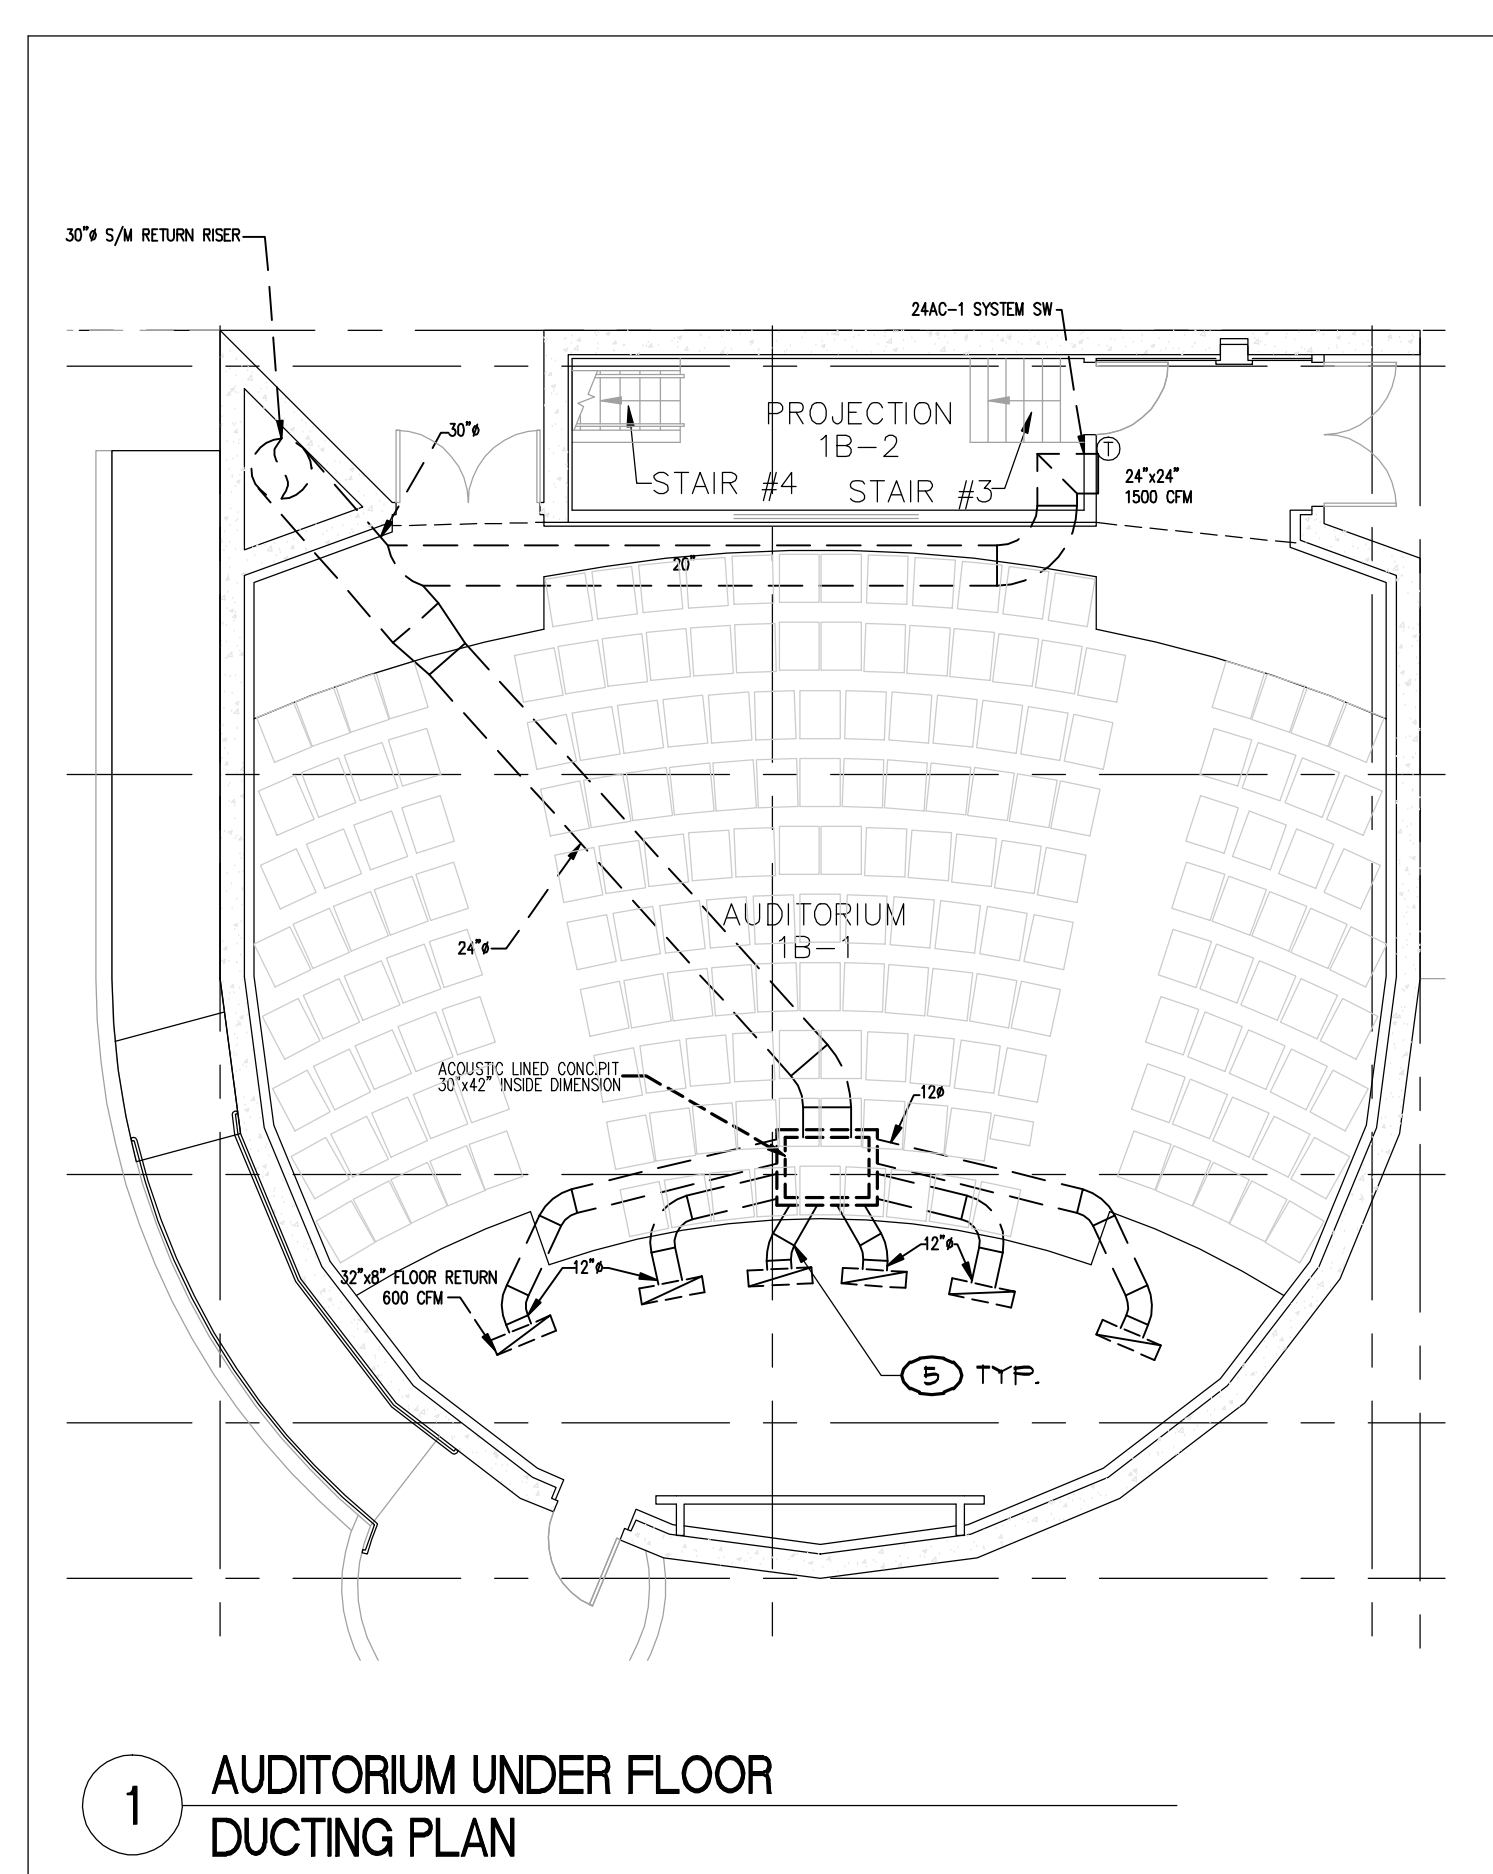

2 AUDITORIUM UNDER FLOOR DUCTING PLAN
SCALE: 1/4" = 1'-0"



<p>CONSULTANTS:</p> <div style="display: flex; align-items: center;"> <div> <p>LP Consulting Engineers, Inc.</p> <p>885 W. Ashlan Ave, Suite 101 Clovis, CA 93612 p 559-348-2130 - f 559-348-2131 www.lpengineers.com Job #: 10-1088</p> </div> </div>		<p>ARCHITECT/ENGINEERS:</p> <div style="display: flex; align-items: center;"> <div> <p>HMC Architects</p> <p>1827 E. Fir Avenue, Studio 103 / Fresno, CA 93720 T 559 322 2444 / www.hmcarchitects.com</p> </div> </div>		<p>Drawing Title FIRST FLOOR MECHANICAL DEMOLITION PLAN</p> <p>Approved: Project Director</p>		<p>Project Number BUILDING 24 SEISMIC CORRECTION AND ADDITION</p> <p>Location VAMC FRESNO, CA</p> <div style="display: flex;"> <div style="margin-right: 10px;"> <p>Date March 12, 2013</p> </div> <div> <p>Checked K.K.</p> </div> <div> <p>Drawn D.N.</p> </div> </div>		<p>Project Number 570-215</p> <p>Building Number 24</p> <p>Drawing Number MD101 Dwg. 132 of 180</p>		<p style="text-align: center;">Office of Construction and Facilities Management</p> <div style="display: flex; align-items: center; justify-content: center;"> <p>Department of Veterans Affairs</p> </div>	
---	--	--	--	---	--	---	--	---	--	---	--