KEY NOTES

1. (E) FUME HOOD TO REMAIN.
2. REMOVE (E) VAV BOX WITH REHEAT COIL
3. REMOVE (E) VAV BOX.
4. REMOVE (E) CEILING GRILLE.
5. REMOVE (E) DUCT SHOWN HATCHED. ALL DUCTWORK TO REMAIN SHALL BE CLEANED PER SPEC. SECT. 23 31 00.
6. (E) VAV BOX TO REMAIN.
7. (E) MAGNEHELIC PRESSURE GAGE AND SENSOR TUBING IN DUCT TO REMAIN. THIS IS TYPICAL AT ALL RETURN AND EXHAUST DUCT PENETRATIONS THRU CORRIDOR WALL. NOT ALL ARE SHOWN ON PLAN.

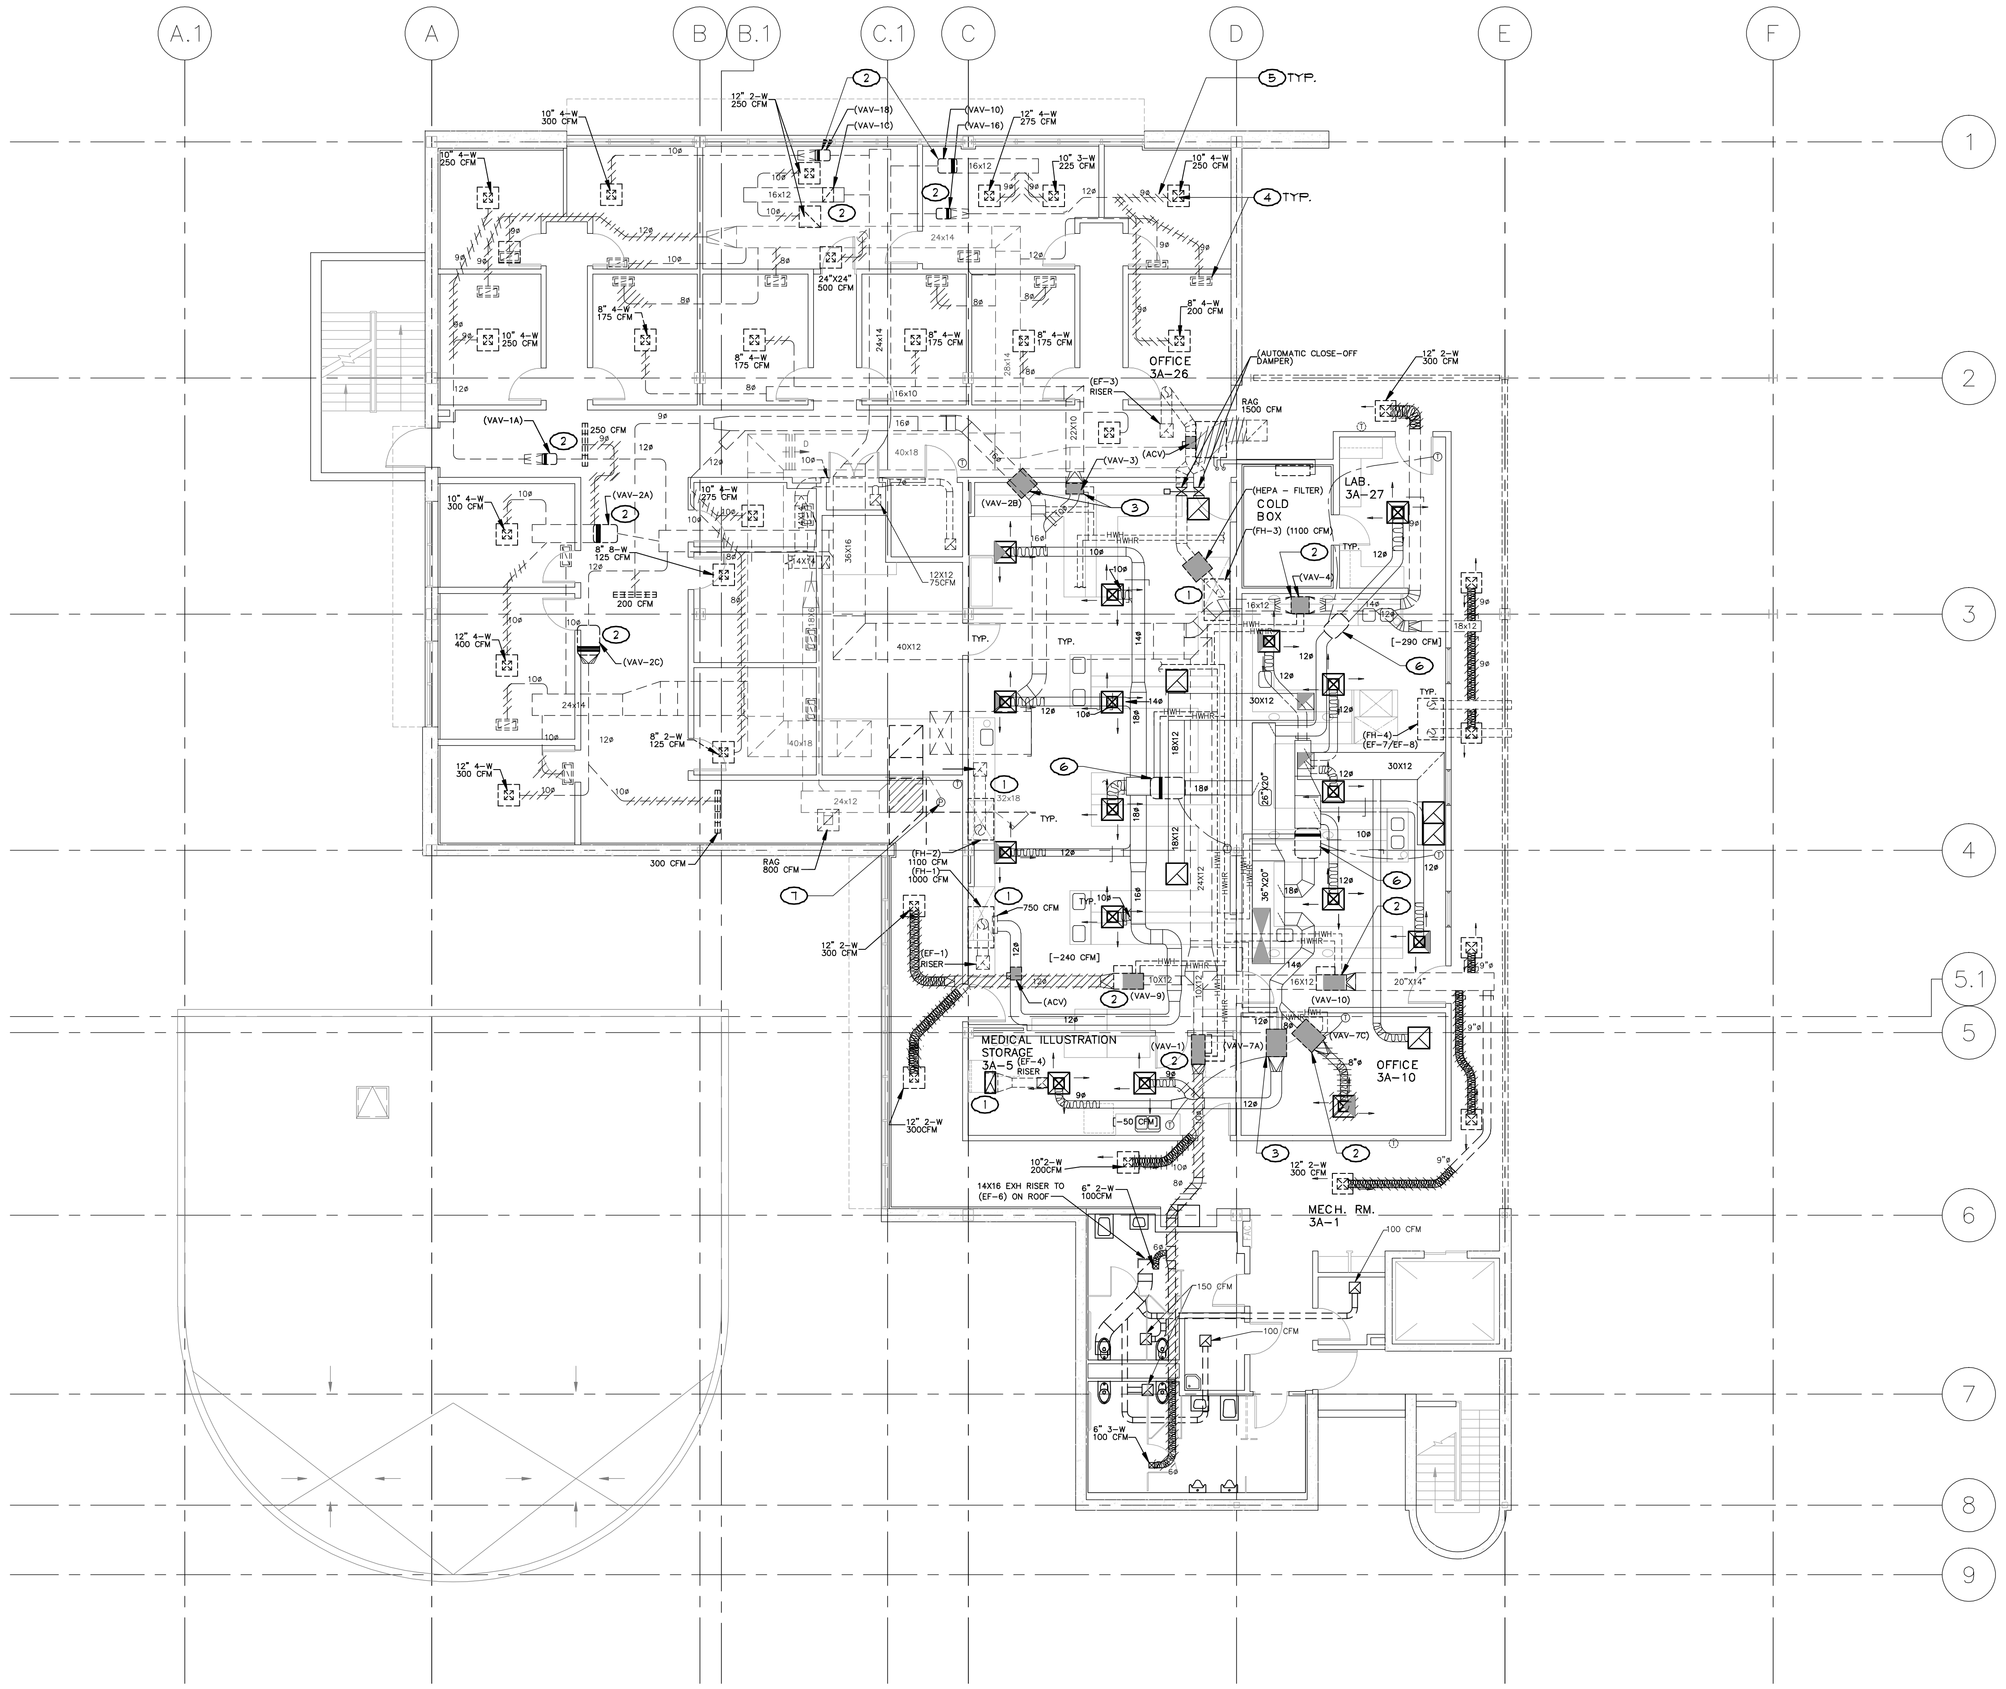

1 THIRD FLOOR MECHANICAL DEMOLITION PLAN
SCALE: 1/8" = 1'-0"

Revisions:	Date

CONSULTANTS:

REGISTERED PROFESSIONAL ENGINEER — GARRETT M. LENGYEL — NO. 33380 — MECH. 6-30-14 — MECHANICAL — STATE OF CALIFORNIA

LP Consulting Engineers, Inc.
895 W. Ashlan Ave, Suite 101 Clovis, CA 93612
p 559-348-2130 - f 559-348-2131
www.lpengineers.com
Job #: 10-1086

LICENSED ARCHITECT — STEVEN M. GRUBB — No. C-16697 — REN. 07-31-15 — STATE OF CALIFORNIA

ARCHITECT/ENGINEERS:

HMC Architects
1827 E. Fir Avenue, Studio 103 / Fresno, CA 93720
T 559 322 2444 / www.hmcarchitects.com

Drawing Title: THIRD FLOOR MECHANICAL DEMOLITION PLAN

Approved: Project Director

Project Title: BUILDING 24 SEISMIC CORRECTION AND ADDITION

Location: VAMC FRESNO, CA

Date: March 12, 2013 | Checked: K.K. | Drawn: D.N.

Project Number: 570-215

Building Number: 24

Drawing Number: MD103
Dwg. 134 of 180

Office of Construction and Facilities Management
Department of Veterans Affairs

VA FORM 08-6231

V:\2010\10-1086 VA Bldg 24 Seismic\Drawings\10-1086 MD103.dwg, 3/26/2013 8:51:38 AM, Adobe PDF v9.0 (Letter), Dwg Title: 1